

TRANSMITTAL OF MEETING HANDOUT MATERIALS FOR IMMEDIATE PLACEMENT IN THE PUBLIC DOMAIN

This form is to be filled out (typed or hand-printed) by the person who announced the meeting (i.e., the person who issued the meeting notice). The completed form, and the attached copy of meeting handout materials, will be sent to the Document Control Desk on the same day of the meeting; under no circumstances will this be done later than the working day after the meeting. Do not include proprietary materials.

DATE OF MEETING

1/12/00

The attached document(s), which was/were handed out in this meeting, is/are to be placed in the public domain as soon as possible. The minutes of the meeting will be issued in the near future. Following are administrative details regarding this meeting:

Docket Number(s) 50-413, 50-414, 50-369, 50-370
50-338, 50-339, 50-280, 50-281

Plant/Facility Name SURRY, NORTH ANNA
MC GUIRE, CATAWBA

TAC Number(s) (if available) /

Reference Meeting Notice 1/3/00

Purpose of Meeting (copy from meeting notice) DUKE HAS EXPRESSED INTEREST IN SUBMITTING CONCURRENT LICENSE RENEWAL APPLICATIONS FOR ITS MC GUIRE & CATAWBA NUCLEAR STATIONS. SIMILARLY, VEPCO HAS EXPRESSED INTEREST IN SUBMITTING CONCURRENT APPLICATIONS FOR ITS SURRY & NORTH ANNA POWER STATIONS. THE JOINT MEETING WITH DUKE ENERGY AND VIRGINIA POWER IS TO DISCUSS THE FORM OF THE APPLICATIONS WITH THE GOAL OF IDENTIFYING EFFICIENCIES BOTH FOR THE *

NAME OF PERSON WHO ISSUED MEETING NOTICE

STEPHEN S. KOENICK

TITLE

PROJ. MNGR.

OFFICE

NRR

DIVISION

DRIP

BRANCH

RLSB

Distribution of this form and attachments:

Docket File/Central File
PUBLIC

* APPLICANTS' PREPARATION AND THE NRC STAFF'S REVIEW OF THE RENEWAL APPLICATIONS.



Dual Application Format For License Renewal

Duke and Virginia Power

January 12, 2000

Purpose of Meeting

To Discuss:

- **Most efficient manner to present two applications that will minimize the NRC's review effort**
- **Use of electronic submittals**
- **Minor changes in the current NRC/NEI LRA Format**




Main Objectives For Dual Applications

- **Minimize NRC review efforts by highlighting or consolidating common sections**
- **Maintain consistency with the basic format agreed upon between the NRC and NEI**
- **Make it easy for each station to review their own application**

Options


#1 One Set of Binders

One set with sections & tables noted as common or station specific (i.e., North Anna/Surry)

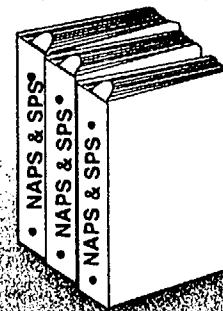


#2 Two Sets of Binders

One set for each station with common information highlighted

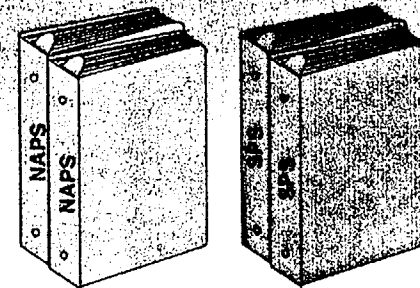


#3 Three Sets of Binders

One set for each station with common information in a third set

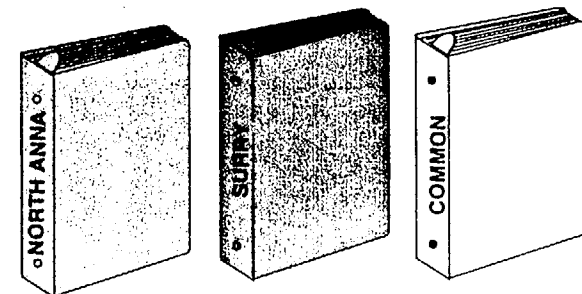

Option Comparison

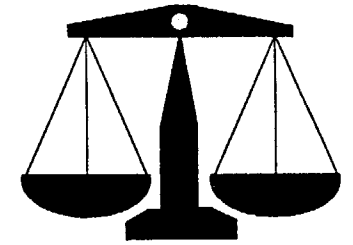


Advantages	#1	#2	#3
1. NRC only needs to review common information once	X	X	X
2. Facilitates NRC development of individual site SERs		X	X
3. Easiest for the Applicant to format & prepare		X	X
4. Easiest for each station to review their own application		X	
5. Easiest for the NRC and other organizations to review		X	
	1	5	3

Recommendation

Option #2

**One set of binders for each station
with common information highlighted**

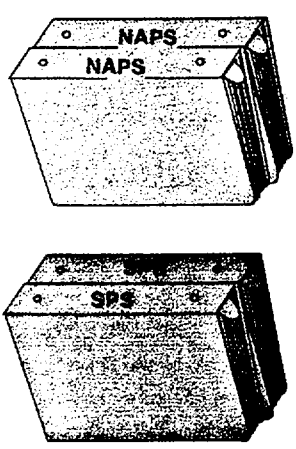

Common Information for Option 2

- 1. Will be included in both applications**
- 2. Will have consistent wording (ensured by using Framemaker)**
- 3. Will be highlighted by shading**
 - Works well for both hardcopy and electronic submittals**

Common Information

Example

Review SPS

Steam and Power Conversion Systems

Handout

Submittal to NRC

- 1. Original signed cover letter**
- 2. One hardcopy application for each site**
- 3. Remaining application copies on CD in PDF**

- **Cover Letter**
- **Application for each site**
- **UFSAR for each site (*)**
- **LR Boundary Drawings (*)**

*** - Not included in the hardcopy application submittal**



Electronic Submittal

Hypertext Links to:

- **UFSAR Sections**
- **LR Boundary Drawings**
- **Other portions of the Application
(Sections, Appendices, Exhibits)**



Proposed License Renewal Application Format

- **General Information [Part 54.17 & 19]**
- **Exhibit A - Technical Information [Part 54.21 (a)-(c)]**
 - **1.0 Introduction & Site Description**
 - **2.0 Structures & Components Subject to AMR**
 - **3.0 Aging Management Review Results**
 - **4.0 Time Limited Aging Analysis**
 - **Appendix A - Aging Management Activities**
 - **Appendix B - Commodity Groups**
 - **Appendix C - CLB Changes**
- **Exhibit B - UFSAR Supplement [Part 54.21(d)]**
- **Exhibit C - Technical Specifications [Part 54.22]**
- **Exhibit D - Environmental Information [Part 54.23]**

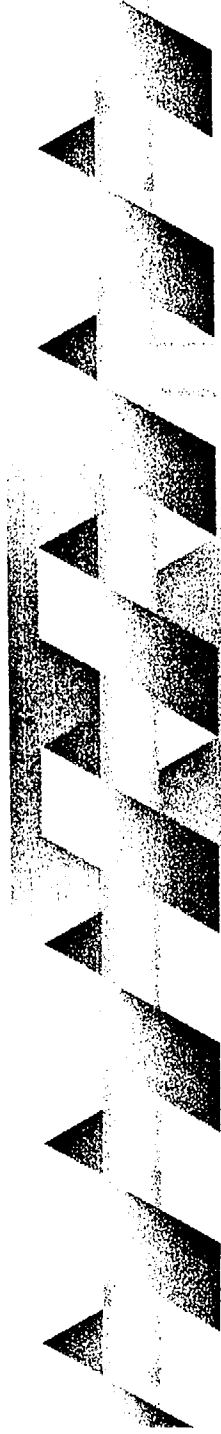



Exhibit A

Technical Information Discussion

Review Virginia Power

Table of Contents Handout

Questions & Issues

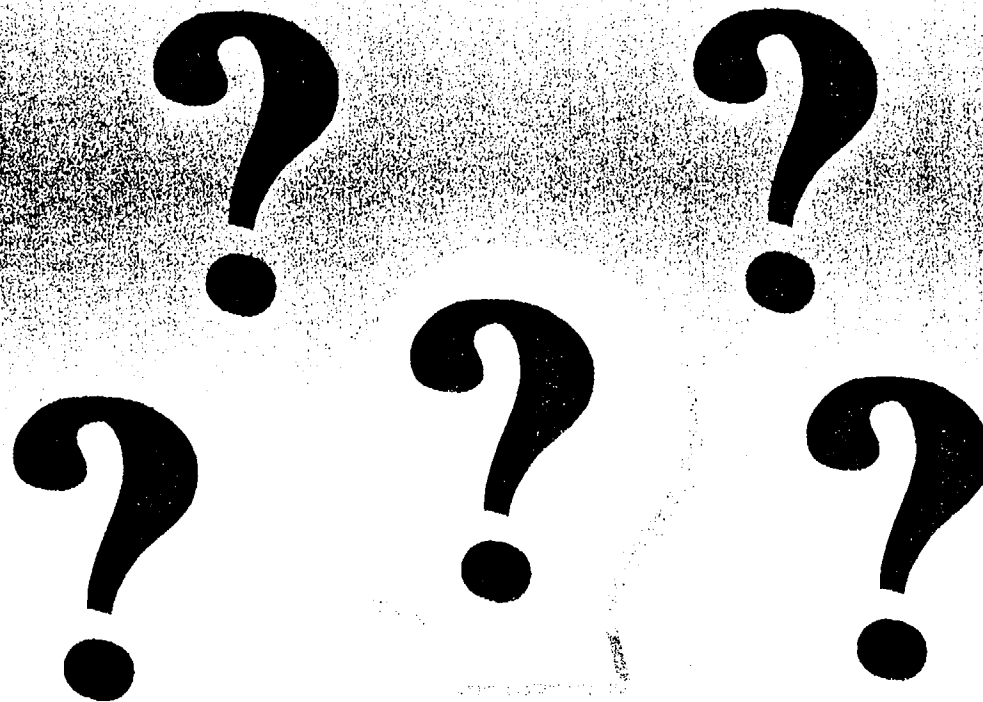

2.3.4 Steam and Power Conversion System

The following systems (internally grouped as secondary process systems) are addressed in this section:

- Feedwater System, which also includes the Auxiliary Feedwater System
- Condensate System
- Main Steam System
- Blowdown System
- Steam Generator Recirculation and Transfer System

2.3.4.1 Feedwater System

System Description

The feedwater system provides feedwater to the steam generators during normal operating conditions and the auxiliary feedwater system provides a source of feedwater to the steam generators during emergency conditions. The components/commodities of the feedwater system that have been evaluated to be within the scope of license renewal encompass the auxiliary feedwater system components and commodities.

The feedwater system is comprised of two main feedwater pumps and associated piping that supply heated feedwater to the steam generators for the safety function of maintaining the reactor heat sink. Water supplied to the steam generators absorbs heat transferred from the reactor coolant system and results in the production of steam, which is subsequently used to generate electricity. The feedwater system originates at the feedwater pump suction and ends at the steam generator feedwater nozzle.

The auxiliary feedwater system is comprised of three pumps; two of the pumps are motor-driven and one pump is steam driven. The steam driven pump has double the capacity of one motor-driven pump so it is capable of supplying the required auxiliary feedwater flow capacity upon loss of power. The auxiliary feedwater pumps are directly connected to the auxiliary feedwater system piping that ties into the main feed line for the steam generators.

The feedwater system (which includes the auxiliary feedwater system) interfaces with the following additional systems and components:

- condensate system
- main steam system
- steam generator (reactor coolant system)
- bearing cooling system
- extraction steam system
- secondary drain system
- reactor protection system

EXAMPLE

The portion of the feedwater system within the scope of license renewal extends from the main FW line isolation check valves to the steam generator nozzles.

UFSAR Reference

Additional details on the feedwater and auxiliary feedwater systems are provided in Section 10.3.5 of the UFSAR.

System Intended Functions

(Later).

Boundary Drawings

The license renewal boundary drawings used in developing the scope and boundaries for the feedwater system during the screening process are listed below:

11448-LRM-064B, SH. 1
11448-LRM-068A, SH. 1
11448-LRM-068A, SH. 3
11448-LRM-068A, SH. 4
11548-LRM-064B, SH. 1
11448-LRM-068A, SH. 1
11448-LRM-068A, SH. 3
11548-LRM-068A, SH. 4

Components/Commodities Subject to an AMR

The components/commodities in the feedwater system that are in-scope for license renewal and require an aging managing review are the flow elements, feedwater heat exchangers, instrument valve assemblies, feedwater pump casings, restricting orifices, strainers, valve bodies, and the feedwater piping indicated on the above boundary drawings.

2.3.4.2 Condensate System

System Description

The condensate system pumps take suction on the main condenser hotwell and increase the water pressure to a pressure suitable for the operation of the steam generator feedwater pumps. The condensate pump discharge is directed through feedwater heaters and drain coolers, which increases the temperature of the condensate, thereby increasing secondary plant efficiency. Water is provided to

EXAMPLE

numerous plant support systems and accepted from numerous systems and components. Most of these components, although important for plant operation, are not within the scope of license renewal. However, the piping, valves, water storage tank and make-up supply for the auxiliary feedwater system have a condensate system designation; these are within the scope of license renewal.

The Emergency Condensate Storage Tank is a missile protected tank that provides a source of emergency cooling water for use by the auxiliary feedwater system via individual lines to the three auxiliary feedwater pumps.

The condensate system interfaces with the following additional systems and components:

- feedwater system
- auxiliary feedwater system
- bearing cooling system
- extraction steam system
- secondary drain system

UFSAR Reference

Additional details of the condensate system are provided in Section 10.3.5 of the UFSAR.

System Intended Functions

(Later)

Boundary Drawings

The license renewal boundary drawings used in developing the scope and boundaries for the condensate system during the screening process are listed below:

11448-LRM-064B, SH. 1
11448-LRM-067A, SH.2
11448-LRM-068A, SH. 3
11448-LRM-068A, SH.4
11548-LRM-067A, SH.2
11548-LRM-068A, SH. 3
11548-LRM-068A, SH.4

EXAMPLE

Components/Commodities Subject to an AMR

The components/commodities in the condensate system that are in-scope for license renewal and require an aging managing review are valve bodies, the condensate tanks (accumulators), and the condensate piping indicated on the above boundary drawings:

2.3.4.3 Main Steam System

System Description

The main steam system transports steam from the steam generators to the main turbine for the production of electricity. During normal operation, the steam produced in the steam generators is also provided to the following via the three main steam lines:

The turbine driven auxiliary feedwater pump.

A manifold with five (5) code safety valves to relieve excessive main steam system pressure to the atmosphere.

One atmospheric relief valve or power-operated relief valve (PORV). The PORVs are used to help control plant heatup or cooldown.

Following a reactor trip or during accident conditions, the main steam system contains valves that provide isolation to prevent excessive cooldown and valves that provide for excessive energy removal from the reactor coolant system.

The main steam system interfaces with the following additional systems and components:

- extraction steam
- auxiliary steam
- main turbine
- electro-hydraulic control system
- feedwater system (Aux. Feedwater portion)

UFSAR Reference

Additional details of the main steam system are provided in Section 10.3.1 of the UFSAR.

System Intended Functions

(Later)

EXAMPLE

Boundary Drawings

The license renewal boundary drawings used in developing the scope and boundaries for the main steam system during the screening process are listed below:

11448-LRM-064A,SH. 1
11448-LRM-064A, SH. 2
11448-LRM-064A, SH. 3
11448-LRM-064A, SH.4
11548-LRM-064A,SH. 1
11548-LRM-064A, SH. 2
11548-LRM-064A, SH. 3
11548-LRM-064A, SH.4

Components/Commodities Subject to an AMR

The components/commodities in the main steam system that are in-scope for license renewal and require an aging managing review are accumulators, flow elements, instrument valve assemblies, steam traps, strainers, tubing, valve bodies, valve operators, and the main steam piping indicated on the above boundary drawings.

2.3.4.4 Blowdown System

System Description

The blowdown system removes particulate and dissolved impurities from the secondary side of the steam generators during startup, shutdown, and power operation, and maintains and controls steam generator water and chemical inventory during periods of wet lay-up.

A secondary purpose of the blowdown system is to chemically treat the blowdown water and return it to the condensate system.

The blowdown system consists of the blowdown cooling subsystem, the blowdown water treatment subsystem, and the recirculation and transfer subsystem. The portion of the blowdown system within the scope of license renewal includes the components from the connection to the steam generator to the outermost automatic containment isolation valves.

EXAMPLE

The blowdown system interfaces with the following additional systems and components:

- feedwater system
- steam generator
- condensate system
- secondary drain system

UFSAR Reference

Additional details on the blowdown system are provided in Sections 10.3.1.2 and 11.2.3.2 of the UFSAR.

System Intended Functions

(Later)

Boundary Drawings

The license renewal boundary drawings used in developing the scope and boundaries for the blowdown system during the screening process are listed below:

11448-LRM-124A, SH. 1
11448-LRM-124A, SH. 2
11448-LRM-124A, SH. 3
11548-LRM-124A, SH. 1
11548-LRM-124A, SH. 2
11548-LRM-124A, SH. 3

Components/Commodities Subject to an AMR

The components/commodities in the blowdown system that are in-scope for license renewal and require an aging managing review are flow elements, hoses, instrument valve assemblies, valve bodies, and the blowdown piping indicated on the above boundary drawings.

EXAMPLE

2.3.4.5 Steam Generator Recirculation and Transfer System

System Description

The recirculation and transfer system consists of recirculation and transfer pumps and recirculation coolers. The pumps are used to thoroughly mix and distribute the water in the steam generator during wet lay-up. The pumps draw water from the top of the steam generator and use the common blowdown lines to return the water to the tube sheet area of the associated steam generator. The suction line has manually operated containment isolation valves (CIVs). The pumps can also be used to transfer the contents of one steam generator to another and to pump the water in a steam generator to the liquid and solid waste radiation waste system.

The recirculation coolers are used to cool the water in the steam generators to minimize the temperature differential between the water in the reactor coolant cold leg and the water in the steam generator. Since this is a manually actuated system and largely not safety-related, the in scope portion extends from the connection at the steam generators to the manually operator outside containment isolation valves.

The recirculation and transfer system interfaces with the following additional systems and components:

- feedwater system
- steam generator
- condensate system
- secondary drain system

UFSAR Reference

Additional details of the steam generator recirculation and transfer system are provided in Section 9.6 of the UFSAR.

System Intended Functions

(Later)

Boundary Drawings

The license renewal boundary drawings used in developing the scope and boundaries for the recirculation and transfer system during the screening process are listed below:

11448-LRM-124A, SH. 1
11448-LRM-124A, SH. 2
11448-LRM-124A, SH. 3
11548-LRM-124A, SH. 1

EXAMPLE

Components/Commodities Subject to an AMR

The components/commodities in the recirculation and transfer system that are in-scope for license renewal and require an aging managing review are valve bodies, and the recirculation and transfer piping indicated on the above boundary drawings.

EXAMPLE

GENERAL INFORMATION

EXHIBIT A – Technical Information

- 1.0 INTRODUCTION AND SITE DESCRIPTION
- 2.0 STRUCTURES AND COMPONENTS SUBJECT TO AGING MANAGEMENT REVIEW
 - 2.1 SCOPING AND SCREENING METHODOLOGY
 - 2.2 PLANT LEVEL SCOPING RESULTS
 - 2.3 MECHANICAL COMPONENTS SYSTEM SCOPING AND SCREENING RESULTS
 - 2.3.1 *Reactor Coolant System Mechanical Components*
 - 2.3.2 *Engineered Safety Features*
 - 2.3.3 *Auxiliary Systems*
 - 2.3.4 *Steam and Power Conversion System*
 - 2.4 STRUCTURES AND STRUCTURAL COMPONENTS SCOPING AND SCREENING RESULTS
 - 2.5 ELECTRICAL AND INSTRUMENTATION AND CONTROLS SYSTEM SCOPING AND SCREENING RESULTS
- 3.0 AGING MANAGEMENT REVIEW RESULTS
 - 3.1 COMMON AGING MANAGEMENT PROGRAMS
 - 3.2 AGING MANAGEMENT REVIEW METHODOLOGY
 - 3.3 MECHANICAL AGING MANAGEMENT REVIEW RESULTS
 - 3.3.1 *Reactor Coolant System*
 - 3.3.2 *Engineered Safety Features*
 - 3.3.3 *Auxiliary Systems*
 - 3.3.4 *Steam and Power Conversion Systems*
 - 3.4 STRUCTURES AND STRUCTURAL COMPONENTS AGING MANAGEMENT REVIEW RESULTS
 - 3.5 ELECTRICAL AND INSTRUMENT AND CONTROLS AGING MANAGEMENT REVIEW RESULTS
- 4.0 TIME-LIMITED AGING ANALYSIS
 - 4.1 IDENTIFICATION OF TLAAS
 - 4.2 REACTOR VESSEL NEUTRON EMBRITTLEMENT
 - 4.3 METAL FATIGUE
 - 4.4 ENVIRONMENTAL QUALIFICATION
 - 4.5 CONTAINMENT LINER PLATE FATIGUE
 - 4.6 AGING OF BORAFLEX IN SPENT FUEL RACK
 - 4.7 OTHER PLANT-SPECIFIC TLAAS

APPENDIX A - Aging Management Activities

APPENDIX B - Commodity Groups

APPENDIX C - CLB Changes

EXHIBIT B - UFSAR Supplement

EXHIBIT C - Technical Specification Changes

EXHIBIT D - Environmental Information

EXAMPLE



**Format for
McGuire and Catawba
License Renewal Applications**

Bob Gill
January 12, 2000

Contents of Plant Specific Document

<p>Submittal Letter contains all required Administrative Information</p> <p>Exhibit A: Technical Information Place Holder – point to Exhibit A</p> <p>Exhibit B: Updated Final Safety Analysis Report (UFSAR) Supplement</p> <p>Exhibit C: Technical Specification Changes (if any)</p>

<p>Exhibit D: Environmental Report</p>

*Contents of Technical Information Document
Exhibit A*

<p>1.0 Administrative Information Place holder – point to plant specific submittal letter</p> <p>2.0 Structures and Components Subject to Aging Management Review 2.1 Scoping and Screening Methodology 2.2 Plant Level Scoping Results 2.3 System Scoping and Screening Results (Mechanical) 2.4 Structures and Structural Components Scoping and Screening Results 2.5 System Scoping and Screening Results (Electrical and Instrumentation and Controls)</p> <p>3.0 Aging Management Review Results 3.1 Common Aging Management Programs 3.1.1 Chemistry Control 3.1.2 Quality Assurance 3.1.3 Structure and System Walkdowns 3.2 Reactor Coolant System 3.3 Engineered Safety Features 3.4 Auxiliary Systems 3.5 Steam and Power Conversion Systems 3.6 Diesel Generators 3.7 Ventilation Systems 3.8 Structures and Structural Components 3.9 Electrical and Instrumentation and Controls</p> <p>4.0 Time-Limited Aging Analyses 4.1 Identification of TLAAs 4.2 Reactor Vessel Neutron Embrittlement 4.3 Metal Fatigue 4.4 Environmental Qualification (EQ) 4.5 Concrete Containment Tendon Prestress (NA for MNS and CNS) 4.6 Containment Liner Plate Fatigue 4.7 Aging of Boraflex in Spent Fuel Rack 4.8 Others as necessary</p> <p>Appendix A: Aging Management Programs and Activities</p> <p>Appendix B: Aging Effects that Require Aging Management</p> <p>Appendix C: CLB Changes (Place Holder until Annual Update)</p>

Contents of Technical Information Document
(Draft January 2000)

McGuire Nuclear Station	Catawba Nuclear Station	Contents of Technical Information Document (Exhibit A)
1.0 Place holder – point to plant specific document	<i>1.0 Place holder – point to plant specific document</i>	1.0 Place holder – point to plant specific document
2.0 Structures and Components Subject to Aging Management Review	<i>2.0 Structures and Components Subject to Aging Management Review</i>	2.0 Structures and Components Subject to Aging Management Review
2.1 Scoping and Screening Methodology	<i>2.1 Scoping and Screening Methodology</i>	Generic Methodology Description
2.2 Plant Level Scoping Results	<i>2.2 Plant Level Scoping Results</i>	Plant specific list of all SSCs in UFSAR currently. Plant specific in scope results in individual tables
2.3 System Scoping and Screening Results (Mechanical)	<i>2.3 System Scoping and Screening Results (Mechanical)</i>	2.3 System Scoping and Screening Results (Mechanical)
2.3.1 Reactor Coolant System	<i>2.3.1 Reactor Coolant System</i>	2.3.1 Reactor Coolant System
Reactor Vessel Internals	<i>Reactor Vessel Internals</i>	Reactor Vessel Internals
Reactor Vessel	<i>Reactor Vessel</i>	Reactor Vessel
Pressurizer	<i>Pressurizer</i>	Pressurizer
Steam Generator	<i>Steam Generator</i>	Steam Generator
Reactor Coolant Pumps	<i>Reactor Coolant Pumps</i>	Reactor Coolant Pumps
Piping (Class 1)	<i>Piping (Class 1)</i>	Piping (Class 1)
Piping (Non-Class 1)	<i>Piping (Non-Class 1)</i>	Piping (Non-Class 1)
CRDM Housings	<i>CRDM Housings</i>	CRDM Housings
Valves	<i>Valves</i>	Valves
2.3.2 Engineered Safety Features	<i>2.3.2 Engineered Safety Features</i>	2.3.2 Engineered Safety Features
Containment Air Return & Hydrogen-Skimmer	<i>Containment Air Return & Hydrogen-Skimmer</i>	Containment Air Return & Hydrogen-Skimmer
Combustible Gas Control	<i>Combustible Gas Control</i>	Combustible Gas Control
Containment Isolation	<i>Containment Isolation</i>	Containment Isolation
Containment Spray	<i>Containment Spray</i>	Containment Spray
	<i>Containment Valve Injection Water</i>	Containment Valve Injection Water (CNS Only)
Residual Heat Removal	<i>Residual Heat Removal</i>	Residual Heat Removal
Safety Injection	<i>Safety Injection</i>	Safety Injection
2.3.3 Auxiliary Systems	<i>2.3.3 Auxiliary Systems</i>	2.3.3 Auxiliary Systems
Boron Recycle	<i>Boron Recycle</i>	Boron Recycle
Boron Thermal Regeneration	<i>Boron Thermal Regeneration</i>	Boron Thermal Regeneration

Contents of Technical Information Document
(Draft January 2000)

McGuire Nuclear Station	Catawba Nuclear Station	Contents of Technical Information Document (Exhibit A)
Chemical & Volume Control	<i>Chemical and Volume Control</i>	Chemical & Volume Control
Component Cooling	<i>Component Cooling</i>	Component Cooling
Fuel Pool Cooling & Cleanup	<i>Fuel Pool Cooling & Cleanup</i>	Fuel Pool Cooling & Cleanup
Instrument Air	<i>Compressed Air</i>	Instrument Air
Nuclear Service Water	<i>Nuclear Service Water</i>	Nuclear Service Water
Recirculated Cooling		Recirculated Cooling (MNS Only)
2.3.4 Steam and Power Conversion	<i>2.3.4 Steam and Power Conversion</i>	2.3.4 Steam and Power Conversion
Auxiliary Feedwater	<i>Auxiliary Feedwater</i>	Auxiliary Feedwater
Feedwater	<i>Feedwater</i>	Feedwater
Main Steam	<i>Main Steam</i>	Main Steam
2.3.5 Diesel Generator	<i>2.3.5 Diesel Generator</i>	2.3.5 Diesel Generator
Cooling Water	<i>Cooling Water</i>	Cooling Water
Crankcase Vacuum		Crankcase Vacuum (MNS Only)
Fuel Oil	<i>Fuel Oil</i>	Fuel Oil
Intake & Exhaust	<i>Intake & Exhaust</i>	Intake & Exhaust
Lube Oil	<i>Lube Oil</i>	Lube Oil
Room Sump Pump	<i>Room Sump Pump</i>	Room Sump Pump
Starting Air	<i>Starting Air</i>	Starting Air
2.3.6 Ventilation	<i>2.3.6 Ventilation</i>	2.3.6 Ventilation
Annulus Ventilation	<i>Annulus Ventilation</i>	Annulus Ventilation
Auxiliary Building	<i>Auxiliary Building</i>	Auxiliary Building
Containment Purge	<i>Containment Purge</i>	Containment Purge
Containment Ventilation	<i>Containment Ventilation</i>	Containment Ventilation
Control Room	<i>Control Room Area</i>	Control Room Area
Diesel Building	<i>Diesel Building</i>	Diesel Building
	<i>Fuel Building</i>	Fuel Building (CNS Only)
	<i>Nuclear Service Water Pump Structure Ventilation</i>	Nuclear Service Water Pump Structure Ventilation (CNS Only)
Radwaste		Radwaste (MNS Only)
Turbine Building	<i>Turbine Building</i>	Turbine Building
2.4 Structures and Structural Components Scoping and Screening Results	<i>2.4 Structures and Structural Components Scoping and Screening Results</i>	2.4 Structures and Structural Components Scoping and Screening Results

Contents of Technical Information Document
(Draft January 2000)

McGuire Nuclear Station	Catawba Nuclear Station	Contents of Technical Information Document (Exhibit A)
Auxiliary Building – including Diesel Building, Fuel Pool, New Fuel Storage Vault, Fuel Storage Racks	<i>Auxiliary Building – including Diesel Building, Fuel pool, Fuel Building, Fuel Storage Racks (New & Spent)</i>	Auxiliary Building – including Diesel Building, Fuel Pool, New Fuel Storage Vault, Fuel Storage Racks
Containment	<i>Containment</i>	Containment
Cranes	<i>Cranes</i>	Cranes
Foundations	<i>Foundations</i>	Foundations
Fuel Handling	<i>Fuel Handling</i>	Fuel Handling
Ice Condenser	<i>Ice Condenser Refrigeration System</i>	Ice Condenser
Intake/Discharge Structures	<i>Nuclear Service Water Structures</i>	Intake/Discharge Structures
Nuclear Service Water Pipe	<i>Nuclear Service Water Pipe</i>	Nuclear Service Water Pipe
Nuclear SW Pond Dam	<i>Standby Nuclear Service Water Pond Dam and Outlet Works</i>	Nuclear SW Pond Dam (MNS)
		Standby Nuclear Service Water Pond Dam and Outlet Works (CNS)
RCS Supports	<i>RCS Supports</i>	RCS Supports
Reactor Building	<i>Reactor Building</i>	Reactor Building
Station Vent	<i>Station Vent</i>	Station Vent
Trenches	<i>Trenches</i>	Trenches
2.5 System Scoping and Screening Results (Electrical and Instrumentation and Controls)	<i>2.5 System Scoping and Screening Results (Electrical and Instrumentation and Controls)</i>	2.5 System Scoping and Screening Results (Electrical and Instrumentation and Controls)
Insulated Cables and Connectors	<i>Insulated Cables and Connectors</i>	Insulated Cables and Connectors

Contents of Technical Information Document
(Draft January 2000)

<i>McGuire Nuclear Station</i>	<i>Catawba Nuclear Station</i>	<i>Contents of Generic Technical Information</i>
3.0 Aging Management Review Results	3.0 Aging Management Review Results	3.0 Aging Management Review Results
		3.1 Common Aging Management Programs
		3.1.1 Chemistry Control (Generic)
		3.1.2 Quality Assurance (Generic)
		3.1.3 Structure and System Walkdowns (Generic)
		3.2 Reactor Coolant System
		3.3 Engineered Safety Features
		3.4 Auxiliary Systems
		3.5 Steam and Power Conversion Systems
		3.6 Diesel Generator
		3.7 Ventilation
		3.8 Structures and Structural Components
		3.9 Electrical and Instrumentation and Controls
4.0 Time-Limited Aging Analyses	4.0 Time-Limited Aging Analyses	4.0 Time-Limited Aging Analyses
		4.1 Identification of TLAAs
		4.2 Reactor Vessel Neutron Embrittlement
		4.3 Metal Fatigue
		4.4 Environmental Qualification (EQ)
		4.5 Concrete Containment Tendon Prestress (NA to MNS and CNS)
		4.6 Containment Liner Plate Fatigue
		4.7 Aging of Boraflex in Spent Fuel Rack
		4.8 Others as necessary

Contents of Technical Information Document
(Draft January 2000)

<i>McGuire Nuclear Station</i>	<i>Catawba Nuclear Station</i>	Contents of Generic Technical Information
		Appendix A: Aging Management Programs and Activities (Generic)
		Appendix B: Aging Effects that Require Aging Management (Generic)
		Appendix C: CLB Changes (Place Holder until Annual Update) (Note: Even though this update will be site-specific, it fits better as part of the technical information document as it will be technical in nature.)

Notes for plant specific differences –

1. Use different paragraphs or sections for the site-specific description of an SSC.
2. If system name is the only difference then put the Catawba system name in ().
3. If SSC is at only one site then state “(McGuire only)” or “(Catawba only)”
4. Consider using bounding parameters, materials, etc., if possible.
5. Key attributes of aging management programs will be the same (frequency, acceptance criteria, sample size). Scope may vary due to plant specific differences.
6. TLAA need to be evaluated on a unit specific basis – results should be presented in a manner that does not confuse the reader.