

---

---

## Document Update Notification

---

---

*COPYHOLDER NO:* 103

*TO:* NRC - WASHINGTON

*ADDRESS:* DOC CNTRL DESK MAIL STOP OP1-17  
WASHINGTON DC 20555

*DOCUMENT NO:* OP-1903.010

*TITLE:* SUPERCEDED EMERGENCY ACTION  
LEVEL CLASSIFICATION

*REVISION NO:* 034-03-0

*CHANGE NO:* PC-03

*SUBJECT:* RE-DISTRIBUTION



*If this box is checked, please sign, date, and return transmittal  
in envelope provided.*

*ANO-1 Docket 50-313*

*ANO-2 Docket 50-368*

---

Signature

Date



# ENTERGY OPERATIONS INCORPORATED ARKANSAS NUCLEAR ONE

<b>TITLE:</b> EMERGENCY ACTION LEVEL CLASSIFICATION	<b>PROC/WORKPLAN NO.</b> 1903.010	<b>REV.</b> 34	<b>CHG.</b> PC-3
---	--------------------------------------	-------------------	---------------------

TEMPORARY CHANGE <input type="checkbox"/> EXPIRATION DATE <u>N/A</u>	PERMANENT CHANGE <input checked="" type="checkbox"/>	AFFECTED UNIT <input checked="" type="checkbox"/> 1 <input checked="" type="checkbox"/> 2	SAFETY-RELATED <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO	PAGE 1 OF <u>1</u>
---	--	--	---	--------------------

**REASON FOR CHANGE::**  
Incorporate changes to the Technical Specifications

**DESCRIPTION OF CHANGE:**  
Changed "Tech Spec Limits" to "ODCM Limitations" in the following steps: Attachment 1 and 2 steps 5.1 and 5.2, Unit 1 EAL 5.1 and 5.2, Unit 2 EAL 5.1 and 5.2.

Does This Change Require a 10CFR50.59 Review Per 1000.131, Step 6.3.2?  YES  NO

DOES THIS CHANGE:	Yes	No	Does this change alter or delete an existing Regulatory Commitment? <sup>1,3</sup> (If yes, coordinate with licensing <u>before</u> implementing.)	Yes	No
Change the Procedure purpose?	<input type="checkbox"/>	<input checked="" type="checkbox"/>		<input type="checkbox"/>	<input checked="" type="checkbox"/>
Change the Procedure scope?	<input checked="" type="checkbox"/>	<input type="checkbox"/>	Was MEF used as source document?	<input checked="" type="checkbox"/>	<input type="checkbox"/>
Implement or change a Temporary Alteration?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<b>STANDARD APPROVAL PROCESS</b> (Required for Intent Changes or Changes Requiring a 50.59 Evaluation)		
Degrade the controls prescribed in the Admin. Procedures?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	ORIGINATOR: (INCLUDES REVIEW AGAINST ATT. 13)	DATE: <u>11-12-98</u>	
Reduce the level of nuclear safety?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	INDEPENDENT REVIEWER:	DATE: <u>11-13-98</u>	
Degrade acceptance criteria?	<input type="checkbox"/>	<input checked="" type="checkbox"/>	ENGINEERING:	DATE: <u>N/A</u>	

If the response to any of the above is YES, or a 50.59 Evaluation is required, the change must be approved using the Standard Approval Process.

<b>INTERIM APPROVAL PROCESS</b> (Non-Intent Changes and changes not requiring a 50.59 Evaluation that are stopping work in progress)	QUALITY: <u>N/A</u> DATE:
---	---------------------------

ORIGINATOR: (INCLUDES REVIEW AGAINST ATT. 13) <u>N/A</u> DATE:	UNIT SURVEILLANCE COORDINATOR: <sup>3</sup> <u>N/A</u> DATE:
--	--

SUPERVISOR APPROVAL:* <u>N/A</u> DATE:	SECTION LEADER: <u>W.C. Hulse</u> DATE: <u>11-16-98</u>
--	---

SRO UNIT TWO:** <u>N/A</u> DATE:	QUALITY ASSURANCE: <u>N/A</u> DATE:
----------------------------------	-------------------------------------

SRO UNIT ONE:** <u>N/A</u> DATE:	OTHER SECTION LEADER(S): (Required for assignment of responsibility outside of responsible section leader's section) DATE:
----------------------------------	--

\*If the change is not required to support work in progress, the Department Head must sign.  
\*\*If both units are affected by this change, then both SRO signatures are required.

FINAL APPROVAL (Required within 14 days of SRO signature)

FINAL APPROVAL: <u>Ashley R. Cotton</u> DATE: <u>11/19/98</u>	PSC CHAIRMAN/TECHNICAL REVIEWER: <sup>2</sup> <u>R. Full</u> DATE: <u>11-18-98</u>
---	--

REQUIRED EFFECTIVE DATE:	DATE: <u>12/3/98</u>
--------------------------	----------------------

FORM TITLE: <b>CHANGE REQUEST</b>	FORM NO: 1000.006C	REV. 46 PC 2/PC-3
-----------------------------------	--------------------	-------------------

<sup>1</sup>(OCNA128509) <sup>2</sup>(OCNA049312) <sup>3</sup>(OCAN049803)

Date: November 16, 1998

Number: EP-98-0086

To: Chairman, Plant Safety Committee

From: W. R. Gresham

*John Miller prepared for WRG*

Subject: Revision 23, PC-4 to Procedure 1903.011

The Emergency Planning staff has reviewed the proposed revision to Procedure 1903.011, "Emergency Response/Notification". The review included an evaluation of the revision in accordance with the requirements of 10CFR50.54(q). Emergency Planning has determined that the revision does not decrease the effectiveness of the Emergency Plan and the Plan continues to meet the standards of 10CFR50.47(b) and the requirements of 10CFR50, Appendix E.

Below is a brief description of the change and its justification:

**Change:** This change involves revising pertinent sections of the Emergency Plan to reflect a change in the location of liquid radiological effluent limits from the Unit-1 and Unit-2 Technical Specifications (TS) to the Offsite Dose Calculation Manual (ODCM). The revision will change:

Table D-1, *page D-4*

Table D-1, *page D-6*

Table D-2, *page D-12*

Table D-2, *page D-14*

Section H, *step 3.2, page H-7*

**Justification:** The revision incorporating the changes from TS references to ODCM references represent a location change for the liquid radiological effluent limits, and do not represent a change in the limits themselves. The location revision represents a change allowed by the NRC with Generic Letter 89-01 that will allow the Radiological Effluent Tech. Spec. to be located in ANOs ODCM. Since the revision represents a reference location change only and does not change limits for the liquid effluents, the revision does not decrease the effectiveness of the Emergency Plan.

WRG/hdy

cc:

ANO-DCC

EP File

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 1 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

1.0 PURPOSE

This procedure establishes criteria for detection and classification of plant events into the four standard Emergency Classes.

2.0 SCOPE

This procedure is applicable to Units 1 and 2 in all modes; it does not include specific plant casualty procedures or systems operations requirements, but rather provides administrative processes only.

3.0 REFERENCES

3.1 REFERENCES USED IN PROCEDURE PREPARATION:

- 3.1.1 ANO Emergency Plan
- 3.1.2 ANO's EAL Bases Document
- 3.1.3 NUREG-0654/FEMA-REP-1, Rev. 1
- 3.1.4 10 CFR 50
- 3.1.5 NRC Branch Position on Acceptable Deviations to Appendix 1 to NUREG-0654/FEMA-REP-1, July 11, 1994

3.2 REFERENCES USED IN CONJUNCTION WITH THIS PROCEDURE:

- 3.2.1 1000.104, "Condition Reporting and Corrective Actions"
- 3.2.2 1903.011, "Emergency Response/Notifications"
- 3.2.3 1903.064, "Emergency Response Facility - Control Room"
- 3.2.4 1903.065, "Emergency Response Facility - Technical Support Center (TSC)"
- 3.2.5 1903.066, "Emergency Response Facility - Operational Support Center (OSC)"
- 3.2.6 1903.067, "Emergency Response Facility - Emergency Operations Facility (EOF)"
- 3.2.7 1203.025, "Natural Emergencies"
- 3.2.8 2203.008, "Natural Emergencies"
- 3.2.9 1202.XXX, "Emergency Operating Procedures"
- 3.2.10 2202.XXX, "Emergency Operating Procedures"
- 3.2.11 1404.016, "Post Earthquake Data acquisition and Measurement"
- 3.2.12 1904.002, "Offsite Dose Projections-RDACS Method"
- 3.2.13 1904.004, "Estimating Airborne Release Rates"
- 3.2.14 NRC Position Paper on "Timeliness of Classification of Emergency Conditions" dated August 17, 1995

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 2 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

3.3 RELATED ANO PROCEDURES:

- 3.3.1 1043.042, "Response to Security Contingencies"
- 3.3.2 1502.004, Attachment H
- 3.3.3 1903.023, "Personnel Emergency"
- 3.3.4 ANO Security Plan/Security Procedures
- 3.3.5 1015.007, "Fire Brigade Organization and Responsibilities"
- 3.3.6 1903.042, "Duties of the Emergency Medical Team"
- 3.3.7 1903.043, "Duties of the Emergency Radiation Team"

3.4 REGULATORY CORRESPONDENCE CONTAINING NRC COMMITMENTS WHICH ARE IMPLEMENTED IN THIS PROCEDURE INCLUDE:

- 3.4.1 0CAN068708
- 3.4.2 0CNA068807
  - A. Section 4.17
  - B. Attachment 3
  - C. Attachment 4
- 3.4.30 0CAN068320
  - A. Section 4.15
- 3.4.40 0CAN108213
  - A. 3.2.2
  - B. 4.11
  - C. 6.1.4
- 3.4.51 0CAN088308
  - A. 5.0
  - B. 6.1

4.0 DEFINITIONS

4.1 Courtesy Call - A notification to the Arkansas Department of Health and follow-up notification to the NRC for conditions/events other than those constituting an Emergency Class as listed in procedure 1903.11, "Emergency Response/Notifications", Section 6.3.

4.2 Emergency Action Level - Alarms, instrument readings or visual sightings that have exceeded pre-determined limits which would categorize the situation into an initiating condition of one of the following four Emergency Classes:

- Notification of Unusual Event
- Alert
- Site Area Emergency
- General Emergency

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 3 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

- 4.2.1 Notification of Unusual Event - Unusual events are in progress or have occurred which indicate a potential degradation of the level of safety of the plant. No releases of radioactive material requiring offsite response or monitoring are expected unless further degradation of safety systems occurs.
- 4.2.2 Alert - Events are in progress or have occurred which involve an actual or potential substantial degradation of the level of safety of the plant. Any releases are expected to be limited to small fractions of the EPA Protective Action Guideline exposure levels.
- 4.2.3 Site Area Emergency - Events are in progress or have occurred which involve actual or likely major failures of plant functions needed for protection of the public. Any releases are not expected to exceed EPA Protective Action Guideline exposure levels except near the site boundary.
- 4.2.4 General Emergency - Events are in progress or have occurred which involve actual or imminent substantial core degradation or melting with the potential for loss of containment integrity. Releases can be reasonably expected to exceed EPA Protective Action Guideline exposure levels off site for more than the immediate site area.
- 4.3 Emergency Direction and Control - Overall direction of facility response which must include the non-delegable responsibilities for the decision to notify and to recommend protective actions to Arkansas Department of Health personnel and other authorities responsible for offsite emergency measures. With activation of the EOF, the EOF Director typically assumes the responsibility for Emergency Direction and Control. The management of on-site facility activities to mitigate accident consequences remains with the TSC Director in the Technical Support Center. The Shift Superintendent retains responsibility for the Control Room and plant systems operation.
- 4.4 Emergency Operations Facility (EOF) - A nearsite emergency response facility located approximately 0.65 miles northeast of the reactor buildings (the ANO Training Center).
- 4.5 Emergency Planning Zone (EPZ) - The EPZ considered by this procedure is the inhalation zone and is that area within approximately a 10 mile radius of ANO.
- 4.6 Emergency Response Organization (ERO) - The organization which is composed of the Initial Response Staff (IRS), the EOF staff, the TSC staff, the OSC staff, and the Emergency Team members. It has the capability to provide manpower and other resources necessary for immediate and long-term response to an emergency situation.
- 4.7 EPA Protective Action Guideline (PAG) Exposure Levels - The projected dose to reference man, or other defined individual, from an unplanned release of radioactive material at which a specific protective action to reduce or avoid that dose is recommended (i.e., 1 Rem TEDE or 5 Rem Child Thyroid (CDE)).
- 4.8 Exclusion Area Boundary - That area surrounding ANO within a minimum radius of 0.65 miles of the reactor buildings and controlled to the extent necessary by Entergy Operations during an emergency.

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>4 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

4.9 Initial Response Staff (IRS) - The emergency organization composed of plant personnel which must be able to respond to the site in accordance with Table B-1 of the Emergency Plan.

4.10 Normal Makeup (MU) Capacity - Normal MU capacity is defined as the maximum expected water addition to the RCS through the MU line with the letdown line isolated. This amount will vary with RC pressure.

4.11 Offsite - Those areas not covered by Section 4.12.

4.12 Onsite - The area within the Exclusion Area Boundary.

4.13 Operational Support Center (OSC) - Emergency response center within the ANO Maintenance Facility where support is coordinated for the following functions:

Onsite Radiological Monitoring  
Maintenance  
Nuclear Chemistry  
Emergency Medical Support  
Fire Fighting Support

The OSC also serves as the briefing area for repair and damage control teams and is located in the Maintenance Facility.

4.14 Technical Support Center (TSC) - The location within the ANO Administration Building equipped with instrumentation and communication systems and facilities useful in monitoring the course of an accident; this center is located in the 3rd Floor of the ANO Administration Building.

4.15 FISSIION PRODUCT BARRIER FAILURE

4.15.1 **Fuel Cladding Failure**

A. Unit 1 - Greater than 1% failed fuel as indicated by ANY of the following:

1. Nuclear Chemistry analysis of RCS sample yields > 400 uCi/gm specific I-131.
2. Failed Fuel Iodine process monitor (RE 1237) indicates >  $8.2 \times 10^5$  CPM.
3. Containment Radiation Levels correspond to a Site Area Emergency from Containment Radiation EAL Plot (Attachment 5).
4. Engineering assessment of core damage indicates > 1% failed fuel.

B. Unit 2 - Greater than 1% failed fuel as indicated by ANY of the following:

1. Nuclear Chemistry analysis of RCS sample yields > 378 uCi/gm specific I-131.
2. Containment Radiation Levels correspond to a Site Area Emergency from Containment Radiation EAL Plot (Attachment 6).



PROC./WORK PLAN NO.  <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE:  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>5 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

3. Engineering assessment of core damage indicates > 1% failed fuel.

4.15.2 **RCS Boundary Failure**

- A. Unit 1 - RCS leakage greater than normal makeup capacity (50 gpm).
- B. Unit 2 - RCS leakage greater than 44 gpm (capacity of a single Charging Pump).

4.15.3 **Containment Integrity Failure**

- A. Abnormally high Containment High Range Radiation Monitor readings (RE-8060 or 8061 for Unit 1; 2RY-8925-1 or 2RY-8925-2 for Unit 2) and indications of radiological effluents outside of the Reactor Building that are not attributable to any other source.
- B. In the judgement of the SS/TSC Director/EOF Director, a breach of the Reactor Building exists. The variety of possible Reactor Building integrity failure scenarios precludes the development of an all inclusive list. In the absence of the conditions described in 4.15.3.A above, the SS/TSC Director/EOF Director must judge the potential for an offsite release to occur based on a current status of Reactor Building isolation systems and structural integrity.

4.15.4 **Inability to Monitor a Fission Product Barrier**

- A. Following the failure of two fission product barriers, the inability to monitor the third barrier is to be regarded as equivalent to a failure of that barrier.

4.16 FISSION PRODUCT BARRIER CHALLENGE

4.16.1 **Challenge to Fuel Cladding:** any event or condition which in the judgement of the SS/TSC Director/EOF Director presents the potential for greater than 1% fuel cladding failure; for example:

- A. RCS temperature and pressure indicates superheated conditions.
- B. Indications of the core being uncovered.
- C. Exceeding safety limits (e.g. DNBR or Local Power Distribution)

PROC./WORK PLAN NO.  <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE:  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>6 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

4.16.2 **Challenge to RCS Boundary:** any event or condition which, in the judgement of the SS/TSC Director/EOF Director could result in RCS leakage in excess of normal makeup capacity (i.e., 50 gpm for Unit 1 or 44 gpm for Unit 2); for example:

- A. RCS pressure > 2450 psig and not decreasing.
- B. Two out of three seal stages failed on any RCP (U-1).
- C. Three out of four seal stages failed on any RCP (U-2).
- D. Failure of any component resulting in RCS leakage greater than Tech. Spec. limits but less than normal make up capacity; (50 gpm) for Unit 1 or (44 gpm) for Unit 2.

4.16.3 **Challenge to Containment Building Integrity:** any event or condition which in the judgement of the SS/TSC Director/ EOF Director significantly increases the potential for failure of containment integrity; for example:

- A. Containment pressure > Reactor Building spray actuation setpoint and increasing with no available RB spray or cooling.
- B. Hydrogen concentrations in containment > 3.5%.
- C. Occurrence of system or component failure which degrades the capability to maintain containment integrity as defined by Tech Specs.

4.17 PLANT TRANSIENT

- 4.17.1 Any unplanned reactor trip from criticality.
- 4.17.2 A planned reactor trip in which the expected post-trip response did not occur.
- 4.17.3 Any event resulting in an automatic ESAS (Unit 1) or ESF (Unit 2) actuation or any event requiring manual initiation of these systems where automatic initiation would likely have occurred.
- 4.17.4 Any turbine-generator power change in excess of 100 MWe in less than one (1) minute other than a momentary spike due to a grid disturbance or a manually initiated runback.
- 4.17.5 Any unplanned main turbine or main feedwater pump turbine trip which results in a significant plant transient (change in excess of 100 MWe).

5.0 RESPONSIBILITY AND AUTHORITY

- 5.1 The responsibility for event classification is assigned to the individual with responsibility for Emergency Direction and Control (i.e., The Shift Superintendent, TSC Director, or EOF Director).

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 7 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

5.2 The Control Room Supervisor (CRS) will assume Emergency Direction and Control responsibilities whenever the SS is not available to assume this responsibility (e.g. the SS becomes incapacitated and a replacement has not yet arrived).

5.3 Any individual who observes an initiating condition which warrants an emergency class declaration, as described in Attachments 3 and 4, shall immediately notify the person with current responsibility for Emergency Direction and Control (i.e. SS/TSC Director/EOF Director).

6.0 INSTRUCTIONS

**NOTE**

On emergencies that effect both units such as earthquakes, tornado's, etc., the unit with the highest Emergency Action Level Classification should be the one that is declaring the emergency.

6.1 CLASSIFYING EMERGENCIES:

**NOTE**

NRC guidelines recommend that once indications are available to ANO staff that an EAL has been exceeded, a 15 minute goal is a reasonable period of time for assessing and classifying an emergency.

6.1.1 When indications of abnormal occurrences are received by the Control Room staff, the SS/TSC Director/EOF Director shall:

- A. Verify the indications of the off-normal event or reported sighting.
- B. Ensure that the immediate actions (e.g., use of Emergency and Abnormal Operating Procedures) are taken for the safe and proper operation of the plant.
- C. Compare the abnormal conditions with those listed in the "Index Of Emergency Action Levels" (Blue Tabs - Unit 1; Green Tabs - Unit 2).
- D. Turn to the appropriate tab which corresponds to the condition picked from the Index Of EALs.

**NOTE**

Unit 1 EALs - Blue Tabs  
Unit 2 EALs - Green Tabs

- E. Assess the information available from valid indications or reports, then:
  - 1. Compare information to criteria given for EAL,
  - 2. Review any Related EALs to determine if the abnormal conditions meet those criteria, and

PROC./WORK PLAN NO.  1903.010	PROCEDURE/WORK PLAN TITLE:  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: 8 of 124 REV: 34 CHANGE:
-------------------------------------	--	--------------------------------------

3. Declare the emergency classification that is indicated. (IF it appears that different classifications could be made for the current plant conditions, the highest classification indicated should be the one that is declared.

**NOTE**

The emergency action levels described in this procedure are not intended to be used during maintenance and/or testing situations where abnormal temperature, pressure, equipment status, etc., is expected. In addition, each EAL contains information on the mode(s) of operation during which it is applicable.

- F. If the indications or reports do not match the given EALs, then refer to the Miscellaneous Tab and using appropriate judgement, determine if the plant status warrants an emergency declaration.
- 6.1.2 Due to the speed in which events sometimes progress and the duty of the plant operators to take immediate corrective actions, an event may occur which was classifiable as an emergency, however, prior to offsite notifications the corrective actions taken may have removed the conditions that would have resulted in an emergency declaration. In this situation, offsite authorities (i.e. ADH and NRC) must be notified of the most severe emergency class that occurred (prior to the time when notifications could be made) with a brief description of events and the current plant status provided via form 1903.011Z. Subsequent activation of response organizations should be based upon the current plant conditions.
  - 6.1.3 If no emergency declaration is required, then refer to procedure 1903.011, "Emergency Response/Notifications", Section 6.3 to determine if the event warrants a "For Information Only" notification to Entergy Management, NRC Resident Inspector and/or the Arkansas Department of Health.
  - 6.1.4 Upon declaration of an emergency classification implement procedure, 1903.011, "Emergency Response Notifications", to ensure that immediate notification requirements are met and the proper Emergency Plan response is taken.
  - 6.1.5 Upgrade the emergency classification if plant conditions degrade per steps 6.1.1.A through F.
  - 6.1.6 Downgrade the emergency classification when plant conditions have improved and step 6.2 is applicable.
- 6.2 DOWNGRADING THE EMERGENCY CLASSIFICATION:
- 6.2.1 Assess the current plant conditions, then perform the following:
    - A. Compare the abnormal conditions with those listed in the "Index Of Emergency Action Levels" (Blue Tabs - Unit 1; Green Tabs - Unit 2)

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>9 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

- B. Turn to the appropriate tab which corresponds to the condition picked from the Index Of EALs.

**NOTE**  
Unit 1 EALs - Blue Tabs  
Unit 2 EALs - Green Tabs

- C. Assess the information available from valid indications or reports, compare it to the given EALs. Obtain concurrence from NRC and State officials that downgrading is appropriate (if their emergency response organizations have been activated as a result of this event). Downgrade to the emergency classification that is indicated.
- D. If the indications or reports do not match the given EALs, then refer to the Miscellaneous Tab and using appropriate judgement, determine if the plant status warrants downgrading the emergency classification.
- 6.2.2 Perform notifications to downgrade the emergency classification if appropriate per procedure 1903.011, "Emergency Response/Notifications".
- 6.2.3 If no emergency classification appears necessary, then terminate the emergency per step 6.3.
- 6.2.4 If the emergency classification is still required, repeat steps 6.2.1 through 6.2.3 whenever plant conditions again appear to have improved.
- 6.3 **TERMINATING THE EMERGENCY:**
- 6.3.1 Compare the existing plant conditions with the following:
- A. Plant conditions no longer meet the emergency action level criteria AND it appears unlikely that current conditions will degrade further requiring reinstatement of an emergency classification.
  - B. Non-routine releases of radioactive material to the environment are under control or terminated.
  - C. Any fire, flood, earthquake, or similar emergency condition is controlled or has ceased.
  - D. All specified corrective actions have occurred OR the plant has been placed in the appropriate operational mode.
  - E. All required notifications have been completed.
  - F. NRC and State officials are in agreement that termination or transition to the recovery phase is appropriate (if their emergency response organizations have been activated as a result of this event).

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>10 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

6.3.2 If the conditions of 6.3.1 A-F are met, terminate the emergency or proceed to the recovery phase.

7.0 ATTACHMENTS AND FORMS

- 7.1 Attachment 1 - Unit 1 Index of EALs
- 7.2 Attachment 2 - Unit 2 Index of EALs
- 7.3 Attachment 3 - Unit 1 Emergency Action Levels
- 7.4 Attachment 4 - Unit 2 Emergency Action Levels
- 7.5 Attachment 5 - Unit 1 Containment Radiation EAL Plot
- 7.6 Attachment 6 - Unit 2 Containment Radiation EAL Plot

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 11 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 1

UNIT 1

INDEX OF EALS

1.0 PRIMARY SYSTEM EVENTS

- 1.1 RCS Activity Indicates >0.1% Failed Fuel.....NUE
- 1.2 RCS Activity Indicates > 1% Failed Fuel.....ALERT
- 1.3 Core Damage Indicated with an Inadequate Core Cooling Condition...SAE
- 1.4 Containment Radiation Reading which Indicates LOCA and >1% Cladding Failure.....SAE
- 1.5 Containment Radiation Reading which Indicates LOCA and >50% Fuel Overheat.....GE
- 1.6 Core Melt.....GE
- 1.7 Loss of or challenge to all 3 Fission Product Barrier.....GE

2.0 RCS LEAKAGE

- 2.1 RCS Leakage > T.S. Limits requiring a plant S/D or C/D.....NUE
- 2.2 RCS Leakage > Normal Makeup Capacity (50 gpm).....ALERT
- 2.3 RCS Leakage > Normal Makeup Capacity (50 gpm) with >1.0% Failed Fuel Conditions.....SAE
- 2.4 RCS Leakage > HPI Capacity.....SAE

3.0 SECONDARY SYSTEM EVENTS

- 3.1 Uncontrolled OTSG Depressurization Resulting in MSLI Actuation....NUE
- 3.2 OTSG Tube Leak > .347 gpm .....NUE
- 3.3 OTSG Tube Leak >10gpm Concurrent with an On-going Steam Release....ALERT
- 3.4 OTSG Tube Rupture with Primary to Secondary Leakage > Normal Makeup Capacity (50 gpm) with ongoing steam release.....SAE
- 3.5 OTSG Tube Leak >1 gpm with >1% Failed Fuel and on-going Steam Release.....SAE

4.0 ELECTRICAL POWER FAILURES

- 4.1 Degraded Power.....NUE
- 4.2 Station Blackout.....ALERT
- 4.3 Blackout for more than 15 minutes.....SAE
- 4.4 Loss of All Vital DC Power.....ALERT
- 4.5 Loss of All Vital DC Power for more than 15 minutes.....SAE

5.0 RADIOLOGICAL EFFLUENTS

- 5.1 Radiological Effluents >.05 mRem/hr TEDE or .15 mRem/hr Child Thyroid CDE at Site Boundary or Liquid Radiological Effluents exceed ODCM Limitations.....NUE
- 5.2 Radiological Effluents >.5 mRem/hr TEDE or 1.5 mRem/hr Child Thyroid CDE at Site Boundary or Liquid Radiological Effluents exceed 10 times ODCM Limitations.....ALERT
- 5.3 Radiological Effluents >50 mRem/hr TEDE or 150 mRem/hr Child Thyroid CDE at the Site Boundary.....SAE
- 5.4 Radiological Effluents >250 mRem/hr TEDE or 500 mRem/hr Child Thyroid CDE at the Site Boundary.....GE
- 5.5 High Radiation/Airborne Levels.....ALERT
- 5.6 Spent Fuel Accident.....SAE

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>12 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 1

UNIT 1

INDEX OF EALS

6.0 SAFETY SYSTEM FUNCTION

- 6.1 Deviation from T.S. action statements when required to shutdown or  
cooldown or deviations pursuant to 10CFR50.54(x).....NUE
- 6.2 RPS Failure to Complete an Automatic Trip.....ALERT
- 6.3 RPS Failure to Complete a Manual Trip.....SAE
- 6.4 Loss of Dose Assessment Capabilities.....NUE
- 6.5 Loss of Communications.....NUE
- 6.6 Loss of Control Room Annunciators.....ALERT
- 6.7 Loss of Control Room Annunciators with Transient in Progress.....SAE
- 6.8 Control Room Evacuation.....ALERT
- 6.9 Control Room Evacuation and control of shutdown systems not  
established in 15 minutes.....SAE
- 6.10 Loss of Decay Heat Removal Systems.....ALERT
- 6.11 Degraded Hot Shutdown Capability.....SAE

7.0 HAZARDS TO STATION OPERATION

- 7.1 Security Threat or Attempted Entry or Attempted Sabotage.....NUE
- 7.2 Ongoing Security Threat within Protected Area Security Fence.....ALERT
- 7.3 Ongoing Security Threat Within Plant Building.....SAE
- 7.4 Ongoing Security Threat Within CR or Vital Area.....GE
- 7.5 Fire or Explosion Onsite.....NUE
- 7.6 Fire or Explosion Onsite Affecting One Train of ANY ES Systems....ALERT
- 7.7 Fire or Explosion Onsite Affecting Both Trains of ANY ES Systems...SAE
- 7.8 Aircraft Crash, Unusual Aircraft Activity, Train Derailment,  
Turbine Failure, Toxic or Flammable Gas Release.....NUE
- 7.9 Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting One  
Train of ANY ES Systems.....ALERT
- 7.10 Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting Both  
Trains of ANY ES Systems.....SAE

8.0 NATURAL EVENTS

- 8.1 Tornado, Flood, Loss of Dardanelle Reservoir, Earthquake.....NUE
- 8.2 Tornado, High Winds, Flood, Loss of Dardanelle Reservoir,  
Earthquake.....ALERT
- 8.3 Tornado, High Winds, Flood, Loss of Dardanelle Reservoir,  
Earthquake.....SAE

9.0 MISCELLANEOUS EVENTS

- 9.1 Plant Conditions Exist Which Require an Increased Awareness by  
Operations Staff and State and/or Local Authorities.....NUE
- 9.2 Plant Conditions Exist that Warrant Activation of the TSC.....ALERT
- 9.3 Plant Conditions Exist that Warrant Activation of the Emergency  
Response Facilities.....SAE
- 9.4 Plant Conditions Exist That Make Release of Large Amount of  
Radioactivity Possible.....GE



<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 13 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 2

UNIT 2

INDEX OF EALS

1.0 PRIMARY SYSTEM EVENTS

- 1.1 RCS Activity Indicates >0.1% Failed Fuel.....NUE
- 1.2 RCS Activity Indicates >1.0% Failed Fuel.....ALERT
- 1.3 Core Damage Indicated with an Inadequate Core Cooling Condition....SAE
- 1.4 Containment Radiation Indicates LOCA and >1% Cladding Failure.....SAE
- 1.5 Containment Radiation Indicates LOCA and >50% Fuel Overheat.....GE
- 1.6 Core Melt with Containment Integrity Lost or Challenged.....GE
- 1.7 Loss of or challenge to all 3 Fission Product Barriers.....GE

2.0 RCS LEAKAGE

- 2.1 RCS Leakage > Tech Spec Limits requiring a Plant S/D or C/D.....NUE
- 2.2 RCS Leakage > 44 gpm.....ALERT
- 2.3 RCS Leakage > 44 gpm with ICC Conditions.....SAE

3.0 SECONDARY SYSTEM EVENTS

- 3.1 Uncontrolled S/G Depressurization Resulting in MSIS Actuation.....NUE
- 3.2 S/G Tube Leak > Tech. Spec. Limits.....NUE
- 3.3 S/G Tube Leak >10gpm with an Ongoing Steam Release.....ALERT
- 3.4 S/G Tube Rupture >44 gpm With an Ongoing Steam Release and RCS Activity > 1.0 µCi/gm.....SAE

4.0 ELECTRICAL POWER FAILURES

- 4.1 Degraded Power.....NUE
- 4.2 Station Blackout.....ALERT
- 4.3 Loss of All Vital DC.....ALERT
- 4.4 Blackout > 15 minutes.....SAE
- 4.5 Loss of All Vital DC for > 15 minutes.....SAE

5.0 RADIOLOGICAL EFFLUENTS

- 5.1 Radiological Effluents  $\geq$ .05 mrem/hr TEDE or .15 Child Thyroid CDE at Site Boundary or Liquid Radiological Effluents exceed ODCM Limitations.....NUE
- 5.2 Radiological Effluents  $\geq$ .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE at Site Boundary or Liquid Radiological Effluents exceed 10 times ODCM Limitations.....ALERT
- 5.3 Radiological Effluents  $\geq$ 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE at the Site Boundary.....SAE
- 5.4 Radiological Effluents  $\geq$ 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE at the Site Boundary.....GE
- 5.5 High Radiation/Airborne Levels.....ALERT
- 5.6 Spent Fuel Accident.....SAE

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 14 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 2  
UNIT 2

INDEX OF EALS

6.0 SAFETY SYSTEM FUNCTION

- 6.1 Deviation from T.S. action statements when required to shutdown or  
cooldown or deviations pursuant to 10CFR50.54(X).....NUE
- 6.2 RPS Failure to Complete an Automatic Trip.....ALERT
- 6.3 RPS Failure to Complete a Manual Trip.....SAE
- 6.4 Loss of Dose Assessment Capabilities.....NUE
- 6.5 Loss of Communications.....NUE
- 6.6 Control Room Evacuation.....ALERT
- 6.7 Control Room Evacuation and control of shutdown systems not  
established in 15 minutes.....SAE
- 6.8 Loss of Decay Heat Removal Systems.....ALERT
- 6.9 Loss of Both S/Gs as a Heat Removal Method.....SAE
- 6.10 Loss of Control Room Annunciators.....ALERT
- 6.11 Loss of Control Room Annunciators with a Transient in Progress.....SAE

7.0 HAZARDS TO STATION OPERATION

- 7.1 Security Threat or Attempted Entry or Attempted Sabotage.....NUE
- 7.2 Ongoing Security Threat Within Protected Area Security Fence.....ALERT
- 7.3 Ongoing Security Threat Within Plant Buildings.....SAE
- 7.4 Ongoing Security Threat Within CR or Vital Area.....GE
- 7.5 Fire or Explosion Onsite.....NUE
- 7.6 Fire or Explosion Onsite Affecting One Train of ESF Systems.....ALERT
- 7.7 Fire or Explosion Onsite Affecting Both Trains of ESF Systems.....SAE
- 7.8 Aircraft Crash, Unusual Aircraft Activity, Train Derailment,  
Turbine Failure, Toxic or Flammable Gas.....NUE
- 7.9 Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting One  
Train of ESF Systems.....ALERT
- 7.10 Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting Both  
Trains of ESF Systems.....SAE

8.0 NATURAL EVENTS

- 8.1 Tornado, Flood, Loss of Dardanelle Reservoir, Earthquake.....NUE
- 8.2 Tornado, High Winds, Flood, Loss of Dardanelle Reservoir,  
Earthquake.....ALERT
- 8.3 Tornado, High Winds, Flood, Loss of Dardanelle Reservoir,  
Earthquake.....SAE

9.0 MISCELLANEOUS EVENTS

- 9.1 Plant Conditions Exist Which Require an Increased Awareness by  
Operations Staff and State and/or Local Authorities.....NUE
- 9.2 Plant Conditions Exist that Warrant Activation of the TSC.....ALERT
- 9.3 Plant Conditions Exist that Warrant Activation of the Emergency  
Response Facility.....SAE
- 9.4 Plant Conditions Exist That Make Release of Large Amount of  
Radioactivity Possible.....GE

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>15 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.1

CONDITION:

RCS Activity indicates >0.1% failed fuel

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES All

CRITERIA:

1. Greater than 0.1% failed fuel as indicated by EITHER of the following:
  - A. Nuclear Chemistry analysis of RCS sample yields >40.0  $\mu\text{Ci/gm}$  specific  $\text{I}^{131}$
  - OR
  - B. Failed Fuel Iodine monitor (RE 1237S) indicates  $>3.3 \times 10^5$  CPM

RELATED EALS:

RCS Activity indicates >1% failed fuel High Radiation / Airborne Levels Initiation of Plant S/D or C/D due to T.S. L.C.O.	TAB
	<u>1</u>
	<u>5</u>
	<u>6</u>
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>16 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.2

CONDITION:

RCS Activity indicates >1% failed fuel

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. Greater than 1% failed fuel is indicated by Either of the following:
- A. Nuclear Chemistry analysis of RCS sample yields >400  $\mu\text{Ci/gm}$  specific  $\text{I}^{131}$
- OR
- B. Failed Fuel Iodine monitor (RE 1237S) indicates  $>8.2 \times 10^5$  CPM.

RELATED EALS:

	TAB
RCS Activity indicates >0.1% failed fuel	1
Containment Radiation indicates LOCA and >1% clad failure	1
Loss of or Challenge to 3 Fission Product Barriers	1
Core Damage indicated with an ICC Condition	1
High Radiation/Airborne Levels	5
Initiation of Plant S/D or C/D due to T.S. L.C.O.	6

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>17 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.3

CONDITION:

Core Damage Indicated with an Inadequate Core Cooling Condition

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Inadequate core cooling capacity exists as evidenced by CETS indicating superheated conditions of Region 3 of Figure 4 of EOP 1202.013.
- AND
2. Greater than 1% failed fuel is indicated by EITHER of the following:
- A. Nuclear Chemistry analysis of RCS sample yields >400 µCi/gm specific I<sup>131</sup>
- OR
- B. Failed Fuel Iodine process monitor (RE 1237S) indicates >8.2 x 10<sup>5</sup> CPM.

RELATED EALS:

	TAB
Containment Radiation High/Very High	<u>1</u>
Core Melt	<u>1</u>
Loss of or challenge to 3 Fission Product Barriers	<u>1</u>
RCS Leakage	<u>2</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>18 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.4

CONDITION:

Containment Radiation reading which indicates LOCA and >1% cladding failure

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Containment Radiation Levels correspond to a Site Area Emergency as Determined from the Containment Radiation EAL Plot (Att 5)
- AND
2. LOCA occurring within the containment building

RELATED EALS:

	TAB
Containment Radiation indicates LOCA and > 50% fuel overheat	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Core Melt	<u>1</u>
Radiological Effluents	<u>5</u>

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 19 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.5

CONDITION:

Containment Radiation readings which indicate LOCA and >50% fuel overheat

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

1. Containment Radiation Levels correspond to a General Emergency as determined from the Containment Radiation EAL Plot (Att 5)

AND

2. LOCA occurring within the Containment Building

RELATED EALS:

	TAB
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Radiological Effluents	<u>5</u>
Core Melt	<u>1</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 20 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.6

CONDITION:

Core Melt
-----------

EMERGENCY CLASSIFICATION:

General Emergency  MODES <u>  All  </u>
---

CRITERIA:

1.     CETs indicate superheat conditions of Region 4 of Figure 4 of EOP 1202.013.
--

RELATED EALS:

	TAB
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Containment Radiation High/Very High	<u>1</u>
Radiological Effluents	<u>5</u>



<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 21 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
PRIMARY SYSTEM EVENTS

1.7

CONDITION:

Loss of or challenge to all 3 Fission Product Barriers

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

1. Either of the following conditions exist:
  - A. Fuel Cladding Failure (refer to section 4.15.1)
  - B. Challenge to Fuel Cladding (refer to section 4.16.1)

AND
2. Either of the following conditions exist:
  - A. RCS boundary failure (refer to section 4.15.2)
  - B. Challenge to RCS boundary (refer to section 4.16.2)

AND
3. Either of the following conditions exist:
  - A. Containment Integrity failure (refer to section 4.15.3)
  - B. Challenge to Containment Integrity (refer to section 4.16.3)

RELATED EALS:

TAB

Containment Radiation High/Very High	1
Core Melt	1
Radiological Effluents	5
Natural Events	8

PROC./WORK PLAN NO.  <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE:  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>22 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RCS LEAKAGE

2.1

CONDITION:

RCS Leakage > Tech. Spec. limits requiring a Plant S/D or C/D
---

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>Above CSD</u>
---

CRITERIA:

- |  |
|--|
| <ol style="list-style-type: none"> <li>1. RCS Leakage exceeds T.S. 3.1.6 requirements necessitating a Plant S/D or C/D</li> <li style="text-align: center; padding: 5px 0;"><b>AND</b></li> <li>2. A plant S/D or C/D has been initiated/commenced.</li> </ol> |
|--|

RELATED EALS:

	TAB
RCS Leakage > Normal Makeup Capacity (50 gpm)	2
Initiation of Plant S/D or C/D due to TS LCO	6
OTSG Tube Leak	3

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>23 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RCS LEAKAGE

2.2

CONDITION:

RCS Leakage > Normal Makeup Capacity (50 gpm)

EMERGENCY CLASSIFICATION:

Alert  
MODES Above CSD

CRITERIA:

1. An RCS leak necessitates EITHER of the following:
  - A. Need to open the BWST suction for the operating makeup pump due to a decreasing makeup tank level.
  - OR
  - B. Full or partial HPI is needed to maintain the RCS Pressure or Pressurizer Level

RELATED EALS:

	TAB
RCS Leakage > Normal Makeup Capacity with Failed Fuel Conditions	<u>2</u>
RCS Leakage > HPI Capacity	<u>2</u>
Containment Radiation High/Very High	<u>1</u>
Core Damage Indicated with an ICC Condition	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Radiological Effluents	<u>5</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>24 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RCS LEAKAGE

2.3

CONDITION:

RCS Leakage > Normal Makeup Capacity (50 gpm) with >1.0% Failed Fuel Conditions

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES Above CSD

CRITERIA:

1. RCS Leakage > Normal Makeup Capacity (50 gpm) (EAL 2.2) with >1.0% Failed Fuel in the RCS (EAL 1.2)

**NOTE**

EAL 2.2 RCS Leakage > Normal Makeup Capacity (50 gpm)  
EAL 1.2 RCS Activity Indicates >1% failed fuel

RELATED EALS:

	TAB
Containment Radiation indicates LOCA and fuel failure	<u>1</u>
Core Damage Indicated with an ICC Condition	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Radiological Effluents	<u>5</u>
Core Melt	<u>1</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 25 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
RCS LEAKAGE

2.4

CONDITION:

RCS Leakage > HPI Capacity

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES Above CSD

CRITERIA:

1. RCS Leakage > HPI Capacity as indicated by:
  - A. Full available HPI being injected into the core

AND

  - B. RCS Pressure/Pressurizer Level continues to decrease or RCS Subcooling margin remains inadequate with no indication of recovery.

RELATED EALS:

TAB

Containment Radiation High/Very High Core Damage Indicated with an ICC Condition Loss of or Challenge to 3 Fission Product Barriers Radiological Effluents Core Melt	<hr/> 1 <hr/> 1 <hr/> 1 <hr/> 5 <hr/> 1
--	---

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 26 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SECONDARY SYSTEM EVENTS

3.1

CONDITION:

Uncontrolled OTSG Depressurization Resulting in MSLI Actuation

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES   Above CSD  

CRITERIA:

1. Any manual or automatic actuation of MSLI due to uncontrolled OTSG depressurization.

RELATED EALS:

OTSG Tube Leak Radiological Effluents	TAB
	<u>  3  </u> <u>  5  </u>

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 27 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SECONDARY SYSTEM EVENTS

3.2

CONDITION:

OTSG Tube Leakage  $\geq$  Tech. Spec. Limits

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES Above CSD

CRITERIA:

1. RCS Leak rate of  $\geq$  150 gallons per day (.104 gpm), with coincident Main Steam line N-16 alarm(s), Steam Line High Range RAD Monitors Increase (RI-2681 or 2682) or condenser off gas process monitor count rate increase or Nuclear Chemistry sample indicating Primary-Secondary tube leak.

RELATED EALS:

	TAB
OTSG Tube Leak	<u>3</u>
RCS Leakage	<u>2</u>
Radiological Effluents	<u>5</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>28 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
SECONDARY SYSTEM EVENTS

3.3

CONDITION:

OTSG Tube Leakage > 10 gpm concurrent with ongoing steam release

EMERGENCY CLASSIFICATION:

Alert  
MODES Above CSD

CRITERIA:

1. RCS Leakrate increase of >10 gpm, with coincident Main Steam Line N-16 alarm(s) or condenser off gas process monitor count rate increase, or Steam Line High Range Rad Monitors Increase (RI-2681 or 2682) or Nuclear Chemistry sample indicating Primary-Secondary tube leak.  

AND
2. ANY of the following occur:
  - A. Loss of offsite power
  - B. Steam release to the environment indicated by:
    1. Main Steam Safety Valve(s) lift
    2. Use the ADV(s) to control affected OTSG pressure
    3. P7A running with steam from affected OTSG
    4. Steam line break outside containment

RELATED EALS:

	TAB
OTSG Tube Rupture >50 gpm with ongoing steam release	<u>3</u>
OTSG Tube Leak with failed fuel	<u>3</u>
RCS Leakage	<u>2</u>
Radiological Effluents	<u>5</u>
High Radiation/Airborne Levels	<u>5</u>
Electrical Power Failures	<u>4</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>29 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
SECONDARY SYSTEM EVENTS

3.4

CONDITION:

OTSG Tube Rupture with primary to secondary leakage >normal makeup capacity (50 gpm) with ongoing steam release

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES Above CSD

CRITERIA:

1. OTSG Tube Rupture as indicated by BOTH of the following:
  - A. RCS Leakage > Normal Makeup Capacity (50 gpm)
  - B. Coincident Main Steam line N-16 alarm(s) or condenser off gas process monitor count rate increase or Steam Line High Range Rad Monitors Increase (RI2681 or RI2682) or Nuclear Chemistry Sample indicating Primary-Secondary tube leak.

AND
2. ANY of the following occur:
  - A. Loss of offsite power
  - B. Steam release to the environment indicated by:
    1. Main Steam Safety Valve(s) lift
    2. Use of ADV(s) to control affected OTSG pressure
    3. P7A running with steam from affected OTSG
    4. Steam line break outside containment

RELATED EALS:

	TAB
RCS Leakage	<u>2</u>
Radiological Effluents	<u>5</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Electrical Power Failures	<u>4</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>30 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

SECONDARY SYSTEM EVENTS

3.5

CONDITION:

OTSG Tube Leak >1 gpm with >1% failed fuel with ongoing steam release

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES Above CSD

CRITERIA:

1. OTSG Leakrate increase of >1 gpm, with coincident Main Steam Line N-16 alarm(s), or condenser off gas process monitor countrate increase or Nuclear Chemistry sample indicating Primary-Secondary tube leak.  

AND
2. Greater than 1% failed fuel indicated in the RCS (EAL 1.2)  

AND
3. ANY of the following occur:
  - A. Loss of offsite power
  - B. Steam release to the environment indicated by:
    1. Main Steam Safety Valve(s) lift
    2. Use of ADV(s) to control affected OTSG pressure
    3. P7A running with steam from affected OTSG
    4. Steam line break outside containment

RELATED EALS:

TAB

RCS Leakage	<u>2</u>
Radiological Effluents	<u>5</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Electrical Power Failures	<u>4</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>31 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
ELECTRICAL POWER FAILURES

4.1

CONDITION:

Degraded Power
----------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>All</u>
---

CRITERIA:

- |   |
|---|
| <ol style="list-style-type: none"> <li>1. Only Diesel Generator (Station Blackout Diesel or Emergency Diesel) power is available to 4160V Buses (A3 and/or A4).<br/><br/><p style="text-align: center;"><u>AND</u></p></li> <li>2. No voltage indicated on 6.9 KV <u>AND</u> 4.16 KV nonvital buses (H1, H2, A1, and A2)</li> </ol> |
|---|

RELATED EALS:

Blackout OTSG Tube Leak	<p>TAB</p> <hr style="width: 50%; margin: 0 auto;"/> <p>4</p> <hr style="width: 50%; margin: 0 auto;"/> <p>3</p> <hr style="width: 50%; margin: 0 auto;"/>
----------------------------	--

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 32 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
ELECTRICAL POWER FAILURES

4.2

CONDITION:

Station Blackout

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. All 4160V buses de-energized.

RELATED EALS:

TAB

Blackout more than 15 minutes Loss of Control Room Annunciators	<u>4</u> <u>6</u>
--	----------------------

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 33 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
ELECTRICAL POWER FAILURES

4.3

CONDITION:

Blackout for more than 15 minutes.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. All 4160V buses de-energized for greater than 15 minutes.

RELATED EALS:

	TAB
Electrical Power Failures	<u>4</u>
Loss of Control Room Annunciators	<u>6</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>34 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
ELECTRICAL POWER FAILURES

4.4

CONDITION:

Loss of All Vital DC Power

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. Loss of voltage on ALL of the following busses
  - A. D01 and D02
  - B. RA1 and RA2
  - C. D11 and D21

RELATED EALS:

TAB

Loss of All Vital DC Power for more than 15 minutes	<u>4</u>
Loss of Control Room Annunciators	<u>6</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>35 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 ELECTRICAL POWER FAILURES

4.5

CONDITION:

Loss of All Vital DC Power for more than 15 minutes

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

1. Loss of voltage on ALL of the following busses
  - A. D01 and D02
  - B. RA1 and RA2
  - C. D11 and D21

AND
2. DC power is not restored within 15 minutes

RELATED EALS:

	TAB
Electrical Power Failures	<u>4</u>
Loss of Control Room Annunciators	<u>6</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>36 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.1

CONDITION:

Projected or measured activity at the Site Boundary, averaged over one hour, is greater than or equal to .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE or Liquid radiological effluents exceed ODCM Limitations.

EMERGENCY CLASSIFICATION:

Notification of Unusual Event

MODES All

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected activity at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report activity at the Site Boundary which, when averaged over the previous one hour, exceeds .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE.
  - OR
  - C. Liquid radiological effluents exceed ODCM Limitations.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
High Radiation/Airborne Levels	<u>5</u>
OTSG Tube Leak	<u>3</u>



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>37 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.2

CONDITION:

Projected or measured activity at the Site Boundary, averaged over one hour, is greater than or equal to .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE or Liquid radiological effluents exceed 10 times ODCM Limitations.

EMERGENCY CLASSIFICATION:

Alert  
  
MODES   All  

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected activity at the Site Boundary, as calculated by the RDACS method, indicates greater than or equal to .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report activity at the Site Boundary which, when averaged over the previous one hour, exceeds .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE.
  - OR
  - C. Liquid radiological effluents exceed 10 times ODCM Limitations.

RELATED EALS:

	TAB
Radiological Effluents	5
OTSG Tube Leak	3
Containment Radiation High	1

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 38 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.3

CONDITION:

Radiological Effluents are greater than or equal to 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE at the Site Boundary.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected dose rates at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report dose rates at the Site Boundary are greater than or equal to 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
Containment Radiation High / Very High	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>39 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.4

CONDITION:

Radiological Effluents are greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE at the Site Boundary.

EMERGENCY CLASSIFICATION:

General Emergency

MODES All

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected dose rates at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report dose rates at the Site Boundary are greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE.

RELATED EALS:

	TAB
Core Melt	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Containment Radiation High / Very High	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>40 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.5

CONDITION:

High Radiation/Airborne Levels

EMERGENCY CLASSIFICATION:

Alert  
  
MODES All

CRITERIA:

1. The loss of control of radioactive material results in ANY of the following:

- A. Containment radiation indicates >2R/hr
- B. Area Radiation levels in controlled access (excluding containment) increase by 1 Rem/hr at 2 or more locations.
- C. General area radiation levels outside of radiologically controlled areas increase by 10 mRem/hr.
- D. Airborne levels as follows:
  - Auxiliary Building  $\geq$ 100 DAC (General Area)
  - Turbine Building  $\geq$ 10 DAC

NOTE: "Loss of Control" shall be defined as: ANY radioactive material outside its normal system boundaries. (For Example: spent resin spill, RCS liquid spill, spent fuel accident resulting in gaseous release, etc.)

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
Containment Radiation High	<u>1</u>
Spent Fuel Accident	<u>5</u>
RCS Leakage	<u>2</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>41 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
RADIOLOGICAL EFFLUENTS

5.6

CONDITION:

Spent Fuel Accident

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. The loss of water OR damage to a spent fuel assembly occurs in the Rx core (head removed), refueling canal, spent fuel pool, cask loading pit, fuel tilt pit or any plant area involved in the movement or storage of spent fuel.

AND

2. Radiation levels increase to 10 R/hr on Area Radiation Monitors or 10 Rem/hr HP Survey Report.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
High Radiation/Airborne Levels	<u>5</u>
Miscellaneous Events	<u>9</u>

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 42 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.1

CONDITION:

Deviation from T.S. action statements when required to shutdown or cooldown or deviations pursuant to 10CFR50.54(x)

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
MODES   Above CSD  

CRITERIA:

1. EITHER of the following conditions exist:
  - A. Inability to reach required mode within Tech. Spec. limits.
  - B. Deviation from Tech Specs authorized pursuant to 10CFR50.54(x)

RELATED EALS:

	TAB
RCS Leakage	<u>2</u>
OTSG Tube Leak	<u>3</u>
RCS Activity High	<u>1</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 43 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.2

CONDITION:

Reactor Protection System Failure to Complete an Automatic Trip

EMERGENCY CLASSIFICATION:

Alert  
  
MODES Hot Stdy-Pwr Ops

CRITERIA:

1. A valid RPS trip setpoint is exceeded on ANY TWO RPS channels and the RPS fails to initiate and complete an automatic trip that brings the reactor subcritical.  
  

AND

2. Subsequent efforts to manually trip the Reactor from the Control Room and bring it subcritical are successful.

RELATED EALS:

RELATED EALS:	TAB
RPS Failure to Complete a Manual Trip	<u>6</u>
Core Melt	<u>1</u>
Core Damage Indicated with an ICC Condition	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>44 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.3

CONDITION:

Reactor Protection System Failure to Complete an Manual Trip

EMERGENCY CLASSIFICATION:

Site Area Emergency  
  
MODES Hot Stdy-Pwr Ops

CRITERIA:

1. A valid RPS trip setpoint is exceeded on ANY TWO RPS channels and the RPS fails to initiate and complete an automatic trip that brings the reactor subcritical.
- AND
2. Failure of manual trip function occurs. (Failure to trip the Reactor in the Control Room; i.e., must leave Control Room to trip the Reactor.)

RELATED EALS:

	TAB
Loss of or Challenge to 3 Fission Product Boundaries	<u>1</u>
Core Melt	<u>1</u>
Core Damage Indicated with an ICC Condition	<u>1</u>



<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 45 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.4

CONDITION:

Loss of Dose Assessment Capabilities
--------------------------------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>All</u>
---

CRITERIA:

- |   |
|---|
| <ol style="list-style-type: none"> <li>1. The following conditions exist in the PASS Building: <ol style="list-style-type: none"> <li>A. SPING is inoperable <u>AND</u></li> <li>B. PASS sampling is in progress <u>AND</u></li> <li>C. Inability to obtain and analyze local grab samples every 2 hours.</li> </ol> <p style="text-align: center;"><u>OR</u></p> </li> <li>2. The following conditions exist in the Low Level Radwaste Building: <ol style="list-style-type: none"> <li>A. SPING is inoperable <u>AND</u></li> <li>B. Compacting is in progress <u>AND</u></li> <li>C. Inability to obtain and analyze local grab samples every 2 hours.</li> </ol> <p style="text-align: center;"><u>OR</u></p> </li> <li>3. Reactor Building Purge System or Penetration Ventilation System is not isolable, and the applicable SPING is inoperable. <p style="text-align: center;"><u>OR</u></p> </li> <li>4. All of the following conditions exist for any source of gaseous effluents in the Auxiliary Building or Spent Fuel Storage Building ventilation systems. <ol style="list-style-type: none"> <li>A. Applicable SPING is inoperable <u>AND</u></li> <li>B. Inability to obtain and analyze local grab samples every 2 hours</li> </ol> </li> </ol> |
|---|

RELATED EALS:

None	TAB  <hr/> <hr/>
------	---------------------------

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>46 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 SAFETY SYSTEM FUNCTION

6.5

CONDITION:

Loss of Communications
------------------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>  All  </u>
---

CRITERIA:

- |   |
|---|
| 1. Complete loss of <u>ANY TWO</u> of the following: <ul style="list-style-type: none"> <li>A. Plant telephone systems (Commercial Telephones and microwave)</li> <li>B. Station Radio</li> <li>C. Emergency Notification System</li> </ul> |
|---|

RELATED EALS:

None	TAB  <hr/> <hr/> <hr/>
------	------------------------------

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 47 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.6

CONDITION:

Loss of Control Room Annunciators

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. Loss of both AC and DC power to >50% of control room annunciators.

RELATED EALS:

Loss of Control Room Annunciators with Transient in Progress	TAB
	6

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 48 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.7

CONDITION:

Loss of Control Room Annunciators with Transient in Progress
--

EMERGENCY CLASSIFICATION:

Site Area Emergency  MODES <u>  All  </u>
---

CRITERIA:

- |  |
|--|
| <ol style="list-style-type: none"> <li>1. Loss of both AC and DC power to &gt;50% of control room annunciators.</li> </ol> <p style="text-align: center;"><u>AND</u></p> <ol style="list-style-type: none"> <li>2. A plant transient is initiated or in progress. (See section 4.17 of this procedure for the definition of a Plant Transient.)</li> </ol> |
|--|

RELATED EALS:

None	<b>TAB</b>  _____ _____ _____
------	---

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>49 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 SAFETY SYSTEM FUNCTION

6.8

CONDITION:

Control Room Evacuation

EMERGENCY CLASSIFICATION:

Alert  
 MODES All

CRITERIA:

1. Control Room evacuation is expected to occur OR has already occurred.

RELATED EALS:

	TAB
Control Room Evacuation and control of shutdown systems not established in 15 minutes	<u>6</u>
Fire or explosion onsite affecting both trains of <u>any</u> ES Systems	<u>7</u>

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 50 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.9

CONDITION:

Control Room Evacuation and control of shutdown systems not established in 15 minutes.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Control Room evacuation has occurred AND control of shutdown systems is not established from local stations within 15 minutes.

RELATED EALS:

	TAB
Core Damage Indicated with an ICC Condition	<u>1</u>
Loss of Decay Heat Removal Systems	<u>6</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>51 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
SAFETY SYSTEM FUNCTION

6.10

CONDITION:

Loss of Decay Heat Removal Capabilities

EMERGENCY CLASSIFICATION:

Alert  
MODES CSD-Refueling S/D

CRITERIA:

1. Loss of Decay Heat Removal capabilities shall be identified as ANY of the following:
  - A. RCS indicates saturated conditions
  - B. Loss of both Decay Heat trains for >1 hr and OTSGs are not available for decay heat removal (NA if Fuel Transfer Canal is flooded)
  - C. HPI is required for cooling the reactor core.

RELATED EALS:

	TAB
Core Damage Indicated with an ICC Condition	<u>1</u>
Radiological Effluents	<u>5</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
High Radiation/Airborne Levels	<u>5</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>52 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 SAFETY SYSTEM FUNCTION

6.11

CONDITION:

Degraded Hot Shutdown Capability

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES Above CSD

CRITERIA:

1. Degraded HSD capability shall be identified as ANY of the following:
  - A. Loss of ALL steam removal capability on BOTH OTSGs. (eg. Loss of ALL Turbine Bypass Valves, Atmospheric Dump Valves, and Main Steam Safety Valves)
  - B. Loss of ALL feedwater supply capability on BOTH OTSGs. (eg. Loss of BOTH Main Feedwater Trains and BOTH EFW trains)
  - C. BOTH HPI Trains are inoperable.

RELATED EALS:

	TAB
Core Damage Indicated with an ICC Condition	<u>1</u>
Containment Radiation Very High	<u>1</u>
Core Melt	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>



<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 53 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.1

CONDITION:

Security threat onsite but outside the Protected Area Security Fence (e.g., attempted entry or sabotage which has been stopped outside the security fence).

EMERGENCY CLASSIFICATION:

Notification of Unusual Event

MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

TAB

Ongoing security Threat Inside Protected Area Fence but outside plant buildings

7  
\_\_\_\_\_  
\_\_\_\_\_  
\_\_\_\_\_

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 54 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.2

CONDITION:

Ongoing security threat within the Protected Area Security Fence but outside of plant buildings

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

Ongoing security threat within plant buildings but not in Control Room or vital areas.	TAB <u>7</u>
	<hr/>
	<hr/>
	<hr/>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 55 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.3

CONDITION:

Ongoing security threat within plant buildings but not within the Control Room or vital areas

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

Ongoing security Threat within Control Room or Vital Areas	<b>TAB</b> <u>7</u>
	<hr/>
	<hr/>
	<hr/>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 56 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.4

CONDITION:

Ongoing security threat within the Control Room or vital areas

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

None	TAB
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 57 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.5

CONDITION:

Fire or Explosion Onsite
--------------------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>  All  </u>
---

CRITERIA:

- |  |
|--|
| <ol style="list-style-type: none"> <li>1. Fire within the Protected Area Security Fence which is not extinguished within 10 minutes.</li> </ol> <p style="text-align: center;"><u>OR</u></p> <ol style="list-style-type: none"> <li>2. Explosion causing facility damage.</li> </ol> |
|--|

RELATED EALS:

Fire or Explosion Onsite Affecting One Train of an ES System	<b>TAB</b> <u>  7  </u> _____ _____ _____
--	---

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 58 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.6

CONDITION:

Fire or Explosion Onsite Affecting One Train of ANY ES Systems

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. Fire or explosion onsite

AND

2. A potential or actual loss of a single train of ANY ES system as a result of the fire or explosion

RELATED EALS:

	TAB
Fire or Explosion Onsite Affecting Both Trains of <u>ANY</u> ES System Control Room Evacuation	<u>7</u>
	<u>6</u>
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>59 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.7

CONDITION:

Fire or Explosion Onsite Affecting Both Trains of ANY ES Systems

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Fire or explosion onsite

AND

2. A potential or actual loss of Both trains of ANY ES system as a result of the fire or explosion

RELATED EALS:

Control Room Evacuation and control of shutdown systems not established in 15 minutes	TAB
	<u>6</u>
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>60 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.8

CONDITION:

Aircraft Crash, Unusual Aircraft Activity, Train Derailment, Turbine Failure, Toxic or Flammable Gas Release

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
MODES All

CRITERIA:

1. ANY of the following:
  - A. Aircraft crash onsite.
  - B. Unusual Aircraft activity over the facility.
  - C. Train derailment onsite.
  - D. Turbine rotating component failure causing rapid plant shutdown.
  - E. Toxic or flammable gas release which limits or restricts access to areas required for security or safe operation of the plant.

RELATED EALS:

	TAB
Fire or Explosion Onsite	<u>7</u>
Security Threat	<u>7</u>
Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting One Train of <u>ANY</u> ES System	<u>7</u>
	_____



<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 61 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
HAZARDS TO STATION OPERATION

7.9

CONDITION:

Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting One Train of ANY ES Systems

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. ANY of the following:
  - A. Aircraft crash onsite.
  - B. Missiles/Projectiles from any source
  - C. Toxic or flammable gas release

AND
2. A potential OR actual loss of a single train of ANY ES system

RELATED EALS:

	TAB
Fire or Explosion Onsite Affecting One Train of an ES System	7
Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting Both Trains of <u>ANY</u> ES System	7

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>62 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 HAZARDS TO STATION OPERATION

7.10

CONDITION:

Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting Both Trains of ANY ES System

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

1. ANY of the following:
  - A. Aircraft crash onsite.
  - B. Missiles/Projectiles from any source
  - C. Toxic or flammable gas release

AND
2. A potential OR actual loss of BOTH trains of ANY ES system

RELATED EALS:

Fire or Explosion Onsite Affecting Both Trains of an ES System	TAB
	<u>7</u>
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>63 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 NATURAL EVENTS

8.1

CONDITION:

Tornado, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
 MODES All

CRITERIA:

1. ANY of the following:
  - A. Tornado observed on the ground within the Exclusion Area
  - B. Flood - Lake level  $>340'$  elev. and rising, with forecasted lake level  $\geq 350'$  elev.
  - C. Low Level - Lake level  $<337'$  elev. AND forecasted by U.S. Army Corp of Engineers to reach  $335'$  elev.
  - D. Earthquake - VERIFIED earthquake of magnitude of .01g

RELATED EALS:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake:	TAB <hr/> 8 <hr/> <hr/>
---	-------------------------------

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>64 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 NATURAL EVENTS

8.2

CONDITION:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Alert  
 MODES All

CRITERIA:

1. ANY of the following:
  - A. Tornado striking vital facility structures (e.g. housing ES related equipment)
  - B. High Winds - Sustained winds of  $>60$  mph (10 minute average as reported by RDACS from either the 10 or 57 meter instruments).
  - C. Flood - Flood waters  $>350'$  elev. and are forecasted by U.S. Army Corp of Engineers to reach or exceed  $354'$  elev.
  - D. Low Level - Lake level  $<335'$  elev
  - E. Earthquake - VERIFIED earthquake of magnitude of  $>.1g$
  - F. Any of the above resulting in the potential or actual loss of ONE train of ANY ES system.

RELATED EALS:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake Loss of or challenge to all 3 Fission Product Barriers	TAB
	<u>8</u> <u>1</u> <hr/>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>65 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 NATURAL EVENTS

8.3

CONDITION:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES Above CSD

CRITERIA:

1. ANY of the following:
  - A. High Winds - Sustained winds of  $\geq 67$  mph (10 minute average as reported by RDACS from either the 10 or 57 meter instruments).
  - B. Flood - Flood Water Level is  $>361'$  elev.
  - C. Low Level Lake level  $\leq 335'$  elev. and Emergency Cooling Pond not available
  - D. VERIFIED Earthquake  $\geq 0.2g$
  - E. Tornado, high wind, flood, low lake level or earthquake resulting in the potential or actual loss of BOTH trains of ANY ES system.

RELATED EALS:

Loss of or challenge to all 3 Fission Product Barriers	TAB
	<u>1</u>
	<hr/>
	<hr/>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 66 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 3  
UNIT 1  
MISCELLANEOUS EVENTS

9.1

CONDITION:

Other plant conditions exist that warrant increased awareness on the part of the operating staff and state and/or local offsite authorities or involve other than normal controlled shutdown.

EMERGENCY CLASSIFICATION:

Notification of Unusual Event

MODES   All  

CRITERIA:

An event has occurred and the following conditions exist:

1. This event is not covered by any other EAL

AND

2. This event does not challenge or cause the loss of a fission product barrier

AND

3. In the judgement of the SS/TSC Director/EOF Director this event requires an increased awareness by the ANO staff and offsite authorities.

RELATED EALS:

Plant Conditions Exist that Warrant Precautionary Activation of the TSC	TAB
	<u>    9    </u>
	<hr/>
	<hr/>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>67 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 MISCELLANEOUS EVENTS

9.2

CONDITION:

Other plant conditions exist that warrant precautionary activation of the Technical Support Center and placing the near-site Emergency Operations Facility and other key emergency personnel on standby.

EMERGENCY CLASSIFICATION:

Alert  
 MODES   All  

CRITERIA:

The following conditions must exist

1. This event is not covered by any other EAL.

AND

2. This event must either challenge or cause the loss of a fission product barrier.

OR

Plant conditions exist that warrant activation of the Emergency Response Organization.

RELATED EALS:

Plant Conditions Exist that Warrant Activation of the Emergency Response Centers.	TAB
	<u>  9  </u> <hr/> <hr/>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>68 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 MISCELLANEOUS EVENTS

9.3

CONDITION:

Other plant conditions exist that warrant activation of the emergency response facilities and monitoring teams or a precautionary notification to the public near the site.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

The following conditions must exist

1. This event is not covered by any other EAL.

AND

2. The event must cause ANY of the following:
  - A. Challenge two fission product barriers
  - B. Failure of one fission product barrier and a challenge to another
  - C. Failure of Two fission product barriers

RELATED EALS:

Plant Conditions Exist that Make Release of Large Amounts of Radioactivity Possible	TAB <u>9</u> <hr/> <hr/>



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>69 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 3  
 UNIT 1  
 MISCELLANEOUS EVENTS

9.4

CONDITION:

Plant Conditions Exist That Make Release of Large Amounts of Radioactivity Possible

EMERGENCY CLASSIFICATION:

General Emergency  
 MODES All

CRITERIA:

The following conditions must exist:

1. This event is not covered by any other EAL

AND

2. Events have occurred that make a release of large amounts of radioactivity in a short period of time possible.

RELATED EALS:

None	TAB

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>70 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 PRIMARY SYSTEM EVENTS

1.1

CONDITION:

RCS Activity indicates >0.1% failed fuel

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
 MODES 1-5

CRITERIA:

1. Greater than 0.1% failed fuel as indicated by EITHER of the following:
  - A. Selected isotope activity ( $I^{131}$ )  $>5.5E^5$  CPM (2RR4806 on 2C14 or 2RITS 4806B on 2C22)
  - B. Specific  $I^{131}$  sample results  $>37.8$   $\mu$ Ci/gm

RELATED EALS:

	TAB
RCS Activity	<u>1</u>
T.S. L.C.O.'s	<u>6</u>
General Area Radiation/Airborne	<u>5</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 71 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.2

CONDITION:

RCS Activity indicates >1.0% failed fuel

EMERGENCY CLASSIFICATION:

Alert  
MODES 1-5

CRITERIA:

1. Greater than 1% failed fuel as indicated by RCS Sample Analysis  
>378  $\mu\text{Ci/gm}$  specific  $\text{I}^{131}$

RELATED EALS:

	TAB
General Area Radiation/Airborne	<u>5</u>
Containment Radiation	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Core Damage/ICC	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>72 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.3

CONDITION:

Core Damage Indicated with an Inadequate Core Cooling Condition

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES 1-5

CRITERIA:

1. Greater than 1% failed fuel as indicated by RCS sample analysis  
>378  $\mu\text{Ci/gm}$  Specific  $\text{I}^{131}$   
  

AND
2. Inadequate core cooling capacity exists as indicated by ANY of the following:
  - A. Th RTD and average CET temperature indicates >10°F superheat  
**AND** RVLMS LVL 7 or Lower indicates Dry.
  - B. Th RTD and average CET temperature indicates >10°F superheat  
with both RVLMS Channels inoperable **AND** RCS temperatures  
increasing.
  - C. CET Temperatures indicate greater than 700°F.

RELATED EALS:

	TAB
Decay Heat Removal	<u>6</u>
Containment Radiation	<u>1</u>
Core Melt	<u>1</u>
RCS Leakage	<u>2</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 73 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.4

CONDITION:

Containment Radiation readings which indicate LOCA and >1% cladding failure

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Containment Radiation Levels correspond to a Site Area Emergency as determined from the containment radiation EAL plot (Att 6)
- AND**
2. LOCA occurring within the Containment Building

RELATED EALS:

	TAB
Containment Radiation	<u>1</u>
Loss of or challenge to 3 Fission Product Barriers	<u>1</u>
Radiological Effluents	<u>5</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>74 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.5

CONDITION:

Containment Radiation readings which indicate LOCA and >50% fuel overheat

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

1. Containment Radiation Levels correspond to a General Emergency as determined from the containment radiation EAL plot (Att 6)

AND

2. LOCA occurring within the Containment Building

RELATED EALS:

	TAB
Loss of or challenge to 3 Fission Product Barriers	<u>1</u>
Radiological Effluents	<u>5</u>
Core Melt	<u>1</u>
	<u>    </u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>75 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.6

CONDITION:

Core Melt with Containment Integrity Lost or Challenged

EMERGENCY CLASSIFICATION:

General Emergency  
 MODES All

CRITERIA:

1. ANY of the following events occur
  - A. Small or Large LOCA and a complete failure of ALL ECCS systems occurs.
  - B. Loss of ALL feedwater AND S/G Level in both S/G's is  $\leq 70$ " (Wide Range) AND a complete failure of ALL ECCS Systems occurs.
  - C. Anticipated transient without a Rx trip

AND
2. Containment Integrity is lost OR challenged as defined by 4.15.3 or 4.16.3 (Definitions)

RELATED EALS:

TAB

Loss of or challenge to 3 Fission Product Barriers  
 Containment Radiation  
 Radiological Effluents

1
1
5

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 76 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
PRIMARY SYSTEM EVENTS

1.7

CONDITION:

Loss of or challenge to all 3 Fission Product Barriers

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

1. Either of the following conditions exist:
  - A. Fuel Cladding Failure (refer to section 4.15.1)
  - B. Challenge to Fuel Cladding (refer to section 4.16.1)

AND
2. Either of the following conditions exist:
  - A. RCS boundary failure (refer to section 4.15.2)
  - B. Challenge to RCS boundary (refer to section 4.16.2)

AND
3. Either of the following condition exist
  - A. Containment Integrity failure (refer to section 4.15.3)
  - B. Challenge to Containment Integrity (refer to section 4.16.3)

RELATED EALS:

	TAB
Containment Radiation	<u>1</u>
Core Melt	<u>1</u>
Radiological Effluents	<u>5</u>
Natural Events	<u>8</u>



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>77 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
RCS LEAKAGE

2.1

CONDITION:

RCS Leakage > Tech. Spec. Limits requiring a plant S/D or C/D

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES 1-4

CRITERIA:

1. RCS Leakage exceeds ANY of the following limits: (T.S. 3.4.6.2)
  - A. RCS pressure boundary leakage >0
  - B. Unidentified RCS Leakage >1 gpm
  - C. Identified RCS Leakage >10 gpm
  - D. RCS Pressure Isolation Valves Leakage > T.S. Table 3.4.6.-1 limits

AND
2. A Plant S/D or C/D has been initiated/commenced

RELATED EALS:

	TAB
RCS Leakage	<u>2</u>
T.S. L.C.O.'s	<u>6</u>
Primary to Secondary Leakage	<u>3</u>
General Area Radiation/Airborne	<u>5</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>78 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 RCS LEAKAGE

2.2

CONDITION:

RCS Leakage > 44 gpm

EMERGENCY CLASSIFICATION:

Alert  
 MODES 1-4

CRITERIA:

1. RCS Leakage is >44 gpm (Capacity of a single Charging Pump).

RELATED EALS:

	TAB
RCS Leakage	<u>2</u>
General Area Radiation/Airborne	<u>5</u>
Containment Radiation	<u>1</u>
Decay Heat Removal	<u>6</u>
Primary to Secondary Leakage	<u>3</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>79 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
RCS LEAKAGE

2.3

CONDITION:

RCS Leakage > 44 gpm with ICC Conditions

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES 1-4

CRITERIA:

1. RCS Leakage is >44 gpm (Capacity of a single Charging Pump).  

AND
2. Inadequate Core Cooling conditions exist as indicated by ANY of the following:
  - A. Th RTD and average CET temperature indicates >10°F superheat **AND** RVLMS LVL 7 or Lower indicates Dry.
  - B. Th RTD and average CET temperature indicates >10°F superheat with both RVLMS Channels inoperable **AND** RCS temperature increasing.
  - C. CET Temperatures indicate greater than 700°F.

RELATED EALS:

	TAB
Core Damage/ICC	<u>1</u>
Radiological Effluents	<u>5</u>
Containment Radiation	<u>1</u>
Core Melt	<u>1</u>
Loss of or challenge to 3 Fission Product Barriers	<u>1</u>
Primary to Secondary Leakage	<u>3</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 80 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
SECONDARY SYSTEM EVENTS

3.1

CONDITION:

Uncontrolled S/G Depressurization Resulting in MSIS Actuation

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES 1-4

CRITERIA:

1. Any actuation of MSIS due to uncontrolled Steam Generator depressurization.

RELATED EALS:

	TAB
Primary to Secondary Leakage	<u>3</u>
Radiological Effluents	<u>5</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 81 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
SECONDARY SYSTEM EVENTS

3.2

CONDITION:

S/G Tube Leak > Tech Spec Limits
----------------------------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>  1-4  </u>
---

CRITERIA:

- |  |
|--|
| <p>1. Primary to Secondary Leakage exceeds <u>EITHER</u> of the following limits</p> <p style="margin-left: 40px;">A. Total leakage through both S/G's is &gt; 300 gallons per day (0.2083 gpm)</p> <p style="text-align: center; margin-left: 80px;"><u>OR</u></p> <p style="margin-left: 40px;">B. Leakage to 1 S/G is &gt; 150 gallons per day (0.1042 gpm)</p> |
|--|

RELATED EALS:

	TAB
RCS Leakage	<u>  2  </u>
Primary to Secondary Leakage	<u>  3  </u>
Radiological Effluents	<u>  5  </u>
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b>  <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b>  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 82 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
SECONDARY SYSTEM EVENTS

3.3

CONDITION:

S/G Tube Leak >10 gpm with an Ongoing Steam Release

EMERGENCY CLASSIFICATION:

Alert  
  
MODES   1-4  

CRITERIA:

1. S/G tube leak >10 gpm with a Steam Release in Progress as indicated by ANY of the following:
  - A. Main Steam Safety Valves maintaing S/G Pressure
  - B. SDBCS Atmospheric Dump Valves in Use
  - C. Steam Line Break Outside of Containment
  - D. 2P7A is in use and continued operation is required to maintain S/G levels.

RELATED EALS:

	TAB
Primary to Secondary Leakage	<u>  3  </u>
RCS Leakage	<u>  2  </u>
General Area Radiation/Airborne	<u>  5  </u>
Radiological Effluents	<u>  5  </u>
Electrical Power	<u>  4  </u>
	<u>  </u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>83 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
SECONDARY SYSTEM EVENTS

3.4

CONDITION:

Steam Generator Tube Rupture >44 gpm With an Ongoing Steam Release and RCS Activity > 1.0 µCi/gm.

EMERGENCY CLASSIFICATION:

Site Area Emergency

MODES 1-4

CRITERIA:

1. S/G tube leak >44 gpm with a Steam Release in Progress as indicated by ANY of the following:
  - A. Main Steam Safety Valve(s) maintaining S/G Pressure
  - B. SDBCS Atmospheric Dump Valve(s) in Use
  - C. Steam Line Break Outside of Containment
  - D. 2P7A is in use and continued operation is required to maintain S/G levels.

AND
2. RCS Activity > 1.0 µCi/gm (T.S. 3.4.8)

RELATED EALS:

TAB

RCS Leakage	<u>2</u>
Radiological Effluents	<u>5</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Core Melt	<u>1</u>
Electrical Power	<u>4</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>84 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 ELECTRICAL POWER FAILURES

4.1

CONDITION:

Degraded Power
----------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>All Modes</u>
---

CRITERIA:

- |  |
|--|
| <ol style="list-style-type: none"> <li>1. Temporary Loss of Normal Control Room Lighting<br/><br/> <div style="text-align: center;"><u>AND</u></div> </li> <li>2. No voltage indicated on Both 4.16 KV nonvital busses (2A1 &amp; 2A2)<br/><br/> <div style="text-align: center;"><u>AND</u></div> </li> <li>3. At least one Emergency Diesel or Station Blackout Diesel started and supplying a vital bus (2A3 or 2A4)</li> </ol> |
|--|

RELATED EALS:

	TAB
Electrical Power	<u>4</u>
MSIS	<u>3</u>
Primary to Secondary Leak	<u>3</u>
	_____
	_____
	_____



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>85 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 ELECTRICAL POWER FAILURES

4.2

CONDITION:

Station Blackout

EMERGENCY CLASSIFICATION:

Alert  
 MODES All Modes

CRITERIA:

1. Loss of all Control Room Lighting except emergency DC Lights  
AND
2. No voltage indicated on Both 4.16 KV nonvital busses. (2A1 and 2A2)  
AND
3. No voltage indicated on Both 4.16 KV vital busses (2A3 and 2A4)

RELATED EALS:

	TAB
Electrical Power	<u>4</u>
Communications, Dose Assessment	<u>6</u>
Primary to Secondary Leak	<u>3</u>
Decay Heat Removal	<u>6</u>
Core Melt	<u>1</u>
	<u>  </u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 86 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
ELECTRICAL POWER FAILURES

4.3

CONDITION:

Loss of All Vital DC

EMERGENCY CLASSIFICATION:

Alert

MODES 1-4

CRITERIA:

1. Loss of All of the following busses has occurred:
  - A. 2D01 and 2D02
  - B. 2RA1 and 2RA2
  - C. 2D21 and 2D23
  - D. 2D22 and 2D24

RELATED EALS:

TAB

Electrical Power  
Communications, Dose Assessment

4
6

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>87 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 ELECTRICAL POWER FAILURES

4.4

CONDITION:

Blackout >15 minutes.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

1. Blackout has occurred as indicated by ALL of the following:
  - A. Loss of all Control Room lighting except emergency DC lights
  - B. No voltage indicated on Both 4.16 KV nonvital busses (2A1 and 2A2)
  - C. Neither Vital 4.16 KV Buss energized (2A3 or 2A4)

AND
2. The Blackout Condition exists for >15 minutes

RELATED EALS:

	TAB
Decay Heat Removal	<u>6</u>
Electrical Power	<u>4</u>
Primary to Secondary Leakage	<u>3</u>
Core Melt	<u>1</u>
Radiological Effluents	<u>5</u>
	<u>  </u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 88 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
ELECTRICAL POWER FAILURES

4.5

CONDITION:

Loss of ALL Vital DC for >15 minutes

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. Loss of both of the following trains of DC Busses has occurred:
- | <u>RED TRAIN</u> | <u>GREEN TRAIN</u> |
|------------------|--------------------|
| 2D01             | 2D02               |
| 2RA1             | 2RA2               |
| 2D21             | 2D22               |
| 2D23             | 2D24               |
- AND
2. Power is not restored to at least one train within 15 minutes

RELATED EALS:

	TAB
Communications, Dose Assessment	6
Decay Heat Removal	6
Core Melt	1
Radiological Effluents	5

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>89 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
RADIOLOGICAL EFFLUENTS

5.1

CONDITION:

Projected or measured activity at the Site Boundary, averaged over one hour, is greater than or equal to .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE or Liquid radiological effluents exceed ODCM Limitations.

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
MODES   All  

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected activity at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report activity at the Site Boundary which, when averaged over the previous one hour, exceeds .05 mrem/hr TEDE or .15 mrem/hr Child Thyroid CDE.
  - OR
  - C. Liquid radiological effluents exceed ODCM Limitations.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
General Area Radiation/Airborne	<u>5</u>
Primary to Secondary Leak	<u>3</u>
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 90 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
RADIOLOGICAL EFFLUENTS

5.2

CONDITION:

Projected or measured activity at the Site Boundary, averaged over one hour, is greater than or equal to .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE or Liquid radiological effluents exceed 10 times ODCM Limitations.

EMERGENCY CLASSIFICATION:

Alert  
  
MODES   All  

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected activity at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE.

OR

  - B. Offsite monitoring teams report activity at the Site Boundary which, when averaged over the previous one hour, exceeds .5 mrem/hr TEDE or 1.5 mrem/hr Child Thyroid CDE.

OR

  - C. Liquid radiological effluents exceed 10 times ODCM Limitations.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
Primary to Secondary Leak	<u>3</u>
Containment Radiation	<u>1</u>
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 91 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
RADIOLOGICAL EFFLUENTS

5.3

CONDITION:

Radiological Effluents are greater than or equal to 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE at the Site Boundary.

EMERGENCY CLASSIFICATION:

Site Area Emergency

MODES All

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected dose rates at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to 50 mrem/hr TEDE or 150 mRem/hr Child Thyroid CDE.

OR

  - B. Offsite monitoring teams report dose rates at the Site Boundary are greater than or equal to 50 mrem/hr TEDE or 150 mrem/hr Child Thyroid CDE.

RELATED EALS:

	TAB
Radiological Effluents	5
Containment Radiation	1
Loss of or Challenge to 3 Fission Product Barriers	1
Core Melt	1

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>92 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 RADIOLOGICAL EFFLUENTS

5.4

CONDITION:

Radiological Effluents are greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE at the Site Boundary.

EMERGENCY CLASSIFICATION:

General Emergency  
 MODES All

CRITERIA:

1. Radiological Release which exceeds ANY of the following limits
  - A. Projected dose rates at the Site Boundary, as calculated by the RDACS method, indicate greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE.
  - OR
  - B. Offsite monitoring teams report dose rates at the Site Boundary are greater than or equal to 250 mrem/hr TEDE or 500 mrem/hr Child Thyroid CDE.

RELATED EALS:

	TAB
Core Melt	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Containment Radiation	<u>1</u>
	_____
	_____



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>93 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
RADIOLOGICAL EFFLUENTS

5.5

CONDITION:

High Radiation/Airborne Levels

EMERGENCY CLASSIFICATION:

Alert  
  
MODES All

CRITERIA:

1. The loss of control of radioactive material results in ANY of the following:

- A. Containment radiation indicates >2R/hr
- B. Area Radiation levels in controlled access (excluding containment) increase by 1 Rem/hr at 2 or more locations.
- C. General area radiation levels outside of radiologically controlled areas increase by 10 mRem/hr.
- D. Airborne levels as follows:
  - Auxiliary Building  $\geq 100$  DAC (General Area)
  - Turbine Building  $\geq 10$  DAC

NOTE: "Loss of Control" Shall be defined as: Any Radioactive material outside its normal system boundaries.  
(For Example: Spent resin spill, RCS liquid spill, Spent fuel accident resulting in gaseous release, etc.)

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
Containment Radiation	<u>1</u>
Spent Fuel Damage	<u>5</u>
RCS Leakage	<u>2</u>
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 94 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
RADIOLOGICAL EFFLUENTS

5.6

CONDITION:

Spent Fuel Accident

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES All

CRITERIA:

1. The loss of water OR damage to a spent fuel assembly occurs in the Rx core (head removed), refueling canal, spent fuel pool, cask loading pit, fuel tilt pit or any plant area involved in the movement or storage of spent fuel.
- AND
2. Radiation levels increase to 10 R/hr by Area Radiation Monitors or 10 Rem/hr HP survey report.

RELATED EALS:

	TAB
Radiological Effluents	<u>5</u>
General Area Radiation/Airborne	<u>5</u>
Miscellaneous	<u>9</u>

PROC./WORK PLAN NO.  <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE:  <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>95 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
UNIT 2  
SAFETY SYSTEM FUNCTION

6.1

CONDITION:

Deviation from T.S. action statements when required to shutdown or cooldown or deviations pursuant to 10CFR50.54(x)

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
 MODES   1-4  

CRITERIA:

1. EITHER of the following conditions exist:
  - A. Inability to reach required mode within Tech. Spec. limits.
  - B. Deviation from Tech Specs authorized pursuant to 10CFR50.54(x)

RELATED EALS:

	TAB
RCS Leakage	<u>  2  </u>
Primary to Secondary Leakage	<u>  3  </u>
RCS Activity	<u>  1  </u>
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 96 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	--

ATTACHMENT 4  
UNIT 2  
SAFETY SYSTEM FUNCTION

6.2

CONDITION:

Reactor Protection System Failure to Complete an Automatic Trip

EMERGENCY CLASSIFICATION:

Alert  
MODES 1-2

CRITERIA:

1. A valid RPS trip setpoint is exceeded  

AND
2. Ten (10) or more CEAs fail to insert as result of the automatic trip  

AND
3. CEAs are inserted either by manual trip or DSS.

RELATED EALS:

	TAB
RPS Failure	<u>6</u>
Core Melt	<u>1</u>
Core Damage/ICC	<u>1</u>
	_____
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>97 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.3

CONDITION:

Reactor Protection System Failure to Complete a Manual Trip

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES 1-2

CRITERIA:

1. A valid RPS trip setpoint is exceeded  

AND
2. Ten (10) or more CEAs fail to insert after the RPS, DSS and manual trip  
 (Example: 2B7 & 2B8 feeder breakers opened to insert CEAs due to a failure of automatic and manual RPS trips.)

RELATED EALS:

	TAB
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Core Melt	<u>1</u>
Core Damage/ICC	<u>1</u>
	_____
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>98 of 124</b> REV: <b>34</b> CHANGE:
--	--	---

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.4

CONDITION:

Loss of Dose Assessment Capabilities
--------------------------------------

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  MODES <u>All</u>
---

CRITERIA:

- |   |
|---|
| <ol style="list-style-type: none"> <li>1. The following conditions exist in the PASS Building:           <ol style="list-style-type: none"> <li>A. SPING is inoperable</li> <li>B. PASS sampling is in progress</li> <li>C. Inability to obtain and analyze local grab samples every 2 hours.</li> </ol> <p style="text-align: center;"><u>OR</u></p> </li> <li>2. The following conditions exist in the Low Level Radwaste Building:           <ol style="list-style-type: none"> <li>A. SPING is inoperable</li> <li>B. Compacting is in progress</li> <li>C. Inability to obtain and analyze local grab samples every 2 hours.</li> </ol> <p style="text-align: center;"><u>OR</u></p> </li> <li>3. Reactor Building Purge penetration is not isolable and both the applicable SPING and the Process Radiation Monitor are inoperable.           <p style="text-align: center;"><u>OR</u></p> </li> <li>4. All of the following conditions exist for any source of gaseous effluents in the Auxiliary Building, Auxiliary Extension Building, or Spent Fuel Storage Building ventilation systems.           <ol style="list-style-type: none"> <li>A. Applicable SPING is inoperable</li> <li>B. Applicable Process Radiation Monitor is inoperable</li> <li>C. Inability to obtain and analyze local grab samples every 2 hours.</li> </ol> </li> </ol> |
|---|

RELATED EALS:

Communications, Dose Assessment	TAB <hr style="width: 50%; margin: 0 auto;"/> 6
---------------------------------	--

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 99 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	--

SAFETY SYSTEM FUNCTION

6.5

CONDITION:

Loss of Communications

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
 MODES All

CRITERIA:

1. Complete loss of ANY TWO of the following:
  - A. Plant telephone systems (Commercial telephones and microwave)
  - B. Station Radio
  - C. Emergency Notification System

RELATED EALS:

None	<b>TAB</b> <hr/> <hr/> <hr/> <hr/> <hr/> <hr/>
------	---

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 100 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
SAFETY SYSTEM FUNCTION

6.6

CONDITION:

Control Room Evacuation

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. Control Room evacuation is expected to occur OR has already occurred

RELATED EALS:

Control Room Evacuation	TAB
	<u>6</u>
	_____
	_____
	_____
	_____



PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>101 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.7

CONDITION:

Control Room Evacuation and control of shutdown systems not established in 15 minutes.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES   1-4  

CRITERIA:

1. Control Room evacuation has occurred AND control of shutdown systems is not established from local stations within 15 minutes.

RELATED EALS:

	TAB
Core Damage/ICC	<u>  1  </u>
Decay Heat Removal	<u>  6  </u>
Core Melt	<u>  1  </u>
	_____
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>102 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
UNIT 2  
SAFETY SYSTEM FUNCTION

6.8

CONDITION:

Loss of Decay Heat Removal Capabilities

EMERGENCY CLASSIFICATION:

Alert  
MODES 5-6

CRITERIA:

1. Loss of Decay Heat Removal capabilities shall be identified as ANY of the following:
  - A. RCS indicates saturated conditions
  - B. Loss of both shutdown cooling trains for >1 hr and S/G's not available for decay heat removal (NA if Fuel Transfer Canal >23 ft)
  - C. HPSI injection required for cooling the core

RELATED EALS:

	TAB
Spent Fuel Accident	<u>5</u>
Core Damage/ICC	<u>1</u>
Radiological Effluents	<u>5</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
High Radiation/Airborne	<u>5</u>
Core Melt	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>103 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.9

CONDITION:

Loss of Both S/Gs as a Heat Removal Method

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES 1-4

CRITERIA:

1. ALL of the following conditions exist:
  - A. S/G level in BOTH S/Gs is <70"
  - AND
  - B. ECCS Vent System is utilized

RELATED EALS:

	TAB
Containment Radiation	<u>1</u>
RCS Leakage	<u>2</u>
Core Melt	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>104 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.10

CONDITION:

Loss of Control Room Annunciators

EMERGENCY CLASSIFICATION:

Alert  
 MODES ALL

CRITERIA:

1. Loss of **BOTH** AC and DC power to 9 or more of the Control Room Annunciator Panels.

RELATED EALS:

	TAB
Loss of Control Room Annunciators with a Transient in progress Electrical Power	<u>6</u> <u>4</u> <hr/> <hr/> <hr/>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>105 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 SAFETY SYSTEM FUNCTION

6.11

CONDITION:

Loss of Control Room Annunciators with a Transient in Progress

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES ALL

CRITERIA:

1. Loss of **BOTH** AC and DC power to 9 or more of the Control Room Annunciator Panels.
- AND**
2. A plant transient is initiated **OR** in progress. (See Section 4.17 of this procedure for the definition of a Plant Transient).

RELATED EALS:

	TAB
Electrical Power	4
	_____
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 106 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.1

CONDITION:

Security threat onsite but outside the Protected Area Security Fence (e.g. attempted entry or sabotage which has been stopped outside the security fence).

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
MODES   All  

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

	TAB
Security Threat	<u>  7  </u> <hr style="border: 0; border-top: 1px solid black; margin: 2px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 2px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 2px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 2px 0;"/> <hr style="border: 0; border-top: 1px solid black; margin: 2px 0;"/>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 107 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.2

CONDITION:

Ongoing security threat within the Protected Area Security Fence but outside of plant buildings.

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

	TAB
Security Threat	<u>7</u>
Fire or Explosion	<u>7</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 108 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.3

CONDITION:

Ongoing security threat within plant buildings but not within the Control Room or vital areas.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES   All  

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

	TAB
Security Threat	<u>  7  </u>
Fire/Explosion	<u>  7  </u>
	<u>      </u>
	<u>      </u>
	<u>      </u>
	<u>      </u>



<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 109 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.4

CONDITION:

Ongoing security threat within the Control Room or vital areas.

EMERGENCY CLASSIFICATION:

General Emergency  
MODES All

CRITERIA:

Same as the Condition stated above.

RELATED EALS:

None	TAB
	_____
	_____
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 110 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.5

CONDITION:

Fire or Explosion Onsite

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES All

CRITERIA:

1. Fire within the Protected Area Security Fence which is not extinguished within 10 minutes.

OR

2. Explosion causing facility damage.

RELATED EALS:

	TAB
Fire or Explosion Security Threat	7 7
	_____
	_____
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>111 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 HAZARDS TO STATION OPERATION

7.6

CONDITION:

Fire or Explosion Onsite affecting One Train of ESF Systems

EMERGENCY CLASSIFICATION:

Alert  
 MODES   All  

CRITERIA:

1. Fire or explosion onsite  
       AND
2. A potential or actual loss of a single train of ANY ESF system as a result of the fire or explosion.

RELATED EALS:

	TAB
Fire or Explosion	<u>7</u>
Communications, Dose Assessment	<u>6</u>
Control Room Evacuation	<u>6</u>
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>112 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 HAZARDS TO STATION OPERATION

7.7

CONDITION:

Fire or Explosion Onsite affecting Both Trains of ESF Systems

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

1. Fire or explosion onsite  
AND
2. A potential or actual loss of Both trains of ANY ESF system as a result of the fire or explosion.

RELATED EALS:

	TAB
Communications, Dose Assessment	<u>6</u>
Control Room Evacuation	<u>6</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 113 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.8

CONDITION:

Aircraft Crash, Unusual Aircraft Activity, Train Derailment, Turbine failure, Toxic or Flammable Gas

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
  
MODES All

CRITERIA:

1. ANY of the following
  - A. Aircraft crash onsite
  - B. Unusual Aircraft activity over the facility
  - C. Train derailment onsite
  - D. Turbine rotating component failure causing rapid plant shutdown
  - E. Toxic or flammable gas release which limits or restricts access to areas required for security or safe operation of the plant.

RELATED EALS:

	TAB
Fire or Explosion	<u>7</u>
Security Threat	<u>7</u>
MSIS	<u>3</u>
Other Hazards	<u>7</u>
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 114 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
HAZARDS TO STATION OPERATION

7.9

CONDITION:

Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting One Train of ESF Systems

EMERGENCY CLASSIFICATION:

Alert  
MODES   All  

CRITERIA:

1. ANY of the following
  - A. Aircraft crash onsite
  - B. Missiles/Projectiles from any source
  - C. Toxic or flammable gas release

AND
2. A potential OR actual loss of a single train of ANY ESF system

RELATED EALS:

	TAB
Fire or Explosion	<u>7</u>
Other Hazards	<u>7</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>115 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 HAZARDS TO STATION OPERATION

7.10

CONDITION:

Aircraft Crash, Missiles, Toxic or Flammable Gas Affecting Both Redundant ESF Trains

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

1. ANY of the following
  - A. Aircraft crash onsite
  - B. Missiles/Projectiles from any source
  - C. Toxic or flammable gas release

AND
2. A potential OR actual loss of BOTH trains of ANY ESF system

RELATED EALS:

	TAB
Fire or Explosion	7
	_____
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 116 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
NATURAL EVENTS

8.1

CONDITION:

Tornado, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Notification of Unusual Event  
MODES   All  

CRITERIA:

1. ANY of the following
  - A. Tornado observed on the ground within the Exclusion Area
  - B. Flood - Lake level  $\geq 340'$  elev. and rising with forecasted lake level  $\geq 350'$  elev.
  - C. Low Level - Lake level  $< 337'$  AND forecasted by U.S. Army Corp of Engineers to reach 335'
  - D. Earthquake - VERIFIED earthquake of magnitude of .01g

RELATED EALS:

	TAB
Natural Events	<u>  8  </u> _____ _____ _____ _____



<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 117 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
NATURAL EVENTS

8.2

CONDITION:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Alert  
MODES All

CRITERIA:

1. ANY of the following

- A. Tornado striking vital facility structures (e.g. housing ES related equipment)
- B. High Winds - Sustained winds of >72 mph (10 minute average as reported by RDACS from either the 10 or 57 meter instruments).
- C. Flood - Flood waters  $\geq 350'$  and are forecasted by U.S. Army Corp of Engineers to reach or exceed 354'
- D. Low Level - Lake level  $\leq 335'$  elevation
- E. Earthquake - VERIFIED Earthquake of magnitude  $\geq .1g$

OR

Any natural event resulting in the potential or actual loss of ONE train of ANY ES system

RELATED EALS:

Natural Events Loss of or challenge to all 3 Fission Product Barriers	<b>TAB</b>  <u>8</u> <u>1</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE:</b> 118 of 124 <b>REV:</b> 34 <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
NATURAL EVENTS

8.3

CONDITION:

Tornado, High Winds, Flood, Loss of Dardanelle Reservoir, Earthquake

EMERGENCY CLASSIFICATION:

Site Area Emergency  
MODES 1-4

CRITERIA:

1. ANY of the following
  - A. High Winds - Sustained winds of >80 mph (10 minute average as reported by RDACS from either the 10 or 57 meter instruments).
  - B. Flood - Flood Water Level is >361' elev.
  - C. Low Level - Lake level <335' elev. and Emergency Cooling Pond not available.
  - D. VERIFIED Earthquake  $\geq 0.2g$
  - E. Tornado, high wind, flood, low lake level or earthquake resulting in the potential or actual loss of BOTH trains of ANY ESF system.

RELATED EALS:

	TAB
Loss of or challenge to all 3 Fission Product Barriers	1
	_____
	_____
	_____
	_____

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 119 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
MISCELLANEOUS EVENTS

9.1

CONDITION:

Other plant conditions exist that warrant increased awareness on the part of the operating staff and state and/or local offsite authorities or involve other than normal controlled shutdown.

EMERGENCY CLASSIFICATION:

Notification of Unusual Event

MODES   All  

CRITERIA:

An event has occurred and the following conditions exist:

1. This event is not covered by any other EAL

AND

2. This event does not challenge or cause the loss of a fission product barrier

AND

3. In the judgement of the SS/TSC Director/EOF Director this event requires an increased awareness by the ANO Staff and offsite authorities.

RELATED EALS:

	TAB
RCS Activity	<u>1</u>
RCS Leakage	<u>2</u>
Primary to Secondary Leak	<u>3</u>
Radiological Effluents	<u>5</u>
T.S. L.C.O.'s	<u>6</u>
Loss of Indications/Communications/Dose Assessment	<u>6</u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>120 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
UNIT 2  
MISCELLANEOUS EVENTS

9.2

CONDITION:

Other plant conditions exist that warrant precautionary activation of the Technical Support Center and placing the near-site Emergency Operations Facility and other key emergency personnel on standby.

EMERGENCY CLASSIFICATION:

Alert  
  
MODES   All  

CRITERIA:

The following conditions must exist

1. This event is not covered by any other EAL

AND

2. This event must either challenge or cause the loss of a fission product barrier.

RELATED EALS:

	TAB
RCS Activity	<u>1</u>
RCS Leakage	<u>2</u>
Primary to Secondary Leak	<u>3</u>
Radiological Effluents	<u>5</u>
Decay Heat Removal	<u>6</u>
	<u> </u>

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>121 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 4  
 UNIT 2  
 MISCELLANEOUS EVENTS

9.3

CONDITION:

Other plant conditions exist that warrant activation of emergency response facilities and monitoring teams or a precautionary notification to the public near the site.

EMERGENCY CLASSIFICATION:

Site Area Emergency  
 MODES All

CRITERIA:

The following conditions must exist

1. This event is not covered by any other EAL

AND

2. This event may cause ANY of the following:
  - A. Challenge to two fission product barriers
  - B. Failure of one fission product barrier and a challenge to another
  - C. Failure of 2 fission product barriers

RELATED EALS:

	TAB
Core Damage/ICC	<u>1</u>
Containment Radiation	<u>1</u>
Decay Heat Removal	<u>6</u>
Radiological Effluents	<u>5</u>
RCS Leakage	<u>2</u>
Primary to Secondary Leak	<u>3</u>

<b>PROC./WORK PLAN NO.</b> <b>1903.010</b>	<b>PROCEDURE/WORK PLAN TITLE:</b> <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	<b>PAGE: 122 of 124</b> <b>REV: 34</b> <b>CHANGE:</b>
---	---	---

ATTACHMENT 4  
UNIT 2  
MISCELLANEOUS EVENTS

9.4

CONDITION:

Plant Conditions Exist That Make Release of Large Amounts of Radioactivity Possible

EMERGENCY CLASSIFICATION:

General Emergency  
  
MODES   All  

CRITERIA:

The following conditions must exist

1. This event is not covered by any other EAL

AND

2. Events have occurred that make a release of large amounts of radioactivity in a short period of time possible.


RELATED EALS:

	TAB
Core Melt	<u>1</u>
Loss of or Challenge to 3 Fission Product Barriers	<u>1</u>
Containment Radiation	<u>1</u>
Radiological Effluents	<u>5</u>
	_____
	_____

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>123 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 5  
UNIT 1

CONTAINMENT RADIATION EAL PLOT

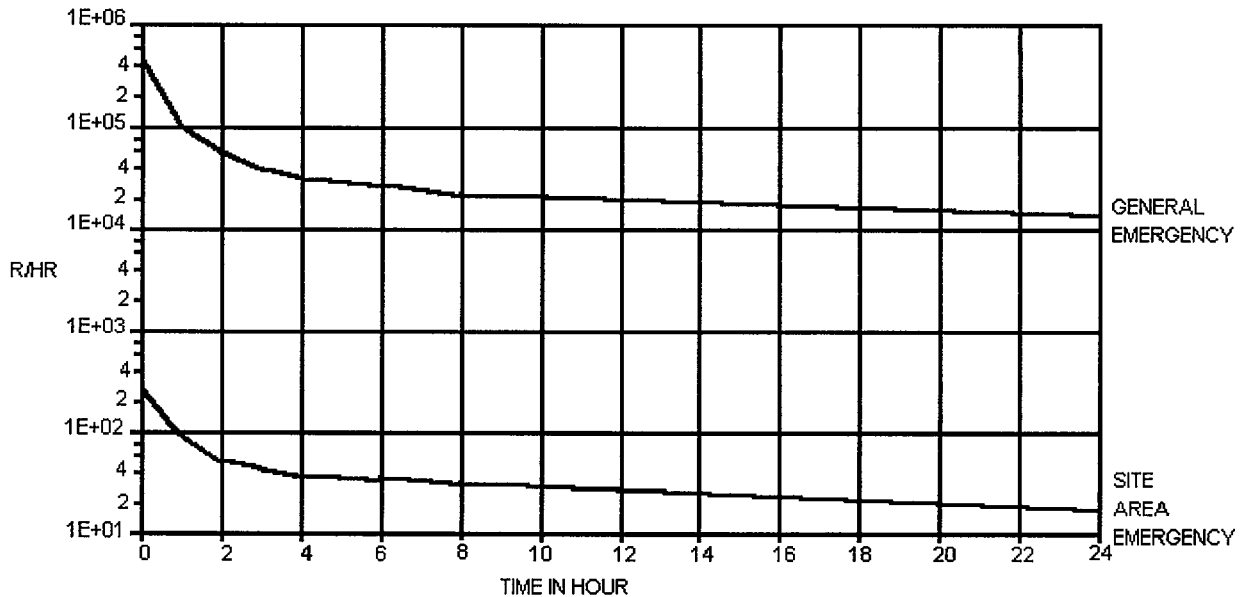

INSTRUCTIONS

**CAUTION**

- \* In the absence of a significant containment temperature transient, monitor readings should be considered valid.
- \* In the event of a significant containment temperature transient, monitor readings may be erratic for a short duration (Ref.IN-97-45, Supplement 1)


- A. Determine the containment radiation level.
1. If the plant has been operating at 100% for the past 30 days, use the reading from RE-8060 or RE-8061.
  2. If the plant has been operating at less than 100% power for the past 30 days, determine the radiation level as follows:  
  

$$\text{Rad level} = \text{Reading from RE-8060 or RE-8061} \times \frac{100\%}{\text{estimated ave. power for the past 30 days}}$$
- B. Determine the time after shutdown (in hours).
- C. Find the intersection of the values from A and B on the graph.
- D. Determine the emergency class.
1. SITE AREA EMERGENCY - intersection is between the two curves
  2. GENERAL EMERGENCY - intersection is above the upper curve

PROC./WORK PLAN NO. <b>1903.010</b>	PROCEDURE/WORK PLAN TITLE: <b>EMERGENCY ACTION LEVEL CLASSIFICATION</b>	PAGE: <b>124 of 124</b> REV: <b>34</b> CHANGE:
--	--	--

ATTACHMENT 6  
UNIT 2

CONTAINMENT RADIATION EAL PLOT

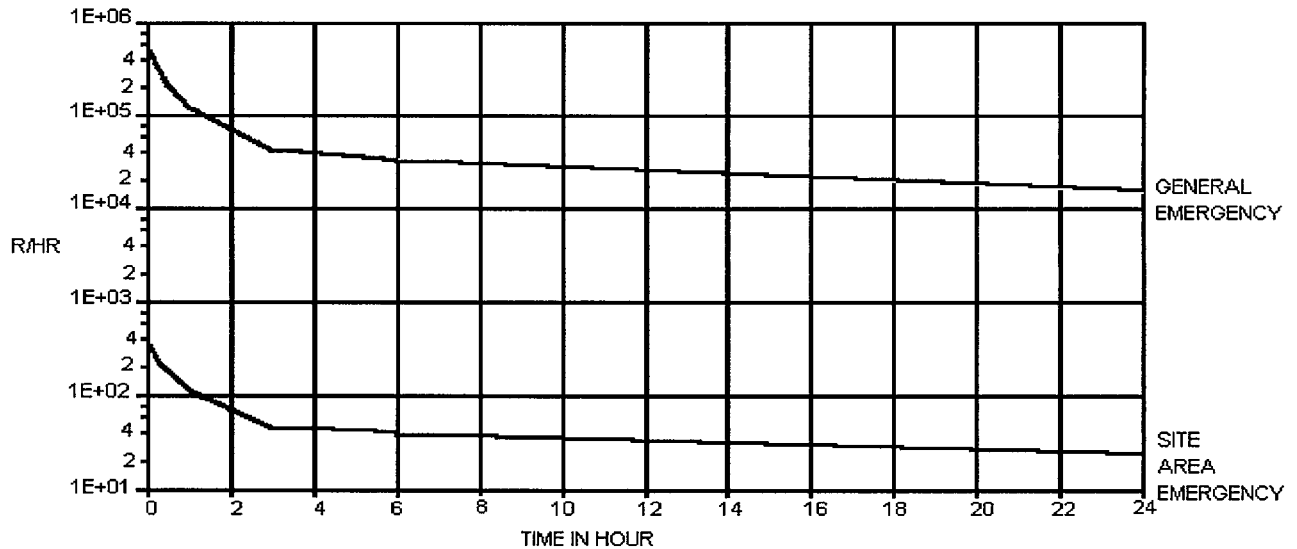

INSTRUCTIONS

**CAUTION**

- \* In the absence of a significant containment temperature transient, monitor readings should be considered valid.
- \* In the event of a significant containment temperature transient, monitor readings may be erratic for a short duration (Ref.IN-97-45, Supplement 1)

- A. Determine the containment radiation level.
1. If the plant has been operating at 100% for the past 30 days, use the reading from 2RY-8925-1 or 2RY-8925-2.
  2. If the plant has been operating at less than 100% power for the past 30 days, determine the radiation level as follows:  
  

$$\text{Rad level} = \text{Reading from 2RY-8925-1 or 2RY-8925-2} \times \frac{100\%}{\text{estimated ave. power for the past 30 days}}$$
- B. Determine the time after shutdown (in hours).
- C. Find the intersection of the values from A and B on the graph.
- D. Determine the emergency class.
1. SITE AREA EMERGENCY - intersection is between the two curves
  2. GENERAL EMERGENCY - intersection is above the upper curve