



**John H. Mueller**  
Senior Vice President and  
Chief Nuclear Officer

February 7, 2000  
NMP2L 1932

Phone: 315.349.7907  
Fax: 315.349.1321  
e-mail: muellerj@nimo.com

U. S. Nuclear Regulatory Commission  
Attn: Document Control Desk  
Washington, DC 20555

RE:                   Nine Mile Point Unit 2  
                          Docket No. 50-410  
                          NPF-69  
                          TAC No. MA7119

Gentlemen:

Niagara Mohawk Power Corporation (NMPC) transmitted an Application for Amendment to Nine Mile Point Unit 2 (NMP2) Operating License NPF-69 on October 25, 1999 (NMP2L 1907). The Application for Amendment contained proposed changes to the Technical Specifications (TS) set forth in Appendix A of the above mentioned license to support the activation of the Oscillation Power Range Monitor (OPRM) function. This information supplements that Application for Amendment.

NMPC herein submits the changes necessary to convert the affected pages of the Current Technical Specifications to Improved Technical Specifications (ITS). Specifically, Attachment A contains the marked-up ITS pages and Attachment B contains the clean typed ITS pages.

Very truly yours,

John H. Mueller  
Senior Vice President and  
Chief Nuclear Officer

JHM/RS/kap  
Attachments

xc:   Mr. H. J. Miller, NRC Regional Administrator, Region I  
      Ms. M. K. Gamberoni, Acting Section Chief PD-I, Section 1, NRR  
      Mr. G. K. Hunegs, NRC Senior Resident Inspector  
      Mr. P. S. Tam, Senior Project Manager, NRR  
      Mr. John P. Spath  
      NYSERDA  
      286 Washington Avenue Ext.  
      Albany, NY 12203-6399  
      Records Management

A001

**ATTACHMENT A**  
**MARKED-UP ITS PAGES**

3.3 INSTRUMENTATION

3.3.1.1 Reactor Protection System (RPS) Instrumentation

LCO 3.3.1.1 The RPS instrumentation for each Function in Table 3.3.1.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.1.1-1.

ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable.	A.1 Place channel in trip.	12 hours
	<u>OR</u> A.2 Place associated trip system in trip.	12 hours
B. -----NOTE----- Not applicable for Functions 2.a, 2.b, 2.c, and 2.d, and 2.e. ----- One or more Functions with one or more required channels inoperable in both trip systems.	B.1 Place channel in one trip system in trip.	6 hours
	<u>OR</u> B.2 Place one trip system in trip.	6 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. One or more Functions with RPS trip capability not maintained.	C.1 Restore RPS trip capability.	1 hour
D. Required Action and associated Completion Time of Condition A, B, or C not met.	D.1 Enter the Condition referenced in Table 3.3.1.1-1 for the channel.	Immediately
E. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	E.1 Reduce THERMAL POWER to < 30% RTP.	4 hours
F. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	F.1 Be in MODE 2.	6 hours
G. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	G.1 Be in MODE 3.	12 hours
H. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	H.1 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

Requires Action and associated Completion Time of Condition F not met. OR

G  
G  
H  
I

F. As required by Required Action D.1 and referenced in Table 3.3.1.1-1. NMP2

F.1 Initiate alternate method to detect and suppress thermal-hydraulic instability oscillations, 3.3-2

AND

F.2 Restore required channel to OPERABLE status.

12 hours

Revision A

120 days

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE		FREQUENCY
SR 3.3.1.1.5	Verify the source range monitor (SRM) and intermediate range monitor (IRM) channels overlap.	Prior to fully withdrawing SRMs
SR 3.3.1.1.6	-----NOTE----- Only required to be met during entry into MODE 2 from MODE 1. ----- Verify the IRM and APRM channels overlap.	7 days
SR 3.3.1.1.7	Calibrate the local power range monitors.	1000 effective full power hours
SR 3.3.1.1.8	Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.1.1.9	Calibrate the trip units.	92 days
SR 3.3.1.1.10	-----NOTES----- 1. For Function 2.a, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2. ----- Perform CHANNEL FUNCTIONAL TEST.	184 days
SR 3.3.1.1.11	Perform CHANNEL CALIBRATION.	18 months

2. For Function 2.e, the CHANNEL FUNCTIONAL TEST only requires toggling the appropriate outputs of the APRM.

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE		FREQUENCY
SR 3.3.1.1.12	Perform CHANNEL FUNCTIONAL TEST.	24 months
SR 3.3.1.1.13	<p>-----NOTES-----</p> <p>1. Neutron detectors are excluded.</p> <p>2. For Functions 1.a and 2.a, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2.</p> <p>-----</p> <p>Perform CHANNEL CALIBRATION.</p>	24 months
SR 3.3.1.1.14	Perform LOGIC SYSTEM FUNCTIONAL TEST.	24 months
SR 3.3.1.1.15	Verify Turbine Stop Valve—Closure, and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions are not bypassed when THERMAL POWER is $\geq 30\%$ RTP.	24 months

(continued)

3. For Function 2.e, the CHANNEL CALIBRATION only requires a verification of OPRM-Upscale setpoints in the APRM by the review of the "Show Parameters" display.

SR 3.3.1.1.16	Verify APRM OPRM-Upscale Function is not bypassed when THERMAL POWER is $\geq 30\%$ RTP and recirculation drive flow is $< 60\%$ of rated recirculation drive flow.	24 months
---------------	---	-----------

**SURVEILLANCE REQUIREMENTS (continued)**

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.1.16 17</p> <p>-----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Function 2. digital electronics are excluded. (f)</li> <li>2. For Functions 3 and 4, the sensor response time may be assumed to be the design sensor response time.</li> <li>3. For Function 5, "n" equals 4 channels for the purpose of determining the STAGGERED TEST BASIS Frequency.</li> <li>4. For Function 9, the RPS RESPONSE TIME is measured from start of turbine control valve fast closure.</li> </ol> <p>-----</p> <p>Verify the RPS RESPONSE TIME is within limits.</p>	<p>24 months on a STAGGERED TEST BASIS</p>

Table 3.3.1.1-1 (page 1 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
1. Intermediate Range Monitors					
a. Neutron Flux - Upscale	2	3	H <del>or</del>	SR 3.3.1.1.1 SR 3.3.1.1.4 SR 3.3.1.1.5 SR 3.3.1.1.6 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 122/125 divisions of full scale
	5(a)	3	I <del>or</del>	SR 3.3.1.1.1 SR 3.3.1.1.4 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 122/125 divisions of full scale
b. Inop	2	3	H <del>or</del>	SR 3.3.1.1.4 SR 3.3.1.1.14	NA
	5(a)	3	I <del>or</del>	SR 3.3.1.1.4 SR 3.3.1.1.14	NA
2. Average Power Range Monitors					
a. Neutron Flux - Upscale, Setdown	2	3 per logic channel	H <del>or</del>	SR 3.3.1.1.2 SR 3.3.1.1.6 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ 20% RTP
b. Flow Biased Simulated Thermal Power - Upscale	1	3 per logic channel	G <del>or</del>	SR 3.3.1.1.2 SR 3.3.1.1.3 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ .58W + 62% RTP and ≤ 115.5% RTP(b)
c. Fixed Neutron Flux - Upscale	1	3 per logic channel	G <del>or</del>	SR 3.3.1.1.2 SR 3.3.1.1.3 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ 120% RTP
d. Inop	1,2	3 per logic channel	H <del>or</del>	SR 3.3.1.1.7 SR 3.3.1.1.10	NA
e. OPZM - Upscale	1	3 per logic channel	F		As specified in the COLR
f. 2-Out-Of-4 Voter	1,2	2	H <del>or</del>	SR 3.3.1.1.2 SR 3.3.1.1.10 SR 3.3.1.1.14 SR 3.3.1.1.16 17	NA

(continued)

- (a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.
- (b) Allowable Value is .58(W - 5%) + 62% RTP when reset for single loop operation per LCO 3.4.1, "Recirculation Loops Operating."

SR 3.3.1.1.2  
SR 3.3.1.1.7  
SR 3.3.1.1.10  
SR 3.3.1.1.13  
SR 3.3.1.1.16

Revision A



Table 3.3.1.1-1 (page 2 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
3. Reactor Vessel Steam Dome Pressure - High	1,2	2	H <del>8</del>	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.46 <sup>17</sup>	≤ 1072 psig
4. Reactor Vessel Water Level - Low, Level 3	1,2	2	H <del>8</del>	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.46 <sup>17</sup>	≥ 157.8 inches
5. Main Steam Isolation Valve - Closure	1	8	G <del>7</del>	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.46 <sup>17</sup>	≤ 12% closed
6. Drywell Pressure - High	1,2	2	H <del>8</del>	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 1.88 psig
7. Scram Discharge Volume Water Level - High					
a. Transmitter/Trip Unit	1,2	2	H <del>8</del>	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.11 SR 3.3.1.1.14	≤ 49.5 inches
	5(a)	2	I <del>7</del>	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.11 SR 3.3.1.1.14	≤ 49.5 inches
b. Float Switch	1,2	2	H <del>8</del>	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 49.5 inches
	5(a)	2	I <del>7</del>	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 49.5 inches
8. Turbine Stop Valve - Closure	≥ 30% RTP	4	E	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.15 SR 3.3.1.1.46 <sup>17</sup>	≤ 7% closed

(continued)

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

Table 3.3.1.1-1 (page 3 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
9. Turbine Control Valve Fast Closure, Trip Oil Pressure - Low	≥ 30% RTP	2	E	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.15 SR 3.3.1.1.16	≥ 465 psig
10. Reactor Mode Switch - Shutdown Position	1,2	2	H <sub>0</sub>	SR 3.3.1.1.12 SR 3.3.1.1.14	NA
	5(a)	2	I <sub>H</sub>	SR 3.3.1.1.12 SR 3.3.1.1.14	NA
11. Manual Scram	1,2	4	H <sub>0</sub>	SR 3.3.1.1.4 SR 3.3.1.1.14	NA
	5(a)	4	I <sub>H</sub>	SR 3.3.1.1.4 SR 3.3.1.1.14	NA

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.a. Average Power Range Monitor Neutron Flux—Upscale,  
Setdown (continued)

With the IRMs at Range 9 or 10, it is possible that the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function will provide the primary trip signal for a core-wide increase in power.

No specific safety analyses take direct credit for the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function. However, this Function indirectly ensures that, before the reactor mode switch is placed in the run position, reactor power does not exceed 25% RTP (SL 2.1.1.1) when operating at low reactor pressure and low core flow. Therefore, it indirectly prevents fuel damage during significant reactivity increases with THERMAL POWER < 25% RTP.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.e. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor Neutron Flux—Upscale, Setdown channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide a Neutron Flux—Upscale, Setdown signal, two channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor Neutron Flux—Upscale, Setdown, with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, at least 20 LPRM inputs are required for each APRM, with at least three LPRM inputs from each of the four axial levels at which the LPRMs are located.

The Allowable Value is based on preventing significant increases in power when THERMAL POWER is < 25% RTP.

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES  
LCO, and  
APPLICABILITY

2.a. Average Power Range Monitor Neutron Flux—Upscale,  
Setdown (continued)

The Average Power Range Monitor Neutron Flux—Upscale, Setdown Function must be OPERABLE during MODE 2 when control rods may be withdrawn, since the potential for criticality exists. In MODE 1, the Average Power Range Monitor Neutron Flux—Upscale Function provides protection against reactivity transients and the RWM and Rod Block Monitor protect against control rod withdrawal error events.

2.b. Average Power Range Monitor Flow Biased Simulated  
Thermal Power—Upscale

The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function monitors neutron flux to approximate the THERMAL POWER being transferred to the reactor coolant. The APRM neutron flux is digitally filtered with a time constant representative of the fuel heat transfer dynamics to generate a signal proportional to the THERMAL POWER in the reactor. The trip level is varied as a function of recirculation drive flow, W, in percent of rated recirculation drive flow, (i.e., at lower core flows the setpoint is reduced proportional to the reduction in power experienced as core flow is reduced with a fixed control rod pattern) but is clamped at an upper limit that is always lower than the Average Power Range Monitor Fixed Neutron Flux—Upscale Function Allowable Value. The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function provides protection against transients where THERMAL POWER increases slowly (such as the loss of feedwater heating event) and protects the fuel cladding integrity by ensuring that the MCPR SL is not exceeded. During these events, the THERMAL POWER increase does not significantly lag the neutron flux response and, because of a lower trip setpoint, will initiate a scram before the high neutron flux scram. For rapid neutron flux increase events, the THERMAL POWER lags the neutron flux and the Average Power Range Monitor Fixed Neutron Flux—Upscale Function will provide a scram signal before the Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function setpoint is exceeded.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.0. Each APRM inputs to all four

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.b. Average Power Range Monitor Flow Biased Simulated  
Thermal Power—Upscale (continued)

The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function is required to be OPERABLE in MODE 1 when there is the possibility of generating excessive THERMAL POWER and potentially exceeding the SL applicable to high pressure and core flow conditions (MCPR SL). During MODES 2 and 5, other IRM and APRM Functions provide protection for fuel cladding integrity.

2.c. Average Power Range Monitor Fixed Neutron  
Flux—Upscale

The APRM channels provide the primary indication of neutron flux within the core and respond almost instantaneously to neutron flux increases. The Average Power Range Monitor Fixed Neutron Flux—Upscale Function is capable of generating a trip signal to prevent fuel damage or excessive Reactor Coolant System pressure. For the overpressurization protection analysis of Reference 2, the Average Power Range Monitor Fixed Neutron Flux—Upscale Function is assumed to terminate the main steam isolation valve (MSIV) closure event and, along with the safety/relief valves (S/RVs), limits the peak reactor pressure vessel (RPV) pressure to less than the ASME Code limits. The control rod drop accident (CRDA) analysis (Ref. 8) takes credit for the Average Power Range Monitor Fixed Neutron Flux—Upscale Function to terminate the CRDA.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor Fixed Neutron Flux—Upscale channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide a Fixed Neutron Flux—Upscale signal, two

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.c. Average Power Range Monitor Fixed Neutron  
Flux—Upscale (continued)

channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor Fixed Neutron Flux—Upscale with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, at least 20 LPRM inputs are required for each APRM, with at least three LPRM inputs from each of the four axial levels at which the LPRMs are located.

The Allowable Value is based on the Analytical Limit assumed in the CRDA analyses.

The Average Power Range Monitor Fixed Neutron Flux—Upscale Function is required to be OPERABLE in MODE 1 where the potential consequences of the analyzed transients could result in the SLs (e.g., MCPR and Reactor Coolant System pressure) being exceeded. Although the Average Power Range Monitor Fixed Neutron Flux—Upscale Function is assumed in the CRDA analysis (Ref. 8) that is applicable in MODE 2, the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function conservatively bounds the assumed trip and, together with the assumed IRM trips, provides adequate protection. Therefore, the Average Power Monitor Fixed Neutron Flux—Upscale Function is not required in MODE 2.

2.d. Average Power Range Monitor—Inop

This signal provides assurance that a minimum number of APRM channels are OPERABLE. For any APRM, any time its function switch is moved out of the Operate position (i.e., to the inop position), a loss of power to the APRM occurs, the firmware/software watchdog timer has timed out, or the automatic self-test system detects a critical fault with the APRM, an inoperative trip signal will be sent to both trip systems via the 2-Out-Of-4 Voter channels, Function 2. (e) ← (f) Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor—Inop channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.d. Average Power Range Monitor—Inop (continued)

provides an input to all four 2-Out-Of-4 Voter channels, one channel per logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide an Inop signal, two channels in both logic channels in each trip system will trip, producing a scram. This Function was not specifically credited in the accident analysis, but it is retained for the overall redundancy and diversity of the RPS as required by the NRC approved licensing basis.

Twelve channels of Average Power Range Monitor—Inop with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal.

There is no Allowable Value for this Function.

This Function is required to be OPERABLE in the MODES where the other APRM Functions are required.

Insert  
2.e

2.e. Average Power Range Monitor 2-Out-Of-4 Voter

two

The 2-Out-Of-4 Voter Function provides the interface between the other APRM Functions and the RPS trip system logic, and as such, supports the safety analyses applicable to the other APRM Functions. Each APRM provides <sup>one</sup> ~~an~~ inputs to all four 2-Out-Of-4 Voter channels (the <sup>one</sup> input is common for Functions 2.a, 2.b, 2.c, and 2.d). The four 2-Out-Of-4 Voter channels are divided into two groups of two channels, with each group providing inputs into one RPS trip system (each channel inputs to one logic channel, similar to most other RPS instrumentation Functions). When two trip signals from any combination of APRM Functions 2.a, 2.b, 2.c, and 2.d are received (from different APRMs) by a 2-Out-Of-4 Voter channel, the 2-Out-Of-4 Voter channel provides a trip signal to its associated trip system. Any one 2-Out-Of-4 Voter channel can trip the associated trip system (i.e., a one-out-of-two logic). In addition, while each 2-Out-Of-4 Voter channel provides two inputs to its associated trip system, only one of the inputs is required for OPERABILITY.

(continued)

or two trip signals from any combination of APRM Function 2.e are received by a 2-Out-Of-4 Voter channel,

### INSERT 2.e. Average Power Range Monitor OPRM—Upscale

The APRM channels provide the primary indication of neutron flux within the core and respond almost instantaneously to neutron flux increases. In addition, the channels can detect oscillatory changes in neutron flux. The Average Power Range Monitor Oscillation Power Range Monitor (OPRM)—Upscale Function is capable of detecting neutron flux oscillations indicative of thermal-hydraulic instabilities, by detecting the related neutron flux oscillations, and generating a trip signal before the MCPR Safety Limit is exceeded (Ref. 14).

The OPRM—Upscale Function receives input signals from the LPRMs, which are combined into cells (four LPRMs per cell) for evaluation by the OPRM algorithms. An OPRM—Upscale trip signal is issued from an APRM channel when the period based detection algorithm in that channel detects oscillatory changes in neutron flux, indicated by the combined signals of the LPRM detectors in a cell, with periodic confirmations and relative cell amplitude exceeding specific setpoints. One or more OPRM cells in a channel exceeding the trip conditions will result in a channel trip. An OPRM—Upscale trip can also be generated if either the growth rate or amplitude based algorithms detect growing oscillatory changes in the neutron flux for one or more cells. However, this portion of the trip is not required by this Specification; only the period based algorithm is required for OPERABILITY.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor OPRM—Upscale channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide an OPRM—Upscale signal, two channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor OPRM—Upscale with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, a minimum of 21 cells, each with a minimum of two LPRMs, are required for each OPRM—Upscale Function.

The Allowable Value, which is specified in the COLR, is based on ensuring the MCPR Safety Limit is not exceeded due to anticipated thermal-hydraulic power oscillations.

The Average Power Range Monitor OPRM—Upscale Function automatic trip is only enabled when THERMAL POWER, as determined by APRM Simulated Thermal Power, is  $\geq 30\%$  RTP and reactor core flow, as indicated by recirculation drive flow, is  $< 60\%$  of rated recirculation drive flow. This is the operating region where actual thermal-hydraulic oscillations may occur. However, the Average Power Range Monitor OPRM—Upscale Function is required to be OPERABLE at all times while in MODE 1. When the automatic trip is bypassed, the Average Power Range Monitor OPRM—Upscale Function is still considered OPERABLE provided the automatic trip is not bypassed when the proper power and flow conditions exist.



INSERT 2.e. Average Power Range Monitor OPRM—Upscale (continued)

Requiring the Average Power Range Monitor OPRM—Upscale Function to be OPERABLE in MODE 1 provides adequate margin to cover the operating region where oscillations may occur as well as the operating regions from which the plant might enter the potential instability region without operator action.

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.e.f. Average Power Range Monitor 2-Out-Of-4 Voter  
(continued)

Each 2-Out-Of-4 Voter channel also includes self-diagnostic functions. If any channel detects a critical fault in its own processing, a trip signal is provided to its associated trip system. Unlike the other APRM Functions, a bypass capability for the 2-Out-Of-4 Voter Function is not provided.

Four channels of the APRM 2-Out-Of-4 Voter Function with two channels in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal.

There is no Allowable Value for this Function.

This Function is required to be OPERABLE in the MODES where the other APRM Functions are required.

3. Reactor Vessel Steam Dome Pressure—High

An increase in the RPV pressure during reactor operation compresses the steam voids and results in a positive reactivity insertion. This causes the neutron flux and THERMAL POWER transferred to the reactor coolant to increase, which could challenge the integrity of the fuel cladding and the RCPB. No specific safety analysis takes direct credit for this Function. However, the Reactor Vessel Steam Dome Pressure—High Function initiates a scram for transients that result in a pressure increase, counteracting the pressure increase by rapidly reducing core power. For the overpressurization protection analysis of Reference 2, the reactor scram (the analyses conservatively assume scram on the Average Power Range Monitor Fixed Neutron Flux—Upscale signal, not the Reactor Vessel Steam Dome Pressure—High signal), along with the S/RVs, limits the peak RPV pressure to less than the ASME Section III Code limits.

High reactor pressure signals are initiated from four pressure transmitters that sense reactor pressure. The Reactor Vessel Steam Dome Pressure—High Allowable Value is chosen to provide a sufficient margin to the ASME Section III Code limits during the event.

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

11. Manual Scram (continued)

There is no Allowable Value for this Function since the channels are mechanically actuated based solely on the position of the switch and push buttons.

Eight channels of Manual Scram with two switch and push buttons (two channels per switch and push button) in each trip system arranged in a one-out-of-two logic (i.e., both channels of a switch and push button must be actuated), are available and required to be OPERABLE in MODES 1 and 2, and in MODE 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies, since these are the MODES and other specified conditions when control rods are withdrawn.

ACTIONS

A Note has been provided to modify the ACTIONS related to RPS instrumentation channels. Section 1.3, Completion Times, specifies that once a Condition has been entered, subsequent divisions, subsystems, components, or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies that Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for inoperable RPS instrumentation channels provide appropriate compensatory measures for separate, inoperable channels. As such, a Note has been provided that allows separate Condition entry for each inoperable RPS instrumentation channel.

A.1 and A.2

Because of the diversity of sensors available to provide trip signals and the redundancy of the RPS design, an allowable out of service time of 12 hours has been shown to be acceptable (Refs. 10 and 11) to permit restoration of any inoperable required channel to OPERABLE status. However, this out of service time is only acceptable provided the associated Function's inoperable channel is in one trip system (except for Functions 2.a, 2.b, 2.c, and 2.d) and the Function still maintains RPS trip capability (refer to Required Actions B.1, B.2, and C.1 Bases.) If the inoperable channel cannot be restored to OPERABLE status

and  
2.e

(continued)

BASES

---

ACTIONS

A.1 and A.2 (continued)

within the allowable out of service time, the channel or the associated trip system must be placed in the tripped condition per Required Actions A.1 and A.2. Placing the inoperable channel in trip (or the associated trip system in trip) would conservatively compensate for the inoperability, restore capability to accommodate a single failure, and allow operation to continue. Alternately, if it is not desired to place the channel (or trip system) in trip (e.g., as in the case where placing the inoperable channel in trip would result in a scram or recirculation pump trip (RPT)), Condition D must be entered and its Required Action taken.

B.1 and B.2

Condition B exists when, for any one or more Functions, at least one required channel is inoperable in each trip system. In this condition, provided at least one channel per trip system is OPERABLE, the RPS still maintains trip capability for that Function, but cannot accommodate a single failure in either trip system.

Required Actions B.1 and B.2 limit the time the RPS scram logic for any Function would not accommodate single failure in both trip systems (e.g., one-out-of-one and one-out-of-one arrangement for a typical four channel Function). The reduced reliability of this logic arrangement was not evaluated in References 10 and 11 for the 12 hour Completion Time, with the exception of Functions 2.a, 2.b, 2.c, and 2.d, as described below. and 2.e, Within the 6 hour allowance, the associated Function will have all required channels either OPERABLE or in trip (or in any combination) in one trip system.

Completing one of these Required Actions restores RPS to an equivalent reliability level as that evaluated in References 10 and 11, which justified a 12 hour allowable out of service time as presented in Condition A. The trip system in the more degraded state should be placed in trip or, alternatively, all the inoperable channels in that trip system should be placed in trip (e.g., a trip system with two inoperable channels could be in a more degraded state than a trip system with four inoperable channels, if the two inoperable channels are in the same Function while the four inoperable channels are all in different Functions). The

(continued)

---

## BASES

## ACTIONS

B.1 and B.2 (continued)

decision as to which trip system is in the more degraded state should be based on prudent judgment and current plant conditions (i.e., what MODE the plant is in). If this action would result in a scram or RPT, it is permissible to place the other trip system or its inoperable channels in trip.

The 6 hour Completion Time is judged acceptable based on the remaining capability to trip, the diversity of the sensors available to provide the trip signals, the low probability of extensive numbers of inoperabilities affecting all diverse Functions, and the low probability of an event requiring the initiation of a scram.

Alternately, if it is not desired to place the inoperable channels (or one trip system) in trip (e.g., as in the case where placing the inoperable channel or associated trip system in trip would result in a scram or RPT), Condition D must be entered and its Required Action taken.

As noted, Condition <sup>and 2e</sup> B is not applicable for Functions 2.a, 2.b, 2.c, ~~and 2.d~~. Since an inoperable APRM affects both trip systems (one channel per logic channel in each trip system is inoperable when an APRM is inoperable), Reference <sup>and 15</sup> 11 evaluated the loss of one APRM and its effects for these Functions, and determined that a 12 hour Completion Time was acceptable. Therefore, when one required APRM is inoperable (which impacts both trip systems) only ACTION A is required to be entered.

C.1

Required Action C.1 is intended to ensure that appropriate actions are taken if multiple, inoperable, untripped channels within the same trip system for the same Function result in the Function not maintaining RPS trip capability. A Function is considered to be maintaining RPS trip capability when sufficient channels are OPERABLE or in trip (or the associated trip system is in trip), such that both trip systems will generate a trip signal from the given Function on a valid signal. For the typical Function with one-out-of-two taken twice logic and the IRM Functions, this would require both trip systems to have one channel OPERABLE or in trip (or the associated trip system in trip). For

(continued)

BASES

ACTIONS

C.1 (continued)

and 2.e

and APRM OPRM-Upscale

Functions 2.a, 2.b, 2.c, and 2.d, (APRM Neutron Flux—Upscale, Setdown, APRM Flow Biased Simulated Thermal Power—Upscale, APRM Fixed Neutron Flux—Upscale, and APRM—Inop), this would require, for each Function, both trip systems to have two channels per logic channel, each OPERABLE or in trip (or the associated trip system in trip). For Function 5 (Main Steam Isolation Valve—Closure), this would require both trip systems to have each channel associated with the MSIVs in three MSLs (not necessarily the same MSLs for both trip systems), OPERABLE or in trip (or the associated trip system in trip). For Function 8 (Turbine Stop Valve—Closure), this would require both trip systems to have three channels, each OPERABLE or in trip (or the associated trip system in trip).

The Completion Time is intended to allow the operator time to evaluate and repair any discovered inoperabilities. The 1 hour Completion Time is acceptable because it minimizes risk while allowing time for restoration or tripping of channels.

D.1

Required Action D.1 directs entry into the appropriate Condition referenced in Table 3.3.1.1-1. The applicable Condition specified in the Table is Function and MODE or other specified condition dependent and may change as the Required Action of a previous Condition is completed. Each time an inoperable channel has not met any Required Action of Condition A, B, or C, and the associated Completion Time has expired, Condition D will be entered for that channel and provides for transfer to the appropriate subsequent Condition.

E.1, F.1, and G.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, the plant must be placed in a MODE or other specified condition in which the LCO does not apply. The Completion Times are reasonable, based on operating experience, to reach the specified condition from full power conditions in an orderly manner

(continued)

BASES

---

ACTIONS E.1. <sup>6</sup>R.1. and <sup>H</sup>G.1 (continued)

and without challenging plant systems. In addition, the Completion Time of Required Action E.1 is consistent with the Completion Time provided in LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)."

*Insert F*

I.H.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, the plant must be placed in a MODE or other specified condition in which the LCO does not apply. This is done by immediately initiating action to fully insert all insertable control rods in core cells containing one or more fuel assemblies. Control rods in core cells containing no fuel assemblies do not affect the reactivity of the core and are, therefore, not required to be inserted. Action must continue until all insertable control rods in core cells containing one or more fuel assemblies are fully inserted.

---

SURVEILLANCE REQUIREMENTS

As noted at the beginning of the SRs, the SRs for each RPS instrumentation Function are located in the SRs column of Table 3.3.1.1-1.

The Surveillances are modified by a Note to indicate that, when a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours, provided the associated Function maintains RPS trip capability. Upon completion of the Surveillance, or expiration of the 6 hour allowance, the channel must be returned to OPERABLE status or the applicable Condition entered and Required Actions taken. This Note is based on the RPS reliability analysis (Ref. 10) assumption of the average time required to perform channel surveillance. That analysis demonstrated that the 6 hour testing allowance does not significantly reduce the probability that the RPS will trip when necessary.

(continued)

---

INSERT F

F.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, an alternate method to detect and suppress thermal-hydraulic instability oscillations must be initiated within 12 hours. This is acceptable since suitable methods exist to properly monitor for and suppress thermal-hydraulic instability oscillations. However, since these methods involve operator actions, the allowance to operate in this condition utilizing manual detect and suppress methods exists for only 120 days (i.e., the channel(s) must be restored within 120 days). If the channel(s) is not restored within 120 days, Condition G must be entered and its Required Actions taken.



BASES

SURVEILLANCE  
REQUIREMENTS  
(continued)

SR 3.3.1.1.7

LPRM gain settings are determined from the local flux profiles measured by the Traversing Incore Probe (TIP) System. This establishes the relative local flux profile for appropriate representative input to the APRM System. The 1000 effective full power hours (EFPH) Frequency is based on operating experience with LPRM sensitivity changes.

SR 3.3.1.1.8, SR 3.3.1.1.10, and SR 3.3.1.1.12

A CHANNEL FUNCTIONAL TEST is performed on each required channel to ensure that the channel will perform the intended function. Any setpoint adjustment shall be consistent with the assumptions of the current plant specific setpoint methodology. For Function 2.b, the CHANNEL FUNCTIONAL TEST also includes the flow input function, excluding the flow transmitters. <sup>1</sup> A Note is provided for SR 3.3.1.1.10 that requires the APRM SR for Function 2.a to be performed within 12 hours of entering MODE 2 from MODE 1. Testing of the MODE 2 APRM Function cannot be performed in MODE 1 without utilizing jumpers, lifted leads, or movable links. This Note allows entry into MODE 2 from MODE 1 if the associated Frequency is not met per SR 3.0.2. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR. †

Insert  
Note 2

The 92 day Frequency of SR 3.3.1.1.8 is based on the reliability analysis of Reference 10. The 184 day Frequency of SR 3.3.1.1.10 is based on the reliability analysis of Reference 11. The 24 month Frequency of SR 3.3.1.1.12 is based on the need to perform this Surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the Surveillance were performed with the reactor at power. Operating experience has shown that these components usually pass the Surveillance when performed at the 24 month Frequency.

SR 3.3.1.1.9

The calibration of trip units provides a check of the actual trip setpoints. The channel must be declared inoperable if the trip setting is discovered to be less conservative than the Allowable Value specified in Table 3.3.1.1-1. If the trip setting is discovered to be less conservative than

(continued)

INSERT NOTE 2

Note 2 is provided for SR 3.3.1.1.10 that allows the Function 2.e CHANNEL FUNCTIONAL TEST to consist of toggling the appropriate outputs of the APRM. This is acceptable since this will test all of the hardware required to produce the trip signal, but not directly re-test software-controlled logic. Also, the automatic self-test logic will automatically detect a hardware fault that results in a change to the software.

BASES

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.9 (continued)

accounted for in the appropriate setpoint methodology, but is not beyond the Allowable Value, the channel performance is still within the requirements of the plant safety analysis. Under these conditions, the setpoint must be readjusted to be equal to or more conservative than accounted for in the appropriate setpoint methodology.

The Frequency of 92 days for SR 3.3.1.1.9 is based on the reliability analysis of Reference 10.

SR 3.3.1.1.11 and SR 3.3.1.1.13

A CHANNEL CALIBRATION is a complete check of the instrument loop and the sensor. This test verifies the channel responds to the measured parameter within the necessary range and accuracy. CHANNEL CALIBRATION leaves the channel adjusted to account for instrument drifts between successive calibrations consistent with the plant specific setpoint methodology. For Function 2.b, the CHANNEL CALIBRATION also includes the flow input function.

Note 1 to SR 3.3.1.1.13 states that neutron detectors are excluded from CHANNEL CALIBRATION because of the difficulty of simulating a meaningful signal. Changes in neutron detector sensitivity are compensated for by performing the 7 day calorimetric calibration (SR 3.3.1.1.3) and the 1000 EFPH LPRM calibration against the TIPS (SR 3.3.1.1.7). ~~A second Note is provided that requires the APRM and IRM SRs for Functions 1.a and 2.a to be performed within 12 hours of entering MODE 2 from MODE 1. Testing of the MODE 2 APRM and IRM Functions cannot be performed in MODE 1 without utilizing jumpers, lifted leads, or movable links. This Note allows entry into MODE 2 from MODE 1 if the associated Frequency is not met per SR 3.0.2. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR.~~ The Frequency of SR 3.3.1.1.11 is based upon the assumption of a 18 month calibration interval in the determination of the magnitude of equipment drift in the setpoint analysis. The Frequency of SR 3.3.1.1.13 is based on the assumption of an 24 month calibration interval in the determination of the magnitude of equipment drift in the setpoint analysis.

2 to  
SR 3.3.1.1.13

Insert  
Note 3

(continued)

**INSERT NOTE 3**

Note 3 is provided for SR 3.3.1.1.13 that allows the Function 2.e CHANNEL CALIBRATION to consist of a verification of OPRM—Upscale setpoints in the APRM by the review of the "Show Parameters" display. This is acceptable because, other than the flow and LPRM input processing, all OPRM functional processing is performed digitally involving equipment or components that cannot be calibrated.

## BASES

SURVEILLANCE  
REQUIREMENTS  
(continued)SR 3.3.1.1.14

The LOGIC SYSTEM FUNCTIONAL TEST (LSFT) demonstrates the OPERABILITY of the required trip logic for a specific channel. The functional testing of control rods, in LCO 3.1.3, "Control Rod OPERABILITY," and SDV vent and drain valves, in LCO 3.1.8, "Scram Discharge Volume (SDV) Vent and Drain Valves," overlaps this Surveillance to provide complete testing of the assumed safety function. In addition, for Function 2, the LSFT includes simulating APRM trip conditions at the APRM channel inputs to the 2-Out-Of-4 Voter channel to check all combinations of two tripped APRM channel inputs to the 2-Out-Of-4 Voter logic in the 2-Out-Of-4 Voter channels.

The 24 month Frequency is based on the need to perform this Surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the Surveillance were performed with the reactor at power. Operating experience has shown that these components usually pass the Surveillance when performed at the 24 month Frequency.

SR 3.3.1.1.15

This SR ensures that scrams initiated from the Turbine Stop Valve—Closure and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions will not be inadvertently bypassed when THERMAL POWER is  $\geq 30\%$  RTP. This involves calibration of the bypass channels. Adequate margins for the instrument setpoint methodology are incorporated into the Allowable Value and the actual setpoint. Because main turbine bypass flow can affect this setpoint nonconservatively (THERMAL POWER is derived from turbine first stage pressure, where a first stage pressure of 136.4 psig is equivalent to 30% RTP), the main turbine bypass valves must remain closed during an in-service calibration at THERMAL POWER  $\geq 30\%$  RTP to ensure that the calibration is valid.

If any bypass channel setpoint is nonconservative (i.e., the Functions are bypassed at  $\geq 30\%$  RTP, either due to open main turbine bypass valve(s) or other reasons), then the affected Turbine Stop Valve—Closure and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions are considered

(continued)

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.15 (continued)

inoperable. Alternatively, the bypass channel can be placed in the conservative condition (nonbypass). If placed in the nonbypass condition, this SR is met and the channel is considered OPERABLE.

The Frequency of 24 months is based on engineering judgment and reliability of the components.

SR 3.3.1.1.16 17

This SR ensures that the individual channel response times are less than or equal to the maximum values assumed in the accident analysis. The RPS RESPONSE TIME acceptance criteria are included in Reference 12.

As noted (Note 1), the Function 2. <sup>(F)</sup>digital electronics are excluded. This is allowed since self-testing and calibration checks the time base of the digital electronics (confirmation of the time base is adequate to assure required response times are met). In addition, Note 2 states the response time of the sensors for Functions 3 and 4 may be assumed to be the design sensor response time and therefore, are excluded from the RPS RESPONSE TIME testing. This is allowed since the sensor response time is a small part of the overall RPS RESPONSE TIME (Ref. 13). Note 4 modifies the starting point of the RPS RESPONSE TIME test for Function 9, since this starting point (start of turbine control valve fast closure) corresponds with the safety analysis assumptions.

RPS RESPONSE TIME tests are conducted on an 24 month STAGGERED TEST BASIS. Note 3 requires STAGGERED TEST BASIS Frequency to be determined based on 4 channels per trip system, in lieu of the 8 channels specified in Table 3.3.1.1-1 for the MSIV Closure Function. This Frequency is based on the logic interrelationships of the various channels required to produce an RPS scram signal. Therefore, staggered testing results in response time verification of these devices every 24 months. The 24 month Frequency is consistent with the typical industry refueling cycle and is based upon plant operating experience, which shows that random failures of instrumentation components causing serious time degradation, but not channel failure, are infrequent.

---

(continued)

INSERT SR 3.3.1.1.16

SR 3.3.1.1.16

This SR ensures that scrams initiated from the APRM OPRM—Upscale Function will not be inadvertently bypassed when THERMAL POWER is  $\geq 30\%$  RTP and recirculation drive flow is  $< 60\%$  rated recirculation drive flow.

If any bypass channel setpoint is nonconservative (i.e., the Function is bypassed at  $\geq 30\%$  RTP and  $< 60\%$  rated recirculation drive flow), then the affected channel is considered inoperable.

The Frequency of 24 months is based on Ref. 15.

BASES (continued)

REFERENCES

1. USAR, Section 7.2.
2. USAR, Section 5.2.2 and Appendix A Section A.5.2.2.
3. USAR, Section 6.3.3.
4. USAR, Chapter 15 and Appendix A.
5. 10 CFR 50.36(c)(2)(ii).
6. USAR, Section 15.4.1.
7. NEDO-23842, "Continuous Control Rod Withdrawal in the Startup Range," April 18, 1978.
8. USAR, Section 15.4.9.
9. Letter, P. Check (NRC) to G. Lainas (NRC), "BWR Scram Discharge System Safety Evaluation," December 1, 1980.
10. NEDO-30851-P-A, "Technical Specification Improvement Analyses for BWR Reactor Protection System," March 1988.
11. NEDC-32410-P-A, "Nuclear Measurement Analysis and Control Power Range Neutron Monitor (NUMAC-PRNM) Retrofit Plus Option III Stability Trip Functions," October 1995.
12. Technical Requirements Manual.
13. NEDO-32291-A, "System Analyses for the Elimination of Selected Response Time Testing Requirements," October 1995.

14. USAR, Section 7.6.1.4.3.

15. NEDC-32410-P-A, "NUMAC-PRNM Retrofit Plus Option III Stability Trip Functions, Supplement 1," November 1997.



3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.1 Recirculation Loops Operating

LCO 3.4.1 Two recirculation loops with matched flows shall be in operation ~~in the "Unrestricted Zone" of Figure 3.4.1-D,~~

OR

One recirculation loop shall be in operation ~~in the "Unrestricted Zone" of Figure 3.4.1-D~~ with the following limits applied when the associated LCO is applicable:

- a. LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)," single loop operation limits specified in the COLR;
- b. LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)," single loop operation limits specified in the COLR;
- c. LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation," Function 2.b (Average Power Range Monitors Flow Biased Simulated Thermal Power—Upscale), Allowable Value of Table 3.3.1.1-1 is reset for single loop operation; and
- d. LCO 3.3.2.1, "Control Rod Block Instrumentation," Function 1.a (Rod Block Monitor—Upscale), Allowable Value of Table 3.3.2.1-1 is reset for single loop operation.

APPLICABILITY: MODES 1 and 2.

ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>A. No recirculation loops in operation.</p>	<p>A.1 Restore operation to the "Unrestricted Zone" of Figure 3.4.1-1.</p> <p><u>AND</u></p> <p>A.2 Be in MODE 2.</p> <p><u>AND</u></p> <p>A.3 Be in MODE 3.</p>	<p>2 hours</p> <p>6 hours</p> <p>12 hours</p>
<p>B. One or two recirculation loops in operation in the "Restricted Zone" of Figure 3.4.1-1 with core flow &gt; 39% of rated core flow.</p>	<p>B.1 Verify APRM and LPRM neutron flux noise levels <math>\leq 3</math> times baseline noise levels.</p> <p><u>AND</u></p> <p>B.2 Determine core flow.</p>	<p>Once per 8 hours</p> <p><u>AND</u></p> <p>30 minutes after completion of any THERMAL POWER increase <math>\geq 5\%</math> RTP</p> <p>Once per 12 hours</p>
<p>C. Required Action B.1 and associated Completion Time not met.</p>	<p>C.1 Restore APRM and LPRM neutron flux noise levels to <math>\leq 3</math> times baseline noise levels.</p>	<p>2 hours</p>

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
<p>D. Required Action B.2 and associated Completion Time not met.</p> <p><u>OR</u></p> <p>One or two recirculation loops in operation in the "Restricted Zone" of Figure 3.4.1-1 with core flow <math>\leq</math> 39% of rated core flow.</p>	<p>D.1 Reduce THERMAL POWER to the "Unrestricted Zone" of Figure 3.4.1-1.</p> <p><u>OR</u></p> <p>D.2 Increase core flow to <math>&gt;</math> 39% of rated core flow.</p>	<p>4 hours</p> <p>4 hours</p>
<p>B E. Recirculation loop flow mismatch not within limits.</p>	<p>E.1 Declare the recirculation loop with lower flow to be "not in operation."</p>	<p>2 hours</p>
<p>C F. Requirements of the LCO not met for reasons other than Conditions A, B, C, D, and E.</p>	<p>F.1 Satisfy the requirements of the LCO.</p>	<p>4 hours</p>
<p>D G. Required Action and associated Completion Time of Condition F not met.</p>	<p>G.1 Be in MODE 3.</p>	<p>12 hours</p>

SURVEILLANCE REQUIREMENTS

SURVEILLANCE	FREQUENCY
<p>SR 3.4.1.1 Verify operation is in the "Unrestricted Zone" of Figure 3.4.1-1.</p>	<p>12 hours</p>
<p>SR 3.4.1.2   -----NOTE-----                      Not required to be performed until 24 hours after both recirculation loops are in operation.                      -----                      Verify jet pump loop flow mismatch with both recirculation loops in operation is:</p> <ul style="list-style-type: none"> <li>a. <math>\leq 10\%</math> of rated core flow when operating at an effective core flow <math>&lt; 70\%</math> of rated core flow; and</li> <li>b. <math>\leq 5\%</math> of rated core flow when operating at an effective core flow <math>\geq 70\%</math> of rated core flow.</li> </ul>	<p>24 hours</p>

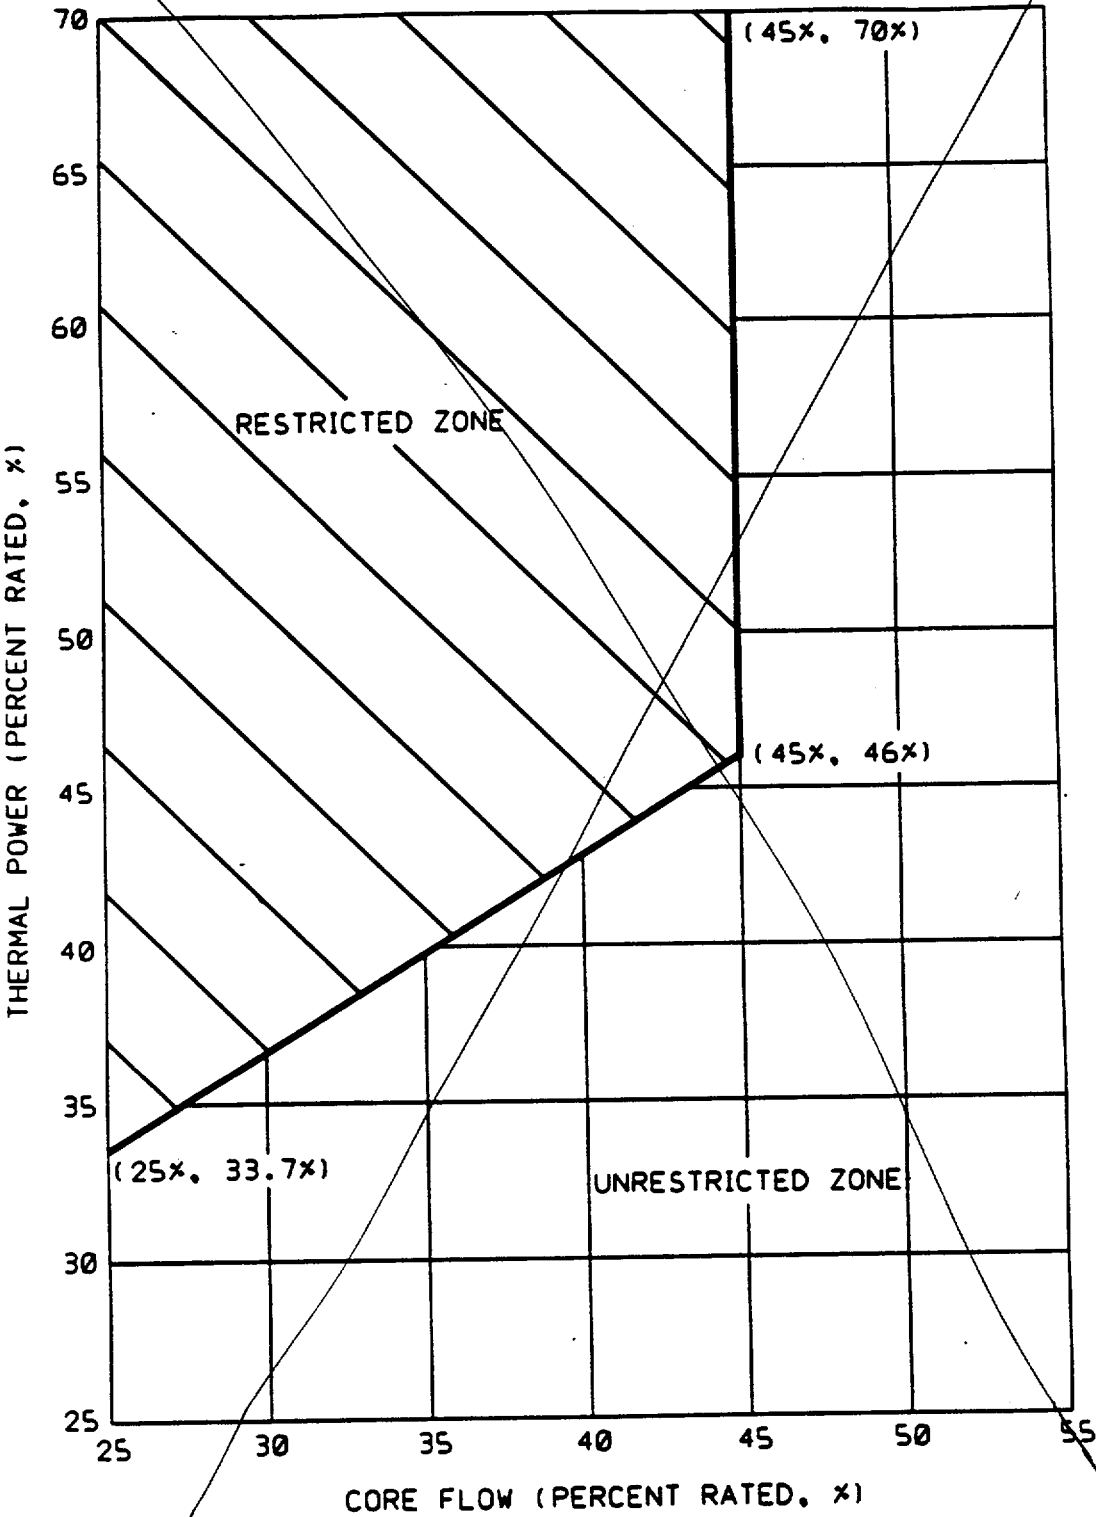


Figure 3.4.1-1 (Page 1 of 1)  
Stability Monitoring Power-to-Flow Map

BASES

---

BACKGROUND  
(continued)

The subcooled water enters the bottom of the fuel channels and contacts the fuel cladding, where heat is transferred to the coolant. As it rises, the coolant begins to boil, creating steam voids within the fuel channel that continue until the coolant exits the core. Because of reduced moderation, the steam voiding introduces negative reactivity that must be compensated for to maintain or to increase reactor power. The recirculation flow control allows operators to increase recirculation flow and sweep some of the voids from the fuel channel, overcoming the negative reactivity void effect. Thus, the reason for having variable recirculation flow is to compensate for reactivity effects of boiling over a wide range of power generation (i.e., 55 to 100% RTP) without having to move control rods and disturb desirable flux patterns. In addition, the combination of core flow and THERMAL POWER is normally maintained such that core thermal-hydraulic oscillations do not occur. These oscillations can occur during two-loop operation, as well as single-loop and no-loop operation. Plant procedures include requirements of this LCO as well as other vendor and NRC recommended requirements and actions to minimize the potential of core thermal-hydraulic oscillations.

Each recirculation loop is manually started from the control room. The recirculation flow control valves provide regulation of individual recirculation loop drive flows. The flow in each loop can be manually or automatically controlled.

---

APPLICABLE  
SAFETY ANALYSES

The operation of the Reactor Recirculation System is an initial condition assumed in the design basis loss of coolant accident (LOCA) (Ref. 1). During a LOCA caused by a recirculation loop pipe break, the intact loop is assumed to provide coolant flow during the first few seconds of the accident. The initial core flow decrease is rapid because the recirculation pump in the broken loop ceases to pump reactor coolant to the vessel almost immediately. The pump in the intact loop coasts down relatively slowly. This pump coastdown governs the core flow response for the next several seconds until the jet pump suction is uncovered (Ref. 2). The analyses assume that both loops are operating at the same flow prior to the accident. However, the LOCA analysis was reviewed for the case with a flow mismatch between the two loops, with the pipe break assumed to be in the loop with the higher flow. While the flow coastdown and

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES  
(continued)

core response are potentially more severe in this assumed case (since the intact loop starts at a lower flow rate and the core response is the same as if both loops were operating at a lower flow rate), a small mismatch has been determined to be acceptable based on engineering judgement.

The recirculation system is also assumed to have sufficient flow coastdown characteristics to maintain fuel thermal margins during abnormal operational transients (Ref. 3), which are analyzed in Chapter 15 of the USAR.

A plant specific LOCA analysis has been performed assuming only one operating recirculation loop. This analysis has demonstrated that, in the event of a LOCA caused by a pipe break in the operating recirculation loop, the Emergency Core Cooling System response will provide adequate core cooling, provided the APLHGR requirements are modified accordingly (Ref. 4).

The transient analyses in Chapter 15 of the USAR have also been performed for single recirculation loop operation (Ref. 4) and demonstrate sufficient flow coastdown characteristics to maintain fuel thermal margins during the abnormal operational transients analyzed provided the MCPR requirements are modified. During single recirculation loop operation, modification to the Reactor Protection System average power range monitor (APRM) and the Rod Block Monitor Allowable Values is also required to account for the different relationships between recirculation drive flow and reactor core flow. The APLHGR and MCPR limits for single loop operation are specified in the COLR. The APRM Flow Biased Simulated Thermal Power—Upscale Allowable Value is in LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation." The Rod Block Monitor—Upscale Allowable Value is in LCO 3.3.2.1, "Control Rod Block Instrumentation."

Safety analyses performed in Refs. 1 and 4 implicitly assure core conditions are stable. However, at the high power/low flow corner of the operating domain, a small probability of limit cycle neutron flux oscillations exists (Ref. 5) depending on combinations of operating conditions (e.g., power shape, bundle power, and bundle flow).

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES  
(continued)

General Electric Service Information Letter (SIL) No. 380 (Ref. 5) addressed boiling instability and made several recommendations. In this SIL, the power-to-flow map was divided into several regions of varying concern. It also discussed the objectives and philosophy of "detect and suppress."

NRC Generic Letter 86-02 (Ref. 6) discussed the GE stability methodology and stated that due to uncertainties, General Design Criteria 10 and 12 could not be met using available analytical procedures on a BWR. The letter discussed SIL 380 and stated that General Design Criteria 10 and 12 could be met by imposing SIL 380 recommendations in operating regions of potential instabilities. The NRC concluded that regions of potential instability constituted decay ratios of 0.8 and greater by the GE methodology.

GE issued Reference 5 to address the stability issue and to establish the stability zones. Subsequently, the zones have been re-established due to power uprate. Figure 3.4.1-1 has been divided into two major zones; the "Unrestricted Zone" and the "Restricted Zone." Continuous operation is permitted in the "Unrestricted Zone" while limited operation is permitted in the "Restricted Zone" due to the potential for thermal-hydraulic oscillations. In addition, the actions to take when operating with one or two recirculation loops in the "Restricted Zone" is based upon core flow being  $> 39\%$  of total core flow or  $\leq 39\%$  of total core flow. The 39% value is equivalent to the minimum core flow for two recirculation pumps operating at high speed with minimum flow control valve position.

Recirculation loops operating satisfies Criterion 2 of Reference 7. (5)

LCO

Two recirculation loops are normally required to be in operation with their flows matched within the limits specified in SR 3.4.1.2 to ensure that during a LOCA caused by a break of the piping of one recirculation loop the assumptions of the LOCA analysis are satisfied. Alternatively, with only one recirculation loop in operation, modifications to the required APLHGR limits (LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)"), MCPR limits (LCO 3.2.2, "MINIMUM CRITICAL POWER

(continued)



BASES

LCO  
(continued)

RATIO (MCPR)), APRM Flow Biased Simulated Thermal Power—Upscale Allowable Value (LCO 3.3.1.1), and the Rod Block Monitor—Upscale Allowable Value (LCO 3.3.2.1) must be applied to allow continued operation consistent with the assumptions of Reference 4. In addition, during two-loop and single-loop operation, the combination of core flow and THERMAL POWER must be in the "Unrestricted Zone" of Figure 3.4.1-1 to ensure core thermal-hydraulic oscillations do not occur. The "Unrestricted Zone" includes all the area to the right of the "Restricted Zone" boundary. The full power-to-flow map is not shown to enhance the readability of the bounds of the "Restricted Zone."

APPLICABILITY

In MODES 1 and 2, requirements for operation of the Reactor Coolant Recirculation System are necessary since there is considerable energy in the reactor core and the limiting design basis transients and accidents are assumed to occur.

In MODES 3, 4, and 5, the consequences of an accident are reduced and the coastdown characteristics of the recirculation loops are not important.

ACTIONS

~~A.1, A.2, and A.3~~

With no recirculation loops in operation, the <sup>unit</sup> probability of thermal-hydraulic oscillations is greatly increased. Therefore, action must be taken as soon as practicable to ensure operation is within the "Unrestricted Zone" of Figure 3.4.1-1, assuring the stability concerns are addressed. The 2 hour Completion Time provides a reasonable amount of time to restore operation to the "Unrestricted Zone" of Figure 3.4.1-1. This may be performed by reducing THERMAL POWER by inserting control rods.

The plant is also required to be brought to ~~at least~~ <sup>a mode in which the</sup> MODE 2 within 6 hours and to MODE 3 within 12 hours. In this condition, the recirculation loops are not required to be operating because of the reduced severity of DBAs and transients and minimal dependence on the recirculation loop coastdown characteristics. The allowed Completion Times are reasonable, based on operating experience, to reach the required plant conditions from full power conditions in an orderly manner and without challenging plant systems.

(continued)

LCO does not apply. To achieve this status, the plant must be brought to

BASES

ACTIONS  
(continued)

B.1 and B.2

With one or two recirculation loops in operation in the "Restricted Zone" of Figure 3.4.1-1 and core flow  $> 39\%$  of rated core flow, the plant is operating in a region where the potential for thermal-hydraulic oscillations exists. To ensure oscillations are not occurring, the APRM and LPRM neutron flux noise levels must be determined to be  $\leq 3$  times the baseline noise levels. For the LPRM neutron flux noise determination, detector levels A and C of one LPRM string per core octant plus detectors A and C of one LPRM string in the center of the core are monitored.

Baseline noise levels are determined uniquely for each cycle during the first operation in the "Restricted Zone" following a refueling outage. This initial baseline is then used for comparison to all subsequent neutron flux noise levels during operation in this zone.

A determination of APRM and LPRM neutron flux noise levels once per 8 hours provides frequent periodic information relative to established baseline noise levels that indicate stable steady state operation. A determination of these noise levels within 30 minutes after an increase of  $\geq 5\%$  RTP provides a more frequent indication of the stability of operation following any significant potential for change of the thermal hydraulic properties of the system. These frequencies provide early detection of neutron flux oscillations due to core thermal hydraulic instabilities.

In addition, core flow is also required to be determined every 12 hours. This will ensure that the operator periodically monitors the core flow and, if core flow decreases to  $\leq 39\%$  of rated core flow, the proper Condition is entered (Condition D). The periodic Completion Time is based on operating experience and the operator's inherent knowledge of reactor status, including changes in core flow.

C.1

If evidence of approaching instability occurs (i.e., APRM or LPRM neutron flux levels exceed three times the established baseline levels), action must be initiated as soon as practicable to restore the APRM and LPRM neutron flux levels

(continued)

BASES

ACTIONS

C.1 (continued)

to  $\leq 3$  times the established baseline levels. This can be done by increasing core flow or by reducing THERMAL POWER. The allowed 2 hour Completion Time is reasonable, based on operating experience, to restore plant parameters in an orderly manner and without challenging plant systems.

D.1 and D.2

With one or two recirculation loops in operation in the "Restricted Zone" of Figure 3.4.1-1, and core flow  $\leq 39\%$  of rated core flow, the plant is operating in a region where the potential for thermal-hydraulic oscillations is increased and sufficient margin may not be available for operator response to suppress potential thermal-hydraulic oscillations. As a result, action must be taken as soon as practicable to restore operation to  $> 39\%$  of rated core flow or to the "Unrestricted Zone" of Figure 3.4.1-1. This can be accomplished by either decreasing THERMAL POWER with control rod insertion or increasing core flow with recirculation flow control valve manipulation. The starting or shifting of a recirculation pump shall not be used as a means to increase core flow  $> 39\%$  of rated core flow. The 4 hour Completion Time provides a reasonable amount of time to complete the Required Action.

B E.1 and E.1

With both recirculation loops operating but the flows not matched, the flows must be matched within 2 hours. If matched flows are not restored, the recirculation loop with lower flow must be declared "not in operation," as required by Required Action E.1. This Required Action does not require tripping the recirculation pump in the lowest flow loop when the mismatch between total jet pump flows of the two loops is greater than the required limits. However, in cases where large flow mismatches occur, low flow or reverse flow can occur in the low flow loop jet pumps, causing vibration of the jet pumps. If zero or reverse flow is detected, the condition should be alleviated by changing flow control valve position to re-establish forward flow or by tripping the pump.

(continued)

BASES

ACTIONS

<sup>B</sup> ~~A.1~~ and <sup>C</sup> ~~K.1~~ (continued)

<sup>(and)</sup> With the requirements of the LCO not met for reasons other than Condition ~~A, B, C, D, or E~~ (e.g. one loop is "not in operation"), the recirculation loops must be restored to operation with matched flows within 4 hours. A recirculation loop is considered not in operation when the pump in that loop is idle or when the mismatch between total jet pump flows of the two loops is greater than required limits for greater than 2 hours (i.e. Required Action ~~K.1~~ <sup>(B)</sup> has been taken). Should a LOCA occur with one recirculation loop not in operation, the core flow coastdown and resultant core response may not be bounded by the LOCA analyses. Therefore, only a limited time is allowed to restore the inoperable loop to operating status.

Alternatively, if the single loop requirements of the LCO are applied to the APLHGR and MCPR operating limits and RPS and RBM Allowable Values, operation with only one recirculation loop would satisfy the requirements of the LCO and the initial conditions of the accident sequence.

The 2 hour and 4 hour Completion Times are based on the low probability of an accident occurring during this time period, on a reasonable time to complete the Required Action, and on frequent core monitoring by operators allowing abrupt changes in core flow conditions to be quickly detected.

<sup>D</sup> ~~L.1~~

<sup>(C)</sup> If the Required Action and associated Completion Time of Condition ~~L.1~~ is not met, the unit is required to be brought to a MODE in which the LCO does not apply. To achieve this status, the plant must be brought to MODE 3 within 12 hours. In this condition, the recirculation loops are not required to be operating because of the reduced severity of DBAs and minimal dependence on the recirculation loop coastdown characteristics. The allowed Completion Time of 12 hours is reasonable, based on operating experience, to reach MODE 3 from full power conditions in an orderly manner and without challenging plant systems.

(continued)

BASES (continued)

SURVEILLANCE  
REQUIREMENTS

SR 3.4.1.1

This SR ensures the combination of core flow and THERMAL POWER are within appropriate limits to prevent uncontrolled thermal-hydraulic oscillations. At low recirculation flows and high reactor power, the reactor exhibits increased susceptibility to thermal-hydraulic instability. Figure 3.4.1-1 is based on guidance provided in References 5, 6, and 7. The 12 hour Frequency is based on operating experience and the operator's inherent knowledge of the reactor status, including significant changes in THERMAL POWER and core flow.

SR 3.4.1.2

This SR ensures the recirculation loop flows are within the allowable limits for mismatch. At low core flow (i.e., effective core flow < 70% of rated core flow), the APLHGR and MCPR requirements provide larger margins to the fuel cladding integrity Safety Limit such that the potential adverse effect of early boiling transition during a LOCA is reduced. A larger flow mismatch can therefore be allowed when effective core flow is < 70% of rated core flow. The jet pump loop flow, as used in this Surveillance, is the summation of the flows from all of the jet pumps associated with a single recirculation loop. The effective core flow shall be calculated by assuming both loops are at the smaller value of the two jet pump loop flows.

The mismatch is measured in terms of percent of rated core flow. If the flow mismatch exceeds the specified limits, the loop with the lower flow is considered not in operation. (However, for the purpose of performing Required Action B.2 the flow rate of both loops shall be used). This SR is not required when both loops are not in operation since the mismatch limits are meaningless during single loop or natural circulation operation. The Surveillance must be performed within 24 hours after both loops are in operation. The 24 hour Frequency is consistent with the Frequency for jet pump OPERABILITY verification and has been shown by operating experience to be adequate to detect off normal jet pump loop flows in a timely manner.

(continued)

BASES (continued)

---

REFERENCES

1. USAR, Section 6.3 and Appendix A Section 6.
2. USAR, Section 6.3.3.7.
3. USAR, Section 5.4.1.3.
4. USAR Chapter 15B.

5. ~~GE Service Information Letter No. 380, "BWR Core Thermal Hydraulic Stability," Revision 1, February 10, 1984.~~

6. ~~NRC Generic Letter 86-02, "Technical Resolution of Generic Issue B-19, Thermal Hydraulic Stability," January 22, 1986.~~

57. 10 CFR 50.36(c)(2)(ii).

---

4. Reactor Protection System Instrumentation Setpoint for the OPRM-Upscale Function Allowable Value for Specification 3.3.1.1.

5.6 Reporting Requirements

5.6.5 CORE OPERATING LIMITS REPORT (COLR) (continued)

1. The APLHGR for Specification 3.2.1.
2. The MCPR for Specification 3.2.2.
3. The LHGR for Specification 3.2.3.
4. Control Rod Block Instrumentation Setpoint for the Rod Block Monitor—Upscale Function Allowable Value for Specification 3.3.2.1.

b. The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:

1. NEDE-24011-P-A-US, General Electric Standard Application for Reactor Fuel," U.S. Supplement, (NRC approved version specified in the COLR).
2. NEDE-23785-1-PA, "The GESTR-LOCA and SAFER Models for the Evaluation of the Loss-of-Coolant Accident, Volume III, SAFER/GESTR Application Methodology," (NRC approved version specified in the COLR).

c. The core operating limits shall be determined such that all applicable limits (e.g., fuel thermal mechanical limits, core thermal hydraulic limits, Emergency Core Cooling Systems (ECCS) limits, nuclear limits such as SDM, transient analysis limits, and accident analysis limits) of the safety analysis are met.

d. The COLR, including any midcycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC.

5.6.6 Post Accident Monitoring (PAM) Instrumentation Report

When a report is required by Condition B or F of LCO 3.3.3.1, "Post Accident Monitoring (PAM) Instrumentation," a report shall be submitted within the following 14 days. The report shall outline the preplanned alternate method of monitoring, the cause of the inoperability, and the plans and schedule for restoring the instrumentation channels of the Function to OPERABLE status.

3. NEDO-32465-A, "Reactor Stability Detect and Suppress Solutions Licensing Basis Methodology for Reload Applications," August 1996. 5.0-20 Revision A

**ATTACHMENT B**

**CLEAN TYPED ITS PAGES**



3.3 INSTRUMENTATION

3.3.1.1 Reactor Protection System (RPS) Instrumentation

LC0 3.3.1.1 The RPS instrumentation for each Function in Table 3.3.1.1-1 shall be OPERABLE.

APPLICABILITY: According to Table 3.3.1.1-1.

ACTIONS

-----NOTE-----  
Separate Condition entry is allowed for each channel.  
-----

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. One or more required channels inoperable.	A.1 Place channel in trip.	12 hours
	<u>OR</u>	
	A.2 Place associated trip system in trip.	12 hours
B. -----NOTE----- Not applicable for Functions 2.a, 2.b, 2.c, 2.d, and 2.e. ----- One or more Functions with one or more required channels inoperable in both trip systems.	B.1 Place channel in one trip system in trip.	6 hours
	<u>OR</u>	
	B.2 Place one trip system in trip.	6 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
C. One or more Functions with RPS trip capability not maintained.	C.1 Restore RPS trip capability.	1 hour
D. Required Action and associated Completion Time of Condition A, B, or C not met.	D.1 Enter the Condition referenced in Table 3.3.1.1-1 for the channel.	Immediately
E. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	E.1 Reduce THERMAL POWER to < 30% RTP.	4 hours
F. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	F.1 Initiate alternate method to detect and suppress thermal-hydraulic instability oscillations.  <u>AND</u> F.2 Restore required channel to OPERABLE status.	12 hours         120 days
G. Required Action and associated Completion Time of Condition F not met.  <u>OR</u>  As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	G.1 Be in MODE 2.	6 hours

(continued)

ACTIONS (continued)

CONDITION	REQUIRED ACTION	COMPLETION TIME
H. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	H.1 Be in MODE 3.	12 hours
I. As required by Required Action D.1 and referenced in Table 3.3.1.1-1.	I.1 Initiate action to fully insert all insertable control rods in core cells containing one or more fuel assemblies.	Immediately

SURVEILLANCE REQUIREMENTS

-----NOTES-----

1. Refer to Table 3.3.1.1-1 to determine which SRs apply for each RPS Function.
  2. When a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours provided the associated Function maintains RPS trip capability.
- 

SURVEILLANCE	FREQUENCY
SR 3.3.1.1.1 Perform CHANNEL CHECK.	12 hours
SR 3.3.1.1.2 Perform CHANNEL CHECK.	24 hours

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.1.3 -----NOTE----- Not required to be performed until 12 hours after THERMAL POWER <math>\geq</math> 25% RTP. -----</p> <p>Verify the absolute difference between the average power range monitor (APRM) channels and the calculated power <math>\leq</math> 2% RTP plus any gain adjustment required by LCO 3.2.4, "Average Power Range Monitor (APRM) Gain and Setpoint," while operating at <math>\geq</math> 25% RTP.</p>	7 days
<p>SR 3.3.1.1.4 -----NOTE----- For Functions 1.a and 1.b, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2. -----</p> <p>Perform CHANNEL FUNCTIONAL TEST.</p>	7 days
<p>SR 3.3.1.1.5 Verify the source range monitor (SRM) and intermediate range monitor (IRM) channels overlap.</p>	Prior to fully withdrawing SRMs
<p>SR 3.3.1.1.6 -----NOTE----- Only required to be met during entry into MODE 2 from MODE 1. -----</p> <p>Verify the IRM and APRM channels overlap.</p>	7 days

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
SR 3.3.1.1.7 Calibrate the local power range monitors.	1000 effective full power hours
SR 3.3.1.1.8 Perform CHANNEL FUNCTIONAL TEST.	92 days
SR 3.3.1.1.9 Calibrate the trip units.	92 days
SR 3.3.1.1.10 -----NOTES----- 1. For Function 2.a, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2.  2. For Function 2.e, the CHANNEL FUNCTIONAL TEST only requires toggling the appropriate outputs of the APRM. -----  Perform CHANNEL FUNCTIONAL TEST.	184 days
SR 3.3.1.1.11 Perform CHANNEL CALIBRATION.	18 months
SR 3.3.1.1.12 Perform CHANNEL FUNCTIONAL TEST.	24 months

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.1.13 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Neutron detectors are excluded.</li> <li>2. For Functions 1.a and 2.a, not required to be performed when entering MODE 2 from MODE 1 until 12 hours after entering MODE 2.</li> <li>3. For Function 2.e, the CHANNEL CALIBRATION only requires a verification of ORRM-Upscale setpoints in the APRM by the review of the "Show Parameters" display.</li> </ol> <p>-----</p> <p>Perform CHANNEL CALIBRATION.</p>	<p>24 months</p>
<p>SR 3.3.1.1.14 Perform LOGIC SYSTEM FUNCTIONAL TEST.</p>	<p>24 months</p>
<p>SR 3.3.1.1.15 Verify Turbine Stop Valve—Closure, and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions are not bypassed when THERMAL POWER is <math>\geq</math> 30% RTP.</p>	<p>24 months</p>
<p>SR 3.3.1.1.16 Verify APRM OPRM-Upscale Function is not bypassed when THERMAL POWER is <math>\geq</math> 30% RTP and recirculation drive flow is <math>&lt;</math> 60% of rated recirculation drive flow.</p>	<p>24 months</p>

(continued)

SURVEILLANCE REQUIREMENTS (continued)

SURVEILLANCE	FREQUENCY
<p>SR 3.3.1.1.17 -----NOTES-----</p> <ol style="list-style-type: none"> <li>1. Function 2.f digital electronics are excluded.</li> <li>2. For Functions 3 and 4, the sensor response time may be assumed to be the design sensor response time.</li> <li>3. For Function 5, "n" equals 4 channels for the purpose of determining the STAGGERED TEST BASIS Frequency.</li> <li>4. For Function 9, the RPS RESPONSE TIME is measured from start of turbine control valve fast closure.</li> </ol> <p>-----</p> <p>Verify the RPS RESPONSE TIME is within limits.</p>	<p>24 months on a STAGGERED TEST BASIS</p>

Table 3.3.1.1-1 (page 1 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
<b>1. Intermediate Range Monitors</b>					
a. Neutron Flux - Upscale	2	3	H	SR 3.3.1.1.1 SR 3.3.1.1.4 SR 3.3.1.1.5 SR 3.3.1.1.6 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 122/125 divisions of full scale
	5(a)	3	I	SR 3.3.1.1.1 SR 3.3.1.1.4 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 122/125 divisions of full scale
b. Inop	2	3	H	SR 3.3.1.1.4 SR 3.3.1.1.14	NA
	5(a)	3	I	SR 3.3.1.1.4 SR 3.3.1.1.14	NA
<b>2. Average Power Range Monitors</b>					
a. Neutron Flux - Upscale, Setdown	2	3 per logic channel	H	SR 3.3.1.1.2 SR 3.3.1.1.6 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ 20% RTP
b. Flow Biased Simulated Thermal Power - Upscale	1	3 per logic channel	G	SR 3.3.1.1.2 SR 3.3.1.1.3 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ .58W + 62% RTP and ≤ 115.5% RTP(b)
c. Fixed Neutron Flux - Upscale	1	3 per logic channel	G	SR 3.3.1.1.2 SR 3.3.1.1.3 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13	≤ 120% RTP
d. Inop	1,2	3 per logic channel	H	SR 3.3.1.1.7 SR 3.3.1.1.10	NA
e. OPRM-Upscale	1	3 per logic channel	F	SR 3.3.1.1.2 SR 3.3.1.1.7 SR 3.3.1.1.10 SR 3.3.1.1.13 SR 3.3.1.1.16	As specified in the COLR
f. 2-Out-Of-4 Voter	1,2	2	H	SR 3.3.1.1.2 SR 3.3.1.1.10 SR 3.3.1.1.14 SR 3.3.1.1.17	NA

(continued)

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

(b) Allowable Value is .58(W - 5%) + 62% RTP when reset for single loop operation per LCO 3.4.1, "Recirculation Loops Operating."



Table 3.3.1.1-1 (page 2 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
3. Reactor Vessel Steam Dome Pressure – High	1,2	2	H	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.17	≤ 1072 psig
4. Reactor Vessel Water Level – Low, Level 3	1,2	2	H	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.17	≥ 157.8 inches
5. Main Steam Isolation Valve – Closure	1	8	G	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.17	≤ 12% closed
6. Drywell Pressure – High	1,2	2	H	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 1.88 psig
7. Scram Discharge Volume Water Level – High					
a. Transmitter/Trip Unit	1,2	2	H	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.11 SR 3.3.1.1.14	≤ 49.5 inches
	5(a)	2	I	SR 3.3.1.1.1 SR 3.3.1.1.8 SR 3.3.1.1.9 SR 3.3.1.1.11 SR 3.3.1.1.14	≤ 49.5 inches
b. Float Switch	1,2	2	H	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 49.5 inches
	5(a)	2	I	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14	≤ 49.5 inches
8. Turbine Stop Valve – Closure	≥ 30% RTP	4	E	SR 3.3.1.1.8 SR 3.3.1.1.13 SR 3.3.1.1.14 SR 3.3.1.1.15 SR 3.3.1.1.17	≤ 7% closed

(continued)

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

Table 3.3.1.1-1 (page 3 of 3)  
Reactor Protection System Instrumentation

FUNCTION	APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS	REQUIRED CHANNELS PER TRIP SYSTEM	CONDITIONS REFERENCED FROM REQUIRED ACTION D.1	SURVEILLANCE REQUIREMENTS	ALLOWABLE VALUE
9. Turbine Control Valve Fast Closure, Trip Oil Pressure - Low	≥ 30% RTP	2	E	SR 3.3.1.1.8	≥ 465 psig
				SR 3.3.1.1.13	
				SR 3.3.1.1.14	
				SR 3.3.1.1.15	
10. Reactor Mode Switch - Shutdown Position	1,2	2	H	SR 3.3.1.1.12	NA
				SR 3.3.1.1.14	
11. Manual Scram	5(a)	2	I	SR 3.3.1.1.12	NA
				SR 3.3.1.1.14	
	1,2	4	H	SR 3.3.1.1.4	NA
				SR 3.3.1.1.14	
5(a)	4	I	SR 3.3.1.1.4	NA	
			SR 3.3.1.1.14		

(a) With any control rod withdrawn from a core cell containing one or more fuel assemblies.

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.a. Average Power Range Monitor Neutron Flux—Upscale,  
Setdown (continued)

With the IRMs at Range 9 or 10, it is possible that the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function will provide the primary trip signal for a core-wide increase in power.

No specific safety analyses take direct credit for the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function. However, this Function indirectly ensures that, before the reactor mode switch is placed in the run position, reactor power does not exceed 25% RTP (SL 2.1.1.1) when operating at low reactor pressure and low core flow. Therefore, it indirectly prevents fuel damage during significant reactivity increases with THERMAL POWER < 25% RTP.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor Neutron Flux—Upscale, Setdown channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide a Neutron Flux—Upscale, Setdown signal, two channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor Neutron Flux—Upscale, Setdown, with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, at least 20 LPRM inputs are required for each APRM, with at least three LPRM inputs from each of the four axial levels at which the LPRMs are located.

The Allowable Value is based on preventing significant increases in power when THERMAL POWER is < 25% RTP.

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.a. Average Power Range Monitor Neutron Flux—Upscale,  
Setdown (continued)

The Average Power Range Monitor Neutron Flux—Upscale, Setdown Function must be OPERABLE during MODE 2 when control rods may be withdrawn, since the potential for criticality exists. In MODE 1, the Average Power Range Monitor Neutron Flux—Upscale Function provides protection against reactivity transients and the RWM and Rod Block Monitor protect against control rod withdrawal error events.

2.b. Average Power Range Monitor Flow Biased Simulated  
Thermal Power—Upscale

The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function monitors neutron flux to approximate the THERMAL POWER being transferred to the reactor coolant. The APRM neutron flux is digitally filtered with a time constant representative of the fuel heat transfer dynamics to generate a signal proportional to the THERMAL POWER in the reactor. The trip level is varied as a function of recirculation drive flow, W, in percent of rated recirculation drive flow, (i.e., at lower core flows the setpoint is reduced proportional to the reduction in power experienced as core flow is reduced with a fixed control rod pattern) but is clamped at an upper limit that is always lower than the Average Power Range Monitor Fixed Neutron Flux—Upscale Function Allowable Value. The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function provides protection against transients where THERMAL POWER increases slowly (such as the loss of feedwater heating event) and protects the fuel cladding integrity by ensuring that the MCPR SL is not exceeded. During these events, the THERMAL POWER increase does not significantly lag the neutron flux response and, because of a lower trip setpoint, will initiate a scram before the high neutron flux scram. For rapid neutron flux increase events, the THERMAL POWER lags the neutron flux and the Average Power Range Monitor Fixed Neutron Flux—Upscale Function will provide a scram signal before the Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function setpoint is exceeded.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.b. Average Power Range Monitor Flow Biased Simulated  
Thermal Power—Upscale (continued)

The Average Power Range Monitor Flow Biased Simulated Thermal Power—Upscale Function is required to be OPERABLE in MODE 1 when there is the possibility of generating excessive THERMAL POWER and potentially exceeding the SL applicable to high pressure and core flow conditions (MCPR SL). During MODES 2 and 5, other IRM and APRM Functions provide protection for fuel cladding integrity.

2.c. Average Power Range Monitor Fixed Neutron  
Flux—Upscale

The APRM channels provide the primary indication of neutron flux within the core and respond almost instantaneously to neutron flux increases. The Average Power Range Monitor Fixed Neutron Flux—Upscale Function is capable of generating a trip signal to prevent fuel damage or excessive Reactor Coolant System pressure. For the overpressurization protection analysis of Reference 2, the Average Power Range Monitor Fixed Neutron Flux—Upscale Function is assumed to terminate the main steam isolation valve (MSIV) closure event and, along with the safety/relief valves (S/RVs), limits the peak reactor pressure vessel (RPV) pressure to less than the ASME Code limits. The control rod drop accident (CRDA) analysis (Ref. 8) takes credit for the Average Power Range Monitor Fixed Neutron Flux—Upscale Function to terminate the CRDA.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor Fixed Neutron Flux—Upscale channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide a Fixed Neutron Flux—Upscale signal, two

(continued)

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.c. Average Power Range Monitor Fixed Neutron  
Flux—Upscale (continued)

channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor Fixed Neutron Flux—Upscale with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, at least 20 LPRM inputs are required for each APRM, with at least three LPRM inputs from each of the four axial levels at which the LPRMs are located.

The Allowable Value is based on the Analytical Limit assumed in the CRDA analyses.

The Average Power Range Monitor Fixed Neutron Flux—Upscale Function is required to be OPERABLE in MODE 1 where the potential consequences of the analyzed transients could result in the SLs (e.g., MCPR and Reactor Coolant System pressure) being exceeded. Although the Average Power Range Monitor Fixed Neutron Flux—Upscale Function is assumed in the CRDA analysis (Ref. 8) that is applicable in MODE 2, the Average Power Range Monitor Neutron Flux—Upscale, Setdown Function conservatively bounds the assumed trip and, together with the assumed IRM trips, provides adequate protection. Therefore, the Average Power Monitor Fixed Neutron Flux—Upscale Function is not required in MODE 2.

2.d. Average Power Range Monitor—Inop

This signal provides assurance that a minimum number of APRM channels are OPERABLE. For any APRM, any time its function switch is moved out of the Operate position (i.e., to the inop position), a loss of power to the APRM occurs, the firmware/software watchdog timer has timed out, or the automatic self-test system detects a critical fault with the APRM, an inoperative trip signal will be sent to both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor—Inop channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM

(continued)

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.d. Average Power Range Monitor—Inop (continued)

provides an input to all four 2-Out-Of-4 Voter channels, one channel per logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide an Inop signal, two channels in both logic channels in each trip system will trip, producing a scram. This Function was not specifically credited in the accident analysis, but it is retained for the overall redundancy and diversity of the RPS as required by the NRC approved licensing basis.

Twelve channels of Average Power Range Monitor—Inop with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal.

There is no Allowable Value for this Function.

This Function is required to be OPERABLE in the MODES where the other APRM Functions are required.

2.e. Average Power Range Monitor OPRM—Upscale

The APRM channels provide the primary indication of neutron flux within the core and respond almost instantaneously to neutron flux increases. In addition, the channels can detect oscillatory changes in neutron flux. The Average Power Range Monitor Oscillation Power Range Monitor (OPRM)—Upscale Function is capable of detecting neutron flux oscillations indicative of thermal-hydraulic instabilities, by detecting the related neutron flux oscillations, and generating a trip signal before the MCPR Safety Limit is exceeded (Ref. 14).

The OPRM—Upscale Function receives input signals from the LPRMs, which are combined into cells (four LPRMs per cell) for evaluation by the OPRM algorithms. An OPRM—Upscale trip signal is issued from an APRM channel when the period based detection algorithm in that channel detects oscillatory changes in neutron flux, indicated by the combined signals of the LPRM detectors in a cell, with periodic confirmations and relative cell amplitude exceeding specific setpoints. One or more OPRM cells in a channel exceeding the trip conditions will result in a channel trip.

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.e. Average Power Range Monitor OPRM—Upscale (continued)

An OPRM—Upscale trip can also be generated if either the growth rate or amplitude based algorithms detect growing oscillatory changes in the neutron flux for one or more cells. However, this portion of the trip is not required by this Specification; only the period based algorithm is required for OPERABILITY.

The APRM System is divided into four APRMs, each providing an input into both trip systems via the 2-Out-Of-4 Voter channels, Function 2.f. Each APRM inputs to all four 2-Out-Of-4 Voter channels, with each APRM input into a 2-Out-Of-4 Voter channel considered a channel. Thus, there are a total of 16 Average Power Range Monitor OPRM—Upscale channels, with eight channels per trip system and four channels per logic channel. The system is designed to allow one APRM to be bypassed (and since the APRM provides an input to all four 2-Out-Of-4 Voter channels, one channel in each logic channel is effectively bypassed). Any two APRM channels in a logic channel can cause the associated trip system to trip. Since each APRM inputs into both trip systems, this effectively means that when two APRMs provide an OPRM—Upscale signal, two channels in both logic channels in each trip system will trip, producing a scram. Twelve channels of Average Power Range Monitor OPRM—Upscale with three channels per logic channel in each trip system are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. In addition, to provide adequate coverage of the entire core, a minimum of 21 cells, each with a minimum of two LPRMs, are required for each OPRM—Upscale Function.

The Allowable Value, which is specified in the COLR, is based on ensuring the MCPR Safety Limit is not exceeded due to anticipated thermal-hydraulic power oscillations.

The Average Power Range Monitor OPRM—Upscale Function automatic trip is only enabled when THERMAL POWER, as determined by APRM Simulated Thermal Power, is  $\geq 30\%$  RTP and reactor core flow, as indicated by recirculation drive flow, is  $< 60\%$  of rated recirculation drive flow. This is the operating region where actual thermal-hydraulic oscillations may occur. However, the Average Power Range Monitor OPRM—Upscale Function is required to be OPERABLE at all times while in MODE 1. When the automatic trip is bypassed, the Average Power Range Monitor OPRM—Upscale Function is

(continued)



BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.e. Average Power Range Monitor OPRM—Upscale (continued)

still considered OPERABLE provided the automatic trip is not bypassed when the proper power and flow conditions exist. Requiring the Average Power Range Monitor OPRM—Upscale Function to be OPERABLE in MODE 1 provides adequate margin to cover the operating region where oscillations may occur as well as the operating regions from which the plant might enter the potential instability region without operator action.

2.f. Average Power Range Monitor 2-Out-Of-4 Voter

The 2-Out-Of-4 Voter Function provides the interface between the other APRM Functions and the RPS trip system logic, and as such, supports the safety analyses applicable to the other APRM Functions. Each APRM provides two inputs to all four 2-Out-Of-4 Voter channels (one input is common for Functions 2.a, 2.b, 2.c, and 2.d). The four 2-Out-Of-4 Voter channels are divided into two groups of two channels, with each group providing inputs into one RPS trip system (each channel inputs to one logic channel, similar to most other RPS instrumentation Functions). When two trip signals from any combination of APRM Functions 2.a, 2.b, 2.c, and 2.d are received (from different APRMs) by a 2-Out-Of-4 Voter channel, or two trip signals from any combination of APRM Function 2.e are received by a 2-Out-Of-4 Voter channel, the 2-Out-Of-4 Voter channel provides a trip signal to its associated trip system. Any one 2-Out-Of-4 Voter channel can trip the associated trip system (i.e., a one-out-of-two logic). In addition, while each 2-Out-Of-4 Voter channel provides two inputs to its associated trip system, only one of the inputs is required for OPERABILITY.

Each 2-Out-Of-4 Voter channel also includes self-diagnostic functions. If any channel detects a critical fault in its own processing, a trip signal is provided to its associated trip system. Unlike the other APRM Functions, a bypass capability for the 2-Out-Of-4 Voter Function is not provided.

Four channels of the APRM 2-Out-Of-4 Voter Function with two channels in each trip system are required to be OPERABLE to ensure that no single failure will preclude a scram from this Function on a valid signal.

(continued)

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

2.f. Average Power Range Monitor 2-Out-Of-4 Voter  
(continued)

There is no Allowable Value for this Function.

This Function is required to be OPERABLE in the MODES where the other APRM Functions are required.

3. Reactor Vessel Steam Dome Pressure—High

An increase in the RPV pressure during reactor operation compresses the steam voids and results in a positive reactivity insertion. This causes the neutron flux and THERMAL POWER transferred to the reactor coolant to increase, which could challenge the integrity of the fuel cladding and the RCPB. No specific safety analysis takes direct credit for this Function. However, the Reactor Vessel Steam Dome Pressure—High Function initiates a scram for transients that result in a pressure increase, counteracting the pressure increase by rapidly reducing core power. For the overpressurization protection analysis of Reference 2, the reactor scram (the analyses conservatively assume scram on the Average Power Range Monitor Fixed Neutron Flux—Upscale signal, not the Reactor Vessel Steam Dome Pressure—High signal), along with the S/RVs, limits the peak RPV pressure to less than the ASME Section III Code limits.

High reactor pressure signals are initiated from four pressure transmitters that sense reactor pressure. The Reactor Vessel Steam Dome Pressure—High Allowable Value is chosen to provide a sufficient margin to the ASME Section III Code limits during the event.

Four channels of Reactor Vessel Steam Dome Pressure—High Function, with two channels in each trip system arranged in a one-out-of-two logic, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. The Function is required to be OPERABLE in MODES 1 and 2 since the RCS is pressurized and the potential for pressure increase exists.

(continued)

---

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY  
(continued)

4. Reactor Vessel Water Level—Low, Level 3

Low RPV water level indicates the capability to cool the fuel may be threatened. Should RPV water level decrease too far, fuel damage could result. Therefore, a reactor scram is initiated at Level 3 to substantially reduce the heat generated in the fuel from fission. The Reactor Vessel Water Level—Low, Level 3 Function is a secondary scram signal to Drywell Pressure—High in the analysis of the recirculation line break (Ref. 3) but is assumed in the loss of feedwater flow event of Reference 4. The reactor scram reduces the amount of energy required to be absorbed and, along with the actions of the Emergency Core Cooling Systems (ECCS), ensures that the fuel peak cladding temperature remains below the limits of 10 CFR 50.46.

Reactor Vessel Water Level—Low, Level 3 signals are initiated from four differential pressure transmitters that sense the difference between the pressure due to a constant column of water (reference leg) and the pressure due to the actual water level (variable leg) in the vessel.

Four channels of Reactor Vessel Water Level—Low, Level 3 Function, with two channels in each trip system arranged in a one-out-of-two logic, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal.

The Reactor Vessel Water Level—Low, Level 3 Allowable Value is selected to ensure that, for transients involving loss of all normal feedwater flow, initiation of the low pressure ECCS at RPV Water Level 1 will not be required.

The Function is required in MODES 1 and 2 where considerable energy exists in the RCS resulting in the limiting transients and accidents. ECCS initiations at Reactor Vessel Water Level—Low Low, Level 2 and Low Low Low, Level 1 provide sufficient protection for level transients in all other MODES.

5. Main Steam Isolation Valve—Closure

MSIV closure results in loss of the main turbine and the condenser as a heat sink for the Nuclear Steam Supply System and indicates a need to shut down the reactor to reduce heat generation. Therefore, a reactor scram is initiated on a

(continued)

BASES

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

5. Main Steam Isolation Valve—Closure (continued)

Main Steam Isolation Valve—Closure signal before the MSIVs are completely closed in anticipation of the complete loss of the normal heat sink and subsequent overpressurization transient. However, for the overpressurization protection analysis of Reference 2, the Average Power Range Monitor Fixed Neutron Flux—Upscale Function, along with the S/RVs, limits the peak RPV pressure to less than the ASME Code limits. That is, the direct scram on position switches for MSIV closure events is not assumed in the overpressurization analysis. Additionally, MSIV closure is assumed in the transients analyzed in Reference 4 (e.g., low steam line pressure, manual closure of MSIVs, high steam line flow). The reactor scram reduces the amount of energy required to be absorbed and, along with the actions of the ECCS, ensures that the fuel peak cladding temperature remains below the limits of 10 CFR 50.46.

MSIV closure signals are initiated from position switches located on each of the eight MSIVs. Each MSIV has two position switches; one inputs to RPS trip system A while the other inputs to RPS trip system B. Thus, each RPS trip system receives an input from eight Main Steam Isolation Valve—Closure channels, each consisting of one position switch. The logic for the Main Steam Isolation Valve—Closure Function is arranged such that either the inboard or outboard valve on three or more of the main steam lines (MSLs) must close in order for a scram to occur. In addition, certain combinations of valves closed in two lines will result in a half-scram.

The Main Steam Isolation Valve—Closure Allowable Value is specified to ensure that a scram occurs prior to a significant reduction in steam flow, thereby reducing the severity of the subsequent pressure transient.

Sixteen channels of the Main Steam Isolation Valve—Closure Function with eight channels in each trip system are required to be OPERABLE to ensure that no single instrument failure will preclude the scram from this Function on a valid signal. This Function is only required in MODE 1 since, with the MSIVs open and the heat generation rate high, a pressurization transient can occur if the MSIVs

(continued)

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

5. Main Steam Isolation Valve—Closure (continued)

close. In MODE 2, the heat generation rate is low enough so that the other diverse RPS functions provide sufficient protection.

6. Drywell Pressure—High

High pressure in the drywell could indicate a break in the RCPB. A reactor scram is initiated to minimize the possibility of fuel damage and to reduce the amount of energy being added to the coolant and the drywell. The Drywell Pressure—High Function is assumed in the analysis of the recirculation line break. The reactor scram reduces the amount of energy required to be absorbed and along with the actions of the ECCS, ensures that the fuel peak cladding temperature remains below the limits of 10 CFR 50.46.

High drywell pressure signals are initiated from four pressure transmitters that sense drywell pressure. The Allowable Value was selected to be as low as possible and be indicative of a LOCA inside primary containment.

Four channels of Drywell Pressure—High Function, with two channels in each trip system, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. The Function is required in MODES 1 and 2 where considerable energy exists in the RCS, resulting in the limiting transients and accidents.

7.a. b. Scram Discharge Volume Water Level—High

The SDV receives the water displaced by the motion of the CRD pistons during a reactor scram. Should this volume fill to a point where there is insufficient volume to accept the displaced water, control rod insertion would be hindered. Therefore, a reactor scram is initiated when the remaining free volume is still sufficient to accommodate the water from a full core scram. However, even though the two types of Scram Discharge Volume Water Level—High Functions are an input to the RPS logic, no credit is taken for a scram initiated from these Functions for any of the design basis accidents or transients analyzed in the USAR. However, they are retained to ensure that the RPS remains OPERABLE.

(continued)

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

7.a, b. Scram Discharge Volume Water Level—High  
(continued)

SDV water level is measured by two diverse methods. The level in each of the two SDVs is measured by two float type level switches and two transmitters and trip units for a total of eight level signals. The outputs of these devices are arranged so that there is a signal from a level switch and a transmitter and trip unit to each RPS logic channel. The level measurement instrumentation satisfies the recommendations of Reference 9.

The Allowable Value is chosen low enough to ensure that there is sufficient volume in the SDV to accommodate the water from a full scram.

Four channels of each type of Scram Discharge Volume Water Level—High Function, with two channels of each type in each trip system, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from these Functions on a valid signal. These Functions are required in MODES 1 and 2, and in MODE 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies, since these are the MODES and other specified conditions when control rods are withdrawn. At all other times, this Function may be bypassed.

8. Turbine Stop Valve—Closure

Closure of the TSVs results in the loss of a heat sink that produces reactor pressure, neutron flux, and heat flux transients that must be limited. Therefore, a reactor scram is initiated at the start of TSV closure in anticipation of the transients that would result from the closure of these valves. The Turbine Stop Valve—Closure is the primary scram signal for the turbine trip event analyzed in Reference 4. For this event, the reactor scram reduces the amount of energy required to be absorbed and, along with the actions of the End of Cycle Recirculation Pump Trip (EOC-RPT) System, ensures that the MCPR SL is not exceeded.

Turbine Stop Valve—Closure signals are initiated by valve stem position switches at each stop valve. One switch is associated with each stop valve, and each switch provides two contacts. One of the two contacts provides input to RPS trip system A; the other, to RPS trip system B. Thus, each

(continued)

---

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

8. Turbine Stop Valve—Closure (continued)

RPS trip system receives an input from four Turbine Stop Valve—Closure channels, each consisting of one valve stem position switch (which is common to a channel in the other RPS trip system) and a switch contact. The logic for the Turbine Stop Valve—Closure Function is such that three or more TSVs must be closed to produce a scram. In addition, certain combinations of two valves closed will result in a half scram.

This Function must be enabled at THERMAL POWER  $\geq$  30% RTP. This is normally accomplished automatically by pressure transmitters sensing turbine first stage pressure; therefore, opening the turbine bypass valves may affect this Function.

The Turbine Stop Valve—Closure, Allowable Value is selected to detect imminent TSV closure thereby reducing the severity of the subsequent pressure transient.

Eight channels of Turbine Stop Valve—Closure, with four channels in each trip system, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function if the TSVs should close. This Function is required, consistent with analysis assumptions, whenever THERMAL POWER is  $\geq$  30% RTP. This Function is not required when THERMAL POWER is  $<$  30% RTP since the Reactor Vessel Steam Dome Pressure—High and the Average Power Range Monitor Fixed Neutron Flux—Upscale Functions are adequate to maintain the necessary safety margins.

9. Turbine Control Valve Fast Closure, Trip Oil Pressure—Low

Fast closure of the TCVs results in the loss of a heat sink that produces reactor pressure, neutron flux, and heat flux transients that must be limited. Therefore, a reactor scram is initiated on TCV fast closure in anticipation of the transients that would result from the closure of these valves. The Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Function is the primary scram signal for the generator load rejection event analyzed in Reference 4. For this event, the reactor scram reduces the amount of energy required to be absorbed and, along with the actions of the EOC-RPT System, ensures that the MCPD SL is not exceeded.

(continued)

---

BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

9. Turbine Control Valve Fast Closure, Trip Oil  
Pressure—Low (continued)

Turbine Control Valve Fast Closure, Trip Oil Pressure—Low signals are initiated by the EHC fluid pressure at each control valve. There is one pressure switch associated with each control valve, the signal from each switch being assigned to a separate RPS logic channel. This Function must be enabled at THERMAL POWER  $\geq$  30% RTP. This is normally accomplished automatically by pressure transmitters sensing turbine first stage pressure; therefore, opening the turbine bypass valves may affect this Function.

The Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Allowable Value is selected high enough to detect imminent TCV fast closure.

Four channels of Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Function, with two channels in each trip system arranged in a one-out-of-two logic, are required to be OPERABLE to ensure that no single instrument failure will preclude a scram from this Function on a valid signal. This Function is required, consistent with the analysis assumptions, whenever THERMAL POWER is  $\geq$  30% RTP. This Function is not required when THERMAL POWER is  $<$  30% RTP since the Reactor Vessel Steam Dome Pressure—High and the Average Power Range Monitor Fixed Neutron Flux—Upscale Functions are adequate to maintain the necessary safety margins.

10. Reactor Mode Switch—Shutdown Position

The Reactor Mode Switch—Shutdown Position Function provides signals, via the manual scram logic channels, that are redundant to the automatic protective instrumentation channels and provide manual reactor trip capability. This Function was not specifically credited in the accident analysis, but it is retained for the overall redundancy and diversity of the RPS as required by the NRC approved licensing basis.

The reactor mode switch is a single switch with four channels (one from each of the four independent banks of contacts), each of which inputs into one of the RPS logic channels.

(continued)

---



BASES

---

APPLICABLE  
SAFETY ANALYSES,  
LCO, and  
APPLICABILITY

10. Reactor Mode Switch—Shutdown Position (continued)

There is no Allowable Value for this Function since the channels are mechanically actuated based solely on reactor mode switch position.

Four channels of Reactor Mode Switch—Shutdown Position Function, with two channels in each trip system, are available and required to be OPERABLE. The Reactor Mode Switch—Shutdown Position Function is required to be OPERABLE in MODES 1 and 2, and in MODE 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies, since these are the MODES and other specified conditions when control rods are withdrawn.

11. Manual Scram

The Manual Scram switch and push button channels provide signals, via the manual scram logic channels, to each of the four RPS logic channels that are redundant to the automatic protective instrumentation channels and provide manual reactor trip capability. This Function was not specifically credited in the accident analysis, but it is retained for the overall redundancy and diversity of the RPS as required by the NRC approved licensing basis.

There is one Manual Scram switch and push button (with two channels) for each of the four RPS logic channels. In order to cause a scram it is necessary that at least one switch and push button in each trip system be actuated.

There is no Allowable Value for this Function since the channels are mechanically actuated based solely on the position of the switch and push buttons.

Eight channels of Manual Scram with two switch and push buttons (two channels per switch and push button) in each trip system arranged in a one-out-of-two logic (i.e., both channels of a switch and push button must be actuated), are available and required to be OPERABLE in MODES 1 and 2, and in MODE 5 with any control rod withdrawn from a core cell containing one or more fuel assemblies, since these are the MODES and other specified conditions when control rods are withdrawn.

---

(continued)

BASES (continued)

---

ACTIONS

A Note has been provided to modify the ACTIONS related to RPS instrumentation channels. Section 1.3, Completion Times, specifies that once a Condition has been entered, subsequent divisions, subsystems, components, or variables expressed in the Condition, discovered to be inoperable or not within limits, will not result in separate entry into the Condition. Section 1.3 also specifies that Required Actions of the Condition continue to apply for each additional failure, with Completion Times based on initial entry into the Condition. However, the Required Actions for inoperable RPS instrumentation channels provide appropriate compensatory measures for separate, inoperable channels. As such, a Note has been provided that allows separate Condition entry for each inoperable RPS instrumentation channel.

A.1 and A.2

Because of the diversity of sensors available to provide trip signals and the redundancy of the RPS design, an allowable out of service time of 12 hours has been shown to be acceptable (Refs. 10 and 11) to permit restoration of any inoperable required channel to OPERABLE status. However, this out of service time is only acceptable provided the associated Function's inoperable channel is in one trip system (except for Functions 2.a, 2.b, 2.c, 2.d, and 2.e) and the Function still maintains RPS trip capability (refer to Required Actions B.1, B.2, and C.1 Bases.) If the inoperable channel cannot be restored to OPERABLE status within the allowable out of service time, the channel or the associated trip system must be placed in the tripped condition per Required Actions A.1 and A.2. Placing the inoperable channel in trip (or the associated trip system in trip) would conservatively compensate for the inoperability, restore capability to accommodate a single failure, and allow operation to continue. Alternately, if it is not desired to place the channel (or trip system) in trip (e.g., as in the case where placing the inoperable channel in trip would result in a scram or recirculation pump trip (RPT)), Condition D must be entered and its Required Action taken.

B.1 and B.2

Condition B exists when, for any one or more Functions, at least one required channel is inoperable in each trip

(continued)

---

BASES

---

ACTIONS

B.1 and B.2 (continued)

system. In this condition, provided at least one channel per trip system is OPERABLE, the RPS still maintains trip capability for that Function, but cannot accommodate a single failure in either trip system.

Required Actions B.1 and B.2 limit the time the RPS scram logic for any Function would not accommodate single failure in both trip systems (e.g., one-out-of-one and one-out-of-one arrangement for a typical four channel Function). The reduced reliability of this logic arrangement was not evaluated in References 10 and 11 for the 12 hour Completion Time, with the exception of Functions 2.a, 2.b, 2.c, 2.d, and 2.e, as described below. Within the 6 hour allowance, the associated Function will have all required channels either OPERABLE or in trip (or in any combination) in one trip system.

Completing one of these Required Actions restores RPS to an equivalent reliability level as that evaluated in References 10 and 11, which justified a 12 hour allowable out of service time as presented in Condition A. The trip system in the more degraded state should be placed in trip or, alternatively, all the inoperable channels in that trip system should be placed in trip (e.g., a trip system with two inoperable channels could be in a more degraded state than a trip system with four inoperable channels, if the two inoperable channels are in the same Function while the four inoperable channels are all in different Functions). The decision as to which trip system is in the more degraded state should be based on prudent judgment and current plant conditions (i.e., what MODE the plant is in). If this action would result in a scram or RPT, it is permissible to place the other trip system or its inoperable channels in trip.

The 6 hour Completion Time is judged acceptable based on the remaining capability to trip, the diversity of the sensors available to provide the trip signals, the low probability of extensive numbers of inoperabilities affecting all diverse Functions, and the low probability of an event requiring the initiation of a scram.

Alternately, if it is not desired to place the inoperable channels (or one trip system) in trip (e.g., as in the case where placing the inoperable channel or associated trip

(continued)

BASES

---

ACTIONS

B.1 and B.2 (continued)

system in trip would result in a scram or RPT), Condition D must be entered and its Required Action taken.

As noted, Condition B is not applicable for Functions 2.a, 2.b, 2.c, 2.d, and 2.e. Since an inoperable APRM affects both trip systems (one channel per logic channel in each trip system is inoperable when an APRM is inoperable), References 11 and 15 evaluated the loss of one APRM and its effects for these Functions, and determined that a 12 hour Completion Time was acceptable. Therefore, when one required APRM is inoperable (which impacts both trip systems) only ACTION A is required to be entered.

C.1

Required Action C.1 is intended to ensure that appropriate actions are taken if multiple, inoperable, untripped channels within the same trip system for the same Function result in the Function not maintaining RPS trip capability. A Function is considered to be maintaining RPS trip capability when sufficient channels are OPERABLE or in trip (or the associated trip system is in trip), such that both trip systems will generate a trip signal from the given Function on a valid signal. For the typical Function with one-out-of-two taken twice logic and the IRM Functions, this would require both trip systems to have one channel OPERABLE or in trip (or the associated trip system in trip). For Functions 2.a, 2.b, 2.c, 2.d, and 2.e (APRM Neutron Flux—Upscale, Setdown, APRM Flow Biased Simulated Thermal Power—Upscale, APRM Fixed Neutron Flux—Upscale, APRM—Inop, and APRM OPRM—Upscale), this would require, for each Function, both trip systems to have two channels per logic channel, each OPERABLE or in trip (or the associated trip system in trip). For Function 5 (Main Steam Isolation Valve—Closure), this would require both trip systems to have each channel associated with the MSIVs in three MSLs (not necessarily the same MSLs for both trip systems), OPERABLE or in trip (or the associated trip system in trip). For Function 8 (Turbine Stop Valve—Closure), this would require both trip systems to have three channels, each OPERABLE or in trip (or the associated trip system in trip).

(continued)

BASES

---

ACTIONS

C.1 (continued)

The Completion Time is intended to allow the operator time to evaluate and repair any discovered inoperabilities. The 1 hour Completion Time is acceptable because it minimizes risk while allowing time for restoration or tripping of channels.

D.1

Required Action D.1 directs entry into the appropriate Condition referenced in Table 3.3.1.1-1. The applicable Condition specified in the Table is Function and MODE or other specified condition dependent and may change as the Required Action of a previous Condition is completed. Each time an inoperable channel has not met any Required Action of Condition A, B, or C, and the associated Completion Time has expired, Condition D will be entered for that channel and provides for transfer to the appropriate subsequent Condition.

E.1, G.1, and H.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, the plant must be placed in a MODE or other specified condition in which the LCO does not apply. The Completion Times are reasonable, based on operating experience, to reach the specified condition from full power conditions in an orderly manner and without challenging plant systems. In addition, the Completion Time of Required Action E.1 is consistent with the Completion Time provided in LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCP R)." |

F.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, an alternate method to detect and suppress thermal-hydraulic instability oscillations must be initiated within 12 hours. This is acceptable since suitable methods exist to properly monitor for and suppress thermal-hydraulic instability oscillations. |

(continued)

---

BASES

---

ACTIONS

F.1 (continued)

However, since these methods involve operator actions, the allowance to operate in this condition utilizing manual detect and suppress methods exists for only 120 days (i.e., the channel(s) must be restored within 120 days). If the channel(s) is not restored within 120 days, Condition G must be entered and its Required Actions taken.

I.1

If the channel(s) is not restored to OPERABLE status or placed in trip (or the associated trip system placed in trip) within the allowed Completion Time, the plant must be placed in a MODE or other specified condition in which the LCO does not apply. This is done by immediately initiating action to fully insert all insertable control rods in core cells containing one or more fuel assemblies. Control rods in core cells containing no fuel assemblies do not affect the reactivity of the core and are, therefore, not required to be inserted. Action must continue until all insertable control rods in core cells containing one or more fuel assemblies are fully inserted.

---

SURVEILLANCE  
REQUIREMENTS

As noted at the beginning of the SRs, the SRs for each RPS instrumentation Function are located in the SRs column of Table 3.3.1.1-1.

The Surveillances are modified by a Note to indicate that, when a channel is placed in an inoperable status solely for performance of required Surveillances, entry into associated Conditions and Required Actions may be delayed for up to 6 hours, provided the associated Function maintains RPS trip capability. Upon completion of the Surveillance, or expiration of the 6 hour allowance, the channel must be returned to OPERABLE status or the applicable Condition entered and Required Actions taken. This Note is based on the RPS reliability analysis (Ref. 10) assumption of the average time required to perform channel surveillance. That analysis demonstrated that the 6 hour testing allowance does not significantly reduce the probability that the RPS will trip when necessary.

(continued)

---

BASES

---

SURVEILLANCE  
REQUIREMENTS  
(continued)

SR 3.3.1.1.1 and SR 3.3.1.1.2

Performance of the CHANNEL CHECK once every 12 hours or every 24 hours, as applicable, ensures that a gross failure of instrumentation has not occurred. A CHANNEL CHECK is normally a comparison of the parameter indicated on one channel to a similar parameter on other channels. It is based on the assumption that instrument channels monitoring the same parameter should read approximately the same value. Significant deviations between the instrument channels could be an indication of excessive instrument drift on one of the channels or something even more serious. A CHANNEL CHECK will detect gross channel failure; thus, it is key to verifying the instrumentation continues to operate properly between each CHANNEL CALIBRATION.

Agreement criteria are determined by the plant staff based on a combination of the channel instrument uncertainties, including indication and readability. If a channel is outside the criteria, it may be an indication that the instrument has drifted outside its limit.

The Frequency is based upon operating experience that demonstrates channel failure is rare. The CHANNEL CHECK supplements less formal, but more frequent, checks of channels during normal operational use of the displays associated with the channels required by the LCO.

SR 3.3.1.1.3

To ensure that the APRMs are accurately indicating the true core average power, the APRMs are calibrated to the reactor power calculated from a heat balance. LCO 3.2.4, "Average Power Range Monitor (APRM) Gain and Setpoint," allows the APRMs to be reading greater than actual THERMAL POWER to compensate for localized power peaking. When this adjustment is made, the requirement for the APRMs to indicate within 2% RTP of calculated power is modified to require the APRMs to indicate within 2% RTP of calculated MFLPD. The Frequency of once per 7 days is based on minor changes in LPRM sensitivity, which could affect the APRM reading between performances of SR 3.3.1.1.7.

An allowance is provided that requires the SR to be performed only at  $\geq 25\%$  RTP because it is difficult to accurately maintain APRM indication of core THERMAL POWER

(continued)

---

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.3 (continued)

consistent with a heat balance when < 25% RTP. At low power levels, a high degree of accuracy is unnecessary because of the large inherent margin to thermal limits (MCPR, APLHGR, and LHGR). At  $\geq 25\%$  RTP, the Surveillance is required to have been satisfactorily performed within the last 7 days in accordance with SR 3.0.2. A Note is provided which allows an increase in THERMAL POWER above 25% if the 7 day Frequency is not met per SR 3.0.2. In this event, the SR must be performed within 12 hours after reaching or exceeding 25% RTP. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR.

SR 3.3.1.1.4

A CHANNEL FUNCTIONAL TEST is performed on each required channel to ensure that the channel will perform the intended function. Any setpoint adjustment shall be consistent with the assumptions of the current plant specific setpoint methodology.

As noted, for Functions 1.a and 1.b, SR 3.3.1.1.4 is not required to be performed when entering MODE 2 from MODE 1 since testing of the MODE 2 required IRM Functions cannot be performed in MODE 1 without utilizing jumpers, lifted leads, or movable links. This allows entry into MODE 2 if the 7 day Frequency is not met per SR 3.0.2. In this event, the SR must be performed within 12 hours after entering MODE 2 from MODE 1. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR.

A Frequency of 7 days provides an acceptable level of system average unavailability over the Frequency interval and is based on reliability analysis (Ref. 10). (The Manual Scram Function CHANNEL FUNCTIONAL TEST Frequency was credited in the analysis to extend many automatic scram Functions Frequencies.)

SR 3.3.1.1.5 and SR 3.3.1.1.6

These Surveillances are established to ensure that no gaps in neutron flux indication exist from subcritical to power

(continued)

---



BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.5 and SR 3.3.1.1.6 (continued)

operation for monitoring core reactivity status.

The overlap between SRMs and IRMs is required to be demonstrated to ensure that reactor power will not be increased into a region without adequate neutron flux indication. This is required prior to fully withdrawing SRMs since indication is being transitioned from the SRMs to the IRMs.

The overlap between IRMs and APRMs is of concern when reducing power into the IRM range. On power increases, the system design will prevent further increases (initiate a rod block) if adequate overlap is not maintained. Overlap between IRMs and APRMs exists when sufficient IRMs and APRMs concurrently have onscale readings such that the transition between MODE 1 and MODE 2 can be made without either APRM downscale rod block, or IRM upscale rod block. Overlap between SRMs and IRMs similarly exists when, prior to withdrawing the SRMs from the fully inserted position, IRMs are above mid-scale on range 1 before SRMs have reached the upscale rod block. The IRM/APRM and SRM/IRM overlaps are also acceptable if a 1/2 decade overlap exists.

As noted, SR 3.3.1.1.6 is only required to be met during entry into MODE 2 from MODE 1. That is, after the overlap requirement has been met and indication has transitioned to the IRMs, maintaining overlap is not required (APRMs may be reading downscale once in MODE 2).

If overlap for a group of channels is not demonstrated (e.g., IRM/APRM overlap), the reason for the failure of the Surveillance should be determined and the appropriate channel(s) declared inoperable. Only those appropriate channel(s) that are required in the current MODE or condition should be declared inoperable.

A Frequency of 7 days is reasonable based on engineering judgment and the reliability of the IRMs and APRMs.

SR 3.3.1.1.7

LPRM gain settings are determined from the local flux profiles measured by the Traversing Incore Probe (TIP) System. This establishes the relative local flux profile

(continued)

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.7 (continued)

for appropriate representative input to the APRM System. The 1000 effective full power hours (EFPH) Frequency is based on operating experience with LPRM sensitivity changes.

SR 3.3.1.1.8, SR 3.3.1.1.10, and SR 3.3.1.1.12

A CHANNEL FUNCTIONAL TEST is performed on each required channel to ensure that the channel will perform the intended function. Any setpoint adjustment shall be consistent with the assumptions of the current plant specific setpoint methodology. For Function 2.b, the CHANNEL FUNCTIONAL TEST also includes the flow input function, excluding the flow transmitters. Note 1 is provided for SR 3.3.1.1.10 that requires the APRM SR for Function 2.a to be performed within 12 hours of entering MODE 2 from MODE 1. Testing of the MODE 2 APRM Function cannot be performed in MODE 1 without utilizing jumpers, lifted leads, or movable links. This Note allows entry into MODE 2 from MODE 1 if the associated Frequency is not met per SR 3.0.2. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR. Note 2 is provided for SR 3.3.1.1.10 that allows the Function 2.e CHANNEL FUNCTIONAL TEST to consist of toggling the appropriate outputs of the APRM. This is acceptable since this will test all of the hardware required to produce the trip signal, but not directly re-test software-controlled logic. Also, the automatic self-test logic will automatically detect a hardware fault that results in a change to the software.

The 92 day Frequency of SR 3.3.1.1.8 is based on the reliability analysis of Reference 10. The 184 day Frequency of SR 3.3.1.1.10 is based on the reliability analysis of Reference 11. The 24 month Frequency of SR 3.3.1.1.12 is based on the need to perform this Surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the Surveillance were performed with the reactor at power. Operating experience has shown that these components usually pass the Surveillance when performed at the 24 month Frequency.

(continued)

---

BASES

---

SURVEILLANCE  
REQUIREMENTS  
(continued)

SR 3.3.1.1.9

The calibration of trip units provides a check of the actual trip setpoints. The channel must be declared inoperable if the trip setting is discovered to be less conservative than the Allowable Value specified in Table 3.3.1.1-1. If the trip setting is discovered to be less conservative than accounted for in the appropriate setpoint methodology, but is not beyond the Allowable Value, the channel performance is still within the requirements of the plant safety analysis. Under these conditions, the setpoint must be readjusted to be equal to or more conservative than accounted for in the appropriate setpoint methodology.

The Frequency of 92 days for SR 3.3.1.1.9 is based on the reliability analysis of Reference 10.

SR 3.3.1.1.11 and SR 3.3.1.1.13

A CHANNEL CALIBRATION is a complete check of the instrument loop and the sensor. This test verifies the channel responds to the measured parameter within the necessary range and accuracy. CHANNEL CALIBRATION leaves the channel adjusted to account for instrument drifts between successive calibrations consistent with the plant specific setpoint methodology. For Function 2.b, the CHANNEL CALIBRATION also includes the flow input function.

Note 1 to SR 3.3.1.1.13 states that neutron detectors are excluded from CHANNEL CALIBRATION because of the difficulty of simulating a meaningful signal. Changes in neutron detector sensitivity are compensated for by performing the 7 day calorimetric calibration (SR 3.3.1.1.3) and the 1000 EFPH LPRM calibration against the TIPs (SR 3.3.1.1.7). Note 2 to SR 3.3.1.1.13 requires the APRM and IRM SRs for Functions 1.a and 2.a to be performed within 12 hours of entering MODE 2 from MODE 1. Testing of the MODE 2 APRM and IRM Functions cannot be performed in MODE 1 without utilizing jumpers, lifted leads, or movable links. This Note allows entry into MODE 2 from MODE 1 if the associated Frequency is not met per SR 3.0.2. Twelve hours is based on operating experience and in consideration of providing a reasonable time in which to complete the SR. Note 3 is provided for SR 3.3.1.1.13 that allows the Function 2.e CHANNEL CALIBRATION to consist of a verification of OPRM—Upscale setpoints in the APRM by the review of the

(continued)

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.11 and SR 3.3.1.1.13 (continued)

"Show Parameters" display. This is acceptable because, other than the flow and LPRM input processing, all OPRM functional processing is performed digitally involving equipment or components that cannot be calibrated. The Frequency of SR 3.3.1.1.11 is based upon the assumption of a 18 month calibration interval in the determination of the magnitude of equipment drift in the setpoint analysis. The Frequency of SR 3.3.1.1.13 is based on the assumption of a 24 month calibration interval in the determination of the magnitude of equipment drift in the setpoint analysis.

SR 3.3.1.1.14

The LOGIC SYSTEM FUNCTIONAL TEST (LSFT) demonstrates the OPERABILITY of the required trip logic for a specific channel. The functional testing of control rods, in LCO 3.1.3, "Control Rod OPERABILITY," and SDV vent and drain valves, in LCO 3.1.8, "Scram Discharge Volume (SDV) Vent and Drain Valves," overlaps this Surveillance to provide complete testing of the assumed safety function. In addition, for Function 2.f, the LSFT includes simulating APRM trip conditions at the APRM channel inputs to the 2-Out-Of-4 Voter channel to check all combinations of two tripped APRM channel inputs to the 2-Out-Of-4 Voter logic in the 2-Out-Of-4 Voter channels.

The 24 month Frequency is based on the need to perform this Surveillance under the conditions that apply during a plant outage and the potential for an unplanned transient if the Surveillance were performed with the reactor at power. Operating experience has shown that these components usually pass the Surveillance when performed at the 24 month Frequency.

SR 3.3.1.1.15

This SR ensures that scrams initiated from the Turbine Stop Valve—Closure and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions will not be inadvertently bypassed when THERMAL POWER is  $\geq 30\%$  RTP. This involves calibration of the bypass channels. Adequate margins for the instrument setpoint methodology are incorporated into the Allowable Value and the actual setpoint. Because main

(continued)

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.15 (continued)

turbine bypass flow can affect this setpoint nonconservatively (THERMAL POWER is derived from turbine first stage pressure, where a first stage pressure of 136.4 psig is equivalent to 30% RTP), the main turbine bypass valves must remain closed during an in-service calibration at THERMAL POWER  $\geq$  30% RTP to ensure that the calibration is valid.

If any bypass channel setpoint is nonconservative (i.e., the Functions are bypassed at  $\geq$  30% RTP, either due to open main turbine bypass valve(s) or other reasons), then the affected Turbine Stop Valve—Closure and Turbine Control Valve Fast Closure, Trip Oil Pressure—Low Functions are considered inoperable. Alternatively, the bypass channel can be placed in the conservative condition (nonbypass). If placed in the nonbypass condition, this SR is met and the channel is considered OPERABLE.

The Frequency of 24 months is based on engineering judgment and reliability of the components.

SR 3.3.1.1.16

This SR ensures that scrams initiated from the APRM OPRM—Upscale Function will not be inadvertently bypassed when THERMAL POWER is  $\geq$  30% RTP and recirculation drive flow is  $<$  60% rated recirculation drive flow.

If any bypass channel setpoint is nonconservative (i.e., the Function is bypassed at  $\geq$  30% RTP and  $<$  60% rated recirculation drive flow), then the affected channel is considered inoperable.

The Frequency of 24 months is based on Ref. 15.

SR 3.3.1.1.17

This SR ensures that the individual channel response times are less than or equal to the maximum values assumed in the accident analysis. The RPS RESPONSE TIME acceptance criteria are included in Reference 12.

(continued)

---

BASES

---

SURVEILLANCE  
REQUIREMENTS

SR 3.3.1.1.17 (continued)

As noted (Note 1), the Function 2.f digital electronics are excluded. This is allowed since self-testing and calibration checks the time base of the digital electronics (confirmation of the time base is adequate to assure required response times are met). In addition, Note 2 states the response time of the sensors for Functions 3 and 4 may be assumed to be the design sensor response time and therefore, are excluded from the RPS RESPONSE TIME testing. This is allowed since the sensor response time is a small part of the overall RPS RESPONSE TIME (Ref. 13). Note 4 modifies the starting point of the RPS RESPONSE TIME test for Function 9, since this starting point (start of turbine control valve fast closure) corresponds with the safety analysis assumptions.

RPS RESPONSE TIME tests are conducted on a 24 month STAGGERED TEST BASIS. Note 3 requires STAGGERED TEST BASIS Frequency to be determined based on 4 channels per trip system, in lieu of the 8 channels specified in Table 3.3.1.1-1 for the MSIV Closure Function. This Frequency is based on the logic interrelationships of the various channels required to produce an RPS scram signal. Therefore, staggered testing results in response time verification of these devices every 24 months. The 24 month Frequency is consistent with the typical industry refueling cycle and is based upon plant operating experience, which shows that random failures of instrumentation components causing serious time degradation, but not channel failure, are infrequent.

---

REFERENCES

1. USAR, Section 7.2.
2. USAR, Section 5.2.2 and Appendix A Section A.5.2.2.
3. USAR, Section 6.3.3.
4. USAR, Chapter 15 and Appendix A.
5. 10 CFR 50.36(c)(2)(ii).
6. USAR, Section 15.4.1.
7. NEDO-23842, "Continuous Control Rod Withdrawal in the Startup Range," April 18, 1978.

(continued)

BASES

---

REFERENCES  
(continued)

8. USAR, Section 15.4.9.
  9. Letter, P. Check (NRC) to G. Lainas (NRC), "BWR Scram Discharge System Safety Evaluation," December 1, 1980.
  10. NEDO-30851-P-A, "Technical Specification Improvement Analyses for BWR Reactor Protection System," March 1988.
  11. NEDC-32410-P-A, "Nuclear Measurement Analysis and Control Power Range Neutron Monitor (NUMAC-PRNM) Retrofit Plus Option III Stability Trip Function," October 1995.
  12. Technical Requirements Manual.
  13. NEDO-32291-A, "System Analyses for the Elimination of Selected Response Time Testing Requirements," October 1995.
  14. USAR, Section 7.6.1.4.3.
  15. NEDC-32410-P-A, "NUMAC-PRNM Retrofit Plus Option III Stability Trip Functions, Supplement 1," November 1997.
-

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.1 Recirculation Loops Operating

LCO 3.4.1 Two recirculation loops with matched flows shall be in operation,

OR

One recirculation loop shall be in operation with the following limits applied when the associated LCO is applicable:

- a. LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)," single loop operation limits specified in the COLR;
- b. LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)," single loop operation limits specified in the COLR;
- c. LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation," Function 2.b (Average Power Range Monitors Flow Biased Simulated Thermal Power—Upscale), Allowable Value of Table 3.3.1.1-1 is reset for single loop operation; and
- d. LCO 3.3.2.1, "Control Rod Block Instrumentation," Function 1.a (Rod Block Monitor—Upscale), Allowable Value of Table 3.3.2.1-1 is reset for single loop operation.

APPLICABILITY: MODES 1 and 2.



ACTIONS

CONDITION	REQUIRED ACTION	COMPLETION TIME
A. No recirculation loops in operation.	A.1 Be in MODE 2.	6 hours
	<u>AND</u> A.2 Be in MODE 3.	12 hours
B. Recirculation loop flow mismatch not within limits.	B.1 Declare the recirculation loop with lower flow to be "not in operation."	2 hours
C. Requirements of the LCO not met for reasons other than Conditions A and B.	C.1 Satisfy the requirements of the LCO.	4 hours
D. Required Action and associated Completion Time of Condition C not met.	D.1 Be in MODE 3.	12 hours

**SURVEILLANCE REQUIREMENTS**

SURVEILLANCE	FREQUENCY
<p>SR 3.4.1.1 -----NOTE-----            Not required to be performed until 24 hours after both recirculation loops are in operation.            -----</p> <p>Verify jet pump loop flow mismatch with both recirculation loops in operation is:</p> <ul style="list-style-type: none"> <li>a. <math>\leq 10\%</math> of rated core flow when operating at an effective core flow <math>&lt; 70\%</math> of rated core flow; and</li> <li>b. <math>\leq 5\%</math> of rated core flow when operating at an effective core flow <math>\geq 70\%</math> of rated core flow.</li> </ul>	<p>24 hours</p>

BASES

---

BACKGROUND  
(continued)

The subcooled water enters the bottom of the fuel channels and contacts the fuel cladding, where heat is transferred to the coolant. As it rises, the coolant begins to boil, creating steam voids within the fuel channel that continue until the coolant exits the core. Because of reduced moderation, the steam voiding introduces negative reactivity that must be compensated for to maintain or to increase reactor power. The recirculation flow control allows operators to increase recirculation flow and sweep some of the voids from the fuel channel, overcoming the negative reactivity void effect. Thus, the reason for having variable recirculation flow is to compensate for reactivity effects of boiling over a wide range of power generation (i.e., 55 to 100% RTP) without having to move control rods and disturb desirable flux patterns.

Each recirculation loop is manually started from the control room. The recirculation flow control valves provide regulation of individual recirculation loop drive flows. The flow in each loop can be manually or automatically controlled.

---

APPLICABLE  
SAFETY ANALYSES

The operation of the Reactor Recirculation System is an initial condition assumed in the design basis loss of coolant accident (LOCA) (Ref. 1). During a LOCA caused by a recirculation loop pipe break, the intact loop is assumed to provide coolant flow during the first few seconds of the accident. The initial core flow decrease is rapid because the recirculation pump in the broken loop ceases to pump reactor coolant to the vessel almost immediately. The pump in the intact loop coasts down relatively slowly. This pump coastdown governs the core flow response for the next several seconds until the jet pump suction is uncovered (Ref. 2). The analyses assume that both loops are operating at the same flow prior to the accident. However, the LOCA analysis was reviewed for the case with a flow mismatch between the two loops, with the pipe break assumed to be in the loop with the higher flow. While the flow coastdown and core response are potentially more severe in this assumed case (since the intact loop starts at a lower flow rate and the core response is the same as if both loops were operating at a lower flow rate), a small mismatch has been determined to be acceptable based on engineering judgement.

(continued)

---

BASES

---

APPLICABLE  
SAFETY ANALYSES  
(continued)

The recirculation system is also assumed to have sufficient flow coastdown characteristics to maintain fuel thermal margins during abnormal operational transients (Ref. 3), which are analyzed in Chapter 15 of the USAR.

A plant specific LOCA analysis has been performed assuming only one operating recirculation loop. This analysis has demonstrated that, in the event of a LOCA caused by a pipe break in the operating recirculation loop, the Emergency Core Cooling System response will provide adequate core cooling, provided the APLHGR requirements are modified accordingly (Ref. 4).

The transient analyses in Chapter 15 of the USAR have also been performed for single recirculation loop operation (Ref. 4) and demonstrate sufficient flow coastdown characteristics to maintain fuel thermal margins during the abnormal operational transients analyzed provided the MCPR requirements are modified. During single recirculation loop operation, modification to the Reactor Protection System average power range monitor (APRM) and the Rod Block Monitor Allowable Values is also required to account for the different relationships between recirculation drive flow and reactor core flow. The APLHGR and MCPR limits for single loop operation are specified in the COLR. The APRM Flow Biased Simulated Thermal Power—Upscale Allowable Value is in LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation." The Rod Block Monitor—Upscale Allowable Value is in LCO 3.3.2.1, "Control Rod Block Instrumentation."

Recirculation loops operating satisfies Criterion 2 of Reference 5.

---

LCO

Two recirculation loops are normally required to be in operation with their flows matched within the limits specified in SR 3.4.1.1 to ensure that during a LOCA caused by a break of the piping of one recirculation loop the assumptions of the LOCA analysis are satisfied. Alternatively, with only one recirculation loop in operation, modifications to the required APLHGR limits (LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)"), MCPR limits (LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)"), APRM Flow Biased Simulated Thermal Power—Upscale Allowable Value (LCO 3.3.1.1), and the Rod

(continued)

---

BASES

---

LCO  
(continued)      Block Monitor—Upscale Allowable Value (LCO 3.3.2.1) must be applied to allow continued operation consistent with the assumptions of Reference 4.

---

APPLICABILITY      In MODES 1 and 2, requirements for operation of the Reactor Coolant Recirculation System are necessary since there is considerable energy in the reactor core and the limiting design basis transients and accidents are assumed to occur.

In MODES 3, 4, and 5, the consequences of an accident are reduced and the coastdown characteristics of the recirculation loops are not important.

---

ACTIONS            A.1 and A.2

With no recirculation loops in operation, the unit is required to be brought to a MODE in which the LCO does not apply. To achieve this status, the plant must be brought to MODE 2 within 6 hours and to MODE 3 within 12 hours. In this condition, the recirculation loops are not required to be operating because of the reduced severity of DBAs and transients and minimal dependence on the recirculation loop coastdown characteristics. The allowed Completion Times are reasonable, based on operating experience, to reach the required plant conditions from full power conditions in an orderly manner and without challenging plant systems.

B.1 and C.1

With both recirculation loops operating but the flows not matched, the flows must be matched within 2 hours. If matched flows are not restored, the recirculation loop with lower flow must be declared "not in operation," as required by Required Action B.1. This Required Action does not require tripping the recirculation pump in the lowest flow loop when the mismatch between total jet pump flows of the two loops is greater than the required limits. However, in cases where large flow mismatches occur, low flow or reverse flow can occur in the low flow loop jet pumps, causing vibration of the jet pumps. If zero or reverse flow is detected, the condition should be alleviated by changing flow control valve position to re-establish forward flow or by tripping the pump.

(continued)

---

BASES

---

ACTIONS

B.1 and C.1 (continued)

With the requirements of the LCO not met for reasons other than Condition A and B (e.g. one loop is "not in operation"), the recirculation loops must be restored to operation with matched flows within 4 hours. A recirculation loop is considered not in operation when the pump in that loop is idle or when the mismatch between total jet pump flows of the two loops is greater than required limits for greater than 2 hours (i.e. Required Action B.1 has been taken). Should a LOCA occur with one recirculation loop not in operation, the core flow coastdown and resultant core response may not be bounded by the LOCA analyses. Therefore, only a limited time is allowed to restore the inoperable loop to operating status.

Alternatively, if the single loop requirements of the LCO are applied to the APLHGR and MCPR operating limits and RPS and RBM Allowable Values, operation with only one recirculation loop would satisfy the requirements of the LCO and the initial conditions of the accident sequence.

The 2 hour and 4 hour Completion Times are based on the low probability of an accident occurring during this time period, on a reasonable time to complete the Required Action, and on frequent core monitoring by operators allowing abrupt changes in core flow conditions to be quickly detected.

D.1

If the Required Action and associated Completion Time of Condition C is not met, the unit is required to be brought to a MODE in which the LCO does not apply. To achieve this status, the plant must be brought to MODE 3 within 12 hours. In this condition, the recirculation loops are not required to be operating because of the reduced severity of DBAs and minimal dependence on the recirculation loop coastdown characteristics. The allowed Completion Time of 12 hours is reasonable, based on operating experience, to reach MODE 3 from full power conditions in an orderly manner and without challenging plant systems.

---

(continued)

BASES (continued)

---

SURVEILLANCE  
REQUIREMENTS

SR 3.4.1.1

This SR ensures the recirculation loop flows are within the allowable limits for mismatch. At low core flow (i.e., effective core flow < 70% of rated core flow), the APLHGR and MCPR requirements provide larger margins to the fuel cladding integrity Safety Limit such that the potential adverse effect of early boiling transition during a LOCA is reduced. A larger flow mismatch can therefore be allowed when effective core flow is < 70% of rated core flow. The jet pump loop flow, as used in this Surveillance, is the summation of the flows from all of the jet pumps associated with a single recirculation loop. The effective core flow shall be calculated by assuming both loops are at the smaller value of the two jet pump loop flows.

The mismatch is measured in terms of percent of rated core flow. If the flow mismatch exceeds the specified limits, the loop with the lower flow is considered not in operation. This SR is not required when both loops are not in operation since the mismatch limits are meaningless during single loop or natural circulation operation. The Surveillance must be performed within 24 hours after both loops are in operation. The 24 hour Frequency is consistent with the Frequency for jet pump OPERABILITY verification and has been shown by operating experience to be adequate to detect off normal jet pump loop flows in a timely manner.

---

REFERENCES

1. USAR, Section 6.3 and Appendix A Section 6.
  2. USAR, Section 6.3.3.7.
  3. USAR, Section 5.4.1.3.
  4. USAR Chapter 15B.
  5. 10 CFR 50.36(c)(2)(ii).
-

5.6 Reporting Requirements

---

5.6.5 CORE OPERATING LIMITS REPORT (COLR) (continued)

1. The APLHGR for Specification 3.2.1.
  2. The MCPR for Specification 3.2.2.
  3. The LHGR for Specification 3.2.3.
  4. Reactor Protection System Instrumentation Setpoint for the OPRM—Upscale Function Allowable Value for Specification 3.3.1.1.
  5. Control Rod Block Instrumentation Setpoint for the Rod Block Monitor—Upscale Function Allowable Value for Specification 3.3.2.1.
- b. The analytical methods used to determine the core operating limits shall be those previously reviewed and approved by the NRC, specifically those described in the following documents:
1. NEDE-24011-P-A-US, "General Electric Standard Application for Reactor Fuel," U.S. Supplement, (NRC approved version specified in the COLR).
  2. NEDE-23785-1-PA, "The GESTR-LOCA and SAFER Models for the Evaluation of the Loss-of-Coolant Accident, Volume III, SAFER/GESTR Application Methodology," (NRC approved version specified in the COLR).
  3. NEDO-32465-A, "Reactor Stability Detect and Suppress Solutions Licensing Basis Methodology for Reload Applications," August 1996.
- c. The core operating limits shall be determined such that all applicable limits (e.g., fuel thermal mechanical limits, core thermal hydraulic limits, Emergency Core Cooling Systems (ECCS) limits, nuclear limits such as SDM, transient analysis limits, and accident analysis limits) of the safety analysis are met.
- d. The COLR, including any midcycle revisions or supplements, shall be provided upon issuance for each reload cycle to the NRC.

(continued)

---



5.6 Reporting Requirements (continued)

---

5.6.6 Post Accident Monitoring (PAM) Instrumentation Report

When a report is required by Condition B or F of LCO 3.3.3.1, "Post Accident Monitoring (PAM) Instrumentation," a report shall be submitted within the following 14 days. The report shall outline the preplanned alternate method of monitoring, the cause of the inoperability, and the plans and schedule for restoring the instrumentation channels of the Function to OPERABLE status.

---

---