


- LEGEND:**
- HOSE STATION
  - GATE VALVE
  - GLOBE VALVE (N.C.)
  - CHECK VALVE
  - SPRAY NOZZLE
  - ANGLE VALVE WITH HOSE ADAPTER
  - REDUCER
  - UNION

- REFERENCES:**
- SX-15976 SH.1 FILTER HOUSE ASSEMBLY
  - SX-16103 PIPING ASSEMBLY SPRAYING SYSTEM SUPPLY
  - H-11906 SH.2 FIRE PROTECTION-CHARCOAL FILTERS-RADWASTE ADDITION EL.185'-0"
  - H-11906 SH.3 FIRE PROTECTION-PIPING DETAILS FROM H-11906 SH.1
  - H-11906 SH.1 FIRE PROTECTION-PIPING-CHARCOAL FILTER-REACTOR BLDG EL. 158'-0" & EL. 164'-0"-RADWASTE BLDG EL.144'-4"
  - D-11901 FIRE PROTECTION AND DETECTION SYSTEMS
  - H-11034 P&ID-REACTOR & RADWASTE BLDGS
  - H-11155 PIPING SECTIONS A-A,B-B,C-C,D-D IN REACTOR & RADWASTE BLDGS
  - H-11924 P&ID-HVAC ROOM

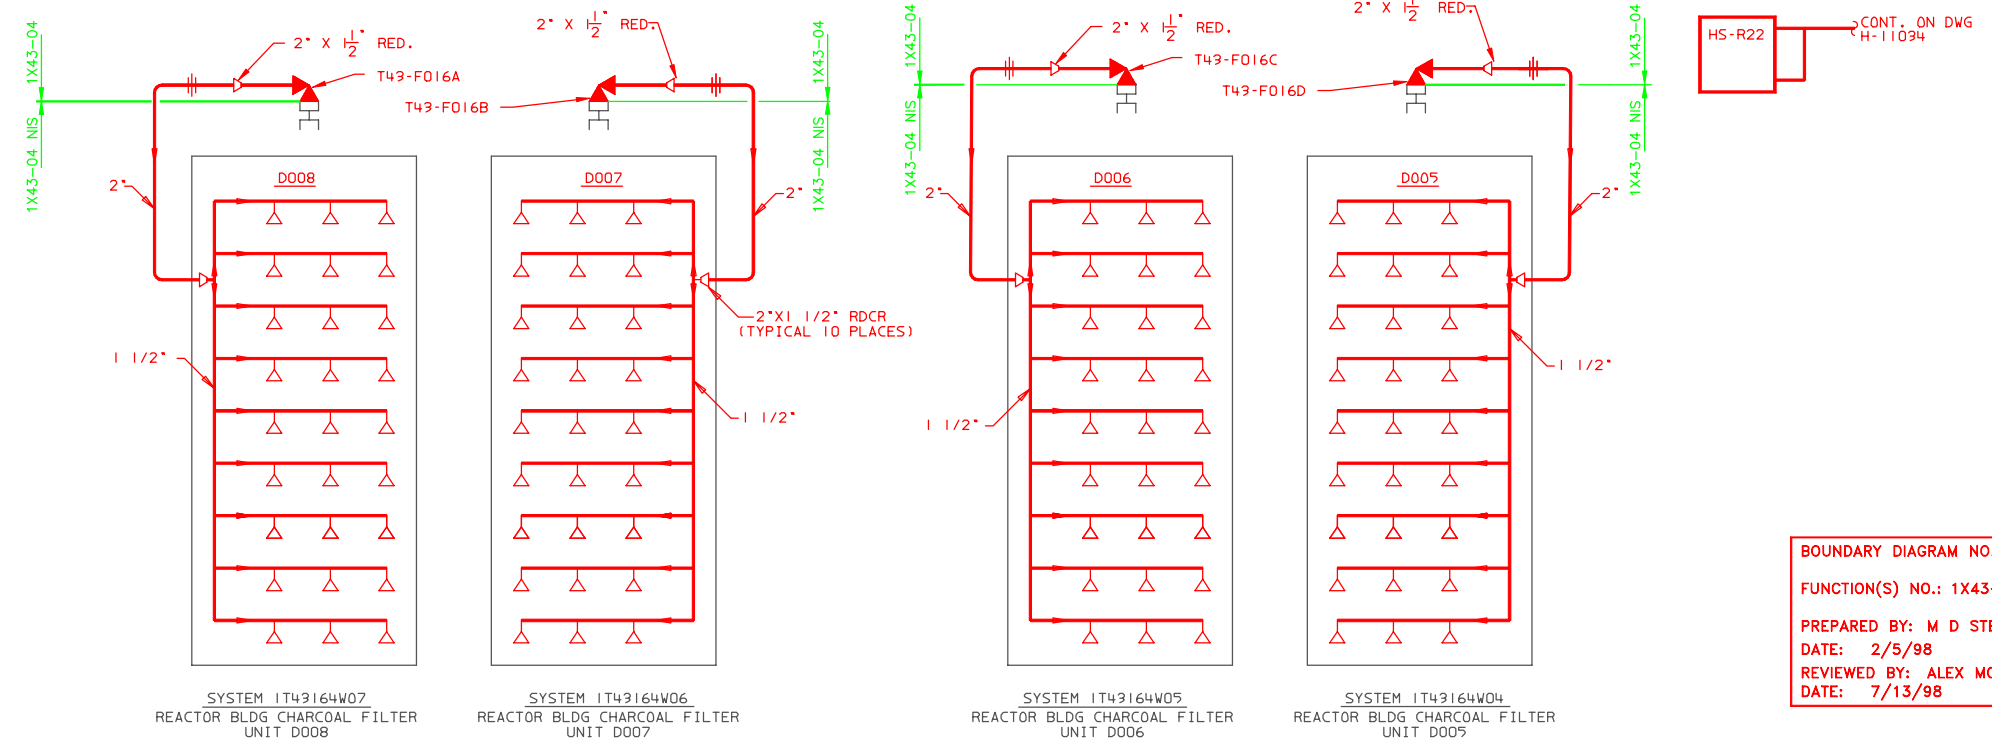

**BOUNDARY DIAGRAM NO.: 1X43-B01-19**  
**FUNCTION(S) NO.: 1X43-04**  
**PREPARED BY: M D STEPHENS**  
**DATE: 2/5/98**  
**REVIEWED BY: ALEX MORRISON**  
**DATE: 7/13/98**

**LICENSE RENEWAL DOCUMENT**

Revision: A Date: 11-19-99  
 APPROVED, ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.8, REV.9; BY TRM.

T43, V43 ACAD14 HL1130408

**SOUTHERN COMPANY**

**LICENSE RENEWAL SCREENING FOR INFORMATION ONLY**

EDWIN I. HATCH NUCLEAR PLANT  
 UNIT 1 FIRE PROT-P&ID-REAC & RADW BLDGS CHARCOAL FLTRS

DATE	BY	SCALE	LOCATION	DOCUMENT NUMBER	REVISION
	TRM	LCF			
	TRM	None	10-502	HL-11304	A

SH. 8 OF 10