


A
B
C
D
E
F
G
H
J

1 2 3 4 5 6 7 8 9 10 11 12 13

- LEGEND:
- DRIP FUNNEL
 - FLOW DIRECTION
 - CAP
 - PLUG
 - GLOBE VALVE (N.C.)
 - PRESSURE SWITCH
 - PRESSURE INDICATOR
 - MONITOR SWITCH
 - ALARM VALVE
 - INDICATING LIGHT
 - GATE VALVE (N.O.)
 - SIDE OUTLET GLOBE VALVE
 - ANGLE VALVE (N.C.)
 - 3-WAY MULTIPORT VALVE
 - CHECK VALVE
 - RESTRICTION CHECK VALVE
 - ADDRESSABLE INTERFACE MODULE
 - RETARD CHAMBER
 - SPRINKLER HEAD
 - UNION

- NOTES:
- ALL MPL NO.S ON THIS DWG ARE PRECEDED BY X43.
- REFERENCES:
- B-11942 FIRE PROT FCD-1X43130W13
 - H-40279 FIRE PROT PUMPHOUSE SPRINKLER SYS. 1FH-73
 - D-11091 FIRE PROTECTION & DETECTION SYS

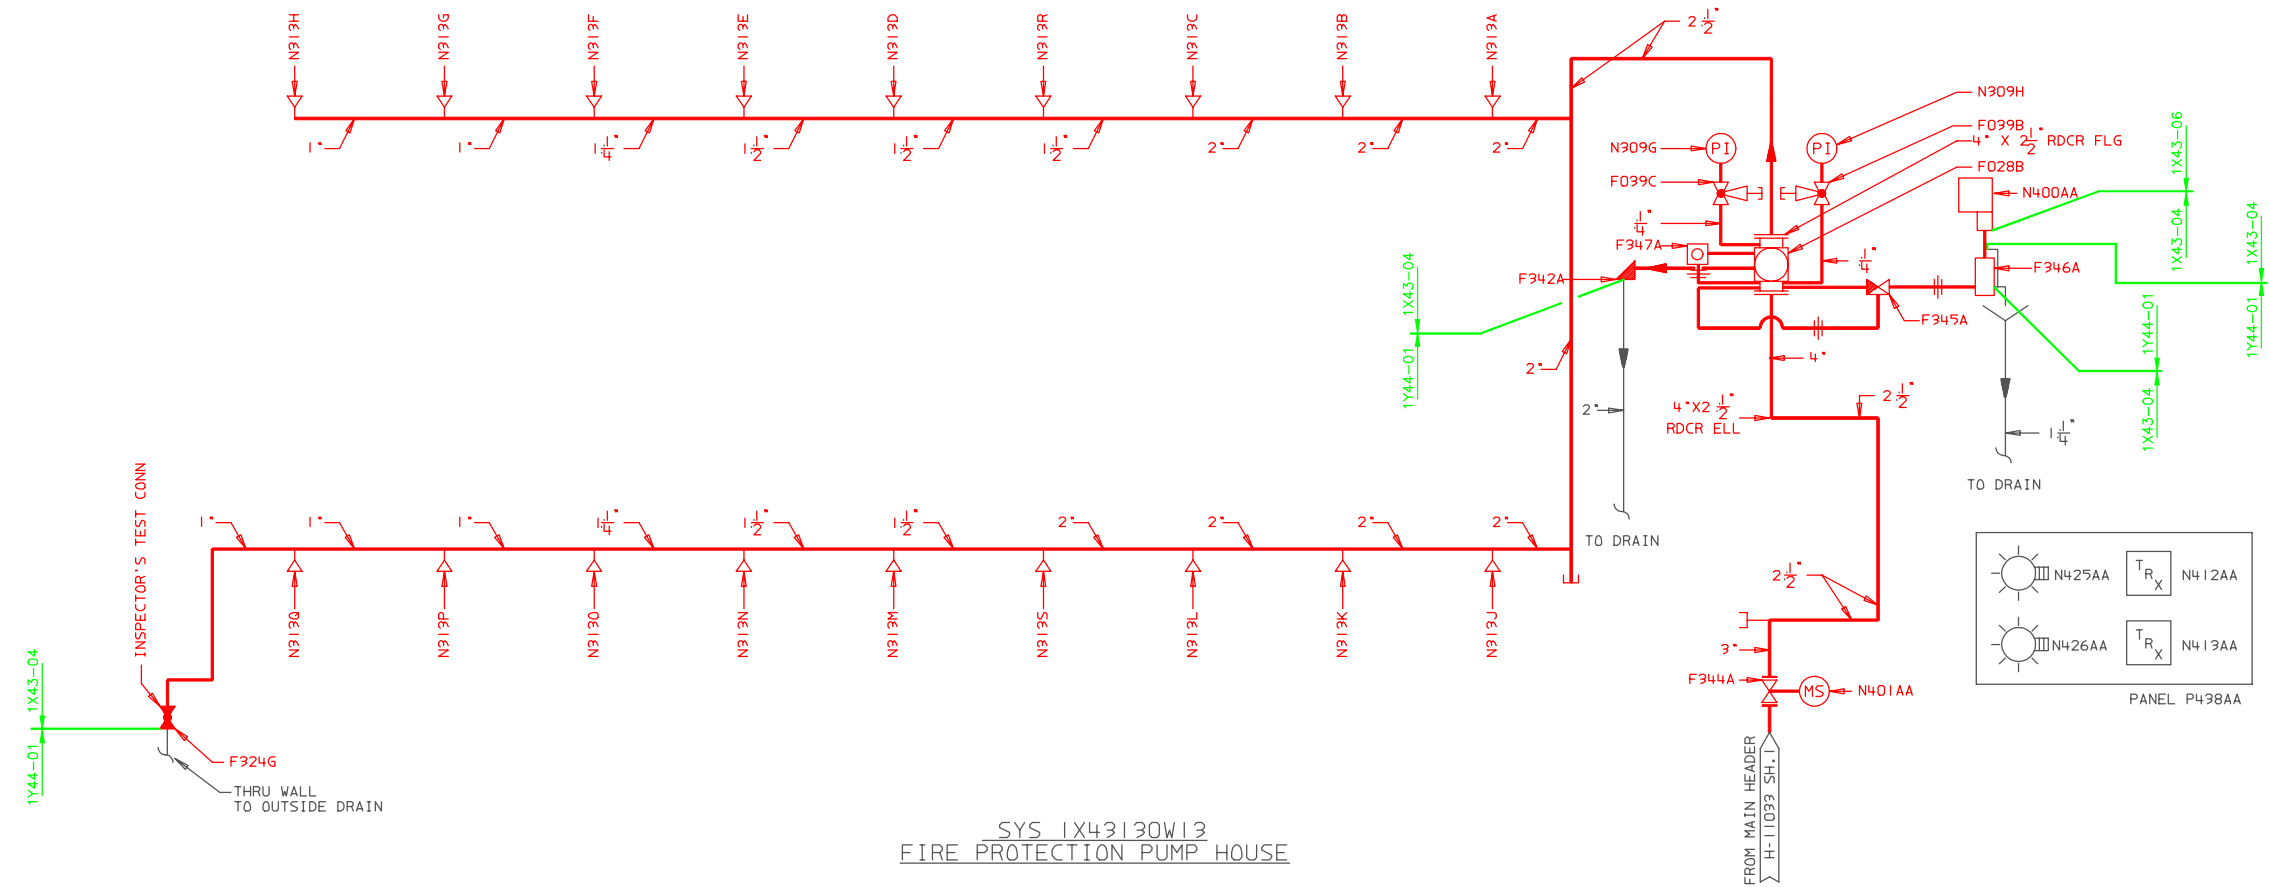

BOUNDARY DIAGRAM NO.: 1X43-B01-04
 FUNCTION(S) NO.: 1X43-04
 1X43-06
 PREPARED BY: M D STEPHENS
 DATE: 2/5/98
 REVIEWED BY: ALEX MORRISON
 DATE: 7/13/98

LICENSE RENEWAL DOCUMENT
 MPL NO. X43 ACAD14 HL1130410

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1
 FIRE PROTECTION P&ID
 SPRINKLER SYS. 1FH-73
 FP PUMPHOUSE

BY	CHK'D	APPR'D	DATE	LOCATION	DOCUMENT NUMBER	REVISION
TRM	LCF					
TRM	MDS	ASK		10-502	HL-11304	A
					SH. 10 OF 10	

Revision: A Date: 12-23-99
 APPROVED, ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11304 SH.10, REV.6; BY TRM.