

- LEGEND:**
- EA-1 SPRAY NOZZLE, 175° TEMP. AND 160' PITCH
 - PRESSURE INDICATOR
 - PRESSURE SWITCH
 - MONITOR SWITCH
 - MULTIMATIC VALVE (PRE ACTION)
 - GATE VALVE (N.O.)
 - GLOBE VALVE (NC)
 - ANGLE VALVE (NC)
 - CHECK VALVE
 - FLOW DIRECTION
 - STRAINER
 - UNION
 - CAPPED OR PLUGGED END
 - REDUCER
 - BALL VALVE (NC)
 - BREAK GLASS STATION
 - BALL VALVE (NO)
 - SOLENOID VALVE
 - GLOBE VALVE (NO)
 - ALARM BELL
 - HORN
 - SIDE OUTLET GLOBE VALVE
 - PRESSURE REGULATOR
 - PRESSURE RELIEF VALVE
 - DRAIN FUNNEL
 - INDICATING LIGHTS
 - RESTRICTIVE ORIFICE
 - EA-1 SPRAY NOZZLE, 175° TEMP. AND 160' PITCH, WITH BAFFLE.
 - INSTRUMENT TEST CONNECTION
 - BALL DRIP VALVE
 - 1/2" AIR LINE
 - ADDRESSABLE INTERFACE MODULE

- REFERENCES:**
- S50071 - FIRE PROT SPY/SPK PLAN CABLE SPREADING ROOM-SUPERSEDES SX-14516
 - S50072 - FIRE PROT SPY/SPR SYS-DETS & NOTES-CABLE SPREADING ROOM-SUPERSEDES SX-14517
 - S50073 - FIRE PROT SPY/SPR SYS-AB ISO-CABLE SPREADING ROOM UNIT 1-SUPERSEDES SX-14535
 - S50082 - FIRE PROT SPY/SPR SYS-AB ISO-CABLE SPREADING RM UNIT 2-SUPERSEDES SX-14536
 - S50170 - FIRE PROT SPY/SPR SYS-8"
 - S50171 - FIRE PROT SPY SYS-4"
 - S50257 - F.P. SPRAY/SPR SYS-AS BUILT HGR DETAILS-CA SPRDNG ROOM UNIT-1
 - S50258 - F.P. SPRAY/SPR SYS-CABLE SPREADING ROOM UNIT 2 HANGERS
 - S50259 - F.P. SPRAY/SPR SYS-8" SUPPLY TO CABLE SPREADING ROOM #1 & 2
 - S50260 - F.P. SPRAY/SPR SYS-8" SUPPLY TO CABLE SPREADING ROOM #1 & 2
 - H-11035 - F.P. P&ID - TURBINE & CONTROL BUILDINGS
 - SX-14522 - INSTRUCTIONS - FIRE PROTECTION SPRINKLER SYSTEMS
 - D-11031 - FIRE PROTECTION & DETECTION SYSTEMS
 - B-24702 - FIRE PROTECTION FCD, 2243147W03
- NOTES:**
- ALL MPL NO'S ON THIS DWG PRECEDED BY Z43 UNLESS OTHERWISE NOTED.

LICENSE RENEWAL DOCUMENT

MPL NO. Z43 ACAD14 HL11323




LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT
UNITS 1 & 2 FIRE PROTECTION
PIPING-P & ID CABLE SPREADING ROOM

Revision: A Date: 11-19-99
APPROVED, ISSUED PER LICENSE
RENEWAL BOUNDARY PACKAGES.
DRAWING CREATED FROM
H-11323, REV.12; BY TRM.

DATE	BY	CHKD.	APPR.	LOCATION	DOCUMENT NUMBER	REVISION
	TRM					
	MDS					
	ASK					

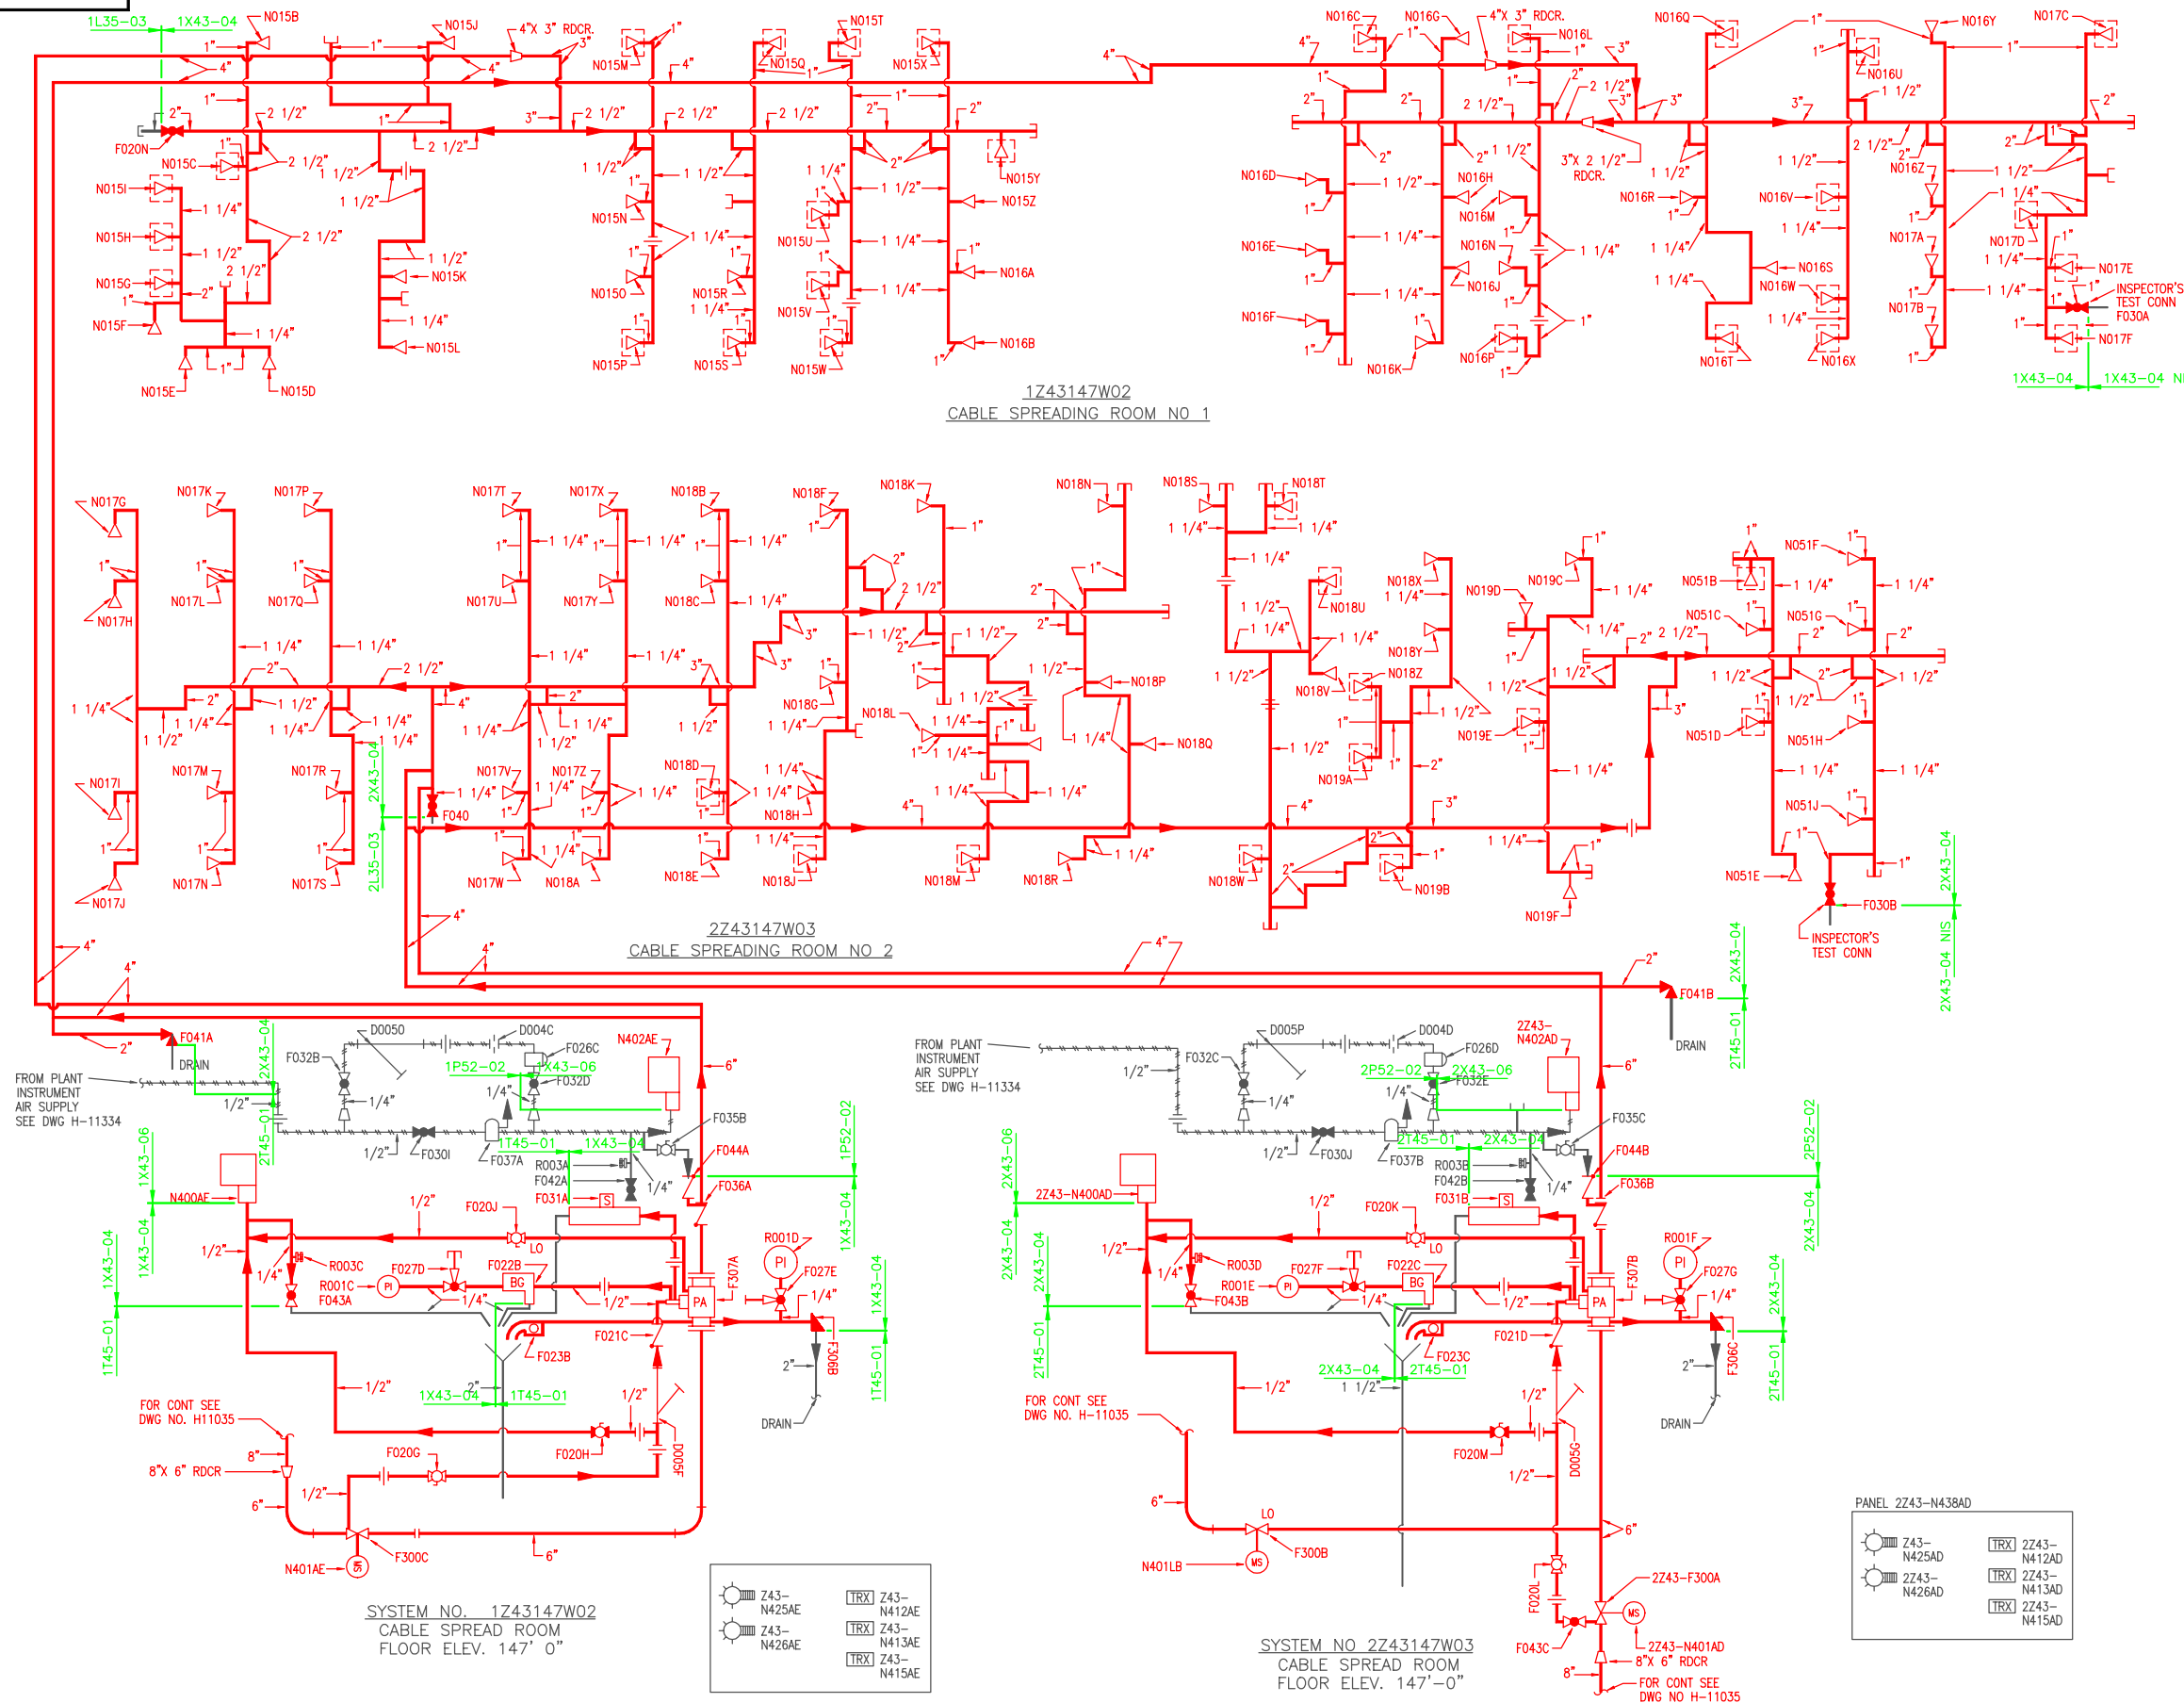

BOUNDARY DIAGRAM NO.:	FUNCTION(S) NO.:	PREPARED BY:	DATE:	REVIEWED BY:	DATE:
1X43-B01-13	1X43-04 1X43-06	M D STEPHENS	2/5/98	ALEX MORRISON	7/13/98
2X43-B01-25	2X43-04 2X43-06	M D STEPHENS	2/6/98	ALEX MORRISON	7/13/98
1X43-B06-04	1X43-06	M D STEPHENS	3/19/98	ALEX MORRISON	7/15/98
2X43-B06-01	2X43-06	M D STEPHENS	3/19/98	ALEX MORRISON	7/15/98

