HL-11881

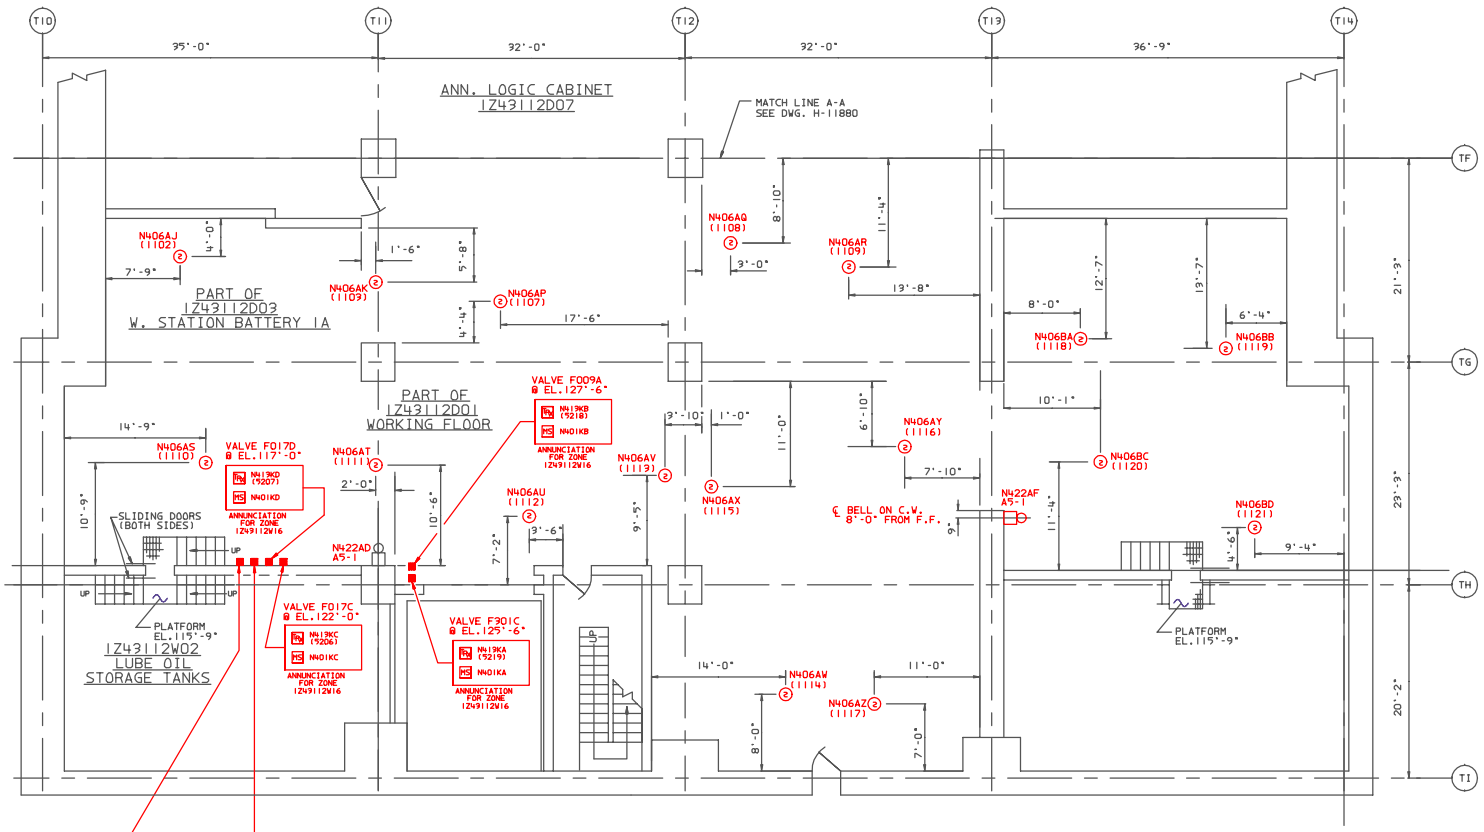





KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1Z49.
2. UNIT 1 BELLS SHOWN. UNIT 2 BELLS MOUNTED ADJACENT. SEE DWG H-11814 FOR UNIT 2 DEVICES.
3. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866.
4. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11812.

REFERENCES:

H-11904	FIRE PROTECTION P&ID SHEETS 1 & 6 OF 10
H-11812	FIRE HAZARDS ANALYSIS.
H-12626	ARCH. TURB. & CONTROL BLDG. GENERAL PLAN EL.112'-0"
H-12627	ARCH. TURB. & CONTROL BLDG. DETAILED FLOOR PLAN EL.112'-0"
S-51109	REV A FIRE PROTECTION MULTIPLEX SYSTEM O & M MANUAL
S-51110	MULTIPLEX RTU MOUNTING DETAILS
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

BOUNDARY DIAGRAM NO.:1X43-B06-33

FUNCTION(S) NO.: 1X43-06

PREPARED BY: M. D. STEPHENS
DATE: 07-14-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

Revision: A	Date: 12-28-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11881, REV.1: BY ECB	

BY	CHK'D	APPR'D
ECB	MDS	ASK

ACAD14 | HL11881

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 1&2
EQUIPMENT LAYOUT DRAWINGS.
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 1Z43 CONTROL BLDG. EL. 112'-0"

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11881	A
DATE	SCALE 3/16"=1'-0"			