


KEY PLAN

- NOTES:
1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 1X43.
  2. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866
  3. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG H-11848.

- REFERENCES:
- H-13009 CONDUIT GROUNDING & LIGHTING FIRE PROT. PUMP HOUSE
  - H-11848 FIRE HAZARDS ANALYSIS
  - S-51109 REV. A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL
  - S-51110 MULTIPLEX RTU MOUNTING DETAILS
  - S-51111 MULTIPLEX RTU INTERNAL WIRING DIAGRAMS

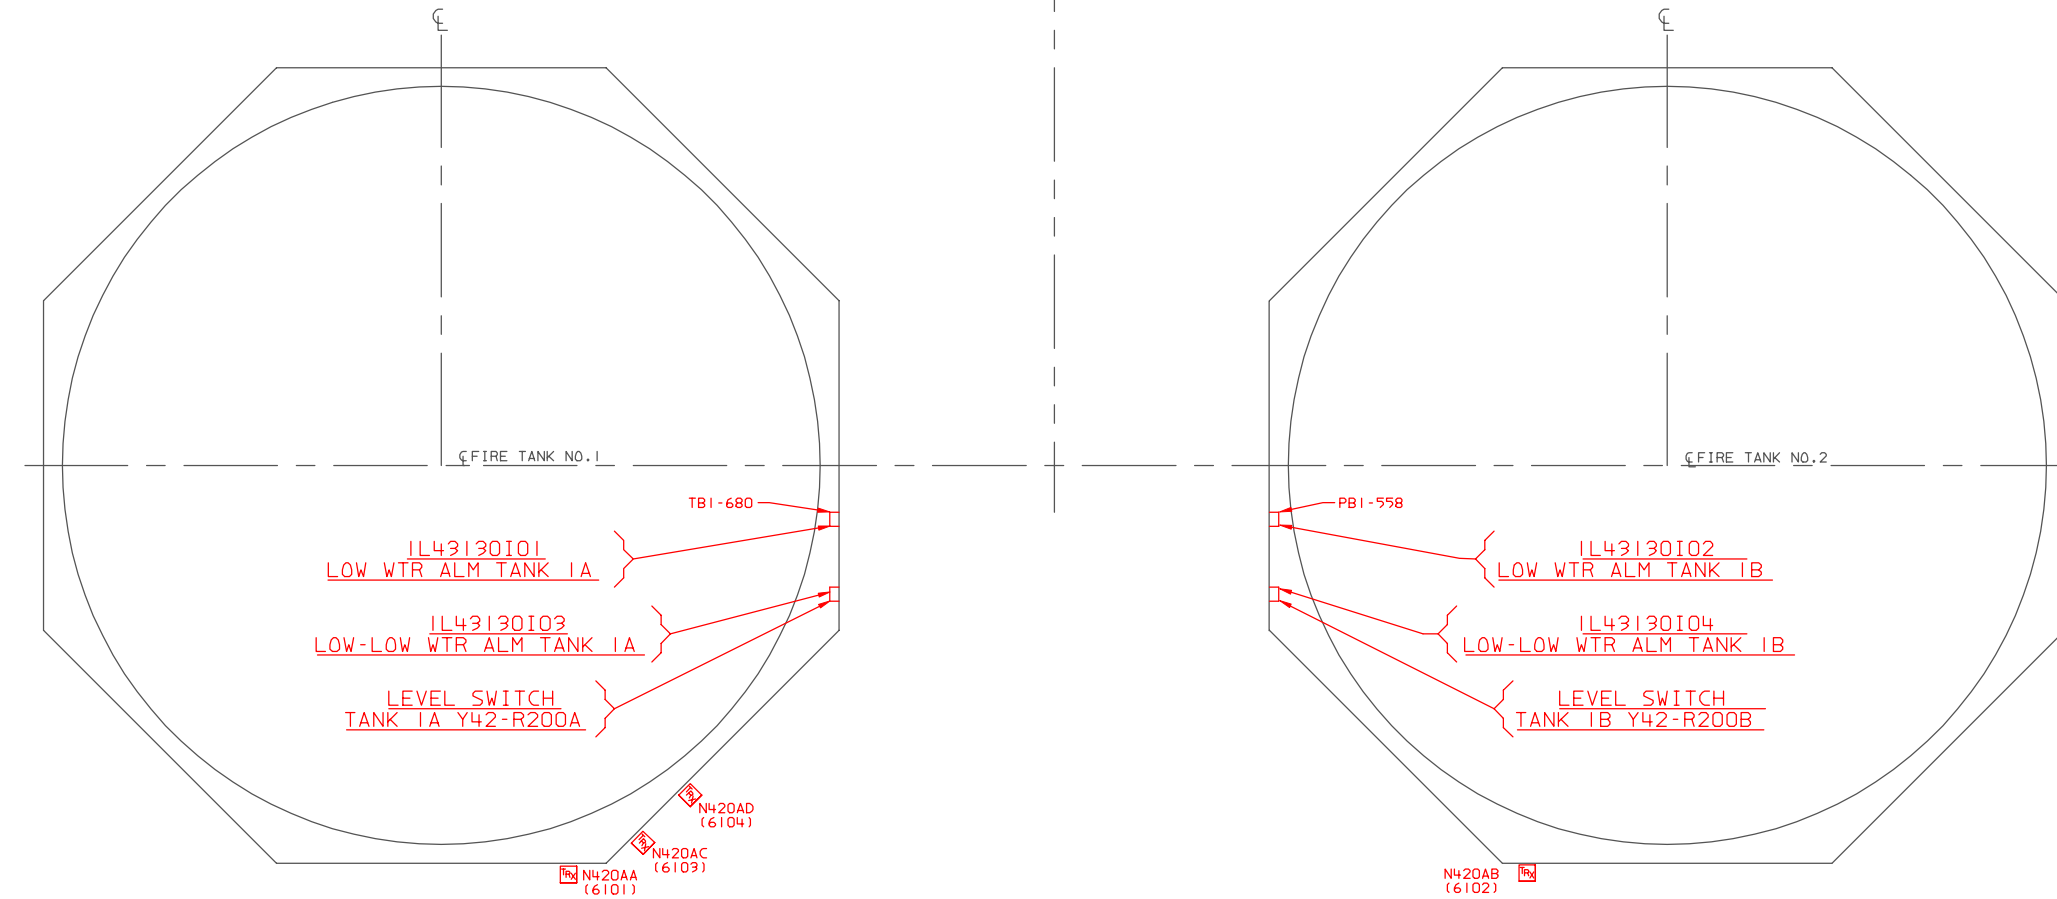

BOUNDARY DIAGRAM NO.: 1X43-B06-6  
 FUNCTION(S) NO.: 1X43-06  
 PREPARED BY: M. D. STEPHENS  
 DATE: 03-19-98  
 REVIEWED BY: ALEX MORRISON  
 DATE: 07-15-98

FIRE PROTECTION PUMP HOUSE FLOOR PLAN AT EL. 128'-5"

LICENSE RENEWAL DOCUMENT

Revision: A		Date: 12-22-99	
APPROVED, ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11896, REV. 2; BY ECB			
DRWN	DESIGN	LOCATION	DOCUMENT NUMBER
ECB	LCF		10-502
DATE	SCALE		HL-11896
	1/4"=1'-0"		A

ACAD14 HL11896

**SOUTHERN COMPANY**

**LICENSE RENEWAL SCREENING FOR INFORMATION ONLY**

EDWIN I. HATCH NUCLEAR PLANT UNIT No.1  
 EQUIPMENT LAYOUT DRAWINGS  
 FIRE DETECTION/SUPPRESSION MULTIPLEX SYS. 1X43 OUT BUILDINGS