HL-11920

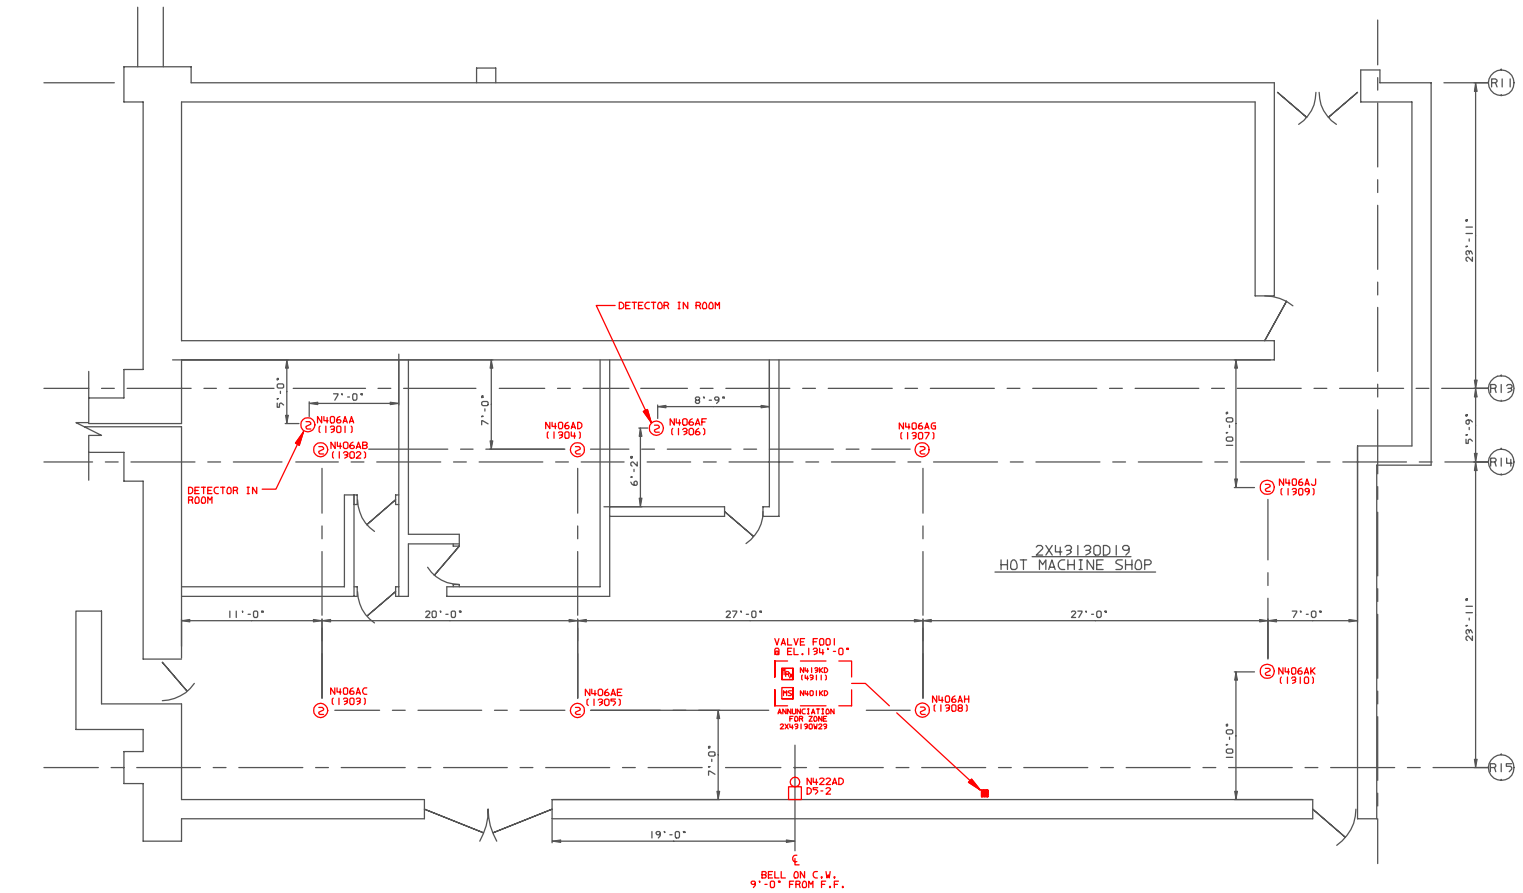



KEY PLAN

NOTES:

1. UNLESS OTHERWISE NOTED, ALL MPL NUMBERS SHALL BE PREFIXED BY 2X49.
2. FOR GENERAL NOTES AND LEGEND SEE DWG. H-11866.
9. FOR HOSE STATION AND EXTINGUISHER LOCATIONS, SEE FHA DWG. H-11852.

REFERENCES:

H-11852	FIRE HAZARDS ANALYSIS.
H-27406	HOT MACHINE SHOP CONDUIT PLAN
S-51109	REV.A FIRE PROTECTION MULTIPLEX SYSTEM O&M MANUAL.
S-51110	MULTIPLEX RTU MOUNTING DETAILS.
S-51111	MULTIPLEX RTU INTERNAL WIRING DIAGRAMS.

BOUNDARY DIAGRAM NO.:2X43-B06-17

FUNCTION(S) NO.: 2X43-06

PREPARED BY: M. D. STEPHENS
DATE: 03-19-98
REVIEWED BY: ALEX MORRISON
DATE: 07-15-98

LICENSE RENEWAL DOCUMENT

ACAD | HL11920

SOUTHERN COMPANY

LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2
EQUIPMENT LAYOUT DRAWINGS.
FIRE DETECTION/SUPPRESSION MULTIPLEX
SYS. 2X43 HOT MACHINE SHOP

Revision: A	Date: 12-22-99
APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-11920, REV. 1; BY ECB	

BY	DWN	APPR
ECB	MDS	ASK

DRAWN	DESIGNED	LOCATION	DOCUMENT NUMBER	REVISION
ECB	LCF	10-502	HL-11920	A
DATE	SCALE 1/4"=1'-0"			