


**REFERENCES:**  
 H-23350 MASTER SINGLE LINE DIAGRAM  
 H-23351 SINGLE LINE DIAGRAM-GENERATOR AND STATION SERVICE  
 H-23124 4160V STA. SERV. CABLE BUSES PROPOSED ARRANGEMENT - DETAILS

**NOTES:**  
 1 MPL NO. FOR RELAY 27-1 ASSIGNED 2S32-K772-1.  
 MPL NO. FOR RELAY 27-2 ASSIGNED 2S32-K772-2.  
 2. REFER TO THE MASTER FUSE LIST FOR FUSE DESIGN INFORMATION.

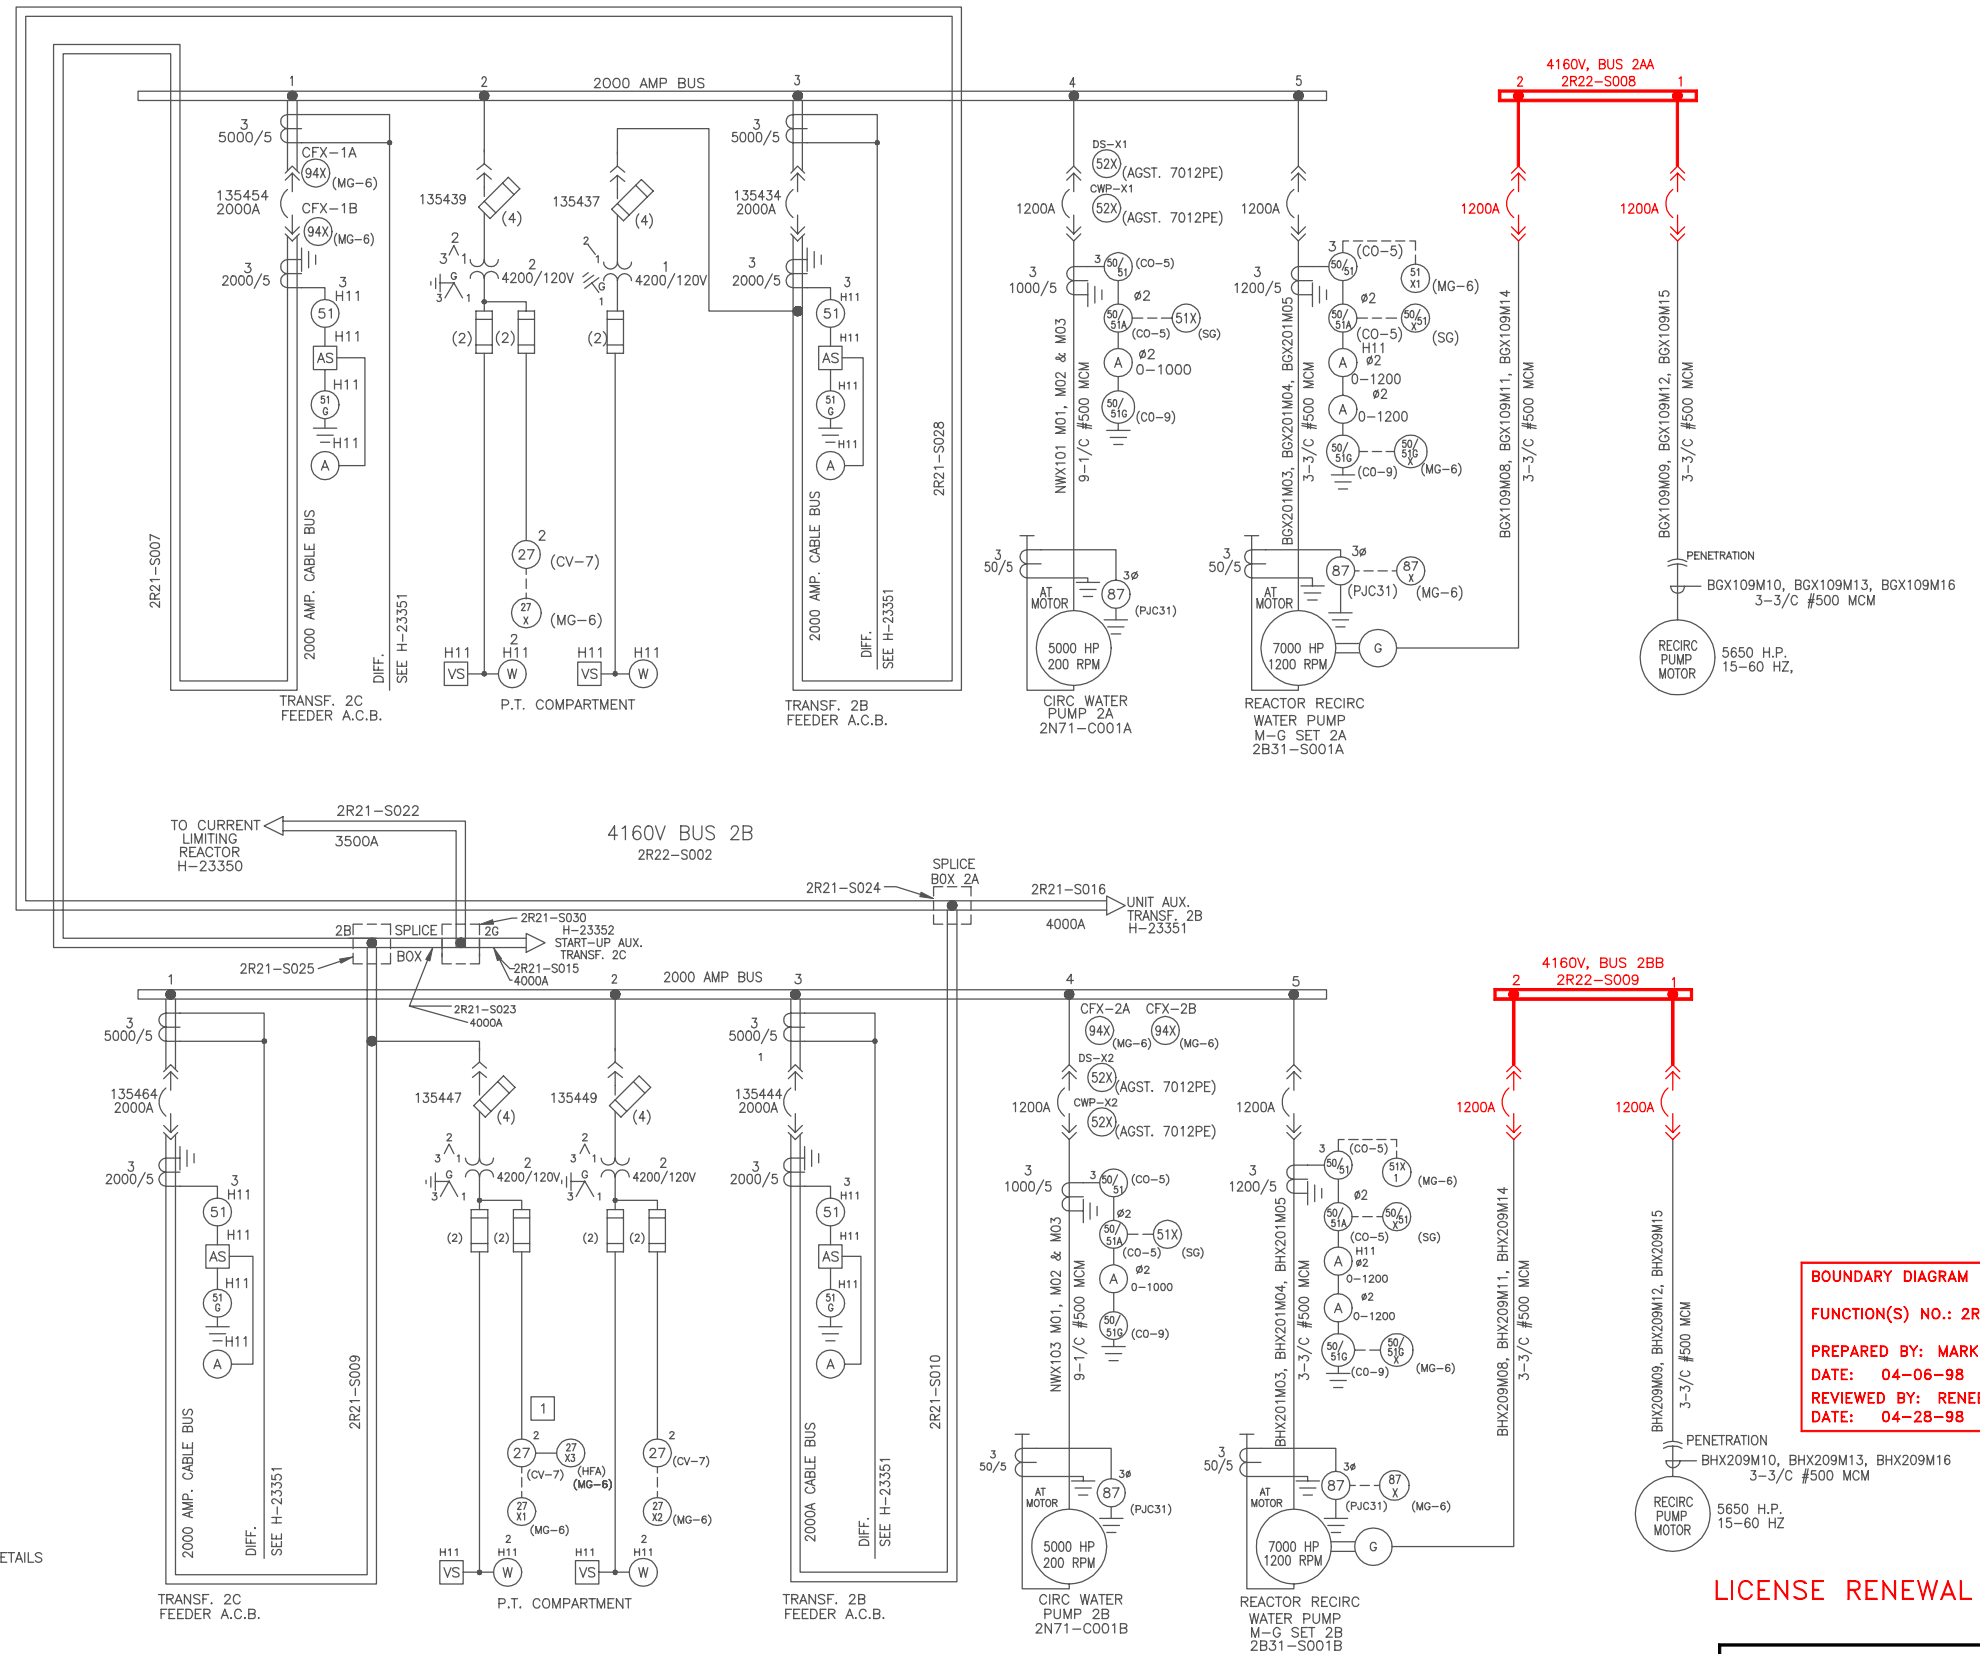

**BOUNDARY DIAGRAM NO.: 2R20-B01-02**  
**FUNCTION(S) NO.: 2R20-01**  
**PREPARED BY: MARK CRISLER**  
**DATE: 04-06-98**  
**REVIEWED BY: RENEE RITCHEY**  
**DATE: 04-28-98**

LICENSE RENEWAL DOCUMENT

ACAD14 HL23355



LICENSE RENEWAL SCREENING FOR INFORMATION ONLY

EDWIN I. HATCH NUCLEAR PLANT UNIT No. 2  
SINGLE LINE DIAGRAM  
4160V BUS 2A & 2B

Revision: A Date: 12-30-99  
 APPROVED. ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H23355, REV. 13; BY ECB

DATE	BY	CHKD.	APPV.	LOCATION	DOCUMENT NUMBER	REVISION
	ECB	LCF		10-502	HL-23355	A
	RBR	ASK				