


A  
B  
C  
D  
E  
F  
G  
H  
J

1 2 3 4 5 6 7 8 9 10 11 12 13

- LEGEND:
- PRESSURE SWITCH
  - PRESSURE INDICATOR
  - SOLENOID VALVE
  - PHOTOELECTRIC SMOKE DETECTOR
  - HALON NOZZLE
  - ADDRESSABLE INTERFACE MODULE
  - SELECTOR SWITCH
  - ALARM BELL
  - MANUAL HALON RELEASE
  - HALON BOTTLE

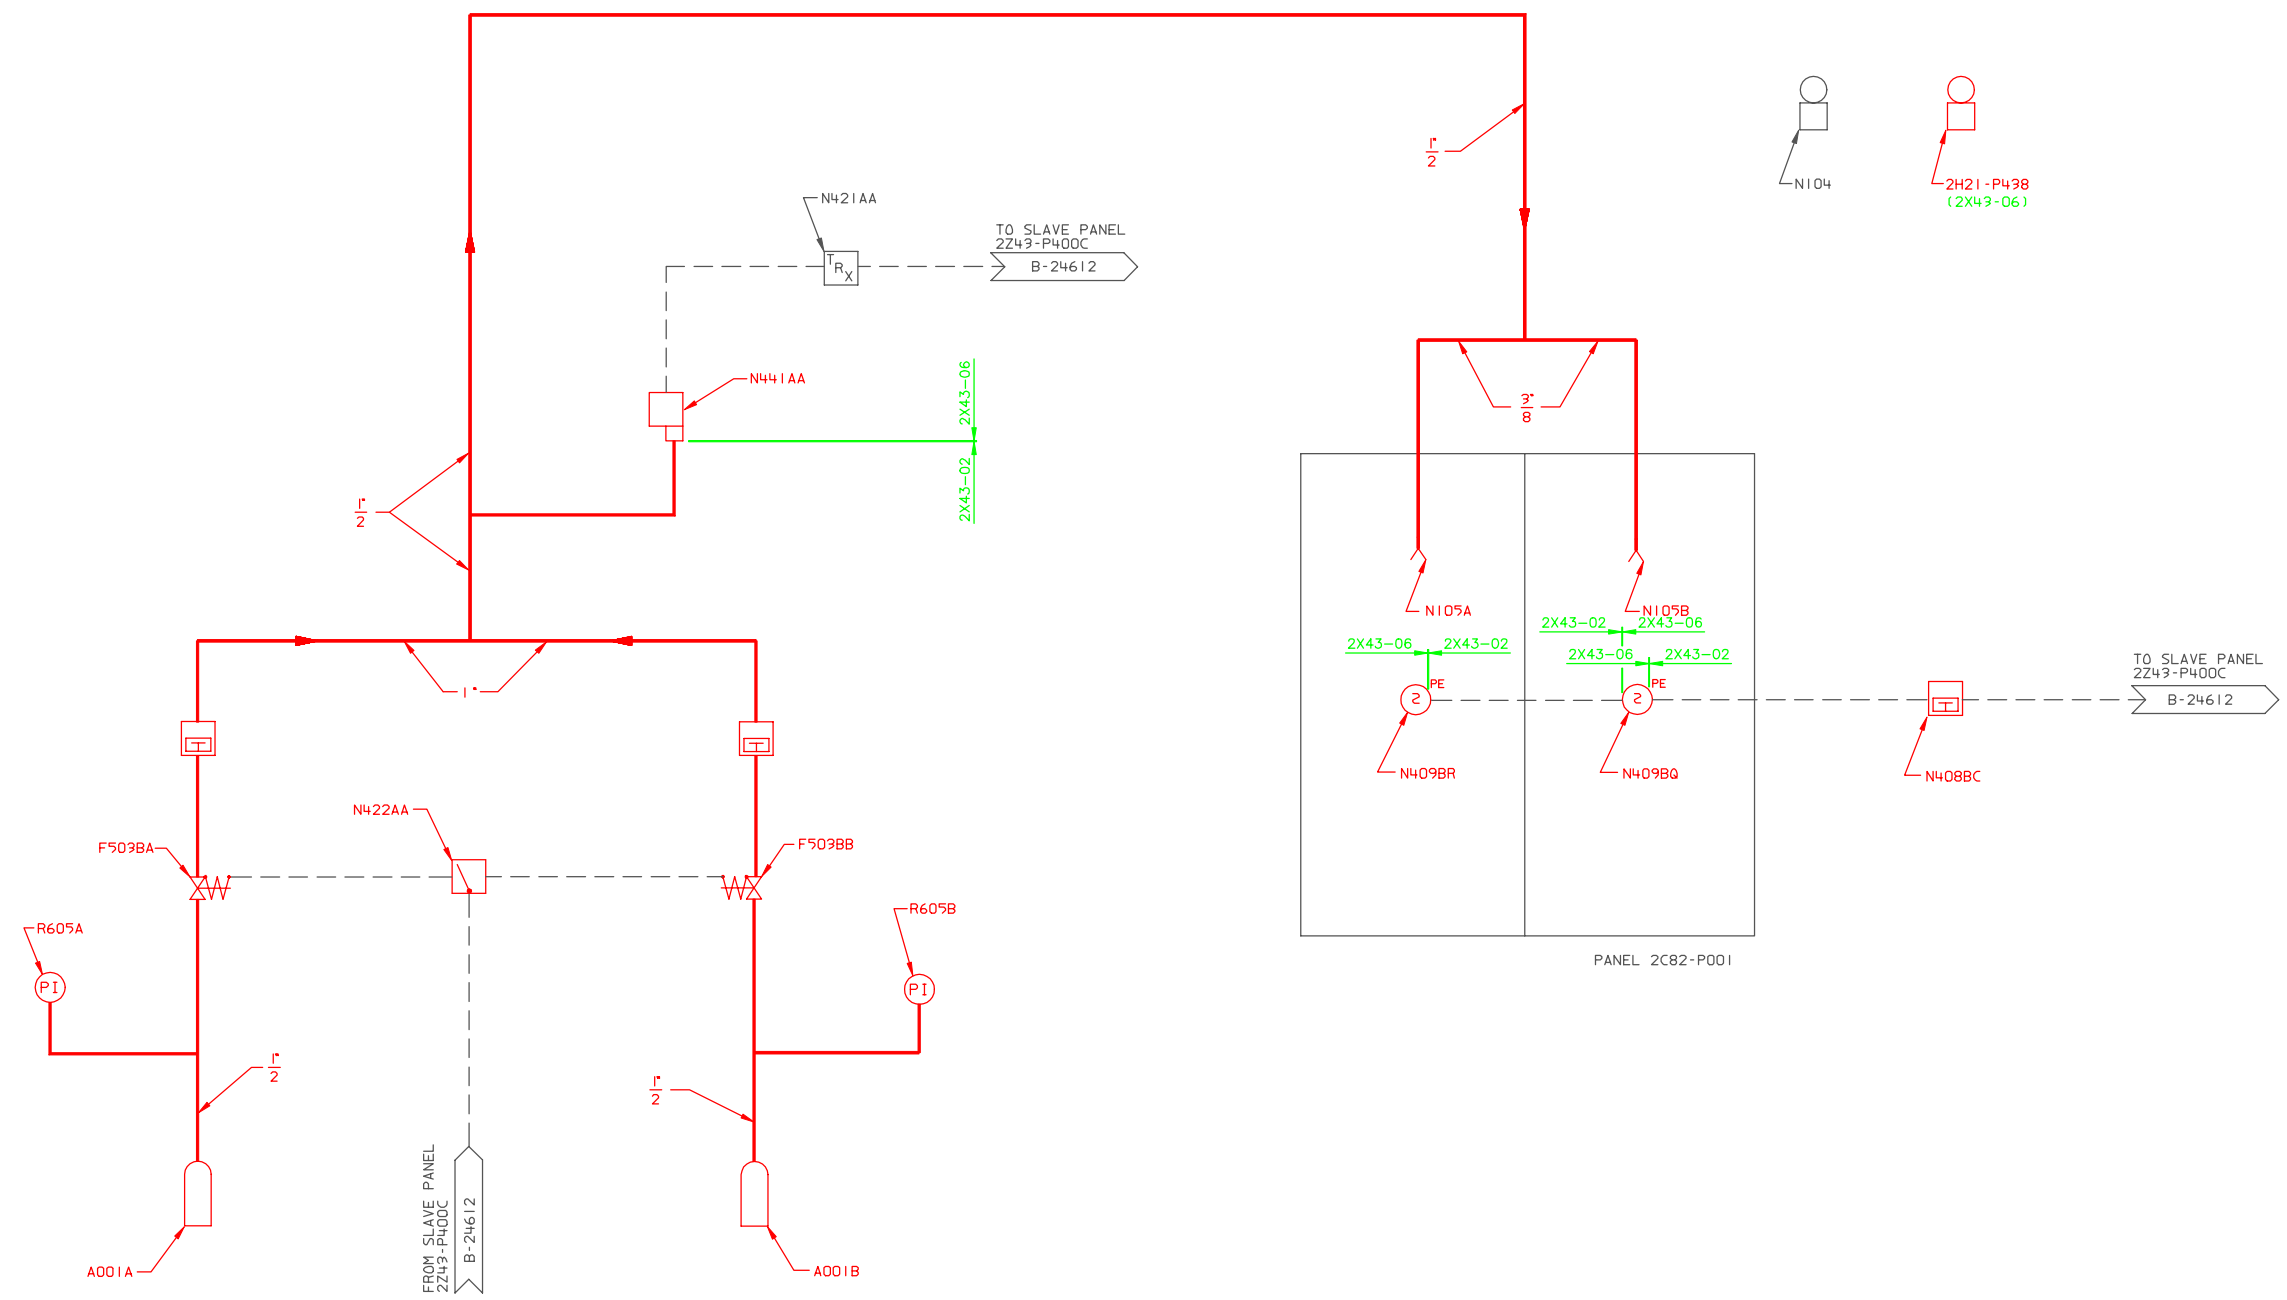

SYSTEM NO. 2T43130H06  
 2C82-P001 REMOTE SHUTDOWN PANEL  
 FLOOR EL. 130'-0"

NOTES:  
 1. ALL MPL NUMBERS ARE PRECEDED BY 2T43 UNLESS OTHERWISE NOTED.

REFERENCES:  
 A-50369 HANGER DRAWINGS  
 B-24612 FIRE PROTECTION - FCD - SYSTEM NUMBER 2T43130H06  
 H-50370 FIRE PROTECTION PIPING - SYSTEM NO. 2T43130H06 - PLAN AND ISOMETRIC OF HALON DISCHARGE LINE

BOUNDARY DIAGRAM NO.: 2X43-B06-26  
 FUNCTION(S) NO.: 2X43-06  
 PREPARED BY: M D STEPHENS  
 DATE: 3/19/98  
 REVIEWED BY: ALEX MORRISON  
 DATE: 7/15/98

Revision: A Date: 11-10-99  
 APPROVED, ISSUED PER LICENSE RENEWAL BOUNDARY PACKAGES. DRAWING CREATED FROM H-50048, REV.2; BY TRM.

MPL NO. 2T42 ACAD14 HL50048

**SOUTHERN COMPANY**

**LICENSE RENEWAL SCREENING FOR INFORMATION ONLY**

EDWIN I. HATCH NUCLEAR PLANT UNIT No.2  
 FIRE PROTECTION - P&ID - HALON SYSTEM FOR PANEL 2C82-P001

DATE	BY	SCALE	LOCATION	DOCUMENT NUMBER	REVISION
	TRM	None	10-502	HL-50048	A

LICENSE RENEWAL DOCUMENT