


Improved Technical Specifications

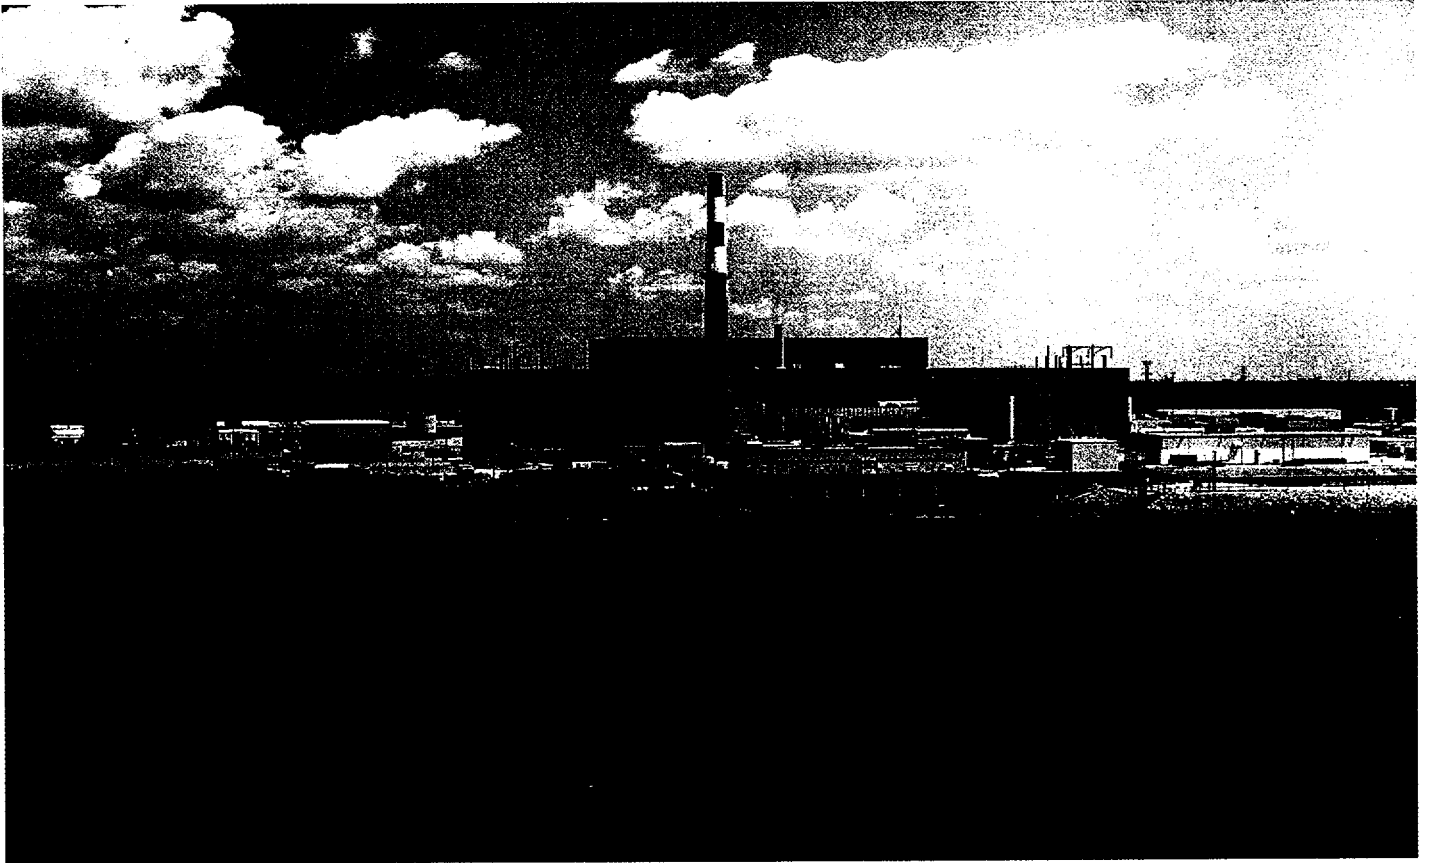

Quad Cities Station

Volume 12:
Complete CTS Markup

A.1

1.0 DEFINITIONS

Notes to Definitions

The following terms are defined so that uniform interpretation of these specifications may be achieved. The defined terms appear in capitalized type and shall be applicable throughout these Technical Specifications.

A.1

ACTION

ACTION shall be that part of a Specification which prescribes remedial measures required under designated conditions.

A.1

AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)

The AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR) shall be applicable to a specific planar height and is equal to the sum of the LINEAR HEAT GENERATION RATE(S) for all the fuel rods in the specified bundle at the specified height divided by the number of fuel rods in the fuel bundle.

LHGRs

A.1

CHANNEL

A CHANNEL shall be an arrangement of a sensor and associated components used to evaluate plant variables and generate a single protective action signal. A CHANNEL terminates and loses its identity where single action signals are combined in a TRIP SYSTEM or logic system.

A.2

CHANNEL CALIBRATION

A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the CHANNEL output such that it responds with the necessary range and accuracy to known values of the parameter which the CHANNEL monitors. The CHANNEL CALIBRATION shall encompass the entire CHANNEL including the required sensor and alarm and trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping, or total CHANNEL steps that the entire CHANNEL is calibrated.

A.3

A.1

CHANNEL CHECK

A CHANNEL CHECK shall be the qualitative assessment of CHANNEL behavior during operation by observation. This determination shall include, where possible, comparison of the CHANNEL indication and status with other indications and/or status derived from independent instrument CHANNELs measuring the same parameter.

A.1

A.1

1.0 DEFINITIONS

CHANNEL FUNCTIONAL TEST

A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog CHANNEL(s) - the injection of a simulated signal ^{or actual} into the CHANNEL as close to the sensor as practicable to verify OPERABILITY, including required alarm and ^{trip functions} and CHANNEL failure trips. _{interlock, display}
- b. Bistable CHANNEL(s) - the injection of a simulated signal ^{into the sensor} to verify OPERABILITY including required alarm and/or trip functions.

The CHANNEL FUNCTIONAL TEST may be performed by ^{means of} any series of sequential, overlapping, or total CHANNEL steps ^{so} that the entire CHANNEL is tested.

CORE ALTERATION

CORE ALTERATION shall be the movement of any fuel, sources, or reactivity control components, within the reactor vessel with the vessel head removed and fuel in the vessel. The following exceptions are not considered to be CORE ALTERATIONS:

- a. Movement of source range monitors, local power range monitors, intermediate range monitors, traversing incore probes, or special movable detectors (including undervessel replacement); and _{core}
- b. Control rod movement, provided there are no fuel assemblies in the associated control cell.

Suspension of CORE ALTERATIONS shall not preclude completion of movement of a component to a safe position.

CORE OPERATING LIMITS REPORT (COLR)

The CORE OPERATING LIMITS REPORT (COLR) ^{is} shall be the unit specific document that provides ^{reload} core operating limits for the current ^{is} operating cycle. These cycle specific ^{reload} operating limits shall be determined for each ^{is} operating cycle in accordance with Specification 6.9. Plant operation within these ^{is} operating limits is addressed in individual specifications.

CRITICAL POWER RATIO (CPR)

The CRITICAL POWER RATIO (CPR) ^{is} shall be the ratio of that power in the assembly ^{that} which is calculated by application of the ^{appropriate} applicable NRC approved critical power correlation, to cause some point in the assembly to experience transition ^(S) boiling, divided by the actual ^(S) assembly operating power.

DOSE EQUIVALENT I-131

DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcurie/gram) ^{that} which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, "Calculation of Distance Factors For Power and Test Reactor Sites."

QUAD CITIES - UNITS 1 & 2

^{add two additional thyroid dose conversion factor methods} Amendment Nos. 171 & 167 ₁₋₂

A.1

1.1 1.0 DEFINITIONS

FRACTION OF LIMITING POWER DENSITY (FLPD)

The ~~FRACTION OF LIMITING POWER DENSITY (FLPD)~~ shall be the LHGR existing at a given location divided by the specified LHGR limit for that bundle. ~~(applicable to GE fuel)~~

A.5
Insert into 1.0 FLPD definition on page 1-4

FRACTION OF RATED THERMAL POWER (F RTP)

The ~~FRACTION OF RATED THERMAL POWER (F RTP)~~ shall be the measured THERMAL POWER divided by the RATED THERMAL POWER.

type

LA.1

FREQUENCY NOTATION

The ~~FREQUENCY NOTATION~~ specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1-1.

A.6

FUEL DESIGN LIMITING RATIO (F DLRX)

The ~~FUEL DESIGN LIMITING RATIO (F DLRX)~~ shall be the limit used to assure that the fuel operates within the end-of-life steady-state design criteria by, among other items, limiting the release of fission gas to the cladding plenum ~~(applicable to SPC fuel)~~.

A.2

FUEL DESIGN LIMITING RATIO FOR CENTERLINE MELT (F DLRC)

The ~~FUEL DESIGN LIMITING RATIO FOR CENTERLINE MELT (F DLRC)~~ shall be 1.2 times the existing LHGR at a given location divided by the product of the ~~TRANSIENT LINEAR HEAT GENERATION RATE~~ limit and the ~~FRACTION OF RATED THERMAL POWER~~ ~~(applicable to SPC fuel)~~.

existing

LHGR

A.1

IDENTIFIED LEAKAGE

~~IDENTIFIED LEAKAGE~~ shall be: ~~(1) leakage into primary containment collection systems, such as pump seal or valve packing leaks, that is captured and conducted to a sump or collecting tank) or (2) leakage into the primary containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of the leakage detection systems or not to be PRESSURE BOUNDARY LEAKAGE.~~

A.1

a. Identified LEAKAGE (1)

the dry well

A.7

A.1

that from

drywell

A.8

A.1 (2)

A.1

A.7

LIMITING CONTROL ROD PATTERN (LCRP)

A ~~LIMITING CONTROL ROD PATTERN (LCRP)~~ shall be a pattern which results in the core being on a thermal hydraulic limit, i.e., operating on a limiting value for APLHGR, LHGR, or MCPR.

A.2

LINEAR HEAT GENERATION RATE (LHGR)

The ~~LINEAR HEAT GENERATION RATE (LHGR)~~ shall be the heat generation ~~rate~~ per unit length of fuel rod. It is the integral of the heat flux over the heat transfer area associated with the unit length.

The

rate

A.1

A.1

1.0 DEFINITIONS

LOGIC SYSTEM FUNCTIONAL TEST (LSFT)

A LOGIC SYSTEM FUNCTIONAL TEST (LSFT) shall be a test of all required logic components (i.e., all required relays and contacts, trip units, solid state logic elements, etc.) of a logic circuit, from as close to the sensor as practicable up to, but not including the actuated device, to verify OPERABILITY. The LOGIC SYSTEM FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping, or total system steps so that the entire logic system is tested.

A.1

MAXIMUM FRACTION OF LIMITING POWER DENSITY (MFLPD)

The MAXIMUM FRACTION OF LIMITING POWER DENSITY (MFLPD) shall be the largest value of the FLPD which exists in the core (applicable to BE fuel).

Fraction of limiting power density

Insert definition of FLPD from page 1-3

A.1

MINIMUM CRITICAL POWER RATIO (MCPR)

The MINIMUM CRITICAL POWER RATIO (MCPR) shall be the critical power ratio smallest CPR which exists in the core for each class of fuel.

Insert definition of CPR from page 1-2

A.5

A.1

OFFSITE DOSE CALCULATION MANUAL (ODCM)

The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Environmental Radiological Monitoring Program. The ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Specification 6.8 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Radioactive Effluent Release Reports required by Specification 6.9.

A.9

moved to specification 5.5

OPERABLE - OPERABILITY

A system, subsystem, unit, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling of seal water, lubrication, of other auxiliary equipment that are required for the system, subsystem, unit, component, or device to perform its specified safety function(s) are also capable of performing their related support function(s).

division

division

A.1

OPERATIONAL MODE

An OPERATIONAL MODE, i.e., MODE, shall correspond to any one inclusive combination of mode switch position, and average reactor coolant temperature, as specified in Table 15.2.

correspond to

A.10

PHYSICS TESTS

PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and 1) described in Chapter 14 of the UFSAR, 2) authorized under the provisions of 10 CFR 50.59, or 3) otherwise approved by the Commission.

and reactor vessel head closure bolt tensioning

1-1 with fuel in the reactor vessel

A.2

1.0 DEFINITIONS**LOGIC SYSTEM FUNCTIONAL TEST (LSFT)**

A LOGIC SYSTEM FUNCTIONAL TEST (LSFT) shall be a test of all required logic components, i.e., all required relays and contacts, trip units, solid state logic elements, etc. of a logic circuit, from as close to the sensor as practicable up to, but not including the actuated device, to verify OPERABILITY. The LOGIC SYSTEM FUNCTIONAL TEST may be performed by means of any series of sequential, overlapping or total system steps so that the entire logic system is tested.

MAXIMUM FRACTION OF LIMITING POWER DENSITY (MFLPD)

The MAXIMUM FRACTION OF LIMITING POWER DENSITY (MFLPD) shall be the highest value of the FLPD which exists in the core (applicable to GE fuel).

MINIMUM CRITICAL POWER RATIO (MCPR)

The MINIMUM CRITICAL POWER RATIO (MCPR) shall be the smallest CPR which exists in the core for each class of fuel.

5.5.1 OFFSITE DOSE CALCULATION MANUAL (ODCM)

5.5.1.a

The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Environmental Radiological Monitoring Program. The

5.5.1.b

ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Specification 6.8 and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Annual Radioactive Effluent Release Reports required by Specification 6.9.

OPERABLE - OPERABILITY

A system, subsystem, train, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified safety function(s) and when all necessary attendant instrumentation, controls, normal or emergency electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its specified safety function(s) are also capable of performing their related support function(s).

OPERATIONAL MODE

An OPERATIONAL MODE, i.e., MODE, shall be any one inclusive combination of mode switch position and average reactor coolant temperature as specified in Table 1-2.

PHYSICS TESTS

PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and 1) described in Chapter 14 of the UFSAR, 2) authorized under the provisions of 10 CFR 50.59, or 3) otherwise approved by the Commission.

A.1

1.0 DEFINITIONS

PRESSURE BOUNDARY LEAKAGE

PRESSURE BOUNDARY LEAKAGE shall be leakage through a nonisolable fault in a reactor coolant system, component body, pipe wall or vessel wall.

A.7

PRIMARY CONTAINMENT INTEGRITY (PCI)

PRIMARY CONTAINMENT INTEGRITY (PCI) shall exist when:

- a. All primary containment penetrations required to be closed during accident conditions are either:
 - 1) Capable of being closed by an OPERABLE primary containment automatic isolation valve system, or
 - 2) Closed by at least one manual valve, blind flange, or deactivated automatic valve secured in its closed position, except for valves that are open under administrative control as permitted by Specification 3.7.D.
- b. All primary containment equipment hatches are closed and sealed.
- c. Each primary containment air lock is in compliance with the requirements of Specification 3.7.C.
- d. The primary containment leakage rates are maintained within the limits of Specification 3.7.A.
- e. The suppression chamber is in compliance with the requirements of Specification 3.7.K.
- f. The sealing mechanism associated with each primary containment penetration; e.g., welds, bellows or O-rings, is OPERABLE.

LA.2

A.11

LA.2

PROCESS CONTROL PROGRAM (PCP)

The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analysis, test, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 81, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of solid radioactive waste.

A.12
moved to Chapter 5.0

RATED THERMAL POWER (RTP)

RATED THERMAL POWER (RTP) shall be a total reactor core heat transfer rate to the reactor coolant of 2511 MWt.

A.1

1.0 DEFINITIONS

PRESSURE BOUNDARY LEAKAGE

PRESSURE BOUNDARY LEAKAGE shall be leakage through a non-isolable fault in a reactor coolant system component body, pipe wall or vessel wall.

PRIMARY CONTAINMENT INTEGRITY (PCI)

PRIMARY CONTAINMENT INTEGRITY (PCI) shall exist when:

- a. All primary containment penetrations required to be closed during accident conditions are either:
 - 1) Capable of being closed by an OPERABLE primary containment automatic isolation valve system, or
 - 2) Closed by at least one manual valve, blind flange, or deactivated automatic valve secured in its closed position, except for valves that are open under administrative control as permitted by Specification 3.7.D.
- b. All primary containment equipment hatches are closed and sealed.
- c. Each primary containment air lock is in compliance with the requirements of Specification 3.7.C.
- d. The primary containment leakage rates are maintained within the limits of Specification 3.7.A.
- e. The suppression chamber is in compliance with the requirements of Specification 3.7.K.
- f. The sealing mechanism associated with each primary containment penetration; e.g., welds, bellows or O-rings, is OPERABLE.

PROCESS CONTROL PROGRAM (PCP)

The **PROCESS CONTROL PROGRAM (PCP)** shall contain the current formulas, sampling, analysis, test, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of solid radioactive waste.

L.A.1

RATED THERMAL POWER (RTP)

RATED THERMAL POWER (RTP) shall be a total reactor core heat transfer rate to the reactor coolant of 2511 MWT.

<See ITS 1.0>

A.1

A.19

Definitions 1.0 | 1

1.0 DEFINITIONS

The response time may be measured by means of any series of sequential, overlapping or total steps, so that the entire response time is measured

REACTOR PROTECTION SYSTEM (RPS) RESPONSE TIME

The

REACTOR PROTECTION SYSTEM (RPS) RESPONSE TIME shall be the time interval from the opening of the sensor contact up to and including the opening of the trip actuator.

that

A.1

until

REPORTABLE EVENT

A REPORTABLE EVENT shall be any of those conditions specified in Section 50.73 to 10 CFR Part 50.

A.2

SECONDARY CONTAINMENT INTEGRITY (SCI)

SECONDARY CONTAINMENT INTEGRITY (SCI) shall exist when:

- a. All secondary containment penetrations required to be closed during accident conditions are either:
 - 1) Capable of being closed by an OPERABLE secondary containment automatic isolation valve system, or
 - 2) Closed by at least one manual valve, blind flange, or deactivated automatic damper secured in its closed position, except as permitted by Specification 3.7.O.
- b. All secondary containment hatches and blowout panels are closed and sealed.
- c. The standby gas treatment system is in compliance with the requirements of Specification 3.7.P.
- d. At least one door in each access to the secondary containment is closed.
- e. The sealing mechanism associated with each secondary containment penetration; e.g., welds, bellows or O-rings, is OPERABLE.
- f. The pressure within the secondary containment is less than or equal to the value required by Specification 4.7.N.v.

A.11

LA.2

LA.2

SHUTDOWN MARGIN (SDM)

SHUTDOWN MARGIN (SDM) shall be the amount of reactivity by which the reactor is subcritical or would be subcritical assuming all control rods are fully inserted except for the single control rod of highest reactivity worth which is assumed to be fully withdrawn, and the reactor is in the shutdown condition: cold, LWR, 68°F; and xenon free;

A.1

that:

C.

b. The moderator temperature is

e. The reactor is

Insert 2

A.13

SOURCE CHECK

A SOURCE CHECK shall be the qualitative assessment of CHANNEL response when the CHANNEL sensor is exposed to a radioactive source.

A.2

A.1

1.0 DEFINITIONS

add proposed definition of STAGGERED TEST BASIS

A.14

THERMAL POWER

THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

TRANSIENT LINEAR HEAT GENERATION RATE (TLHGR)

The TRANSIENT LINEAR HEAT GENERATION RATE (TLHGR) limit protects against fuel centerline melting and 1% plastic cladding strain during transient conditions throughout the life of the fuel (applicable to SPC fuel).

LA.1

TRIP SYSTEM

A TRIP SYSTEM shall be an arrangement of instrument CHANNEL trip signals and auxiliary equipment required to initiate action to accomplish a protective trip function. A TRIP SYSTEM may require one or more instrument CHANNEL trip signals related to one or more plant parameters in order to initiate TRIP SYSTEM action. Initiation of protective action may require the tripping of a single TRIP SYSTEM or the coincident tripping of two TRIP SYSTEMS.

A.2

UNIDENTIFIED LEAKAGE

into the drywell that

UNIDENTIFIED LEAKAGE shall be all leakage which is not IDENTIFIED LEAKAGE;

A.8

A.7

add proposed definition of
TURBINE BYPASS SYSTEM
RESPONSE TIME

C. Total Leakage
Sum of the identified
and unidentified
LEAKAGE; and

A.14

A.1

TABLE 1-1
SURVEILLANCE FREQUENCY NOTATION

	<u>NOTATION</u>	<u>FREQUENCY</u>
1. Shift	S	At least once per 12 hours
2. Day	D	At least once per 24 hours
3. Week	W	At least once per 7 days
4. Month	M	At least once per 31 days
5. Quarter	Q	At least once per 92 days
6. Semiannual	SA	At least once per 184 days
7. Annual	A	At least once per 366 days
8. Sesquiannual	E	At least once per 18 months (550 days)
9. Startup	S/U	Prior to each reactor startup
10. Not Applicable	NA	Not applicable

A.6

A.1

TABLE 1.1-1
1.1-1
TABLE 1-2

OPERATIONAL MODES

MODE	TITLE	REACTOR MODE SWITCH POSITION	AVERAGE REACTOR COOLANT TEMPERATURE °F
1. POWER OPERATION		Run Refuel (a) or	Any temperature
2. STARTUP		Startup/Hot Standby	Any temperature
3. HOT SHUTDOWN		Shutdown	> 212°F
4. COLD SHUTDOWN		Shutdown	≤ 212°F
5. REFUELING		Shutdown or Refuel	≤ 140°F

(a) All reactor vessel head closure bolts fully tensioned.

TABLE NOTATIONS

- (a) The reactor mode switch may be placed in the Run, Startup/Hot Standby or Refuel position to test the switch interlock functions provided the control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.
- (b) The reactor mode switch may be placed in the Refuel position while a single control rod drive is being removed from the reactor pressure vessel per Specification 3.10.1.
- (c) Fuel in the reactor vessel with one or more vessel head closure bolts less than fully tensioned or with the head removed.
- (d) See Special Test Exceptions 3.12.A, 3.12.B and 3.12.C.
- (e) The reactor mode switch may be placed in the Refuel position while a single control rod is being moved provided the one-rod-out interlock is OPERABLE.
- (f) When there is no fuel in the reactor vessel, the reactor is considered not to be in any OPERATIONAL MODE. The reactor mode switch may then be in any position or may be inoperable.

add proposed Sections 1.2, 1.3, and 1.4

A.1

TABLE 1-2

OPERATIONAL MODES

<u>MODE</u>	<u>MODE SWITCH POSITION^m</u>	<u>AVERAGE REACTOR COOLANT TEMPERATURE</u>
1. POWER OPERATION	Run	Any temperature
2. STARTUP	Startup/Hot Standby	Any temperature
3. HOT SHUTDOWN	Shutdown ^(a,b)	> 212°F ^m
4. COLD SHUTDOWN	Shutdown ^(a,b,m)	≤ 212°F
5. REFUELING ^m	Shutdown or Refuel ^(a,m)	≤ 140°F

See ITS Chapter 1.0

Applicability of MODES 3, 4, and 5

TABLE NOTATIONS

LCO 3.10.1.

(a) The reactor mode switch may be placed in the Run, Startup/Hot Standby or Refuel position to test the switch interlock functions provided the control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual. **L.A.1**

(b) The reactor mode switch may be placed in the Refuel position while a single control rod drive is being removed from the reactor pressure vessel per Specification 3.10.1.

(c) Fuel in the reactor vessel with one or more vessel head closure bolts less than fully tensioned or with the head removed.

(d) See Special Test Exceptions 3.12.A, 3.12.B and 3.12.C.

(e) The reactor mode switch may be placed in the Refuel position while a single control rod is being moved provided the one-rod-out interlock is OPERABLE.

(f) When there is no fuel in the reactor vessel, the reactor is considered not to be in any OPERATIONAL MODE. The reactor mode switch may then be in any position or may be inoperable.

See ITS Chapter 1.0

add proposed ACTION and Surveillance Requirements

M.1

in core cells containing one or more fuel assemblies.

L.1

add proposed LCO 3.10.1.b

QUAD CITIES - UNITS 1 & 2

T-9

Amendment Nos. 179 & 177

A.1

TABLE 1-2

OPERATIONAL MODES

<u>MODE</u>	<u>MODE SWITCH POSITION^(m)</u>	<u>AVERAGE REACTOR COOLANT TEMPERATURE</u>
1. POWER OPERATION	Run	Any temperature
2. STARTUP	Startup/Hot Standby	Any temperature
3. HOT SHUTDOWN	Shutdown ^(a,e)	> 212°F ^(d)
4. COLD SHUTDOWN	Shutdown ^(a,b,e)	≤ 212°F
5. REFUELING ^(d)	Shutdown or Refuel ^(a,e)	≤ 140°F

See ITS Chapter 1.0

TABLE NOTATIONS

- (a) The reactor mode switch may be placed in the Run, Startup/Hot Standby or Refuel position to test the switch interlock functions provided the control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.
- (b) The reactor mode switch may be placed in the Refuel position while a single control rod drive is being removed from the reactor pressure vessel per Specification 3.10.1.
- (c) Fuel in the reactor vessel with one or more vessel head closure bolts less than fully tensioned or with the head removed.
- (d) See Special Test Exceptions 3.12.A, 3.12.B and 3.12.C.

Applicability of MODE 3

(e) The reactor mode switch may be placed in the Refuel position while a single control rod is being moved provided the one-rod-out interlock is OPERABLE.

(f) When there is no fuel in the reactor vessel, the reactor is considered not to be in any OPERATIONAL MODE. The reactor mode switch may then be in any position or may be inoperable.

LCD 3.10.2
LCD 3.10.2.a

M.1

Add proposed LCD 3.10.2.b, c, and d

Add proposed ACTION and SRs 3.10.2.2 and 3.10.2.3

See ITS Chapter 1.0

M.1

QUAD CITIES - UNITS 1 & 2

1-9

Amendment Nos. 179 & 177

TABLE 1-2

OPERATIONAL MODES

<u>MODE</u>	<u>MODE SWITCH POSITION^(m)</u>	<u>AVERAGE REACTOR COOLANT TEMPERATURE</u>
1. POWER OPERATION	Run	Any temperature
2. STARTUP	Startup/Hot Standby	Any temperature
3. HOT SHUTDOWN	Shutdown ^(a,c)	> 212°F ^(d)
4. COLD SHUTDOWN	Shutdown ^(a,b,e)	≤ 212°F
5. REFUELING ^(c)	Shutdown or Refuel ^(a,c)	≤ 140°F

See ITS Chapter 1.0

TABLE NOTATIONS

Applicability of MODE 4

(a) The reactor mode switch may be placed in the Run, Startup/Hot Standby or Refuel position to test the switch interlock functions provided the control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.

LCO 3.10.3 (b) The reactor mode switch may be placed in the Refuel position while a single control rod drive is being removed from the reactor pressure vessel per Specification 3.10.1.

LCO 3.10.3.b.1

(c) Fuel in the reactor vessel with one or more vessel head closure bolts less than fully tensioned or with the head removed.

(d) See Special Test Exceptions 3.12.A, 3.12.B and 3.12.C.

add proposed LCO 3.10.3.b.1 control rod position indication requirement

m.2

LCO 3.10.3

LCO 3.10.3.b.1

(e) The reactor mode switch may be placed in the Refuel position while a single control rod is being moved provided the one-rod-out interlock is OPERABLE.

(f) When there is no fuel in the reactor vessel, the reactor is considered not to be in any OPERATIONAL MODE. The reactor mode switch may then be in any position or may be inoperable.

See ITS Chapter 1.0

add proposed LCO 3.10.3.b.2

L.2

A.1

2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

A.2

Moved to
ITS 3.3.1.1

2.1 SAFETY LIMITS

THERMAL POWER, Low Pressure or Low Flow

2.1.1.1

2.1.A THERMAL POWER shall not exceed 25% of RATED THERMAL POWER with the reactor vessel steam dome pressure less than 785 psig or core flow less than 10% of rated flow.

APPLICABILITY: OPERATIONAL MODE(s) 1 and 2.

m.1

ACTION:

2.2

With THERMAL POWER exceeding 25% of RATED THERMAL POWER and the reactor vessel steam dome pressure less than 785 psig or core flow less than 10% of rated flow, be in at least HOT SHUTDOWN within 2 hours and comply with the requirements of Specification 6.7.

A.3

THERMAL POWER, High Pressure and High Flow

2.1.1.2

2.1.B The MINIMUM CRITICAL POWER RATIO (MCPR) shall not be less than 1.11 with the reactor vessel steam dome pressure greater than or equal to 785 psig and core flow greater than or equal to 10% of rated flow. During single recirculation loop operation, this MCPR limit shall be increased by 0.01.

APPLICABILITY: OPERATIONAL MODE(s) 1 and 2.

m.1

ACTION:

2.2

With MCPR less than the above applicable limit and the reactor vessel steam dome pressure greater than or equal to 785 psig and core flow greater than or equal to 10% of rated flow, be in at least HOT SHUTDOWN within 2 hours and comply with the requirements of Specification 6.7.

A.3

A.1

A.2 Moved to ITS 3.3.1.1

2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

Reactor Coolant System Pressure

2.1.2 2.1.C The reactor coolant system pressure, as measured in the reactor vessel steam dome, shall not exceed 1345 psig.

APPLICABILITY: OPERATIONAL MODE(s) 1, 2, 3 and 4.

M.1

ACTION:

2.2 With the reactor coolant system pressure, as measured in the reactor vessel steam dome, above 1345 psig, be in at least HOT SHUTDOWN with reactor coolant system pressure less than or equal to 1345 psig within 2 hours and comply with the requirements of Specification 6.7.

A.3

Reactor Vessel Water Level

2.1.1.3 2.1.D The reactor vessel water level shall be greater than twelve inches above the top of the active irradiated fuel.

L.1

APPLICABILITY: OPERATIONAL MODE(s) 3, 4 and 5.

M.1

ACTION:

within 2 hours.

L.1

L.2

2.2 With the reactor vessel water level at or below twelve inches above the top of the active irradiated fuel, manually initiate the ECCS to restore the water level, after depressurizing the reactor vessel, if required, and comply with the requirements of Specification 6.7.

A.3

A.1

ITS Chapter 2.0
LSSS 2.2

2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS A.2 Moved to ITS 3.3.1.1

2.2 LIMITING SAFETY SYSTEM SETTINGS

Reactor Protection System (RPS) Instrumentation Setpoint

2.2.A The reactor protection system instrumentation setpoints shall be set consistent with the Trip Setpoint values shown in Table 2.2.A-1.

APPLICABILITY: As shown in Table 3.1.A-1.

ACTION:

With a reactor protection system instrumentation setpoint less conservative than the value shown in the Trip Setpoint column of Table 2.2.A-1, declare the CHANNEL inoperable and apply the applicable ACTION statement requirement of Specification 3.1.A until the CHANNEL is restored to OPERABLE status with its setpoint adjusted consistent with the Trip Setpoint value.

A.2

Moved to
ITS 3.3.1.1

A.1

ITS 3.3.1.1

LSSS 2.2

2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

2.2 LIMITING SAFETY SYSTEM SETTINGS

A.14

Reactor Protection System (RPS) Instrumentation Setpoints

LC0 3.3.1.1

2.2.A The reactor protection system instrumentation setpoints shall be set consistent with the Trip Setpoint values shown in Table 2.2.A-1.

A.14

APPLICABILITY: As shown in Table 3.1.A-1.

Allowable Value

A.10

ACTION:

A.14

ACTION A-H

With a reactor protection system instrumentation setpoint less conservative than the value shown in the Trip Setpoint column of Table 2.2.A-1, declare the CHANNEL inoperable and apply the applicable ACTION statement requirement of Specification 3.1.A until the CHANNEL is restored to OPERABLE status with its setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value

A.10

A.1

TABLE 2.2.A-1

REACTOR PROTECTION SYSTEM INSTRUMENTATION SETPOINTS

A.2
Moved
to
ITS
3.3.1.1

<u>Functional Unit</u>	<u>Trip Setpoint</u>
1. Intermediate Range Monitor:	
a. Neutron Flux - High	≤120/125 divisions of full scale
b. Inoperative	NA
2. Average Power Range Monitor:	
a. Setdown Neutron Flux - High	≤15% of RATED THERMAL POWER
b. Flow Biased Neutron Flux - High	
1) Dual Recirculation Loop Operation	
a) Flow Biased	≤0.58W th + 62%, with a maximum of
b) High Flow Clamped	≤120% of RATED THERMAL POWER
2) Single Recirculation Loop Operation	
a) Flow Biased	≤0.58W th + 58.5%, with a maximum of
b) High Flow Clamped	≤116.5% of RATED THERMAL POWER
c. Fixed Neutron Flux - High	≤120% of RATED THERMAL POWER
d. Inoperative	NA
3. Reactor Vessel Steam Dome Pressure - High	≤1080 psig
4. Reactor Vessel Water Level - Low	≥144 inches above top of active fuel
5. Main Steam Line Isolation Valve - Closure	≤10% closed
6. Main Steam Line Radiation - High	≤15 x normal full power background (without hydrogen addition)

a W shall be the recirculation loop flow expressed as a percentage of the recirculation loop flow which produces a rated core flow of 86 million lbs/hr.

A.11

ITS 3.3.1.1

LSSS 2.2

TABLE 2(A-1) 3.3.1.1-1

REACTOR PROTECTION SYSTEM INSTRUMENTATION SETPOINTS

Function Functional Unit	Trip Setpoint	Allowable Values
1. Intermediate Range Monitor:	LF.1	A.10
1.a. Neutron Flux - High	≤120/125 divisions of full scale	
1.b. Inoperative	NA	
2. Average Power Range Monitor:		
2.a. Shutdown Neutron Flux - High	≤15% of RATED THERMAL POWER	
2.b. Flow Biased Neutron Flux - High		
1) Dual Recirculation Loop Operation		
a) Flow Biased	≤0.58W + 62%, with a maximum of	LA.4
b) High Flow Clamped	≤120% of RATED THERMAL POWER	
2) Single Recirculation Loop Operation		
a) Flow Biased	≤0.58W + 58.5%, with a maximum of	LA.4
b) High Flow Clamped	≤116.5% of RATED THERMAL POWER	
2.c. Fixed Neutron Flux - High	≤120% of RATED THERMAL POWER	
2.d. Inoperative	NA	
3. Reactor Vessel Steam Dome Pressure - High	≤1060 psig	LA.5
4. Reactor Vessel Water Level - Low	≥144 inches above top of active fuel	
5. Main Steam Line Isolation Valve - Closure	≤10% closed	
6. Main Steam Line Radiation - High	≤15 x normal full power background (without hydrogen addition)	A.8

a. W shall be the recirculation loop flow expressed as a percentage of the recirculation loop flow which produces a rated core flow of 98 million lbs/hr.

A.1

TABLE 2.2.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SETPOINTS

<u>Functional Unit</u>	<u>Trip Setpoint</u>
7. Drywell Pressure - High	≤2.5 psig
8. Scram Discharge Volume Water Level - High:	≤40 gallons
9. Turbine Stop Valve - Closure	≤10% closed
10. Deleted	
11. Turbine Control Valve Fast Closure	≥460 psig EHC fluid pressure
12. Turbine Condenser Vacuum - Low	≥21 inches Hg vacuum
13. Reactor Mode Switch Shutdown Position	NA
14. Manual Scram	NA

A.2

moved to
ITS 3.3.1.1

A.1

ITS 3.3.1.1

3.3.1.1-1

LSSS 2.2

TABLE 2.2A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SETPOINTS

Functional Unit

- 6. 7. Drywell Pressure - High
- 7. 8. Scram Discharge Volume Water Level - High:
- 8. 9. Turbine Stop Valve - Closure
- ~~10. Deleted~~
- 9. 11. Turbine Control Valve Fast Closure
- 10. 12. Turbine Condenser Vacuum - Low
- 11. 13. Reactor Mode Switch Shutdown Position
- 12. 14. Manual Scram

Tripping Setpoint

Allowable Value

A.10

≤2.5 psig
 ≤40 gallons
 ≤10% closed

LF.1

≥460 psig EHC fluid pressure
 ≥21 inches Hg vacuum

LF.1

NA

NA

A.1

Applicability 3/4.0

3.0 - LIMITING CONDITIONS FOR OPERATION (LCO)

A.2

A.2

LCO 3.0.1 A.

Compliance with the Limiting Conditions for Operation contained in the succeeding Specifications is required during the OPERATIONAL MODE(s) or other conditions specified therein; except that upon failure to meet the Limiting Conditions for Operation, the associated ACTION requirements shall be met, except as provided in Specification 3.0.E.

A.3

Insert 1

LCO 3.0.2 B.

Noncompliance with a Specification shall exist when the requirements of the Limiting Condition for Operation and associated ACTION requirements are not met within the specified time intervals, except as provided in Specification 3.0.E. If the Limiting Condition for Operation is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.

A.4

Insert 2

LCO 3.0.3 C.

When a Limiting Condition for Operation is not met, except as provided in the associated ACTION requirements, within one hour ACTION shall be initiated to place the unit in an OPERATIONAL MODE in which the Specification does not apply by placing it, as applicable, in:

A.5

- 1. At least HOT SHUTDOWN within the next 12 hours, and
- 2. At least COLD SHUTDOWN within the subsequent 24 hours.

Insert 3

Where corrective measures are completed that permit operation under the ACTION requirements, the ACTION may be taken in accordance with the specified time limits as measured from the time of failure to meet the Limiting Condition for Operation. Exceptions to these requirements are stated in the individual Specifications.

This Specification is not applicable in OPERATIONAL MODE 4 or 5.

LCO 3.0.4 D.

When an LCO is not met, entry into a MODE or other specified condition in the Applicability shall not be made except when the associated ACTIONS to be entered permit continued operation in the MODE or other specified condition in the Applicability for an unlimited period of time. This Specification shall not prevent changes in MODES or other specified conditions in the Applicability that are required to comply with ACTIONS. Exceptions to these requirements are stated in the individual Specifications.

or that are part of a shutdown of the unit

A.2

A.6

LCO 3.0.4 is only applicable for entry into a MODE or other specified condition in the Applicability in MODEs 1, 2, and 3.

LCO 3.0.5 E.

Equipment removed from service or declared inoperable to comply with ACTIONS may be returned to service under administrative control solely to perform testing required to demonstrate its OPERABILITY or the OPERABILITY of other equipment. This is an exception to Specification 3.0.A and 3.0.B for the system returned to service under administrative control to perform the testing required to demonstrate OPERABILITY.

A.3

Add proposed LCO 3.0.6

A.7

Add proposed LCO 3.0.7

A.8

QUAD CITIES - UNITS 1 & 2

3/4.0-1

Amendment Nos. 184, 181

Add proposed LCO 3.0.8

A.13

A.1

Applicability 3/4.0

3.0 4.0 - SURVEILLANCE REQUIREMENTS (SR)

A.2

A.2

SR 3.0.1 A. ^{SRs} Surveillance Requirements shall be met during the ^{in the Applicability} ~~OPERATIONAL MODE~~ or other conditions specified for individual ^{LCOs} Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement. ^{Insert 4.}

A.9

SR 3.0.2 B. Each Surveillance Requirement shall be performed within the specified surveillance interval with a maximum allowable extension not to exceed 25 percent of the surveillance interval.

L.1 A.10
Insert 5
M.1

SR 3.0.3 C. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Specification 4.0.B, shall constitute noncompliance with the OPERABILITY requirements for a Limiting Condition for Operation. ^{A.9 moved to SR 3.0.1} The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. ^{Insert 6} Surveillance requirements do not have to be performed on inoperable equipment. ^{L.2}

A.9 moved to SR 3.0.1
Insert 6
L.2
A.9
moved to SR 3.0.1

SR 3.0.4 D. Entry into an OPERATIONAL MODE or other specified applicable condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the applicable surveillance interval or as otherwise specified. This provision shall not prevent passage through or to OPERATIONAL MODE(s) as required to comply with ACTION requirements. ^{Insert T}

Insert T
A.11

E. Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:
1. Inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, Section 50.55a(g) and 50.55a(f), respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(i), respectively.

← Add proposed SR 3.0.5 — A.13

A.12
moved to
ITS Section 5.5

A.1

4.0 - SURVEILLANCE REQUIREMENTS

- A. Surveillance Requirements shall be met during the reactor OPERATIONAL MODE(s) or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.
- B. Each Surveillance Requirement shall be performed within the specified surveillance interval with a maximum allowable extension not to exceed 25 percent of the surveillance interval.
- C. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Specification 4.0.B, shall constitute noncompliance with the OPERABILITY requirements for a Limiting Condition for Operation. The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. Surveillance requirements do not have to be performed on inoperable equipment.
- D. Entry into an OPERATIONAL MODE or other specified applicable condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the applicable surveillance interval or as otherwise specified. This provision shall not prevent passage through or to OPERATIONAL MODE(s) as required to comply with ACTION requirements.

5.5.6 E. Surveillance Requirements for ~~inservice inspection and~~ testing of ASME Code Class 1, 2, and 3 ~~components~~ shall be applicable as follows:

1. ~~Inservice inspection of ASME Code Class 1, 2, and 3 components and~~ inservice testing of ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR Part 50, ~~Section 50.55a(b) and 50.55a(f) respectively, except where specific written relief has been granted by the Commission pursuant to 10 CFR Part 50, Section 50.55a(g)(6)(i) or 50.55a(f)(6)(ii), respectively.~~

LA.2

pumps and valves

LA.3

LA.2

LA.3

< See ITS Section 3.0 >

A.1

Applicability 3/4.0

3.0 4.0 - SURVEILLANCE REQUIREMENTS (SR)

A.2

2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

<u>ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities</u>	<u>Required Frequencies for performing inservice inspection and testing activities</u>
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 9 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days

3. The provisions of Specification 4.0.B are applicable to the above required frequencies for performing inservice inspection and testing activities.
4. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.
6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

A.12

Moved to ITS Section 5.5

4.0 - SURVEILLANCE REQUIREMENTS

5.5.6.a 2. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice ~~inspection and~~ testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

ASME Boiler and Pressure Vessel Code and applicable Addenda terminology for inservice inspection and testing activities	Required Frequencies for performing inservice inspection and testing activities
Weekly	At least once per 7 days
Monthly	At least once per 31 days
Quarterly or every 3 months	At least once per 92 days
Semiannually or every 6 months	At least once per 184 days
Every 8 months	At least once per 276 days
Yearly or annually	At least once per 366 days
Biennially or every 2 years	At least once per 731 days
Every 18 months	At least once per 549 days

LA.2

A.10

5.5.6.b 3. The provisions of Specification 4.0.B are applicable to the above required frequencies for performing inservice ~~inspection and~~ testing activities.

4. Performance of the above inservice ~~inspection and~~ testing activities shall be in addition to other specified Surveillance Requirements.

A.5

5.5.6.d 5. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.

6. The Inservice Inspection Program for piping identified in NRC Generic Letter 88-01 shall be performed in accordance with the staff positions on schedule, methods, and personnel and sample expansion included in Generic Letter 88-01 or in accordance with alternate measures approved by the NRC staff.

LA.2

5.5.6.c The provisions of SR 3.0.3 are applicable to inservice testing activities; and

A.2

3.1 - LIMITING CONDITIONS FOR OPERATION

4.1 - SURVEILLANCE REQUIREMENTS

A. Reactor Protection System (RPS)

A. Reactor Protection System

LD 3.3.1.1

The reactor protection system (RPS) instrumentation CHANNEL(s) shown in Table 3.1.A-1 shall be OPERABLE.

A.2

APPLICABILITY:

add proposed ACTION'S NOTE 1

As shown in Table 3.1.A-1.

ACTION:

A.3

Insert CTS 3.1.A Actions

1. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place the inoperable CHANNEL(s) and/or that TRIP SYSTEM in the tripped conditionSM within 1 hour.
2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEM(s), place at least one TRIP SYSTEM in the tripped conditionSM within 1 hour and take the ACTION required by Table 3.1.A-1.

Note 1 to Surveillance Requirements

SR 3.3.1.1.17

SR 3.3.1.1.18

LD.1

1. Each reactor protection system instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.1.A-1.

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months. 24-LD.1

3. The response time of each reactor trip functional unit shown in Table 3.1.A-1 shall be demonstrated at least once per 18 months. Each test shall include at least one CHANNEL per TRIP SYSTEM such that all CHANNEL(s) are tested at least once every N times 18 months where N is the total number of redundant CHANNEL(s) in a specific reactor TRIP SYSTEM. L.10

addressed by Definition of Staggered Test BASIS, Note 2 and A.7

add proposed Note 1 to SR 3.3.1.1.18

L.1

Insert CTS 3.1.A Notes (a) and (b)

A.3

- a. An inoperable CHANNEL need not be placed in the tripped condition when this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within 2 hours or the ACTION required by Table 3.1.A-1 for that trip function shall be taken.
- b. The TRIP SYSTEM need not be placed in the tripped condition if this would cause the trip function to occur. When a TRIP SYSTEM can be placed in the tripped condition without causing the trip function to occur, place the TRIP SYSTEM with the most inoperable CHANNEL(s) in the tripped condition; if both systems have the same number of inoperable CHANNEL(s), place either TRIP SYSTEM in the tripped condition.

REACTOR PROTECTION SYSTEM

A.1

ITS 3.10.7

RPS 3/4.1.A

3.1 - LIMITING CONDITIONS FOR OPERATION

4.1 - SURVEILLANCE REQUIREMENTS

A. Reactor Protection System (RPS)

A. Reactor Protection System

LCO 3.10.7 a

The reactor protection system (RPS) instrumentation CHANNEL(s) shown in Table 3.1.A-1 shall be OPERABLE.

APPLICABILITY:
As shown in Table 3.1.A-1.

A.8

SR 3.10.7.1

ACTION:

1. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place the inoperable CHANNEL(s) and/or that TRIP SYSTEM in the tripped conditionSM within 1 hour.
2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEM(s), place at least one TRIP SYSTEM in the tripped conditionSM within 1 hour and take the ACTION required by Table 3.1.A-1.

1. Each reactor protection system instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.1.A-1.
2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

A.8

3. The response time of each reactor trip functional unit shown in Table 3.1.A-1 shall be demonstrated at least once per 18 months. Each test shall include at least one CHANNEL per TRIP SYSTEM such that all CHANNEL(s) are tested at least once every N times 18 months where N is the total number of redundant CHANNEL(s) in a specific reactor TRIP SYSTEM.

Insert 3.1.A Actions 1, 2, and 3

<See ITS 3.3.1.1>

A.10

Insert 3.1.A Notes

- a An inoperable CHANNEL need not be placed in the tripped condition when this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within 2 hours or the ACTION required by Table 3.1.A-1 for that trip function shall be taken.
- b The TRIP SYSTEM need not be placed in the tripped condition if this would cause the trip function to occur. When a TRIP SYSTEM can be placed in the tripped condition without causing the trip function to occur, place the TRIP SYSTEM with the most inoperable CHANNEL(s) in the tripped condition; if both systems have the same number of inoperable CHANNEL(s), place either TRIP SYSTEM in the tripped condition.

A.3 Insert CTS 3.1.A Actions

Insert 1, Page 3/4.1-1

1. With one CHANNEL required by Table 3.1.A-1 inoperable ~~for Functional Units 1~~ A.4

ACTION A ~~through 12~~ A.2
in one or more Functional Units place the inoperable CHANNEL and/or that TRIP SYSTEM in the tripped condition^(a) within 12 hours.

2. With two or more CHANNELS required by Table 3.1.A-1 inoperable ~~for~~ A.4
FUNCTIONS
A, B
and C Functional Units 7 through 12 in one or more Functional Units:

ACTION C
a. Within one hour, verify sufficient CHANNELS remain OPERABLE or tripped^(a) to maintain trip capability in the Functional Unit, and

ACTION B
b. Within 6 hours, place the inoperable CHANNEL(s) in one TRIP SYSTEM and/or that TRIP SYSTEM^(b) in the tripped condition^(a), and

ACTION A
c. Within 12 hours, restore the inoperable CHANNELS in the other TRIP SYSTEM to an OPERABLE status or tripped^(a).

ACTION D Otherwise, take the ACTION required by Table 3.1.A-1 for the Functional Unit.

3. With one or more CHANNEL(s) required by Table 3.1.A-1 inoperable for A.4

ACTION C ~~Functional Units 13 or 14~~
within one hour place the inoperable CHANNEL(s) in the tripped condition^(a).

ACTION D Otherwise, take the ACTION required by Table 3.1.A-1 for the Functional Unit.

A.10

Insert 3.1.A Actions 1, 2, and 3

Insert 1, Page 3/4.1-1

M.2

1. With one CHANNEL required by Table 3.1.A-1 inoperable for Functional Units 1 through 12 in one or more Functional Units, place the inoperable CHANNEL and/or that TRIP SYSTEM in the tripped condition^(a) within 12 hours.

2. With two or more CHANNELS required by Table 3.1.A-1 inoperable for Functional Units 1 through 12 in one or more Functional Units:

a. Within one hour, verify sufficient CHANNELS remain OPERABLE or tripped^(a) to maintain trip capability in the Functional Unit, and

b. Within 6 hours, place the inoperable CHANNEL(s) in one TRIP SYSTEM and/or that TRIP SYSTEM^(b) in the tripped condition^(a), and

c. Within 12 hours, restore the inoperable CHANNELS in the other TRIP SYSTEM to an OPERABLE status or tripped^(a)

Otherwise, take the ACTION required by Table 3.1.A-1 for the Functional Unit.

3. With one or more CHANNEL(s) required by Table 3.1.A-1 inoperable for Functional Units 13 or 14, within one hour place the inoperable CHANNEL(s) in the tripped condition^(a).

Otherwise, take the ACTION required by Table 3.1.A-1 for the Functional Unit.

A.3

Insert CTS 3.1.A Notes a and b

~~Insert 2, Page 3/4.1-1~~

LA.1

a. ~~An inoperable CHANNEL or TRIP SYSTEM need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, if the inoperable~~
ACTION D CHANNEL is not restored to OPERABLE status within the required time, the ACTION required by Table 3.1.A-1 for the Functional Unit shall be taken.

b. ~~This ACTION applies to that TRIP SYSTEM with the most inoperable CHANNELS; if both TRIP SYSTEMS have the same number of inoperable CHANNELS, the ACTION can be applied to either TRIP SYSTEM.~~

LA.1

A.10

Insert CTS 31.A Notes

ITS 310.7

Insert 2, Page 3/4.1-1

- a. An inoperable CHANNEL or TRIP SYSTEM need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, if the inoperable CHANNEL is not restored to OPERABLE status within the required time, the ACTION required by Table 31.A-1 for the Functional Unit shall be taken.
- b. This ACTION applies to that TRIP SYSTEM with the most inoperable CHANNELS; if both TRIP SYSTEMS have the same number of inoperable CHANNELS, the ACTION can be applied to either TRIP SYSTEM.

M.2

Table 3.3.1.1-1
TABLE 3.1.A-1

REACTOR PROTECTION SYSTEM INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

REACTOR PROTECTION SYSTEM

Function Functional Unit	Applicable OPERATIONAL MODE(s)	Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM	ACTION
1. 1. Intermediate Range Monitor:			Note 2 to Surveillance Requirements
1.a a. Neutron Flux - High	2 3/4 5 [†]	3 2 3	G 11 12 H 13
1.b b. Inoperative	2 3, 4 5 [†]	3 2 3	G 11 12 H 13
2. 2. Average Power Range Monitor:			
2.a a. Setdown Neutron Flux - High	2 3 5 [†]	2 2 2	G 11 12 13
2.b b. Flow Biased Neutron Flux - High	1	2	F 14
2.c c. Fixed Neutron Flux - High	1	2	F 14
2.d d. Inoperative	1, 2 3 5 [†]	2 2 2	G 11 12 13
3. 3. Reactor Vessel Steam Dome Pressure - High	1, 2	2	G 11
4. 4. Reactor Vessel Water Level - Low	1, 2	2	G 11

L.3
Add proposed Note (a) to Table 3.3.1.1-1

LA.2

L.2

L.2

L.2

A.5

L.2

A.5

A.6

Moved to ITS 3.10.7

Moved to ITS 3.10.7

RPS 3/4.1A

ITS 3.3.1.1

Amendment Nos. 183; 180

QUAD CITIES - UNITS 1 & 2

3/4.1-2


TABLE 3.1.A-1

REACTOR PROTECTION SYSTEM INSTRUMENTATION

Functional Unit	Applicable OPERATIONAL MODE(s)	Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM ^(a)	ACTION
1. Intermediate Range Monitor:			
a. Neutron Flux - High	2	3	11
	3, 4	2	12
	5	3	13
b. Inoperative	2	3	11
	3, 4	2	12
	5	3	13
2. Average Power Range Monitor^(a):			
a. Setdown Neutron Flux - High	2	2	11
	3	2	12
	4	2	13
	5	2	14
b. Flow Biased Neutron Flux - High	1	2	14
c. Fixed Neutron Flux - High	1	2	14
d. Inoperative	1, 2	2	11
	3	2	12
	4	2	13
3. Reactor Vessel Steam Dome Pressure - High	1, 2 ^(b)	2	11
4. Reactor Vessel Water Level - Low	1, 2	2	11

A.8
 LCO 3.10.7.a
 LCO 3.10.7.a

Amendment Nos. 183; 180

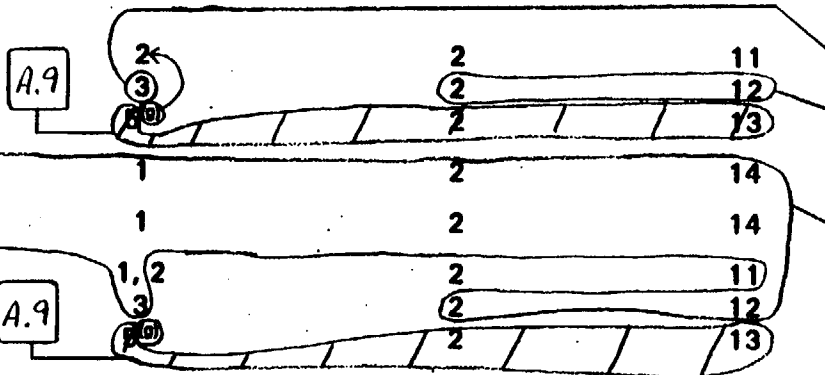

REACTOR PROTECTION SYSTEM

A.1

RPS 3/4.1.A

ITS 3.10.7

See ITS 3.3.1.1

QUAD CITIES - UNITS 1 & 2

3/4.1.3

Page 5 of 16
Amendment Nos. 193 & 189

3.3.1.1-1


TABLE 3.3.1.1-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION

Note 2 to Surveillance Requirements

REACTOR PROTECTION SYSTEM

Function Functional Unit	Applicable OPERATIONAL MODE(s)	Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM ^(a)	ACTION
5. 5. Main Steam Line Isolation Valve - Closure	1	1	F 14
6. Main Steam Line Radiation - High	1, 2 ^(b)	2	15
6. 7. Drywell Pressure - High	1, 2 ^(b)	2	G 11
7. 8. Scram Discharge Volume Water Level - High	1, 2	2	G 11
b. a. ΔP Switch, and	5 ^(b,1)	2	H 13
a. b. Thermal Switch	5 ^(b,1)	2	H 13
8. 9. Turbine Stop Valve - Closure	1 ^(b)	4	E 16
10. Deleted			
9. 11. Turbine Control Valve Fast Closure	1 ^(b)	2	E 16
10. 12. Turbine Condenser Vacuum - Low	1	2	F 14

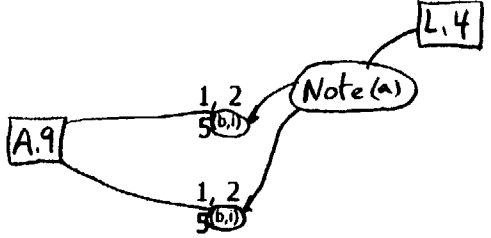

A.11

RPS 3/4.1.A

ITS 3.3.1.1

3.3.1.1-1

TABLE 3.7.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION

Note 2 to Surveillance Requirements

QUAD CITIES - UNITS 1 & 2

3/4.1-4

Amendment Nos. 171 & 167

Page 6 of 16

Function
Functional Unit

Applicable OPERATIONAL MODE(s)

Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM^(a)

ACTION

// 13. Reactor Mode Switch Shutdown Position

L.3

1, 2	1	G 11
3, 4	1	H 13
5	1	

L.2

add proposed Note (a) to Table 3.3.1.1-1

12 14. Manual Scram

1, 2	1	G 11
3, 4	1	H 19
5	1	

L.2

A.1

ITS 3.3.1.1

REACTOR PROTECTION SYSTEM

3.3.1.1-1

RPS 3/4.1.A

TABLE 3.1.A (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION

ACTION

G ACTION 11 - Be in at least HOT SHUTDOWN within 12 hours.

ACTION 12 - Verify all insertable control rods to be fully inserted in the core and lock the reactor mode switch in the Shutdown position within one hour.

L.3
L.4
A.11

L.2
A.11

Initiate action to

H ACTION 13 - Suspend all operations involving CORE ALTERATIONS and fully insert all insertable control rods within one hour. If SRM instrumentation is not OPERABLE per Specification 3.10.B, also suspend replacement of LPRMs.

immediately

L.5

F ACTION 14 - Be in at least STARTUP within 8 hours.

A.8

ACTION 15 - Be in STARTUP with the main steam line isolation valves closed within 8 hours or in at least HOT SHUTDOWN within 12 hours.

L.6

E ACTION 16 - Initiate a reduction in THERMAL POWER within 15 minutes and reduce reactor power to less than 45% of RATED THERMAL POWER within 2 hours.

L.9

ACTION 17 - Verify all insertable control rods to be fully inserted in the core within one hour.

L.2

ACTION 18 - Lock the reactor mode switch in the Shutdown position within one hour.

L.2

H ACTION 19 - Suspend all operations involving CORE ALTERATIONS, and fully insert all insertable control rods and lock the reactor mode switch in the Shutdown position within one hour. If SRM instrumentation is not OPERABLE per Specification 3.10.B, also suspend replacement of LPRMs.

Initiate action to

L.3
L.4

A.11

L.3

immediately

L.5

A.1

ITS 3.3.1.1

REACTOR PROTECTION SYSTEM

RPS 3/4.1.A

3.3.1.1-1

TABLE 3.1.A-1 (Continued)

A.3

REACTOR PROTECTION SYSTEM INSTRUMENTATION

Insert CTS Table 3.1.A-1 Note a

TABLE NOTATION

(a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the TRIP SYSTEM in the tripped condition provided at least one OPERABLE CHANNEL in the same TRIP SYSTEM is monitoring that parameter.

(b) This function may be bypassed, provided a control rod block is actuated, for reactor protection system logic reset in Refuel and Shutdown positions of the reactor mode switch.

L.4

(c) Deleted Function 8.9 Applicability

(d) With THERMAL POWER greater than or equal to 45% of RATED THERMAL POWER.

L.A.2

(e) An APRM CHANNEL is inoperable if there are fewer than 2 LPRM inputs per level or there are less than 50% of the normal complement of LPRM inputs to an APRM CHANNEL.

(f) This function is not required to be OPERABLE when the reactor pressure vessel head is unbolted or removed per Specification 3.12.A.

A.6

(g) Required to be OPERABLE only prior to and during required SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

A.5 moved to ITS 3.10.7

(h) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

A.6

(i) With any control rod withdrawn. (Not applicable to control rods removed per Specification 3.10.I or 3.10.J)

A.9

from a core cell containing one or more fuel assemblies

L.4

Table 3.3.1.1-1 footnote (a)

REACTOR PROTECTION SYSTEM

RPS 3/4.1.A

TABLE 3.1.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION

TABLE NOTATION

- (a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the TRIP SYSTEM in the tripped condition provided at least one OPERABLE CHANNEL in the same TRIP SYSTEM is monitoring that parameter.
- (b) This function may be bypassed, provided a control rod block is actuated, for reactor protection system logic reset in Refuel and Shutdown positions of the reactor mode switch.
- (c) Deleted.
- (d) With THERMAL POWER greater than or equal to 45% of RATED THERMAL POWER.
- (e) An APRM CHANNEL is inoperable if there are fewer than 2 LPRM inputs per level or there are less than 50% of the normal complement of LPRM inputs to an APRM CHANNEL.
- (f) This function is not required to be OPERABLE when the reactor pressure vessel head is unbolted or removed per Specification 3.12.A.

- ^{LCO} 3.10.7.2(g) Required to be OPERABLE only prior to and during required SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

A.8

- (h) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.
- (i) With any control rod withdrawn. Not applicable to control rods removed per Specification 3.10.I or 3.10.J.

See ITS 3.3.1.1

A.1

ITS 313.111

A.3

Insert to Table 3.1.A-1 Note a

Insert 3, Page 3/4.1-6

- (a) When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains RPS trip capability.

Note 2
to Surveillance
Requirements

3.3.1.1-1
TABLE 4.1.1.1

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

Note 1 to
SR 3.3.1.1.14
SR 3.3.1.1.16

REACTOR PROTECTION SYSTEM

Functional Unit

1. 1. Intermediate Range Monitor:

1.a a. Neutron Flux - High

1.b b. Inoperative

2. 2. Average Power Range Monitor

2.a a. Setdown Neutron Flux - High

2.b b. Flow Biased Neutron Flux - High

2.c c. Fixed Neutron Flux - High

2.d d. Inoperative

3. 3. Reactor Vessel Steam Dome Pressure - High

4. 4. Reactor Vessel Water Level - Low

5. 5. Main Steam Line Isolation Valve - Closure

6. 6. Main Steam Line Radiation - High

6. 7. Drywell Pressure - High

Applicable OPERATIONAL MODES

SR 3.3.1.1.1 CHANNEL CHECK

SR 3.3.1.1.5 CHANNEL FUNCTIONAL TEST

SR 3.3.1.1.2
SR 3.3.1.1.3
SR 3.3.1.1.11
SR 3.3.1.1.12
SR 3.3.1.1.14
SR 3.3.1.1.16
CHANNEL CALIBRATION

L.3
add proposed Note (a) to Table 3.3.1.1-1

SR 3.3.1.1.6
SR 3.3.1.1.7

A.12

24 months

LE.1

SR 3.3.1.1.4

SR 3.3.1.1.7

A.12

A.5 moved to ITS 3.10.7

A.1

add proposed SR 3.3.1.1.16 for flow portion of Channel and Note 3 to SR 3.3.1.1.14

L.8

L.2

2
5^(m)

S^(m) -1
S

S/U^(m) W^(m) -4
W^(m) -4

14-SA^(m)
SA^(m)

LE.1

24 months

1 A.5 moved to ITS 3.10.7

A.13

A.3

W^(m) -10

W^(m), SA-14

2) W^(m), SA-14

1-S

NA

A.3

W^(m) -10

W^(m) -10

NA

A.14

A.3

16-E

LE.1

24 months

M.2

12 hours

D -1

M -10

M -10

16-E^(m) -11

LE.1

24 months

1

NA

M -10

16-E

A.8

1, 2^(m)

A.6

S

M

E^(m)

RPS 3/4.1.A

1, 2^(m)

A.6

NA

A.3

M -10

Q-12

ITS 3.3.1.1

QUAD CITIES - UNITS 1 & 2

REACTOR PROTECTION SYSTEM

TABLE 4.1.A-1

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

Functional Unit	Applicable OPERATIONAL MODES	CHANNEL CHECK	CHANNEL FUNCTIONAL TEST	CHANNEL ⁽¹⁾ CALIBRATION
1. Intermediate Range Monitor:				
a. Neutron Flux - High	2 3, 4, 5	S ⁽¹⁾ S	S/U ⁽¹⁾ , W ⁽¹⁾ W ⁽¹⁾	E ⁽¹⁾ E ⁽¹⁾
b. Inoperative	2, 3, 4, 5	NA	W ⁽¹⁾	NA
2. Average Power Range Monitor ⁽¹⁾ :				
a. Setdown Neutron Flux - High	2 3, 4, 5	S ⁽¹⁾ S	S/U ⁽¹⁾ , W ⁽¹⁾ W ⁽¹⁾	SA ⁽¹⁾ SA ⁽¹⁾
b. Flow Biased Neutron Flux - High	1	S, D	W ⁽¹⁾ , SA	W ^(1,e) , SA
c. Fixed Neutron Flux - High	1	S	W ⁽¹⁾ , SA	W ⁽¹⁾ , SA
d. Inoperative	1, 2, 3, 4, 5	NA	W ⁽¹⁾	NA
3. Reactor Vessel Steam Dome Pressure - High	1, 2 ⁽¹⁾	S	E ⁽¹⁾	E ⁽¹⁾
4. Reactor Vessel Water Level - Low	1, 2	D	E ⁽¹⁾	E ⁽¹⁾
5. Main Steam Line Isolation Valve - Closure	1	NA	E	E
6. Main Steam Line Radiation - High	1, 2 ⁽¹⁾	S	E ⁽¹⁾	E ⁽¹⁾
7. Drywell Pressure - High	1, 2 ⁽¹⁾	NA	Q	Q


A.8
(SR 3.10.7.1)
3/4.1-7

LCO 3.10.7.a

A.9

(see ITS 3.3.1.1)

Amendment Nos. 194 & 190
Page 9 of 10

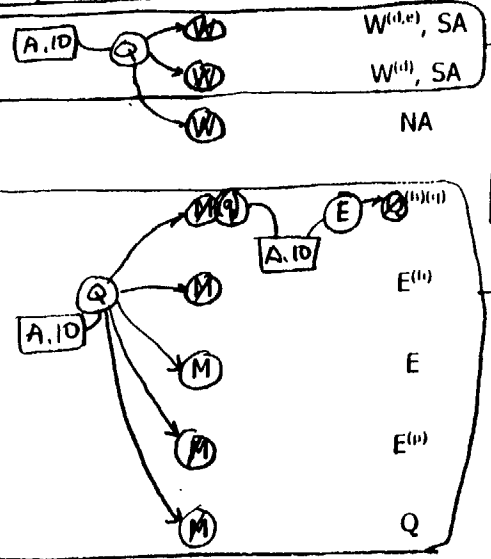

RPS 3/4.1.A

A.1

ITS 3.10.7

3.3.1.1-1

TABLE 4.1.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

QUAD CITIES - UNITS 1 & 2

REACTOR PROTECTION SYSTEM

Functional Unit	Applicable OPERATIONAL MODES	CHANNEL CHECK	CHANNEL FUNCTIONAL TEST (M)	CHANNEL CALIBRATION
7. 8. Scram Discharge Volume Water Level - High	L.4	M.1	A.3	LE.1
7,b a. ΔP Switch, and	1, 2, 5, Note(a)	NA	Q-10	24 months
7,a b. Thermal Switch	1, 2, 5, Note(a)	NA	Q-10	NA
8. 9. Turbine Stop Valve - Closure	245% RTP	NA	A.3	Q, M-10, 24 months, P-16, LE.1
10. Deleted				
9. 11. Turbine Control Valve Fast Closure	10	NA	A.3	Q, M-10, 24 months, P-16
10. 12. Turbine Condenser Vacuum - Low	1, L.2	NA	A.3	Q, M-10, Q-12
11. 13. Reactor Mode Switch Shutdown Position	1, 2, 3, 4, 5, L.2	NA		P-15, 24 months, NA, LD.2
12. 14. Manual Scram	1, 2, 3, 4, 5, L.2	NA	M-8	NA, LD.2

add proposed Note (a) to Table 3.3.1.1-1

add proposed SR 3.3.1.1.13

add proposed SR 3.3.1.1.12

Note 1 to SR 3.3.1.1.14 SR 3.3.1.1.16

SR 3.3.1.1.8 SR 3.3.1.1.10 SR 3.3.1.1.15 CHANNEL FUNCTIONAL TEST (M) SR 3.3.1.1.5

SR 3.3.1.1.12 SR 3.3.1.1.16 CHANNEL CALIBRATION

A.11

ITS 3.3.1.1

RPS 3/4.1.A

A.1

ITS.3.3.1.1

REACTOR PROTECTION SYSTEM

3.3.1.1-1

RPS 3/4.1.A

TABLE 3.3.1.1-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

TABLE NOTATION

Note 1
R 3.3.1.1.14
R 3.3.1.1.16

(a) Neutron detectors may be excluded from the CHANNEL CALIBRATION. LA.3

SR 3.3.1.1.6

(b) The IRM and SRM channels shall be determined to overlap for at least 1/2 decades during each startup after entering OPERATIONAL MODE 2 and the IRM and APRM channels shall be

SR 3.3.1.1.7

determined to overlap for at least 1/2 decades during each controlled shutdown, if not performed within the previous 7 days. LA.3 A.12

SR 3.3.1.1.4

(c) Within 24 hours prior to startup, if not performed within the previous 7 days. The weekly CHANNEL FUNCTIONAL TEST may be used to fulfill this requirement.

SR 3.3.1.1.2

(d) This calibration shall consist of the adjustment of the APRM CHANNEL to conform, within 2% of RATED THERMAL POWER, to the power values calculated by a heat balance during OPERATIONAL MODE 1 when THERMAL POWER is ≥ 25% of RATED THERMAL POWER. This adjustment must be accomplished: a) within 2 hours if the APRM CHANNEL is indicating lower power values than the heat balance, or b) within 12 hours if the APRM CHANNEL is indicating higher power values than the heat balance. And if any required APRM adjustment has been accomplished, notification shall be posted on the reactor control panel. L.11 L.7

ACTIONS Note 2

SR 3.3.1.1.2 Note

Any APRM CHANNEL gain adjustment made in compliance with Specification 3.11.B shall not be included in determining the above difference. This calibration is not required when THERMAL POWER is < 25% of RATED THERMAL POWER. The provisions of Specification 4.0.D are not applicable. Not required to be performed until 12 hours after THERMAL POWER ≥ 25% RTP

SR 3.3.1.1.3

(e) This calibration shall consist of the adjustment of the APRM flow biased channel to conform to a calibrated flow signal.

SR 3.3.1.1.9

(f) The LPRMs shall be calibrated at least once per 2000 effective full power hours (EFPH).

g) Deleted.

SR 3.3.1.1.11

(h) Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table. 92 A.3

SR 3.3.1.1.16

(i) This function is not required to be OPERABLE when the reactor pressure vessel head is unbolted or removed per Specification 3.12.A. A.6 L.4

Table 3.3.1.1-1 footnote (a)

(j) With any control rod withdrawn. Not applicable to control rods removed per Specification 3.10.1 or 3.10.4. A.9

(k) This function may be bypassed, provided a control rod block is actuated, for reactor protection system reset in Refuel and Shutdown positions of the reactor mode switch. L.4

A.1

ITS 3.3.1.1

REACTOR PROTECTION SYSTEM

3.3.1.1-1

RPS 3.4.1.A

TABLE 4.1.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

Functions Band 9 Applicability

(l) With THERMAL POWER greater than or equal to 45% of RATED THERMAL POWER. A.5 moved to ITS 3.10.7

(m) Required to be OPERABLE only prior to and during required SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

(n) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required. A.6

SR 3.3.1.1.4
SR 3.3.1.1.14
SR 3.3.1.1.16 (o) The provisions of Specification 4.0.D are not applicable to the CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION surveillances for a period of 24 hours after entering OPERATIONAL MODE 2 or 3 when shutting down from OPERATIONAL MODE 1.

(p) A current source provides an instrument channel alignment every 3 months. A.8

(q) The CHANNEL CHECK frequency will remain NA and the CHANNEL CALIBRATION frequency will remain Q for Functional Unit 3 until instrument upgrades are completed (Design Change Package Nos. 9900090 for Unit 1 and 9900091 for Unit 2). A.16

SR 3.3.1.1.5 (r) A Functional Test of each automatic Scram contactor will be performed on a surveillance frequency of W. A.3

A.1

REACTOR PROTECTION SYSTEM

<see ITS 3.3.1.1>

RPS 3.4.1.A

TABLE 4.1.A-1 (Continued)

REACTOR PROTECTION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

(l) With THERMAL POWER greater than or equal to 45% of RATED THERMAL POWER.

LC03.10.7.4

(m) Required to be OPERABLE only prior to and during required SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

A.8

(n) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

(o) The provisions of Specification 4.0.D are not applicable to the CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION surveillances for a period of 24 hours after entering OPERATIONAL MODE 2 or 3 when shutting down from OPERATIONAL MODE 1.

(p) A current source provides an instrument channel alignment every 3 months.

(q) The CHANNEL CHECK frequency will remain NA and the CHANNEL CALIBRATION frequency will remain Q for Functional Unit 3 until instrument upgrades are completed (Design Change Package Nos. 9900090 for Unit 1 and 9900091 for Unit 2).

(r) A Functional Test of each Automatic Scram contactor will be performed on a surveillance frequency of W.

A.10

<see ITS 3.3.1.1>

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

A. Isolation Actuation

A. Isolation Actuation

LC03.3.6.1 The isolation actuation instrumentation CHANNEL(s) shown in Table 3.2.A-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

Allowable Values A.7

APPLICABILITY:

As shown in Table 3.2.A-1.

ACTION:

add proposed ACTIONS Note A.2

ACTIONS A and B

1. With an isolation actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.A-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value A.7

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) within one hour.

Insert CTS 3.2.A Actions 2

A.3

A.3

Insert CTS 3.2.A footnote a

^a An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within 2 hours or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

Note 1 to Surveillance Requirements
1. Each isolation actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.A-1.

SR3.3.6.1.6
2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

24 LD.1

INSTRUMENTATION

A.1

ITS 3.3.6.2
Isolation Actuation 3/4.2.A

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

A. Isolation Actuation

A. Isolation Actuation

L103362
The isolation actuation instrumentation CHANNEL(s) shown in Table 3.2.A-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

Note 1
to Surveillance Requirements
1. Each isolation actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.A-1.

Allowable Value
A.6

APPLICABILITY:

As shown in Table 3.2.A-1.

add proposed ACTIONS Note A.2

ACTION:

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

24 LD.1

ACTIONS A and B

1. With an isolation actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.A-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value A.6

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^a within one hour.

A.3
add CTS 3.2.A Actions 2

A.3
Insert CTS 3.2.A Note a

^a An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within 2 hours or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

INSTRUMENTATION

A.1

ITS 3.3.7.1

Isolation Actuation 3/4.2.A

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

A. Isolation Actuation

A. Isolation Actuation

LC0 3.3.7.1 The isolation actuation instrumentation CHANNEL(s) shown in Table 3.2.A-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip/Setpoint column.

Note 1 to Surveillance Requirements

1. Each isolation actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.A-1.

APPLICABILITY:

Allowable Value A.2

As shown in Table 3.2.A-1.

SR 3.3.7.1.6

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

24 LD.1

ACTION:

1. With an isolation actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip/Setpoint column of Table 3.2.A-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip/Setpoint value.

ACTION A

add proposed ACTIONS Note A.3

Allowable Value A.2

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^a within one hour.

Insert CTS 3.2.A Action 2. A.4

Insert CTS 3.2.a footnote (a) A.4

^a An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within 2 hours or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

3. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEMS, place at least one TRIP SYSTEM^(b) in the tripped condition^(c) within one hour and take the ACTION required by Table 3.2.A-1.

Insert CTS 3.2.A Action 2

A.3

A.3

b If more CHANNEL(s) are inoperable in one TRIP SYSTEM than in the other, select the TRIP SYSTEM with the greater number of inoperable CHANNEL(s) to place in the tripped condition except when this would cause the trip function to occur; if both TRIP SYSTEM(s) have the same number of inoperable CHANNEL(s), place either TRIP SYSTEM in the tripped condition.

A.3

c An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within one hour or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

3. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEMS, place at least one TRIP SYSTEM in the tripped condition within one hour and take the ACTION required by Table 3.2.A-1.

Insert CTS 3.2.A
Action 2

A.3

A.3

b If more CHANNEL(s) are inoperable in one TRIP SYSTEM than in the other, select the TRIP SYSTEM with the greater number of inoperable CHANNEL(s) to place in the tripped condition except when this would cause the trip function to occur. If both TRIP SYSTEM(s) have the same number of inoperable CHANNEL(s), place either TRIP SYSTEM in the tripped condition.

c An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within one hour or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

A.3

A.1

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

3. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEMS, place at least one TRIP SYSTEM in the tripped condition^(a) within one hour and take the ACTION required by Table 3.2.A-1.

Insert CTS 3.2.A
Action 3

A.4

b If more CHANNEL(s) are inoperable in one TRIP SYSTEM than in the other, select the TRIP SYSTEM with the greater number of inoperable CHANNEL(s) to place in the tripped condition except when this would cause the trip function to occur; if both TRIP SYSTEM(s) have the same number of inoperable CHANNEL(s), place either TRIP SYSTEM in the tripped condition.

A.4

c An inoperable CHANNEL need not be placed in the tripped condition where this would cause the trip function to occur. In these cases, the inoperable CHANNEL shall be restored to OPERABLE status within one hour or the ACTION required by Table 3.2.A-1 for that trip function shall be taken.

A.4

A.3

ITS 3.3.6

Insert CTS 3.2.A Action 2

Insert 5, Pages 3/4.2-1, 3/4.2-2

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement:

- ACTION B a) Within 1 hour, verify sufficient CHANNELS remain OPERABLE or in the tripped condition to ensure automatic isolation capability.
 - ACTION A b) Within 12 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units common to RPS: 1a, 1b, 2a, 2b, 3a, 3b, 4b, and 7a, and
 - c) Within 24 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units not common to RPS.
- OR

A.5

Moved to
ITS 3.3.6.2
ITS 3.3.7.1

A.6

ACTION C { Take the ACTION required by Table 3.2.A-1.

A.3

LA.1

Insert CTS 3.2.A footnote (a)

a

ACTION C (An inoperable channel need not be placed in the tripped condition where this would cause the Trip Function to occur) In these cases, if the inoperable channel is not restored to OPERABLE status within the required time, the ACTION required by Table 3.2.A-1 for the Functional Unit shall be taken.

A.3

ITS 3.3.6.2

Insert CTS 3.2.A Action 2

Insert 5, Pages 3/4.2-1, 3/4.2-2

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement:

ACTION B

a) Within 1 hour, verify sufficient CHANNELS remain OPERABLE or in the tripped condition to ensure automatic isolation capability.

ACTION A

b) Within 12 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units common to RPS: 1a, 1b, 2a, 2b, 3a, 3b, 4b, and 7a and
c) Within 24 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units not common to RPS.

see ITS 3.3.6.1

OR

ACTION C { Take the ACTION required by Table 3.2.A-1.

A.3

LA.1

Insert CTS 3.2.A Note a

a An inoperable channel need not be placed in the tripped condition where this would cause the Trip Function to occur. In these cases, if the inoperable channel is not restored to OPERABLE status within the required time, the ACTION required by Table 3.2.A-1 for the Functional Unit shall be taken.

ACTION C

A.4

Insert CTS 3.2.A Action 2

ITS 3.3.7.1

Insert 5. Pages 3/4.2-1, 3/4.2-2

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement:

ACTIONS A, B, and C

Required Action B.1 and C.1

Required Action C.2

Required Action B.2

- a) Within 1 hour, verify sufficient CHANNELS remain OPERABLE or in the tripped condition to ensure automatic isolation capability.
- b) Within 12 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units common to RPS: 1a, 1b, 2a, 2b, 3a, 3b, 4b, and 7a and
- c) Within 24 hours, place the inoperable CHANNEL(s) and/or TRIP SYSTEM in the tripped condition^(a) for Table 3.2.A-1 Functional Units not common to RPS.

See ITS 3.3.6.1

OR

ACTION D

Take the ACTION required by Table 3.2.A-1.

A.4

Insert CTS 3.2.A Note a

LA.1

a

An inoperable channel need not be placed in the tripped condition where this would cause the Trip Function to occur. In these cases, if the inoperable channel is not restored to OPERABLE status within the required time, the ACTION required by Table 3.2.A-1 for the Functional Unit shall be taken.

ACTION D

TABLE 3.2.A-1 (3.3.6.1)

ISOLATION ACTUATION INSTRUMENTATION

Note 2 to Surveillance Requirements

QUAD CITIES - UNITS 1 & 2

3/4.2-3

Function Functional Unit	Allowable Value	Trip Setpoints	Minimum CHANNEL(s) per TRIP SYSTEM	Applicable OPERATIONAL MODE(s)	ACTION
2. 1. PRIMARY CONTAINMENT ISOLATION					
2.a a. Reactor Vessel Water Level - Low		≥144 inches	2	1, 2, 3	G 20
2.b b. Drywell Pressure - High		≤2.5 psig	2	1, 2, 3	G 20
2.c c. Drywell Radiation - High		≤100 R/hr	1	1, 2, 3	F 23

2. SECONDARY CONTAINMENT ISOLATION

a. Reactor Vessel Water Level - Low ^(c,k)	≥144 inches	2	1, 2, 3 & *	24
b. Drywell Pressure - High ^(c,d,k)	≤2.5 psig	2	1, 2, 3	24
c. Reactor Building Ventilation Exhaust Radiation - High ^(c,k)	≤10 mR/hr	2	1, 2, 3 & **	24
d. Refueling Floor Radiation - High ^(c,k)	≤100 mR/hr	2	1, 2, 3 & **	24

1. 3. MAIN STEAM LINE (MSL) ISOLATION

1.a a. Reactor Vessel Water Level - Low Low	≥84 inches	2	1, 2, 3	D 21
b. MSL Tunnel Radiation - High ^(b)	≤15 ^(m) x normal background	2	1, 2, 3	21
1.b c. MSL Pressure - Low	≥825 psig	2	1	E 22
1.d d. MSL Flow - High	≤140% of rated	2/line	1, 2, 3	D 21
1.e e. MSL Tunnel Temperature - High	≤200°F	2 of 4 in each of 2 sets	1, 2, 3	D 21

add proposed Function 1.c

Amendment Nos. 171 & 167
Page 4 of 12

ITS 3.3.6.1
Isolation Actuation 3/4.2.A

A.7

A.2

LF.1

A.4

A.5

A.1

A.6

LF.1

A.11

2 per string

moved to ITS 3.3.7.1

≥144 inches
≤2.5 psig
≤100 R/hr

≥84 inches

≥825 psig
≤140% of rated
≤200°F

2 of 4 in each of 2 sets

moved to ITS 3.3.6.2 3.3.7.1

336.2-1
TABLE 3.2.A-1

ISOLATION ACTUATION INSTRUMENTATION

Functional Unit	Allowable Value	Trip Setpoint	Minimum CHANNEL(s) per TRIP SYSTEM ^(M)	Applicable OPERATIONAL MODE(s)	ACTION
1. PRIMARY CONTAINMENT ISOLATION					
a. Reactor Vessel Water Level - Low	≥144 inches		2	1, 2, 3	20
b. Drywell Pressure - High ^(M)	≤2.5 psig		2	1, 2, 3	20
c. Drywell Radiation - High	≤100 R/hr		1	1, 2, 3	23
2. SECONDARY CONTAINMENT ISOLATION					
1 a. Reactor Vessel Water Level - Low ^(c, M)	≥144 inches		2	1, 2, 3 & L.1	C 24
2 b. Drywell Pressure - High ^(c, M)	≤2.5 psig		2	1, 2, 3	C 24
3 c. Reactor Building Ventilation Exhaust Radiation - High ^(c, M)	≤10 mR/hr		2	1, 2, 3 & **	C 24
4 d. Refueling Floor Radiation - High ^(c, M)	≤100 mR/hr		2	1, 2, 3 & **	C 24
3. MAIN STEAM LINE (MSL) ISOLATION					
a. Reactor Vessel Water Level - Low Low	≥84 inches		2	1, 2, 3	21
b. MSL Tunnel Radiation - High ^(M)	≤15 ^(M) x normal background		2	1, 2, 3	21
c. MSL Pressure - Low	≥825 psig		2	1	22
d. MSL Flow - High ^(M)	≤140% of rated		2/line	1, 2, 3	21
e. MSL Tunnel Temperature - High	≤200°F		2 of 4 in each of 2 sets	1, 2, 3	21

← See ITS 3.3.6.1 →

A.6

LA.2

LF.1

L.1

M.1

add CORE ALTERATIONS

add during OPDRVs

M.2

A.1

INSTRUMENTATION

ITS 3.3.6.2
Isolation Actuation 3/4.2.A

← See ITS 3.3.6.1 →

3.3.7.1-1

TABLE 3.2.A-1

ISOLATION ACTUATION INSTRUMENTATION

Note 2
to Surveillance
Requirements

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Functional Unit	Allowable Value	Trip Setpoint	Minimum CHANNEL(s) per TRIP SYSTEM	Applicable OPERATIONAL MODE(s)	ACTION
1. PRIMARY CONTAINMENT ISOLATION					
a. Reactor Vessel Water Level - Low	≥144 inches		2	1, 2, 3	20
b. Drywell Pressure - High ^(A)	≤2.5 psig		2	1, 2, 3	20
c. Drywell Radiation - High	≤100 R/hr		1	1, 2, 3	23
<i>CREV System Isolation Instrumentation</i>					
2. SECONDARY CONTAINMENT ISOLATION					
a. Reactor Vessel Water Level - Low ^(A)	≥144 inches		2	1, 2, 3 & *	C (24)
b. Drywell Pressure - High ^(A)	≤2.5 psig		2	1, 2, 3	C (24)
c. Reactor Building Ventilation Exhaust Radiation - High ^(A)	≤10 mR/hr		2	1, 2, 3 & **	B (24)
d. Refueling Floor Radiation - High ^(A)	≤100 mR/hr		2	1, 2, 3 & **	B (24)
3. MAIN STEAM LINE (MSL) ISOLATION					
a. Reactor Vessel Water Level - Low Low	≥84 inches		2	1, 2, 3	21
b. MSL Tunnel Radiation - High ^(M)	≤15 ^(M) x normal background		2	1, 2, 3	21
c. MSL Pressure - Low	≥825 psig		2	1	22
d. MSL Flow - High ^(M)	≤140% of rated		2/line	1, 2, 3	B (21)
e. MSL Tunnel Temperature - High	≤200°F		2 of 4 in each of 2 sets	1, 2, 3	21

Allowable Value A.2

LA.2

A.5

1
2
5
3/4.2.3

Sec ITS 3.3.6.1

4

Sec ITS 3.3.6.1

Page 4 of 9

A.5


Amendment Nos. 3

171 & 167

Sec ITS 3.3.6.1

Isolation Actuation 3/4.2.A

ITS 3.3.7.1



3.3.6.1-1
TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

Function Functional Unit	Allowable Value	Trip Setpoint	Minimum CHANNEL(s) per TRIP SYSTEM	Applicable OPERATIONAL MODE(s)	ACTION
4. REACTOR WATER CLEANUP SYSTEM ISOLATION					
5.a a. Standby Liquid Control System Initiation	NA	NA	NA	1, 2, 3	H 23
5.b b. Reactor Vessel Water Level - Low	≥144 inches	≥144 inches	2	1, 2, 3	F 23
5. REACTOR CORE ISOLATION COOLING ISOLATION					
4.a a. Steam Flow - High	≤300% of rated steam flow	≤300% of rated steam flow	1	1, 2, 3	F 23
4.c b. Reactor Vessel Pressure - Low	≥60 psig	≥60 psig	2	1, 2, 3	F 23
4.d c. Area Temperature - High	≤170°F	≤170°F	2	1, 2, 3	F 23
6. HIGH PRESSURE COOLANT INJECTION ISOLATION					
3.a a. Steam Flow - High	≤300% of rated steam flow	≤300% of rated steam flow	1	1, 2, 3	F 23
3.c b. Reactor Vessel Pressure - Low	≥100 psig	≥100 psig	2	1, 2, 3	F 23
3.e c. Area Temperature - High	≤170°F	≤170°F	2	1, 2, 3	F 23

Note 2 to Surveillance Requirements

Minimum CHANNEL(s) per TRIP SYSTEM

Applicable OPERATIONAL MODE(s)

ACTION

Allowable Value

A.7

LA.2

Trip Setpoint

M.3

L.2

M.4

add proposed Function 4.b

Note (a) to Table 3.3.6.1-1

add proposed Function 3.b

add Function 3.d

M.2

3.3.6.1-1

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

Note 2 to Surveillance Requirement

<u>Functional Unit</u>	<p>Allowable Value A.7 Trip Setpoint LA.2</p>	<u>Minimum CHANNEL(s) per TRIP SYSTEM[ⓐ]</u>	<u>Applicable OPERATIONAL MODE(s)</u>	<u>ACTION</u>
6 7. <u>RHR SHUTDOWN COOLING MODE ISOLATION</u>				
6.b a. Reactor Vessel Water Level - Low	<p>≥144 inches</p>	<p>Note (b) to Table 3.3.6.1-1 2[ⓑ]</p>	3, 4, 5	<p>I 23 L.3</p>
6.c b. Reactor Vessel Pressure - High (Cut-in Permissive)	<p>≤135 psig</p> <p>L.F.1</p>	2	1, 2, 3	F 23

INSTRUMENTATION

A.1

ITS 3.3.6.1
Isolation Actuation 3/4.2.A

3.3.6.1-1 A.1

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

ACTION

G ACTION 20 - Be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours. [L4] 12

D ACTION 21 - Be in at least ~~STARTUP~~ with the associated isolation valves closed within 8 hours or be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

E ACTION 22 - Be in at least STARTUP within 8 hours.

H/F ACTION 23 - Close the affected system isolation valves within one hour and declare the affected system inoperable.

[L.2] for SLC Initiation Function
[A.8]

ACTION 24 - Establish SECONDARY CONTAINMENT INTEGRITY with the standby gas treatment system operating within one hour.

add proposed ACTION G [L.1]

[A.5] moved to ITS 3.3.6.2

A.1

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

ACTION

(see ITS 3.3.6.1)

ACTION 20 - Be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

ACTION 21 - Be in at least STARTUP with the associated isolation valves closed within 8 hours or be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

ACTION 22 - Be in at least STARTUP within 8 hours.

ACTION 23 - Close the affected system isolation valves within one hour and declare the affected system inoperable.

ACTION
C

ACTION 24 - Establish SECONDARY CONTAINMENT INTEGRITY with the standby gas treatment system operating within one hour.

A.4

add proposed
Required Actions C.1.2
and C.2.2

L.2

TABLE 3.2.A-1 (Continued)
2.3.7.1

ISOLATION ACTUATION INSTRUMENTATION

ACTION

<see ITS 3.3.6.1>

ACTION 20 - Be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

L.1

ACTION D

ACTION 21 - Be in at least STARTUP with the associated isolation valves closed within 6 hours or be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

1

<see ITS 3.3.6.1>

ACTION 22 - Be in at least STARTUP within 8 hours.

ACTION 23 - Close the affected system isolation valves within one hour and declare the affected system inoperable.

ACTION D

ACTION 24 - Establish SECONDARY CONTAINMENT INTEGRITY with the standby gas treatment system operating within one hour.

add proposed Required Actions D.1 and D.3

M.1

<see ITS 3.3.6.2>

add proposed Required Actions D.1 and D.3

L.1

3.3.6.1-1 [A.1]

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

moved to
ITS 3.3.6.2
ITS 3.3.7.1
[A.5]

TABLE NOTATION

[A.3]

- During CORE ALTERATIONS or operations with a potential for draining the reactor vessel.
- When handling irradiated fuel in the secondary containment.

Insert CTS Table 3.2.A-1 Note (a)

(a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains isolation actuation capability.

[A.6]

(b) Also trips the mechanical vacuum pump and isolates the steam jet air ejectors.

[A.5]

(c) Isolates the reactor building ventilation system and actuates the standby gas treatment system.

moved to
ITS 3.3.6
3.3.7.1

(d) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

[A.4]

Note (a)
to Table
3.2.A-1

(e) Only one TRIP SYSTEM.

[LA.3]

[A.9]

(f) Closes only reactor water cleanup system isolation valves.

Note b
to Table
3.3.6.1-1

(g) Only one trip system required in OPERATIONAL MODE(s) 4 and 5 with RHR Shutdown Cooling System integrity maintained. System integrity is maintained provided the piping is intact and no maintenance is being performed that has the potential for draining the reactor vessel through the system.

[LA.4]

(h) Normal background is as measured during full power operation without hydrogen being injected.

[A.6]

Allowable
Value
Functions
3.4, 4.b

(i) Includes a time delay of $3 \leq t \leq 9$ seconds.

[LF.1]

(j) Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).

[LA.2]

(k) Also isolates the control room ventilation system.

[A.5]

moved to
ITS 3.3.7.1

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

L.1

TABLE NOTATION

Note (a) to Table 3.3.6.2-1
Note (b) to Table 3.3.6.2-1

During **CORE ALTERATIONS** or operations with a potential for draining the reactor vessel.

When handling irradiated fuel in the secondary containment.

add CORE ALTERATIONS M.1

A.3

Insert CTS Table 3.2.A-1 Note (a)

- (a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains isolation actuation capability. (see ITS 3.3.6.1)
- (b) Also trips the mechanical vacuum pump and isolates the steam jet air ejectors.
- (c) Isolates the reactor building ventilation system and actuates the standby gas treatment system. LA.3
- (d) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required. A.5
- (e) Only one TRIP SYSTEM. (see ITS 3.3.6.1)
- (f) Closes only reactor water cleanup system isolation valves.
- (g) Only one trip system required in OPERATIONAL MODE(s) 4 and 5 with RHR Shutdown Cooling System integrity maintained. System integrity is maintained provided the piping is intact and no maintenance is being performed that has the potential for draining the reactor vessel through the system.
- (h) Normal background is as measured during full power operation without hydrogen being injected.
- (i) Includes a time delay of $3 \leq t \leq 9$ seconds. LA.2
- (j) Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).
- (k) Also isolates the control room ventilation system. (see ITS 3.3.6.1)

A.1

ITS 3.3.7.1
Isolation Actuation 3/4.2.A

INSTRUMENTATION

Table 3.3.7.1-1

TABLE 3.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION

TABLE NOTATION

Table 3.3.7.1-1
Notes
(A)
(B)

L.2

M.2

add CORE ALTERATIONS

- During CORE ALTERATIONS or operations with a potential for draining the reactor vessel.
- When handling irradiated fuel in the secondary containment.

Insert Table 3.2.A-1
foot note (a)

A.4

(a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains isolation actuation capability.

(b) Also trips the mechanical vacuum pump and isolates the steam jet air ejectors.

(c) Isolates the reactor building ventilation system and actuates the standby gas treatment system.

A.6

(d) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

see ITS 3.3.6.1

(e) Only one TRIP SYSTEM.

(f) Closes only reactor water cleanup system isolation valves.

(g) Only one trip system required in OPERATIONAL MODE(s) 4 and 5 with RHR Shutdown Cooling System integrity maintained. System integrity is maintained provided the piping is intact and no maintenance is being performed that has the potential for draining the reactor vessel through the system.

(h) Normal background is as measured during full power operation without hydrogen being injected.

(i) Includes a time delay of $3 \leq t \leq 9$ seconds.

(j) Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).

LA.2

(k) Also isolates the control room ventilation system.

LA.3

A.3

ITS 3.3.6.1

Insert CTS Table 3.2.A.1 Note a

Insert 6, Page 3/4.2-7

- (a) { When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains isolation actuation capability.

Note 2 to
Surveillance
Requirements

A.3

Insert 6. Page 3/4.2-7

- (a) { When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains isolation actuation capability.

Note 2
to Surveillance
Requirements

A.4

Insert Table 32.A-1 footnote a

Insert 6. Page 3/4.2-7

- (a) When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains isolation actuation capability.

Note 2
to Surveillance
Requirements

TABLE 4.2.A-1 3.3.6.1-1

ISOLATION ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

INSTRUMENTATION

Functional Unit	SR 3.3.6.1.1 CHANNEL CHECK	SR 3.3.6.1.2 CHANNEL FUNCTIONAL TEST	SR 3.3.6.1.3 SR 3.3.6.1.4 SR 3.3.6.1.5 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
2. 1. PRIMARY CONTAINMENT ISOLATION				
2.a a. Reactor Vessel Water Level - Low	S-1	A.3 M-Q -2	S E-3	1, 2, 3 LE.1
2.b b. Drywell Pressure - High A.4	NA	M-Q -2	Q-4	1, 2, 3
2.c c. Drywell Radiation - High	S-1	M-Q -2	E-5	1, 2, 3 A.5
2. SECONDARY CONTAINMENT ISOLATION				
a. Reactor Vessel Water Level - Low ^(c,d)	S	A.3 M-Q	E-3	1, 2, 3 & * A.1
b. Drywell Pressure - High ^(b,c,d)	NA	M-Q	Q	1, 2, 3
c. Reactor Building Ventilation Exhaust Radiation - High ^(c,d)	S	M-Q	Q	1, 2, 3 & **
d. Refueling Floor Radiation - High ^(c,d)	S	M-Q	Q	1, 2, 3 & **
3. MAIN STEAM LINE (MSL) ISOLATION				
1.a a. Reactor Vessel Water Level - Low Low	S-1	A.3 M-Q -2	S E-3	1, 2, 3 A.6
b. MSL Tunnel Radiation - High	S	M-Q	E-3	1, 2, 3
1.b c. MSL Pressure - Low	NA	M-Q -2	Q-4	1
1.4 d. MSL Flow - High A.5	S-1	M-Q -2	E-Q M.5	1, 2, 3
1.e e. MSL Tunnel Temperature - High	NA	E A.10	B-5	1, 2, 3

add proposed Function 1.c Surveillances M.1

24 months
L.D.1

24 months
LE.1

moved to
ITS
3.3.6.2
3.3.7.1

ITS 3.3.6.1
Isolation Actuation 3/4.2.A

Table 3.3.6.2-1

TABLE 4.2.A-1

ISOLATION ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Functional Unit	SR 3.3.6.2.1 CHANNEL CHECK	SR 3.3.6.2.2 CHANNEL FUNCTIONAL TEST	SR 3.3.6.2.3 SR 3.3.6.2.4 SR 3.3.6.2.5 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
-----------------	-------------------------------	---	---	--------------------------------

1. PRIMARY CONTAINMENT ISOLATION

a. Reactor Vessel Water Level - Low	S	M	E ¹⁰	1, 2, 3
b. Drywell Pressure - High TM	NA	M	Q	1, 2, 3
c. Drywell Radiation - High	S	M	E	1, 2, 3

A.1.1

2. SECONDARY CONTAINMENT ISOLATION

7.5

3/4.2-8

a. Reactor Vessel Water Level - Low TM	S - 1	M Q - 2	E ¹⁰ - 3	1, 2, 3 & 4
b. Drywell Pressure - High TM	NA	M Q - 2	Q - 4	1, 2, 3
c. Reactor Building Ventilation Exhaust Radiation - High TM	S - 1	M Q - 2	Q - 4	1, 2, 3 & 4
d. Refueling Floor Radiation - High TM	S - 1	M Q - 2	Q - 4	1, 2, 3 & 4

LA.3

A.3

24 months

LE.1

L.1

add CORE ALTERATIONS

M.1

add during OPDRS

M.2

3. MAIN STEAM LINE (MSL) ISOLATION

a. Reactor Vessel Water Level - Low Low	S	M	E ¹⁰	1, 2, 3
b. MSL Tunnel Radiation - High	S	M	E ¹⁰	1, 2, 3
c. MSL Pressure - Low	NA	M	Q	1
d. MSL Flow - High TM	S	M	E	1, 2, 3
e. MSL Tunnel Temperature - High	NA	E	E	1, 2, 3

See ITS 3.3.6.1

ITS 3.3.6.2
Isolation Actuation 3/4.2.A

Table 3.3.7.1

TABLE 4.2.A-1

ISOLATION ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Function Functional Unit	SR 3.3.7.1.1 CHANNEL CHECK	SR 3.3.7.1.2 CHANNEL FUNCTIONAL TEST	SR 3.3.7.1.3 SR 3.3.7.1.4 SR 3.3.7.1.5 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
-----------------------------	----------------------------------	---	--	--------------------------------------

1. PRIMARY CONTAINMENT ISOLATION

a. Reactor Vessel Water Level - Low	S	M	E ¹⁰	1, 2, 3
b. Drywell Pressure - High ¹⁰	NA	M	Q	1, 2, 3
c. Drywell Radiation - High	S	M	E	1, 2, 3

CAEV System Isolation Instrumentation

2. SECONDARY CONTAINMENT ISOLATION

A.5

3/4.2-8

1 a. Reactor Vessel Water Level - Low ¹⁰ [LA.3]	S-1	(M) (Q) - 2	5 → 3	1, 2, 3 & *
2 b. Drywell Pressure - High ¹⁰ [A.6]	NA	(M) (Q) - 2	Q-4	1, 2, 3
5 c. Reactor Building/Ventilation Exhaust Radiation - High ¹⁰	S-1	(M) (Q) - 2	Q-4	1, 2, 3 & **
4 d. Refueling Floor Radiation - High ¹⁰ [LA.3]	S-1	(M) (Q) - 2	Q-4	1, 2, 3 & **

24 months

[E.1]

A.1

See ITS 3.3.6.1

3. MAIN STEAM LINE (MSL) ISOLATION

a. Reactor Vessel Water Level - Low Low	S	M	E ¹⁰	1, 2, 3
b. MSL Tunnel Radiation - High	S	M	E ¹⁰	1, 2, 3
c. MSL Pressure - Low	NA	M	Q	1
d. MSL Flow - High ¹⁰ [LA.3]	S-1 [A.4]	(M) (Q) - 2	5 → 24 months	1, 2, 3 [E.1]
e. MSL Tunnel Temperature - High	NA	E	E	1, 2, 3

see ITS 3.3.6.1

Page 8 of 9

Amendment Nos. 171 & 167

ITS 3.3.7.1
Isolation Actuation 3/4.2.A

3.3.6.1-1
TABLE 4.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

QUAD CITIES - UNITS 1 & 2

3/4.2-9

Amendment Nos. 171 & 167
Page 11 of 12

Functional Unit	SR 3.3.6.1.1 CHANNEL CHECK	SR 3.3.6.1.2 CHANNEL FUNCTIONAL TEST	SR 3.3.6.1.3 SR 3.3.6.1.4 SR 3.3.6.1.5 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
5 4. REACTOR WATER CLEANUP SYSTEM ISOLATION			(24 months) LD.1	
5.a a. Standby Liquid Control System Initiation	NA	SR 3.3.6.1.6 (E) A.10	NA	1, 2, 3 (L.2)
5.b b. Reactor Vessel Water Level - Low	S-1	A.3 (M) (Q) - 2	5 (E) - 3	1, 2, 3
4. 5. REACTOR CORE ISOLATION COOLING ISOLATION			(24 months) LE.1	
4.a a. Steam Flow - High (add proposed Functions 4.b)	NA	A.3 (M) (Q) - 2	Q - 4	1, 2, 3
4.c b. Reactor Vessel Pressure - Low (M.4)	NA	(M) (Q) - 2	Q - 4	1, 2, 3
4.d c. Area Temperature - High	NA	(E) A.10	(E) - 5	1, 2, 3
3 6. HIGH PRESSURE COOLANT INJECTION ISOLATION			(24 months) LD.1	
3.a a. Steam Flow - High (add proposed Function 3.b)	NA	A.3 (M) (Q) - 2	5 (E) - 3	1, 2, 3
3.c b. Reactor Vessel Pressure - Low (M.4)	NA	(M) (Q) - 2	5 (E) - 3	1, 2, 3
3.e c. Area Temperature - High (add proposed Function 3.d) (M.2)	NA	SR 3.3.6.1.6 (E) A.10	(E) - 5	1, 2, 3
6. 7. RHR SHUTDOWN COOLING MODE ISOLATION			(24 months) LE.1	
6.b a. Reactor Vessel Water Level - Low	S-1	A.3 (M) (Q) - 2	5 (E) - 3	3, 4, 5
6.a b. Reactor Vessel Pressure - High (Cut-in Permissive)	NA	(M) (Q) - 2	Q - 4	1, 2, 3

A.1

INSTRUMENTATION

A.1

ITS 3.3.7.1
Isolation Actuation 3/4.2.A

Table 3.3.7.1-1
TABLE 4.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

M.2

TABLE NOTATION

add CORE ALTERATIONS

Table 3.3.7.1-1
Notes

L.2

- (a) During CORE ALTERATIONS operations with a potential for draining the reactor vessel.
- (b) ** When handling irradiated fuel in the secondary containment.

92

A.4

SR 3.3.7.1.3 (a) Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table.

A.6

- (b) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.
- (c) Isolates the reactor building ventilation system and actuates the standby gas treatment system.
- (d) Also isolates the control room ventilation system.
- (e) These instrument channels will be calibrated using simulated electrical signals once every three months. In addition, calibration including the sensors will be performed every 18 months.

L.A.3

<see ITS 3.3.6.1>

<see ITS 3.3.6.1>

TABLE 4.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

A.5 moved to
ITS 3.3.6.2
ITS 3.3.7.1

TABLE NOTATION

- During CORE ALTERATIONS or operations with a potential for draining the reactor vessel.
- When handling irradiated fuel in the secondary containment.

SR 3.3.6.1.3

SR 3.3.6.1.5

92 A.3

(a) Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table.

A.4

(b) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

(c) Isolates the reactor building ventilation system and actuates the standby gas treatment system.

(d) Also isolates the control room ventilation system.

A.5 moved to ITS 3.3.6.2
ITS 3.3.7.1

(e) These instrument channels will be calibrated using simulated electrical signals once every three months. In addition, calibration including the sensors will be performed every 18 months.

A.6

TABLE 4.2.A-1 (Continued)

ISOLATION ACTUATION INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

TABLE NOTATION

L.1

add CORE ALTERATIONS - M.1

Note (a)

to Table 3.3.6.2-1

During CORE ALTERATIONS or operations with a potential for draining the reactor vessel.

Note (b) to

Table 3.3.6.2-1

When handling irradiated fuel in the secondary containment.

92 - A.3

SR 3.3.6.2.3

SR 3.3.6.2.5

(a) Trip units are calibrated at least once per 92 days and transmitters are calibrated at the frequency identified in the table.

A.5

(b) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

(c) Isolates the reactor building ventilation system and actuates the standby gas treatment system.

LA.3

(d) Also isolates the control room ventilation system.

<see ITS 3.3.6.1>

(e) These instrument channels will be calibrated using simulated electrical signals once every three months. In addition, calibration including the sensors will be performed every 18 months.

<see ITS 3.3.6.1>

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

B. Emergency Core Cooling Systems (ECCS) Actuation

B. ECCS Actuation

The ECCS actuation instrumentation CHANNEL(s) shown in Table 3.2.B-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

Note 1
to
Surveillance
Requirements

LC03351

Allowable Value - A.2

APPLICABILITY:

As shown in Table 3.2.B-1.

SR 3.3.5.1.8

1. Each ECCS actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.B-1.

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 24 months.

24 - LD.1

ACTION:

add proposed ACTIONS Note - A.3

1. With an ECCS actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.B-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

ACTION A

Allowable Value - A.2

2. With one or more ECCS actuation instrumentation CHANNEL(s) inoperable, take the ACTION required by Table 3.2.B-1.

ACTION A

A.8

~~3. With either ADS TRIP SYSTEM inoperable, restore the inoperable TRIP SYSTEM to OPERABLE status within:
a. 7 days provided that both the HPCI and RCIC systems are OPERABLE, or
b. 72 hours.
With the above provisions of this ACTION not met, be in at least HOT~~

INSTRUMENTATION

A.11

ECCS Actuation 3/4.2.B

LOP Instrumentation

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

A.2

B. Emergency Core Cooling Systems (ECCS) Actuation

B. (ECCS Actuation)

LOP Instrumentation


LCO 3.3.8.1

The (ECCS/actuation) instrumentation CHANNEL(s) shown in Table 3.2.B-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the (Trip Setpoint) column.

Note 1 to Surveillance Requirements

1. Each (ECCS/actuation) instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.B-1.

See ITS 3.3.5.1

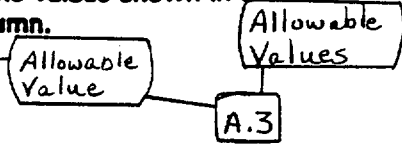

APPLICABILITY:

As shown in Table 3.2.B-1.

SR 3.3.8.1.3

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

24

LD.1

Add proposed ACTIONS Note

ACTION:

1. With an (ECCS/actuation) instrumentation CHANNEL trip setpoint less conservative than the value shown in the (Trip Setpoint) column of Table 3.2.B-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the (Trip Setpoint) value.

ACTION A

2. With one or more (ECCS/actuation) instrumentation CHANNEL(s) inoperable, take the ACTION required by Table 3.2.B-1.

3. With either ADS TRIP SYSTEM inoperable, restore the inoperable TRIP SYSTEM to OPERABLE status within:
a. 7 days provided that both the HPCI and RCIC systems are OPERABLE, or
b. 72 hours.
With the above provisions of this ACTION not met, be in at least HOT

ITS 3.3.5.1

ECCS Actuation 3/4.2.B

INSTRUMENTATION

A.1

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

SHUTDOWN within the next 12 hours
and reduce reactor steam dome
pressure to ≤ 150 psig within the
following 24 hours.

A.8

3.3.5.1-1
TABLE 3.2.B-1

EMERGENCY CORE COOLING SYSTEMS ACTUATION INSTRUMENTATION

Function Functional Unit	Allowable Values	Minimum CHANNEL(s) per Trip Function	Applicable OPERATIONAL MODE(s)	ACTION
1. CORE SPRAY (CS) SYSTEM				
1.a	Reactor Vessel Water Level - Low Low <i>add Gore Spray Pump Start - Time Delay Relay (Function 1.c)</i>	4	1, 2, 3, 4 ^(a) , 5 ^(a)	30 B
1.b	Drywell Pressure - High	4	1, 2, 3	30 B
1.c	Reactor Vessel Pressure - Low (Permissive)	2	1, 2, 3 4 ^(a) , 5 ^(a)	31 C 32 B
1.d	CS Pump Discharge Flow - Low (Bypass)	1/loop	1, 2, 3, 4 ^(a) , 5 ^(a)	33 E
2. LOW PRESSURE COOLANT INJECTION (LPCI) SUBSYSTEM				
2.a	Reactor Vessel Water Level - Low Low	4	1, 2, 3, 4 ^(a) , 5 ^(a)	30 B
2.b	Drywell Pressure - High	4	1, 2, 3	30 B
2.c	Reactor Vessel Pressure - Low (Permissive)	2	1, 2, 3 4 ^(a) , 5 ^(a)	31 C 32 B
2.f	LPCI Pump Discharge Flow - Low (Bypass)	1/loop	1, 2, 3, 4 ^(a) , 5 ^(a)	33 E

QUAD CITIES - UNITS 1 & 2

 3/4.2-13

 Amendment Nos. 171 & 167

 Page 3 of 17

M.1

A.2 *add Gore Spray Pump Start - Time Delay Relay (Function 1.c)*

LA.1 *Allowable Values*

LF.1 *Trip Setpoint*

A.5 *Note (b) to Table 3.3.5.1-1*

M.2 *≤ 874 gpm*

M.1 *add proposed Functions 2.d, 2.e, 2.g, 2.h, 2.i, 2.j, and 2.k*

Note 2 to Surveillance Requirement

Table 3.3.5.1-1 Note (a)

Table 3.3.5.1 Note (a)

INSTRUMENTATION

ITS 3.3.5.1
 ECCS Actuation 3/4.2.B

3.3.5.1-1
TABLE 3.2.B-1 (Continued)

Note 2 to Surveillance Requirements

ECCS ACTUATION INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

3.a
 3.b
 3.d
 3.e
 3.c
 3.f
 3.g

3/4.2-14

Page 4 of 17

Amendment Nos. 171 & 167

Functional Unit	Setpoint	Minimum CHANNEL(s) per Trip Function	Applicable OPERATIONAL MODE(s)	ACTION
3. HIGH PRESSURE COOLANT INJECTION (HPCI) SYSTEM				
a. Reactor Vessel Water Level - Low Low	≥84 inches	4	1, 2, 3	37 B
b. Drywell Pressure - High	≤2.5 psig	4	1, 2, 3	37 B
c. Condensate Storage Tank Level - Low	≥10,000 gal	2	1, 2, 3	35 D
d. Suppression Chamber Water Level - High	≤14'8" above bottom of chamber	2	1, 2, 3	35 D
e. Reactor Vessel Water Level - High (Trip)	≤201 inches	2	1, 2, 3	31 C
f. HPCI Pump Discharge Flow - Low (Bypass)	≥600 gpm	1	1, 2, 3	33 E
g. Manual Initiation	NA	1/system	1, 2, 3	34 C
4. AUTOMATIC DEPRESSURIZATION SYSTEM - TRIP SYSTEM 'A'				
a. Reactor Vessel Water Level - Low Low	≥84 inches	2	1, 2, 3	39 F
b. Drywell Pressure - High	≤2.5 psig	2	1, 2, 3	39 F
c. Initiation Timer	≤120 sec	1	1, 2, 3	31 G
d. Low Low Level Timer	≤9.0 min	1	1, 2, 3	31 G
e. CS Pump Discharge Pressure - High (Permissive)	≥100 psig & ≤150 psig	2 pumps	1, 2, 3	31 G
f. LPCI Pump Discharge Pressure - High (Permissive)	≥100 psig & ≤150 psig	2 pumps	1, 2, 3	31 G

A.2 Allowable Value

LA.1

Table 3.3.5.1 Note (c)

Trip Setpoint

Minimum CHANNEL(s) per Trip Function

Applicable OPERATIONAL MODE(s)

ACTION

LF.1

A.6

LA.2

LA.1


A.7

Table 3.3.5.1 Note (c)


A.6

LF.1

A.B



A.1



ECCS Actuation 3/4.2.B

75 3.3.5.1

QUAD CITIES - UNITS 1 & 2
3/4.2-15

33.5.1-1
TABLE 3.2.B-1 (Continued)

ECCS ACTUATION INSTRUMENTATION

Note 2 to Surveillance Requirements

Functional Unit	Trip Setpoint	Minimum CHANNEL(s) per Trip Function	Applicable OPERATIONAL MODE(s)	ACTION
5. AUTOMATIC DEPRESSURIZATION SYSTEM - TRIP SYSTEM 'B'				
5.a. Reactor Vessel Water Level - Low Low	> 84 inches	2	1, 2, 3	30 F
5.b. Drywell Pressure - High	< 2.5 psig	2	1, 2, 3	30 F
5.c. Initiation Timer	≤ 120 sec	1	1, 2, 3	31 G
5.d. Low Low Level Timer	≤ 9.0 min	1	1, 2, 3	31 G
5.e. CS Pump Discharge Pressure - High (Permissive)	> 100 psig & ≤ 150 psig	2 pumps	1, 2, 3	31 G
5.e.1. LPCI Pump Discharge Pressure - High (Permissive)	> 100 psig & ≤ 150 psig	2 pumps	1, 2, 3	31 G

	Trip Setpoint	Minimum CHANNEL(s) per Trip Function	Applicable OPERATIONAL MODE(s)	ACTION
6. LOSS OF POWER				
a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)	3045 ± 152 volts decreasing voltage	2/bus	1, 2, 3, 4 th , 5 th	36
b. 4.16 kv Emergency Bus Undervoltage (Degraded Voltage)	> 3845 volts (Unit 1) ^{low} > 3845 volts (Unit 2) ^{low}	2/bus	1, 2, 3, 4 th , 5 th	36

A.9 moved to ITS 338.1

Page 5 of 17

Amendment Nos. 1813, 179

INSTRUMENTATION

A.11

ECCS Actuation 3/4.2.B

ITS 335.1

Table 3.3.8.1-1
TABLE 3.2.B-1 (Continued)

A.2 — LOP

ECCS ACTUATION INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

Function Functional Unit	Trip Setpoint ^M	Minimum CHANNEL(s) per Trip Function ^M	Applicable OPERATIONAL MODE(s)	ACTION
5. AUTOMATIC DEPRESSURIZATION SYSTEM - TRIP SYSTEM 'B'				
a. Reactor Vessel Water Level - Low Low	> 84 inches	2	1, 2, 3	30
b. Drywell Pressure - High ^M	< 2.5 psig	2	1, 2, 3	30
c. Initiation Timer	≤ 120 sec	1	1, 2, 3	31
d. Low Low Level Timer	≤ 9.0 min	1	1, 2, 3	31
e. CS Pump Discharge Pressure - High (Permissive)	≥ 100 psig & ≤ 150 psig	1/pump	1, 2, 3	31
f. LPCI Pump Discharge Pressure - High (Permissive)	≥ 100 psig & ≤ 150 psig	1/pump	1, 2, 3	31

see
ITS 3.3.5.1

3/4.2-15

INSTRUMENTATION

M.1

A.3 — Allowable Value

Trip Setpoint

	Trip Setpoint	Minimum CHANNEL(s) per Trip Function	Applicable OPERATIONAL MODE(s)	ACTION
6. LOSS OF POWER				
1. a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)	3045 ± 152 volts decreasing/voltage	2/bus	1, 2, 3, 4 ^M , 5 ^M	LF.1 36 LA.1
2.a 2.b b. 4.16 kv Emergency Bus Undervoltage (Degraded Voltage)	≥ 3845 volts (Unit 1) ≥ 3845 volts (Unit 2)	2/bus	1, 2, 3, 4 ^M , 5 ^M	36 M.1 ECCS Actuation 3/4.2.B LOP Instrumentation A.2

and ≤ 3933 volts — M.2

Page 2 of 6

Amendment Nos. 181 & 179

ACTIONS A AND B

ITS 3.3.8.1

INSTRUMENTATION

A.1
3.3.S.1-1

ITS 3.3.15.1
ECCS Actuation 3/4.2.B

TABLE 3.2.B-1 (Continued)

ECCS ACTUATION INSTRUMENTATION

A.8

Insert ACTION 31

ACTION

Insert ACTION 30

ACTION 30 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

- a. With one CHANNEL inoperable, place the inoperable CHANNEL in the tripped condition within one hour or declare the associated ECCS system(s) inoperable.
- b. With more than one CHANNEL inoperable, declare the associated ECCS system(s) inoperable.

ACTION 31 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

- a. For ADS, declare the associated ADS TRIP SYSTEM inoperable.
- b. For CS, LPCI or HPCI, declare the associated ECCS system(s) inoperable.

A.13

ACTION 32 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within ~~one hour~~ 24 hours or declare associated ECCS pump inop.

ACTION B
ACTION H

A.B

Insert ACTION 33

ACTION 33 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour; restore the inoperable CHANNEL to OPERABLE status within 7 days or declare the associated ECCS system(s) inoperable.

ACTION 34 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, restore the inoperable CHANNEL to OPERABLE status within ~~24~~ 24 hours or declare the associated ECCS system(s) inoperable.

ACTION C
ACTION H

A.B

Insert ACTION 35

ACTION 35 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place at least one inoperable CHANNEL in the tripped condition within one hour or declare the HPCI system inoperable.

A.9

ACTION 36 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour, or declare the associated emergency diesel generator inoperable and take the ACTION required by Specification 3.9.A or 3.9.B, as appropriate.

moved to ITS 338.1

QUAD CITIES - UNITS 1 & 2

3/4.2-16

Amendment Nos. 171 & 167

Insert ACTION 37 and 38

A.8

A.8

ITS 33.5.1

Insert ACTION 30

Insert 8, Page 3/4.2-16

ACTION 30 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement (Action 30a only applies in OPERATIONAL MODES 1, 2 and 3):

ACTION B

Required Action B.1 (a.
Required Action B.3 (b.

Within one hour from discovery of loss of initiation capability declare the associated ECCS systems inoperable, AND
Place the inoperable CHANNEL(s) in the tripped condition within 24 hours or declare the associated ECCS system inoperable.

A.8

Insert ACTION 31

Insert 9, Page 3/4.2-16

ACTION 31 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION C For CS, LPCI and HPCI (Action 31a applies only in OPERATIONAL MODES 1, 2, and 3 for Functional Units 1.c and 2.c):

- a. Within one hour from discovery of loss of initiation capability declare the associated ECCS systems inoperable, AND
- b. Restore the inoperable CHANNEL(s) to OPERABLE status within 24 hours or declare the associated ECCS system(s) inoperable

ACTION H**ACTION G**

For ADS:

- a. Within one hour from discovery of loss of initiation capability in both ADS trip systems, declare the ADS relief valves inoperable, AND
- b. With RCIC or HPCI inoperable, restore the inoperable CHANNEL(s) to OPERABLE status within 96 hours or declare the ADS trip system(s) inoperable, AND

ACTION H

- c. With RCIC and HPCI OPERABLE, restore the inoperable CHANNEL(s) to OPERABLE status within 8 days or declare the ADS trip system(s) inoperable

ACTION H

A.8

ITS 3.3.I.1

Insert ACTION 33

Insert 10, Page 3/4.2-16

ACTION 33 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement (For Functional Units 1.d and 2.d, Action 33a only applies in OPERATIONAL MODES 1, 2 and 3):

ACTION E

- a. Within one hour from discovery of loss of initiation capability declare the associated ECCS system(s) inoperable, AND
- b. Restore the CHANNEL(s) to OPERABLE status within 7 days or declare the associated ECCS system(s) inoperable

ACTION H)

A.8

Insert ACTION 35

ITS 3.3.5.1

Insert 11, Page 3/4.2-16

ACTION 35 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION D

- a. Within one hour from discovery of loss of initiation capability, declare HPCI inoperable, AND
- b. Place the inoperable CHANNEL(s) in the tripped condition within 24 hours or declare the HPCI system inoperable

ACTION H)

add proposed
Required Action D.2.2

A.10

A. 8

Insert ITS 3.3.5.1

Insert ACTION 37

Insert 12, Page 3/4.2-16

ACTION 37 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION B
Required Action B.2
Required Action B.3

- a. Within one hour from discovery of loss of initiation capability declare HPCI inoperable, AND
- b. Place the inoperable CHANNEL(s) in the tripped condition within 24 hours or declare HPCI inoperable.

A.8

ITS 335.1

Insert ACTION 38

INSERT 13, Page 3/4.2-16

ACTION 38 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION F

a. Within one hour from discovery of loss of initiation capability in both ADS trip systems, declare the ADS relief valves inoperable AND

b. With RCIC or HPCI inoperable, place the inoperable CHANNEL(s) in the tripped condition within 96 hours or declare the ADS trip system(s) inoperable, AND


c. Place the inoperable CHANNEL(s) in the tripped condition within 8 days or declare the ADS trip system(s) inoperable

ACTION H

INSTRUMENTATION

A.1

Table 3.3.8.1-1
TABLE 3.2.B-1 (Continued)

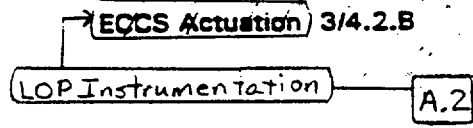

< See ITS 3.3.5.1 >

ACTION

- ACTION 30 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:
 - a. With one CHANNEL inoperable, place the inoperable CHANNEL in the tripped condition within one hour or declare the associated ECCS system(s) inoperable.
 - b. With more than one CHANNEL inoperable, declare the associated ECCS system(s) inoperable.
- ACTION 31 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:
 - a. For ADS, declare the associated ADS TRIP SYSTEM inoperable.
 - b. For CS, LPCI or HPCI, declare the associated ECCS system(s) inoperable.
- ACTION 32 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour.
- ACTION 33 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour; restore the inoperable CHANNEL to OPERABLE status within 7 days or declare the associated ECCS system(s) inoperable.
- ACTION 34 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, restore the inoperable CHANNEL to OPERABLE status within 8 hours or declare the associated ECCS system(s) inoperable.
- ACTION 35 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place at least one inoperable CHANNEL in the tripped condition within one hour or declare the HPCI system inoperable.

- ACTION 36 -** With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour, or declare the associated emergency diesel generator inoperable and take the ACTION required by Specification 3.9.A or 3.9.B, as appropriate. A.5

INSTRUMENTATION

A.1
3.3.5.1-1

ITS 3.3.5.1
ECCS Actuation 3/4.2.B

TABLE 3.2.B-1 (Continued)

ECCS ACTUATION INSTRUMENTATION

A.8

TABLE NOTATION

Insert CTS Table 3.2.B-1
Note (a)

(a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the associated Functional Unit maintains ECCS initiation capability.

Note (b) to
Table 3.3.5.1-1

(b) Also actuates the associated emergency diesel generator.

Note (a) to
Table 3.3.5.1-1

(c) When the system is required to be OPERABLE per Specification 3.5.B.

Note (c) to
Table 3.3.5.1-1

(d) Not required to be OPERABLE when reactor steam dome pressure is ≤ 150 psig.

(e) Required when the associated diesel generator is required to be OPERABLE per Specification 3.9.B.

A.9 moved to
ITS 3.3.8.1

(f) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

A.6

(g) With no LOCA signal present, there is an additional time delay of 5 ± 0.25 minutes.

A.9 moved
to ITS 3.3.8.1

(h) Reactor water level settings are expressed in inches above the top of active fuel (which is 380 inches above vessel zero).

LA.1

(i) Provides signal to pump suction valves only.

LA.2

(j) There is an inherent time delay of 7 ± 1.4 seconds on degraded voltage.

A.9 moved
to ITS 3.3.8.1

A.8

Insert CTS Table 3.2.B-1 Note (a)

Insert 14, Page 3/4.2-17

- (a) When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed as follows:
- 1) For up to six hours for Functional Units 3.e, 3.f, and 3.g; and
 - 2) For up to six hours for Functional Units other than 3.e, 3.f, and 3.g provided the functional unit maintains actuation capability.

Note 2 to Surveillance Requirements

INSTRUMENTATION

A.1

ECCS/Actuation 3/4.2.B

Table 3.3.8.1-1
TABLE 3.2.B-1 (Continued)

LOP Instrumentation A.2




TABLE NOTATION

(a) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the associated Functional Unit maintains ECCS initiation capability.

(b) Also actuates the associated emergency diesel generator.

(c) When the system is required to be OPERABLE per Specification 3.5.B.

(d) Not required to be OPERABLE when reactor steam dome pressure is ≤ 150 psig.

Applicability (e) Required when the associated diesel generator is required to be OPERABLE per Specification 3.9.B.

(f) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

Function 2.b (g) With no LOCA signal present, there is an additional time delay of 5 ± 0.25 minutes. LF.1

(h) Reactor water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).

(i) Provides signal to pump suction valves only. See ITS 3.3.5.1

Function 2.a (j) There is an inherent time delay of 7 ± 1.4 seconds on degraded voltage. LF.1

QUAD CITIES - UNITS 1 & 2

1
1.a
1.b
1.c
1.d

2.a
2.b
2.c
2.f

3/4.2-18

Amendment Nos.

171 & 167

Page 15 of 17

M.1
add Core Spray Pump
Time Start-Time Delay
Relay (Function 1.e)

3.3.5.1-1
TABLE 4.2.B-T

**ECCS ACTUATION INSTRUMENTATION
SURVEILLANCE REQUIREMENTS**

SR 3.3.5.1.2
SR 3.3.5.1.4

SR 3.3.5.1.3
SR 3.3.5.1.5
SR 3.3.5.1.6
SR 3.3.5.1.7

INSTRUMENTATION

Functional Unit	SR 3.3.5.1.1 CHANNEL CHECK	CHANNEL FUNCTIONAL TEST	CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
1. CORE SPRAY (CS) SYSTEM				
a. Reactor Vessel Water Level - Low Low	S-1	M-2	A.B. → E → B/M → 3	1, 2, 3, 4, 5
b. Drywell Pressure - High A.6	NA	Q-4	Q-6	1, 2, 3
c. Reactor Vessel Pressure - Low (Permissive)	NA	Q-4	Q-6	1, 2, 3, 4, 5
d. CS Pump Discharge Flow - Low (Bypass)	NA	Q-4	7-E → 5 24 months	1, 2, 3, 4, 5
2. LOW PRESSURE COOLANT INJECTION (LPCI) SUBSYSTEM				
a. Reactor Vessel Water Level - Low Low	S-1	M-2	A.B. → E → B/M → 3	1, 2, 3, 4, 5
b. Drywell Pressure - High A.6	NA	Q-4	Q-6	1, 2, 3
c. Reactor Vessel Pressure - Low (Permissive)	NA	Q-4	Q-6	1, 2, 3, 4, 5
d. LPCI Pump Discharge Flow - Low (Bypass)	NA	Q-4	7-E → 5 24 months	1, 2, 3, 4, 5
3. HIGH PRESSURE COOLANT INJECTION (HPCI) SYSTEM				
a. Reactor Vessel Water Level - Low Low	S-1	M-2	A.B. → E → B/M → 3 24 months	1, 2, 3
b. Drywell Pressure - High A.6	NA	Q-4	Q-6	1, 2, 3
c. Condensate Storage Tank Level - Low	NA	Q-4	M.5 → NA	1, 2, 3
d. Suppression Chamber Water Level - High	NA	Q-4	NA	1, 2, 3
e. Reactor Vessel Water Level - High (Trip)	NA	M-2	A.B. → E → B/M → 3	1, 2, 3
f. HPCI Pump Discharge Flow - Low (Bypass)	NA	Q-4	7-E → 5 24 months	1, 2, 3
g. Manual Initiation	NA	E → A.VI LD.1	NA	1, 2, 3

Table 3.3.5.1-Not. (a)

Table 3.3.5.1-Not. (a)

Table 3.3.5.1 Note (c)

add Functions 2.d, 2.e, 2.g, 2.h, 2.i, 2.j and 2.k

ECCS Actuation 3/4.2.B

3.3.5.1

3.3.5.1-1
TABLE 4.2.B-1 (Continued)

**ECCS ACTUATION INSTRUMENTATION
 SURVEILLANCE REQUIREMENTS**

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Functional Unit	SR 3.3.5.1.1	SR 3.3.5.1.2 SR 3.3.5.1.4	SR 3.3.5.1.3 SR 3.3.5.1.6 SR 3.3.5.1.7	Applicable OPERATIONAL MODE(s)
	CHANNEL CHECK	CHANNEL FUNCTIONAL TEST	CHANNEL CALIBRATION	
4. AUTOMATIC DEPRESSURIZATION SYSTEM				
4.a/5.24 a. Reactor Vessel Water Level - Low Low	S-1	M ⁻²	A.8 B/M-3	1, 2, 3
4.b/5.b b. Drywell Pressure - High A.6	NA	Q-4	Q-6	1, 2, 3
4.c/5.c c. Initiation Timer	NA	A.8 LD.1 E A.12	7-E 24 months	1, 2, 3
4.f/5.f d. Low Low Level Timer	NA	E A.12	7-E	1, 2, 3
4.d/5.a(e) e. CS Pump Discharge Pressure - High (Permissive)	NA	Q-4	Q-6 LE.11	1, 2, 3
4.e/5.e f. LPCI Pump Discharge Pressure - High (Permissive)	NA	Q-4	Q-6	1, 2, 3

5. LOSS OF POWER

a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)	NA	E	E	1, 2, 3, 4 ^{id} , 5 ^{id}
b. 4.16 kv Emergency Bus Undervoltage (Degraded Voltage)	NA	E	E	1, 2, 3, 4 ^{id} , 5 ^{id}

A.9 moved to
 ITS 3.3.8.1

A.11

Amendment Nos. 171 & 167
 Page 16 of 17

ITS 3.3.5.1
 ECCS Actuation 3/4.2.B

Table 3.3.8.1-1
TABLE 4.2.B-1 (Continued)

QUAD CITIES - UNITS 1 & 2

3/4.2-19



INSTRUMENTATION

Function Functional Unit	CHANNEL CHECK	SR 3.3.8.1.1 CHANNEL FUNCTIONAL TEST	SR 3.3.8.1.2 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
4. AUTOMATIC DEPRESSURIZATION SYSTEM^{1d}				
a. Reactor Vessel Water Level - Low Low	S	M	Q	1, 2, 3
b. Drywell Pressure - High ^{1d}	NA	M	Q	1, 2, 3
c. Initiation Timer	NA	E	E	1, 2, 3
d. Low Low Level Timer	NA	E	E	1, 2, 3
e. CS Pump Discharge Pressure - High (Permissive)	NA	M	Q	1, 2, 3
f. LPCI Pump Discharge Pressure - High (Permissive)	NA	M	Q	1, 2, 3


See ITS 3.3.5.1

See ITS 3.3.5.1

A.1

5. LOSS OF POWER

a. 4.16 kv Emergency Bus Undervoltage (Loss of Voltage)	NA			
b. 4.16 kv Emergency Bus Undervoltage (Degraded Voltage)	NA			

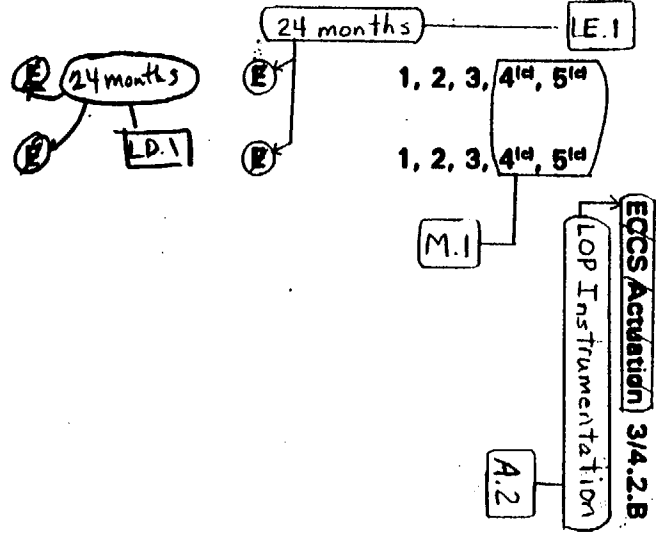

2.4
2.5

Amendment Nos. 171 & 167

Page 5 of 6

ITS 3.3.8.1

INSTRUMENTATION

A.1

ITS 3.3.5.1
ECCS Actuation 3/4.2.B

3.3.5.1-1
TABLE 4.2.B-1 (Continued)

ECCS ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

TABLE NOTATION

Table 3.3.5.1-1
Note(c)

(a) Not required to be OPERABLE when reactor steam dome pressure is ≤ 150 psig.

Table 3.3.5.1-1
Note(a)

(b) When the system is required to be OPERABLE per Specification 3.5.B.

A.9 moved to
ITS 3.3.8.1

(c) Required when the associated diesel generator is required to be OPERABLE per Specification 3.9.B.

A.6

(d) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

92 A.8

SR 3.3.5.1.5
SR 3.3.5.1.7

(e) Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table.

INSTRUMENTATION

A.1

ECCS/Actuation 3/4.2.B

Table 3.3.8.1-1

LOP Instrumentation

TABLE 4.2.B-1 (Continued)

A.2

ECCS ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

TABLE NOTATION

(a) Not required to be OPERABLE when reactor steam dome pressure is ≤ 150 psig.

See ITS 3.3.5.1

(b) When the system is required to be OPERABLE per Specification 3.5.B.

applicability

(c) Required when the associated diesel generator is required to be OPERABLE per Specification 3.9.B.

(d) This function is not required to be OPERABLE when PRIMARY CONTAINMENT INTEGRITY is not required.

(e) Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table.

add proposed Note 2 to Surveillance Requirements

L.1

INSTRUMENTATION

A.1

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

C. ATWS - RPT

C. ATWS - RPT

LC 3.3.4.1

The anticipated transient without scram recirculation pump trip (ATWS - RPT) instrumentation CHANNEL(s) shown in Table 3.2.C-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

1. Each ATWS - RPT instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.2.C-1.

Allowable Value A.4

APPLICABILITY:

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 24 months.

OPERATIONAL MODE 1.

SR 3.3.4.1.5

ACTION:

add proposed ACTIONS Note

A.2

24 LA1

including breaker actuation

M.2

ACTIONS A, B, and C

1. With an ATWS - RPT instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.C-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with the CHANNEL trip setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value

A.4

2. With one level CHANNEL or one pressure CHANNEL inoperable in one (or both) TRIP SYSTEM(s), within 14 days, either restore the inoperable CHANNEL to OPERABLE status or place the inoperable CHANNEL in the tripped condition^a. Otherwise, be in STARTUP within the next 8 hours.

M.1

M.2

add proposed Required Action A.2 Note

ACTION A

ACTION D

add proposed Required Action D.1

L.1

ACTION A

3. With two level CHANNELS or two pressure CHANNELS inoperable in one (or both) TRIP SYSTEM(s), declare the TRIP SYSTEM(s) inoperable.

L.2

LA.1

^a The inoperable CHANNEL(s) need not be placed in the tripped condition where this would cause the Trip Function to occur.

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS


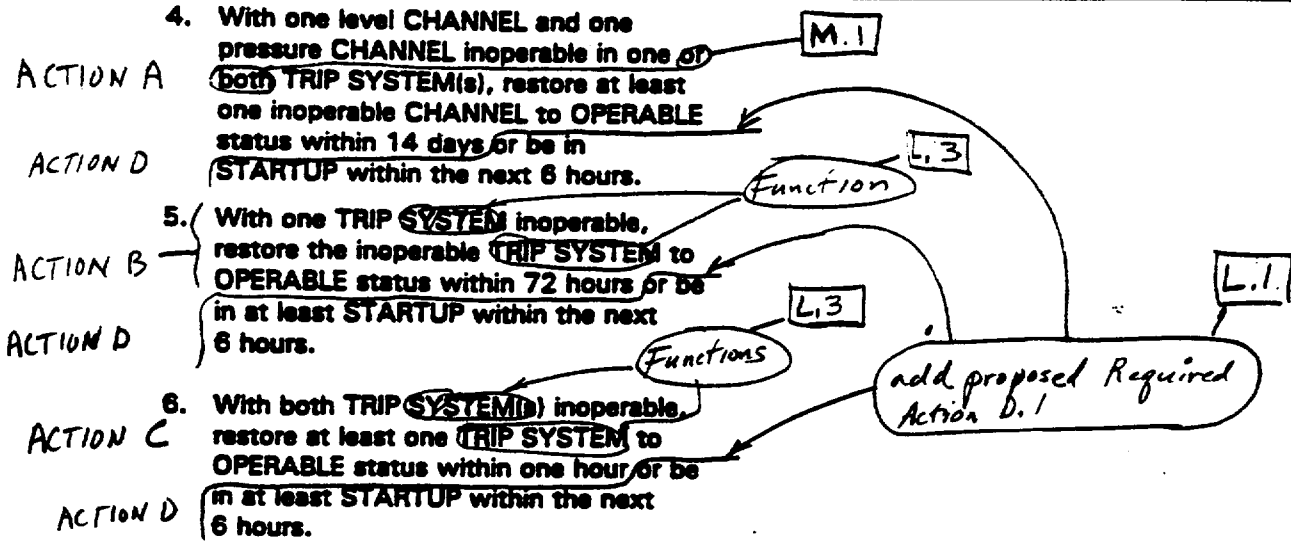


TABLE 3.2.C-1

ATWS - RPT INSTRUMENTATION

Functional Unit
LC 3.3.4.1a 1. Reactor Vessel Water Level - Low Low
LC 3.3.4.1b 2. Reactor Vessel Pressure - High

Steam Done

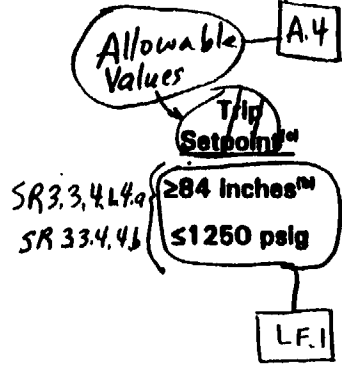

Note to Surveillance Requirements

Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM^a

LC 3.3.4.1 2
2

INSTRUMENTATION

A.1

Insert CTS 3.2.C-1 Note a

A.3

- a A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the TRIP SYSTEM in the tripped condition provided at least one OPERABLE CHANNEL in the same TRIP SYSTEM is monitoring that parameter.
- b Includes a time delay of $0 \leq t \leq 10$ seconds.
- c Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).

SR 3, 3.4.1.4.a

A.2

ITS 3.3.4.1

ATWS - RPT 3/4.2.C

A3

Insert CTS 3.2.C-1 Note a

ITS, 3.3.4.1

When a CHANNEL is placed in an inoperable status solely for performance of required Surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains ATWS ~~actuation~~ capability.
+np

Note to
Surveillance
Requirements

QUAD CITIES - UNITS 1 & 2

3/4.2-24

TABLE 4.2.C-1

ATWS - RPT INSTRUMENTATION SURVEILLANCE REQUIREMENTS

SR 334.1.3

SR 3.3.4.1.2

SR 334.1.4

SR 3.3.4.1.1

Functional Unit

CHANNEL CHECK




CHANNEL FUNCTIONAL TEST

CHANNEL CALIBRATION

- 1. Reactor Water Level - Low Low
- 2. Reactor Vessel Pressure - High

S-1

S-1



A.1

SR 334.1.2

SR 334.1.4

a Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency identified in the table.

ATWS - RPT 3/4.2.C

ITS 3.3.4.1

INSTRUMENTATION

Amendment Nos. 171 & 167

Page 5 of 5

INSTRUMENTATION

A.1

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

D. Reactor Core Isolation Cooling Actuation

D. Reactor Core Isolation Cooling Actuation

LCO
3.3.5.2

The reactor core isolation cooling (RCIC) system actuation instrumentation CHANNEL(s) shown in Table 3.2.D-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

Note 1 to Surveillance Requirements

1. Each RCIC system actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.2.D-1.

Allowable Value - A.8

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3 with the reactor steam dome pressure > 150 psig.

2. LOGIC SYSTEM FUNCTIONAL TEST(s) SR3.3.5.2.6 of all CHANNEL(s) shall be performed at least once per 24 months.

24 - LD.1

ACTION:

add proposed ACTIONS Note - A.2

ACTION A

1. With a RCIC system actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.D-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value - A.8

ACTION A

2. With one or more RCIC system actuation instrumentation CHANNEL(s) inoperable, take the ACTION required by Table 3.2.D-1.

33.5.2-1
TABLE 3.2.D-1


REACTOR CORE ISOLATION COOLING ACTUATION INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

3/4.2-26

Functional Unit	Trip Setpoint	Minimum CHANNEL(s) per Trip Function	ACTION
1. Reactor Vessel Water Level - Low Low	≥84 inches	4	B 40
2. Reactor Vessel Level - High (Trip)	≤201 inches	2	C 41
3. Condensate Storage Tank Level - Low	≥598' El.	2	D 42
4. Suppression Chamber Water Level - High	≤14'8" above bottom of chamber	2	D 42
5. Manual Initiation	NA	1/system	C 43

Note 2 to Surveillance Requirement

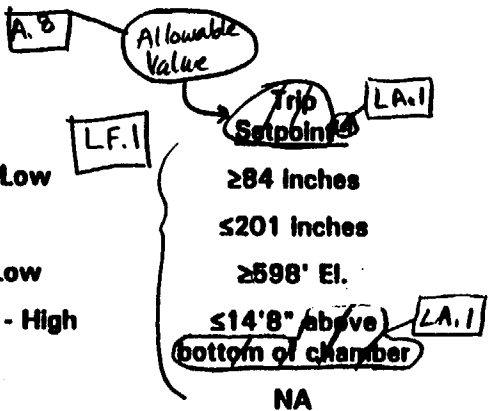

INSTRUMENTATION

D.1

Insert CTS Table 3.2.D-1 Note (a)

a A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains FCIC actuation capability.

b Provides signal to pump section valves only. LA. 2

c Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero). LA. 1

Amendment Nos. 171 & 167
Page 2 of 7

ITS 3.3.5.2
FCIC Actuation 3/4.2.D

A.4

Insert CTS Table 3.2.0-1 Note (a)

Insert 18, Page 3/4.2-26

- a When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed as follows:

Note 2
to
Surveillance
Requirement

- 1) For up to six hours for Functional Units 2 and 5; and
- 2) For up to six hours for Functional Units other than 2 and 5 provided the functional unit maintains actuation capability.

INSTRUMENTATION

A.1

TABLE 3.2.D-1(Continued)
3.3.5.2-1

REACTOR CORE ISOLATION COOLING ACTUATION INSTRUMENTATION

ACTION

INSERT ACTION 40

ACTION 40 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement:

- a. With one CHANNEL inoperable, place the inoperable CHANNEL in the tripped condition within one hour or declare the RCIC system inoperable.
- b. With more than one CHANNEL inoperable, declare the RCIC system inoperable.

A.6 Function

Within 24 hours restore the inoperable channel A.4

ACTION 41 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement, declare the RCIC system inoperable.

ACTION C
ACTION E

ACTION 42 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per TRIP SYSTEM requirement, place at least one inoperable CHANNEL in the tripped condition within one hour or declare the RCIC system inoperable.

ACTION 43 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM requirement, restore the inoperable CHANNEL to OPERABLE status within 8 hours or declare the RCIC system inoperable.

ACTION C
ACTION E

24 hours

A.6

Function

A.4

Insert ACTION 42 - A.4

A.4

ITS 3.3.5, 2

Insert 19, Page 3/4.2-27

Insert ACTION 40

ACTION 40- With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION B

- a. Within one hour from discovery of loss of initiation capability declare RCIC inoperable, AND
- b. Place the inoperable CHANNEL(s) in the tripped condition within 24 hours or

ACTION E)

declare RCIC inoperable

A.4

ITS 3.3.5.2

Insert 20, Page 3/4.2-27

Insert ACTION 42

ACTION 42 – With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement:

ACTION D

- a. Within one hour from discovery of loss of initiation capability declare RCIC inoperable, AND
- b. Place the inoperable CHANNEL(s) in the tripped condition within 24 hours or declare RCIC inoperable

ACTION E)

add proposed Required Action D.2.2

A.5

3.3.5.2-1
 TABLE 4.2.D-1

**REACTOR CORE ISOLATION COOLING ACTUATION INSTRUMENTATION
 SURVEILLANCE REQUIREMENTS**

QUAD CITIES - UNITS 1 & 2

3/4.2-28

Amendment Nos. 171 & 167

Page 7 of 7

Functional Unit

1. Reactor Vessel Water Level - Low Low
2. Reactor Vessel Water Level - High (Trip)
3. Condensate Storage Tank Level - Low
4. Suppression Chamber Water Level - High
5. Manual Initiation


SR 3.3.5.2.1

CHANNEL
CHECK

- S - 1
- S - 1
- NA
- NA
- NA


SR 3.3.5.2.2
 SR 3.3.5.2.4

CHANNEL
FUNCTIONAL
TEST

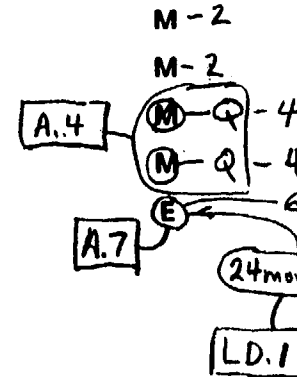

SR 3.3.5.2.3
 SR 3.3.5.2.5

CHANNEL
CALIBRATION

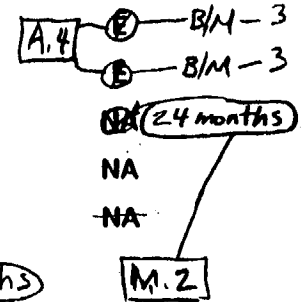

INSTRUMENTATION

D
1

RCIC Actuation 3/4.2.D

ITS 3.3.5.2

A.1

INSTRUMENTATION

Control Rod Blocks 3/4.2.E

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

E. Control Rod Block Actuation

E. Control Rod Block Actuation

LCO 3.3.2.1 The control rod block actuation instrumentation CHANNEL(s) shown in Table 3.2.E-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column.

Each of the required control rod block actuation TRIP SYSTEM(s) and instrumentation CHANNEL(s) shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.E-1.

Allowable Value - A.2

APPLICABILITY:

As shown in Table 3.2.E-1.

Note 1 to Surveillance Requirements

ACTION:

ACTIONS A and B

1. With a control rod block actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.E-1, declare the CHANNEL inoperable until the CHANNEL is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

Allowable Value - A.2

ACTIONS A and B

2. With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, take the ACTION required by Table 3.2.E-1.

A.1

Table 3.3.2.1-1
TABLE 3.2.E-1

CONTROL ROD BLOCK INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Function Functional Unit	Allowable Value Trip Setpoint	Minimum CHANNEL(s) per Trip Function ^m	Applicable OPERATIONAL MODE(s)	ACTION
1. ROD BLOCK MONITORS[®]				
a. a. Upscale	As specified in COLR	2	1 ^m	50 A, B
b. b. Inoperative	NA	2	1 ^m	50 A, B
c. c. Downscale	≥3/125 of full scale	2	1 ^m	50 A, B
2. AVERAGE POWER RANGE MONITORS				
a. Flow Biased Neutron Flux - High				
1. Dual Recirculation Loop Operation	≤(0.58W + 50) ^m	4	1	51
2. Single Recirculation Loop Operation	≤(0.58W + 48.5) ^m	4	1	51
b. Inoperative	NA	4	1, 2, 5 ^m	51
c. Downscale	≥3/125 of full scale	4	1	51
d. Startup Neutron Flux - High	≤12/125 of full scale	4	2, 5 ^m	51

L.A.1

L.F.1

A.2

A.3

K.1

3/4.2-30

Amendment Nos. 171 & 167

Control Rod Blocks 3/4.2.E

A.11

INSTRUMENTATION

Control Rod Blocks 3/4.2.E

Table 3.3.2.1-1
TABLE 3.2.E-1 (Continued)

CONTROL ROD BLOCK INSTRUMENTATION

Functional Unit	Trip Setpoint	Minimum CHANNEL(s) per Trip Function ^(a)	Applicable OPERATIONAL MODE(S)	ACTION
3. SOURCE RANGE MONITORS				
a. Detector not full in ^(b)	NA	3	2 ^(d) 5 ^(e)	51 51
b. Upscale ^(c)	≤ 1 x 10 ⁵ cps	3	2	51
c. Inoperative ^(f)	NA	2	5	51
4. INTERMEDIATE RANGE MONITORS				
a. Detector not full in	NA	3	2	51
b. Upscale	≤ 108/125 of full scale	2	5	51
c. Inoperative	NA	6	2.5	51
d. Downscale ^(g)	≥ 3/125 of full scale	6	2.5	51

R-1

INSTRUMENTATION

Control Rod Blocks 3/4.2.E

Table 3.3.2.1-1

TABLE 3.2.E.1 (Continued)

CONTROL ROD BLOCK INSTRUMENTATION

Functional Unit	SCRAM DISCHARGE VOLUME (SDV)	Trip Setpoint	Minimum CHANNEL(s) per Trip Function ^m	Applicable OPERATIONAL MODE(S)	ACTION
a. Water Level - High		≤25 gal	1 per bank	1, 2, 5 ^m	52
b. SDV Switch in Bypass		NA	1	5 ^m	52

Add proposed Function 3, "Reactor Mude Switch - Shutdown Position"

R.1 M.1

A.11

INSTRUMENTATION

Control Rod Blocks 3/4.2.E

Table 3.3.2.1-1

TABLE 3.2.E-1 (Continued)

CONTROL ROD BLOCK INSTRUMENTATION

ACTION

ACTIONS
A and B

ACTION 50 - Declare the rod block monitor inoperable and take the ACTION required by Specification 3.3.M.

ACTION 51 - With the number of OPERABLE CHANNEL(s):

- a. One less than required by the Minimum CHANNEL(s) per Trip Function requirement, restore the inoperable CHANNEL to OPERABLE status within 7 days or place the inoperable CHANNEL in the tripped condition within the next hour.
- b. Two or more less than required by the Minimum CHANNEL(s) per Trip Function requirement, place at least one inoperable CHANNEL in the tripped condition within one hour.

ACTION 52 - With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) per Trip Function requirement, place the inoperable CHANNEL in the tripped condition within one hour.

12 hours

R.1

A.4

Table 3.3.2.1-1

TABLE 3.2.E-1 (Continued)

CONTROL ROD BLOCK INSTRUMENTATION

TABLE NOTATION

A.3

LA.1

(a) The RBM shall be automatically bypassed when a peripheral control rod is selected.

(b) This function shall be automatically bypassed if the IRM channels are on range 3 or higher.

(c) This function shall be automatically bypassed when the associated IRM channels are on range 3 or higher.

(d) This function shall be automatically bypassed when the IRM channels are on range 1.

R.1

Table 3.3.2.1-1
Note (a)

(e) With THERMAL POWER \geq 30% of RATED THERMAL POWER, and no peripheral control rod selected

A.3

(f) With more than one control rod withdrawn. Not applicable to control rods removed per Specification 3.10.I or 3.10.J.

R.1

(g) The Average Power Range Monitor/rod block function is varied as a function of recirculation loop flow (W). The trip setting of this function must be maintained in accordance with Specification 3.11.B. W is equal to the percentage of the drive flow required to produce a rated core flow of 95×10^6 lbs/hr.

(h) Required to be OPERABLE only during SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

(i) A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains control rod block capability.

(j) With detector count rate less than or equal to 100 cps.

R.1

Insert CTS Table 3.2.E-1

A.4

Insert CTS Table 3.2.E-1

A.4

~~Insert 16, Page 3/4.2-34~~

- (i) When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided the Functional Unit maintains rod block actuation capability.

Note 2 to Surveillance Requirements

Table 3.3.2.1-1

TABLE 4.2.E-1

CONTROL ROD BLOCK INSTRUMENTATION SURVEILLANCE REQUIREMENTS

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Function
Functional Unit

CHANNEL CHECK

SR 3.3.2.1.1
CHANNEL FUNCTIONAL TEST

SR 3.3.2.1.4
CHANNEL CALIBRATION


Applicable OPERATIONAL MODE(s)

Note to SR 3.3.2.1.4

1. ROD BLOCK MONITORS

- a. Upscale
- b. Inoperative
- c. Downscale

NA
NA
NA




Q-4
NA
Q-4



2. AVERAGE POWER RANGE MONITORS

- a. Flow Biased Neutron Flux - High
 - 1. Dual Recirculation Loop Operation
 - 2. Single Recirculation Loop Operation
- b. Inoperative
- c. Downscale
- d. Startup Neutron Flux - High

NA
NA
NA
NA
NA



SA
SA
NA
SA
SA

1
1
1, 2, 5^M
1
2, 5^M

3. SOURCE RANGE MONITORS

- a. Detector not full in^M
- b. Upscale^M
- c. Inoperative^M

NA
NA
NA



E
E
NA

2^M, 5^M
2^M, 5
2^M, 5

M.2
Add proposed SR 3.3.2.1.5

3/4.2-35

Amendment Nos. 174 & 175

Page 8 of 12

A.1

Control Rod Blocks 3.4.2.E

ITS 3.3.2.1

A.4

R.1

A.11

ITS 3.3.2.1


INSTRUMENTATION

Control Rod Blocks 3/4.2.E

Table 3.3.2.1-1
TABLE 4.4.E-1 (Continued)

**CONTROL ROD BLOCK INSTRUMENTATION
SURVEILLANCE REQUIREMENTS**

Functional Unit	CHANNEL CHECK	CHANNEL FUNCTIONAL TEST	CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(S)
4. INTERMEDIATE RANGE MONITORS				
a. Detector not full in	NA	S/U ^m , W	E	2 ^m , 5
b. Upscale	NA	S/U ^m , W	E	2 ^m , 5
c. Inoperative	NA	S/U ^m , W	NA	2 ^m , 5
d. Downscale ^m	NA	S/U ^m , W	E	2 ^m , 5
5. SCRAM DISCHARGE VOLUME (SDV)				
a. Water Level - High	NA	Q	NA	1, 2, 5 ^m
b. SDV Switch in Bypass	NA	E	NA	5 ^m

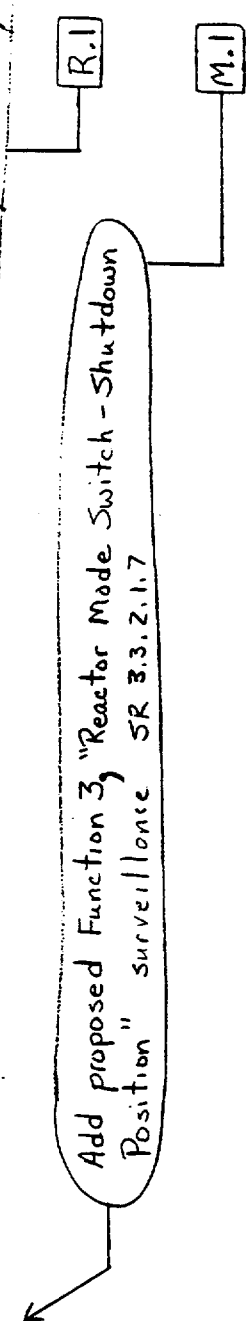

QUAD CITIES - UNITS 1 & 2

3/4.2-36

Amendment Nos.

171 & 167

A.1

Table 3.3.2.1-1
TABLE 4.2.E-1 (Continued)

**CONTROL ROD BLOCK INSTRUMENTATION
SURVEILLANCE REQUIREMENTS**

TABLE NOTATION

Note to
SR 3.3.2.1.4
and
SR 3.3.2.1.5

(a) Neutron detectors may be excluded from CHANNEL CALIBRATION.

(b) Within 7 days prior to startup.

L.1

(c) Includes reactor manual control "relay select matrix/system input."

LA.2

Table 3.3.2.1-1
Note (a)

(d) With THERMAL POWER \geq 30% of RATED THERMAL POWER

and no peripheral
rod is selected

A.3

(e) With more than one control rod withdrawn. Not applicable to control rods removed per Specification 3.10.I or 3.10.J.

(f) This function shall be automatically bypassed if the IRM channels are on range 3 or higher.

(g) This function shall be automatically bypassed when the associated IRM channels are on range 8 or higher.

(h) This function shall be automatically bypassed when the IRM channels are on range 1.

(i) The provisions of Specification 4.0.D are not applicable to the CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION surveillances for entry into the applicable OPERATIONAL MODE(s) from OPERATIONAL MODE 1 provided the surveillances are performed within 12 hours after such entry.

(j) Required to be OPERABLE only during SHUTDOWN MARGIN demonstrations performed per Specification 3.12.B.

(k) With detector count rate less than or equal to 100 cps.

R.1

A.1

INSTRUMENTATION

Accident Monitors 3/4.2.F

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

LCD 3.3.3.1 F. Accident Monitoring

F. Accident Monitoring

The accident monitoring instrumentation CHANNEL(s) shown in Table 3.2.F-1 shall be OPERABLE.

SR Note 1

Each of the required accident monitoring instrumentation CHANNEL(s) shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations for the OPERATIONAL MODE(s) and at the frequencies shown in Table 4.2.F-1.

APPLICABILITY:

As shown in Table 3.2.F-1.

ACTION:

With one or more of the required number of accident monitoring instrumentation CHANNEL(s) inoperable, take the ACTION shown by Table 3.2.F-1.

ACTION
A-F

L.2

L.1

A.2

Add proposed Note Z

Add proposed ACTIONS NOTE 1

Add proposed ACTIONS NOTE 2

Table 3.3.3.1-1

TABLE 3.2.F-1

ACCIDENT MONITORING INSTRUMENTATION

QUAD CITIES - UNITS 1 & 2

3/4.2-39

Amendment Nos. 171 & 167

Function	INSTRUMENTATION	Required CHANNEL(s)	Minimum CHANNEL(s)	Applicable OPERATIONAL MODE(s)	ACTION
1.	1. Reactor Vessel Pressure	2	1	1, 2	60 A, B, C, E
2.	2. Reactor Vessel Water Level	2	1	1, 2	60 A, B, C, E
3.	3. Torus Water Level	2	1	1, 2	60 A, B, C, E
4.	4. Torus Water Temperature	2	1	1, 2	60 A, B, C, E
4a	5. Drywell Pressure - Wide Range	2	1	1, 2	60 A, B, C, E
4b	6. Drywell Pressure - Narrow Range	2	1	1, 2	60 A, B, C, E
	7. Drywell Air Temperature	2	1	1, 2	60
8.	8. Drywell Oxygen Concentration - Analyzer and Monitor	2	1	1, 2	A, B, C, E 62
7.	9. Drywell Hydrogen Concentration - Analyzer and Monitor	2	1	1, 2	A, B, C, E 62
	10. Safety & Relief Valve Position Indicators - Acoustic & Temperature	2/valve (1 each)	1/valve	1, 2	63
	11. (Source Range) Neutron Monitors	2	2	1, 2	60
5.	12. Drywell Radiation Monitors	2	2	1, 2, 3	A, B, C, F 61
	13. Torus Air Temperature	2	1	1, 2	60
	14. Torus Pressure	2 ¹⁴	1	1, 2	60
	This function is shared with Drywell Pressure-Wide Range and Drywell Pressure-Narrow Range.				LA.3
	Add proposed ITS 3.3.3.1 Function 6				M.1

INSTRUMENTATION

Accident Monitors 3/4.4.F

A.3

a. Wide Range
b. Narrow Range

R.1

A.1

L.6

LA.3

M.1

Page 2 of 6

ITS 3.3.3.1

A.1

INSTRUMENTATION

Accident Monitors 3/4.2.F

TABLE 3.2.F-1 (Continued)

ACCIDENT MONITORING INSTRUMENTATION

		ACTION	L.3
<i>Add proposed ACTION B</i>			
ACTION 60 - ACTION A	a.	With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Required CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours.	L.4
ACTION C ACTIONS D and E	b.	With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 48 hours or be in at least HOT SHUTDOWN within the next 12 hours. <i>7 days</i>	L.4
ACTION 61- L.A.1		With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1, initiate the preplanned alternate method of monitoring the appropriate parameter(s) within 72 hours, and: <i>one required</i> <i>Insert proposed ACTION A</i>	L.5
ACTION C with two required channels inoperable	a.	Either restore the inoperable CHANNEL(s) to OPERABLE status within 7 days of the event, or	
ACTIONS B and F	b.	Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.B within 30 days following the event outlining the action taken, the cause of the inoperability and the plans and schedule for restoring the system to OPERABLE status. <i>moved to ITS 5.6</i>	A.4
ACTION 62- ACTION A	a.	With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) one less than the Required CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours.	
ACTION C ACTIONS D and E	b.	With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1; restore at least one inoperable CHANNEL to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours.	

TABLE 3.2.F-1 (Continued)

ACCIDENT MONITORING INSTRUMENTATION

ACTION

- ACTION 60 -**
- a. With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Required CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours.
 - b. With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 48 hours or be in at least HOT SHUTDOWN within the next 12 hours.

ACTION 61- With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1, initiate the preplanned alternate method of monitoring the appropriate parameter(s) within 72 hours, and:

- a. Either restore the inoperable CHANNEL(s) to OPERABLE status within 7 days of the event, or

5.6.6

- b. Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.B within 30 days following the event outlining the action taken, the cause of the inoperability and the plans and schedule for restoring the system to OPERABLE status.

M.1

- ACTION 62-**
- a. With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) one less than the Required CHANNEL(s) shown in Table 3.2.F-1, restore the inoperable CHANNEL(s) to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours.
 - b. With the number of OPERABLE accident monitoring instrumentation CHANNEL(s) less than the Minimum CHANNEL(s) shown in Table 3.2.F-1; restore at least one inoperable CHANNEL to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours.

< See ITS 3.3.3.1 >

A.11

ITS 3.3.3.1

INSTRUMENTATION

Accident Monitors 3/4.2.F

TABLE 3.2.F-1 (Continued)

ACCIDENT MONITORING INSTRUMENTATION

R.1

- ACTION 63 -**
- a. With the number of **OPERABLE** accident monitoring/instrumentation **CHANNEL(s)** less than the **Required CHANNEL(s)** shown in **Table 3.2.F-1**, restore the inoperable **CHANNEL(s)** to **OPERABLE** status prior to startup from a **COLD SHUTDOWN** of longer than **72 hours**.
 - b. With the number of **OPERABLE** accident monitoring instrumentation **CHANNEL(s)** less than the **Minimum CHANNEL(s)** shown in **Table 3.2.F-1**, restore at least one of the inoperable **CHANNEL(s)** to **OPERABLE** status within **30 days** or be in at least **HOT SHUTDOWN** within the next **12 hours**.

Table 3.3.3.1-1
TABL. 4.2.F-1

**ACCIDENT MONITORING INSTRUMENTATION
 SURVEILLANCE REQUIREMENTS**

QUAD CITIES - UNITS 1 & 2

INSTRUMENTATION

Function	INSTRUMENTATION	SR 3.3.3.1.1 CHANNEL CHECK	SR 3.3.3.1.2 SR 3.3.3.1.3 CHANNEL CALIBRATION	Applicable OPERATIONAL MODE(s)
1	1. Reactor Vessel Pressure	M-1	3- (E)	1, 2
2	2. Reactor Vessel Water Level	M-1	3- (E)	1, 2
3	3. Torus Water Level	M-1	3- (E)	1, 2
4	4. Torus Water Temperature	M-1	3- (E)	1, 2
4a	5. Drywell Pressure - Wide Range	M-1	3- (E)	1, 2
4b	6. Drywell Pressure - Narrow Range	M-1	(E)	1, 2
3/4.2-4.2	7. Drywell Air Temperature	M	E	1, 2 (R.1)
8	8. Drywell Oxygen Concentration - Analyzer and Monitor	M-1	Q-2	1, 2
7	9. Drywell Hydrogen Concentration - Analyzer and Monitor	M-1	Q-2	1, 2
	10. Safety & Relief Valve Position Indicators - Acoustic & Temperature	M	E	1, 2 (R.1)
	11. (Source Range) Neutron Monitors	M	EM	1, 2 (L.6)
5	12. Drywell Radiation Monitors	1 - M (LD.1)	(E) 3 (LA.2)	1, 2 (R.1)
	13. Torus Air Temperature	M	E	1, 2 (R.1)
	14. Torus Pressure	M	E	1, 2 (A.3)
	Add proposed ITS 3.3.3.1 Function 6	M.1		

A.3
 a. Wide Range
 b. Narrow Range

LE.1
 LD.1

A.1

Accident Monitors 3/4.2.F

ITS 3.3.3.1

Amendment Nos. 171 & 167

Page 5 of 6

INSTRUMENTATION

Accident Monitors 3/4.2.F

TABLE 4.2.F-1 (Continued)

ACCIDENT MONITORING INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

TABLE NOTATION

- (a) CHANNEL CALIBRATION shall consist of an electronic calibration of the CHANNEL, not including the detector, for range decades above 10 R/hr and a one point calibration check of the detector below 10 R/hr with an installed or portable gamma source. LA.2
- (b) Neutron detectors may be excluded from the CHANNEL CALIBRATION. R.1

A.1

INSTRUMENTATION

SRM 3/4.2.G

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

A.3

LEO 3.3.1.2 G. Source Range Monitoring

G. Source Range Monitoring

Add proposed Note to Surveillance Requirements

At least the following source range monitor (SRM) channels shall be OPERABLE:

Each of the required source range monitor CHANNEL(s) shall be demonstrated OPERABLE by:

- a. In OPERATIONAL MODE 2nd, three.
- b. In OPERATIONAL MODE 3 and 4, two.

SR 3.3.1.2.41. Verifying, prior to withdrawal of the control rods, that the SRM count rate is ≥ 3 cps with the detector fully inserted.

M.1

L.A.1

Table 3.3.1.2-1

APPLICABILITY:

L.B or ≥ 0.7 cps w. with a signal to noise ratio $\geq 20:1$

- 2. Performance of a CHANNEL CHECK at least once per:

OPERATIONAL MODE(s) 2nd, 3, and 4.

SR 3.3.1.2.1

- a. 12 hours in OPERATIONAL MODE 2nd, and

L.1

SR 3.3.1.2.3

- b. 24 hours in OPERATIONAL MODE(s) 3 or 4.

M.5

ACTION:

and determination of signal to noise ratio

- 1. In OPERATIONAL MODE 2nd with one of the above required source range monitor CHANNEL(s) inoperable, at least 3 source range monitor CHANNEL(s) shall be restored to OPERABLE status within 4 hours or the reactor shall be in at least HOT SHUTDOWN within the next 12 hours.

ACTION A

- 3. Performance of a CHANNEL FUNCTIONAL TEST:

- a. Within 7 days prior to startup, and

L.3

ACTION C

- b. At least once per 31 days^{min}.

SR 3.3.1.2.6

- 2. In OPERATIONAL MODE(s) 3 or 4 with one or more of the above required source range monitor CHANNEL(s) inoperable, verify all insertable control rods to be fully inserted in the core and lock the reactor mode switch in the Shutdown position within one hour.

A.2

SR 3.3.1.2.7

- 4. Performance of a CHANNEL CALIBRATION^{min} at least once per 18 months^{min}.

24

L.E.1

ACTION D

place L.2

Add proposed ACTION B L.1

Table 3.3.1.2-1

- Note a SR 3.3.1.2.6 With IRM's on range 2 or below.
- Note b SR 3.3.1.2.7 The provisions of Specification 4.0.D are not applicable for entry into the applicable OPERATIONAL MODE(s) from OPERATIONAL MODE 1, provided the surveillance is performed within 12 hours after such entry.
- Note c SR 3.3.1.2.7 Neutron detectors may be excluded from the CHANNEL CALIBRATION.

INSTRUMENTATION

3.2 - LIMITING CONDITIONS FOR OPERATION

H. Explosive Gas Monitoring

The explosive gas monitoring instrumentation CHANNEL(s) shown in Table 3.2.H-1 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 3.8.H are not exceeded.

APPLICABILITY:

During offgas holdup system operation.

ACTION:

1. With an explosive gas monitoring instrumentation CHANNEL alarm/trip setpoint less conservative than required by the above specification, declare the CHANNEL inoperable and take the ACTION shown in Table 3.2.H-1.
2. With less than the minimum number of explosive gas monitoring instrumentation CHANNEL(s) OPERABLE, take the ACTION shown in Table 3.2.H-1. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.B to explain why this inoperability was not corrected in a timely manner.
3. The provisions of Specification 3.0.C are not applicable.

4.2 - SURVEILLANCE REQUIREMENTS

H. Explosive Gas Monitoring

Each explosive gas monitoring instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.2.H-1.

R.1

QUAD CITIES - UNITS 1 & 2

3/4.2-46

Amendment Nos. 171 & 167

Page 2 of 3

TABLE 3.2.H-1

EXPLOSIVE GAS MONITORING INSTRUMENTATION

Functional Unit

**Minimum
CHANNEL(s) OPERABLE**

ACTION

**MAIN CONDENSER OFFGAS TREATMENT SYSTEM
EXPLOSIVE GAS MONITORING SYSTEM**

Hydrogen Monitor

1

70

ACTION

ACTION 70 -

With the number of OPERABLE CHANNEL(s) less than required by the Minimum CHANNEL(s) OPERABLE requirement, operation of the main condenser offgas treatment system may continue provided grab samples are collected at least once per 4 hours and analyzed within the following 4 hours. If the recombiner(s) temperature remains constant and THERMAL POWER has not changed, the grab sample collection frequency may be changed to 8 hours.

INSTRUMENTATION

Explosive Gas Monitoring 3/4.2.H

CTS 3/4.2.H

CTS 3/4.2.H

Explosive Gas Monitoring 3/4.2.H

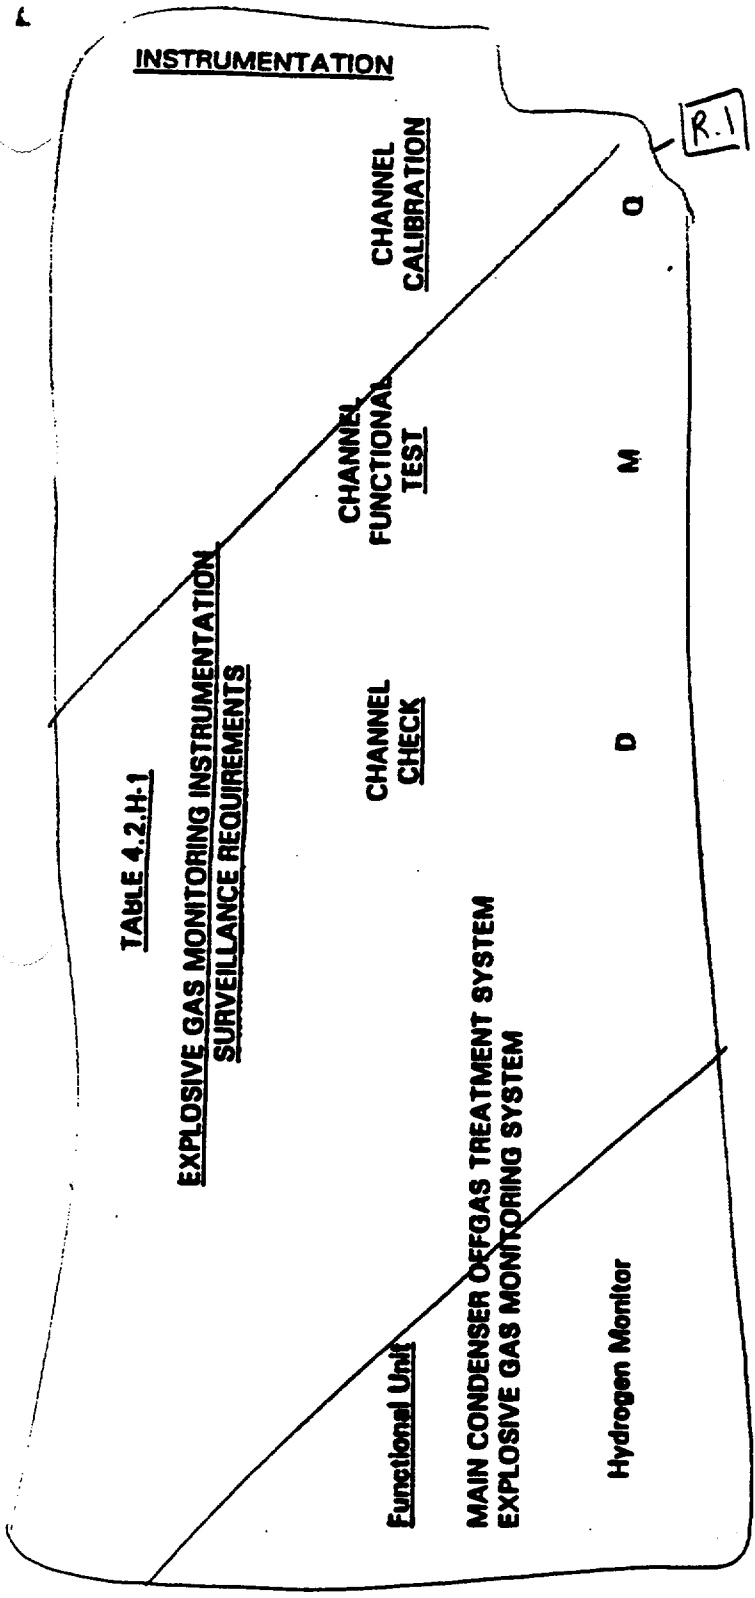


TABLE 4.2.H-1

EXPLOSIVE GAS MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

CHANNEL CALIBRATION

O

CHANNEL FUNCTIONAL TEST

M

CHANNEL CHECK

D

Functional Unit

MAIN CONDENSER OFFGAS TREATMENT SYSTEM
EXPLOSIVE GAS MONITORING SYSTEM

Hydrogen Monitor

R.1

INSTRUMENTATION

Suppression Chamber and Drywell Spray Actuation 3/4.2.1

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

R.1

I. Suppression Chamber and Drywell Spray Actuation

I. Suppression Chamber and Drywell Spray Actuation

The Suppression Chamber and Drywell Spray Actuation instrumentation CHANNEL(s) shown in Table 3.2.1-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.2.1-1.

1. Each Suppression Chamber and Drywell Spray Actuation instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.2.1-1.

APPLICABILITY:

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

OPERATIONAL MODE(s) 1, 2 & 3.

ACTION:

With a Suppression Chamber and Drywell Spray Actuation instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.1-1, declare the CHANNEL inoperable and take the ACTION shown in Table 3.2.1-1.

QUAD CITIES - UNITS 1 & 2

3/4-2-49

Amendment Nos.

171 & 167

Page 2 of 3

TABLE 3.2.1-1

SUPPRESSION CHAMBER AND DRYWELL SPRAY ACTUATION INSTRUMENTATION

<u>Functional Unit</u>	<u>Trip Setpoint^(a)</u>	<u>Minimum CHANNEL(s) per TRIP SYSTEM^(a)</u>	<u>ACTION</u>
1. Drywell Pressure - High (Permissive)	$0.5 \leq p \leq 1.5$ psig	2	80
2. Reactor Vessel Water Level - Low (Permissive)	≥ -48 inches	1	80

ACTION

- ACTION 80 -**
- a. With the number of OPERABLE CHANNEL(s) less than required by the Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM requirement for one TRIP SYSTEM, place at least one inoperable CHANNEL in the tripped condition^(b) within one hour or declare the Suppression Chamber and Drywell Spray Actuation mode of the Residual Heat Removal system inoperable.
 - b. With the number of OPERABLE CHANNEL(s) less than required by the Minimum OPERABLE CHANNEL(s) per TRIP SYSTEM requirement for both TRIP SYSTEM(s), declare the Suppression Chamber and Drywell Spray Actuation mode of the Residual Heat Removal system inoperable.

- a Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).
- b If an instrument is inoperable, it shall be placed (or simulated) in a tripped condition so that it will not prevent a containment spray.
- c A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition provided the Functional Unit maintains Suppression Chamber and Drywell Spray Actuation capability.

INSTRUMENTATION

Suppression Chamber and Drywell Spray Actuation 3/4.2.1

R.11

CTS 3/4.2.1

TABLE 4.2.1-1

SUPPRESSION CHAMBER AND DRYWELL SPRAY ACTUATION INSTRUMENTATION SURVEILLANCE REQUIREMENTS

INSTRUMENTATION

<u>Functional Unit</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNEL CALIBRATION</u>
1. Drywell Pressure - (Permissive)	NA	M	Q
2. Reactor Vessel Water Level - Low (Permissive)	D	M	E ¹⁴

Suppression Chamber and Drywell Spray Actuation 3/4.2.1

CTS 3/4.2.1

a Trip units are calibrated at least once per 31 days and transmitters are calibrated at the frequency indicated in the table.

R.1

A.1

M.1

ITS 3.3.2.2
Feedwater Pump Trip 3/4.2.J

INSTRUMENTATION

System and Main Turbine
High Water Level Trip

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

J. Feedwater Pump Trip

J. Feedwater Pump Trip

M.1

system and main turbine

L 10 3.3.2.2

The feedwater pump trip instrumentation CHANNEL(s) shown in Table 3.2.J-1 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.2.J-1.

SR 3.3.2.2.1

SR 3.3.2.2.2

SR 3.3.2.2.3

1. Each feedwater pump trip instrumentation CHANNEL shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.2.J-1.

Allowable Value A.2

APPLICABILITY:

OPERATIONAL MODE 1

L.1

M.1

system and main turbine

THERMAL POWER $\geq 25\%$ RTP

ACTION:

With a feedwater pump trip instrumentation CHANNEL trip setpoint less conservative than the value shown in the Trip Setpoint column of Table 3.2.J-1, declare the CHANNEL inoperable and take the ACTION shown in Table 3.2.J-1

Allowable Value

A.2

ACTIONS
A and B

2. LOGIC SYSTEM FUNCTIONAL TEST(s) of all CHANNEL(s) shall be performed at least once per 18 months.

24

LD.1

(SR 3.3.2.2.4

including breaker and valve actuation

M.2

TABLE 3.2.J-1

FEEDWATER PUMP TRIP INSTRUMENTATION

Functional Unit	Allowable Value	Trip Setpoint	Minimum CHANNEL(s)	ACTION
Reactor Vessel Water Level -High <i>L(0.3.3.2.2)</i>	A.2	S201 inches	2	90 A, B

Note to Surveillance Requirements

INSTRUMENTATION

ACTION

ACTION 90 - ACTION A a. With the number of OPERABLE CHANNEL(s) one less than required by the Minimum CHANNEL(s) requirement, restore ~~the inoperable CHANNEL to OPERABLE status~~ within ~~7~~ *2 hours* or place the inoperable CHANNEL in the tripped condition within the next 8 hours.

ACTION A b. With the number of OPERABLE CHANNEL(s) two less than required by the Minimum CHANNEL(s) requirement, restore ~~at least one of the inoperable CHANNEL(s) to OPERABLE status~~ within ~~7~~ *2* hours or be in at least ~~STARTUP~~ within the next 8 hours.

add proposed Required Action B.1

L.2

225%

L.1

LA.1

a Reactor vessel water level settings are expressed in inches above the top of active fuel (which is 360 inches above vessel zero).

b A CHANNEL may be placed in an inoperable status for up to 2 hours for required surveillance without placing the CHANNEL in the tripped condition.

Note to Surveillance Requirements

ITS 3.3.2.2
Feedwater Pump Trip 3/4.2.J

QUAD CTIES - UNITS 1 & 2

3/4.2-53

Amendment Nos. 171 & 167

Page 3 of 3

TABLE 4.2.J-1

FEEDWATER PUMP TRIP INSTRUMENTATION
SURVEILLANCE REQUIREMENTS

INSTRUMENTATION

<u>Functional Unit</u>	SR 3.3.2.2.1	SR 3.3.2.2.2	SR 3.3.2.2.3
Reactor Vessel Water Level - High	<u>CHANNEL CHECK</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNEL CALIBRATION</u>
LLO 3.3.2.2	D-1	E-2	E-2
		92 days	
		M.4	

A.11

ITS 3.3.2.2
Feedwater Pump Trip 3/4.2.J

INSTRUMENTATION

Toxic Gas Monitoring 3/4.2.K

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

K. Toxic Gas Monitoring

K. Toxic Gas Monitoring

The toxic gas monitoring system shall be OPERABLE with the alarm/trip setpoints adjusted to actuate at an ammonia concentration of less than or equal to 50 ppm.

The toxic gas monitoring system shall be demonstrated OPERABLE by performance of a:

APPLICABILITY:

All OPERATIONAL MODE(s)

1. CHANNEL CHECK at least once per 12 hours,
2. CHANNEL FUNCTIONAL TEST at least once per 31 days, and
3. CHANNEL CALIBRATION at least once per 18 months.

ACTION:

1. With the toxic gas monitoring system inoperable, within one hour initiate and maintain operation of the control room ventilation system in the isolation mode of operation.

R.1

A.1

ITS 3.3.7.2

INSTRUMENTATION

Mechanical Vacuum Pump 3/4.2.L

A.2

3.2 - LIMITING CONDITIONS FOR OPERATION

4.2 - SURVEILLANCE REQUIREMENTS

L. Mechanical Vacuum Pump Isolation Instrumentation

LCO 3.3.2.2 Four CHANNELS of the of the Main Steam Line Radiation - High Function for the Mechanical Vacuum Pump trip shall be OPERABLE^(c).

L. Mechanical Vacuum Pump Isolation Instrumentation

The Main Steam Line Radiation - High Function for the Mechanical Vacuum Pump trip shall be demonstrated OPERABLE by performance of a:

APPLICABILITY

OPERATIONAL MODE(s) 1 and 2 with the Mechanical Vacuum Pump in service and any main steam line not isolated.

- SR 3.3.7.2.1) 1. CHANNEL CHECK at least once per 12 hours, (92) A.6
- SR 3.3.7.2.2 2. CHANNEL FUNCTIONAL TEST at least once per (31) days, and A.5
- SR 3.3.7.2.4 3. CHANNEL CALIBRATION^(a) at least once per (18) months. The (trip setpoint) shall be $\leq (15) \times \text{normal background}^{(b)}$. Allowable Value L.F.1
- (24) 4. LOGIC SYSTEM FUNCTIONAL TEST at least once per (18) months including the Mechanical Vacuum Pump breaker. (24) LD.1

ACTION:

add proposed ACTIONS Note A.3

With one or more CHANNEL(s) inoperable:

- ACTION B a. Within one hour, verify sufficient CHANNELS remain OPERABLE to maintain trip capability, AND
- ACTION A b. Within 12 hours, place the inoperable CHANNEL(s) in the tripped condition^(d).

add proposed Required Action A.1 A.4

Otherwise, within 12 hours either:

- ACTION C a. Trip or isolate the Mechanical Vacuum Pump, OR
- b. Close the Main Steam Lines, OR
- c. Be in OPERATIONAL MODE 3. (SR 3.3.7.2.3 SR 3.3.7.2.4)

- (a) A current source provides an instrument channel alignment every 3 months.
- (b) Normal background is as measured during full power operation without hydrogen being injected.
- (c) When a CHANNEL is placed in an inoperable status solely for performance of required surveillances, entry into the associated Limiting Conditions for Operation and required ACTIONS may be delayed for up to 6 hours provided Mechanical Vacuum Pump trip capability is maintained.
- (d) Not applicable if the inoperable channel is due to an inoperable Mechanical Vacuum Pump breaker.

Required Action A.2 Note

Note to Surveillance Requirements Amendment Nos.

A.1

REACTIVITY CONTROL

SDM 3/4.3.A

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

A. SHUTDOWN MARGIN (SDM)

A. SHUTDOWN MARGIN

The SHUTDOWN MARGIN (SDM) shall be equal to or greater than:

The SHUTDOWN MARGIN shall be determined to be equal to or greater than that specified at any time during the operating cycle:

- 1. 0.38% $\Delta k/k$ with the highest worth control rod analytically determined, or
- 2. 0.28% $\Delta k/k$ with the highest worth control rod determined by test.

- 1. By demonstration, prior to or during the first startup after each refueling outage.

APPLICABILITY:

- 2. Within 24 hours after detection of a withdrawn control rod that is immovable, as a result of excessive friction or mechanical interference, or known to be unscrammable.

OPERATIONAL MODE(s) 1, 2, 3, 4, and 5.

ACTION:

The required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or unscrammable control rod.

A.13

With the SHUTDOWN MARGIN less than specified:

- 3. By calculation, prior to each fuel movement during the fuel loading sequence.

- 1. In OPERATIONAL MODE 1 or 2, restore the required SHUTDOWN MARGIN within 6 hours or be in at least HOT SHUTDOWN within the next 12 hours.
- 2. In OPERATIONAL MODE 3 or 4, immediately verify all insertable control rods to be fully inserted and suspend all activities that could reduce the SHUTDOWN MARGIN. In OPERATIONAL MODE 4, establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.
- 3. In OPERATIONAL MODE 5, suspend CORE ALTERATION(s) and other activities that could reduce the SHUTDOWN MARGIN and fully insert all insertable control rods within 1 hour. Establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

See ITS 3.1.1

A.1

ITS. 3.1.1

REACTIVITY CONTROL

SDM 3/4.3.A

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

A. SHUTDOWN MARGIN (SDM)

A. SHUTDOWN MARGIN

LCO 3.1.1

The SHUTDOWN MARGIN (SDM) shall be equal to or greater than:

SR3.1.1

The SHUTDOWN MARGIN shall be determined to be equal to or greater than that specified at any time during the operating cycle:

- 1. 0.38% $\Delta k/k$ with the highest worth control rod analytically determined, or
- 2. 0.28% $\Delta k/k$ with the highest worth control rod determined by test.

1. By demonstration, prior to or during the first startup after each refueling outage.

LA.1

A.7

A.8

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4, and 5.

2. Within 24 hours after detection of a withdrawn control rod that is immovable, as a result of excessive friction or mechanical interference, or known to be unscramble. The required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or unscramble control rod.

A.9
moved to ITS 3.1.3

LA.1

ACTION:

With the SHUTDOWN MARGIN less than specified:

3. By calculation, prior to each fuel movement during the fuel loading sequence.

ACTION A 1. In OPERATIONAL MODE 1 or 2, restore the required SHUTDOWN MARGIN within 6 hours or be in at least HOT SHUTDOWN within the next 12 hours.

ACTION B

ACTIONS C and D 2. In OPERATIONAL MODE 3 or 4, immediately verify all insertable control rods to be fully inserted and suspend all activities that could reduce the SHUTDOWN MARGIN. In OPERATIONAL MODE 4, establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

ACTION D

ACTION E 3. In OPERATIONAL MODE 5, suspend CORE ALTERATION(s) and other activities that could reduce the SHUTDOWN MARGIN and fully insert all insertable control rods within 1 hour. Establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

A.1

ITS 3.1.3

REACTIVITY CONTROL

SDM 3/4.3.A

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

A. SHUTDOWN MARGIN (SDM)

A. SHUTDOWN MARGIN

The SHUTDOWN MARGIN (SDM) shall be equal to or greater than:

Required Action A.4

The SHUTDOWN MARGIN shall be determined to be equal to or greater than that specified at any time during the operating cycle:

- 1. 0.38% $\Delta k/k$ with the highest worth control rod analytically determined, or
- 2. 0.28% $\Delta k/k$ with the highest worth control rod determined by test.

- 1. By demonstration, prior to or during the first startup after each refueling outage.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4, and 5.

- 2. Within 24 hours after detection of a withdrawn control rod that is

Required Action A.4

immovable, as a result of excessive friction or mechanical interference, or known to be unscrammable. The required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or unscrammable control rod.

A.5

ACTION:

With the SHUTDOWN MARGIN less than specified:

- 1. In OPERATIONAL MODE 1 or 2, restore the required SHUTDOWN MARGIN within 6 hours or be in at least HOT SHUTDOWN within the next 12 hours.
- 2. In OPERATIONAL MODE 3 or 4, immediately verify all insertable control rods to be fully inserted and suspend all activities that could reduce the SHUTDOWN MARGIN. In OPERATIONAL MODE 4, establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.
- 3. In OPERATIONAL MODE 5, suspend CORE ALTERATION(s) and other activities that could reduce the SHUTDOWN MARGIN and fully insert all insertable control rods within 1 hour. Establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

- 3. By calculation, prior to each fuel movement during the fuel loading sequence.

A.9

moved to ITS Chapter 1.0 SDM definition

See ITS 3.1.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

3.1.2 B. Reactivity Anomalies

LCo 3.1.2

A.2

The reactivity equivalence of the difference between the actual critical control rod configuration and the predicted critical control rod configuration shall not exceed 1% Δk/k.

SR 3.1.2.1

M.1

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION A With the reactivity equivalence difference exceeding .1% Δk/k, within 72 hours perform an analysis to determine and explain the cause of the reactivity difference; operation may continue if the difference is explained and corrected.

72 L.1

LA.1

ACTION B With the provisions of the ACTION above not met, be in at least HOT SHUTDOWN within the next 12 hours.

B. Reactivity Anomalies

A.2

The reactivity equivalence of the difference between the actual critical control rod configuration and the predicted critical control rod configuration shall be verified to be less than or equal to 1% Δk/k:

A.3

1. During the first startup following CORE ALTERATION(s), and
2. At least once per 31 effective full power days

L.2

L.3

1000 MWD/T

A.1

A.2

REACTIVITY CONTROL

general reorganization

CR OPERABILITY 3/4.3.C

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

C. Control Rod OPERABILITY

C. Control Rod OPERABILITY

LCO 3.1.3 All control rods shall be OPERABLE.

SR 3.1.3.2
SR 3.1.3.3

1. When above the low power setpoint of the RWM, all withdrawn control rods not required to have their directional control valves disarmed electrically or hydraulically shall be demonstrated OPERABLE by moving each control rod at least one notch:

A.6

M.5

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

A.3 A.4

Add proposed ACTIONS Note

ACTION:

Add proposed Required Action A.1 Note

ACTION A

1. With one control rod inoperable due to being immovable as a result of excessive friction or mechanical interference, or known to be unscrammable:

A.5

M.1

SR 3.1.3.2

SR 3.1.3.3

a. At least once per 7 days for each fully withdrawn control rod, and at least once per 31 days for each partially withdrawn control rod, and

SR 3.1.3.2 Note

b. Within 24 hours when any control rod is immovable as a result of excessive friction or mechanical interference, or known to be unscrammable.

SR 3.1.3.3 Note

L.1

a. Within one hour:

Add proposed Required Action A.1

ACTION D

1) Verify that the inoperable control rod, if withdrawn, is separated from all other inoperable withdrawn control rods by at least two control cells in all directions.

M.2

L.2

Required Action A.2

2) Disarm the associated directional control valves either:

2. All control rods shall be demonstrated OPERABLE by performance of Surveillance Requirements 4.3.D, 4.3.F, 4.3.G, 4.3.H and 4.3.I.

A.7

a) Electrically, or

M.3

b) Hydraulically by closing the drive water and exhaust water isolation valves.

control rod drive (CRD)

LA.1

Add proposed ACTION B

M.3

b. With the provisions of ACTION 1.a above not met, be in at least HOT SHUTDOWN within the next 12 hours.

a May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.8

SR 3.1.3.2 b and SR 3.1.3.3

Not required to be performed until 7 days (for fully withdrawn) or 31 days (for partially withdrawn) after the control rod is withdrawn and above the low power setpoint of the RWM.

A.1

ITS 3.1.3

REACTIVITY CONTROL

CR OPERABILITY 3/4.3.C

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

Required Action A.4 } c. Comply with Surveillance Requirement 4.3.A.2 within 24 hours or be in HOT SHUTDOWN within the next 12 hours. (72) L.4

ACTION F }

ACTION C 2. With one or more control rods scrammable but inoperable for causes other than addressed in ACTION 3.3.C.1 above: add proposed Note to Condition D L.1

a. If the inoperable control rod(s) is withdrawn, within one hour:

L.1 } ACTION D

1) Verify that the inoperable withdrawn control rod(s) is separated from all other inoperable withdrawn control rods by at least two control cells in all directions, and M.2

A.4 } add proposed Required Action C.1 Note

L.5 } Required Actions C.1 and C.2

2) Demonstrate the insertion capability of the inoperable withdrawn control rod(s) by inserting the inoperable withdrawn control rod(s) at least one notch by drive water pressure within the normal operating range. M.6

b. With the provisions of ACTION 2.a above not met, fully insert the inoperable withdrawn control rod(s) and disarm the associated directional control valvesSM either:

- 1) Electrically, or
- 2) Hydraulically by closing the drive water and exhaust water isolation valves. (CRA) LA.1

M.6

b The inoperable control rod may then be withdrawn to a position no further withdrawn than its position when found to be inoperable. A.B

a May be reformed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.1


REACTIVITY CONTROL

CR OPERABILITY 3/4.3.C

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

Required
Action
C.2

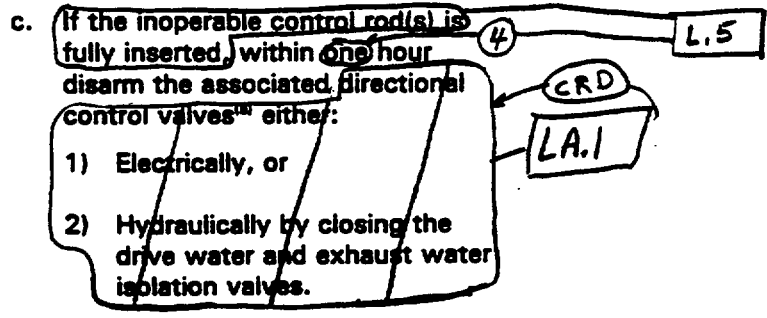

ACTION F 3. With the provisions of ACTION 2 above not met, be in at least HOT SHUTDOWN within the next 12 hours.

ACTION F 4. With more than 8 control rods inoperable, be in at least HOT SHUTDOWN within 12 hours.

A. B

a May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.11

ITS 3.1.3

REACTIVITY CONTROL

(general organization) - A.10

Maximum Scram Times 3/4.3.D

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

D. Maximum Scram Insertion Times

D. Maximum Scram Insertion Times

SR 3.1.3.4

The maximum scram insertion time of each control rod from the fully withdrawn position to 90% insertion, based on de-energization of the scram pilot valve solenoids as time zero, shall not exceed 7 seconds.

A.11

The maximum scram insertion time of the control rods shall be demonstrated through measurement with reactor coolant pressure greater than 800 psig and, during single control rod scram time tests, with the control rod drive pumps isolated from the accumulators:

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

With the maximum scram insertion time of one or more control rods exceeding 7 seconds:

ACTION A
or ACTION C

1. Declare the control rod(s) exceeding the above maximum scram insertion time inoperable, and

L.6

2. When operation is continued with three or more control rods with maximum scram insertion times in excess of 7 seconds, perform Surveillance Requirement 4.3.D.3 at least once per 60 days of POWER OPERATION.

With the provisions of the ACTION above not met, be in at least HOT SHUTDOWN within 12 hours.

1. For all control rods prior to THERMAL POWER exceeding 40% of RATED THERMAL POWER:
 - a. following CORE ALTERATION(s), or
 - b. after a reactor shutdown that is greater than 120 days,
2. For specifically affected individual control rodsSM following maintenance on or modification to the control rod or control rod drive system which could affect the scram insertion time of those specific control rods, and
3. For at least 10% of the control rods, on a rotating basis, at least once per 120 days of POWER OPERATION.

A.12 - add proposed SR 3.1.3.4

<see ITS 3.1.4

a The provisions of Specification 4.0.D are not applicable provided this surveillance is conducted prior to exceeding 40% of RATED THERMAL POWER.

A.1

REACTIVITY CONTROL

Maximum Scram Times 3/4.3.D

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

D. Maximum Scram Insertion Times

The maximum scram insertion time of each control rod from the fully withdrawn position to 90% insertion, based on de-energization of the scram pilot valve solenoids as time zero, shall not exceed 7 seconds.

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

With the maximum scram insertion time of one or more control rods exceeding 7 seconds:

1. Declare the control rod(s) exceeding the above maximum scram insertion time inoperable, and
2. When operation is continued with three or more control rods with maximum scram insertion times in excess of 7 seconds, perform Surveillance Requirement 4.3.D.3 at least once per 60 days of POWER OPERATION.

With the provisions of the ACTION above not met, be in at least HOT SHUTDOWN within 12 hours.

see ITS 3.1.3

M.1

D. Maximum Scram Insertion Times

SR 3.1.4.1, SR 3.1.4.2, SR 3.1.4.4

or equal to

The maximum scram insertion time of the control rods shall be demonstrated through measurement with reactor coolant pressure greater than 800 psig and, during single control rod scram time tests, with the control rod drive pumps isolated from the accumulators: NOTE to Surveillance Requirements

1. For all control rods prior to THERMAL POWER exceeding 40% of RATED THERMAL POWER:

L.1

SR 3.1.4.4

a. following CORE ALTERATION(s), or

SR 3.1.4.1

b. after a reactor shutdown that is greater than 120 days.

add proposed SR 3.1.4.3

SR 3.1.4.4

2. For specifically affected individual control rods following maintenance on or modification to the control rod or control rod drive system which could affect the scram insertion time of those specific control rods, and

M.1

SR 3.1.4.2

3. For at least 10% of the control rods, on a rotating basis, at least once per 120 days of POWER OPERATION.

LA.1

A.2

SR 3.1.4.4

The provisions of Specification 4.0.D are not applicable provided this surveillance is conducted prior to exceeding 40% of RATED THERMAL POWER.

REACTIVITY CONTROL

A.1

Average Scram Times 3/4.3.E

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

E. Average Scram Insertion Times

E. Average Scram Insertion Times

The average scram insertion time of all OPERABLE control rods from the fully withdrawn position, based on de-energization of the scram pilot valve solenoids as time zero, shall not exceed any of the following:

The control rod average scram times shall be demonstrated by scram time testing from the fully withdrawn position as required by Surveillance Requirement 4.3.D.

Footnote (a) to Table 3.1.4-1

SR 3.1.4.1, SR3.1.4.2 and SR3.1.4.4

<u>% Inserted From Fully Withdrawn</u>	<u>Avg. Scram Insertion Times (sec)</u>
5	0.375
20	0.900
50	2.00
90	3.50

M,2

add proposed L to 3.1.4 and Table 3.1.4-1

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION A

With the average scram insertion time exceeding any of the above limits, be in at least HOT SHUTDOWN within 12 hours.

REACTIVITY CONTROL

A.1

Group Scram Times 3/4.3.F

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

F. Group Scram Insertion Times

F. Group Scram Insertion Times

The average of the scram insertion times, from the fully withdrawn position, for the three fastest control rods of all groups of four control rods in a two-by-two array, based on de-energization of the scram pilot valve solenoids as time zero, shall not exceed any of the following:

All control rods shall be demonstrated OPERABLE by scram time testing from the fully withdrawn position as required by Surveillance Requirement 4.3.D.

SR 3.1.1.1, SR 3.1.4.2, and SR 3.1.4.4

add proposed LCO 3.1.4 and Table 3.1.4-1

Footnote (a) to Table 3.1.4-1

% Inserted From Fully Withdrawn	Avg. Scram Insertion Times (sec)
5	0.398
20	0.954
50	2.120
90	3.800

M.2

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION A

With the average scram insertion times of control rods exceeding the above limits:

1. Declare the control rods exceeding the above average scram insertion times inoperable until an analysis is performed to determine that required scram reactivity remains for the slow four control rod group, and
2. When operation is continued with an average scram insertion time(s) in excess of the average scram insertion time limit, perform Surveillance Requirement 4.3.D.3 at least once per 60 days of power operation.

M.2

With the provisions of the ACTION(s) above not met, be in at least HOT SHUTDOWN within 12 hours.

A.11

ITS 3.1.5

REACTIVITY CONTROL

Scram Accumulators 3/4.3.G

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

G. Control Rod Scram Accumulators

G. Control Rod Scram Accumulators

LLO 3.1.5

All control rod scram accumulators shall be OPERABLE.

Each control rod scram accumulator shall be determined OPERABLE at least once per 7 days by verifying that the indicated pressure is ≥ 940 psig unless the control rod is fully inserted and disarmed, or scrambled.

SR 3.1.5.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 5th

A.2 moved to ITS 3.9.5

A.6

ACTION:

add proposed ACTIONS Note

1. In OPERATIONAL MODE 1 or 2:

ACTION A

a. With one control rod scram accumulator inoperable, within 8 hours:

with reactor scram done pressure ≥ 900 psig

1) Restore the inoperable accumulator to OPERABLE status, or

A.4

M.1

add proposed Required Action A.1

L.1

2) Declare the control rod associated with the inoperable accumulator inoperable.

Required Action A.2

b. With the provisions of ACTION 1.a above not met, be in at least HOT SHUTDOWN within the next 12 hours.

A.5

M.1

L.1

ACTION B
ACTION C

c. With more than one control rod scram accumulator inoperable, declare the associated control rods inoperable and:

add proposed Required Action B.2.1

Required Actions B.2.2, C.2

within 1 hour

L.1

A.2 moved to LLO 3.9.5

a In OPERATIONAL MODE 5, this Specification is applicable for the accumulators associated with each withdrawn control rod and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

A.11

ITS 3.9.5
Scram Accumulators 3/4.3.G

REACTIVITY CONTROL

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

G. Control Rod Scram Accumulators

G. Control Rod Scram Accumulators

All control rod scram accumulators shall be OPERABLE.

Each control rod scram accumulator shall be determined OPERABLE at least once per 7 days by verifying that the indicated pressure is ≥ 940 psig unless the control rod is fully inserted and disarmed, or scrambled.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 5^(a)

ACTION:

1. In OPERATIONAL MODE 1 or 2:
 - a. With one control rod scram accumulator inoperable, within 8 hours:
 - 1) Restore the inoperable accumulator to OPERABLE status, or
 - 2) Declare the control rod associated with the inoperable accumulator inoperable.
 - b. With the provisions of ACTION 1.a above not met, be in at least HOT SHUTDOWN within the next 12 hours.
 - c. With more than one control rod scram accumulator inoperable, declare the associated control rods inoperable and:

A.2

SR 3.9.5.1

A.3

add proposed control rod scram insertion capability

A.4

M.1

add proposed SR 3.9.5.1

(see ITS 3.1.5)

A.2

In OPERATIONAL MODE 5, this Specification is applicable for the accumulators associated with each withdrawn control rod and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

A.3

A.1

ITS 3.1.5

REACTIVITY CONTROL

Scram Accumulators 3/4.3.G

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

Required Action D.1 Note
 Required Actions B.1 and C.1
 ACTION D

1) If the control rod associated with any inoperable scram accumulator is withdrawn, immediately verify that at least one control rod drive pump is operating by inserting at least one withdrawn control rod at least one notch. With no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.

A.7 L.2

2) Fully insert the inoperable control rods and disarm the associated directional control valves^(b) either:

a) Electrically or
 b) Hydraulically by closing the drive water and exhaust water isolation valves.

d. With the provisions of ACTION 1.c.2 above not met, be in at least HOT SHUTDOWN within 12 hours.

A.8

2. In OPERATIONAL MODE 5^(a)

a. With one withdrawn control rod with its associated scram accumulator inoperable, fully insert the affected control rod and disarm the associated directional control valves^(b) within one hour, either:

A.2 moved to ITS 3.9.5

A.2 moved to ITS 3.9.5

a In OPERATIONAL MODE 5, this Specification is applicable for the accumulators associated with each withdrawn control rod and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

b May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

REACTIVITY CONTROL

ITS 3.9.5
Scram Accumulators 3/4.3.G

A.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

1) If the control rod associated with any inoperable scram accumulator is withdrawn, immediately verify that at least one control rod drive pump is operating by inserting at least one withdrawn control rod at least one notch. With no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.

2) Fully insert the inoperable control rods and disarm the associated directional control valvesTM either:

- a) Electrically, or
- b) Hydraulically by closing the drive water and exhaust water isolation valves.

d. With the provisions of ACTION 1.c.2 above not met, be in at least HOT SHUTDOWN within 12 hours.

2. In OPERATIONAL MODE 5

a. With one withdrawn control rod with its associated scram accumulator inoperable, fully insert the affected control rod and disarm the associated directional control valvesTM within one hour, either:

<see ITS 3.1.5>

M.1

add proposed ACTION A for control rod scram insertion capability

ACTION A

A.3 A.2
A.5

- a. In OPERATIONAL MODE 5, this Specification is applicable for the accumulators associated with each withdrawn control rod and is not applicable to control rods removed per Specification 3.10.1 or 3.10.J.
- b. May be rearmed intermittently under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.1

ITS 3.10.7

Scram Accumulators 3/4.3.G

REACTIVITY CONTROL

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

- 1) If the control rod associated with any inoperable scram accumulator is withdrawn, immediately verify that at least one control rod drive pump is operating by inserting at least one withdrawn control rod at least one notch. With no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.
- 2) Fully insert the inoperable control rods and disarm the associated directional control valvesSM either:
 - a) Electrically, or
 - b) Hydraulically by closing the drive water and exhaust water isolation valves.
- d. With the provisions of ACTION 1.c.2 above not met, be in at least HOT SHUTDOWN within 12 hours.

See ITS 3.1.5

2. In OPERATIONAL MODE 5SM

A.7

M.1

- a. With one withdrawn control rod with its associated scram accumulator inoperable, fully insert the affected control rod and disarm the associated directional control valvesSM within one hour, either:

- a In OPERATIONAL MODE 5, this Specification is applicable for the accumulators associated with each withdrawn control rod and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.
- b May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.1

ITS 3.1.5

REACTIVITY CONTROL

Scram Accumulators 3/4.3.G

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

- 1) Electrically, or
 - 2) Hydraulically by closing the drive water and exhaust water isolation valves.
- b. With more than one withdrawn control rod with the associated scram accumulator inoperable or no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.

A.2

moved to
ITS 3.9.5

REACTIVITY CONTROL

A.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

- 1) Electrically, or
- 2) Hydraulically by closing the drive water and exhaust water isolation valves.

A.5

b. With more than one withdrawn control rod with the associated scram accumulator inoperable or no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.

A.5 moved to ITS 3.10.7

REACTIVITY CONTROL

A.1

ITS 3.10.7
Scram Accumulators 3/4.3.G

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

- 1) Electrically, or
- 2) Hydraulically by closing the drive water and exhaust water isolation valves.

<See ITS 3.1.5>

LCD 3.10.7.f
and
ACTION B

- b. ~~With more than one withdrawn control rod with the associated scram accumulator inoperable or no control rod drive pump operating, immediately place the reactor mode switch in the Shutdown position.~~

A.7

M.1

A.1

ITS 3.1.3

REACTIVITY CONTROL

CRD Coupling 3/4.3.H

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

SR 3.1.3.5

H. Control Rod Drive Coupling

H. Control Rod Drive Coupling

All control rods shall be coupled to their drive mechanisms.

A.13

SR 3.1.3.5

Each affected control rod shall be demonstrated to be coupled to its drive mechanism by verifying that the control rod drive does not go to the overtravel position:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 5(a).

L.7

ACTION:

1. In OPERATIONAL MODE 1 or 2 with one control rod not coupled to its associated drive mechanism, within 2 hours:

L.5

a. If permitted by the RWM, insert the control rod drive mechanism to accomplish recoupling and verify recoupling by withdrawing the control rod, and:

A.14

(1) Observing any indicated response of the nuclear instrumentation, and

L.10

(2) Demonstrating that the control rod will not go to the overtravel position.

L.8

L.9

b. If not permitted by the RWM or, if recoupling is not accomplished in accordance with ACTION 1.a above, then declare the control rod inoperable, fully insert the control rod and disarm the associated

ACTION C

directional control valves either:

CRD

(1) Electrically, or

LA.1

L.7

a. In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

b. May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

A.8

A.1

ITS 3.1.3

REACTIVITY CONTROL

CRD Coupling 3/4.3.H

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

2) Hydraulically by closing the drive water and exhaust water isolation valves.

L.A.1

ACTION F

2. With the provisions of ACTION 1 above not met, be in at least HOT SHUTDOWN within 12 hours.

3. In OPERATIONAL MODE 5^(a) with a withdrawn control rod not coupled to its associated drive mechanism, within 2 hours:

a. Insert the control rod to accomplish recoupling and verify recoupling by withdrawing control rod and demonstrating that the control rod will not go to the overtravel position, or

b. If recoupling is not accomplished, declare the control rod inoperable, fully insert the control rod and disarm the associated directional control valves^(b) within one hour, either:

1) Electrically, or

2) Hydraulically by closing the drive water and exhaust water isolation valves.

L.7

L.7

a In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3/10.1 or 3.10.1

b May be returned intermittently under administrative control, to permit testing associated with restoring the control rod to OPERABLE status.

L.7

A.1

REACTIVITY CONTROL

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

I. Control Rod Position Indication System

I. Control Rod Position Indication System

SR 3.1.3.1

All control rod position indicators shall be OPERABLE.

SR 3.1.3.1

The control rod position indication system shall be determined OPERABLE by verifying:

A.15

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 5th.

moved to ITS 3.9.4

A.16

ACTION:

2. That the indicated control rod position changes during the movement of the control rod drive when performing Surveillance Requirement 4.3.C.1.

L.11

ACTION C

1. In OPERATIONAL MODE 1 or 2 with one or more control rod position indicators inoperable, within one hour either:

L.5

a. Determine the position of the control rod by an alternate method.

LA.2

b. Move the control rod to a position with an OPERABLE position indicator, or

LA.2

c. Declare the control rod inoperable, fully insert the inoperable withdrawn control rod(s), and disarm the associated directional control valvesSM either:

CRD

- 1) Electrically, or
- 2) Hydraulically by closing the drive water and exhaust water isolation valves.

LA.1

A.16 moved to ITS 3.9.4

a In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

b May be rechecked intermittently, under administrative control, to permit testing associated with restoring the control rod(s) to OPERABLE status.

A.8

REACTIVITY CONTROL

A.1

ITS 3.9.4

RPIS 3/4.3.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

I. Control Rod Position Indication System

LC03.9.4

All control rod position indicators shall be OPERABLE.

Each A.1

"full-in"

channel

L.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 5

M.1

ACTION:

1. In OPERATIONAL MODE 1 or 2 with one or more control rod position indicators inoperable, within one hour either:
 - a. Determine the position of the control rod by an alternate method, or
 - b. Move the control rod to a position with an OPERABLE position indicator, or
 - c. Declare the control rod inoperable, fully insert the inoperable withdrawn control rod(s), and disarm the associated directional control valves² either:
 - 1) Electrically, or
 - 2) Hydraulically by closing the drive water and exhaust water isolation valves.

I. Control Rod Position Indication System

The control rod position indication system shall be determined OPERABLE by verifying:

Full-in

channel

L.1

1. At least once per 24 hours that the position of each control rod is indicated. L.1
2. That the indicated control rod position changes during the movement of the control rod drive when performing Surveillance Requirement 4.3.C.1. L.1
3. Deleted.

{see ITS 3.1.3}

- a ~~In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3.10.1 of 3.18.1~~ M.1
- b May be rearmed intermittently, under administrative control, to permit testing associated with restoring the control rod(s) to OPERABLE status. A.2

QUAD CITIES - UNITS 1 & 2

3/4.3-14

Amendment Nos. 171 & 167

Page 1 of 2

{see ITS 3.1.3}

A.1

REACTIVITY CONTROL

RPIS 3/4.3.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

ACTION
F

- 2. With the provisions of ACTION 1 above not met, be in at least HOT SHUTDOWN within the next 12 hours.

3. In OPERATIONAL MODE 5⁰⁴ with a withdrawn control rod position indicator inoperable:

- a. Move the control rod to a position with an OPERABLE position indicator, or
- b. Fully insert the control rod.

A.16 moved to ITS 3.9.4

A.16 moved to ITS 3.9.4

a In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3.10.I or 3.10.J.

REACTIVITY CONTROL

A.1

ITS 3.9.4

RPIS 3/4.3.1

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

2. With the provisions of ACTION 1 above not met, be in at least HOT SHUTDOWN within the next 12 hours.

see ITS 3.1.3

M.1

ACTION A

3. In OPERATIONAL MODE 5 with a ~~withdrawn~~ control rod position indicator inoperable:

Fault in

L.1

add proposed A.3 ACTIONS Note

a. Move the control rod to a position with an OPERABLE position indicator, or

M.1

b. Fully insert the control rod.

M.1

~~a. In OPERATIONAL MODE 5, this Specification is applicable for withdrawn control rods and is not applicable to control rods removed per Specification 3.10.1 or 3.10.2.~~

A.2

REACTIVITY CONTROL

CRD Housing Support 3/4.3.J

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

J. Control Rod Drive Housing Support

The control rod drive housing support shall be in place.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 3.

ACTION:

With the control rod drive housing support not in place, be in at least HOT SHUTDOWN within 12 hours and in at least COLD SHUTDOWN within the following 24 hours.

J. Control Rod Drive Housing Support

The control rod drive housing support shall be verified to be in place by a visual inspection prior to startup any time it has been disassembled or when maintenance has been performed in the control rod drive housing support area.

L.1

A.1

REACTIVITY CONTROL

SDV Vents & Drains 3/4.3.K

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

K. SDV Vent and Drain Valves

K. SDV Vent and Drain Valves

LCO 3.1.8 All scram discharge volume (SDV) vent and drain valves shall be OPERABLE.

The scram discharge volume vent and drain valves shall be demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION A 1. With^{one} one or more SDV vent or drain lines with one valve inoperable, isolate^{the} the associated line within 7 days or be in HOT SHUTDOWN within the next 12 hours.

ACTION C

ACTION B 2. With^{one} one or more SDV vent or drain lines with both valves inoperable, isolate^{the} the associated line within 8 hours or be in HOT SHUTDOWN within the next 12 hours.

ACTION C

SR 3.1.8.1

1. At least once per 31 days by verifying each valve to be open^{ed}, and

SR 3.1.8.2

2. At least once per 92 days by cycling each valve through at least one complete cycle of travel.

24

LD.1

SR 3.1.8.3

3. At least once per 24 months, the scram discharge volume vent and drain valves shall be demonstrated to:

a. Close within 30 seconds after receipt of a signal for control rods to scram, and

b. Open after the scram signal is reset.

actual or simulated

A.2

ACTIONS

Note 1) b

Separate Action statement entry is allowed for each SDV vent and drain line.

ACTIONS } c

Note 2

An isolated line may be unisolated under administrative control to allow draining and venting of the SDV.

Note to } a

SR 3.1.8.1

These valves may be closed intermittently for testing under administrative controls.

REACTIVITY CONTROL

RWM 3/4.3.L

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

L Rod Worth Minimizer (RWM)

L Rod Worth Minimizer (RWM)

LCO 3.3.2.1 and Table 3.3.2.1-1 Function 2

The rod worth minimizer (RWM) shall be OPERABLE.

The RWM shall be demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2, when thermal power is less than or equal to 10% of RATED THERMAL POWER.

SR 3.3.2.1.8

1. By verifying that the control rod patterns and sequence input to the RWM computer are correctly loaded following any loading of the program into the computer.

Add proposed Note to SR 3.3.2.1.2

SR 3.3.2.1.2

2. In OPERATIONAL MODE 2 within 8 hours prior to withdrawal of control rods for the purpose of making the reactor critical:

a. by verifying proper indication of the selection error of at least one out-of-sequence control rod.

b. By verifying the rod block function.

3. In OPERATIONAL MODE 1, prior to reducing thermal power below 10% of RATED THERMAL POWER:

a. by verifying proper indication of the selection error of at least one out-of-sequence control rod.

b. by verifying the rod block function.

SR 3.3.2.1.3

Add proposed Note to SR 3.3.2.1.3

ACTION:

With the RWM inoperable, verify control rod movement and compliance with the prescribed control rod pattern by a second licensed operator or technically qualified individual who is present at the reactor control console. Otherwise, control rod movement may be made only by actuating the manual scram or placing the reactor mode switch in the Shutdown position.

add proposed Required Actions C.2.1.1 and C.2.1.2

Conditions C and D

Required Actions C.2.2 and D.1

Required Action C.1

a Entry into OPERATIONAL MODE 2 and withdrawal of selected control rods is permitted for the purpose of determining the OPERABILITY of the RWM prior to withdrawal of control rods for the purpose of bringing the reactor to criticality.

A.1

REACTIVITY CONTROL

RBM 3/4.3.M

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

M. Rod Block Monitor (RBM)

M. Rod Block Monitor (RBM)

LCO 3.3.2.1
and Table
3.3.2.1-1
Function 1

Both rod block monitor (RBM) CHANNEL(s) shall be OPERABLE.

Each of the required RBM CHANNEL(s) shall be demonstrated OPERABLE by performance of a:

APPLICABILITY:

OPERATIONAL MODE 1, when thermal power is greater than or equal to 30% of RATED THERMAL POWER

and no peripheral rod is selected

ACTION:

1. With one RBM CHANNEL inoperable:

a. Verify that the reactor is not operating in a LIMITING CONTROL ROD PATTERN, and

b. Restore the inoperable RBM CHANNEL to OPERABLE status within 24 hours.

2. With the provisions of ACTION 1 above not met, place the inoperable rod block monitor CHANNEL in the tripped condition within the next one hour.

3. With both RBM CHANNEL(s) inoperable, place at least one inoperable rod block monitor CHANNEL in the tripped condition within one hour.

ACTION A

ACTION B

SR 3.3.2.1
SR 3.3.2.1

A.3

1. CHANNEL FUNCTIONAL TEST and CHANNEL CALIBRATION at the frequencies and for the OPERATIONAL MODE(s) specified in Table 4.2.E-1.

2. CHANNEL FUNCTIONAL TEST prior to control rod withdrawal when the reactor is operating in a LIMITING CONTROL ROD PATTERN, but no more often than daily.

L.3

L.3

REACTIVITY CONTROL

R.1

EGC 3/4.3.N

3.3 - LIMITING CONDITIONS FOR OPERATION

4.3 - SURVEILLANCE REQUIREMENTS

N. Economic Generation Control (EGC) System

N. Economic Generation Control (EGC) System

The economic generation control (EGC) system may be in operation with automatic flow control provided:

The economic generation control system shall be demonstrated OPERABLE by verifying that core flow is within 65% to 100% of rated core flow and THERMAL POWER is $\geq 20\%$ of RATED THERMAL POWER:

- 1 Core flow is within 65% to 100% of rated core flow, and
- 2. THERMAL POWER is $\geq 20\%$ of RATED THERMAL POWER.

- 1 Prior to entry into EGC operation, and
- 2. At least once per 12 hours while operating in EGC.

APPLICABILITY

OPERATIONAL MODE 1.

ACTION:

With core flow less than 65% or greater than 100% of rated core flow, or THERMAL POWER less than 20% of RATED THERMAL POWER, restore operation to within the limits within one hour. Otherwise, immediately remove the plant from EGC operation.

A.1

STANDBY LIQUID CONTROL SYSTEM

SLCS 3/4.4.A

3.4 - LIMITING CONDITIONS FOR OPERATION

4.4 - SURVEILLANCE REQUIREMENTS

A. Standby Liquid Control System (SLCS)

A. Standby Liquid Control System

LCO 3.1.7

The standby liquid control system (SLCS) shall be OPERABLE.

The standby liquid control system shall be demonstrated OPERABLE:

APPLICABILITY:

1. At least once per 24 hours by verifying that:

OPERATIONAL MODE(s) 1 and 2.

SR 3.1.7.2

ACTION:

a. The temperature of the sodium pentaborate solution is greater than or equal to the limits of Figure 3.4.A-1.

b. The volume of the sodium pentaborate solution is greater than or equal to the limits shown in Figure 3.4.A-2.

c. The temperature of the pump suction piping to be greater than or equal to 83°F.

SR 3.1.7.1

SR 3.1.7.3

2. At least once per 31 days by:

a. Verifying the continuity of the explosive charge.

b. Determining^{ed} (by physical analysis) that the available concentration of boron in solution is 14% by weight to 16.5% by weight. *within limits of Figure 3.1.7.1*

c. Verifying that each valve, manual, power operated or automatic, in the flow path that is not locked, sealed, or otherwise secured in position, is in the correct position, or can be aligned to the correct position.

SR 3.1.7.6

ACTION A

ACTION C

ACTION B

ACTION C

1. With one subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours.

2. With both standby liquid control subsystems inoperable, restore at least one subsystem to OPERABLE status within 8 hours or be in at least HOT SHUTDOWN within the next 12 hours.

once within 24 hours after M.1

SR 3.1.7.5

a This surveillance shall also be performed anytime water or boron is added to the solution or when the solution temperature drops below the limits specified by Figure 3.4.A-1.

ITS 3.1.7

A.1

STANDBY LIQUID CONTROL SYSTEM

SLCS 3/4.4.A

3.4 - LIMITING CONDITIONS FOR OPERATION

4.4 - SURVEILLANCE REQUIREMENTS

SR 3.1.7.7

- 3. When tested pursuant to Specification 4.O.E, by demonstrating that the minimum flow requirement of 40 gpm per pump at a pressure of greater than or equal to 1275 psig is met.

24 SR 3.1.7.8

- 4. At least once per 12 months by: D.1

- a. Initiating one of the standby liquid control subsystems, ~~verifying~~ ~~and~~ ~~verifying~~ that a flow path from the pumps to the reactor pressure vessel is available. Both injection loops shall be tested ~~in 36~~ months.



- b. Deleted

- c. Demonstrating that the pump suction line from the storage tank is not plugged.

SR 3.1.7.9

A.1

ITS 3.1.7

STANDBY LIQUID CONTROL SYSTEM

SLCS 3/4.4.A

Figure 3.1.7-2

FIGURE 3.4.A-1

SODIUM PENTABORATE SOLUTION TEMPERATURE REQUIREMENTS


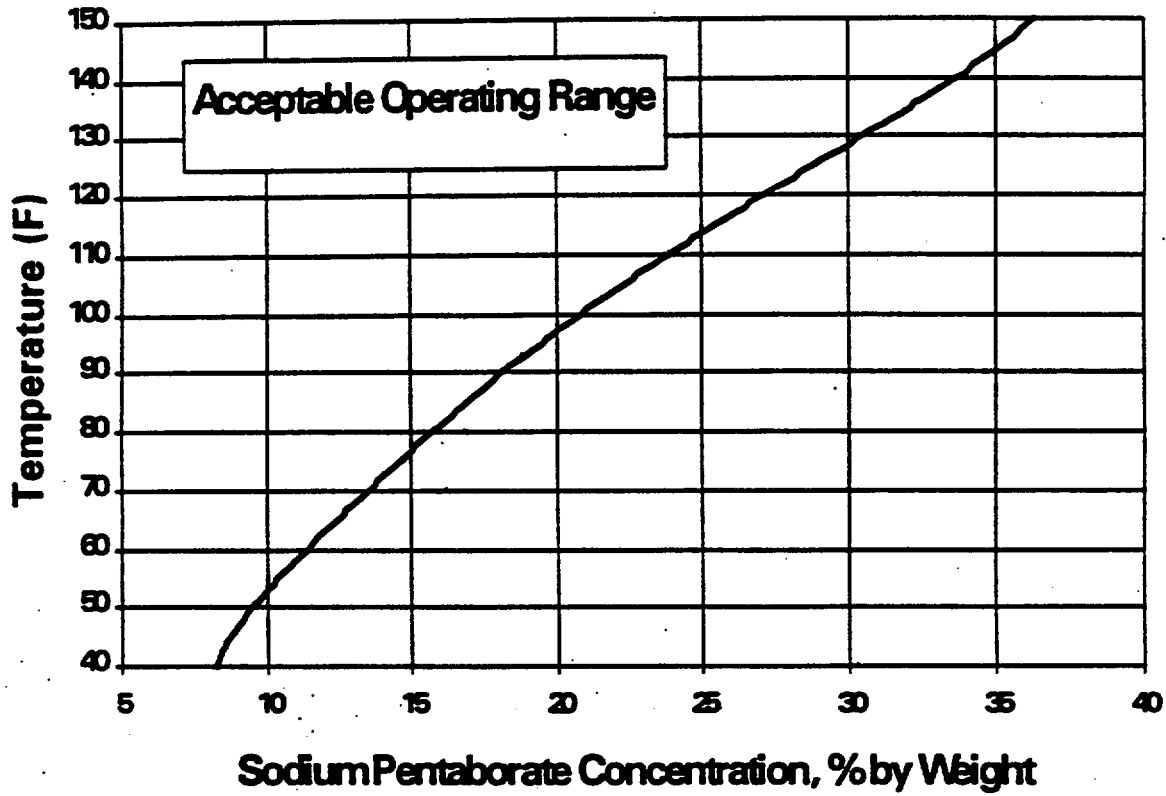


Figure 3.1.7-1
FIGURE 3.4.A-2

SODIUM PENTABORATE SOLUTION VOLUME REQUIREMENTS

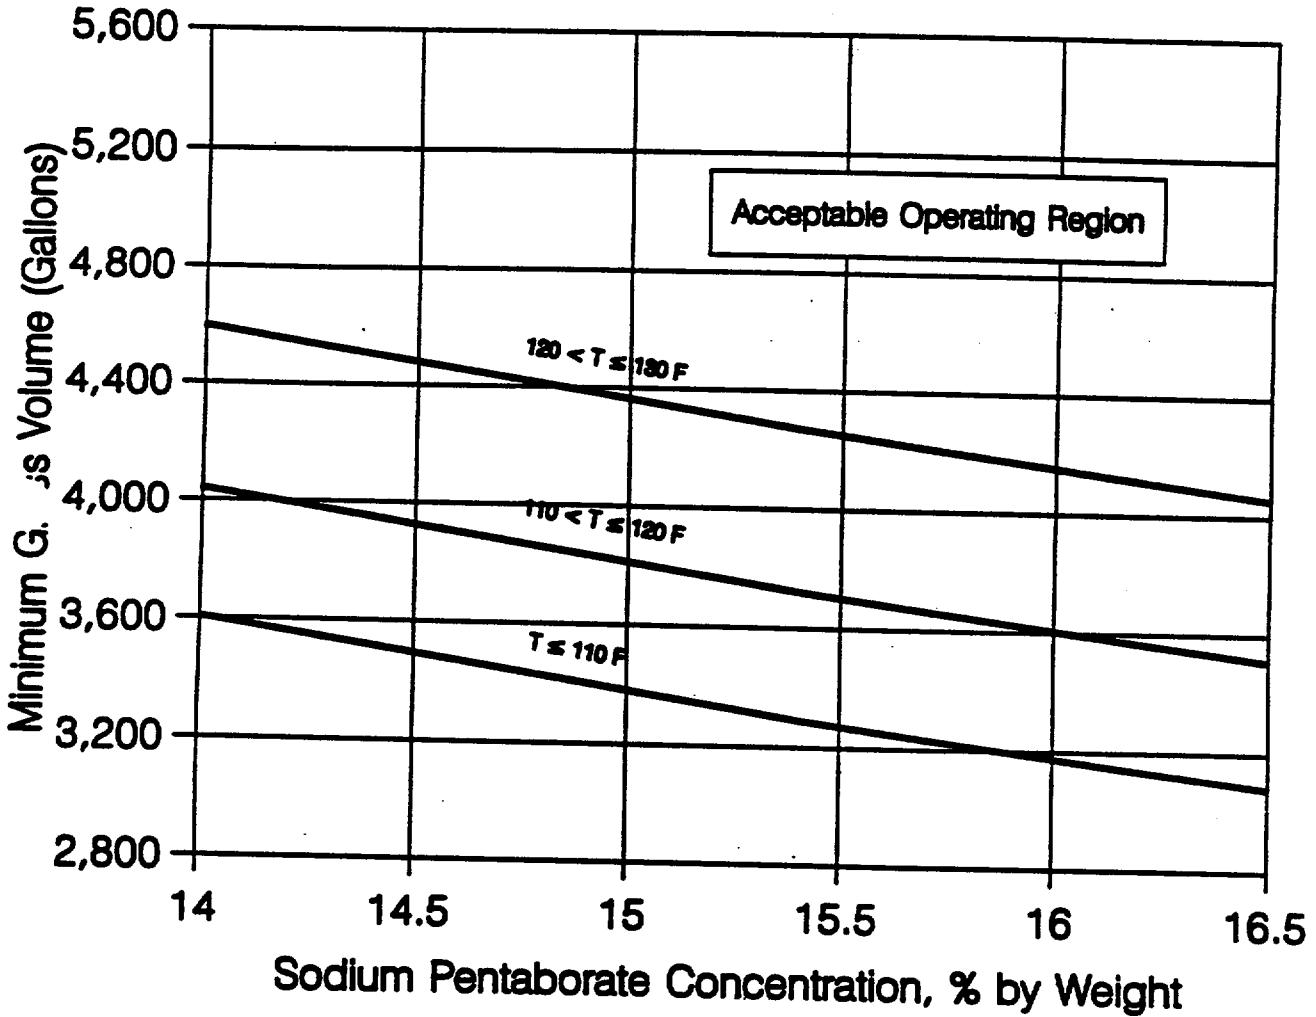

A.1

ITS 3.5.1
ECCS - Operating 3/4.5.A

EMERGENCY CORE COOLING SYSTEMS

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

A. Emergency Core Cooling System - Operating

A. Emergency Core Cooling System - Operating

ECO 3.5.1

The emergency core cooling systems (ECCS) shall be OPERABLE with:

The ECCS shall be demonstrated OPERABLE by:

- 1. The core spray (CS) system consisting of two subsystems with each subsystem comprised of:
 - a. One OPERABLE CS pump, and
 - b. An OPERABLE flow path capable of taking suction from the suppression chamber and transferring the water through the spray sparger to the reactor vessel.

- 1. At least once per 31 days:
 - a. For the CS system, the LPCI subsystem and the HPCI system:
 - 1) Verifying that the system piping from the pump discharge valve to the system isolation valve is filled with water.

M.1

- 2. The low pressure coolant injection (LPCI) subsystem comprised of:
 - a. Four OPERABLE LPCI pumps, and
 - b. An OPERABLE flow path capable of taking suction from the suppression chamber and transferring the water to the reactor vessel.

- 2) Verifying that each valve, manual, power operated or automatic, in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.

- b. For the HPCI system, verifying that the HPCI pump flow controller is in the correct position.

- 3. The high pressure/cooling injection (HPCI) system consisting of:
 - a. One OPERABLE HPCI pump, and
 - b. An OPERABLE flow path capable of taking suction from the suppression chamber and transferring the water to the reactor vessel.

← add proposed SR 3.5.1.3, SR 3.5.1.4, and SR 3.5.1.11

SR 3.5.1.2 Note

- e The LPCI subsystem may be considered OPERABLE during alignment and operation for decay heat removal when below the actual RHR cut in permissive pressure in MODE 3, if capable of being manually realigned (remote or local)
- a Except that an automatic valve capable of automatic return to its ECCS position when an ECCS signal is present may be in position for another mode of operation.

EMERGENCY CORE COOLING SYSTEMS

A.1

ITC 3.5.1
ECCS - Operating 3/4.5.A

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

LCO 3.5.1
4. The automatic depressurization system (ADS) with at least 3 OPERABLE ADS valves.

4 - L.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2nd and 3rd.

ACTION:

1. For the core spray system:

a. With one CS subsystem inoperable, provided that the LPCI subsystem is OPERABLE, restore the inoperable CS subsystem to OPERABLE status within 7 days, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

ACTION E

b. With both CS subsystems inoperable, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION J

2. For the LPCI subsystem:

a. With one LPCI pump inoperable, provided that both CS subsystems are OPERABLE, restore the inoperable LPCI pump to OPERABLE status within 30 days,

ACTION A

2. Verifying that, when tested pursuant to Specification 4.0.E:

a. The CS pump in each subsystem develop a flow of at least 4500 gpm against a test line pressure corresponding to a reactor vessel pressure of ≥ 90 psig.

b. Two LPCI pumps together develop a flow of at least 9,000 gpm against a test line pressure corresponding to a reactor vessel pressure of ≥ 20 psig.

c. The HPCI pump develops a flow of at least 5000 gpm against a system head corresponding to reactor vessel pressure, when steam is being supplied to the turbine between 920 and 1005 psig.

SR 3.5.1.5

SR 3.5.1.6

3. At least once per 18 months:

a. For the CS system, the LPCI subsystem, and the HPCI system, verify each system/subsystem actuates on an actual or simulated automatic initiation signal. Actual injection of coolant into the reactor vessel may be excluded from this test.

SR 3.5.1.8

A.3

24

L.P.1

A.2

b The HPCI system and ADS are not required to be OPERABLE when reactor steam dome pressure is ≤ 150 psig.

f The provisions of Specification 3.9.A, Actions 4.a or 6.b are applicable to the LPCI subsystem such that with an inoperable diesel generator, for the remaining OPERABLE diesel generator, both LPCI pumps (and their associated flow path) associated with that OPERABLE diesel generator, shall be OPERABLE. Otherwise, enter Specification 3.5.A/Action 2.c.

A.2

c The provisions of Specification 4.0.D are not applicable provided the surveillance is performed within 12 hours after reactor steam pressure is adequate to perform the test.

and flow

A.3

QUAD CITIES - UNITS 1 & 2

3/4.5-2

Amendment Nos. 171 & 167

Page 2 of 5

applicability

SR 3.5.1.6
Note

EMERGENCY CORE COOLING SYSTEMS

A.1

ITS 3.5.1

ECCS - Operating 3/4.5.A

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

ACTION E or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.

M.1

A.2

SR 3.5.1.7

ACTION B
ACTION C

b. With the LPCI subsystem otherwise inoperable, provided that both CS subsystems are **OPERABLE**, restore the LPCI subsystem to **OPERABLE** status within 7 days or be in at

ACTION E

least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.

A.4

M.1

ACTION J

c. With the LPCI subsystem and one or both CS subsystems inoperable, be in at least **HOT SHUTDOWN** within 12 hours and in **COLD SHUTDOWN** within the next 24 hours.

A.4

Enter LLO 3.0.3

M.3

c. Performing a **CHANNEL CALIBRATION** of the ECCS discharge line "keep filled" alarm instrumentation.

L.2

ACTION F

3. With the HPCI system inoperable, provided both CS subsystems, the LPCI subsystem, the ADS and the Reactor Core Isolation Cooling (RCIC) system are **OPERABLE**, restore the HPCI system to **OPERABLE** status within 14 days or be in at least **HOT SHUTDOWN** within the next 12 hours

d. Deleted.

ACTION I

and reduce reactor steam dome pressure to ≤ 150 psig within the following 24 hours.

add proposed **ACTION G**

L.3

f The provisions of Specification 3.9.A. Actions 4.a or 6.b are applicable to the LPCI subsystem such that with an inoperable diesel generator, for the remaining **OPERABLE** diesel generator, both LPCI pumps (and their associated flow path) associated with that **OPERABLE** diesel generator, shall be **OPERABLE**. Otherwise, enter Specification 3.5.A, Action 2.c.

A.2

d Whenever the two required RHR SDC mode subsystems are inoperable, if unable to attain **COLD SHUTDOWN** as required by this ACTION, maintain reactor coolant temperature as low as practical by use of alternate heat removal methods.

A.4

SR 3.5.1.7 c Note

The provisions of Specification 4.0.D are not applicable provided the surveillance is performed within 12 hours after reactor steam pressure is adequate to perform the test.

QUAD CITIES - UNITS 1 & 2

and flow

3/4.5-3

Amendment Nos. 171 & 167

A.3

EMERGENCY CORE COOLING SYSTEMS

A.1

ITS 3.5.1

ECCS - Operating 3/4.5.A

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

4. For the ADS:

ACTION H

a. With one of the above required ADS valves inoperable, provided the HPCI system, both CS subsystems and three LPCI pumps are OPERABLE, restore the inoperable ADS valve to OPERABLE status within 14 days or be in at

ACTION I

least HOT SHUTDOWN within the next 12 hours and reduce reactor steam dome pressure to ≤ 150 psig within the following 24 hours.

ACTION I

b. With two or more of the above required ADS valves inoperable, be in at least HOT SHUTDOWN within 12 hours and reduce reactor steam dome pressure to ≤ 150 psig within the following 24 hours.

5. With an ECCS discharge line "keep filled" pressure alarm instrumentation CHANNEL inoperable, perform Surveillance Requirement 4.5.A.1.a(1) for CS and LPCI at least once per 24 hours.

L.2

4. At least once per 18 months for the ADS:

24

LD.1

SR 3.5.1.9

a. Verifying the ADS actuates on an actual or simulated automatic initiation signal. Actual valve actuation may be excluded from this test.

required

L.1

SR 3.5.1.10

b. Manually opening each ADS valve when the reactor steam dome pressure is ≥ 150 psig and observing that either:

A.3

- 1) The turbine control valve or turbine bypass valve position responds accordingly, or
- 2) There is a corresponding change in the measured steam flow.

LA.3

add proposed ACTION J **A.5**
M.3

SR 3.5.1.11
Note

c The provisions of Specification 4.0.D are not applicable provided the surveillance is performed within 12 hours after reactor steam pressure is adequate to perform the test.

QUAD CITIES - UNITS 1 & 2

and flow

A.3

3/4.5-4

Amendment Nos. 171 & 167

Page 4 of 5

EMERGENCY CORE COOLING SYSTEMS

A.11

ITS 3.5.1
ECCS - Operating 3/4.5.A

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

6. Deleted.

7. In the event an ECCS system is actuated and injects water into the Reactor Coolant System, a Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.B within 90 days describing the circumstances of the actuation and the total accumulated actuation cycles to date. The current value of the usage factor for each affected safety injection nozzle shall be provided in this Special Report whenever its value exceeds 0.70.

L.4

A.1

ITS 3.5.2

EMERGENCY CORE COOLING SYSTEMS

SR 3.5.2.2
SR 3.5.2.3
SR 3.5.2.4
SR 3.5.2.5

LD.1

ECCS - Shutdown 3/4.5.B

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

B. Emergency Core Cooling System - Shutdown

(low pressure ECCS injection / spray subsystems)

At least two of the following four subsystems/loops shall be OPERABLE^(a):

LA.1

1. One or both core spray (CS) subsystems with:
 - a. An OPERABLE flow path capable of taking suction from at least one of the following water sources and transferring the water through the spray sparger to the reactor vessel:
 - 1) From the suppression chamber, or
 - 2) When the suppression chamber water level is less than the limit or is drained, from the condensate storage tank containing at least 140,000 available gallons of water.

SR 3.5.2.1.6

50,000

L.5

2. One or both low pressure coolant injection (LPCI) subsystem loops with a subsystem loop comprised of:
 - a. At least one OPERABLE LPCI pump, and
 - b. An OPERABLE flow path capable of taking suction from at least one of the following water sources and transferring the water to the reactor vessel:
 - 1) From the suppression chamber, or

LA.1

B. Emergency Core Cooling System - Shutdown

The required ECCS shall be demonstrated OPERABLE per Surveillance Requirement 4.5.A, except:

A.2

1. The LPCI subsystems cross-tie valves may be closed.

LA.1

2. Each LPCI pump develops the required flow when tested pursuant to Specification 4.0.E.

M.1

add proposed flow rate and head conditions for one pump

^a One LPCI subsystem may be aligned for decay heat removal and considered OPERABLE for the ECCS function, if it can be manually realigned (remote or local) to the LPCI mode and is not otherwise inoperable.

LA.2

SR 3.5.2.3
Note

A.1

ITS 3.5.2

ECCS - Shutdown 3/4.5.B

EMERGENCY CORE COOLING SYSTEMS

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

LA.1

2) When the suppression chamber water level is less than the limit or is drained, from the condensate storage tank containing at least 140,000 available gallons of water.

SR 3.5.2.1, b

50,000

L.5

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5th.

ACTION:

ACTION A 1. With one of the above required subsystems/loops inoperable, restore at least two subsystems/loops to **OPERABLE** status within 4 hours or

ACTION B suspend all operations with a potential for draining the reactor vessel.

ACTION C 2. With both of the above required subsystems/loops inoperable, suspend **CORE ALTERATION(s)** and all operations with a potential for draining the reactor vessel. Restore at least one subsystem/loop to **OPERABLE** status within 4 hours or establish

L.1

ACTION D **SECONDARY CONTAINMENT INTEGRITY** within the next 8 hours

A.3

A.4

A.5

Applicability b

The ECCS is not required to be OPERABLE provided that the reactor vessel head is removed, the cavity is flooded, the spent fuel pool gates are removed, and water level is maintained within the limits of Specification 3.10.G and 3.10.H.

EMERGENCY CORE COOLING SYSTEMS

ITS 3.5.2
Suppression Chamber 3/4.5.C

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

C. Suppression Chamber

C. Suppression Chamber

The suppression chamber shall be **OPERABLE**:

The suppression chamber shall be determined **OPERABLE** by verifying:

1. In OPERATIONAL MODE(s) 1, 2, and 3 with a contained water volume equivalent to a water level of $\geq 14'$ 1" above the bottom of the suppression chamber.

1. For OPERATIONAL MODE(s) 1, 2 and 3, at least once per 24 hours, the water level to be $\geq 14'$ 1".

2. In OPERATIONAL MODE(s) 4 and 5th with a contained volume equivalent to a water level of $\geq 8.5'$ above the bottom of the suppression chamber, except that the suppression chamber level may be less than the limit provided that:

2. For OPERATIONAL MODE(s) 4 or 5th, at least once per 12 hours:

a. No operations are performed that have a potential for draining the reactor vessel.

a. The water level to be $\geq 8.5'$, or

b. Verify the alternate conditions of Specification 3.5.C.2 or the conditions of footnote (a), to be satisfied.

b. The reactor mode switch is locked in the Shutdown or Refuel position.

c. The condensate storage tank contains $\geq 140,000$ available gallons of water, and

add proposed SR 3.5.2.1.b Note

50,000

d. The ECCS systems are OPERABLE per Specification 3.5.B.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4 and 5th.

A.6

moved to ITS 3.6.2.2

SR 3.5.2.1
SR 3.5.2.2.a

SR 3.5.2.1.b

LCO 3.5.2

Applicability

a. The suppression chamber is not required to be OPERABLE provided that the reactor vessel head is removed, the cavity is flooded or being flooded from the suppression pool, the spent fuel pool gates are removed within the cavity is flooded, and the water level is maintained within the limits of Specification 3.10.G and 3.10.H.

QUAD CITIES - UNITS 1 & 2

3/4.5-8

Amendment Nos. 181 & 179

M.2

Page 3 of 4

A.11

A.6

moved to ITS 3.6.2.2

LA.1

L.2

L.3

L.5

L.4

A.7

A.5

EMERGENCY CORE COOLING SYSTEMS

A.1

ITS.3.6.2.2

Suppression Chamber 3/4.5.C

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

C. Suppression Chamber

C. Suppression Chamber

The suppression chamber shall be OPERABLE:

SR 3.6.2.2.1

The suppression chamber shall be determined OPERABLE by verifying:

LCO 3.6.2.2

- 1. In OPERATIONAL MODE(s) 1, 2, and 3 with a contained water volume equivalent to a water level of $\geq 14' 1"$ above the bottom of the suppression chamber

L.A.11

- 1. For OPERATIONAL MODE(s) 1, 2 and 3, at least once per 24 hours, the water level to be $\geq 14' 1"$.

- 2. In OPERATIONAL MODE(s) 4 and 5^(a) with a contained volume equivalent to a water level of $\geq 8.5'$ above the bottom of the suppression chamber, except that the suppression chamber level may be less than the limit provided that:

- 2. For OPERATIONAL MODE(s) 4 or 5^(a), at least once per 12 hours:

- a. No operations are performed that have a potential for draining the reactor vessel,
- b. The reactor mode switch is locked in the Shutdown or Refuel position,
- c. The condensate storage tank contains $\geq 140,000$ available gallons of water, and
- d. The ECCS systems are OPERABLE per Specification 3.5.B.

- a. The water level to be $\geq 8.5'$, or
- b. Verify the alternate conditions of Specification 3.5.C.2, or the conditions of footnote (a), to be satisfied.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4 and 5^(a)

A.3

Moved to ITS 3.5.2

a The suppression chamber is not required to be OPERABLE provided that the reactor vessel head is removed, the cavity is flooded or being flooded from the suppression pool, the spent fuel pool gates are removed when the cavity is flooded, and the water level is maintained within the limits of Specification 3.10.G and 3.10.H.

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

ACTION:

1. In OPERATIONAL MODE(s) 1, 2, or 3 with the suppression chamber water level less than the above limit, restore the water level to within the limit within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

A.6 moved to 3.6.2.2

L.2

2. In OPERATIONAL MODE(s) 4 or 5th with the suppression chamber water level less than the above limit or drained and the above required conditions not satisfied, suspend CORE ALTERATION(s) and all operations that have a potential for draining the reactor vessel and lock the reactor mode switch in the Shutdown position. Establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

add proposed Required Action A.1.

L.1

L.3

A.4

A.3

ACTION C

ACTION C and D

A.5

a The suppression chamber is not required to be OPERABLE provided that the reactor vessel head is removed, the ~~SPENT FUEL POOL~~ or ~~being flooded from the SUPPRESSION POOL~~, the spent fuel pool gates are removed ~~when the~~ cavity is flooded, and the water level is maintained within the limits of Specification 3.10.G and 3.10.H

Applicability

QUAD CITIES - UNITS 1 & 2

3/4.5-9

Amendment Nos. 171 & 167

M.2

Page 4 of 4

A.1

EMERGENCY CORE COOLING SYSTEMS

Suppression Chamber 3/4.5.C

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

ACTION:

- 1. In OPERATIONAL MODE(s) 1, 2, or 3 with the suppression chamber water level less than the above limit, restore the water level to within the limit within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION A

L.1 - 2

ACTION B

2. In OPERATIONAL MODE(s) 4 or 5th with the suppression chamber water level less than the above limit or drained and the above required conditions not satisfied, suspend CORE ALTERATION(s) and all operations that have a potential for draining the reactor vessel and lock the reactor mode switch in the Shutdown position. Establish SECONDARY CONTAINMENT INTEGRITY within 8 hours.

A.3 moved to ITS 3.5.2

a The suppression chamber is not required to be OPERABLE provided that the reactor vessel head is removed, the cavity is flooded or being flooded from the suppression pool, the spent fuel pool gates are removed when the cavity is flooded, and the water level is maintained within the limits of Specification 3.10.G and 3.10.H.

A.1

EMERGENCY CORE COOLING SYSTEMS

RCIC 3/4.5.D

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

D. Reactor Core Isolation Cooling System

D. Reactor Core Isolation Cooling System

LCO 3.5.3

The reactor core isolation cooling (RCIC) system shall be OPERABLE with an OPERABLE flow path/capable of automatically taking suction from the suppression chamber and transferring the water to the reactor pressure vessel.

LA.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3 with reactor steam dome pressure > 150 psig.

ACTION:

ACTION A

With the RCIC system inoperable, operation may continue provided the HPCI system is OPERABLE; restore the RCIC system to OPERABLE status within 14 days or be in at least HOT SHUTDOWN within the next 12 hours and reduce reactor steam dome pressure to ≤ 150 psig within the following 24 hours.

ACTION B

D. Reactor Core Isolation Cooling System

The RCIC system shall be demonstrated OPERABLE:

1. At least once per 31 days by:

SR 3.5.3.1

a. Verifying that the system piping from the pump discharge valve to the system isolation valve is filled with water.

SR 3.5.3.2

b. Verifying that each valve, manual, power operated or automatic in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position.

c. Verifying that the pump flow controller is in the correct position.

LA.2

SR 3.5.3.3

2. At least once per 92 days, when tested pursuant to 4.0.E, by verifying that the RCIC pump develops a flow of ≥ 400 gpm against a system head corresponding to reactor vessel pressure when steam is being supplied to the turbine between 920 and 1005 psig.

A.2

24

LD.1

3. At least once per 18 months by:

SR 3.5.3.5

a. Verifying the RCIC system actuates on an actual or simulated automatic initiation signal. Actual injection of coolant into the reactor vessel may be excluded.

SR 3.5.3.5 NOTE

SR 3.5.3.3 NOTE

a The provisions of Specification 4.0.D are not applicable provided the surveillance is performed within 12 hours after reactor steam pressure is adequate to perform the test.

QUAD CITIES - UNITS 1 & 2

and flow

3/4.5-10

Amendment Nos. 171 & 167

A.2

A.1

ITS 3.5.3

EMERGENCY CORE COOLING SYSTEMS

RCIC 3/4.5.D

3.5 - LIMITING CONDITIONS FOR OPERATION

4.5 - SURVEILLANCE REQUIREMENTS

SR 3.5.3.4

b. Verifying that the system will develop a flow of ≥ 400 gpm against a system head corresponding to reactor vessel pressure, when steam is supplied to the turbine at a pressure between 150 and 180 psig.

A.2

LA.3

c. Verifying that the suction for the RCIC system is automatically transferred from the condensate storage tank to the suppression pool on a condensate storage tank water level - low signal and on a suppression pool water level - high signal.

LA.2

SR 3.5.3.4
NOTE

a The provisions of Specification 4.0.D are not applicable provided the surveillance is performed within 12 hours after reactor steam pressure is adequate to perform the test.

and flow

QUAD CITIES - UNITS 1 & 2

3/4.5-11

Amendment Nos.

171 & 167

A.2

A.1

ITS 3.4.1

PRIMARY SYSTEM BOUNDARY

A.2 general organization

Recirculation Loops 3/4.6.A

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

A. Recirculation Loops

A. Recirculation Loops

LC0 3.4.1 Two reactor coolant system recirculation loops shall be in operation.

Each pump motor generator (MG) set scoop tube mechanical and electrical stop shall be demonstrated OPERABLE with the overspeed setpoints specified in the CORE OPERATING LIMITS REPORT at least once per 18 months.

A.1

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION C 1. With only one reactor coolant system recirculation loop in operation, within 24 hours either, restore both loops to operation or:

a. Increase the MINIMUM CRITICAL POWER RATIO (MCPR) Safety Limit by 0.01 per Specification 2.1.B, and

A.3

b. Increase the MINIMUM CRITICAL POWER RATIO (MCPR) Operating Limit by 0.01 per Specification 3.11.C, and

LA.3

c. Reduce the Average Power Range Monitor (APRM) Flow Biased Neutron Flux Scram and Rod Block and Rod Block Monitor Trip Setpoints to those applicable to single recirculation loop operation per Specifications 2.2.A and 3.2.E.

A.4

Allowable Values

d. Reduce the AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR) to single loop operation limits as specified in the CORE OPERATING LIMITS REPORT (COLR).

A.2

LC03.4.1

PRIMARY SYSTEM BOUNDARY

A.1

ITS 3.4.1

Recirculation Loops 3/4.6.A

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

e. Electrically prohibit the idle recirculation pump from starting.

L.1

ACTION D

Otherwise, be in at least HOT SHUTDOWN within the next 12 hours.

ACTION A

2. With no reactor coolant system recirculation loops in operation, immediately initiate measures to place the unit in at least STARTUP within 8 hours and in HOT SHUTDOWN within the next 6 hours.

LA.2

M.2

Except to permit testing in preparation for returning the pump to service.

L.1

QUAD CITIES - UNITS 1 & 2

3/4.6-2

Amendment Nos. 171 & 167

Page 2 of 3

A.1

PRIMARY SYSTEM BOUNDARY

Jet Pumps 3/4.6.B

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

B. Jet Pumps

B. Jet Pumps

LCO 3.4.2

All jet pumps shall be OPERABLE and flow indication shall be OPERABLE on at least 18 jet pumps.

All jet pumps shall be demonstrated OPERABLE as follows:

← Add proposed SR 3.4.2.1 NOTE 1

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2.

ACTION:

ACTION A

1. With one or more jet pumps inoperable for other than inoperable flow indication, be in at least HOT SHUTDOWN within 12 hours.

2. With flow indication inoperable for three or more jet pumps, flow indication shall be restored such that at least 18 jet pumps have OPERABLE flow indication within 12 hours or be in at least HOT SHUTDOWN within the next 12 hours.

3. With flow indication inoperable for both jet pumps on the same jet pump riser, flow indication shall be restored to OPERABLE status for at least one of these jet pumps within 12 hours or be in at least HOT SHUTDOWN within the next 12 hours.

4. With flow indication inoperable on both calibrated (double-tap) jet pumps on the same recirculation loop, flow indication shall be restored to OPERABLE status for at least one of these jet pumps within 12 hours or be in at least HOT SHUTDOWN within the next 12 hours.

1. During two loop operation, at least once per 24 hours while greater than 25% of RATED THERMAL POWER by determining recirculation loop flow,

total core flow and individual jet pump flow for each jet pump and verifying that no two of the following conditions occur when both recirculation pumps are operating in accordance with Specification 3.6.C:

a. The indicated recirculation pump flow differs by > 10% from the established speed-flow characteristics.

b. The indicated total core flow differs by > 10% from the established total core flow value derived from established core plate ΔP/core flow relationships.

c. The indicated flow of any individual jet pump differs from the established patterns by > 10%.

d. The provisions of Specification 4.0.D are not applicable provided that the surveillance is performed within 24 hours after exceeding 25% of RATED THERMAL POWER.

a inoperable flow indication shall not be allowed on both jet pumps sharing a jet pump riser, nor on both calibrated jet pumps on the same recirculation loop.

A.1

PRIMARY SYSTEM BOUNDARY

Jet Pumps 3/4.6.B

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

2. During single recirculation loop operation, at least once per 24 hours while greater than 25% of RATED THERMAL POWER by verifying that no two of the following conditions occur:

A.2

L.2

Add proposed SR 3.4.2.1 NOTE 1

SR 3.4.2.1.a

a. The indicated recirculation pump flow in the operating loop differs by >10% from the established single recirculation speed-flow characteristics.

b. The indicated total core flow differs by > 10% from the established total core flow value derived from established core plate ΔP /core flow relationships.

M.1

SR 3.4.2.1.b

c. The indicated flow of any individual jet pump differs from established single recirculation loop patterns by > 10%.

SR 3.4.2.1
NOTE 2

d. The provisions of Specification 4.0.D are not applicable provided that the surveillance is performed within 24 hours after exceeding 25% of RATED THERMAL POWER.

ITS 3.4.1

Pump Speed 3/4.6.C

PRIMARY SYSTEM BOUNDARY

A.1

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

C. Recirculation Pumps

C. Recirculation Pumps

LC 3.4.1

Recirculation pump speed shall be maintained within:

SR 3.4.1.1

Recirculation pump speed shall be verified to be within the limits at least once per 24 hours.

SR 3.4.1.1

- 1. 10% of each other with THERMAL POWER \geq 80% of RATED THERMAL POWER.
- 2. 15% of each other with THERMAL POWER $<$ 80% of RATED THERMAL POWER.

M.1

add proposed SR 3.4.1.1 Note

L.3

APPLICABILITY:

OPERATIONAL MODE(s) 1 and 2 during two recirculation loop operation.

A.2

ACTION:

ACTION B

With the recirculation pump speeds different by more than the specified limits, either:

- 1. Restore the recirculation pump speeds to within the specified limit within 2 hours, or
- 2. Trip one of the recirculation pumps and take the ACTION required by Specification 3.6.A.1.

A.5

L.2

A.6

A.11

PRIMARY SYSTEM BOUNDARY

Idle Loop Startup 3/4.6.D

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

D. Idle Recirculation Loop Startup

D. Idle Recirculation Loop Startup

SR 3.4.9.3

An idle recirculation loop shall not be started unless the temperature differential between the reactor pressure vessel ~~steam space~~ coolant and the bottom head ~~drain~~ ~~the~~ coolant is $\leq 145^{\circ}\text{F}^{\text{a}}$, and:

LA.3

1. When both loops have been idle, unless the temperature differential between the reactor coolant within the idle loop to be started up and the coolant in the reactor pressure vessel is $\leq 50^{\circ}\text{F}$, or
2. When only one loop has been idle, unless the temperature differential between the reactor coolant ~~within the~~ ~~idle and operating~~ recirculation loops is $\leq 50^{\circ}\text{F}$ and the speed of the operating pump is $\leq 45\%$ of rated pump speed.

SR 3.4.9.4

A.7

A.8

SR 3.4.9.3
SR 3.4.9.4

LA.1

The temperature differentials ~~and flow/rate~~ shall be determined to be within the limits within 15 minutes prior to startup of an idle recirculation loop.

APPLICABILITY:

SR 3.4.9.3
SR 3.4.9.4

OPERATIONAL MODE(s) 1, 2, 3 and 4^x

during recirculation pump startup

A.7

ACTION:

With temperature differences ~~and/or flow rates~~ exceeding the above limits, suspend startup of any idle recirculation loop.

LA.1

Add proposed ACTIONS A, B, and C

M.1

^a Below 25 psig reactor pressure this temperature differential is not applicable.

M.2

A.1

TS 3.4.3
Safety Valves 3/4.6.E

PRIMARY SYSTEM BOUNDARY

A.2 (general organization)

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

E. Safety Valves

E. Safety Valves

The safety valve function of the 9 reactor coolant system safety valves shall be OPERABLE in accordance with the specified code safety valve function lift settings established as:

LC 3.4.3

LA.1

1. Deleted.

LA.3

SR 3.4.3.1

- 1 safety valve @ 1135 psig ± 1%
- 2 safety valves @ 1240 psig ± 1%
- 2 safety valves @ 1250 psig ± 1%
- 4 safety valves @ 1260 psig ± 1%

SR 3.4.3.1

2. At least once per 18 months, 1/2 of the safety valves shall be removed, set pressure tested and reinstalled or replaced with spares that have been previously set pressure tested and stored in accordance with manufacturer's recommendations. At least once per 40 months, the safety valves shall be rotated such that all 9 safety valves are removed, set pressure tested and reinstalled or replaced with spares that have been previously set pressure tested and stored in accordance with manufacturer's recommendations.

LA.2

In accordance with the Inservice Testing Program

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

ACTION B

- 1. With the safety valve function of one or more of the above required safety valves inoperable, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

2. Deleted.

LA.1

a The lift setting pressure shall correspond to ambient conditions of the valves at nominal operating temperatures and pressures.

b Target Rock combination safety/relief valve. LA.3

A.1

A.2

general organization

Safety Valves 3/4.6.E

PRIMARY SYSTEM BOUNDARY

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

E. Safety Valves

E. Safety Valves

LCO 3.4.3

The safety valve function of the 9 reactor coolant system safety valves shall be OPERABLE in accordance with the specified code safety valve function lift settings^(A) established as:

LA.3

- 1 safety valve @ 1135 psig ± 1%
- 2 safety valves @ 1240 psig ± 1%
- 2 safety valves @ 1250 psig ± 1%
- 4 safety valves @ 1260 psig ± 1%

SR 3.4.3.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3

ACTION:

ACTION B

- 1. With the safety valve function of one or more of the above required safety valves inoperable, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours

1. Deleted

A.3

2. At least once per 18 months, 1/2 of the safety valves shall be removed, set pressure tested and reinstalled or replaced with spares that have been previously set pressure tested and stored in accordance with manufacture's recommendations. At least once per 40 months, the safety valves shall be rotated such that all 9 safety valves are removed, set pressure tested and reinstalled or replaced with spares that have been previously set pressure tested and stored in accordance with manufacture's recommendations.

In accordance with Inservice Testing Program

LA.2

2. Deleted

- a. The lift setting pressure shall correspond to ambient conditions of the valves at nominal operating temperatures and pressures. LA.1
- b. Target Rock combination safety/relief valve. LA.3
- c. The surveillance interval has been extended to 24 months for Unit 1, cycle 16 only. The provisions of Specification 4.0.B are applicable. A.3

PRIMARY SYSTEM BOUNDARY

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

F. Relief Valve Instrumentation

F. Relief Valve Add proposed SR 3.3.6.3 Note

LCO 3.3.6.3
Table 3.3.6.3-1
Function 1.b

5 reactor coolant system relief valves and the reactivation time delay of two relief valves shall be OPERABLE with the following settings:

Table 3.3.6.3-1 Functions 1.a and 2.a
Table 3.3.6.3-1 Function 1.b

The relief valve function and the reactivation time delay function instrumentation shall be demonstrated OPERABLE by performance of a:

Table 3.3.6.3-1 Function 1.a and 2.a

Relief Function Setting (psig)	Allowable Value
Open	LF.1
≤1115 psig	
≤1115 psig	
≤1135 psig	
≤1135 psig	
≤1135 psig	

(see ITS 3.4.3)

a. CHANNEL FUNCTIONAL TEST of the relief valve function at least once per 18 months, and a

SR 3.3.6.3.1
SR 3.3.6.3.2

b. CHANNEL CALIBRATION and LOGIC SYSTEM FUNCTIONAL TEST of the entire system at least once per 18 months.

2. Deleted.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With one or more relief valves open, provided that suppression pool average water temperature is <110°F, take action to close the open relief valve(s); if suppression pool average water temperature is ≥110°F place the reactor mode switch in the Shutdown position.

(see ITS 3.4.3)

M.1
Add proposed Table 3.3.6.3-1 Function 1.b time delay Allowable Value

a Target/Rock combination safety/relief valve.

PRIMARY SYSTEM BOUNDARY

Relief Valves 3/4.6.F

A.1

A.2 (general organization)

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

F. Relief Valves

F. Relief Valves

LCO 3.4.3

5 reactor coolant system relief valves and the reactivation time delay of two relief valves shall be OPERABLE with the following settings:

<see ITS 3.3.6.3>

Relief Function Setpoint (psig)

Open

≤1115 psig

≤1115 psig

≤1135 psig

≤1135 psig

≤1135 psig^(a)

<see ITS 3.3.6.3>

1. The relief valve function and the reactivation time delay function instrumentation shall be demonstrated OPERABLE by performance of a:

- a. CHANNEL FUNCTIONAL TEST of the relief valve function at least once per 18 months, and a
- b. CHANNEL CALIBRATION and LOGIC SYSTEM FUNCTIONAL TEST of the entire system at least once per 18 months.

2. Deleted.

<see ITS 3.3.6.3>

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With one or more relief valves open, provided that suppression pool average water temperature is <110°F, take action to close the open relief valve(s); if suppression pool average water temperature is ≥110°F place the reactor mode switch in the Shutdown position.

L.1

add proposed SRs 3.4.3.2 and 3.4.3.3

A.4

<see ITS 3.3.6.3>

a Target Rock combination safety/relief valve.

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

E. Relief Valves

F. Relief Valves

5 reactor coolant system relief valves and the reactivation time delay of two relief valves shall be OPERABLE with the following settings:

Relief Function Setpoint (psig)

- Open
- ≤1115 psig
- ≤1115 psig
- ≤1135 psig
- ≤1135 psig
- ≤1135 psig⁽¹⁾

The two low set relief valves shall be OPERABLE

1. The relief valve function and the reactivation time delay function instrumentation shall be demonstrated OPERABLE by performance of a:

- a. CHANNEL FUNCTIONAL TEST of the relief valve function at least once per 18 months, and a
- b. CHANNEL CALIBRATION and LOGIC SYSTEM FUNCTIONAL TEST of the entire system at least once per 18 months.

2. Deleted

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With one or more relief valves open, provided that suppression pool average water temperature is <110°F, take action to close the open relief valve(s); if suppression pool average water temperature is ≥110°F place the reactor mode switch in the Shutdown position.

add proposed SRs 3.6.1.6.1 and 3.6.1.6.2

a Target Rock combination safety/relief valve.

A.1

ITS 3.5.6.3
Instrumentation
Relief Valves 3/4.6.F

PRIMARY SYSTEM BOUNDARY

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

- 2. With the relief valve function and/or the reactuation time delay of one of the above required reactor coolant system relief valves inoperable, restore the inoperable relief valve function and the reactuation time delay function to **OPERABLE status within 14 days** or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.
 - ACTION A —
 - ACTION B —
- 3. With the relief valve function and/or the reactuation time delay of more than one of the above required reactor coolant system relief valves inoperable, be in at least **HOT SHUTDOWN** within 12 hours and in **COLD SHUTDOWN** within the next 24 hours.
 - ACTION B —

4. Deleted.

A.1

ITS 3.4.3
Relief Valves 3/4.6.F

PRIMARY SYSTEM BOUNDARY

A.2 (general organization)

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

ACTION A 2. With the relief valve function and/or the reactuation time delay of one of the above required reactor coolant system relief valves inoperable, restore the inoperable relief valve function and the reactuation time delay function to OPERABLE status within 14 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

see ITS 3.3.6.3

ACTION B 3. With the relief valve function and/or the reactuation time delay of more than one of the above required reactor coolant system relief valves inoperable, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

4/ Deleted.

A.1

PRIMARY SYSTEM BOUNDARY

Relief Valves 3/4.6.F

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

2. With the relief valve function and/or the reactuation time delay of one of the above required reactor coolant system relief valves inoperable, restore the inoperable relief valve function and the reactuation time delay function to OPERABLE status within 14 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION A

ACTION B

< see ITS 3.3.6.3 >

3. With the relief valve function and/or the reactuation time delay of more than one of the above required reactor coolant system relief valves inoperable, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

ACTION B

< see ITS 3.3.6.3 >

4. ~~Deleted.~~

A.1

3.6 LIMITING CONDITIONS FOR OPERATION

4.11 - SURVEILLANCE REQUIREMENTS

L.3

G. Leakage Detection Systems

G. Leakage Detection Systems

add proposed NOTE to Surveillance Table

LC03.4.5

The following reactor coolant system leakage detection systems shall be OPERABLE:

The reactor coolant system leakage detection systems shall be demonstrated OPERABLE by:

A.5

- 1. The primary containment atmosphere particulate radioactivity sampling system, and
- 2. The drywell floor drain sump monitoring system.

- 1. Performing the leakage determinations of Specification 4.6.H.
- 2. Performing a CHANNEL CALIBRATION of required leakage detection instrumentation at least once per months.

SR 3.4.5.3

add proposed SR 3.4.5.2 M.1

24

LE.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

add proposed NOTE to ACTION B L.1

1. With the primary containment atmosphere particulate radioactivity sampling system inoperable, restore the inoperable leak detection radioactivity sampling system to OPERABLE status within 24 hours; otherwise, be in HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

add proposed Required Action B.1 M.2

ACTION C

30 days L.2

add proposed NOTE to ACTION A L.1

2. With the drywell floor drain sump monitoring system inoperable, within 8 hours establish an alternate manual method of determining drywell floor drain sump flow rates by calculating flow rates using sump pump run times. AND within 30 days restore the drywell floor drain sump monitoring system to an OPERABLE status; otherwise, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION A

A.3

ACTION C

A.4

add proposed ACTION D

A.1

PRIMARY SYSTEM BOUNDARY

Leakage 3/4.6.H

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

H. Operational Leakage

H. Operational Leakage

LCO 3.4.4

Reactor coolant system leakage shall be limited to:

The reactor coolant system leakage shall be demonstrated to be within each of the limits by:

1. No PRESSURE BOUNDARY LEAKAGE.
2. ≤25 gpm total leakage averaged over any 24 hour surveillance period. *the previous*
3. ≤5 gpm UNIDENTIFIED LEAKAGE. *the previous*
4. ≤2 gpm increase in UNIDENTIFIED LEAKAGE within any period of 24 hours or less (Applicable in OPERATIONAL MODE 1 only).

1. Sampling the primary containment atmospheric particulate radioactivity at least once per 12 hours and

moved to ITS 3.4.5

A.3

2. Determining the primary containment sump flow rate at least once per 8 hours not to exceed 12 hours.

LA.1

L.1

SR 3.4.4.1

A.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

ACTION C

1. With any PRESSURE BOUNDARY LEAKAGE, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

ACTION A

2. With the reactor coolant system UNIDENTIFIED LEAKAGE or total leakage rate(s) greater than the above limit(s), reduce the leakage rate to within the limits within 4 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION C

a Not a means of quantifying leakage.

Moved to ITS 3.4.5

A.3

QUAD CITIES - UNITS 1 & 2

3/4.6-11

Amendment Nos. 171 & 167

PRIMARY SYSTEM BOUNDARY

A.1

ITS 3.4.5

Leakage 3/4.6.H

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

H. Operational Leakage

Reactor coolant system leakage shall be limited to:

1. No PRESSURE BOUNDARY LEAKAGE.
2. ≤25 gpm total leakage averaged over any 24 hour surveillance period.
3. ≤5 gpm UNIDENTIFIED LEAKAGE.
4. ≤2 gpm increase in UNIDENTIFIED LEAKAGE within any period of 24 hours or less (Applicable in OPERATIONAL MODE 1 only).

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With any PRESSURE BOUNDARY LEAKAGE, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.
2. With the reactor coolant system UNIDENTIFIED LEAKAGE or total leakage rate(s) greater than the above limit(s), reduce the leakage rate to within the limits within 4 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

H. Operational Leakage

The reactor coolant system leakage shall be demonstrated to be within each of the limits by:

1. Sampling the primary containment atmospheric particulate radioactivity at least once per 12 hours^a, and
2. Determining the primary containment sump flow rate at least once per 8 hours, not to exceed 12 hours.

SR 3.4.5.1

A.2

LA.1

see ITS 3.4.4

LA.1

^a Not a means of quantifying leakage.

A.1

PRIMARY SYSTEM BOUNDARY

Leakage 3/4.6.H

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

ACTION B

3. With an increase in reactor coolant system UNIDENTIFIED LEAKAGE of > 2 gpm within any period of 24 hours or less in OPERATIONAL MODE 1:

the previous

A.2

add proposed Required Action B.1

a. Identify the source of leakage as not IGSCC susceptible material within 4 hours, or

A.4

ACTION C

b. Be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

PRIMARY SYSTEM BOUNDARY

A.1

ITS 3.4.6

Specific Activity 3/4.6.J

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

J. Specific Activity

J. Specific Activity

LCO 3.4.6 The specific activity of the reactor coolant shall be limited to $\leq 0.2 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$.

SR 3.4.6.1 In OPERATIONAL MODE 1, the specific activity of the reactor coolant shall be verified to be $\leq 0.2 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$ once per 7 days.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3, with any main steam line not isolated.

ACTION:

ACTION A 1. With the specific activity of the reactor coolant $> 0.2 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$ but $\leq 4.0 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$, determine DOSE EQUIVALENT I-131 once per 4 hours and restore DOSE EQUIVALENT I-131 to within limits within 48 hours^{min}.

ACTION B 2. With the specific activity of the reactor coolant $> 0.2 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$ for greater than 48 hours, or with the specific activity of the reactor coolant $> 4.0 \mu\text{Ci}/\text{gram DOSE EQUIVALENT I-131}$, determine DOSE EQUIVALENT I-131 once per 4 hours, and isolate all main steam lines within 12 hours, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

Required Actions
A.1 and A.2
Note

LCO 3.0.4

The provisions of Specification 3.0.B are not applicable.

QUAD CITIES - UNITS 1 & 2

3/4.6-16

Amendment Nos. 171 & 167

Page 1 of 1

PRIMARY SYSTEM BOUNDARY

PT Limits 3/4.6.K

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

K. Pressure/Temperature Limits

K. Pressure/Temperature Limits

LLo 3.4.9 The primary system coolant system temperature and reactor vessel metal temperature and pressure shall be limited as specified below:

1. Pressure Testing:

SR 3.4.9.1 a. The reactor vessel metal temperature and pressure shall be maintained within the Acceptable Regions as shown on Figure 3.6.K-1 with the rate of change of the primary system coolant temperature $\leq 20^\circ\text{F}$ per hour, or

SR 3.4.9.1 b. The rate of change of the primary system coolant temperature shall be $\leq 100^\circ\text{F}$ per hour when reactor vessel metal temperature and pressure is maintained within the Acceptable Regions as shown on Figure 3.6.K-2.

2. Non-Nuclear Heatup and Cooldown and low power PHYSICS TESTS:

SR 3.4.9.1 a. The reactor vessel metal temperature and pressure shall be maintained within the Acceptable Regions as shown on Figure 3.6.K-2, and

SR 3.4.9.1 b. The rate of change of the primary system coolant temperature shall be $\leq 100^\circ\text{F}$ per hour.

1. During non-nuclear heatup or cooldown, and pressure testing operations, at least once per 30 minutes,

a. The rate of change of the primary system coolant temperature shall be determined to be within the heatup and cooldown rate limits, and

b. The reactor vessel metal temperature and pressure shall be determined to be within the Acceptable Regions on Figures 3.6.K-1 through 3.6.K-2.

2. For reactor critical operation, determine within 15 minutes prior to the withdrawal of control rods and at least once per 30 minutes during primary system heatup or cooldown,

a. The rate of change of the primary system coolant temperature to be within the limits, and

b. The reactor vessel metal temperature and pressure to be within the Acceptable Region on Figure 3.6.K-3.

3. The reactor vessel material surveillance specimens shall be removed and examined, to determine changes in reactor pressure vessel material properties in accordance with 10CFR Part 50, Appendix H.

L.2

A.4

A.1

ITS 3.4.9

PRIMARY SYSTEM BOUNDARY

PT Limits 3/4.6.K

A.5

add proposed SR 3.4.9.7 Note

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

3. Nuclear Heatup and Cooldown:

4. The reactor vessel flange and head flange temperature shall be verified to be $\geq 83^\circ\text{F}$:

SR 3.4.9.2 a. The reactor vessel metal temperature and pressure shall be maintained within the Acceptable Region as shown on Figure 3.6.K-3, and

a. In OPERATIONAL MODE 4 when the reactor coolant temperature is:

SR 3.4.9.1 b. The rate of change of the primary system coolant temperature shall be $\leq 100^\circ\text{F}$ per hour.

SR 3.4.9.7 1) $\leq 113^\circ\text{F}$, at least once per 12 hours.

SR 3.4.9.6 2) $\leq 93^\circ\text{F}$, at least once per 30 minutes.

SR 3.4.9.5 SR 3.4.9.6 SR 3.4.9.7 4. The reactor vessel flange and head flange temperature $\geq 83^\circ\text{F}$ when reactor vessel head bolting studs are under tension.

SR 3.4.9.5 b. Within 30 minutes prior to and at least once per 30 minutes during tensioning of the reactor vessel head bolting studs. A.6

add proposed SR 3.4.9.6 Note

APPLICABILITY:

At all times.

ACTION:

With any of the above limits exceeded,

add proposed Notes for Condition A and C

A.5

A.2

1. Restore the reactor vessel metal temperature and/or pressure to within the limits (within 30 minutes) without exceeding the applicable primary system coolant temperature rate of change limit, and

A.3

ACTION A
ACTION C

2. Perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the reactor coolant system and determine that the reactor coolant system remains acceptable for continued operations within (72 hours) or

L.A.2

L.1

ACTION B

3. Be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the following 24 hours.

A.1

ITS 3.4.9


PRIMARY SYSTEM BOUNDARY

PT Limits 3/4.6.K

3.4.9-1

FIGURE 3.6.K-1

PRESSURE - TEMPERATURE LIMITS FOR PRESSURE TESTING - VALID TO 32 EPFY

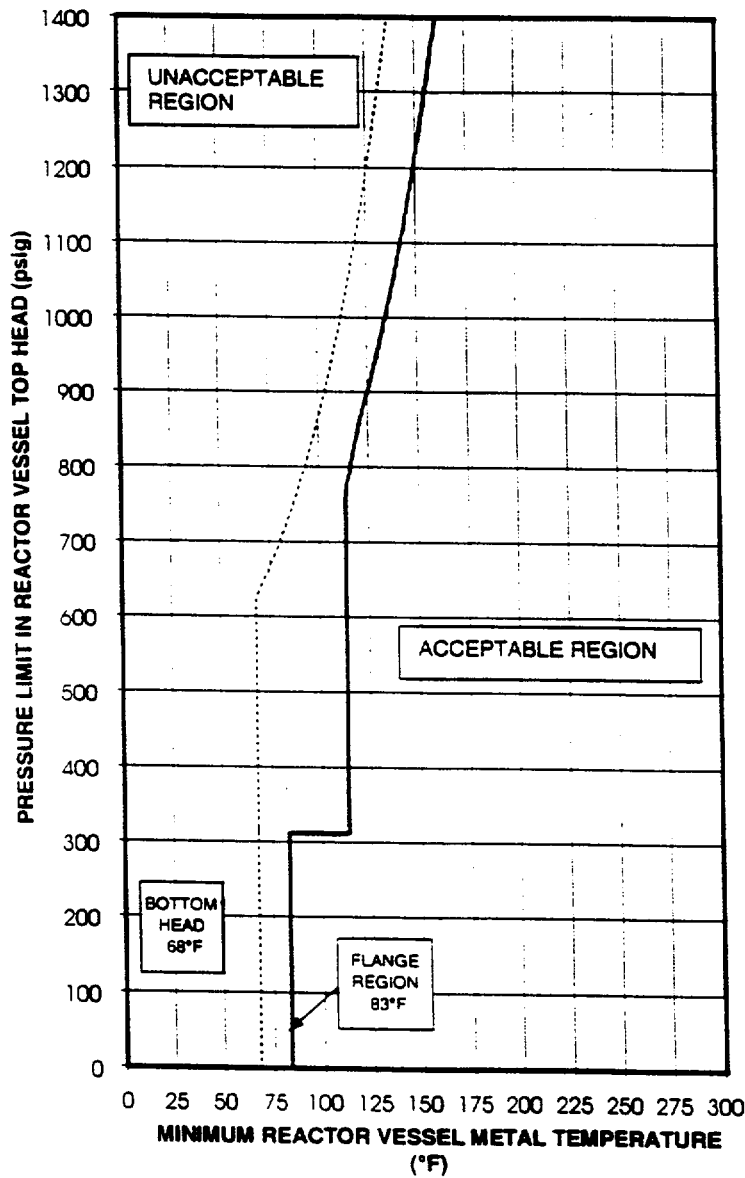

HEATUP/COOLDOWN RATE OF COOLANT $\leq 20^{\circ}\text{F}/\text{HR}$ SR 3.4.9.1

— UPPER VESSEL AND BELTLINE LIMITS
- - - - - BOTTOM HEAD CURVE


ITS 3.4.9

PRIMARY SYSTEM BOUNDARY

PT Limits 3/4.6.K

3.4.9-2

FIGURE 3.6.K-2
PRESSURE - TEMPERATURE LIMITS FOR NON-NUCLEAR
HEATUP/COOLDOWN - VALID TO 32 EPFY

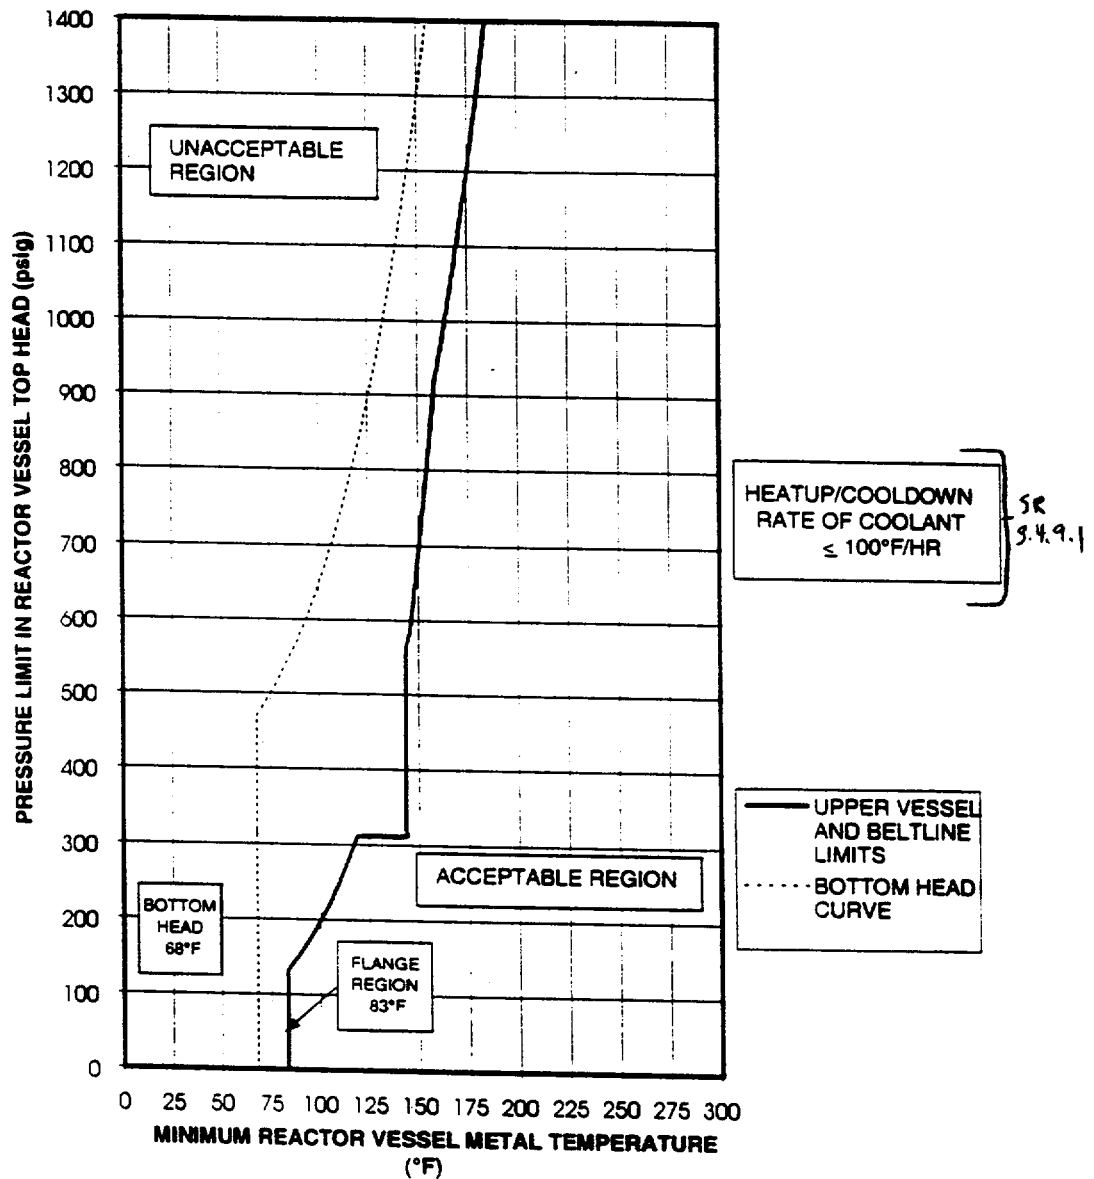

A.1


ITS 3.4.9

PRIMARY SYSTEM BOUNDARY

PT Limits 3/4.6.K

3.4.9-3

FIGURE 3.6.K-3
PRESSURE - TEMPERATURE LIMITS FOR CRITICAL
CORE OPERATIONS - VALID TO 32 EPY

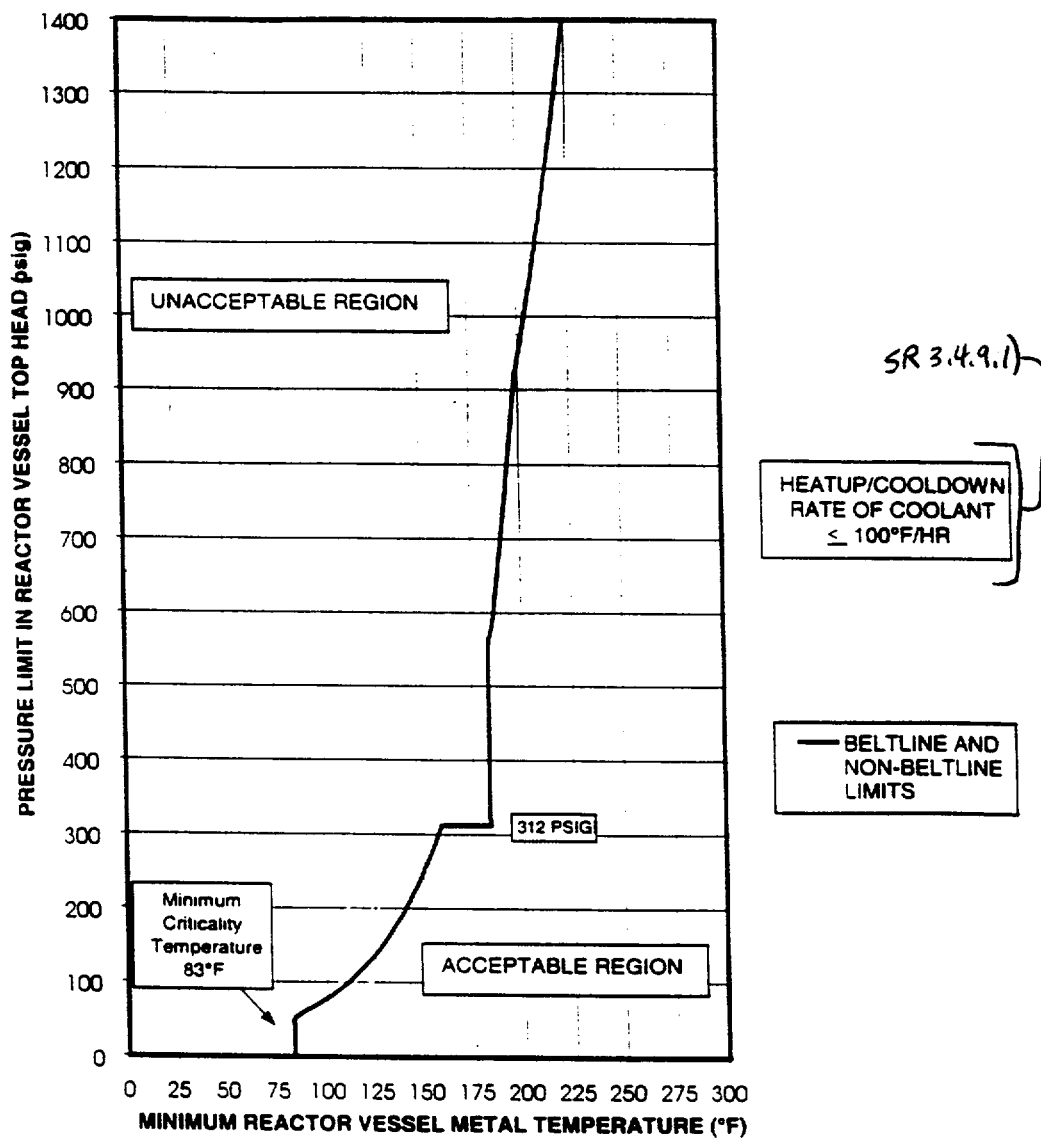

A.1

IFS 3.4.10

Dome Pressure 3/4.6.L

PRIMARY SYSTEM BOUNDARY

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

L. Reactor Steam Dome Pressure

L. Reactor Steam Dome Pressure

LCO 3.4.10 The pressure in the reactor steam dome shall be ≤ 1005 psig.

SR 3.4.10.1 The reactor steam dome pressure shall be verified to be ≤ 1005 psig at least once per 12 hours.

APPLICABILITY:

OPERATIONAL MODE(s) 1[Ⓢ] and 2[Ⓢ]

M.1

ACTION:

ACTION A { With the reactor steam dome pressure > 1005 psig, reduce the pressure to ≤ 1005 psig within 15 minutes or be in at least

ACTION B } HOT SHUTDOWN within 12 hours.

M.1

a Not applicable during anticipated transients.

QUAD CITIES - UNITS 1 & 2

3/4.6-22

Amendment Nos. 171 & 167

PRIMARY SYSTEM BOUNDARY

A.1

MSIV 3/4.6.M

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

M. Main Steam Line Isolation Valves

A.9

LCO 3.6.1.3

SR 3.6.1.3.6

Two main steam line isolation valves (MSIVs) per main steam line shall be OPERABLE with closing times ≥ 3 seconds and ≤ 5 seconds.

SR 3.6.1.3.6

M. Main Steam Line Isolation Valves

Each of the above required MSIVs shall be demonstrated OPERABLE by verifying full closure between 3 and 5 seconds when tested pursuant to Specification 4.0.E.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

add proposed Note 1 to ACTIONS

L.4

ACTION:

add proposed Note 4 to ACTIONS

A.4

ACTIONS A and D

With one or more MSIVs inoperable, maintain at least one MSIV OPERABLE in each affected main steam line that is open and within 8 hours either:

add proposed Note 2 to ACTIONS

A.3

A.5

1. Restore the inoperable valve(s) to OPERABLE status, or

A.6

2. Isolate the affected main steam line by use of a deactivated MSIV in the closed position.

L.2

ACTION E

Otherwise, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

add ACTION B

L.3

R.1

CTS 3/4.6.N

PRIMARY SYSTEM BOUNDARY

Structural Integrity 3/4.6.N

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

N. Structural Integrity

N. Structural Integrity

The structural integrity of ASME Code Class 1, 2 and 3 components shall be maintained in accordance with Specification 4.6.N.

No additional Surveillance Requirements other than those required by Specification 4.0.E.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4 and 5.

ACTION:

1. With the structural integrity of any ASME Code Class 1 component(s) not conforming to the above requirements, restore the structural integrity of the affected component(s) to within its limits or isolate the affected component(s) prior to increasing the Reactor Coolant System temperature more than 50°F above the minimum temperature required by NDT considerations.
2. With the structural integrity of any ASME Code Class 2 component(s) not conforming to the above requirements, restore the structural integrity of the affected component(s) to within its limit or isolate the affected component(s).
3. With the structural integrity of any ASME Code Class 3 component(s) not conforming to the above requirements, restore the structural integrity of the affected component(s) to within its limit or isolate the affected component(s) from service.

ITS 3.47

PRIMARY SYSTEM BOUNDARY

A.1

RHR - HOT SHUTDOWN 3/4.6.0

add proposed SR 3.4.7 Note

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

O. Residual Heat Removal - HOT SHUTDOWN

O. Residual Heat Removal - HOT SHUTDOWN

LCO 3.4.7

Two shutdown cooling mode subsystems of the residual heat removal (RHR) system shall be OPERABLE and, unless at least one recirculation pump is in operation, at least one shutdown cooling mode subsystem shall be capable of circulating reactor coolant with each subsystem consisting of at least:

1. One OPERABLE RHR pump, and
2. One OPERABLE RHR heat exchanger.

A.2

A.3

Two

M.1

SR 3.4.7.1

Required Action A.3

At least one shutdown cooling mode subsystem of the residual heat removal system, recirculation pump or alternate method shall be verified to be capable of circulating reactor coolant at least once per 12 hours.

L.2

LA.2

A.2

moved to Required Action A.3

A.2

L.1

add proposed LCO Note

APPLICABILITY:

OPERATIONAL MODE 3, with reactor vessel pressure less than the RHR cut-in permissive setpoint.

ACTION:

add proposed ACTIONS Note 2

A.4

1. With less than the above required RHR shutdown cooling mode subsystems OPERABLE, immediately initiate corrective action to return the required subsystems to OPERABLE status as soon as possible. Within 1 hour and at least once per 24 hours thereafter, demonstrate the operability of at least one alternate method capable of decay heat removal for each inoperable RHR shutdown cooling mode subsystem. Be in at least COLD SHUTDOWN within 24 hours.

ACTION A

A.5

A.6

A.2

LA.1

SR 3.4.7.1 ACTIONS NOTE 1

a Each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat. (The provisions of Specification 3.0.D are not applicable.)

b The RHR shutdown cooling subsystem may be removed from operation during hydrostatic testing.

c Whenever the two required RHR SDC mode subsystems are inoperable, if unable to attain COLD SHUTDOWN as required by this ACTION, maintain reactor coolant temperature as low as practical by use of alternate heat removal methods.

PRIMARY SYSTEM BOUNDARY

A.11

ITS 3.4.7
RHR - HOT SHUTDOWN 3/4.6.0

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

ACTION A

Required
Actions A,3
and A.4 Note

2. With no RHR shutdown cooling mode subsystem OPERABLE, immediately initiate corrective action to return at least one subsystem to OPERABLE status as soon as possible. Within 1 hour establish reactor coolant circulation with a recirculation pump or by an alternate method and monitor reactor coolant temperature and pressure at least once per hour.

L.A.2

ITS 3.4.8

PRIMARY SYSTEM BOUNDARY

RHR - COLD SHUTDOWN 3/4.6.P

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

P. Residual Heat Removal - COLD SHUTDOWN

P. Residual Heat Removal - COLD SHUTDOWN

LCO 3.4.8

Two shutdown cooling mode subsystems of the residual heat removal (RHR) system shall be OPERABLE^(a) and, unless at least one recirculation pump is in operation, at least one shutdown cooling mode subsystem shall be capable of circulating reactor coolant^(b) with each subsystem/consisting of at least:

1. One OPERABLE RHR pump, and
2. One OPERABLE RHR heat exchanger.

SR3.4.8.1

At least one shutdown cooling mode subsystem of the residual heat removal system, recirculation pump or alternate method shall be verified to be capable of circulating reactor coolant at least once per 12 hours.

LA.2

A.2

moved to Required Action A.2

Required Action A.2

LA.1

APPLICABILITY:

OPERATIONAL MODE 4.

add proposed LCO 3.4.8 Note

L.1

ACTION:

1. With less than the above required RHR shutdown cooling mode subsystems OPERABLE, within 1 hour and at least once per 24 hours thereafter, demonstrate the operability of at least one alternate method capable of decay heat removal for each inoperable RHR shutdown cooling mode subsystem.

add proposed ACTION Note

A.4

ACTION A

LA.1

A.2

a Each shutdown cooling subsystem is considered OPERABLE if it can be manually aligned (remote or local) in the shutdown cooling mode for removal of decay heat.

b The RHR shutdown cooling subsystem(s) is not required to be OPERABLE and may be removed from operation during hydrostatic testing.

LCO 3.4.8 Note 1

A.1

ITS 5.4.8

PRIMARY SYSTEM BOUNDARY

RHR - COLD SHUTDOWN 3/4.6.P

3.6 - LIMITING CONDITIONS FOR OPERATION

4.6 - SURVEILLANCE REQUIREMENTS

ACTION A

- 2. With no RHR shutdown cooling mode subsystem OPERABLE, immediately initiate corrective action to return at least one subsystem to OPERABLE status as soon as possible. Within 1 hour establish reactor coolant circulation with a recirculation pump or by an alternate method and monitor reactor coolant temperature and pressure at least once per hour.

L.2

L.A.2

A.1

CONTAINMENT SYSTEMS

PC INTEGRITY 3/4.7.A

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

A. PRIMARY CONTAINMENT INTEGRITY

A. PRIMARY CONTAINMENT INTEGRITY

LC0 3.6.1.1

PRIMARY CONTAINMENT INTEGRITY shall be maintained

PRIMARY CONTAINMENT INTEGRITY shall be demonstrated:

OPERABLE

1. Perform required visual examinations and leakage rate testing except for primary containment air lock testing in accordance with and at the frequency specified by the Primary Containment Leakage Rate Testing Program.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2^(a) and 3.

SR 3.6.1.1

ACTION:

OPERABLE A.2

ACTION A

Without PRIMARY CONTAINMENT INTEGRITY, restore PRIMARY CONTAINMENT INTEGRITY within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

2. At least once per 31 days by verifying that all primary containment penetrations^(a) not capable of being closed by OPERABLE containment automatic isolation valves and required to be closed during accident conditions are closed, except for valves that are open under administrative control as permitted by Specification 3.7.D.

3. By verifying each primary containment air lock is in compliance with the requirements of Specification 3.7.C.

4. By verifying the suppression chamber is in compliance with the requirements of Specification 3.7.K.

A.4 moved to ITS 3.6.1.3

A.5

A.3

A.4 moved to ITS 3.6.1.3

a See Special Test Exception 3.12.A.

b Except valves, blind flanges, and deactivated automatic valves which are located inside the containment. Valves and blind flanges in high radiation areas may be verified by use of administrative controls. These penetrations shall be verified closed during each COLD SHUTDOWN except such verification need not be performed when the primary containment has not been de-inerted since the last verification or more often than once per 92 days.

CONTAINMENT SYSTEMS

A.1

PC INTEGRITY 3/4.7.A

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

A. PRIMARY CONTAINMENT INTEGRITY

PRIMARY CONTAINMENT INTEGRITY shall be maintained.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2nd and 3.

ACTION:

Without PRIMARY CONTAINMENT INTEGRITY, restore PRIMARY CONTAINMENT INTEGRITY within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

A. PRIMARY CONTAINMENT INTEGRITY

PRIMARY CONTAINMENT INTEGRITY shall be demonstrated:

1. Perform required visual examinations and leakage rate testing except for primary containment air lock testing in accordance with and at the frequency specified by the Primary Containment Leakage Rate Testing Program.

L.9

and not locked, sealed, or secured

Required Actions A.2 and C.2 and SR 3.6.1.3.2

2. At least once per 31 days by verifying that all primary containment penetrations² not capable of being closed by OPERABLE containment automatic isolation valves and required to be closed during accident conditions are closed, except for valves that are open under administrative control as permitted by Specification 3.7.D.

add Note 2 to Required Action A.2 and C.2

L.10

Note 2 to SR 3.6.1.3.2 and SR 3.6.1.3.3

3. By verifying each primary containment air lock is in compliance with the requirements of Specification 3.7.C.
4. By verifying the suppression chamber is in compliance with the requirements of Specification 3.7.K.

see ITS 3.6.1.1

L.10

Note 1 to Required Action A.2 and C.2
Note 1 to SR 3.6.1.3.2 and SR 3.6.1.3.3

a See Special Test Exception 3.12.A.

Required Actions A.2 and SR 3.6.1.3.3

- b Except valves, blind flanges, and deactivated automatic valves which are located inside the containment. Valves and blind flanges in high radiation areas may be verified by use of administrative controls. These penetrations shall be verified closed during each COLD SHUTDOWN except such verification need not be performed when the primary containment has not been de-inerted since the last verification or more often than once per 92 days.

CONTAINMENT SYSTEMS

A.1

PC Air Locks 3/4.7.C

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

C. Primary Containment Air Locks

C. Primary Containment Air Locks

LC03.6.1.2 Each primary containment air lock shall be OPERABLE.

Each primary containment air lock shall be demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2[Ⓢ] and 3.

add proposed ACTIONS Note 1

ACTION: add proposed ACTIONS Note 2

1. With one primary containment air lock door inoperable:

Verify L.2 within 1 hour

ACTION A

a. Maintain at least the OPERABLE air lock door closed[Ⓢ] and either restore the inoperable air lock door to OPERABLE status within 24 hours or lock the OPERABLE air lock door closed.

ACTION A

b. Operation may then continue until performance of the next required overall air lock leakage test provided that the OPERABLE air lock door is verified to be locked closed[Ⓢ] at least once per 31 days.

1. By performing required primary containment air lock leakage testing in accordance with and at the frequency specified by the Primary Containment Leakage Rate Testing Program[Ⓢ].

2. At least once per 24 months, by verifying that only one door in each air lock can be opened at a time[Ⓢ].

ACTIONS NOTE 1)

a See Special Test Exception 3.12.A.

b Except during entry through an OPERABLE door to repair an inoperable door or to facilitate the removal of personnel for a cumulative time not to exceed one hour per year.

c An inoperable air lock door does not invalidate the previous successful performance of the overall air lock leakage test.

d Results shall be evaluated against acceptance criteria applicable to Specification 4.7.A.1.

e Only required to be performed upon entry into primary containment air lock when the primary containment is de-inerted.

CONTAINMENT SYSTEMS

A.1

PC Air Locks 3/4.7.C

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

c. Otherwise, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION D


2. With the primary containment air lock interlock mechanism inoperable, restore the air lock interlock mechanism to OPERABLE status within 24 hours, or lock at least one air lock door closed and verify that the door is locked closed at least once per 31 days. Personnel entry and exit through the airlock is permitted provided one OPERABLE air lock door remains locked closed at all times and an individual is dedicated to assure that both air lock doors are not opened simultaneously.

ACTION B

3. With the primary containment air lock inoperable, except as a result of an inoperable air lock door or interlock mechanism, maintain at least one air lock door closed; restore the inoperable air lock to OPERABLE status within 24 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION C

ACTION D

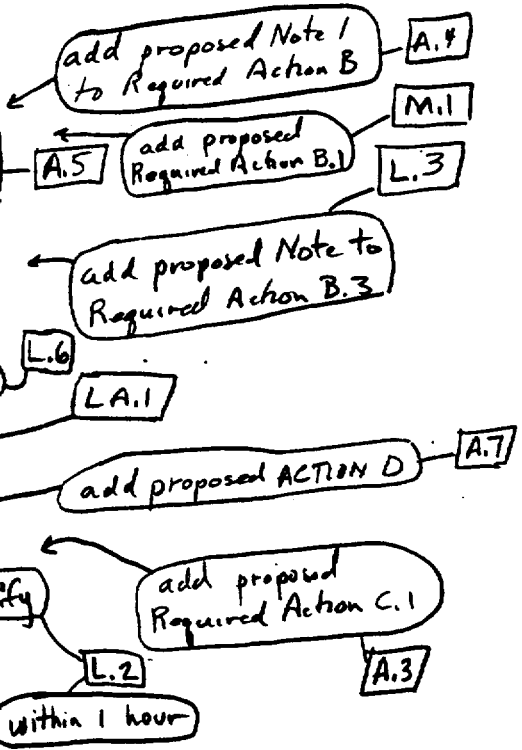

excluding reactor building suppression chamber vacuum breakers

ITS 3.6.1.3

PCIVs 3/4.7.D

CONTAINMENT SYSTEMS

A.2

A.1

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

D. Primary Containment Isolation Valves

D. Primary Containment Isolation Valves

LC03.6.1.3

Each primary containment isolation valve and reactor instrumentation excess flow check valve shall be OPERABLE^(M).

1. Each power-operated or automatic primary containment isolation valve shall be demonstrated OPERABLE prior to returning the valve to service after maintenance, repair, or replacement work is performed on the valve or its associated actuator, control, or power circuit by performance of a cycling test and verification of isolation time.

APPLICABILITY:

add proposed 2nd Applicability

OPERATIONAL MODE(s) 1, 2 and 3.

M.1 A.3

ACTION:

add proposed Note 2 to ACTIONS

add proposed Notes 3 and 4 to ACTIONS

A.4

1. With one or more of the primary containment isolation valve(s) inoperable, maintain at least one isolation valve OPERABLE in each affected penetration that is open and within 4 hours either:

SR 3.6.1.3.7

A.2

A.5

LD.1

24

L.1

A.6

a. Restore the inoperable valve(s) to OPERABLE status, or

b. Isolate each affected penetration by use of at least one deactivated automatic valve secured in the isolated position^(M), or

SR 3.6.1.3.5

L.2

Required Action A, only or check valve with flow secured

c. Isolate each affected penetration by use of at least one closed manual valve or blind flange^(M).

SR 3.6.1.3.8

3. The isolation time of each power-operated or automatic primary containment isolation valve shall be determined to be within its limit when tested pursuant to Specification 4.0.E.

L.A.1

4. Each reactor instrumentation line excess flow check valve which fulfills a primary containment isolation function shall be demonstrated OPERABLE at least once per 12 months by verifying that the valve checks flow.

24

LD.V

5. Each traversing in-core probe system explosive isolation valve shall be demonstrated OPERABLE:

SR 3.6.1.3.4

SR 3.6.1.3.9

actuates to the isolation position

L.7

ACTIONS A and C

ACTION E

Otherwise, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

L.3

add proposed ACTION B

add proposed ACTION F

M.1

M.2 add proposed SR 3.6.1.3.1

L.4

ACTIONS Note 1

a. Locked or sealed closed valves may be opened on an intermittent basis under administrative control.

b. Except main steam isolation valves (MSIVs). Required actions for inoperable MSIVs are provided in Specification 3.6.M.

A.2

CONTAINMENT SYSTEMS

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

2. With one or more reactor instrumentation line excess flow check valves inoperable, operation may continue and the provisions of Specification 3.0.C are not applicable provided that within 4 hours either:

ACTION C

continue and the provisions of Specification 3.0.C are not applicable

A.8

72

L.8

a. The inoperable valve is restored to OPERABLE status, or

SR 3.6.13.9

A.6

b. The instrument line is isolated and the associated instrument is declared inoperable.

A.4

NOTE 3

ACTIONS

Otherwise, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION E

a. At least once per 31 days by verifying the continuity of the explosive charge.

24

LD.1

b. At least once per 12 months by removing at least one explosive squib from an explosive valve such that each explosive squib will be tested at least once per 90 months, and initiating the removed explosive squib(s).

120

The replacement charge for the exploded squib(s) shall be from the same manufactured batch as the one fired or from another batch which has been certified by having at least one of that batch successfully fired. No squib shall remain in use beyond the expiration of its shelf-life or operating life, as applicable.

LA.2

SR 3.6.1.3.10

6. In accordance with the methods and at the frequency specified by the Primary Containment Leakage Rate Testing Program, verify total maximum pathway leakage for all main steam isolation valves (MSIVs) is ≤ 46 scfh when tested at P₁ (25 psig).

LA.3

CONTAINMENT SYSTEMS

A.1

ITS 3.6.1.8

Drywell Vacuum Breakers 3/4.7.E

L.3

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

add proposed Note 1 to SR 3.6.1.8.1

E. Suppression Chamber - Drywell Vacuum Breakers

E. Suppression Chamber - Drywell Vacuum Breakers

LC03.6.1.8

Nine suppression chamber - drywell vacuum breakers shall be OPERABLE and twelve suppression chamber - drywell vacuum breakers shall be closed.

Each suppression chamber - drywell vacuum breaker shall be:

A.2

SR 3.6.1.8.1

add proposed Note 2 to SR 3.6.1.8.1

1. Verified closed at least once per 7 days.

14 L.2

2. Demonstrated OPERABLE:

a. At least once per 31 days and within 12 hours after any discharge of steam to the suppression chamber from one or more main steam relief valve(s), by cycling each vacuum breaker through at least one complete cycle of full travel.

SR 3.6.1.8.2

b. At least once per 31 days by verifying both position indicator(s) OPERABLE by observing expected valve movement during the cycling test.

L.1

24 L.D.1

c. At least once per 18 months by:

SR 3.6.1.8.3

1) Verifying the force required to open the vacuum breaker, from the closed position, to be ≤ 0.5 psid, and

L.A.1

2) Verifying both position indicators OPERABLE by performance of a CHANNEL CALIBRATION.

L.1

3) Verifying that each valve's position indicator is capable of detecting disk displacement of ≥ 0.0625 inches.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

M.1

1. With one or more of the required suppression chamber - drywell vacuum breakers inoperable for opening but known to be closed, restore at least nine vacuum breakers to OPERABLE status within 72 hours or be in at least

ACTION A

HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION C

2. With one suppression chamber - drywell vacuum breaker open, restore the open vacuum breaker to the closed position within 4 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

ACTION C

3. With one position indicator of any OPERABLE suppression chamber - drywell vacuum breaker inoperable, verify the vacuum breaker(s) with the inoperable position indicator to be closed by conducting a test which demonstrates that the ΔP is

L.1

CONTAINMENT SYSTEMS

A.1

Drywell Vacuum Breakers 3/4.7.E

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

maintained at greater than or equal to 0.5 psi for one hour without makeup within 24 hours and at least once per 15 days thereafter. Otherwise be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

L.1

CONTAINMENT SYSTEMS

A.1

ITS 3.6.1.7
RB Vacuum Breakers 3/4.7.F

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

F. Reactor Building - Suppression Chamber Vacuum Breakers

F. Reactor Building - Suppression Chamber Vacuum Breakers

LCO
3.6.1.7

All reactor building - suppression chamber vacuum breakers shall be OPERABLE and closed.

Each reactor building - suppression chamber vacuum breaker shall be: *add proposed Notes and 2 to SR 3.6.1.7.1*

L.A.1

SR 3.6.1.7.1

1. Verified closed at least once per 7 days.

A.3

14

L.3

2. Demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

A.2

ACTION:

add proposed ACTION'S Note

SR 3.6.1.7.2

a. At least once per 92 days when tested pursuant to Specification 4.0.E by:

1) Cycling the vacuum breaker through at least one test cycle.

2) Verifying the air operated vacuum breaker position indicator OPERABLE by observing expected valve movement during the cycling test.

L.2

L.D.1

b. At least once per 12 months by:

1) Demonstrating that the force required to open each vacuum breaker does not exceed the equivalent of 0.5 psid.

2) Verifying the air operated vacuum breaker position indicator OPERABLE by performance of a CHANNEL CALIBRATION.

L.2

1. With one reactor building - suppression chamber vacuum breaker line inoperable for opening with both valves known to be closed, restore the inoperable vacuum breaker line to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

L.1

add proposed ACTION D

ACTION C

ACTION E

2. With one reactor building - suppression chamber vacuum breaker line otherwise inoperable, verify at least one vacuum breaker in the line to be closed within 2 hours and restore the open vacuum breaker to the closed position within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

M.1

ACTION A

ACTION B

ACTION A

ACTION E

3. With the position indicator of the air operated reactor building - suppression chamber vacuum breaker inoperable, restore the inoperable position indicator to OPERABLE status within 14 days or verify the vacuum breaker to be closed at least once per 24 hours by an

L.2

CONTAINMENT SYSTEMS

A.1

ITS 3.6.7

RB Vacuum Breakers 3/4.7.F

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

alternate means. Otherwise, be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.

L.2

ITS 3.6.1.4

CONTAINMENT SYSTEMS

A.1

Drywell Internal Pressure 3/4.7.G

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

G. Drywell Internal Pressure

G. Drywell Internal Pressure

LCO 3.6.1.4

The drywell internal pressure shall not exceed +1.5 psig.

A.2

SR 3.6.1.4.1

The drywell internal pressure shall be determined to be within the limits at least once per 12 hours.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With the drywell internal pressure < 1.0 psig during the applicable time period for OPERATIONAL MODE 1, restore the internal pressure to above the low pressure limit within 24 hours or reduce THERMAL POWER to < 15% RATED THERMAL POWER within the next 8 hours.

A.2

ACTION A } 2. With the drywell internal pressure otherwise outside of the specified limits, restore the internal pressure to within the limits within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

A.2

a In OPERATIONAL MODE 1, during the time period beginning within 24 hours after THERMAL POWER is > 15% of RATED THERMAL POWER following startup, and ending within 24 hours prior to reducing THERMAL POWER to < 15% of RATED THERMAL POWER preliminary to a scheduled reactor shutdown, the drywell internal pressure shall also be maintained ≥ 1.0 psig (except for up to 4 hours for required surveillance which reduces the differential pressure.)

A.1

CONTAINMENT SYSTEMS

Drywell - Supp. Chamber Diff. Pressure 3/4.7.H

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

H. Drywell - Suppression Chamber Differential Pressure

H. Drywell - Suppression Chamber Differential Pressure

LCD 3.6.2.5

Differential pressure between the drywell and the suppression chamber shall be ≤ 1.0 psid^{max}.

SR3.6.2.5.1

1. The drywell - suppression chamber differential pressure shall be demonstrated to be within limits by verifying the differential pressure at least once per 12 hours.

APPLICABILITY:

OPERATIONAL MODE 1, during the time period:

1. Beginning within 24 hours after THERMAL POWER is $> 15\%$ of RATED THERMAL POWER following startup, and
2. Ending within 24 hours prior to reducing THERMAL POWER to $\leq 15\%$ of RATED THERMAL POWER preliminary to a scheduled reactor shutdown.

2. At least one drywell / suppression chamber differential pressure instrumentation CHANNEL, and at least one drywell pressure and one suppression chamber pressure instrumentation CHANNEL shall be demonstrated OPERABLE by performance of a:

- a. CHANNEL CHECK at least once per 24 hours,
- b. CHANNEL CALIBRATION at least once per 6 months.

L.1

ACTION:

m.1

ACTION A

1. With the drywell - suppression chamber differential pressure less than the above limit, restore the required differential pressure within 24 hours or

ACTION B

- reduce THERMAL POWER to $\leq 15\%$ RATED THERMAL POWER within the next 8 hours.

\leq A.2

2. With the drywell - suppression chamber differential pressure instrumentation CHANNEL inoperable, restore the inoperable CHANNEL to OPERABLE status within 30 days or reduce THERMAL POWER to $< 15\%$ RATED THERMAL POWER within the next 8 hours.

L.1

L.A.1

Note LCD 3.6.2.5

a Except for up to 4 hours for required surveillance which reduces the differential pressure

A.1

ITS 3.6.2.5

CONTAINMENT SYSTEMS

Drywell - Supp. Chamber Diff. Pressure 3/4.7.H

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

- 3. With the drywell and/or suppression chamber pressure instrumentation CHANNEL(s) inoperable, restore the inoperable CHANNEL(s) to OPERABLE status within 30 days or reduce THERMAL POWER to <15% RATED THERMAL POWER within the next 8 hours.
- 4. With the drywell - suppression chamber differential pressure instrumentation CHANNEL inoperable and with insufficient drywell and suppression chamber pressure instrumentation CHANNEL(s) OPERABLE to determine drywell - suppression chamber differential pressure, restore either the drywell - suppression chamber differential pressure instrumentation CHANNEL or sufficient drywell and suppression chamber pressure instrumentation CHANNEL(s) to determine drywell - suppression chamber differential pressure to OPERABLE status within 8 hours or reduce THERMAL POWER to <15% RATED THERMAL POWER within the next 8 hours.

L.1

A.1

CONTAINMENT SYSTEMS

PC O₂ Concentration 3/4.7.J

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

J. Primary Containment Oxygen Concentration

J. Primary Containment Oxygen Concentration

LEO 3.6.3.1 The suppression chamber and drywell atmosphere oxygen concentration shall be <4% by volume.

SR 3.6.3.1.1 The suppression chamber and drywell oxygen concentration shall be verified to be within the limit within 24 hours after THERMAL POWER is >15% of RATED THERMAL POWER and at least once per 7 days thereafter.

A.3

APPLICABILITY:

OPERATIONAL MODE 1, during the time period:

1. Beginning within 24 hours after THERMAL POWER is >15% of RATED THERMAL POWER following startup, and
2. Ending within 24 hours prior to reducing THERMAL POWER to <15% of RATED THERMAL POWER preliminary to a scheduled reactor shutdown.

ACTION:

- ACTION A - With the drywell and/or suppression chamber oxygen concentration exceeding the limit, restore the oxygen concentration to within the limit within 24 hours or
- ACTION B - reduce THERMAL POWER to ≤15% RATED THERMAL POWER within the next 8 hours.

≤

A.2

CONTAINMENT SYSTEMS

A.1

ITS. 3.6.1.1

Suppression Chamber 3/4.7.K

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

K. Suppression Chamber

The suppression chamber shall be OPERABLE with:

1. The suppression pool water level between 14' 1" and 14' 5",
2. A suppression pool maximum average water temperature of $\leq 95^{\circ}\text{F}$ during OPERATIONAL MODE(s) 1 or 2, except that the maximum average temperature may be permitted to increase to:
 - a. $\leq 105^{\circ}\text{F}$ during testing which adds heat to the suppression pool.
 - b. $\leq 110^{\circ}\text{F}$ with THERMAL POWER $\leq 1\%$ of RATED THERMAL POWER.
 - c. $\leq 120^{\circ}\text{F}$ with the main steam line isolation valves closed following a scram.

3. A total leakage between the suppression chamber and drywell of less than the equivalent leakage through a 1 inch diameter orifice at a differential pressure of 1.0 psid.

A.6

L.3

SR 3.6.1.1.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With the suppression pool water level outside the above limits, restore the water level to within the limits

add proposed ACTION A

L.1

K. Suppression Chamber

The suppression chamber shall be demonstrated OPERABLE:

1. By verifying the suppression pool water level to be within the limits at least once per 24 hours.
2. At least once per 24 hours by verifying the suppression pool average water temperature to be $\leq 95^{\circ}\text{F}$, except:
 - a. At least once per 5 minutes during testing which adds heat to the suppression pool, by verifying the suppression pool average water temperature to be $\leq 105^{\circ}\text{F}$.
 - b. At least once per hour when suppression pool average water temperature is $\geq 95^{\circ}\text{F}$, by verifying:
 - 1) Suppression pool average water temperature to be $\leq 110^{\circ}\text{F}$, and
 - 2) THERMAL POWER to be $\leq 1\%$ of RATED THERMAL POWER after suppression pool average water temperature has exceeded 95°F for more than 24 hours.
 - c. At least once per 30 minutes with the main steam line isolation valves closed following a scram and suppression pool average water temperature $> 95^{\circ}\text{F}$, by verifying suppression pool average water temperature to be $\leq 120^{\circ}\text{F}$.

see ITS 3.6.2.1 and ITS 3.6.2.2

A.1

CONTAINMENT SYSTEMS

Suppression Chamber 3/4.7.K

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

K. Suppression Chamber

K. Suppression Chamber

LCD 3.6.2.1

The suppression chamber shall be OPERABLE with:

The suppression chamber shall be demonstrated OPERABLE:

1. The suppression pool water level between 14' 1" and 14' 5",

1. By verifying the suppression pool water level to be within the limits at least once per 24 hours.

LCD 3.6.2.1.a

2. A suppression pool maximum average water temperature of $\leq 95^{\circ}\text{F}$ during OPERATIONAL MODE(s) 1 or 2, except that the maximum average temperature may be permitted to increase to:

2. At least once per 24 hours by verifying the suppression pool average water temperature to be $\leq 95^{\circ}\text{F}$, except:

A.2

OPERATIONAL MODE(s) 1 or 2, except that the maximum average temperature may be permitted to increase to:

SR 3.6.2.1.1

a. At least once per 5 minutes during testing which adds heat to the suppression pool, by verifying the suppression pool average water temperature to be $\leq 105^{\circ}\text{F}$.

LCD 3.6.2.1.b

a. $\leq 105^{\circ}\text{F}$ during testing which adds heat to the suppression pool.

LCD 3.6.2.1.c

b. $\leq 110^{\circ}\text{F}$ with THERMAL POWER $\leq 1\%$ of RATED THERMAL POWER.

A.2

c. $\leq 120^{\circ}\text{F}$ with the main steam line isolation valves closed following a scram.

Required Action A.1

b. At least once per hour when suppression pool average water temperature is $\geq 95^{\circ}\text{F}$, by verifying:

CONDITION E

M.1

1) Suppression pool average water temperature to be $\leq 110^{\circ}\text{F}$, and

A.3

3. A total leakage between the suppression chamber and drywell of less than the equivalent leakage through a 1 inch diameter orifice at a differential pressure of 1.0 psid.

moved to ITS 3.6.1.1

2) THERMAL POWER to be $\leq 1\%$ of RATED THERMAL POWER after suppression pool average water temperature has exceeded 95°F for more than 24 hours.

L.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With the suppression pool water level outside the above limits, restore the water level to within the limits

Required Action D.2

c. At least once per 30 minutes with the main steam line isolation valves closed following a scram and suppression pool average water temperature $> 95^{\circ}\text{F}$, by verifying suppression pool average water temperature to be $\leq 120^{\circ}\text{F}$.

M.1

L.2

See ITS 3.6.2.2

A.1

CONTAINMENT SYSTEMS

Suppression Chamber 3/4.7.K

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

K. Suppression Chamber

K. Suppression Chamber

The suppression chamber shall be OPERABLE with:

The suppression chamber shall be demonstrated OPERABLE:

LEO 3.6.2.2

1. The suppression pool water level between 14' 1" and 14' 5",

SR 3.6.2.2.1

1. By verifying the suppression pool water level to be within the limits at least once per 24 hours.

2. A suppression pool maximum average water temperature of $\leq 95^{\circ}\text{F}$ during OPERATIONAL MODE(s) 1 or 2, except that the maximum average temperature may be permitted to increase to:

2. At least once per 24 hours by verifying the suppression pool average water temperature to be $\leq 95^{\circ}\text{F}$, except:

a. $\leq 105^{\circ}\text{F}$ during testing which adds heat to the suppression pool.

a. At least once per 5 minutes during testing which adds heat to the suppression pool, by verifying the suppression pool average water temperature to be $\leq 105^{\circ}\text{F}$.

b. $\leq 110^{\circ}\text{F}$ with THERMAL POWER $\leq 1\%$ of RATED THERMAL POWER.

b. At least once per hour when suppression pool average water temperature is $\geq 95^{\circ}\text{F}$, by verifying:

c. $\leq 120^{\circ}\text{F}$ with the main steam line isolation valves closed following a scram.

1) Suppression pool average water temperature to be $\leq 110^{\circ}\text{F}$, and

2) THERMAL POWER to be $\leq 1\%$ of RATED THERMAL POWER after suppression pool average water temperature has exceeded 95°F for more than 24 hours.

3. A total leakage between the suppression chamber and drywell of less than the equivalent leakage through a 1 inch diameter orifice at a differential pressure of 1.0 psid.

c. At least once per 30 minutes with the main steam line isolation valves closed following a scram and suppression pool average water temperature $> 95^{\circ}\text{F}$, by verifying suppression pool average water temperature to be $\leq 120^{\circ}\text{F}$.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

1. With the suppression pool water level outside the above limits, restore the water level to within the limits

ACTION A

< See ITS 3.6.2.1 >

CONTAINMENT SYSTEMS

A.11

ITS 3.6.1.1

Suppression Chamber 3/4.7.K

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

- within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
2. In OPERATIONAL MODE(s) 1 or 2 with the suppression pool average water temperature > 95°F, except as permitted above, restore the average temperature to ≤ 95°F within 24 hours or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.
 3. With the suppression pool average water temperature > 105°F during testing which adds heat to the suppression pool, except as permitted above, stop all testing which adds heat to the suppression pool and restore the average temperature to ≤ 95°F within 24 hours or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.
 4. With the suppression pool average water temperature > 110°F, immediately place the reactor mode switch in the Shutdown position and operate at least one residual heat removal loop in the suppression pool cooling mode.
 5. With the suppression pool average water temperature > 120°F, depressurize the reactor pressure vessel to < 150 psig (reactor steam dome pressure) within 12 hours.

SR3.6.1.12

~~3. Deleted.~~

~~4. Deleted.~~

24 LD:1

5. At least once per 18 months by conducting a drywell to suppression chamber bypass leak test at an initial differential pressure of 1.0 psid and verifying that the measured leakage is within the specified limit. L.3

If any drywell to suppression chamber bypass leak test fails to meet the specified limit, the test schedule for subsequent tests shall be reviewed and approved by the Commission. L.2

If two consecutive tests fail to meet the specified limit, a test shall be performed at least every 9 months until two consecutive tests meet the specified limit, at which time the 18 month test schedule may be resumed. L.4

see ITS 3.6.2.1 and 3.6.2.2

CONTAINMENT SYSTEMS

A.1

ITS 3.6.2.1

Suppression Chamber 3/4.7.K

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

within 1 hour or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

~~3/ Deleted.~~

~~4/ Deleted.~~

A.3 Moved to ITS 3.6.1.1

ACTION A 2. In OPERATIONAL MODE(s) 1 or 2 with the suppression pool average water temperature > 95°F, except as permitted above, restore the average temperature to ≤ 95°F within 24 hours or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.

5. At least once per 18 months by conducting a drywell to suppression chamber bypass leak test at an initial differential pressure of 1.0 psid and verifying that the measured leakage is within the specified limit. If any drywell to suppression chamber bypass leak test fails to meet the specified limit, the test schedule for subsequent tests shall be reviewed and approved by the Commission. If two consecutive tests fail to meet the specified limit, a test shall be performed at least every 9 months until two consecutive tests meet the specified limit, at which time the 18 month test schedule may be resumed.

ACTION C 3. With the suppression pool average water temperature > 105°F during testing which adds heat to the suppression pool, except as permitted above, stop all testing which adds heat to the suppression pool and restore the average temperature to ≤ 95°F within 24 hours/or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.

< See ITS 3.6.2.2 >

ACTION D 4. With the suppression pool average water temperature > 110°F, immediately place the reactor mode switch in the Shutdown position and operate at least one residual heat removal loop in the suppression pool cooling mode.

and be in MODE 4 in 36 hours.

ACTION E 5. With the suppression pool average water temperature > 120°F, depressurize the reactor pressure vessel to < 150 psig (reactor steam dome pressure) within 12 hours.

L.1

M.2

A.1

ITS 3.6.2.2

CONTAINMENT SYSTEMS

Suppression Chamber 3/4.7.K

L.1

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

ACTION A

2

within 7 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

2. In OPERATIONAL MODE(s) 1 or 2 with the suppression pool average water temperature > 95°F, except as permitted above, restore the average temperature to ≤ 95°F within 24 hours or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.

3. With the suppression pool average water temperature > 105°F during testing which adds heat to the suppression pool, except as permitted above, stop all testing which adds heat to the suppression pool and restore the average temperature to ≤ 95°F within 24 hours or reduce THERMAL POWER to ≤ 1% RATED THERMAL POWER within the next 12 hours.

4. With the suppression pool average water temperature > 110°F, immediately place the reactor mode switch in the Shutdown position and operate at least one residual heat removal loop in the suppression pool cooling mode.

5. With the suppression pool average water temperature > 120°F, depressurize the reactor pressure vessel to < 150 psig (reactor steam dome pressure) within 12 hours.

3. Deleted.

4. Deleted.

5. At least once per 18 months by conducting a drywell to suppression chamber bypass leak test at an initial differential pressure of 1.0 psid and verifying that the measured leakage is within the specified limit. If any drywell to suppression chamber bypass leak test fails to meet the specified limit, the test schedule for subsequent tests shall be reviewed and approved by the Commission. If two consecutive tests fail to meet the specified limit, a test shall be performed at least every 9 months until two consecutive tests meet the specified limit, at which time the 18 month test schedule may be resumed.

A.2

Moved to ITS 3.6.1.1

<See ITS 3.6.2.1>

A.1

ITS 3.6.2.4

CONTAINMENT SYSTEMS

Suppression Chamber and Drywell Spray 3/4.7.1

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

L. Suppression Chamber and Drywell Spray

L. Suppression Chamber and Drywell Spray

LCO 3.6.2.4

The suppression chamber and drywell spray functions of the residual heat removal (RHR) system shall be OPERABLE with two independent subsystems, each subsystem consisting of:

The suppression chamber and drywell spray functions of the RHR system shall be demonstrated OPERABLE:

1. One OPERABLE RHR pump, and
2. An OPERABLE flow path capable of recirculating water from the suppression pool through a heat exchanger and the suppression chamber and drywell spray nozzles.

1. At least once per 31 days by verifying that each valve, manual, power operated or automatic in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position or can be aligned to the correct position.

2. By performance of an air or smoke flow test of the drywell spray nozzles at least once per 5 years and verifying that each spray nozzle is unobstructed.

APPLICABILITY:

L.A.1

OPERATIONAL MODE(s) 1, 2 and 3.

ACTION:

- ACTION A** 1. With one suppression chamber/drywell spray subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
- ACTION C**

- ACTION B** 2. With both suppression chamber/drywell spray subsystems inoperable, restore at least one subsystem to OPERABLE status within 8 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the next 24 hours.
- ACTION C**

Add proposed SR 3.6.2.4.2

M.1

R.1

A.2

Whenever the two required RHR SDC mode subsystems are inoperable, if unable to attain COLD SHUTDOWN as required by this ACTION, maintain reactor coolant temperature as low as practical by use of alternate heat removal methods.

A.1

CONTAINMENT SYSTEMS

Suppression Pool Cooling 3/4.7.M

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

M. Suppression Pool Cooling

M. Suppression Pool Cooling

LCD 3.6.2.3 The suppression pool cooling function of the residual heat removal (RHR) system shall be OPERABLE with two independent subsystems, each subsystem consisting of:

The suppression pool cooling function of the RHR system shall be demonstrated OPERABLE:

- 1. One OPERABLE RHR pump, and
- 2. An OPERABLE flow path capable of recirculating water from the suppression pool through a heat exchanger.

SR 3.6.2.3.1

LA.1

- 1. At least once per 31 days by verifying that each valve, manual, power operated or automatic, in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position. or can be aligned to the correct position

A.3

APPLICABILITY:

SR 3.6.2.3.2

OPERATIONAL MODE(s) 1, 2 and 3.

- 2. By verifying that each of the required RHR pumps develops the required recirculation flow through the heat exchanger and the suppression pool when tested pursuant to Specification 4.0.E.

≥ 5000 gpm

M.1

ACTION:

L.1

- 1. With one suppression pool cooling subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

restore one subsystem to OPERABLE status within 8 hours

- 2. With both suppression pool cooling subsystems inoperable, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

A.2

a Whenever the two required RHR/SDC mode subsystems are inoperable, if unable to attain COLD SHUTDOWN as required by this ACTION, maintain reactor coolant temperature as low as practical by use of alternate heat removal methods.

A.1

ITS 3.6.4.1

CONTAINMENT SYSTEMS

SECONDARY CONTAINMENT INTEGRITY 3/4.7.N

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

N. SECONDARY CONTAINMENT INTEGRITY

N. SECONDARY CONTAINMENT INTEGRITY

LCO 3.6.4.1

SECONDARY CONTAINMENT INTEGRITY shall be maintained OPERABLE

SECONDARY CONTAINMENT INTEGRITY shall be demonstrated by: OPERABLE

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3 and *.

ACTION:

ACTION A

A.2

1. Without SECONDARY CONTAINMENT INTEGRITY in OPERATIONAL MODES(s) 1, 2 or 3, restore SECONDARY CONTAINMENT INTEGRITY within 4 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

A.2

2. Without SECONDARY CONTAINMENT INTEGRITY in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

ACTION C

SR 3.6.4.1.1

1. Verifying at least once per 24 hours that the pressure within the secondary containment is ≥ 0.10 inches of vacuum water gauge.

2. Verifying at least once per 31 days that:

a. At least one door in each secondary containment air lock is closed.

b. All secondary containment penetrations not capable of being closed by OPERABLE secondary containment automatic isolation dampers and required to be closed during accident conditions are closed.

3. At least once per 18 months by operating one standby gas treatment subsystem at a flow rate ≤ 4000 cfm for one hour and maintaining ≥ 0.25 inches of vacuum water gauge in the secondary containment.

OPERABLE

to OPERABLE status

OPERABLE

A.3

Moved to ITS 3.6.4.2

A.4

LD.1

24

M.1

ON a STAGGERED TEST BASES

APPLICABILITY

When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

Moved to ITS 3.6.4.2

a Valves and blind flanges in high-radiation areas may be verified by use of administrative controls. Normally locked or sealed-closed penetrations may be opened intermittently under administrative control.

A.4

A.1

CONTAINMENT SYSTEMS

SECONDARY CONTAINMENT INTEGRITY 3/4.7.N

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

N. SECONDARY CONTAINMENT INTEGRITY

N. SECONDARY CONTAINMENT INTEGRITY

SECONDARY CONTAINMENT INTEGRITY shall be maintained.

SECONDARY CONTAINMENT INTEGRITY shall be demonstrated by:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3 and *.

1. Verifying at least once per 24 hours that the pressure within the secondary containment is ≥ 0.10 inches of vacuum water gauge.

ACTION:

2. Verifying at least once per 31 days that:

1. Without SECONDARY CONTAINMENT INTEGRITY in OPERATIONAL MODES(s) 1, 2 or 3, restore SECONDARY CONTAINMENT INTEGRITY within 4 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

a. At least one door in each secondary containment air lock is closed.

2. Without SECONDARY CONTAINMENT INTEGRITY in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

Required Action A.2 and SR 3.6.4.2.1

b. All secondary containment penetrations^(a) not capable of being closed, by OPERABLE secondary containment automatic isolation ~~clamps~~ valves and required to be closed during accident conditions are closed.

3. At least once per 18 months by operating one standby gas treatment subsystem at a flow rate ≤ 4000 cfm for one hour and maintaining ≥ 0.25 inches of vacuum water gauge in the secondary containment.

and not locked, sealed, or otherwise secured

See ITS 3.6.4.1

Required Action A.2 Note SR 3.6.4.2.1 Note 1 SR 3.6.4.2.1 Note 2

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

Valves and blind flanges in high-radiation areas may be verified by use of administrative controls. Normally locked or sealed closed penetrations may be opened intermittently under administrative control.

A.1

CONTAINMENT SYSTEMS

Secondary Containment Isolation 3/4.7.0

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

LCO 3.6.4.2 O. Secondary Containment ~~Automatic~~ Isolation ~~Dampers~~ Valves

Each secondary containment ~~ventilation~~ system automatic isolation ~~dampers~~ shall be OPERABLE.

valve

O. Secondary Containment ~~Automatic~~ Isolation ~~Dampers~~ Valves

Each secondary containment ~~ventilation~~ system automatic isolation ~~dampers~~ shall be demonstrated OPERABLE:

valve

A.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3 and *.

add proposed Note 1 to ACTIONS

add proposed Notes 2 and 3 to ACTIONS

ACTION:

valves

With one or more of the secondary containment ~~ventilation~~ system automatic isolation ~~dampers~~ inoperable, maintain at least one isolation damper OPERABLE in each effected penetration that is open and within 8 hours either:

1. Restore the inoperable dampers to OPERABLE status, or

2. Isolate each effected penetration by use of at least one deactivated automatic ~~dampers~~ secured in the isolation position, or

valve

3. Isolate each effected penetration by use of at least one closed manual valve or blind flange.

Otherwise, in OPERATIONAL MODE(s) 1, 2 or 3, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

Otherwise, in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE

1. Prior to returning the damper to service after maintenance, repair, or replacement work is performed on the valve or its associated actuator, control, or power circuit by performance of a cycling test.

2. At least once per 18 months by ~~actual or~~ verifying that on an isolation test signal each automatic isolation ~~dampers~~ valve actuates to its isolation position.

add proposed SR 3.6.4.2.2

ACTION A

ACTION C

ACTION D

Applicability When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

CONTAINMENT SYSTEMS

Secondary Containment Isolation 3/4.7.0

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

ACTION D ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

A.1

CONTAINMENT SYSTEMS

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

P. Standby Gas Treatment System

P. Standby Gas Treatment System

LCO 3.6.4.3

Two independent standby gas treatment subsystems shall be OPERABLE.

Each standby gas treatment subsystem shall be demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3 and *.

ACTION:

ACTION A 1. With one standby gas treatment subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 7 days, or:

ACTION B a. In OPERATIONAL MODE(s) 1,2 or 3, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION C b. In OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

ACTION D 2. With both standby gas treatment subsystems inoperable in OPERATIONAL MODE(s) 1,2 or 3, restore at least one subsystem to OPERABLE status within one hour, or
ACTION E be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

LA.1

SR 3.6.4.3.1

LA.2

1. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the subsystem operates for at least 10 hours with the heaters operating.

2. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the subsystem by:

a. Verifying that the subsystem satisfies the in-place penetration and bypass leakage testing acceptance criteria of <1% and uses the test procedure guidance in Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 4000 cfm ± 10%.

b. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <2.5%, when tested at 30°C and 70% relative humidity; and

add proposed SR 3.6.4.3.2

A.2

Moved to ITS Section 5.5

Add proposed Required Action C.1

L.1

Applicability When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

CONTAINMENT SYSTEMS

A.1

SBGT 3/4.7.P

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

P. Standby Gas Treatment System

Two independent standby gas treatment subsystems shall be OPERABLE.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3 and *.

ACTION:

1. With one standby gas treatment subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 7 days, or:
 - a. In OPERATIONAL MODE(s) 1,2 or 3, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
 - b. In OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.
2. With both standby gas treatment subsystems inoperable in OPERATIONAL MODE(s) 1,2 or 3, restore at least one subsystem to OPERABLE status within one hour, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

P. Standby Gas Treatment System

Each standby gas treatment subsystem shall be demonstrated OPERABLE:

1. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the subsystem operates for at least 10 hours with the heaters operating. LD.2
2. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the subsystem by: 24 significant A.11
 - a. Verifying that the subsystem satisfies the in-place penetration and bypass leakage testing acceptance criteria of <1% and uses the test procedure guidance in Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 4000 cfm ±10%. A.6

Add proposed ITS 5.5.7

 - 5.5.7.a
 - 5.5.7.b
 - b. Verifying ~~within 31 days/after removal~~ that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <2.5%, when tested at 30°C and 70% relative humidity; and A.7

and ANSI/ASME N510-1980
- 5.5.7.c LA.4

QUAD CITIES - UNITS 1 & 2

3/4.7-24

Amendment Nos. 175 & 171

< See ITS 3.6.4.3 >

A.1

ITS 3.3.6.2

CONTAINMENT SYSTEMS

SBGT 3/4.7.P

3.7 - LIMITING CONDITIONS FOR OPERATION

- 3. With both standby gas treatment subsystems inoperable in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

4.7 - SURVEILLANCE REQUIREMENTS

- c. Verifying a subsystem flow rate of 4000 cfm ± 10% during system operation when tested in accordance with ANSI N510-1980.
- 3. After every 1440 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <2.5%, when tested at 30°C and 70% relative humidity.

- 4. At least once per 18 months by: 24 D.1

a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 4000 cfm ± 10%.

b. Verifying that the filter train starts and isolation dampers open on each of the following test signals:

- 1) Manual initiation from the control room, and

2) Simulated automatic initiation signal. LA.4

c. Verifying that the heaters dissipate 30 ± 3 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations in voltage.

See ITS 3.6.4.3

SR 3.3.6.2.6

When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

CONTAINMENT SYSTEMS

SBGT 3/4.7.P

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

ACTION F

3. With both standby gas treatment subsystems inoperable in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

c. Verifying a subsystem flow rate of 4000 cfm ± 10% during system operation when tested in accordance with ANSI N510-1980.
3. After every 1440 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <2.5%, when tested at 30°C and 70% relative humidity.

A.2 moved to ITS Section 5.5

4. At least once per 18 months by:

24 LD.1

a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 4000 cfm ± 10%.

A.2 moved to ITS Section 5.5

SR 3.6.4.3.3

b. Verifying that the filter train starts and isolation dampers open on or actual each of the following test signals:

L.2

1) Manual initiation from the control room, and

LA.2

2) Simulated automatic initiation signal.

A.3

c. Verifying that the heaters dissipate 30 ± 3 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations in voltage.

A.2 moved to ITS Section 5.5

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

CONTAINMENT SYSTEMS

SBGT 3/4.7.P

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

3. With both standby gas treatment subsystems inoperable in OPERATIONAL MODE *, suspend handling of irradiated fuel in the secondary containment, CORE ALTERATION(s), and operations with a potential for draining the reactor vessel. The provisions of Specification 3.0.C are not applicable.

<See ITS 3.6.4.3>

5.5.7.a c. Verifying a subsystem flow rate of 4000 cfm ± 10% during system operation when tested in accordance with ANSI N510-1980.
5.5.7.b

5.5.7 3. After every 1440 hours of charcoal adsorber operation by verifying (within 31 days after removal) that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <2.5%, when tested at 30°C and 70% relative humidity. LA.4

5.5.7 4. At least once per 18 months by: (24) LD.2

5.5.7.d a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 4000 cfm ± 10%.

b. Verifying that the filter train starts and isolation dampers open on each of the following test signals:
1) Manual initiation from the control room, and
2) Simulated automatic initiation signal.

5.5.7.e c. Verifying that the heaters dissipate 30 ± 3 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations in voltage.

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

CONTAINMENT SYSTEMS

A.1

SBGT 3/4.7.P

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

- 5. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter bank satisfies the in-place penetration and leakage testing acceptance criteria of <1% in accordance with ANSI N510-1980 while operating the system at a flow rate of 4000 cfm ± 10%.
- 6. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorber bank satisfies the in-place penetration and leakage testing acceptance criteria of <1% in accordance with ANSI N510-1980 for a halogenated hydrocarbon refrigerant test gas while operating the system at a flow rate of 4000 cfm ± 10%.

A.2

moved to
ITS
Section
5.5

CONTAINMENT SYSTEMS

3.7 - LIMITING CONDITIONS FOR OPERATION

4.7 - SURVEILLANCE REQUIREMENTS

5.5.7 5. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter bank satisfies the in-place penetration and leakage testing acceptance criteria of <1% in accordance with ANSI N510-1980 while operating the system at a flow rate of 4000 cfm ± 10%.

5.5.7.a

5.5.7 6. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorber bank satisfies the in-place penetration and leakage testing acceptance criteria of <1% in accordance with ANSI N510-1980 for a halogenated hydrocarbon refrigerant test gas while operating the system at a flow rate of 4000 cfm ± 10%.

5.5.7.b

A.6

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the VFTP test frequencies.

PLANT SYSTEMS

A.1

ITS 3.7.1
RHRSW 3/4.8.A

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

A. Residual Heat Removal Service Water System

A. Residual Heat Removal Service Water System

LC 3.7.1

At least the following independent residual heat removal service water (RHRSW) subsystems, with each subsystem comprised of:

SR 3.7.1.1

Each of the required RHRSW subsystems shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve, manual or power operated, in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position.

- 1. Two OPERABLE RHRSW pumps, and
- 2. An OPERABLE flow path capable of taking suction from the ultimate heat sink and transferring the water:
 - a. Through one RHR heat exchanger, and separately,
 - b. To the associated safety related equipment.

LA.1

or can be aligned to the correct position

A.2

shall be OPERABLE:

1. In OPERATIONAL MODE(s) 1, 2 and 3, two subsystems.

2. In OPERATIONAL MODE(s) 4, 5 and the subsystem(s) associated with subsystems/loops and components required OPERABLE by Specifications 3.6.D, 3.6.P, 3.8.D, 3.10.K and 3.10.L.

LA.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4, 5 and :

LA.2

LA.2

When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

ACTION:

1. In OPERATIONAL MODE 1, 2 or 3:

ACTION A a. With one RHRSW pump inoperable, restore the inoperable pump to OPERABLE status within 30 days

ACTION E or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B b. With one RHRSW pump in each subsystem inoperable, restore at least one inoperable pump to OPERABLE status within 7 days or

ACTION E be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION C c. With one RHRSW subsystem otherwise inoperable, restore the inoperable subsystem to OPERABLE status with at least one OPERABLE pump within 7 days or

ACTION E be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION D d. With both RHRSW subsystems otherwise inoperable, restore at least one subsystem to OPERABLE status within 8 hours or be in at

ACTION E least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN^{2a} within the following 24 hours.

A.3

a Whenever both RHRSW subsystems are inoperable, if unable to attain COLD SHUTDOWN as required by this ACTION, maintain reactor coolant temperature as low as practical by use of alternate heat removal methods.

PLANT SYSTEMS

A.1

ITS 3.7.1

RHR SW 3/4.8.A

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

Note to
Required
Action C.1
and D.1

2. In OPERATIONAL MODE 3 ~~6/A~~ with the RHR SW subsystem which is associated with an RHR subsystem required OPERABLE by Specification 3.6.O or 3.6.P inoperable, declare the associated RHR subsystem inoperable and take the ACTION required by Specification 3.6.O or 3.6.P, as applicable.

LA.2

3. In OPERATIONAL MODE 5 with the RHR SW subsystem which is associated with an RHR subsystem required OPERABLE by Specification 3.10.K or 3.10.L inoperable, declare the associated RHR subsystem inoperable and take the ACTION required by Specification 3.10.K or 3.10.L, as applicable.

LA.2

4. In OPERATIONAL MODE * with both unit RHR SW subsystem(s) inoperable, declare the control room emergency filtration system, Train B, inoperable and take the ACTION required by Specification 3.8.D.

LA.2

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

PLANT SYSTEMS

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

B. Diesel Generator Cooling Water System

B. Diesel Generator Cooling Water System

LC 3.7.2

A diesel generator cooling water (DGCW) subsystem shall be OPERABLE for each required diesel generator with each subsystem comprised of:

- 1. One OPERABLE DGCW pump, and
- 2. An OPERABLE flow path capable of taking suction from the ultimate heat sink and transferring cooling water to the associated diesel generator.

LA.1

Each of the required DGCW subsystems shall be demonstrated OPERABLE:

- 1. At least once per 31 days by verifying that each valve in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position.
- 2. At least once per 24 months by verifying that each pump starts automatically upon receipt of a start signal for the associated diesel generator.

A.4

24

LD.1

APPLICABILITY:

When the diesel generator is required to be OPERABLE.

LA.2

MODES 1, 2 and 3

M.1

ACTION:

With one or more DGCW subsystems inoperable, declare the associated diesel generator inoperable and take the ACTION required by Specifications 3.9.A or 3.9.B, as applicable.

ACTION A

M.1

A.3

The following DGCW subsystem shall be OPERABLE:

- a. Two unit DGCW subsystems, and
- b. The opposite unit DGCW subsystem capable of supporting its associated DG.

M.1

add proposed ACTIONS Note

A.2

PLANT SYSTEMS

A.1

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

C. Ultimate Heat Sink

C. Ultimate Heat Sink

LC 0 3.7.3 The ultimate heat sink shall be OPERABLE with:

SR 3.7.3.1 The ultimate heat sink shall be determined OPERABLE at least once per 24 hours by SR 3.7.3.2 verifying the average water temperature and water level to be within their limits.

SR 3.7.3.1 1. A minimum water level at or above elevation 568 ft Mean Sea Level, and

SR 3.7.3.2 2. An average water temperature of $\leq 95^{\circ}\text{F}$.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4, 5 and *

LA.1

ACTION:

With the requirements of the above specification not satisfied:

ACTION A

1. In OPERATIONAL MODE(s) 1, 2 or 3, be in at least HOT SHUTDOWN within 12 hours and in COLD SHUTDOWN within the next 24 hours.

2. In OPERATIONAL MODE(s) 4 or 5 declare the RHRSW system and the diesel generator cooling water system inoperable and take the ACTION(s) required by Specifications 3.8.A and 3.8.B.

LA.1

3. In OPERATIONAL MODE *, declare the diesel generator cooling water system inoperable and take the ACTION(s) required by Specification 3.8.B. The provisions of Specification 3.0.C are not applicable.

LA.1

When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

D. Control Room Emergency Ventilation System

D. Control Room Emergency Ventilation System

The control room emergency ventilation system shall be OPERABLE, with the system comprised of an OPERABLE control room emergency filtration system and an OPERABLE refrigeration control unit (RCU).

The control room emergency ventilation system shall be demonstrated OPERABLE:

LCO 3.7.4

LA.1

1. At least once per 18 months by verifying that the RCU has the capability to remove the required heat load.

See ITS 3.7.5

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, and *.

SR 3.7.4.1

2. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 10 hours with the heaters operating.

LA.2

ACTION:

1. In OPERATIONAL MODE(s) 1, 2 or 3:

ACTION A

a. With the control room emergency filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION B

b. With the refrigeration control unit (RCU) inoperable, restore the inoperable RCU to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

See ITS 3.7.5

3. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the system by:

a. Verifying that the system satisfies the in-place penetration and bypass leakage testing acceptance criteria of <0.05% and uses the test procedure guidance in Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 2000 scfm ± 10%.

A.2

See ITS 5.5
Add proposed SR 3.7.4.2

Applicability When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

PLANT SYSTEMS

CREVS 3/4.8.D

A.1

A.2

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

D. Control Room Emergency Ventilation System

D. Control Room Emergency Ventilation System

LCO 3.7.5

The control room emergency ventilation system shall be OPERABLE with the system comprised of an OPERABLE control room emergency filtration system and an OPERABLE refrigeration control unit (RCU).

The control room emergency ventilation system shall be demonstrated OPERABLE:

SR 3.7.5.1

1. At least once per 18 months by verifying that the RCU has the capability to remove the required heat load.

24 LD.1

See ITS 3.7.4

2. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 10 hours with the heaters operating.

3. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the system by:

a. Verifying that the system satisfies the in-place penetration and bypass leakage testing acceptance criteria of <0.05% and uses the test procedure guidance in Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 2000 acfm ± 10%.

See ITS 5.5

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, and *.

ACTION:

1. In OPERATIONAL MODE(s) 1, 2 or 3:

a. With the control room emergency filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

See ITS 3.7.4

b. With the refrigeration control unit (RCU) inoperable, restore the inoperable RCU to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

Action A

Action B

Control Room Emergency Ventilation AC System

A.2

Applicability When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

D. Control Room Emergency Ventilation System

The control room emergency ventilation system shall be OPERABLE, with the system comprised of an OPERABLE control room emergency filtration system and an OPERABLE refrigeration control unit (RCU).

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, and *.

ACTION:

1. In OPERATIONAL MODE(s) 1, 2 or 3:
 - a. With the control room emergency filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
 - b. With the refrigeration control unit (RCU) inoperable, restore the inoperable RCU to OPERABLE status within 30 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

D. Control Room Emergency Ventilation System

The control room emergency ventilation system shall be demonstrated OPERABLE:

1. At least once per 18 months by verifying that the RCU has the capability to remove the required heat load.
2. At least once per 31 days by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 10 hours with the heaters operating.

3. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire or chemical release in any ventilation zone communicating with the system by:

- a. Verifying that the system satisfies the in-place penetration and bypass leakage testing acceptance criteria of <0.05% and uses the test procedure guidance in Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 2000 scfm ± 10%.

LD.3

24

significant

A.11

Add proposed ITS 5.5.7

A.6

A.7

and ANSI/ASME NS10-1980

See ITS 3.7.4

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

ACTION
C

2. In OPERATIONAL MODE *, with the control room emergency filtration system (or the RCU) inoperable, immediately suspend CORE ALTERATION(s), handling of irradiated fuel in the secondary containment and operations with a potential for draining the reactor vessel.

ACTION
C
NOTE

3. The provisions of Specification 3.0.C are not applicable in OPERATIONAL MODE *.

See
ITS 3.7.5

b. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity; and

c. Verifying a system flow rate of 2000 scfm ± 10% during system operation when tested in accordance with ANSI N510-1980.

A.2

4. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity.

LD.1

5. At least once per 18 months by:

24

a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 2000 scfm ± 10%.

A.2

See ITS 5.5

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

A.1

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

Action C 2. In OPERATIONAL MODE ^o, with the control room emergency filtration system or the (RCU) inoperable, immediately suspend CORE ALTERATION(s), handling of irradiated fuel in the secondary containment and operations with a potential for draining the reactor vessel.

Action C Note 3. The provisions of Specification 3.0.C are not applicable in OPERATIONAL MODE ^o.

Control Room Emergency Ventilation AC System

A.2

<See ITS 3.7.4>

b. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity; and

c. Verifying a system flow rate of 2000 scfm ± 10% during system operation when tested in accordance with ANSI N510-1980.

4. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity.

5. At least once per 18 months by:

a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 2000 scfm ± 10%.

<See ITS 5.5>

Applicability When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

QUAD CITIES - UNITS 1 & 2

3/4.8-7

Amendment Nos. 171 & 167

A.1

PLANT SYSTEMS

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

- 2. In OPERATIONAL MODE *, with the control room emergency filtration system or the RCU inoperable, immediately suspend CORE ALTERATION(s), handling of irradiated fuel in the secondary containment and operations with a potential for draining the reactor vessel.
- 3. The provisions of Specification 3.0.C are not applicable in OPERATIONAL MODE *.

- 5.5.7.c b. Verifying ~~within 31 days after removal~~ that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity; and

LA.4

- 5.5.7.a
5.5.7.b c. Verifying a system flow rate of 2000 scfm ± 10% during system operation when tested in accordance with ANSI N510-1980.

- 5.5.7 4. After every 720 hours of charcoal adsorber operation by verifying ~~within 31 days after removal~~ that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of ASTM-D-3803-89, for a methyl iodide penetration of <0.50%, when tested at 30°C and 70% relative humidity.
- 5.5.7.c

LA.4

- 5.5.7 5. At least once per ~~18~~ months by:

24

LD.3

- 5.5.7.d a. Verifying that the pressure drop across the combined HEPA filters and charcoal adsorber banks is <6 inches water gauge while operating the filter train at a flow rate of 2000 scfm ± 10%.

See ITS 3.7.4

* When handling irradiated fuel in the secondary containment, during CORE ALTERATION(s), and operations with a potential for draining the reactor vessel.

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

SR 3.7.4.3

b. Verifying that the isolation dampers close on each of the following signals:

L.1
actuator

1) Manual initiation from the control room, and

L.2

2) Simulated automatic isolation signal:

SR 3.7.4.4

c. Verifying that during the pressurization mode of operation, control room positive pressure is maintained at $\geq 1/8$ inch water gauge relative to adjacent areas during system operation at a flow rate ≤ 2000 scfm.

d. Verifying that the heaters dissipate 12 ± 1.2 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations from 480 volts at the bus.

6. After each complete or partial replacement of an HEPA filter bank by verifying that the HEPA filter bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 while operating the system at a flow rate of 2000 scfm $\pm 10\%$.

7. After each complete or partial replacement of an charcoal adsorber bank by verifying that the charcoal adsorber bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 for a halogenated hydrocarbon refrigerant test gas while operating the system at flow rate of 2000 scfm $\pm 10\%$.

A.2

< See ITS 5.5 >

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

See ITS 3.7.4

- b. Verifying that the isolation dampers close on each of the following signals:
 - 1) Manual initiation from the control room, and
 - 2) Simulated automatic isolation signal.
- c. Verifying that during the pressurization mode of operation, control room positive pressure is maintained at $\geq 1/8$ inch water gauge relative to adjacent areas during system operation at a flow rate ≤ 2000 scfm.

- d. Verifying that the heaters dissipate 12 ± 1.2 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations from 480 volts at the bus.
- 6. After each complete or partial replacement of an HEPA filter bank by verifying that the HEPA filter bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 while operating the system at a flow rate of 2000 scfm $\pm 10\%$.
- 7. After each complete or partial replacement of an charcoal adsorber bank by verifying that the charcoal adsorber bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 for a halogenated hydrocarbon refrigerant test gas while operating the system at flow rate of 2000 scfm $\pm 10\%$.

See ITS 5.5

A.1

ITS 5.5

PLANT SYSTEMS

CREVS 3/4.8.D

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

← See ITS 3.7.4 →

- b. Verifying that the isolation dampers close on each of the following signals:
 - 1) Manual initiation from the control room, and
 - 2) Simulated automatic isolation signal.
- c. Verifying that during the pressurization mode of operation, control room positive pressure is maintained at $\geq 1/8$ inch water gauge relative to adjacent areas during system operation at a flow rate ≤ 2000 scfm.

5.5.7.e d. Verifying that the heaters dissipate 12 ± 1.2 kw when tested in accordance with ANSI N510-1989. This reading shall include the appropriate correction for variations from 480 volts at the bus.

5.5.7 6. After each complete or partial replacement of an HEPA filter bank by verifying that the HEPA filter bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 while operating the system at a flow rate of $2000 \text{ scfm} \pm 10\%$.

5.5.7.a

5.5.7 7. After each complete or partial replacement of an charcoal adsorber bank by verifying that the charcoal adsorber bank satisfies the in-place penetration and leakage testing acceptance criteria of $< 0.05\%$ in accordance with ANSI N510-1980 for a halogenated hydrocarbon refrigerant test gas while operating the system at flow rate of $2000 \text{ scfm} \pm 10\%$.

5.5.7.b

A.6

→ The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the VFTP test frequencies.

PLANT SYSTEMS

Flood 3/4.8.E

3.8 - LIMITING CONDITIONS FOR OPERATION

E. Flood Protection

Flood protection shall be available for all required safe shutdown systems, components and structures.

APPLICABILITY:

At all times.

ACTION:

With the water level, as measured at the plant intake bay:

1. Above elevation 586 ft Mean Sea Level USGS datum, initiate the applicable flood protection measures.
2. Above, or predicted to exceed within 3 days, elevation 594 ft Mean Sea Level USGS datum, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

4.8 - SURVEILLANCE REQUIREMENTS

E. Flood Protection

The water level at the plant intake bay shall be determined to be within the limit by:

1. Measurement at least once per 24 hours when the water level is below elevation 585.5 ft Mean Sea Level USGS datum, and
2. Measurement at least once per 2 hours when the water level is equal to or above elevation 585.5 ft Mean Sea Level USGS datum.

R.1

PLANT SYSTEMS

LA.1

Snubbers 3/4.8.F

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

F. Snubbers

F. Snubbers

All required snubbers shall be OPERABLE. The only snubbers excluded from this requirement are those installed on nonsafety-related systems and then only if their failure or failure of the system on which they are installed would have no adverse impact on any safety-related system.

Each snubber shall be demonstrated OPERABLE by the performance of the following augmented inservice inspection program in addition to the requirements of Specification 4.0.E.

APPLICABILITY:

1. Inspection Types

OPERATIONAL MODE(s) 1, 2 and 3.
OPERATIONAL MODE(s) 4 and 5 for snubbers located on systems required OPERABLE in OPERATIONAL MODE(s) 4 and 5.

As used in this specification, "type of snubber" shall mean snubbers of the same design and manufacturer, irrespective of capacity.

ACTION:

2. Visual Inspections

With one or more snubbers inoperable, on any system, within 72 hours:

Snubbers are categorized as inaccessible or accessible during reactor operation. Each of these categories (inaccessible and accessible) may be inspected independently according to the schedule determined by Table 4.8.F-1. The visual inspection interval for each type of snubber shall be determined based upon the criteria provided in Table 4.8.F-1^(a).

1. Replace or restore the inoperable snubbe/(s) to OPERABLE status, and
2. Perform an engineering evaluation per Specification 4.8.F.7 on the attached component.

3. Visual Inspection Acceptance Criteria

Otherwise, declare the attached system inoperable and follow the appropriate ACTION statement for that system.

Visual inspections shall verify that: (1) the snubber has no visible indications of damage or impaired OPERABILITY, (2) attachments to the foundation or supporting structure are functional, and (3) fasteners for the attachment of the snubber to the component and to the snubber anchorage are functional. Snubbers which appear inoperable as a result of

a The first inspection interval determined using this criteria shall be based upon the previous inspection interval as established by the requirements in effect before amendment nos 171 and 167.

LA.1

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

visual inspections shall be classified as unacceptable. A review and evaluation shall be performed and documented to justify continued operation with an unacceptable snubber. If continued operation cannot be justified, the snubber shall be declared inoperable and the ACTION requirements shall be met.

Snubbers originally classified as unacceptable may be reclassified as acceptable for the purpose of establishing the next visual inspection interval, provided that: (1) the cause of the rejection is clearly established and remedied for that particular snubber and for other snubbers irrespective of type that may be generically susceptible; and (2) the affected snubber is functionally tested in the as-found condition and determined OPERABLE per Specification 4.8.F.6.

4. Transient Event Inspection

An inspection shall be performed of all snubbers attached to sections of systems that have experienced unexpected, potentially damaging transients, as determined from a review of operational data or a visual inspection of the systems, within 72 hours for accessible systems and 6 months for inaccessible systems following this determination. In addition to satisfying the visual inspection acceptance criteria, freedom-of-motion of mechanical snubbers shall be verified using at least one of the following: (1) manually induced snubber movement; or (2) evaluation of in-place snubber piston setting; or (3) stroking the mechanical snubber through its full range of travel.

LA.1

PLANT SYSTEMS

Snubbers 3/4.8.F

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

5. Functional Tests

At least once per 18 months, a representative sample of snubbers shall be tested using one of the following sample plans for each type of snubber. The sample plan shall be selected prior to the test period and cannot be changed during the test period. The NRC Regional Administrator shall be notified in writing of the sample plan selected prior to the test period or the sample plan used in the prior test period shall be implemented:

- a. At least 10% of the total of each type of snubber shall be functionally tested either in-place or in a bench test. For each snubber of a type that does not meet the functional test acceptance criteria of Specification 4.8.F.6, an additional 10% of that type of snubber shall be functionally tested until no more failures are found or until all snubbers of that type have been functionally tested; or
- b. A representative sample of each type of snubber shall be functionally tested, in accordance with Figure 4.8.F-1. "C" is the total number of snubbers of a type found not meeting the acceptance requirements of Specification 4.8.F.6. The cumulative number of snubbers of a type tested is denoted by "N". At the end of each day's testing, the new values of "N" and "C" (previous day's total plus current day's increments) shall be plotted on Figure 4.8.F-1.

LA.1

CTS 3/4.8.F

Snubbers 3/4.8.F

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

If at any time the point plotted falls on or above the "Reject" line, all snubbers of that type shall be functionally tested. If at any time the point plotted falls on or below the "Accept" line, testing of snubbers of that type may be terminated. When the point plotted lies in the "Continue Testing" region, additional snubbers of that type shall be tested until the point falls in the "Accept" region or the "Reject" region, or all the snubbers of that type have been tested. Testing equipment failure during functional testing may invalidate that day's testing and allow that day's testing to resume anew at a later time, providing all snubbers tested with the failed equipment during the day of equipment failure are retested; or

- c. An initial representative sample of 55 snubbers of each type shall be functionally tested. For each snubber type which does not meet the functional test acceptance criteria, another sample of at least one-half the size of the initial sample shall be tested until the total number tested is equal to the initial sample size multiplied by the factor, $1 + C/2$, where "C" is the number of snubbers found which do not meet the functional test acceptance criteria. The results from this sample plan shall be plotted using an "Accept" line which follows the equation $N = 55(1 + C/2)$. Each snubber point should be plotted as soon as the snubber is tested. If the point plotted falls on or below the

LA.1

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

"Accept" line, testing of that type of snubber may be terminated. If the point plotted falls above the "Accept" line, testing must continue until the point falls on or below the "Accept" line or all the snubbers of that type have been tested.

The representative sample selected for the functional test sample plans shall be randomly selected from the snubbers of each type and reviewed before beginning the testing. The review shall ensure as far as practical that they are representative of the various configurations, operating environments, range of size, and capacity of snubbers of each type.

Snubbers placed in the same location as snubbers which failed the previous functional test shall be retested at the time of the next functional test but shall not be included in the sample plan, and failure of this functional test shall not be the sole cause for increasing the sample size under the sample plan. If during testing, additional sampling is required due to failure of only one type of snubber, the functional testing results shall be reviewed at the time to determine if additional samples should be limited to the type of snubber which has failed the functional testing.

6. Functional Test Acceptance Criteria

The snubber functional test shall verify that:

- a. Activation (restraining action) is achieved within the specified range in both tension and compression;

LA.1

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

- b. The force required to initiate or maintain motion of the snubber is within the specified range in both directions of travel; and
- c. For snubbers specifically required not to displace under continuous load, the ability of the snubber to withstand load without displacement.

Testing methods may be used to measure parameters indirectly or parameters other than those specified if those results can be correlated to the specified parameters through established methods.

7. Functional Test Failure Analysis

An engineering evaluation shall be made of each failure to meet the functional test acceptance criteria to determine the cause for the failure. The results of this evaluation shall be used, if applicable, in selecting snubbers to be tested in an effort to determine the OPERABILITY of other snubbers irrespective of type which may be subject to the same failure mode.

For the snubbers found inoperable, an engineering evaluation shall be performed on the components to which the inoperable snubbers are attached. The purpose of this engineering evaluation shall be to determine if the components to which the inoperable snubbers are attached were adversely affected by the inoperability of the snubbers in order to ensure that the component remains capable of meeting the designed service.

LA.1

CTS 3/4.8.F

Snubbers 3/4.8.F

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

If any snubber selected for functional testing either fails to lock up or fails to move, i.e., frozen-in-place, the cause will be evaluated and, if caused by manufacturer or design deficiency, all snubbers of the same type subject to the same defect shall be functionally tested. This testing requirement shall be independent of the requirements stated in Specification 4.8.F.5 for snubbers not meeting the functional test acceptance criteria.

8. Functional Testing of Repaired and Replaced Snubbers

Snubbers which fail the visual inspection or the functional test acceptance criteria shall be repaired or replaced. Replacement snubbers and snubbers which have repairs which might affect the functional test result shall be tested to meet the functional test criteria before installation in the unit. Mechanical snubbers shall have met the acceptance criteria subsequent to their most recent service, and the freedom-of-motion test must have been performed within 12 months before being installed in the unit.

9. Snubber Service Life Program

The service life of all snubbers shall be monitored to ensure that the service life is not exceeded between surveillance inspections. The maximum expected service life for various seals, springs, and other critical parts shall be extended or shortened based on monitored test results and failure history. Critical parts shall be replaced so that the maximum service life will not be exceeded during a period when

PLANT SYSTEMS

LA.1

CTS 3/4.8.F

Snubbers 3/4.8.F

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

the snubber is required to be OPERABLE. The parts replacements shall be documented and the documentation shall be retained.

L.A.1

TABLE 4.B.F-1

SNUBBER VISUAL INSPECTION CRITERIA


NUMBER OF UNACCEPTABLE SNUBBERS

Population ^(mm) or Category	Column A ^(mm) <u>Extend Interval</u>	Column B ^(mm) <u>Repeat Interval</u>	Column C ^(mm) <u>Reduce Interval</u>
1	0	0	1
80	0	0	2
100	0	1	4
150	0	3	8
200	2	5	13
300	5	12	25
400	8	18	36
500	12	24	48
750	20	40	78
≥1000	29	56	109

- a The next visual inspection interval for a snubber population or category size shall be determined based upon the previous inspection interval and the number of unacceptable snubbers found during that interval. Snubbers may be categorized, based upon their accessibility during power operation, as accessible or inaccessible. These categories may be examined separately or jointly. However, the decision must be made and documented before any inspection and shall be used as the basis upon which to determine the next inspection interval for that category.
- b Interpolation between population or category sizes and the number of unacceptable snubbers is permissible. Use next lower integer for the value of the limit for Columns A, B, or C if that integer includes a fractional value of unacceptable snubbers as determined by interpolation.
- c If the number of unacceptable snubbers is equal to or less than the number in Column A, the next inspection interval may be twice the previous interval, but not greater than 48 months.
- d If the number of unacceptable snubbers is equal to or less than the number in Column B but greater than the number in Column A, the next inspection interval shall be the same as the previous interval.
- e If the number of unacceptable snubbers is equal to or greater than the number in Column C, the next inspection interval shall be two-thirds of the previous interval, but not less than 31 days. However, if the number of unacceptable snubbers is less than the number in Column C but greater than the number in Column B, the next interval shall be reduced proportionally by interpolation, that is, the previous interval shall be reduced by a factor that is one-third of the ratio of the difference between the number of unacceptable snubbers found during the previous interval and the number in Column B to the difference in the numbers in Columns B and C.
- f The provisions of Specification 4.0.B are applicable for all inspection intervals up to and including 48 months.

LA.1

FIGURE 4.8.F-1
SAMPLING PLAN FOR SNUBBER FUNCTIONAL TESTING

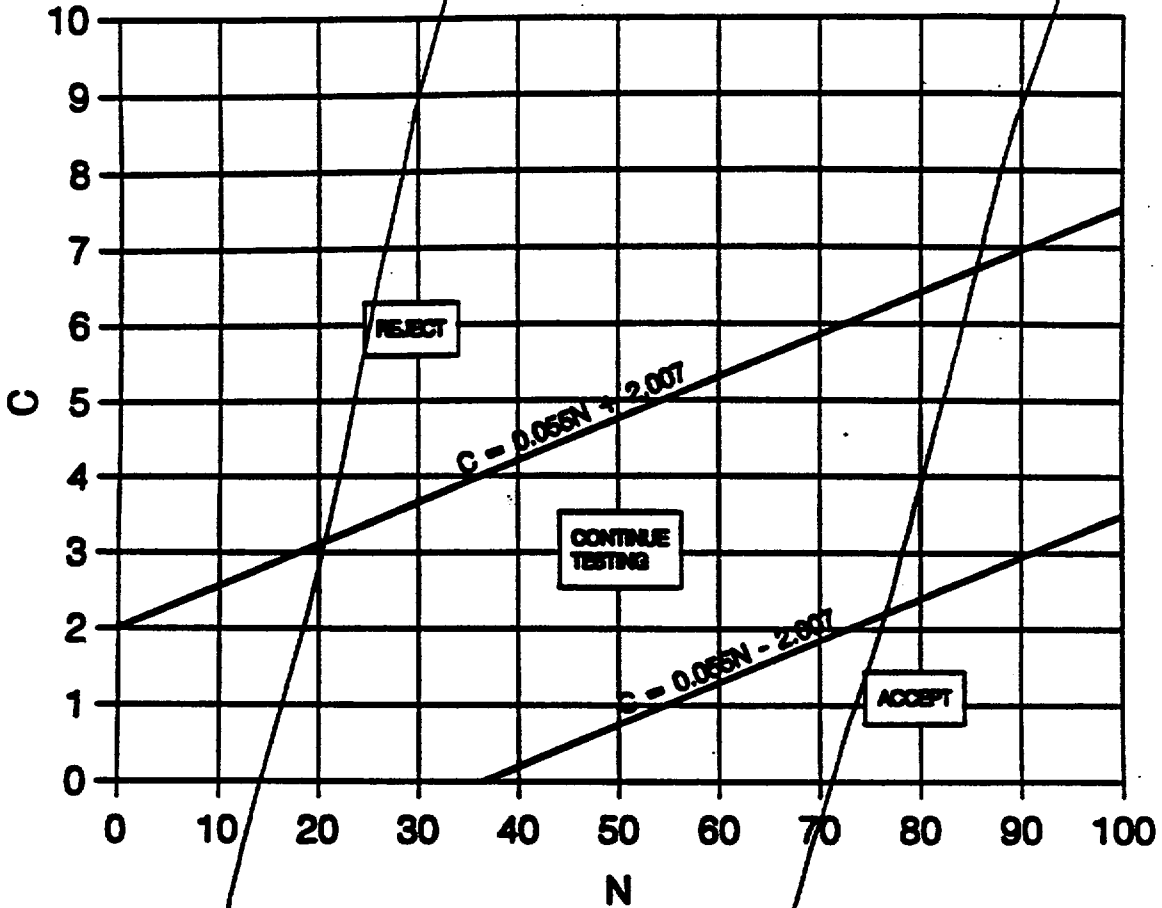

N = Cumulative number of snubbers of a type tested.

C = Total number of snubbers of a type not meeting acceptance requirements.

R.1

3.8 - LIMITING CONDITIONS FOR OPERATION

G. Sealed Source Contamination

Each sealed source containing radioactive material either in excess of 100 μCi of beta and/or gamma emitting material or 5 μCi of alpha emitting material shall be free of $\geq 0.005 \mu\text{Ci}$ of removable contamination.

APPLICABILITY:

At all times.

ACTION:

1. With a sealed source having removable contamination in excess of the above limit, withdraw the sealed source from use and either:
 - a. Decontaminate and repair the sealed source, or
 - b. Dispose of the sealed source in accordance with Commission Regulations.
2. With a sealed source leakage test revealing the presence of removable contamination in excess of the above limit, a report shall be prepared and submitted to the Commission on an annual basis.
3. The provisions of Specification 3.0.C are not applicable.

4.8 - SURVEILLANCE REQUIREMENTS

G. Sealed Source Contamination

1. Test Requirements - Each sealed source shall be tested for leakage and/or contamination by:
 - a. The licensee, or
 - b. Other persons specifically authorized by the Commission or an Agreement State.

The test method shall have a detection sensitivity of at least 0.005 μCi per test sample.

2. Test Frequencies - Each category of sealed sources, excluding startup sources and fission detectors previously subjected to core flux, shall be tested at the frequency described below.
 - a. Sources in use - At least once per 6 months for all sealed sources containing radioactive material:
 - 1) With a half-life > 30 days, excluding Hydrogen 3, and
 - 2) in any form other than gas.
 - b. Stored sources not in use - Each sealed source shall be tested prior to use or transfer to another licensee unless tested within the previous 6 months. Sealed sources transferred without a certificate indicating the last test date shall be tested prior to being placed into use.

PLANT SYSTEMS

R.1

CTS 3/4.8.G

Sealed Source 3/4.8.G

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

- c. Startup sources and fission detectors - Each sealed startup source and fission detector shall be tested within 31 days prior to being subjected to core flux or installed in the core and following repair or maintenance to the source.

A.1

PLANT SYSTEMS

Explosive Gas Mixture 3/4.8.H

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

H. Offgas Explosive Mixture

H. Explosive Gas Mixture

5.5.8.a The concentration of hydrogen in the offgas holdup system shall be limited to ≤4% by volume.

5.5.8.a The concentration of hydrogen in the offgas holdup system shall be determined to be within the above limits as required by Table 3.2.H/1 of Specification 3.2.H.

APPLICABILITY:
During offgas holdup system operation.

ACTION:
With the concentration of hydrogen in the offgas holdup system exceeding the limit, restore the concentration to within the limit within 48 hours. The provisions of Specification 3.0.C are not applicable.

LA.5

M.2

Add proposed ITS 5.5.8 for Storage Tank Radioactivity Monitoring

A.8

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Explosive Gas and Storage Tank Radioactivity Monitoring Program Surveillance Frequencies.

PLANT SYSTEMS

ITS 3.7.6
Offgas Activity 3/4.8.1

A.1

3.8 - LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

I. Main Condenser Offgas Activity

I. Main Condenser Offgas Activity

The release rate of the sum of the activities of the noble gases measured prior to the offgas holdup line shall be limited to $5(100) \mu\text{Ci/sec (MW)}$, after 30 minutes decay.

1. The release rate of noble gases from the main condenser air ejector shall be continuously monitored in accordance with the ODCM.

2. The release rate of the sum of the activities from noble gases from the main condenser air ejector shall be determined to be within the limits of Specification 3.8.1 at the following frequencies^(a) by performing an isotopic analysis of a representative sample of gases taken at the recombiner outlet, or the air ejector outlet, if the recombiner is bypassed.

- a. At least once per 31 days, and
- b. Within 4 hours following the determination of an increase of >50%.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2nd and 3rd.

ACTION:

With the release rate of the sum of the activities of the noble gases in the main condenser air ejector effluent (as measured prior to the offgas holdup line) > $100 \mu\text{Ci/sec (MW)}$, after 30 minutes decay, restore the release rate to within its limit within 72 hours of ~~the increase~~ **STARTUP** with the main steam isolation valves closed within the next 2 hours.

STARTUP with the main steam isolation valves closed within the next 2 hours.

LC 3.7.6

25,100

A.2

SR 3.7.6.1

A.2

25,100

ACTION A

Required Action B.1

12 L.1

add proposed Required Action B.2

A.3

add proposed Required Action B.3.1 and B.3.1

L.2

after factoring out increases due to changes in THERMAL POWER level

L.3

or equal to

A.1

With any main steam line not isolated and

A.3

L.4

- a When the main condenser air ejector is in operation.
- b The provisions of Specification 4.0.D are not applicable.

add proposed Note to SR 3.7.6.1

SR 3.7.6.1 Note

ITS 37.9

A.1

PLANT SYSTEMS

SSMP 3/4.8.J

3.8 LIMITING CONDITIONS FOR OPERATION

4.8 - SURVEILLANCE REQUIREMENTS

J. Safe Shutdown Makeup Pump

J. Safe Shutdown Makeup Pump

LCO 3.7.9 The Safe Shutdown Makeup Pump (SSMP) shall be OPERABLE.

The SSMP system shall be demonstrated OPERABLE:

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2 and 3 with reactor steam dome pressure greater than 150 psig.

ACTION:

1. At least once per 31 days by:

a. Verifying that each valve, manual, power operated or automatic in the flow path that is not locked, sealed or otherwise secured in position, is in its correct position.

SR 3.7.9.1

b. Verifying that the pump flow controller is in the correct position.

L.A.1

1. With the SSMP system inoperable, restore the inoperable SSMP system to OPERABLE status within 14 days, or

ACTION A

be in at least HOT SHUTDOWN within the next 12 hours and in COLD

ACTION B

SHUTDOWN within the following 24 hours.

SR 3.7.9.2

2. At least once per 92 days by verifying that the SSMP develops a flow of greater than or equal to 400 gpm against a system head corresponding to reactor vessel pressure of greater than 1120 psig.

≤ 150 psig

A.2

A.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

M.1

A. A.C. Sources - Operating

A. A.C. Sources - Operating

add proposed Surveillance Table Notes 1 and 2

LCO 3.8.1

As a minimum, the following A.C. electrical power sources shall be OPERABLE:

qualified

LCO 3.8.1.a

1. Two physically independent circuits between the offsite transmission network and the onsite Class 1E distribution system, and

L.A.1

L.A.1

LCO 3.8.1.b

2. Two separate and independent diesel generators, each with:

SR 3.8.1.1

a. A separate fuel oil day tank containing ≥205 gallons of available fuel,

A.2

SR 3.8.1.9

SR 3.8.1.4

A.2

SR 3.8.1.4

b. A separate bulk fuel storage system containing ≥10,000 gallons of available fuel, and

SR 3.8.1.4

SR 3.8.1.6

c. A separate fuel oil transfer pump.

L.A.1

a. At least once per 7 days by verifying correct breaker alignments and indicated power availability, and

24

L.D.1

b. At least once per 24 months by manually transferring the power supply from the normal circuit to the alternate circuit.

2. Each of the required diesel generators shall be demonstrated OPERABLE™ at least once per 31 days by:

SR 3.8.1.4

a. Verifying the fuel levels in both the fuel oil day tank and the bulk fuel storage tank.

SR 3.8.1.6

b. Verifying the fuel transfer pump starts and transfers fuel from the bulk fuel storage system to the fuel oil day tank.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 3.

ACTION:

1. With one of the above required offsite circuit power sources inoperable:

ACTION A

a. Demonstrate the OPERABILITY of the remaining offsite circuit by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.

add proposed LCO 3.8.1.c and d

add proposed Applicability Note

add proposed ACTION Note

M.2

add proposed Required Action A.2

SR 3.8.1.2 Note 1

All diesel generator starts may be preceded by an engine pre-lube period. All diesel generator starts that require loading may be preceded by an engine pre-lube period and followed by a warmup period prior to loading. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor.

SR 3.8.1.3 Note 1

A.1

ELECTRICAL POWER SYSTEMS

General Description

A.C. Sources - Operating 3/4.9.A

A.2

3.9 - LIMITING CONDITIONS FOR OPERATION

A. A.C. Sources - Operating

As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- 1. Two physically independent circuits between the offsite transmission network and the onsite Class 1E distribution system, and
- 2. Two separate and independent diesel generators, each with:
 - a. A separate fuel oil day tank containing ≥205 gallons of available fuel,
 - b. A separate bulk fuel storage system containing ≥10,000 gallons of available fuel, and
 - c. A separate fuel oil transfer pump.

Add proposed fuel oil and starting air LCD

4.9 - SURVEILLANCE REQUIREMENTS

A. A.C. Sources - Operating

- 1. Each of the required independent circuits between the offsite transmission network and the onsite Class 1E distribution system shall be determined OPERABLE:
 - a. At least once per 7 days by verifying correct breaker alignments and indicated power availability, and
 - b. At least once per 18 months by manually transferring the power supply from the normal circuit to the alternate circuit.
- 2. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 31 days by:
 - a. Verifying the fuel levels in both the fuel oil day tank and the bulk fuel storage tank.
 - b. Verifying the fuel transfer pump starts and transfers fuel from the bulk fuel storage system to the fuel oil day tank.

SR 3.8.3.2

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 3.

A.2

ACTION:

- 1. With one of the above required offsite circuit power sources inoperable:
 - a. Demonstrate the OPERABILITY of the remaining offsite circuit by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.

Add proposed Actions Note

A.3

See ITS 3.8.1

a All diesel generator starts may be preceded by an engine prelude period. All diesel generator starts that require loading may be preceded by an engine prelude period and followed by a warmup period prior to loading. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor.

ELECTRICAL POWER SYSTEMS

A.1

ITS 3.8.1

3.9 - LIMITING CONDITIONS FOR OPERATION

ACTION A
add proposed Required Action A.3
2nd Completion Time
L.1

b. Restore the inoperable offsite circuit to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION F

2. With one of the above required diesel generator power sources inoperable:

a. Demonstrate the OPERABILITY of the offsite circuit power sources by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.

b. If the diesel generator is inoperable due to any cause other than an inoperable support system, an independently testable component, or preplanned preventive maintenance or testing, demonstrate the OPERABILITY of the remaining OPERABLE diesel generator by performing Surveillance Requirement 4.9.A.2.c within 24 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours, and

L.3

ACTION B

A.C. Sources - Operating 3/4.9.A

add proposed Note 3 to SR 3.8.1.2

A.4

A.3

add proposed Note 2 to SR 3.8.1.2

4.9 - SURVEILLANCE REQUIREMENTS

A.5

SR 3.8.1.2

Add proposed Note 4 to SR 3.8.1.3

M.3

SR 3.8.1.3

2340

L.12

c. Verifying the diesel starts and accelerates to synchronous speed with generator voltage and frequency at 4160 ± 420 volts and 60 ± 1.2 Hz, respectively.

A.13

208

add proposed Note 5 to SR 3.8.1.3

A.4

d. Verifying the diesel generator is synchronized, loaded to between 2470 and 2600 kW in accordance with the manufacturer's/vendor's recommendations, and operates with this load for ≥ 60 minutes.

e. Verifying the diesel generator is aligned to provide standby power to the associated emergency busses.

L.4

A.6 moved to ITS 3.8.3

f. Verifying the pressure in required starting air receiver tanks to be ≥ 230 psig.

3. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 31 days and after each operation of the diesel where the period of operation was ≥ 1 hour by removing any accumulated water from the day tank.

L.5

SR 3.8.6.5

SR 3.8.1.7

4. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 92 days by checking for and removing accumulated water from the fuel oil bulk storage tanks.

L.2

b. Contrary to the provisions of Specification 3.0.B, this test is required to be completed regardless of when the inoperable diesel generator is restored to OPERABILITY for failures that are potentially generic to the remaining diesel generator and for which appropriate alternative testing cannot be designed.

c. Surveillance Requirement 4.9.A.7 may be substituted for Surveillance Requirement 4.9.A.2.c.

A.5

d. Momentary transients outside of the load range do not invalidate this test. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor. This surveillance shall be conducted on only one diesel generator at a time.

Notes 1, 2 and 3 to SR 3.8.1.3

A.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- b. Restore the inoperable offsite circuit to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
- 2. With one of the above required diesel generator power sources inoperable:
 - a. Demonstrate the OPERABILITY of the offsite circuit power sources by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.
 - b. If the diesel generator is inoperable due to any cause other than an inoperable support system, an independently testable component, or preplanned preventive maintenance or testing, demonstrate the OPERABILITY of the remaining OPERABLE diesel generator by performing Surveillance Requirement 4.9.A.2.c^m within 24 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours, and

- c. Verifying^m the diesel starts and accelerates to synchronous speed with generator voltage and frequency at 4160 ± 420 volts and 60 ± 1.2 Hz, respectively.
- d. Verifying the diesel generator is synchronized, loaded to between 2470 and 2600 kW^m in accordance with the manufacturer's/vendor's recommendations, and operates with this load for ≥ 60 minutes.
- e. Verifying the diesel generator is aligned to provide standby power to the associated emergency buses.
- f. Verifying the pressure in required starting air receiver tanks to be ≥ 230 psig.
- 3. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 31 days and after each operation of the diesel where the period of operation was ≥ 1 hour by removing any accumulated water from the day tank.
- 4. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 92 days by checking for and removing accumulated water from the fuel oil bulk storage tanks.

See ITS 3.8.1

- b. Contrary to the provisions of Specification 3.0.B, this test is required to be completed regardless of when the inoperable diesel generator is restored to OPERABILITY for failures that are potentially generic to the remaining diesel generator and for which appropriate alternative testing cannot be designed.
- c. Surveillance Requirement 4.9.A.7 may be substituted for Surveillance Requirement 4.9.A.2.c.
- d. Momentary transients outside of the load range do not invalidate this test. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor. This surveillance shall be conducted on only one diesel generator at a time.

ELECTRICAL POWER SYSTEMS

ITS 3.8.1

A.C. Sources - Operating 3/4.9.A

A.1

L.1

add proposed Required Action B.4 2nd completion Time

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

Required Action B.4

ACTION F

c. Restore the diesel generator to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

add proposed ACTION D Note

Condition D

3. With one of the above offsite circuit power sources and one of the above required diesel generator power sources inoperable:

A.7

Required Actions A.1 and B.1

a. Demonstrate the OPERABILITY of the remaining offsite circuit power source by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.

Required Action B.3.2

b. If the diesel generator is inoperable due to any cause other than preplanned preventive maintenance or testing, demonstrate the OPERABILITY of the remaining OPERABLE diesel generator by performing Surveillance Requirement 4.9.A.2.c within 8 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours for each OPERABLE diesel generator.

A.8

L.3

2.4

Required Action B.3.1

8 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours for each OPERABLE diesel generator.

5. Each of the required diesel generators shall be demonstrated OPERABLE by:

a. Sampling new fuel oil prior to addition to the storage tanks in accordance with applicable ASTM standards, and

b. Verifying prior to addition to the storage tanks that the sample meets the applicable ASTM standards for API gravity, water and sediment, and the visual test for free water and particulate contamination^m, and

c. Verifying within 31 days of obtaining the sample that the kinematic viscosity is within applicable ASTM limits.

6. Each of the required diesel generators shall be demonstrated OPERABLE by:

a. Sampling and analyzing the bulk fuel storage tanks at least once per 31 days in accordance with applicable ASTM standards, and

b. Verifying that the sample meets the applicable ASTM standards for water and sediment, kinematic viscosity, and ASTM particulate contaminant^m is < 10 mg/liter.

A.6 moved to ITS 3.8.3

A.6

a. A successful test of OPERABILITY per Surveillance Requirement 4.9.A.2.c under this ACTION/statement satisfies the diesel generator test requirements of ACTION(s) 1 or 2 above.

L.2

b. Contrary to the provisions of Specification 3.0.B, this test is required to be completed regardless of when the inoperable diesel generator is restored to OPERABILITY for failures that are potentially generic to the remaining diesel generator and for which appropriate alternative testing cannot be designed.

n. The particulate contamination surveillance is not required for No. 1 fuel oil. It is required for No. 2 fuel oil and for blends.

A.6 moved to ITS 3.9.3

QUAD CITIES - UNITS 1 & 2

3/4.9-3

Amendment Nos. 171 & 167

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- c. Restore the diesel generator to **OPERABLE** status within 7 days or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.
- 3. With one of the above offsite circuit power sources and one of the above required diesel generator power sources inoperable:
 - a. Demonstrate the **OPERABILITY** of the remaining offsite circuit power source by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.
 - b. If the diesel generator is inoperable due to any cause other than preplanned preventive maintenance or testing, demonstrate the **OPERABILITYSM** of the remaining **OPERABLE** diesel generator by performing Surveillance Requirement 4.9.A.2.cSM within 8 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours for each **OPERABLE** diesel generator.

- 5. Each of the required diesel generators shall be demonstrated **OPERABLE** by:
 - a. Sampling new fuel oil prior to addition to the storage tanks in accordance with applicable ASTM standards, and
 - b. Verifying prior to addition to the storage tanks that the sample meets the applicable ASTM standards for API gravity, water and sediment, and the visual test for free water and particulate contaminationSM, and
 - c. Verifying within 31 days of obtaining the sample that the kinematic viscosity is within applicable ASTM limits.
- 6. Each of the required diesel generators shall be demonstrated **OPERABLE** by:
 - a. Sampling and analyzing the bulk fuel storage tanks at least once per 31 days in accordance with applicable ASTM standards, and
 - b. Verifying that the sample meets the applicable ASTM standards for water and sediment, kinematic viscosity, and ASTM particulate contaminantSM is < 10 mg/liter.

A.4

Add proposed SR 3.8.3.1

See ITS 3.8.1

- e A successful test of **OPERABILITY** per Surveillance Requirement 4.9.A.2.c under this **ACTION** statement satisfies the diesel generator test requirements of **ACTION(s)** 1 or 2 above.
- b Contrary to the provisions of Specification 3.0.B, this test is required to be completed regardless of when the inoperable diesel generator is restored to **OPERABILITY** for failures that are potentially generic to the remaining diesel generator and for which appropriate alternative testing cannot be designed.
- fn The particulate contamination surveillance is not required for No. 1 fuel oil. It is required for No. 2 fuel oil and for blends.

A.4

ELECTRICAL POWER SYSTEMS

A.1

A.C. Sources - Operating 3/4.8.A A.9

Add proposed ITS 5.5.9

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- c. Restore the diesel generator to OPERABLE status within 7 days or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
- 3. With one of the above offsite circuit power sources and one of the above required diesel generator power sources inoperable:
 - a. Demonstrate the OPERABILITY of the remaining offsite circuit power source by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.
 - b. If the diesel generator is inoperable due to any cause other than unplanned preventive maintenance or testing, demonstrate the OPERABILITYSM of the remaining OPERABLE diesel generator by performing Surveillance Requirement 4.9.A.2.cSM within 8 hours unless the absence of any potential common mode failure for the remaining diesel generator is demonstrated (if it has not been successfully tested within the past 24 hours) and within the subsequent 72 hours for each OPERABLE diesel generator.

5. Each of the required diesel generators shall be demonstrated OPERABLE by:

5.5.9 a. Sampling new fuel oil prior to addition to the storage tanks in accordance with applicable ASTM standards, and

5.5.9.a

L.1

or absolute specific gravity

L.1

b. Verifying prior to addition to the storage tanks that the sample meets the applicable ASTM standards for API gravity, water and sediment, and the visual test for free water and particulate contaminationSM, and

5.5.9.a.1
5.5.9.a.2
5.5.9.a.3

L.1

flash point

M.3

5.5.9.b c. Verifying within 31 days of obtaining the sample that the kinematic viscositySM within applicable ASTM limits.

addition of the new fuel oil to storage tanks

properties of the fuel oil, other than those addressed above are

6. Each of the required diesel generators shall be demonstrated OPERABLE by:

5.5.9.c a. Sampling and analyzing the bulk fuel storage tanks at least once per 31 days in accordance with applicable ASTM standards, and

5.5.9.c b. Verifying that the sample meets the applicable ASTM standards for water and sediment, kinematic viscosity, and ASTM particulate contaminantSM is ≤ 10 mg/liter.

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Diesel Fuel Oil Testing Program testing frequencies.

- e A successful test of OPERABILITY per Surveillance Requirement 4.9.A.2.c under this ACTION statement satisfies the diesel generator test requirements of ACTION(s) 1 or 2 above.
- b Contrary to the provisions of Specification 3.0.B, this test is required to be completed regardless of when the inoperable diesel generator is restored to OPERABILITY for failures that are potentially generic to the remaining diesel generator and for which appropriate alternative testing cannot be designed.

h The particulate contamination surveillance is not required for No. 1 fuel oil. It is required for No. 2 fuel oil and for blends.

QUAD CITIES - UNITS 1 & 2

3/4.9-3

Amendment Nos. 171 & 167

See ITS 3.8.1

Add proposed ITS 5.5.10

Add proposed ITS 5.5.11

ELECTRICAL POWER SYSTEMS

A.1

add proposed Note 2 to SR 3.8.1.8

ITS 3.8.1

A.13

A.C. Sources - Operating 3/4.9.A

258.8 Hz and 2,395r

L.7

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

Required Actions D.1 and D.2

c. Restore at least one of the inoperable A.C. power sources to **OPERABLE** status within **12 hours** or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours, and

ACTION F

SR 3.8.1.8

7. Each of the required diesel generators shall be demonstrated **OPERABLE** at least once per 184 days by verifying the diesel starts and accelerates to **synchronous speed** in **≤10 seconds**. The generator voltage and frequency shall be verified to reach **4160 ± 420 volts** and **60 ± 1.2 Hz**, respectively, **≤10 seconds** after the start signal.

A.9

A.5

Steady state

2.08

A.13

L.7

Required Actions A.3 and B.4

d. Restore both offsite circuits and both diesel generators to **OPERABLE** status within **7 days** from the time of the initial loss or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.

ACTION F

8. Each of the required diesel generators shall be demonstrated **OPERABLE** at least once per **18 months** by:

a. Deleted.

24

L.0.1

add proposed Required Action A.3 2nd Completion Time and Required Action B.4 2nd Completion Time

L.1

Required Action B.2

4. With one of the above required diesel generator power sources inoperable, in addition to ACTION 2 or 3, as applicable:

a. Verify within **0** hours that at least one of the required two systems, subsystems, trains, components and devices in two train systems is **OPERABLE** including its emergency power supply.

L.6

b. Otherwise, take the applicable **ACTIONS** for both systems, subsystems, trains, components or devices inoperable, or be in at least **HOT SHUTDOWN** within the next 12 hours and in **COLD SHUTDOWN** within the following 24 hours.

ACTION F

SR 3.8.1.9 Note 1
SR 3.8.1.13 Note
SR 3.8.1.12 Note
SR 3.8.1.16 Note 2
SR 3.8.1.19 Note

All diesel generator starts may be preceded by an engine pre-lube period. All diesel generator starts that require loading may be preceded by an engine pre-lube period and followed by a warmup period prior to loading. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor.

A.9

Surveillance Requirement 4.9.A.7 may be substituted for Surveillance Requirement 4.9.A.2.c.

A.5

QUAD CITIES - UNITS 1 & 2

3/4.9-4

Amendment Nos. 171 & 167

ELECTRICAL POWER SYSTEMS

A.1

ITS 3.8.1

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- ACTION C) 5. With two of the above required offsite circuit power sources inoperable:
 - a. Restore at least one of the inoperable offsite circuits to OPERABLE status within 24 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
 - b. Restore at least two offsite circuits to OPERABLE status within 7 days from the time of initial loss or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
- ACTION F) (linked to 5a)
- ACTION A) (linked to 5b)
- ACTION F) (linked to 5b)
- ACTION E) 6. With both of the above required diesel generator power sources inoperable:
 - a. Demonstrate the OPERABILITY of the offsite circuit power sources by performing Surveillance Requirement 4.9.A.1.a within 1 hour and at least once per 8 hours thereafter.

Required Action B.1

SR 3.8.1.12

- b. Verify the diesel generator rejects a load greater than or equal to its largest single emergency load, and:
 - 1) Following load rejection, the frequency is ≤ 66.73 Hz.
 - 2) Within 3 seconds following load rejection, the voltage is 4160 ± 210 volts.
 - 3) Within 4 seconds following load rejection, the frequency is 60 ± 1.2 Hz.
- c. Verifying the diesel generator capability to reject a load between 2340 and 2600 kW^(d), without tripping on overspeed. The generator voltage shall not exceed 5000 volts^(e) during or following the load rejection.

M.2

add proposed Required Action C.1 SR 3.8.1.10

add proposed Note to SR 3.8.1.10

A.4

L.1

A.4

add proposed Note 1 to SR 3.8.1.11

L.12

2340

SR 3.8.1.11

A.13

L.8

- d. Simulating a loss of offsite power by itself, and:
 - 1) Verifying de-energization of the emergency buses, and load shedding from the emergency buses.
 - 2) Verifying the diesel starts on the auto-start signal, energizes the emergency buses with permanently connected loads in ≤ 10 seconds, energizes the auto-connected shutdown loads, and operates with this load for ≥ 5 minutes. After energization, the steady-state voltage and frequency of the emergency busses shall be maintained at 4160 ± 208 volts and 60 ± 1.2 Hz, respectively, during this test.

A.11

A.13

208

A.9

~~momentary transients outside of the load range do not invalidate this test. Diesel generator loadings may include gradual loadings as recommended by the manufacturer/vendor. This surveillance shall be conducted on only one diesel generator at a time.~~

A.10

SR 3.8.1.11 Note 2

momentary transients outside of the voltage limit do not invalidate this test.

L.13

A.1

ITS 3.8.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

Required Action E.1

b. Within 2 hours, restore at least one of the above required diesel generators to OPERABLE status and verify that at least one of the required two systems, subsystems, trains, components and devices in two train systems is OPERABLE including its emergency power supply. Otherwise, take the applicable ACTIONS for both systems, subsystems, trains, components or devices inoperable, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

A.8

Required Action B.2

add 4 hour Completion Time L.6

ACTION F

Required Actions B.3.1 and B.3.2

c. Demonstrate the continued OPERABILITY of the restored diesel generator by performing Surveillance Requirement 4.9.A.2.c within the subsequent 72 hours, and

L.3

Required Action B.4

d. Restore at least two required diesel generators to OPERABLE status within 7 days from the time of initial loss, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

L.1

ACTION F

7. With the fuel oil contained in the bulk fuel storage tank(s) not meeting the properties specified in Surveillance Requirements 4.9.A.5 and 4.9.A.6, restore the fuel oil properties to within the specified limits within 7 days. Otherwise, declare the associated diesel generator(s) inoperable.

A.6 moved to ITS 3.8.3

add ACTION G A.12

actual or L.8

e. Verifying that on an ECCS actuation, test signal, without loss of offsite power, the diesel generator starts on the auto-start signal and operates on standby for ≥5 minutes. The generator voltage and frequency shall be 4160 ± 420 volts and 60 ± 1.2 Hz, respectively, in ≤10 seconds after the auto-start signal; the steady state generator voltage and frequency shall be maintained within these limits during this test.

L.7

SR 3.8.1.13

M.7

add proposed SR 3.8.1.13.d and e

f. Simulating a loss of offsite power in conjunction with an ECCS actuation, test signal, and

SR 3.8.1.19

actual or L.8

1) Verifying de-energization of the emergency buses, and load shedding from the emergency buses.

2) Verifying the diesel starts on the auto-start signal, energizes the emergency buses with permanently connected loads in ≤10 seconds, energizes the auto-connected emergency loads through the load sequencer, and operates with this load for ≥5 minutes. After energization, the steady-state voltage and frequency of the emergency buses shall be maintained at 4160 ± 420 volts and 60 ± 1.2 Hz, respectively, during this test.

L.A.3

A.13

208

A.8

e. A successful test of OPERABILITY per Surveillance Requirement 4.9.A.2.c under this ACTION statement satisfies the diesel generator test requirements of ACTION(s) 1 or 2 above.

A.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- b. Within 2 hours, restore at least one of the above required diesel generators to OPERABLESM status and verify that at least one of the required two systems, subsystems, trains, components and devices in two train systems is OPERABLE including its emergency power supply. Otherwise, take the applicable ACTIONS for both systems, subsystems, trains, components or devices inoperable, or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.
- c. Demonstrate the continued OPERABILITY of the restored diesel generator by performing Surveillance Requirement 4.9.A.2.c within the subsequent 72 hours, and
- d. Restore at least two required diesel generators to OPERABLE status within 7 days from the time of initial loss or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

- e. Verifying that on an ECCS actuation test signal, without loss of offsite power, the diesel generator starts on the auto-start signal and operates on standby for ≥5 minutes. The generator voltage and frequency shall be 4160 ±420 volts and 60 ±1.2 Hz, respectively, in ≤10 seconds after the auto-start signal; the steady state generator voltage and frequency shall be maintained within these limits during this test.
- f. Simulating a loss of offsite power in conjunction with an ECCS actuation test signal, and
 - 1) Verifying de-energization of the emergency buses, and load shedding from the emergency buses.
 - 2) Verifying the diesel starts on the auto-start signal, energizes the emergency buses with permanently connected loads in ≤10 seconds, energizes the auto-connected emergency loads through the load sequencer, and operates with this load for ≥5 minutes. After energization, the steady-state voltage and frequency of the emergency buses shall be maintained at 4160 ±420 volts and 60 ±1.2 Hz, respectively, during this test.

7. With the fuel oil contained in the bulk fuel storage tank(s) not meeting the properties specified in Surveillance Requirements 4.9.A.5 and 4.9.A.6, restore the fuel oil properties to within the specified limits within 7 days. L.1

Otherwise, declare the associated diesel generator(s) inoperable.

Actions A and B

Action D

Add proposed Action C and ACTIONS NOTE L.2

< See ITS 3.8.1

e A successful test of OPERABILITY per Surveillance Requirement 4.9.A.2.c under this ACTION statement satisfies the diesel generator test requirements of ACTION(s) 1 or 2 above.

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

g. Verifying that all automatic diesel generator trips, except engine overspeed and generator differential current are automatically bypassed upon an emergency actuation signal.

SR 3.8.1.14

L.8

actual or simulated within the power factor limit

M.4
add proposed Note 2 to SR 3.8.1.15

h. Verifying the diesel generator operates for ≥ 24 hours. During the first 2 hours of this test, the diesel generator shall be loaded to between 2730 and 2860 kW and during the remaining 22 hours of this test, the diesel generator shall be loaded to between 2340 and 2600 kW. The generator voltage and frequency shall be 4160 ± 420 volts and 60 ± 1.2 Hz, respectively, in ≤ 10 seconds after the start signal; the steady state generator voltage and frequency shall be maintained within these limits during this test. Within 5 minutes after completing this 24 hour test, perform Surveillance Requirement 4.9.A.2.c.

M.4

A.9

L.12

2340

A.4
add proposed Note 3 to SR 3.8.1.15

SR 3.8.1.15

A.9

The generator voltage and frequency shall be 4160 ± 420 volts and 60 ± 1.2 Hz, respectively, in ≤ 10 seconds after the start signal; the steady state generator voltage and frequency shall be maintained within these limits during this test. Within 5 minutes after completing this 24 hour test, perform Surveillance Requirement 4.9.A.2.c.

L.9

A.4
add proposed Note 3 to SR 3.8.1.16

SR 3.8.1.16

M.8

i. Verifying that the auto-connected loads to each diesel generator do not exceed the 2000 hour rating of 2860 kW.

L.A.4

or power factor M.4

SR 3.8.1.15 Note 1

d. Momentary transients outside of the load range do not invalidate this test. Diesel generator loadings may include gradual loadings as recommended by the manufacturer/vendor. The surveillance shall be conducted on only one diesel generator at a time.

A.9

L.13

SR 3.8.1.16 Note 1

1. If Surveillance Requirement 4.9.A.2.c is not satisfactorily completed, it is not necessary to repeat the preceding 24 hour test. Instead, the diesel generator may be operated at approximately full load for 2 hours or until the operating temperature has stabilized.

Z

M.9

≥ 2340 kW

QUAD C'TIES - UNITS 1 & 2

3/4.9-7

Amendment Nos. 176 & 172

momentary transients below the load limit do not invalidate the test

ELECTRICAL POWER SYSTEMS

A.11

ITS 3.8.1
A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

SR 3.8.1.17

- j. Verifying the diesel generator's capability to:
 - 1) synchronize with the offsite power source while the generator is loaded with its emergency loads upon a simulated restoration of offsite power;
 - 2) transfer its loads to the offsite power source, and
 - 3) be restored to its standby status.

SR 3.8.1.18

- k. Verifying that the automatic load sequence logic is OPERABLE with the interval between each load block within $\pm 10\%$ of its design interval.

SR 3.8.1.20

- 9. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 10 years or after any modifications which could affect diesel generator interdependence by starting both diesel generators simultaneously, and verifying that both diesel generators accelerate to ≥ 500 rpm in ≤ 10 seconds.

A.9

L.10

add proposed minimum voltage in ≤ 10 sec

M.10

58.8 Hz

L.11

- 10. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 10 years by draining each fuel oil storage tank, removing the accumulated sediment and cleaning the tank.

A.6
moved to
ITS 3.8.3

SR 3.8.1.20
Note

M.1

add proposed SR 3.8.1.21

All diesel generator starts may be preceded by an engine pre-lube period. All diesel generator starts that require loading may be preceded by an engine pre-lube period and followed by a warm-up period prior to loading. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor.

A.9

A.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Operating 3/4.9.A

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- j. Verifying the diesel generator's capability to:
 - 1) synchronize with the offsite power source while the generator is loaded with its emergency loads upon a simulated restoration of offsite power;
 - 2) transfer its loads to the offsite power source, and
 - 3) be restored to its standby status.
- k. Verifying that the automatic load sequence logic is OPERABLE with the interval between each load block within $\pm 10\%$ of its design interval.

9. Each of the required diesel generators shall be demonstrated OPERABLETM at least once per 10 years or after any modifications which could affect diesel generator interdependence by starting both diesel generators simultaneously, and verifying that both diesel generators accelerate to ≥ 900 rpm in ≤ 10 seconds.

← See ITS 3.8.1 →

10. Each of the required diesel generators shall be demonstrated OPERABLE at least once per 10 years by draining each fuel oil storage tank, removing the accumulated sediment and cleaning the tank.

L3

a All diesel generator starts may be preceded by an engine prelube period. All diesel generator starts that require loading may be preceded by an engine prelube period and followed by a warmup period prior to loading. Diesel generator loadings may include gradual loading as recommended by the manufacturer/vendor.

A.11

ITS 3.8.1

<u>TABLE 4.9.A-1</u>		
<u>DIESEL GENERATOR TEST SCHEDULE</u>		
	(NOT USED)	

ELECTRICAL POWER SYSTEMS

A.1

ITS 3.8.2

A.C. Sources - Shutdown 3/4.9.B

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

B. A.C. Sources - Shutdown

B. A.C Sources - Shutdown

LCO 3.8.2

As a minimum, the following A.C. electrical power sources shall be OPERABLE:

Each of the required A.C. electrical power sources shall be demonstrated OPERABLE per the surveillance requirements in Specification 4.9.A, except for 4.9.A.2.d.

LCO 3.8.2.a

1. One circuit between the offsite transmission network and the onsite Class 1E distribution system, and

Specification 4.9.A, except for 4.9.A.2.d.

LLC 3.8.2.b

2. One diesel generator with:

SR 3.8.2.1

a. A fuel oil day tank containing ≥205 gallons of available fuel,

SR 3.8.2.1

b. A bulk fuel storage system containing ≥10,000 gallons of available fuel, and

c. A fuel oil transfer pump.

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5, and when handling irradiated fuel in the secondary containment.

ACTION:

1. With less than the above required A.C. electrical power sources OPERABLE:

a. Suspend CORE ALTERATIONS,

b. Suspend handling of irradiated fuel in the secondary containment,

c. Suspend operations with a potential for draining the reactor vessel, and

ACTIONS A and B

A.1

ELECTRICAL POWER SYSTEMS

A.C. Sources - Shutdown 3/4.9.B

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

B. A.C. Sources - Shutdown

As a minimum, the following A.C. electrical power sources shall be OPERABLE:

1. One circuit between the offsite transmission network and the onsite Class 1E distribution system, and
2. One diesel generator with:
 - a. A fuel oil day tank containing ≥ 205 gallons of available fuel,
 - b. A bulk fuel storage system containing $\geq 10,000$ gallons of available fuel, and
 - c. A fuel oil transfer pump.

B. A.C Sources - Shutdown

SR 3.8.3.1 and SR 3.8.3.2

Each of the required A.C. electrical power sources shall be demonstrated OPERABLE per the surveillance requirements in Specification 4.9.A, except for 4.9.A.2.d.

<General Description>

Add proposed fuel oil and starting air LCO

A.2

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5, and when handling irradiated fuel in the secondary containment.

A.2

ACTION:

1. With less than the above required A.C. electrical power sources OPERABLE:
 - a. Suspend CORE ALTERATIONS,
 - b. Suspend handling of irradiated fuel in the secondary containment,
 - c. Suspend operations with a potential for draining the reactor vessel, and

Add proposed Actions Note

A.3

Add proposed Actions A and B

L.1

Add proposed Action C and ACTIONS NOTE

L.2

for portions not applicable to fuel oil properties or starting air

See ITS 3.8.2

ELECTRICAL POWER SYSTEMS

A1

ITS 3.8.2

A.C. Sources - Shutdown 3/4.9.B

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

d. Suspend crane operations over the spent fuel storage pool if fuel assemblies are stored therein.

LA.2

2. In addition, when in OPERATIONAL MODE 5 with the water level < 23 feet above the reactor pressure vessel flange, immediately initiate corrective action to restore the required power sources to OPERABLE status as soon as practical.

M.3

3. The provisions of Specification 3.0.C are not applicable.

Required
Actions A.2.4
and B.4

ACTIONS
Note

ELECTRICAL POWER SYSTEMS

A.1

ITS 3.8.4
D.C. Sources - Operating 3/4.9.C

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

C. D.C. Sources - Operating

C. D.C. Sources - Operating

LC0 3.8.4

As a minimum, the following D.C. electrical power sources shall be **OPERABLE** with the identified parameters within the limits specified in Table 4.9.C-1:

A.2

moved to ITS 3.8.6

Each of the required 125 volt and 250 volt batteries and chargers shall be demonstrated **OPERABLE**.

LA.2

LC0 3.8.4.a

1. Two station 250 volt batteries, each with a full capacity charger.

A.1

LC0 3.8.4.b

2. Two station 125 volt batteries, each with a full capacity charger.

Division Land 2

DC electrical power subsystems

add proposed LC0 3.8.4.c

APPLICABILITY:

M.2

OPERATIONAL MODE(s) 1, 2, and 3.

ACTION:

ACTION A

1. With one of the above required 250 volt station batteries and/or chargers inoperable, restore the inoperable equipment to **OPERABLE** status within 72 hours.

1. At least once per 7 days by verifying that:

a. The parameters in Table 4.9.C-1 meet Category A limits, and

A.2

moved to ITS 3.8.6

b. There is correct breaker alignment to the battery chargers and total battery terminal voltage is ≥ 125.9 or ≥ 280.4 volts, as applicable, on float charge.

SR3.8.4.1

A.4

2. At least once per 92 days and within

L.1

7 days after a battery discharge with a battery terminal voltage below 105 or 210 volts, as applicable, or battery overcharge with battery terminal voltage above 150 or 300 volts, as applicable, by verifying that:

a. The parameters in Table 4.9.C-1 meet the Category B limits.

A.2

moved to ITS 3.8.6

b. There is no visible corrosion at either terminals or connectors, or the connection resistance of these items is $\leq 150 \times 10^{-6}$ ohms for $\geq 20\%$ above baseline connection resistance, whichever is higher, and

SR3.8.4.2

M.3

c. The average electrolyte temperature of all connected cells is above 65°F.

A.2

moved to ITS 3.8.6

LA.2

a. An alternate 125 volt battery shall adhere to these same Surveillance Requirements to be considered **OPERABLE**.

A.1

ITS 3.8.6

D.C. Sources - Operating 3/4.9.C

ELECTRICAL POWER SYSTEMS

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

C. D.C. Sources - Operating

Battery Cell Parameters

C. D.C. Sources - Operating

LCO 3.8.6

As a minimum, the following D.C. electrical power sources shall be **OPERABLE** with the identified parameters within the limits specified in Table 4.9.C-1:

A.2

1. Two station 250 volt batteries, each with a full capacity charger.
2. Two station 125 volt batteries, each with a full capacity charger.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 3.

A.3

ACTION:

1. With one of the above required 250 volt station batteries and/or chargers inoperable, restore the inoperable equipment to **OPERABLE** status within 72 hours.

See ITS 3.8.4

Each of the required 125 volt and 250 volt batteries and chargers shall be demonstrated **OPERABLE**. LA.1

1. At least once per 7 days by verifying that:

SR 3.8.6.1 a. The parameters in Table 4.9.C-1 meet Category A limits, and

b. There is correct breaker alignment to the battery chargers and total battery terminal voltage is ≥ 125.9 or ≥ 260.4 volts, as applicable, on float charge.

for average electrolyte temperature only

2. At least once per 92 days and within 7 days after a battery discharge with a battery terminal voltage below 105 or 210 volts, as applicable, or battery overcharge with battery terminal voltage above 150 or 300 volts, as applicable, by verifying that:

L.1

SR 3.8.6.2 a. The parameters in Table 4.9.C-1 meet the Category B limits,

b. There is no visible corrosion at either terminals or connectors, or the connection resistance of these items is $\leq 150 \times 10^{-4}$ ohms or $\leq 20\%$ above baseline connection resistance, whichever is higher, and

SR 3.8.6.3 c. The average electrolyte temperature of all connected cells is above 65°F.

representative

L.2

LA.1

a. An alternate 125 volt battery shall adhere to these same Surveillance Requirements to be considered **OPERABLE**.

ELECTRICAL POWER SYSTEMS

A.1

ITS 3.8.4

D.C. Sources - Operating 3/4.9.C

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

2. With one of the above required 125 volt station batteries and/or chargers inoperable, within 72 hours^(M), either restore the inoperable equipment to OPERABLE status, or place an OPERABLE corresponding alternate 125 volt battery (with an OPERABLE full capacity charger) in service.

ACTION B
ACTION C
ACTION D

SR 3.8.4.3

M.2

add proposed ACTION E

3. With the provisions of either ACTION 1 or 2 above not met, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

ACTION F

SR 3.8.4.4

4. With any Category A parameter(s) outside the limit(s) shown in Table 4.9.C-1, the battery may be considered OPERABLE provided that its associated charger is OPERABLE, and within 24 hours all the Category B measurements are taken and found to be within their allowable values, and provided all Category A and B parameter(s) are restored to within limits within the next 6 days.

SR 3.8.4.5

c. The resistance of each cell-to-cell and terminal connection is $\leq 150 \times 10^{-6}$ ohms or 520% above baseline connection resistance, whichever is higher.

M.3

add proposed limits

A.5

d. The battery chargers will supply a load equal to the manufacturer's rating for at least 4 hours.

SR 3.8.4.6

LD.1

4. At least every 24 months, by verifying that the battery capacity is adequate to supply and maintain in OPERABLE status all of the actual or simulated emergency loads for design duty cycle when the battery is subjected to a battery service test.

SR 3.8.4.7

required

LA.3

A.2 moved to ITS 3.8.6

ACTION B^b With Unit 1 and 2 in OPERATIONAL MODE(s) 1, 2 or 3, each 125 volt battery may be inoperable for up to a maximum of seven days per operating cycle for maintenance or testing provided the alternate 125 volt battery is placed into service and is OPERABLE. If it is determined that a 125 volt battery need be replaced as a result of maintenance or testing, a specific battery may be inoperable for an additional seven days provided the alternate 125 volt battery is placed into service and is OPERABLE. With the other Unit in MODE(s) 4 or 5, operations may continue with one of the two 125 volt battery systems inoperable provided the alternate 125 volt battery is placed into service and is OPERABLE.

ACTION C
ACTION D

ELECTRICAL POWER SYSTEMS

A.11

ITS 3.8.6
D.C. Sources - Operating 3/4.9.C

See ITS 3.8.4

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

2. With one of the above required 125 volt station batteries and/or chargers inoperable, within 72 hours^{M.I.}, either restore the inoperable equipment to OPERABLE status, or place an OPERABLE corresponding alternate 125 volt battery (with an OPERABLE full capacity charger) in service.

3. With the provisions of either ACTION 1 or 2 above not met, be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

4. With any Category A parameter(s) outside the limit(s) shown in Table 4.9.C-1, the battery may be considered OPERABLE provided that its associated charger is OPERABLE and within 24 hours all the Category B measurements are taken and found to be within their allowable values, and provided all Category A and B parameter(s) are restored to within limits within the next 6 days.

5. With any Category B parameter(s) outside the limit(s) shown in Table 4.9.C-1, the battery may be considered OPERABLE provided that the Category B parameters are within their allowable values and provided the Category B parameter(s) are restored to within the limit(s) within 7 days.

3. At least every 18 months by verifying that:

- a. The cells, cell plates and battery racks show no visual indication of physical damage or abnormal deterioration.
- b. The cell-to-cell and terminal connections are clean, tight, free of corrosion and coated with anti-corrosion material.
- c. The resistance of each cell-to-cell and terminal connection is $\leq 150 \times 10^{-6}$ ohms or $\leq 20\%$ above baseline connection resistance, whichever is higher.
- d. The battery chargers will supply a load equal to the manufacturer's rating for at least 4 hours.

4. At least every 18 months, by verifying that the battery capacity is adequate to supply and maintain in OPERABLE status all of the actual or simulated emergency loads for design duty cycle when the battery is subjected to a battery service test.

See ITS 3.8.4

b With Unit 1 and 2 in OPERATIONAL MODE(s) 1, 2 or 3, each 125 volt battery may be inoperable for up to a maximum of seven days per operating cycle for maintenance or testing provided the alternate 125 volt battery is placed into service and is OPERABLE. If it is determined that a 125 volt battery need be replaced as a result of maintenance or testing, a specific battery may be inoperable for an additional seven days provided the alternate 125 volt battery is placed into service and is OPERABLE. With the other Unit in MODE(s) 4 or 5, operations may continue with one of the two 125 volt battery systems inoperable provided the alternate 125 volt battery is placed into service and is OPERABLE.

A.4
add proposed ACTIONS Note

add proposed Required Action A.1

ACTION A

A.5

L.3

31

6

ACTION A

L.3

31

A.1

ELECTRICAL POWER SYSTEMS

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

6. With any Category B parameter not within its allowable value(s), immediately declare the battery inoperable.

A.2 moved to ITS 3.8.6

SR 3.8.4.8
1st frequency

SR 3.8.4.7
Note

5. At least once per 60 months, verify that the battery capacity is at least the greater of either 80% of the manufacturer's rating or the minimum acceptable battery capacity from the load profile when subjected to either a performance discharge test or a modified performance discharge test.

The modified performance discharge test satisfies the requirements of both the service test and the performance test and therefore, may be performed in lieu of a service test.

SR 3.8.4.8
2nd and 3rd frequencies

6. For any battery that shows signs of degradation or has reached 85% of the service life for the expected application and delivers a capacity of less than 100% of the manufacturer's rated capacity, a performance discharge test or a modified performance test of battery capacity shall be performed at least once every 12 months or the

battery shall be replaced or restored to 100% or greater of the manufacturer's rated capacity during the next refuel outage.

M.1

Degradation is indicated when the battery capacity drops more than 10% from its capacity on the previous performance test, or is below 90% of the manufacturer's rating.

LA.4

If the battery has reached 85% of service life, delivers a capacity of 100% or greater of the manufacturer's rated capacity and has shown no signs of degradation, a performance test or a modified performance test of battery capacity shall be performed at least once every two years.

A.1

ELECTRICAL POWER SYSTEMS

D.C. Sources - Operating 3/4.9.C

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

ACTION B

- 6. With any Category B parameter not within its allowable value(s), immediately declare the battery inoperable.

add proposed ACTION B for electrolyte temperature and Category A or B limits not restored

A.6

- 5. At least once per 60 months, verify that the battery capacity is at least the greater of either 80% of the manufacturer's rating or the minimum acceptable battery capacity from the load profile when subjected to either a performance discharge test or a modified performance discharge test. The modified performance discharge test satisfies the requirements of both the service test and the performance test and therefore, may be performed in lieu of a service test.
- 6. For any battery that shows signs of degradation or has reached 85% of the service life for the expected application and delivers a capacity of less than 100% of the manufacturer's rated capacity, a performance discharge test or a modified performance test of battery capacity shall be performed at least once every 12 months or the battery shall be replaced or restored to 100% or greater of the manufacturer's rated capacity during the next refuel outage. Degradation is indicated when the battery capacity drops more than 10% from its capacity on the previous performance test, or is below 90% of the manufacturer's rating. If the battery has reached 85% of service life, delivers a capacity of 100% or greater of the manufacturer's rated capacity and has shown no signs of degradation, a performance test or a modified performance test of battery capacity shall be performed at least once every two years.

(see ITS 3.8.4)

A.1

ITS 3.8.4

ELECTRICAL POWER SYSTEMS

D.C. Sources - Operating 3/4.9.C

TABLE 4.9.C-1

BATTERY SURVEILLANCE REQUIREMENTS

PARAMETER	CATEGORY A	CATEGORY B	
	LIMITS FOR EACH DESIGNATED PILOT CELL	LIMITS FOR EACH CONNECTED CELL	ALLOWABLE VALUE FOR EACH CONNECTED CELL
Electrolyte Level	> Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	> Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	Above top of plates, and not overflowing
Float Voltage	≥ 2.13 volts	≥ 2.13 volts ^(a)	≥ 2.07 volts
Specific Gravity ^(a)	≥ 1.200 ^(a)	≥ 1.195 ^(a) , and Average of all connected cells > 1.205 ^(a)	Not more than 0.020 below the average of all connected cells, and Average of all connected cells ≥ 1.195 ^(a)

TABLE NOTATIONS

- (a) Corrected for electrolyte temperature and level.
- (b) Or battery charging current is less than 2 amperes when on float charge.
- (c) May be corrected for average electrolyte temperature.

A, 2

moved to
ITS 3.8.6

A.1

Table 3.8.6-1
TABLE 4.9.C-1

CATEGORY C

BATTERY SURVEILLANCE REQUIREMENTS

PARAMETER	CATEGORY A	CATEGORY B	
	LIMITS FOR EACH DESIGNATED PILOT CELL	LIMITS FOR EACH CONNECTED CELL	ALLOWABLE VALUE FOR EACH CONNECTED CELL
Electrolyte Level	> Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	> Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	Above top of plates, and not overflowing
Float Voltage	≥ 2.13 volts	≥ 2.13 volts	≥ 2.07 volts
Specific Gravity	≥ 1.200 <i>add proposed footnote (a)</i> L.4	≥ 1.195 , and Average of all connected cells > 1.205	Not more than 0.020 below the average of all connected cells, and Average of all connected cells ≥ 1.195

LIMITS

M.2

M.4

moved notation

L.4

TABLE NOTATIONS

Add proposed footnote (a)

footnote b (a) Corrected for electrolyte temperature and level.

footnote c (b) Or battery charging current is less than 2 amperes when on float charge.

(c) May be corrected for average electrolyte temperature. M.2

add proposed footnote (c) time allowance
M.3

A.1

ITS 3.8.5

ELECTRICAL POWER SYSTEMS

D.C. Sources - Shutdown 3/4.9.D

A.2 (General Description)

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

L.1

D. D.C. Sources - Shutdown

D. D.C. Sources - Shutdown

add proposed Note

SR 3.8.5.1

LCO 3.8.5

As a minimum, the following D.C. electrical power sources shall be OPERABLE.

The required batteries and chargers shall be demonstrated OPERABLE per the surveillance requirements in Specification 4.9.C.

LA.2

LA.1

1. One station 250 volt battery with a full capacity charger.
2. One station 125 volt battery with a full capacity charger.

LA.1

to support the electrical power distribution subsystem(s) required by LCO 3.8.8, "Distribution Systems - Shutdown"

M.1

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5, and when handling irradiated fuel in the secondary containment.

M.2

add proposed ACTIONS Note

ACTION:

one or more

ACTION A

With any of the above required station batteries and/or associated charger(s) inoperable, suspend CORE ALTERATIONS, suspend handling of irradiated fuel in the secondary containment, and suspend operations with a potential for draining the reactor vessel.

add proposed Required Action A.1

M.3

add proposal Required Actions A.2.4

LA.2/

a An alternate 125 volt battery shall adhere to these same Surveillance Requirements to be considered OPERABLE.

ELECTRICAL POWER SYSTEMS

ITS 3.8.6

D.C. Sources - Shutdown 3/4.9.D

A.1

Battery Cell Parameters

A.2

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

D. D.C. Sources - Shutdown

D. D.C. Sources - Shutdown

As a minimum, the following D.C. electrical power sources shall be OPERABLE:

1. One station 250 volt battery with a full capacity charger.
2. One station 125 volt battery with a full capacity charger.

The required batteries and chargers shall be demonstrated OPERABLE^(a) per the surveillance requirements in Specification 4/9.C.

A.2

add proposed LCO 3.8.6

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5, and when handling irradiated fuel in the secondary containment.

A.3

see ITS 3.8.5

ACTION:

With any of the above required station batteries and/or associated charger(s) inoperable, suspend CORE ALTERATIONS, suspend handling of irradiated fuel in the secondary containment, and suspend operations with a potential for draining the reactor vessel.

L.5

Add proposed ACTIONS A and B

A.2

^a An alternate 125 volt battery shall adhere to these same Surveillance Requirements to be considered OPERABLE.

A.1

ELECTRICAL POWER SYSTEMS

Distribution - Operating 3/4.9.E

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

E. Distribution - Operating

E. Distribution - Operating

The following power distribution systems shall be energized:

Each of the required power distribution system divisions shall be determined energized at least once per 7 days by verifying correct breaker alignment and voltage on the busses/MCCs/panels.

A.2

Division 1 and Division 2

SR3.8.7.1

LCD 3.8.7
a. and b.

1. A.C. power distribution, consisting of:

- a. Both Unit engineered safety features 4160 volt buses:
 - 1) For Unit 1, Nos. 13-1 and 14-1,
 - 2) For Unit 2, Nos. 23-1 and 24-1.
- b. Both Unit engineered safety features 480 volt buses:
 - 1) For Unit 1, Nos. 18 and 19,
 - 2) For Unit 2, Nos. 28 and 29, and
- c. The Unit 120 volt Essential Service Bus and Instrument Bus

LA.1

2. 250 volt D.C. power distribution, consisting of:

- a. 1) For Unit 1, TB MCC No. 1,
2) For Unit 2, TB MCC No. 2,
- b. 1) For Unit 1, RB MCC Nos. 1A and 1B,
2) For Unit 2, RB MCC Nos. 2A and 2B.

LA.1

3. For Unit 1, 125 volt D.C. power distribution, consisting of:

- a. TB Main Bus Nos. 1A, 1A-1 and 2A,
- b. TB Reserve Bus Nos. 1B and 1B-1, and
- c. RB Distribution Panel No. 1.

M.3

; and
 The portions of the opposite unit's AC and DC electrical power distribution subsystems necessary to support equipment required to be OPERABLE by LCD 3.6.4.3, "Standby Gas Treatment (SGT) System," LCD 3.7.4, "Control Room Emergency Ventilation (CREV) System" (Unit 2 only), LCD 3.7.5, "Control Room Emergency Ventilation Air Conditioning (AC) System" (Unit 2 only), and LCD 3.8.1, "AC Sources - Operating."

A.1

ELECTRICAL POWER SYSTEMS

Distribution - Operating 3/4.9.E

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

- 4. For Unit 2, 125 volt D.C. power distribution, consisting of:
 - a. TB Main Bus Nos. 1A, 2A and 2A-1,
 - b. TB Reserve Bus Nos. 2B and 2B-1, and
 - c. RB Distribution Panel No. 2.

L.A.1

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, and 3.

ACTIONS:

ACTIONS A, B, and C

1. With one, ^{or more} of the above required A.C. distribution systems not energized, re-energize the system within 8 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

add proposed Required Actions A.1, B.1, and C.1 second Completion Times

L.1
M.1

ACTION F

ACTION D

2. With one, ^{or more} of the above required D.C. distribution systems not energized, re-energize the system within 2 hours or be in at least HOT SHUTDOWN within the next 12 hours and in COLD SHUTDOWN within the following 24 hours.

add proposed Required Action D.1 second Completion Time

L.1
M.1

ACTION F

← Add proposed Action E

M.3

← Add proposed Action G

M.2

ELECTRICAL POWER SYSTEMS

Distribution - Shutdown 3/4.9.F

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

F. Distribution - Shutdown

F. Distribution - Shutdown

LCO 3.8.8

The following power distribution systems shall be energized with:

SR 3.8.8.1 Each of the required power distribution system divisions shall be determined energized at least once per 7 days by verifying correct breaker alignment and voltage on the buses/MCCs/panels.

1. A.C. power distribution consisting of:

- a. One Unit engineered safety features 4160 volt bus:
 - 1) For Unit 1, No. 13-1 or 14-1,
 - 2) For Unit 2, No. 23-1 or 24-1,
- b. One associated Unit engineered safety features 480 volt bus:
 - 1) For Unit 1, No. 18 or 19,
 - 2) For Unit 2, No. 28 or 29.

to support equipment required to be OPERABLE.

M.1

2. For Unit 1, 125 volt D.C. power distribution consisting of either:

- a. TB Main Bus No. 1A and 1A-1, and RB Distribution Panel No. 1, or
- b. TB Main Bus No. 2A, and TB Reserve Bus Nos. 1B and 1B-1.

3. For Unit 2, 125 volt D.C. power distribution consisting of either:

- a. TB Main Bus Nos. 2A and 2A-1, and RB Distribution Panel No. 2, or
- b. TB Main Bus No. 1A, and TB Reserve Bus Nos. 2B and 2B-1.

LA.1

M.1

; and the opposite unit's electrical power distribution subsystems to support equipment required to be OPERABLE

APPLICABILITY:

OPERATIONAL MODE(s) 4, 5, and when handling irradiated fuel in the secondary containment.

A.1

ELECTRICAL POWER SYSTEMS

Distribution - Shutdown 3/4.9.F

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

ACTIONS:

ACTION
A

With ~~less than~~ the above required A.C. or D.C. distribution systems ~~operated~~ suspend CORE ALTERATIONS, suspend handling of irradiated fuel in the secondary containment, and suspend operations with a potential for draining the reactor vessel.

Add proposed ACTIONS Note

m.2

one or more

m.1

inoperable

Add proposed Required Action A.1

Add proposed Required Actions A.2.4 and A.2.5

m.3

A.1

ELECTRICAL POWER SYSTEMS

RPS Electric Power Monitoring 3/4.9.G

3.9 - LIMITING CONDITIONS FOR OPERATION

4.9 - SURVEILLANCE REQUIREMENTS

G. RPS Power Monitoring

Electric

assemblies

G. RPS Power Monitoring

LCO 3.3.8.2

Two Reactor Protection System (RPS) electric power monitoring CHANNEL(s) for each inservice RPS Motor Generator (MG) set or alternate power supply shall be OPERABLE.

SR 3.3.8.2.1

The specified RPS electric power monitoring CHANNEL(s) shall be determined OPERABLE:

By performance of a CHANNEL FUNCTIONAL TEST™ each time the plant is in COLD SHUTDOWN for a period of more than 24 hours, unless performed in the previous 6 months.

APPLICABILITY:

OPERATIONAL MODE(s) 1, 2, 3, 4 and 5.

L.3

SR 3.3.8.2.2

At least once per 24 months by demonstrating the OPERABILITY of overvoltage, undervoltage, and underfrequency protective instrumentation by performance of a CHANNEL CALIBRATION including simulated automatic actuation of the protective relays, tripping logic, and output circuit breakers, and verifying the following setpoints (Allowable Values)

L.D.1

L.E.1

ACTION:

assembly

ACTION A

1. With one RPS electric power monitoring CHANNEL for an inservice RPS MG set or alternate power supply inoperable, restore the inoperable power monitoring CHANNEL to OPERABLE status within 72 hours or remove the associated RPS MG set or alternate power supply from service.

A.2

SR 3.3.8.2.3

assemblies

ACTION B

2. With both RPS electric power monitoring CHANNEL(s) for an inservice RPS MG set or alternate power supply inoperable, restore at least one electric power monitoring CHANNEL to OPERABLE status within 30 minutes or remove the associated RPS MG set or alternate power supply from service.

A.2

SR 3.3.8.2.2

a. Overvoltage ≤ 129.8 volts AC

b. Undervoltage ≥ 105.3 volts AC

c. Underfrequency ≥ 55.4 Hz

with time delay set to ≤ 4 seconds

M.2

Add proposed ACTION C

A.3

Add proposed ACTION D

L.4

a With any control rod withdrawn

from a core cell containing one or more fuel assemblies

L.3

b Only required to be performed prior to entering MODE 2 (or 3) from MODE 4.

L.1

REFUELING OPERATIONS

A.1

ITS 3.9.1
Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

A. Reactor Mode Switch

A.2 moved to ITS 3.9.2

The reactor mode switch shall be OPERABLE and locked in the Shutdown or Refuel position. (When the reactor mode switch is locked in the Refuel position:

Applicability

1. A control rod shall not be withdrawn unless the Refuel position one-rod-out interlock is OPERABLE.

In-vessel fuel movement

2. CORE ALTERATION(S) shall not be performed using equipment associated with a Refuel position interlock unless at least the following associated Refuel position interlocks are OPERABLE for such equipment.

LCO 3.9.1

- a. All rods in.
- b. Refuel platform position.
- c. Refuel platform hoists fuel-loaded.
- d. Fuel grapple position.

SR3.9.1.1

A.4

APPLICABILITY:

OPERATIONAL MODE(S) 3rd, 4th and 5th.

A.5 moved to ITS 3.10.2 and ITS 3.10.3

ACTION:

1. With the reactor mode switch not locked in the Shutdown or Refuel position as specified, suspend CORE ALTERATION(S) and lock the reactor mode switch in the Shutdown or Refuel position.

A.6 moved to ITS 3.9.2

A. Reactor Mode Switch

1. The reactor mode switch shall be verified to be locked in the Shutdown or Refuel position as specified:

a. Within 2 hours prior to:

- 1. Beginning CORE ALTERATION(s), and
- 2. Resuming CORE ALTERATION(s) when the reactor mode switch has been unlocked.

b. At least once per 12 hours.

2. Each of the required reactor mode switch Refuel position interlocks shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST within 24 hours prior to the start of and at least once per 7 days during control rod withdrawal or CORE ALTERATION(S) as applicable.

A.6 moved to ITS 3.10.1

L.1

In-vessel fuel movement

3. Each of the required reactor mode switch Refuel position interlocks that is affected shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST prior to resuming control rod withdrawal or

L.2

A.6 moved to ITS 3.10.2 and ITS 3.10.3

a. When the reactor mode switch is in the Refuel position.

b. See Special Test Exceptions 3.12.A and 3.12.B.

c. The reactor shall be maintained in OPERATIONAL MODE 5 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

d. The reactor mode switch may be placed in the Run or Startup/Hot Standby position to test the switch interlock functions provided that all control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.

A.7 moved to ITS 3.10.1

REFUELING OPERATIONS

A.1

ITS 3.9.2

Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

A. Reactor Mode Switch

A. Reactor Mode Switch

L.1 The reactor mode switch shall be OPERABLE and locked in the Shutdown or Refuel position. When the reactor mode switch is locked in the Refuel position:

1. The reactor mode switch shall be verified to be locked in the Shutdown or Refuel position as specified:

Applicability

LCO 3.9.2

1. A control rod shall not be withdrawn unless the Refuel position one-rod-out interlock is OPERABLE.

2. CORE ALTERATION(s) shall not be performed using equipment associated with a Refuel position interlock unless at least the following associated Refuel position interlocks are OPERABLE for such equipment.

- a. All rods in.
b. Refuel platform position.
c. Refuel platform hoists fuel-loaded.
d. Fuel grapple position.

APPLICABILITY:

OPERATIONAL MODE(s) 3(a), 4(a) and 5(a).

ACTION:

1. With the reactor mode switch not locked in the Shutdown or Refuel position as specified, suspend CORE ALTERATION(s) and lock the reactor mode switch in the Shutdown or Refuel position.

ACTION A

a When the reactor mode switch is in the Refuel position.

b See Special Test Exceptions 3.12.A and 3.12.B.

c The reactor shall be maintained in OPERATIONAL MODE 5 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

d The reactor mode switch may be placed in the Run or Startup/Hot Standby position to test the switch interlock functions provided that all control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.

REFUELING OPERATIONS

A.1

ITS 3.10.1

Mode Switch 3/4:10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

A. Reactor Mode Switch

The reactor mode switch shall be OPERABLE and locked in the Shutdown or Refuel position. When the reactor mode switch is locked in the Refuel position:

1. A control rod shall not be withdrawn unless the Refuel position one-rod-out interlock is OPERABLE.
2. CORE ALTERATION(s) shall not be performed using equipment associated with a Refuel position interlock unless at least the following associated Refuel position interlocks are OPERABLE for such equipment.
 - a. All rods in.
 - b. Refuel platform position.
 - c. Refuel platform hoists fuel-loaded.
 - d. Fuel grapple position.

APPLICABILITY:

OPERATIONAL MODE(s) 3rd, 4th and 5th.

ACTION:

1. With the reactor mode switch not locked in the Shutdown or Refuel position as specified, suspend CORE ALTERATION(s) and lock the reactor mode switch in the Shutdown or Refuel position.

A. Reactor Mode Switch

1. The reactor mode switch shall be verified to be locked in the Shutdown or Refuel position as specified:

- a. Within 2 hours prior to:
 1. Beginning CORE ALTERATION(s), and
 2. Resuming CORE ALTERATION(s) when the reactor mode switch has been unlocked.
- b. At least once per 12 hours.

2. Each of the required reactor mode switch Refuel position interlocks shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST within 24 hours prior to the start of and at least once per 7 days during control rod withdrawal or CORE ALTERATION(s), as applicable.

3. Each of the required reactor mode switch Refuel position interlocks that is affected shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST prior to resuming control rod withdrawal or


LCO 3.10.1

← See ITS 3.9.1 and ITS 3.9.2 →

- a. When the reactor mode switch is in the Refuel position.
- b. See Special Test Exceptions 3.12.A and 3.12.B.
- c. The reactor shall be maintained in OPERATIONAL MODE 5 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.
- d. The reactor mode switch may be placed in the Run or Startup/Hot Standby position to test the switch interlock functions provided that all control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual LA.1

LCO 3.10.1

QUAD CITIES - UNITS 1 & 2

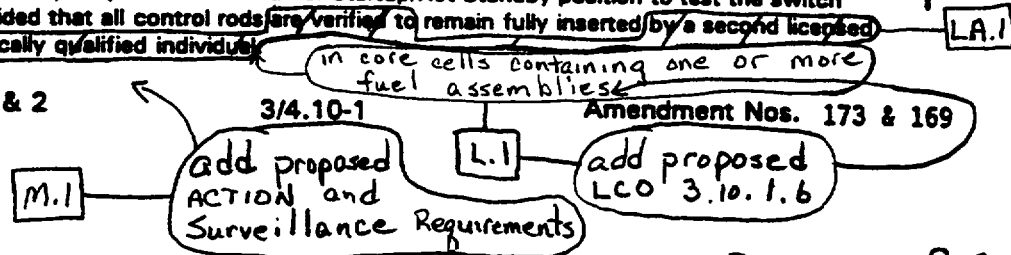

A.1

ITS 3.10.2

REFUELING OPERATIONS

Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

A. Reactor Mode Switch

A. Reactor Mode Switch

L.1

LC 3.10.2

The reactor mode switch shall be OPERABLE (and locked) in the Shutdown or Refuel position. When the reactor mode switch is locked in the Refuel position:

LC 3.10.2.a.1

1. A control rod shall not be withdrawn unless the Refuel position one-rod-out interlock is OPERABLE.

2. CORE ALTERATION(s) shall not be performed using equipment associated with a Refuel position interlock unless at least the following associated Refuel position interlocks are OPERABLE for such equipment.
a. All rods in.
b. Refuel platform position.
c. Refuel platform hoists fuel-loaded.
d. Fuel grapple position.

APPLICABILITY:

OPERATIONAL MODE(s) 3rd, 4th and 5th.

ACTION:

1. With the reactor mode switch not locked in the Shutdown or Refuel position as specified, suspend CORE ALTERATION(s) and lock the reactor mode switch in the Shutdown or Refuel position.

1. The reactor mode switch shall be verified to be locked in the Shutdown or Refuel position as specified:

a. Within 2 hours prior to:

1. Beginning CORE ALTERATION(s), and

2. Resuming CORE ALTERATION(s) when the reactor mode switch has been unlocked.

b. At least once per 12 hours.

2. Each of the required reactor mode switch Refuel position interlocks^(a) shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST within 24 hours prior to the start of and at least once per 7 days during control rod withdrawal or CORE ALTERATION(s), as applicable.

3. Each of the required reactor mode switch Refuel position interlocks^(a) that is affected shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST prior to resuming control rod withdrawal or

A.3

Add proposed SR 3.10.2.1

See ITS 3.9.1 and ITS 3.9.2

Applicability

a. When the reactor mode switch is in the Refuel position.

b. See Special Test Exceptions 3.12.A and 3.12.B.

c. The reactor shall be maintained in OPERATIONAL MODE 5 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.

d. The reactor mode switch may be placed in the Run or Startup/Hot Standby position to test the switch interlock functions provided that all control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.

A.1

ITS 3.10.3

REFUELING OPERATIONS

Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

A. Reactor Mode Switch

A. Reactor Mode Switch

LCO 3.10.3

The reactor mode switch shall be OPERABLE and locked in the Shutdown or Refuel position. When the reactor mode switch is locked in the Refuel position:

1. A control rod shall not be withdrawn unless the Refuel position one-rod-out interlock is OPERABLE.
2. CORE ALTERATION(s) shall not be performed using equipment associated with a Refuel position interlock unless at least the following associated Refuel position interlocks are OPERABLE for such equipment.
 - a. All rods in.
 - b. Refuel platform position.
 - c. Refuel platform hoists fuel-loaded.
 - d. Fuel grapple position.

APPLICABILITY:

OPERATIONAL MODE(s) 3rd 4th and 5th

ACTION:

1. With the reactor mode switch not locked in the Shutdown or Refuel position as specified, suspend CORE ALTERATION(s) and lock the reactor mode switch in the Shutdown or Refuel position.

Applicability

- a. When the reactor mode switch is in the Refuel position.
- b. See Special Test Exceptions 3.12.A and 3.12.B.
- c. The reactor shall be maintained in OPERATIONAL MODE 5 whenever fuel is in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.
- d. The reactor mode switch may be placed in the Run or Startup/Hot Standby position to test the switch interlock functions provided that all control rods are verified to remain fully inserted by a second licensed operator or other technically qualified individual.

1. The reactor mode switch shall be verified to be locked in the Shutdown or Refuel position as specified:

- a. Within 2 hours prior to:
 1. Beginning CORE ALTERATION(s), and
 2. Resuming CORE ALTERATION(s) when the reactor mode switch has been unlocked.

add proposed SR 3.10.3.1

- b. At least once per 12 hours.

2. Each of the required reactor mode switch Refuel position interlocks¹⁰ shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST within 24 hours prior to the start of and at least once per 7 days during control rod withdrawal or CORE ALTERATION(s), as applicable.

3. Each of the required reactor mode switch Refuel position interlocks¹⁰ that is affected shall be demonstrated OPERABLE by performance of a CHANNEL FUNCTIONAL TEST prior to resuming control rod withdrawal or

<See ITS 3.9.1>

REFUELING OPERATIONS

A.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

2. With the one-rod-out interlock inoperable, lock the reactor mode switch in the Shutdown position.

A.2
refer to
ITS 3.9.2

CORE ALTERATION(s), as applicable, following repair, maintenance or replacement of any component that could affect the Refuel position interlock.

L.2

3. With any of the above required Refuel position equipment interlocks inoperable, suspend CORE ALTERATION(s) with equipment associated with the inoperable Refuel position equipment interlock.

ACTION A

In-vessel fuel
movement

A.3

add proposed
Required Actions A.2.1 and A.2.2

L.3

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

ACTION A
2. With the one-rod-out interlock inoperable, lock the reactor mode switch in the Shutdown position. L.2

3. With any of the above required Refuel position equipment interlocks inoperable, suspend CORE ALTERATION(s) with equipment associated with the inoperable Refuel position equipment interlock.

A.3 moved to
ITS 3.9.1

CORE ALTERATION(s), as applicable, following repair, maintenance or replacement of any component that could affect the Refuel position interlock. L.5

A.1

ITS 3.10.2

REFUELING OPERATIONS

Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

Required
Action
A.2.2

2. With the one-rod-out interlock inoperable, lock the reactor mode switch in the Shutdown position.

place

A.2

3. With any of the above required Refuel position equipment interlocks inoperable, suspend CORE ALTERATION(s) with equipment associated with the inoperable Refuel position equipment interlock.

CORE ALTERATION(s), as applicable, following repair, maintenance or replacement of any component that could affect the Refuel position interlock.

A.3

See ITS 3.9.1
and ITS 3.9.2

A.1

ITS 3.10.3

REFUELING OPERATIONS

Mode Switch 3/4.10.A

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

Required
Action A.2.2

2. With the one-rod-out interlock inoperable, ~~lock~~ the reactor mode switch in the Shutdown position.

place

A.9

3. With any of the above required Refuel position equipment interlocks inoperable, suspend CORE ALTERATION(s) with equipment associated with the inoperable Refuel position equipment interlock.

CORE ALTERATION(s), as applicable, following repair, maintenance or replacement of any component that could affect the Refuel position interlock.

A.8

See ITS 3.9.1

A.1

REFUELING OPERATIONS

Instrumentation 3/4.10.B

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

LCO 3.3.1.2 and Table 3.3.1.2-1

B. Instrumentation

At least 2 source range monitor^(a) (SRM) CHANNEL(s) shall be OPERABLE and inserted to the normal operating level with:

1. Continuous visual indication in the control room, and

LA.2

2. One of the required SRM detectors located in the quadrant where CORE ALTERATION(s) are being performed and the other required SRM detector located in an adjacent quadrant.

B. Instrumentation

Each of the required SRM channels shall be demonstrated OPERABLE by:

1. At least once per 12 hours:

SR 3.3.1.2.1

a. Performance of a CHANNEL CHECK.

LA.2

b. Verifying the detectors are inserted to the normal operating level, and

c. During CORE ALTERATION(s), verifying that the detector of an OPERABLE SRM CHANNEL is located in the core quadrant where CORE ALTERATION(s) are being performed and another is located in an adjacent quadrant.

SR 3.3.1.2.2 b and c

APPLICABILITY:

OPERATIONAL MODE 5, unless the following conditions are met:

1. No more than two fuel assemblies are present in each core quadrant associated with an SRM;

SR 3.3.1.2.4 Note

M.2

M.5 and determination of signal to noise ratio

SR 3.3.1.2.5

2. Performance of a CHANNEL FUNCTIONAL TEST:

a. Within 24 hours prior to the start of CORE ALTERATION(s), and

b. At least once per 7 days.

3. Verifying that the channel count rate is at least 3 cps:

a. Prior to control rod withdrawal,

b. Prior to and at least once per 12 hours during CORE ALTERATION(s).

c. At least once per 24 hours.

Add proposed SR 3.3.1.2.4 Note

L.4

L.8

or 20.7cps with a signal to noise ratio $\geq 20:1$

Add proposed SR 3.3.1.2.7

M.4

Table 3.3.1.2-1 Note c

a The use of special movable detectors during CORE ALTERATION(s) in place of the normal SRM neutron detectors is permissible as long as these special detectors are connected to the normal SRM circuits.

QUAD CITIES - UNITS 1 & 2

3/4.10-3

Amendment Nos. 183; 180

add proposed Note b to Table 3.3.1.2-1

L.7

ITS 3.3.1.2

A.1

REFUELING OPERATIONS

Instrumentation 3/4.10.B

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

3.3.1.2.4
Note
3.3.1.2.2


2. While in the core, these two fuel assemblies are in locations adjacent to the SRM; and M.2

3. In the case of movable detectors, each group of fuel assemblies shall be separated by at least two fuel cell locations from any other fuel assemblies. LA.3

ACTION:

ACTION
E

With the requirements of the above specification not satisfied, immediately suspend all operations involving CORE

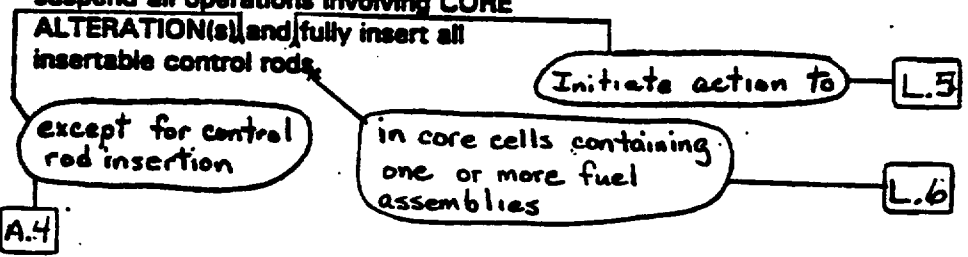

REFUELING OPERATIONS

A.1

ITS 3.9.3
CR Position 3/4.10.C

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

C. Control Rod Position

C. Control Rod Position

LCO 3.9.3 All control rods shall be fully inserted.

A.2

SA 3.9.3.1

All control rods shall be verified to be fully inserted, except as specified:

APPLICABILITY:

~~OPERATIONAL MODE 5/during/CORE ALTERATION(s).~~

when loading fuel assemblies into the core

A.2

ACTION:

With all control rods not fully inserted, suspend ~~all other CORE ALTERATION(s)~~, except that one control rod may be withdrawn under control of the reactor mode switch Refuel position one-rod-out interlock.

A.2

L.1

1. Within 2 hours prior to:
a. The start of CORE ALTERATION(s).

L.2

b. The withdrawal of one control rod under the control of the reactor mode switch Refuel position one-rod-out interlock.

A.2

2. At least once per 12 hours.

loading fuel assemblies into the core

~~a Except control rods removed per Specification 3.10.I or 3.10.J or one control rod withdrawn under control of the reactor mode switch refuel position one-rod-out interlock.~~

~~b See Special Test Exception 2.12.B~~

A.2

REFUELING OPERATIONS

Communications 3/4, 10.E

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

E. Communications

Direct communication shall be maintained between the control room and refueling platform personnel.

APPLICABILITY:

OPERATIONAL MODE 5, during CORE ALTERATION(s)^a.

ACTION:

When direct communication between the control room and refueling platform personnel cannot be maintained, immediately suspend CORE ALTERATION(s).

E. Communications

Direct communication between the control room and refueling platform personnel shall be demonstrated within one hour prior to the start of and at least once per 12 hours during CORE ALTERATION(s).

R.1

^a Except movement of control rods with their normal drive system.

REFUELING OPERATIONS

A.1

ITS 3.9.6
Reactor Water Level 3/4.10.G

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

G. Water Level - Reactor Vessel

G. Water Level - Reactor Vessel

LLO 3.9.6

At least 23 feet of water shall be maintained over the top of the reactor pressure vessel flange.

SR 3.9.6.1

The reactor vessel water level shall be determined to be at least its minimum required depth within 2 hours prior to the start of and at least once per 24 hours during handling of fuel assemblies or control rods within the reactor pressure vessel.

L.1

APPLICABILITY:

New fuel requirements only moved to ITS 3.9.7

During handling of fuel assemblies or control rods within the reactor pressure vessel while in OPERATIONAL MODES when the fuel assemblies or control rods being handled are irradiated or the fuel assemblies or control rods seated within the reactor vessel are irradiated.

A.3

A.2 moved to ITS 3.9.7

ACTION:

New fuel requirements only moved to ITS 3.9.7

ACTION A

With the requirements of the above specification not satisfied, suspend all operations involving handling of fuel assemblies or control rods within the reactor pressure vessel until placing all fuel assemblies and control rods in a safe condition.

L.A.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

G. Water Level - Reactor Vessel

LC03.7

At least 23 feet of water shall be maintained over the top of the reactor pressure vessel flange.

irradiated fuel assemblies seated within

SR3.9.7.1

L.1

new

APPLICABILITY:

During handling of fuel assemblies or control rods within the reactor pressure vessel while in OPERATIONAL MODE B when the fuel assemblies or control rods being handled are irradiated or the fuel assemblies or control rods seated within the reactor vessel are irradiated.

A.2

L.1

ACTION:

ACTION A

With the requirements of the above specification not satisfied, suspend all operations involving handling of fuel assemblies or control rods within the reactor pressure vessel after placing all fuel assemblies and control rods in a safe condition.

new

LA.1

G. Water Level - Reactor Vessel

The reactor vessel water level shall be determined to be at least its minimum required depth within 2 hours prior to the start of and at least once per 24 hours during handling of fuel assemblies or control rods within the reactor pressure vessel.

L.2

new

REFUELING OPERATIONS

A.1

ITS 3.7.8

Pool Water Level 3/4.10.H

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

H. Water Level - Spent Fuel Storage Pool

H. Water Level - Spent Fuel Storage Pool

LCO 3.7.8 The pool water level shall be maintained at a level of ≥ 33 feet.

SR 3.7.8.1 The water level in the spent fuel storage pool shall be determined to be at least at its minimum required depth at least once per 7 days.

APPLICABILITY:

During movement of

Whenever irradiated fuel assemblies are in the spent fuel storage pool.

A.2

During movement of new fuel assemblies in the spent fuel storage pool with irradiated fuel assemblies seated in the spent fuel storage pool.

ACTION:

ACTION A

With the requirements of the above specification not satisfied, suspend all movement of fuel assemblies and crane operations with loads in the spent fuel storage pool ~~area~~ after placing the fuel assemblies and crane load in a safe condition. The provisions of Specification 3.0.C are not applicable.

LA.1

LA.2

> 19 feet over the top of irradiated fuel assemblies seated in the spent fuel storage pool racks

M.1

REFUELING OPERATIONS

CR Removal 3/4.10.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

I. Single Control Rod Removal

I. Single Control Rod Removal

One control rod and/or the associated control rod drive mechanism may be removed from the core and/or reactor pressure vessel provided that at least the following requirements are satisfied until a control rod and associated control rod drive mechanism are reinstalled and the control rod is fully inserted in the core.

Within 4 hours prior to the start of removal of a control rod and/or the associated control rod drive mechanism from the core and/or reactor pressure vessel and at least once per 24 hours thereafter until a control rod and associated control drive mechanism are reinstalled and the control rod is fully inserted in the core, verify that:

1. The reactor mode switch is OPERABLE and locked in the Shutdown position or in the Refuel position per Table 1-2 and Specification 3.10.A.

1. The reactor mode switch is OPERABLE per Surveillance Requirement 4.1.A.1 or 4.10.A.2, as applicable, and locked in the Shutdown position or in the Refuel position with the "one-rod-out" Refuel position interlock OPERABLE per Specification 3.10.A.

2. The source range monitors (SRM) are OPERABLE per Specification 3.10.B.

2. The SRM CHANNEL(s) are OPERABLE per Specification 3.10.B.

3. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied, except that the control rod selected to be removed;

3. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied per Specification 3.10.1.3.

- a. May be assumed to be the highest worth control rod required to be assumed to be fully withdrawn by the SHUTDOWN MARGIN test, and
b. Need not be assumed to be immovable or unscrammable.

4. All other control rods in a five-by-five array centered on the control rod being removed are either:

4. All other control rods in a five-by-five array centered on the control rod being removed are either:

a. Fully inserted and electrically or hydraulically disarmed, or

4. All other control rods in a five-by-five array centered on the control rod being removed are either:

a. Fully inserted and electrically or hydraulically disarmed, or

b. The four fuel assemblies surrounding the control rod or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

b. The four fuel assemblies surrounding the control rod or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

5. All other control rods are fully inserted.

Add proposed SR 3.10.3.1 and SR 3.10.3.4

< See ITS 3.10.4 >

LCO 3.10.3

Applicability

L.1

LCO 3.10.3.c.2

LCO 3.10.3.c.2

LCO 3.10.3.a

LCO 3.10.3.c.2

SR 3.10.3.2 and SR 3.10.3.3

A.2

A.3

L.2

A.4

L.A.1

A.5

L.3

A.2

L.1

A.3

A.6

L.A.1

A.5

L.2

A.1

ITS 3.10.4

REFUELING OPERATIONS

CR Removal 3/4.10.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

I. Single Control Rod Removal

I. Single Control Rod Removal

LCO 3.10.4

One control rod and/or the associated control rod drive mechanism may be removed from the core and/or reactor pressure vessel provided that at least the following requirements are satisfied until a control rod and associated control rod drive mechanism are reinstalled and the control rod is fully inserted in the core.

Within 4 hours prior to the start of removal of a control rod and/or the associated control rod drive mechanism from the core and/or reactor pressure vessel and at least once per 24 hours thereafter until a control rod and associated control drive mechanism are reinstalled and the control rod is fully inserted in the core, verify that:

1. The reactor mode switch is OPERABLE and locked in the Shutdown position or in the Refuel position per Table 1-2 and Specification 3.10.A.

1. The reactor mode switch is OPERABLE per Surveillance Requirement 4.1.A.1 or 4.10.A.2, as applicable, and locked in the Shutdown position or in the Refuel position with the "one-rod-out" Refuel position interlock OPERABLE per Specification 3.10.A.

2. The source range monitors (SRM) are OPERABLE per Specification 3.10.B.

2. The SRM CHANNEL(s) are OPERABLE per Specification 3.10.B.

3. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied, except that the control rod selected to be removed;

3. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied per Specification 3.10.I.3.

a. May be assumed to be the highest worth control rod required to be assumed to be fully withdrawn by the SHUTDOWN MARGIN test, and

4. All other control rods in a five-by-five array centered on the control rod being removed are either:

b. Need not be assumed to be immovable or unscrammable.

a. Fully inserted and electrically or hydraulically disarmed, or

LCO 3.10.4.c

LCO 3.10.4.b

4. All other control rods in a five-by-five array centered on the control rod being removed are either:

b. The four fuel assemblies surrounding the control rod or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

LCO 3.10.4.a

LCO 3.10.4.b

a. Fully inserted and electrically or hydraulically disarmed, or

b. The four fuel assemblies surrounding the control rod or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

5. All other control rods are fully inserted.

Add proposed SR 3.10.4.3 and SR 3.10.4.5

Add proposed LCO 3.10.4.c (first part) and LCO 3.10.4.d

A.1

REFUELING OPERATIONS

CR Removal 3/4.10.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

Lo 3.10.3.a

5. All other control rods are fully inserted.

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5.

<See ITS 3.10.4>

A.7

ACTION:

With the requirements of the above specification not satisfied, suspend removal of the control rod and/or associated control rod drive mechanism from the core and/or reactor pressure vessel and initiate ACTION to satisfy the above requirements.

Actions A and B

Add proposed ACTIONS Note

A.6

Add proposed Required Action A.1 Notes

Add Proposed Required Actions A.2.1, A.2.2, and B.2.1

M.1

A.1

ITS 3.10.4

CR Removal 3/4.10.1

REFUELING OPERATIONS

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

LCO 3.10.4.a 5. All other control rods are fully inserted.

APPLICABILITY:

OPERATIONAL MODE(s) 4 and 5

with LCO 3.9.5 not met

A.6

<See ITS 3.10.3>

ACTION:

ACTION
A

With the requirements of the above specification not satisfied, suspend removal of the control rod and/or associated control rod drive mechanism from the core and/or reactor pressure vessel and initiate ACTION to satisfy the above requirements

Add proposed Required Action A.2.1

A.7

REFUELING OPERATIONS

A.1

ITS 3.10.5
Multiple CR Removal 3/4.10.J

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

J. Multiple Control Rod Removal

J. Multiple Control Rod Removal

LCO 3.10.5

Any number of control rods and/or control rod drive mechanisms may be removed from the core and/or reactor pressure vessel provided that at least the following requirements are satisfied until all control rods and control rod drive mechanisms are reinstalled and all control rods are fully inserted in the core.

A.2

1. The reactor mode switch is OPERABLE and locked in the Shutdown position or in the Refuel position per Specification 3.10.A, except that the Refuel position "one-rod-out" interlock may be bypassed, as required, for those control rods and/or control rod drive mechanisms to be removed, after the fuel assemblies have been removed as specified below.

L.1

LCO 3.10.5

2. The source range monitors (SRM) are OPERABLE per Specification 3.70.B.

A.3

3. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied.

A.4

LCO 3.10.5.b

4. All other control rods are either fully inserted or have the surrounding four fuel assemblies removed from the core cell.

SR 3.10.5.2

LCO 3.10.5.a

5. The four fuel assemblies surrounding each control rod or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

SR 3.10.5.1

Add proposed LCO 3.10.5.c

M.1

APPLICABILITY:

OPERATIONAL MODE 5

with LCO 3.9.3, LCO 3.9.4, or LCO 3.9.5 not met.

A.5

1. Within 4 hours prior to the start of removal of control rods and/or control rod drive mechanisms from the core and/or reactor pressure vessel and at least once per 24 hours thereafter until all control rods and control rod drive mechanisms are reinstalled and all control rods are fully inserted in the core, verify that:

L.2

A.2

a. The reactor mode switch is OPERABLE per Surveillance Requirement 4.1.A.1 or 4.10.A.2, as applicable and locked in the Shutdown position or in the Refuel position per Specification 3.10.A.

L.1

b. The SRM CHANNEL(s) are OPERABLE per Specification 3.10.B.

A.3

c. The SHUTDOWN MARGIN requirements of Specification 3.3.A are satisfied.

A.4

d. All other control rods are either fully inserted or have the surrounding four fuel assemblies removed from the core cell.

e. The four fuel assemblies surrounding each control rod and/or control rod drive mechanism to be removed from the core and/or reactor vessel are removed from the core cell.

A.1

ITS 3.10.5

Multiple CR Removal 3/4.10.J

REFUELING OPERATIONS

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

ACTION:

ACTION
A

With the requirements of the above specification not satisfied, suspend removal of control rods and/or control rod drive mechanisms from the core and/or reactor pressure vessel and initiate ACTION to satisfy the above requirements.

~~2. Following replacement of all control rods and/or control rod drive mechanisms removed in accordance with this specification, perform a functional test of the "one-rod-out" Refuel position interlock, if this function had been bypassed.~~

L.3

m.1

Add proposed Required Action A.2

Add proposed SR 3.10.5.3

m.1

Add proposed Required Action A.3.1

A.6

REFUELING OPERATIONS

A.1

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

K. Residual Heat Removal and Coolant Circulation - High Water Level

K. Residual Heat Removal and Coolant Circulation - High Water Level

LCO 3.9.8

At least one shutdown cooling mode loop of the residual heat removal (RHR) system shall be OPERABLE with at least:

SR 3.9.2.2

1. At least one shutdown cooling mode loop of the RHR system shall be verified to be capable of circulating reactor coolant at least once per 12 hours.

A.5

LA.1

- 1. One OPERABLE RHR pump, and
- 2. One OPERABLE RHR heat exchanger.

SR 3.9.2.1

2. Monitor the reactor coolant temperature at least once per hour.

APPLICABILITY:

OPERATIONAL MODE 5, when irradiated fuel is in the reactor vessel and the water level is 223 feet above the top of the reactor pressure vessel flange.

ACTION:

ACTION A

With no RHR shutdown cooling mode loop OPERABLE, within one hour and at least once per 24 hours thereafter, demonstrate the OPERABILITY of at least one alternate method capable of decay heat removal.

ACTION B

Otherwise, suspend all operations involving an increase in the reactor decay heat load and establish SECONDARY CONTAINMENT INTEGRITY within 4 hours.

add proposed Required Actions A.2 and A.3

M.1

A.2

A.4

A.3

A.1

ITS 3.9.9

REFUELING OPERATIONS

RHR Low Water Level 3/4.10.L

3.10 - LIMITING CONDITIONS FOR OPERATION

4.10 - SURVEILLANCE REQUIREMENTS

L. Residual Heat Removal and Coolant Circulation - Low Water Level

L. Residual Heat Removal and Coolant Circulation - Low Water Level

LC0 3.9.9

Two shutdown cooling mode (loop) of the residual heat removal (RHR) system shall be OPERABLE, with each loop consisting of at least:

- 1. One OPERABLE RHR pump, and
- 2. One OPERABLE RHR heat exchanger.

LA.1

M.3

each required

- 1. At least ~~one~~ shutdown cooling mode loop of the RHR system shall be verified to be capable of circulating reactor coolant at least once per 12 hours.

L.1

A.2

SR3.9.1

- 2. Monitor the reactor coolant temperature at least once per hour.

APPLICABILITY:

OPERATIONAL MODE 5, when irradiated fuel is in the reactor vessel and the water level is < 23 feet above the top of the reactor pressure vessel flange.

ACTION:

ACTION A

With less than the above required shutdown cooling mode loops of the RHR system OPERABLE, within one hour and at least once per 24 hours thereafter, demonstrate the OPERABILITY of at least one alternate method capable of decay heat removal for each inoperable RHR shutdown cooling mode loop.

add proposed Required Actions A.2 and A.3

M.1

M.2

add proposed ACTION B

POWER DISTRIBUTION LIMITS

APLHGR 3/4.11.A

A.1

3.11 - LIMITING CONDITIONS FOR OPERATION

4.11 - SURVEILLANCE REQUIREMENTS

A. AVERAGE PLANAR LINEAR HEAT GENERATION RATE

A. AVERAGE PLANAR LINEAR HEAT GENERATION RATE

LC03.2.1

All AVERAGE PLANAR LINEAR HEAT GENERATION RATES (APLHGR) shall not exceed the limits specified in the CORE OPERATING LIMITS REPORT. *SR3.2.1*

The APLHGRs shall be verified to be equal to or less than the limits specified in the CORE OPERATING LIMITS REPORT.

APPLICABILITY:

A.2

OPERATIONAL MODE 1 when THERMAL POWER is greater than or equal to 25% of RATED THERMAL POWER.

1. At least once per 24 hours,
2. Within 12 hours after completion of a THERMAL POWER increase of at least 7.25% ~~15%~~ of RATED THERMAL POWER, and L.1

ACTION:

3. Initially and at least once per 12 hours when the reactor is operating with a LIMITING CONTROL ROD PATTERN for APLHGR. L.2

ACTION A

With an APLHGR exceeding the limits specified in the CORE OPERATING LIMITS REPORT:

4. The provisions of Specification 4.0.D are not applicable. L.1

1. Initiate corrective ACTION within 15 minutes, and L.A.1

2. Restore APLHGR to within the required limit within 2 hours.

ACTION B

With the provisions of the ACTION above not met, reduce THERMAL POWER to less than 25% of RATED THERMAL POWER within the next 4 hours.

3.11 - LIMITING CONDITIONS FOR OPERATION

4.11 - SURVEILLANCE REQUIREMENTS

B. TRANSIENT LINEAR HEAT GENERATION RATE

B. TRANSIENT LINEAR HEAT GENERATION RATE

The TRANSIENT LINEAR HEAT GENERATION RATE (TLHGR) shall be maintained such that the FUEL DESIGN LIMITING RATIO for CENTERLINE MELT (FDLRC)^(a) is less than or equal to 1.0.

The value of FDLRC^(a) shall be verified:

LCO 3.2.4.a
LCO 3.2.4.b
LCO 3.2.4.c

Where FDLRC is equal to:

$$\frac{(TLHGR)(1.2)}{(TLHGR)(FRTTP)}$$

1. At least once per 24 hours, $\geq 25\%$
2. Within 12 hours after completion of a THERMAL POWER increase of at least 15% of RATED THERMAL POWER, and
3. Initially and at least once per 12 hours when the reactor is operating with FDLRC greater than or equal to 1.0.

APPLICABILITY:

OPERATIONAL MODE 1, when THERMAL POWER is greater than or equal to 25% of RATED THERMAL POWER.

ACTION:

With FDLRC greater than 1.0, initiate corrective ACTION within 15 minutes and within 6 hours either:

each required APRM Flow Biased Neutron Flux - High Function Allowable Value shall be modified by the lesser of 1/FDLRC or FRTTP/MFLPD; or each required APRM gain shall be adjusted such that the APRM readings are ≥ 100 times the higher of FRTTP times FDLRC or of MFLPD.

ACTION A

1. Restore FDLRC to less than or equal to 1.0, or Allowable Value
2. Adjust the flow biased APRM setpoints specified in Specifications 2.2.A and 3.2.E by 1/FDLRC, or
3. Adjust each APRM gain such that the APRM readings are ≥ 100 times the FRACTION OF RATED THERMAL POWER (FRTTP) times FDLRC.

ACTION B

With the provisions of the ACTION above not met, reduce THERMAL POWER to less than 25% of RATED THERMAL POWER within the next 4 hours.

LCO 3.2.4.a

- a. For GE fuel, MFLPD/FRTTP is substituted for FDLRC. Adjustments are based on the lowest APRM setpoint or highest APRM reading resulting from the two limits.
- b. Provided that the adjusted APRM reading does not exceed 100% of RATED THERMAL POWER and a notice of adjustment is posted on the reactor control panel.

A.1

ITS 3.2.2

MCPR 3/4.11.C

POWER DISTRIBUTION LIMITS

3.11 - LIMITING CONDITIONS FOR OPERATION

4.11 - SURVEILLANCE REQUIREMENTS

C. MINIMUM CRITICAL POWER RATIO

C. MINIMUM CRITICAL POWER RATIO

LCB 3.2.2 The MINIMUM CRITICAL POWER RATIO (MCPR) shall be equal to or greater than the MCPR operating limit specified in the CORE OPERATING LIMITS REPORT.

SR 3.2.2.1 MCPR shall be determined to be equal to or greater than the applicable MCPR operating limit specified in the CORE OPERATING LIMITS REPORT.

APPLICABILITY:

A.2

OPERATIONAL MODE 7, when THERMAL POWER is greater than or equal to 25% of RATED THERMAL POWER.

ACTION:

ACTION A

With MCPR less than the applicable MCPR operating limit as determined for one of the conditions specified in the CORE OPERATING LIMITS REPORT:

L.A.1

1. Initiate corrective ACTION within 15 minutes, and
2. Restores MCPR to within the required limit within 2 hours.

ACTION B

With the provisions of the ACTION above not met, reduce THERMAL POWER to less than 25% of RATED THERMAL POWER within the next 4 hours.

1. At least once per 24 hours,

2. Within 12 hours after completion of a THERMAL POWER increase of at least 15% of RATED THERMAL POWER, and $\geq 25\%$

L.1

3. Initially and at least once per 12 hours when the reactor is operating with a LIMITING CONTROL ROD PATTERN for MCPR.

L.2

4. The provisions of Specification 4.0.D are not applicable.

L.1

2 Add proposed SR 3.2.2.2

M.1

POWER DISTRIBUTION LIMITS

A.1

LHGR 3/4.11.D

3.11 - LIMITING CONDITIONS FOR OPERATION

4.11 - SURVEILLANCE REQUIREMENTS

D. LINEAR HEAT GENERATION RATE

D. LINEAR HEAT GENERATION RATE

LCO 3.2.3

JR 3.2.3.1

The LINEAR HEAT GENERATION RATE (LHGR) for each type of fuel shall not exceed the limits specified in the CORE OPERATING LIMITS REPORT.

The LHGR shall be determined to be equal to or less than the limit:

APPLICABILITY:

A.2

OPERATIONAL MODE 1, when THERMAL POWER is greater than or equal to 25% of RATED THERMAL POWER.

225%

2. Within 12 hours after completion of a THERMAL POWER increase of at least 15% of RATED THERMAL POWER, and

L.1

ACTION:

3. Initially and at least once per 12 hours when the reactor is operating with a LIMITING CONTROL ROD PATTERN for LHGR.

L.2

ACTION A With a LHGR exceeding the limits specified in the CORE OPERATING LIMITS REPORT:

4. The provisions of Specification 4.0.D are not applicable.

L.1

L.A.1

1. Initiate corrective ACTION within 15 minutes, and

2. Restore the LHGR to within the required limit within 2 hours.

ACTION B With the provisions of the ACTION above not met, reduce THERMAL POWER to less than 25% of RATED THERMAL POWER within the next 4 hours.

SPECIAL TEST EXCEPTIONS

PCI 3/4.12.A

3.12 - LIMITING CONDITIONS FOR OPERATION

4.12 - SURVEILLANCE REQUIREMENTS

A. PRIMARY CONTAINMENT INTEGRITY

A. PRIMARY CONTAINMENT INTEGRITY

The provisions of Specifications 3.7.A, 3.7.E and 3.10.A and Table 1-2 may be suspended to permit the reactor pressure vessel closure head and the drywell head to be removed and the primary containment air lock doors to be open when the reactor mode switch is in the Startup position during low power PHYSICS TESTS with THERMAL POWER less than 1% of RATED THERMAL POWER and reactor coolant temperature less than 212°F.

The THERMAL POWER and reactor coolant temperature shall be verified to be within the limits at least once per hour during low power PHYSICS TESTS.

APPLICABILITY:

OPERATIONAL MODE 2, during low power PHYSICS TESTS.

ACTION:

With THERMAL POWER greater than or equal to 1% of RATED THERMAL POWER or with the reactor coolant temperature greater than or equal to 212°F, immediately place the reactor mode switch in the Shutdown position.

M.I

A.1

SPECIAL TEST EXCEPTIONS

SDM 3/4.12.8

3.12 - LIMITING CONDITIONS FOR OPERATION

4.12 - SURVEILLANCE REQUIREMENTS

B. SHUTDOWN MARGIN Demonstrations A.2

B. SHUTDOWN MARGIN Demonstrations L.1

LCO 3.10.7 The provisions of Specifications 3.10.A and 3.10.C and Table 1-2 may be suspended to permit the reactor mode switch to be in the Startup position and to allow more than one control rod to be withdrawn for SHUTDOWN MARGIN demonstration, provided that at least the following requirements are satisfied.

Within 30 minutes prior to and at least once per 12 hours during the performance of a SHUTDOWN MARGIN demonstration, verify that:

A.3
1. The source range monitors are OPERABLE per Specification 3.10.B.

1. The source range monitors are OPERABLE per Specification 3.10.B. A.3

LCO 3.10.7.b 2. The rod worth minimizer is OPERABLE per Specification 3.3.L and is programmed for the SHUTDOWN MARGIN demonstration, or conformance with the SHUTDOWN MARGIN demonstration procedure is verified by a second licensed operator or other technically qualified individual.

2. The rod worth minimizer is OPERABLE with the required program per Specification 3.3.L or a second licensed operator or other technically qualified individual is present and verifies compliance with the SHUTDOWN MARGIN demonstration procedures, and

LCO 3.10.7.d 3. The "rod-out-notch-override" control shall not be used during out-of-sequence movement of the control rods.

3. No other CORE ALTERATION(s) are in progress. SR 3.10.7.2
SR 3.10.7.3

LCO 3.10.7.e 4. No other CORE ALTERATION(s) are in progress.

Add proposed SR 3.10.7.2 and SR 3.10.7.3 Notes A.6

Add proposed SR 3.10.7.5 A.4

Add proposed SR 3.10.7.6 M.1

Add proposed LCO 3.10.7.c A.4

Add proposed LCO 3.10.7.f M.1

with the reactor mode switch in startup/hot standby position A.5

APPLICABILITY:

OPERATIONAL MODE 5, during SHUTDOWN MARGIN demonstrations.

ACTION:

ACTION B

With the requirements of the above specification not satisfied, immediately place the reactor mode switch in the Shutdown or Refuel position.

Add proposed ACTION A A.4

4.0 5.0 DESIGN FEATURES

4.1 5.1 SITE

Site and Exclusion Area

4.1.1 5.1.A The site consists of approximately 784 acres on the east bank of the Mississippi River opposite the mouth of the Wapsipinicon River, approximately three miles north of the village of Cordova, Rock Island County, Illinois. The Exclusion Area shall not be less than 380 meters from the centerline of the chimney.

Low Population Zone

4.1.2 5.1.B The Low Population Zone shall be a three mile radius from the centerline of the chimney.

Radioactive Gaseous Effluents

5.1.C Information regarding radioactive gaseous effluents shall be located in the OFFSITE DOSE CALCULATION MANUAL.


Radioactive Liquid Effluents

5.1.D Information regarding radioactive liquid effluents shall be located in the OFFSITE DOSE CALCULATION MANUAL.

A.3

A.1

FIGURE 5.1.A-1

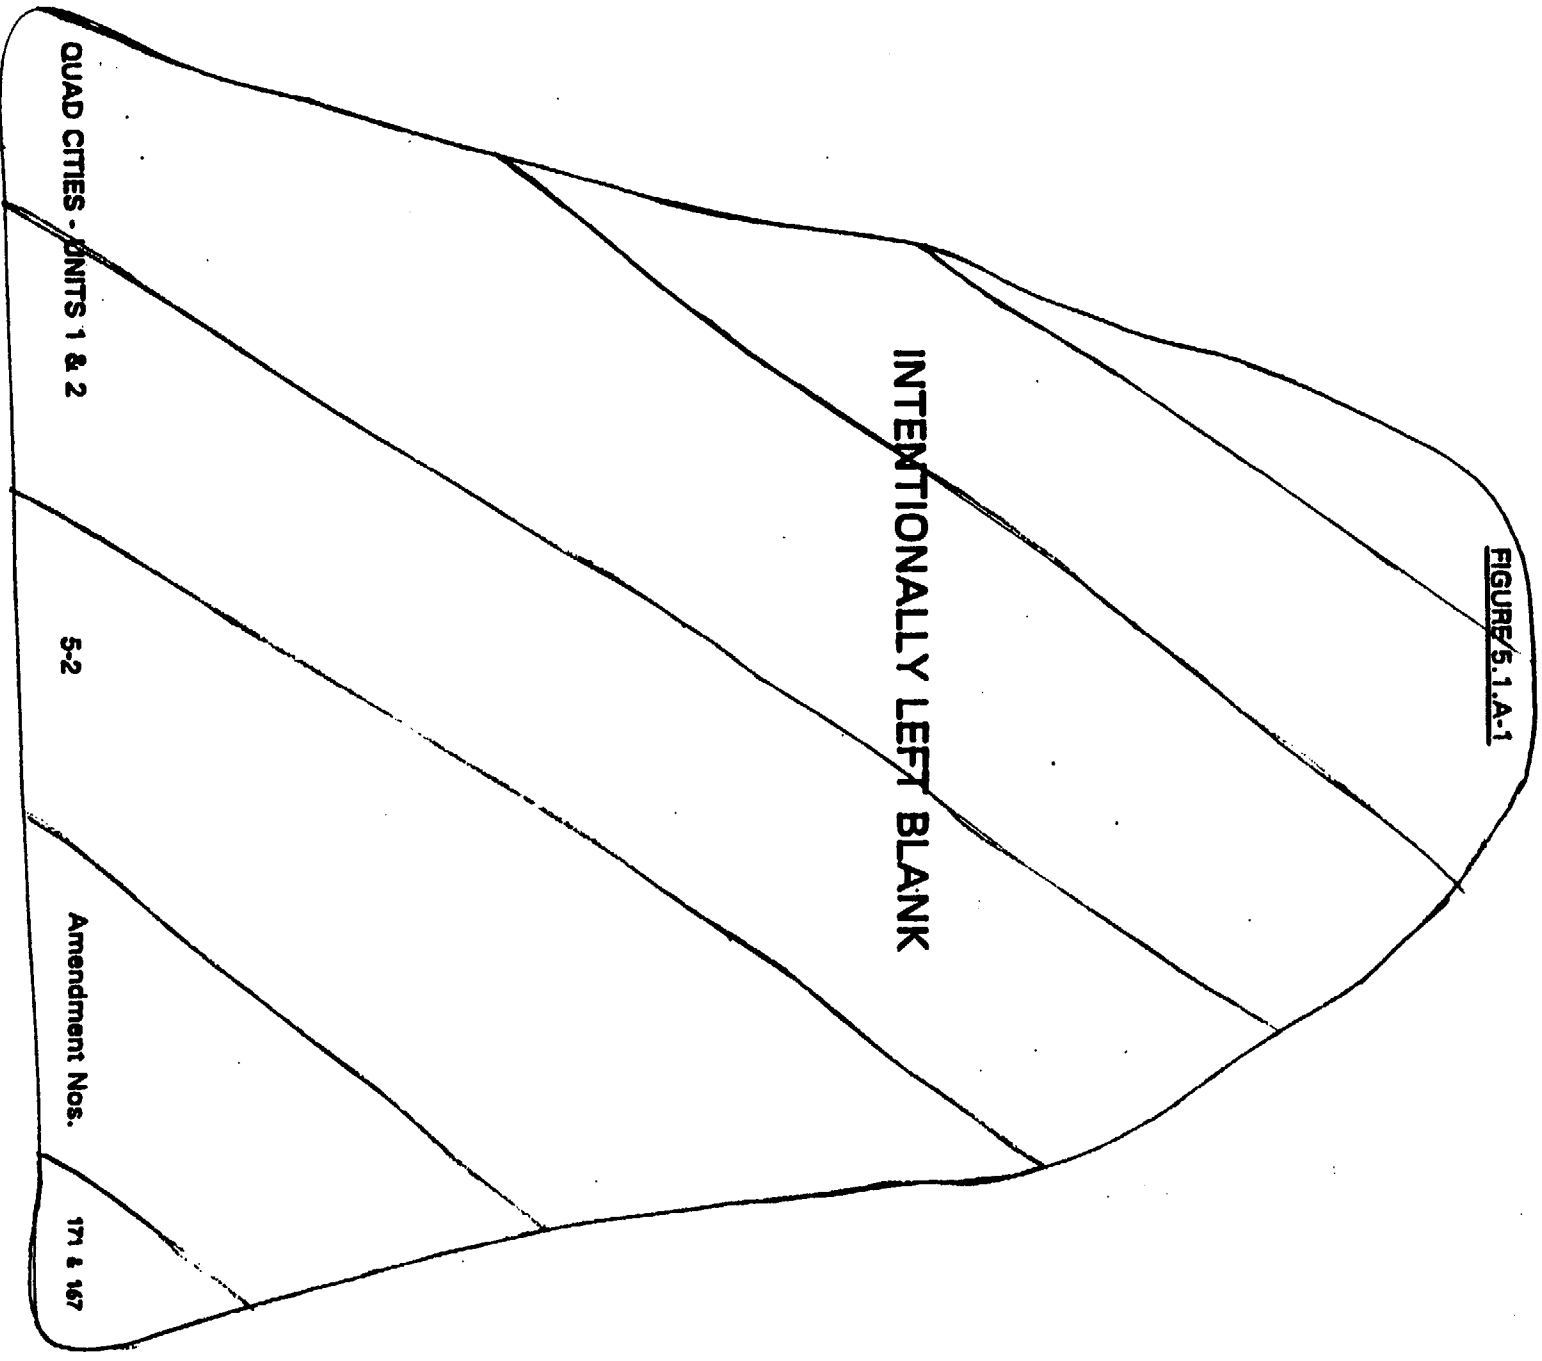

5.0 DESIGN FEATURES

5.2 CONTAINMENT

LA.2

Configuration

5.2.A The primary containment is a steel lined concrete structure consisting of a drywell and suppression chamber. The drywell is a steel structure composed of a spherical lower portion, a cylindrical middle portion, and a hemispherical top head. The drywell is attached to the suppression chamber through a series of downcomer vents. The drywell has a minimum free air volume of 158,236 cubic feet. The suppression chamber has an air region of 120,800 to 117,300 cubic feet and a water region of 111,500 to 115,000 cubic feet.

Design Temperature and Pressure

5.2.B The primary containment is designed and shall be maintained for:

1. Maximum internal pressure: 56 psig.
2. Maximum internal temperature: drywell 281°F.
suppression pool 281°F.
3. Maximum external pressure: drywell 2 psig.
suppression pool 1 psig.

Secondary Containment

5.2.C The secondary containment consists of the Reactor Building and a portion of the main steam tunnel and has a minimum free volume of 4,716,000 cubic feet.

5.0 DESIGN FEATURES

4.2 5.3 REACTOR CORE

Fuel Assemblies

4.2.1 5.3.A The reactor core shall contain 724 fuel assemblies. Each assembly consists of a matrix of Zircaloy clad fuel rods with an initial composition of natural or slightly enriched uranium dioxide as fuel material. The assemblies may contain water rods or water boxes. Limited substitutions of Zircaloy or ZIRLO filler rods for fuel rods, in accordance with NRC-approved applications of fuel rod configurations, may be used. Fuel assemblies shall be limited to those fuel designs that have been analyzed with applicable NRC staff-approved codes and methods, and shown by tests or analyses to comply with all fuel safety design bases. A limited number of lead test assemblies that have not completed representative testing may be placed in non-limiting core regions.

Control Rod Assemblies

4.2.2 5.3.B The reactor core shall contain 177 cruciform shaped control rod assemblies. The control material shall be boron carbide powder (B₄C) and hafnium metal. The control rod assembly shall have a nominal axial absorber length of 143 inches.

LA.3

5.0 DESIGN FEATURES

4.3 **5.6 FUEL STORAGE**

4.3.1 **Criticality**

4.3.1.1 **5.6.A** The spent fuel storage racks are designed and shall be maintained with:

- 4.3.1.1.a 1. A k_{eff} equivalent to ≤ 0.95 when flooded with unborated water, including all calculational uncertainties and biases as described in Section 9.1 of the UFSAR.
- 4.3.1.1.b 2. A nominal 6.22 inch center-to-center distance between fuel assemblies placed in the storage racks.

A.1

2

4.3.2 **Drainage**

5.6.B The spent fuel storage pool is designed and shall be maintained to prevent inadvertent draining of the pool below elevation 866' 8.5".

4.3.3 **Capacity**

5.6.C The spent fuel storage pool is designed and shall be maintained with a storage capacity limited to no more than 3657(Unit 1)/3897(Unit 2) fuel assemblies.

A.1

5.0 ADMINISTRATIVE CONTROLS

5.1 6.1 RESPONSIBILITY

5.1.1 6.1.A The Station Manager shall be responsible for overall facility operation and shall delegate in writing the succession to this responsibility during his absence. LA.1

5.1.2 6.1.B The Shift Engineer shall be responsible for directing and commanding the safe overall operation of the facility under all conditions.

add proposed ITS 5.1.2 LA.2

ADMINISTRATIVE CONTROLS

5.2 **6.2 ORGANIZATION**

5.2.1 **6.2.A Onsite and Offsite Organizations**

Onsite and offsite organizations shall be established for unit operation and corporate management, respectively. The onsite and offsite organizations shall include the positions for activities affecting the safety of the nuclear power plant.

5.2.1.a

1. Lines of authority, responsibility, and communication shall be established and defined for the highest management levels through intermediate levels to and including all operating organization positions. These relationships shall be documented and updated, as appropriate, in the form of organization charts, functional descriptions of departmental responsibilities and relationships, and job descriptions for key personnel positions, or in equivalent forms of documentation. These requirements shall be documented in the Quality Assurance Manual.

LA.1

INSERT 5.2.1.a

5.2.1.b

2. The Station Manager shall be responsible for overall unit safe operation and shall have control over those onsite activities necessary for safe operation and maintenance of the plant.

LA.1

5.2.1.c

3. The Chief Nuclear Officer (CNO) shall have corporate responsibility for overall plant nuclear safety and shall take any measures needed to ensure acceptable performance of the staff in operating, maintaining, and providing technical support to the plant to ensure nuclear safety.

A corporate officer

5.2.1.d

4. The individuals who train the operating staff and those who carry out health physics and quality assurance functions may report to the appropriate onsite manager; however, they shall have sufficient organizational freedom to ensure their independence from operating pressures.

A.2

radiation protection

ADMINISTRATIVE CONTROLS

5.2.2 6.2.B Unit Staff

The unit staff shall include the following:

At least one required non-licensed operator assigned to each unit.

5.2.2.a 1. Three non-licensed operators shall be on site at all times. M.1

5.2.2.b 2. At least one licensed Reactor Operator shall be present in the control room when fuel is in the reactor. In addition, while the unit is in MODE(s) 1, 2, 3 or 4, at least one licensed Senior Reactor Operator shall be present in the control room. L.1

5.2.2.c 3. Shift crew composition may be less than the minimum requirement of 10 CFR 50.54(m)(2)(i) and 6.2.B.1 and 6.2.C for a period of time not to exceed two hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the shift crew composition to within the minimum requirements.

5.2.2.d 4. A Radiation Protection Technician shall be on site when fuel is in the reactor. The position may be vacant for not more than two hours, in order to provide for unexpected absence, provided immediate action is taken to fill the required position. A.2

5. Administrative procedures shall be developed and implemented to limit the working hours of unit staff who perform safety-related functions; e.g. senior reactor operators, reactor operators, health physicists, auxiliary operators, and key maintenance personnel. LA.2

5.2.2.e The amount of overtime worked by unit staff members performing safety-related functions shall be limited in accordance with the NRC Policy Statement on working hours (Generic Letter 82-12).

5.2.2.f 6. The Operations Manager or Shift Operations Supervisor shall hold a Senior Reactor Operator License. LA.1

6.2.C Shift Technical Advisor

5.2.2.g The Shift Technical Advisor (STA) shall provide technical advisory support to the Shift Supervisor in the areas of thermal hydraulics, reactor engineering and plant analysis with regard to the safe operation of the facility. In addition, the STA shall meet the qualifications specified by the Commission Policy Statement on Engineering Expertise on Shift. A single STA may fulfill this function for both units.

shift manager

A.3

ADMINISTRATIVE CONTROLS

5.3 **6.3 UNIT STAFF QUALIFICATIONS**

5.3.1

Each member of the unit staff shall meet or exceed the minimum qualifications of ANSI N18.1-1971, "Selection and Training of Nuclear Plant Personnel", dated March 8, 1971, except for the Rad/Chem Superintendent or Lead Health Physicist, who shall meet or exceed the qualifications of the Radiation Protection Manager as specified in Regulatory Guide 1.8, September 1975, and the Shift Technical Advisor who shall have a bachelor's degree or equivalent in a scientific or engineering discipline with specific training in plant design and response and analysis of the plant for transients and accidents.

radiation protection technician

LA.1

A.2

radiation protection manager

LA.1

CTS 6.4

Training 6.4

ADMINISTRATIVE CONTROLS

6.4 TRAINING

A retraining and replacement program for the unit staff shall be maintained under the direction of the appropriate on site manager. Training shall be in accordance with ANSI N18.1-1971 and 10 CFR 55 for appropriate designated positions and shall include familiarization with relevant industry operational experience.

LA.1

CTS 6.7

Safety Limit Violation 6.7

ADMINISTRATIVE CONTROLS

6.7 SAFETY LIMIT VIOLATION

A.1

6.7.A The following actions shall be taken in the event a Safety Limit is violated:

1. The NEC Operations Center shall be notified by telephone as soon as possible and in all cases within 1 hour. The Site Vice-President or his designated alternate shall be notified within 24 hours.

LA.1

2. Within 30 days, a Licensee Event Report (LER) shall be prepared documenting the event pursuant to 10 CFR 50.73. The LER shall be submitted to the NRC.

3. Critical operation of the Unit shall not be resumed until authorized by the Commission.

A.1

ADMINISTRATIVE CONTROLS

5.4 6.8 **PROCEDURES AND PROGRAMS** *<See ITS 5.5>*

5.4.1 6.8.A Written procedures shall be established, implemented, and maintained covering the activities referenced below:

5.4.1.a 1. The applicable procedures recommended in Appendix A, of Regulatory Guide 1.33, Revision 2, February 1978,

5.4.1.b 2. The Emergency Operating Procedures required to implement the requirements of NUREG-0737 and Supplement 1 to NUREG-0737 as stated in Section 7.1 of Generic Letter No. 82-33,

- 3. Station Security Plan implementation, A.2
- 4. Generating Station Emergency Response Plan implementation, LA.1
- 5. PROCESS CONTROL PROGRAM (PCP) implementation, A.3
- 6. OFFSITE DOSE CALCULATION MANUAL (ODCM) implementation, and M.1

5.4.1.c 7. Fire Protection Program implementation.

<Add proposed ITS 5.4.1.d>

~~6.8.B Deleted~~

~~6.8.C Deleted~~

6.8.D The following programs shall be established, implemented, and maintained:

1. Reactor Coolant Sources Outside Primary Containment

This program provides controls to minimize leakage from those portions of systems outside primary containment that could contain highly radioactive fluids during a serious transient or accident to as low as practical levels. The systems include CS, HPCI, LPCI, RCIC, process sampling (post accident sampling of reactor coolant and containment atmosphere), containment monitoring, and standby gas treatment systems. The program shall include the following:

- a. Preventive maintenance and periodic visual inspection requirements, and
- b. Leak test requirements for each system at a frequency of at least once per operating cycle.

<See ITS 5.5>

5.0 ADMINISTRATIVE CONTROLS

5.5 6.8 PROCEDURES AND PROGRAMS

6.8.A Written procedures shall be established, implemented, and maintained covering the activities referenced below:

1. The applicable procedures recommended in Appendix A, of Regulatory Guide 1.33, Revision 2, February 1978,
2. The Emergency Operating Procedures required to implement the requirements of NUREG-0737 and Supplement 1 to NUREG-0737 as stated in Section 7.1 of Generic Letter No. 82-33,
3. Station Security Plan implementation,
4. Generating Station Emergency Response Plan implementation,
5. PROCESS CONTROL PROGRAM (PCP) implementation,
6. OFFSITE DOSE CALCULATION MANUAL (ODCM) implementation, and
7. Fire Protection Program implementation.

6.8.B Deleted

< See ITS 5.4 >

6.8.C Deleted

5.5 6.8.D The following programs shall be established, implemented, and maintained:

5.5.2 1. Reactor Coolant Sources Outside Primary Containment

This program provides controls to minimize leakage from those portions of systems outside primary containment that could contain highly radioactive fluids during a serious transient or accident to as low as practical levels. The systems include CS, HPCI, LPCI, RCIC, process sampling (post accident sampling of reactor coolant and containment atmosphere), containment monitoring, and standby gas treatment systems. The program shall include the following:

M.1
Reactor Water Cleanup

LA.7

5.5.2.a Preventive maintenance and periodic visual inspection requirements, and

5.5.2.b Leak test requirements for each system at a frequency of at least once per operating cycle

24 months

LD.1

QUAD CITIES - UNITS 1 & 2

6-9

Amendment Nos. 171 & 167

The provisions of SR 3.0.2 are applicable to the 24 month Frequency for performing integrated system leak test activities.

A.2

ADMINISTRATIVE CONTROLS

2. In-Plant Radiation Monitoring LA.1

This program provides controls which will ensure the capability to accurately determine the airborne iodine concentration in vital areas under accident conditions. This program shall include the following:

- a. Training of personnel,
- b. Procedures for monitoring, and
- c. Provisions for maintenance of sampling and analysis equipment.

5.5.3 3. Post Accident Sampling

This program provides controls which will ensure the capability to obtain and analyze reactor coolant, radioactive iodines and particulates in plant gaseous effluents, and primary containment atmosphere samples under accident conditions. The program shall include the following:


- 5.5.3.a a. Training of personnel,
- 5.5.3.b b. Procedures for sampling and analysis,
- 5.5.3.c c. Provisions for maintenance of sampling and analysis equipment.

ADMINISTRATIVE CONTROLS

5.5.4 4. Radioactive Effluent Controls Program

A program shall be provided conforming with 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to members of the public from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by station procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- 5.5.4.a a. Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM,
- 5.5.4.b b. Limitations on the instantaneous concentrations of radioactive material released in liquid effluents to unrestricted areas conforming to ten (10) times the concentration values in 10 CFR Part 20, Appendix B, Table 2, Column 2 to 10 CFR Part 20.1001 - 20.2402,
- 5.5.4.c c. Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.1302 and with the methodology and parameters in the ODCM,
- 5.5.4.d d. Limitations on the annual and quarterly doses to a member of the public from radioactive materials in liquid effluents released from each Unit conforming to Appendix I to 10 CFR Part 50,
- 5.5.4.e e. Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days,

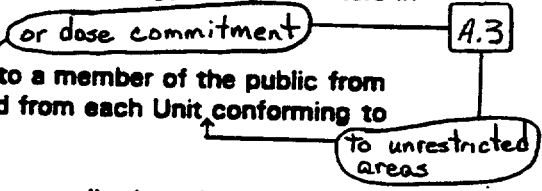

ADMINISTRATIVE CONTROLS

- 5.5.4.f f. Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that the appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a 31-day period would exceed 2 percent of the guidelines for the annual dose conforming to Appendix I to 10 CFR Part 50,
- 5.5.4.g g. Limitations on the dose rate resulting from radioactive materials released in gaseous effluents from the site to areas at or beyond the site boundary shall be limited to the following:
 - 5.5.4.g.1 a) For noble gases: less than or equal to a dose rate of 500 mrem/yr to the whole body and less than or equal to a dose rate of 3000 mrem/yr to the skin, and
 - 5.5.4.g.2 b) For Iodine-131, Iodine-133, tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: less than or equal to a dose rate of 1500 mrem/yr to any organ.
- 5.5.4.h h. Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each Unit to areas beyond the site boundary conforming to Appendix I to 10 CFR Part 50,
- 5.5.4.i i. Limitations on the annual and quarterly doses to a member of the public from Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released from each Unit conforming to Appendix I to 10 CFR Part 50,
- 5.5.4.j j. Limitations on the annual dose or dose commitment to any member of the public due to releases of radioactivity and to radiation from uranium fuel cycle sources conforming to 40 CFR Part 190.

A.3

or dose commitment

← Add proposed ITS 5.5.5

M.2

The provisions of SR 3.0.2 and SR 3.0.3 are applicable to the Radioactive Effluents Control Program Surveillance Frequencies.

A.2

ADMINISTRATIVE CONTROLS

5.5.12 5. Primary Containment Leakage Rate Testing Program

5.5.12.a A program shall be established to implement the leakage rate testing of the primary containment as required by 10 CFR 50.54(o) and 10 CFR 50, Appendix J, Option B, as modified by approved exemption. This program shall be in accordance with the guidelines contained in Regulatory Guide 1.163, "Performance-Based Containment Leak-Testing Program," dated September 1995.

5.5.12.b The peak calculated primary containment internal pressure for the design basis loss of coolant accident, P_p , is 48 psig.

5.5.12.c The maximum allowable primary containment leakage rate, L_p , at P_p , is 1% of primary containment air weight per day.

5.5.12.d Leakage rate acceptance criteria are:

5.5.12.d.1 a. Primary containment overall leakage rate acceptance criterion is $\leq 1.0 L_p$. During the first unit startup following testing in accordance with this program, the leakage rate acceptance criteria are $\leq 0.60 L_p$ for the combined Type B and Type C tests, and $\leq 0.75 L_p$ for Type A tests.

5.5.12.d.2 b. Air lock testing acceptance criteria is the overall air lock leakage rate is $\leq 0.05 L_p$ when tested at $\geq P_p$.

The provisions of 4.0.B do not apply to the test frequencies specified in the Primary Containment Leakage Rate Testing Program.

A.4

5.5.12.e The provisions of 4.0.C are applicable to the Primary Containment Leakage Rate Testing Program.

A.1

Reporting Requirements 6.9

ADMINISTRATIVE CONTROLS

5.6

6.9 REPORTING REQUIREMENTS

In addition to the applicable reporting requirements of Title 10, Code of Federal Regulations, the following identified reports shall be submitted to the Regional Administrator/ of the appropriate Regional Office of the NRC unless otherwise noted.

A.2

6.9.A. Routine Reports

in accordance with 10 CFR 50.4

1. Deleted

A.3

2. Annual Report

5.6.1

Annual reports covering the activities of the Unit for the previous calendar year, as described in this section shall be submitted prior to May 1 of each year.

A.1

ITS 5.6

Reporting Requirements 6.9

ADMINISTRATIVE CONTROLS

Add proposed ITS 5.6.1 Note

A.4

The reports required shall include:

A.3

5.6.1

a. Tabulation of the number of station, utility, and other personnel (including contractors) receiving exposures greater than 100 mrem/year and their associated person rem exposure according to work and job functions, e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignments to various duty functions may be estimated based on pocket dosimeter or TLD. Small exposures totaling less than 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total whole body dose received from external sources should be assigned to specific major work functions.

A.5

electronic or

A.6

b. The results of specific activity analysis in which the reactor coolant exceeded the limits of Specification 3.6.J. The following information shall be included: (1) Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded; (2) results of the last isotopic analysis for radioiodine performed prior to exceeding the limit, results of analysis while limit was exceeded and results of one analysis after the radioiodine activity was reduced to less than the limit. Each result should include date and time of sampling and the radioiodine concentrations; (3) Clean-up system flow history starting 48 hours prior to the first sample in which the limit was exceeded; (4) Graph of the I-131 concentration and one other radioiodine isotope concentration in microcuries per gram as a function of time for the duration of the specific activity above the steady-state level; and (5) The time duration when the specific activity of the reactor coolant exceeded the radioiodine limit.

A.4

5.6.2

3. Annual Radiological Environmental Operating Report

Add proposed ITS 5.6.2 Note

The Annual Radiological Environmental Operating Report covering the operation of the Unit during the previous calendar year shall be submitted prior to May 1 of each year. The report shall include summaries, interpretations, and analysis of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the ODCM and (2) Sections IV.B.2, IV.B.3, and IV.C of Appendix I to 10 CFR Part 50.

15

L.1

A.1

ITS 5.6

ADMINISTRATIVE CONTROLS

A.4

Add proposed ITS 5.6.3 Note

A.7

5.6.3 4. Radioactive Effluent Release Report

in accordance with 10 CFR 50.36a

The Radioactive Effluent Release Report covering the operation of the facility during the previous calendar year shall be submitted prior to April 7 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the facility. The material provided shall be (1) consistent with the objectives outlined in the ODCM and PCP and (2) in conformance with 10 CFR 50.36a and Section IV.B.1 of Appendix I to 10 CFR Part 50.

5.6.4 5. Monthly Operating Report

prior to May 1 of each year

L.1

Routine reports of operating statistics and shutdown experience, including documentation of all challenges to safety valves or safety/relief valves, shall be submitted on a monthly basis to the Director, Office of Resource Management, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, with a copy to the Regional Administrator of the NRC Regional Office, no later than the 15th of each month following the calendar month covered by the report.

A.2

5.6.5 6. CORE OPERATING LIMITS REPORT

5.6.5.a a. Core operating limits shall be established and documented in the CORE OPERATING LIMITS REPORT before each reload cycle or any remaining part of a reload cycle for the following:

5.6.5.a.5 (1) The Control Rod Withdrawal Block Instrumentation for Table 3.2.E-1 of Specification 3.2.E.

5.6.5.a.1 (2) The Average Planar Linear Heat Generation Rate (APLHGR) Limit for Specification 3.11.A.

5.6.5.a.3 (3) The Linear Heat Generation Rate (LHGR) for Specification 3.11.D.

5.6.5.a.2 (4) The Minimum Critical Power Operating Limit (including scram insertion time) for Specification 3.11.C. This includes rated and off-rated flow conditions.

LA.1

5.6.5.b b. The analytical methods used to determine the operating limits shall be those previously reviewed and approved by the NRC in the latest approved revision or supplement of topical reports:

5.6.5.b.1 (1) NEDE-24011-P-A, "General Electric Standard Application for Reactor Fuel," (latest approved revision).

5.6.5.b.2 (2) Commonwealth Edison Topical Report NFSR-0085, "Benchmark of BWR Nuclear Design Methods," (latest approved revision).

QUAD CITIES - UNITS 1 & 2

6-15

Amendment Nos. 177 & 175

5.6.5.a.t The LHGR and transient linear heat generation rate limit for 3.2.4

A.9

ADMINISTRATIVE CONTROLS

- 5.6.5.b.3 (3) Commonwealth Edison Topical Report NFSR-0085, Supplement 1, "Benchmark of BWR Nuclear Design Methods - Quad Cities Gamma Scan Comparisons," (latest approved revision).
- 5.6.5.b.4 (4) Commonwealth Edison Topical Report NFSR-0085, Supplement 2, "Benchmark of BWR Nuclear Design Methods - Neutronic Licensing Analyses," (latest approved revision).
- 5.6.5.b.5 (5) Advanced Nuclear Fuels Methodology for Boiling Water Reactors, XN-NF-80-19(P)(A), Volume 1, Supplement 3, Supplement 3 Appendix F, and Supplement 4, Advanced Nuclear Fuels Corporation, November 1990.
- 5.6.5.b.6 (6) Exxon Nuclear Methodology for Boiling Water Reactors: Application of the ENC Methodology to BWR Reloads, XN-NF-80-19(P)(A), Volume 4, Revision 1, Exxon Nuclear Company, June 1986.
- 5.6.5.b.7 (7) Exxon Nuclear Methodology for Boiling Water Reactors THERMEX: Thermal Limits Methodology Summary Description, XN-NF-80-19(P)(A), Volume 3, Revision 2, Exxon Nuclear Company, January 1987.
- 5.6.5.b.8 (8) Exxon Nuclear Methodology for Boiling Water Reactors - Neutronic Methods for Design and Analysis, XN-NF-80-19(P)(A), Volume 1 and Supplements 1 and 2, Exxon Nuclear Company, March 1983.
- 5.6.5.b.9 (9) Generic Mechanical Design for Exxon Nuclear Jet Pump BWR Reload Fuel, XN-NF-85-67(P)(A) Revision 1, Exxon Nuclear Company, September 1986.
- 5.6.5.b.10 (10) Qualification of Exxon Nuclear Fuel for Extended Burnup Supplement 1: Extended Burnup Qualification of ENC 9x9 BWR Fuel, XN-NF-82-06(P)(A) Supplement 1, Revision 2, Advanced Nuclear Fuels Corporation, May 1988.
- 5.6.5.b.11 (11) Advanced Nuclear Fuels Corporation Generic Mechanical Design for Advanced Nuclear Fuels 9x9-IX and 9x9-9X BWR Reload Fuel, ANF-89-014(P)(A), Revision 1 and Supplements 1 and 2, Advanced Nuclear Fuels Corporation, October 1991.
- 5.6.5.b.12 (12) Generic Mechanical Design Criteria for BWR Fuel Designs, ANF-89-98(P)(A) Revision 1, and Revision 1 Supplement 1, Advanced Nuclear Fuels Corporation, May 1995.
- 5.6.5.b.13 (13) Exxon Nuclear Plant Transient Methodology for Boiling Water Reactors, XN-NF-79-71(P)(A), Revision 2 Supplements 1, 2, and 3, Exxon Nuclear Company, March 1986.

A.1

ADMINISTRATIVE CONTROLS

- 5.6.5.b.14 (14) ANFB Critical Power Correlation, ANF-1125(P)(A) and Supplements 1 and 2, Advanced Nuclear Fuels Corporation, April 1990.
- 5.6.5.b.15 (15) Advanced Nuclear Fuels Corporation Critical Power Methodology for Boiling Water Reactors/Advanced Nuclear Fuels Corporation Critical Power Methodology for Boiling Water Reactors: Methodology for Analysis of Assembly Channel Bowing Effects/NRC Correspondence, ANF-524(P)(A), Revision 2, Supplement 1 Revision 2, Supplement 2, Advanced Nuclear Fuels Corporation, November 1990.
- 5.6.5.b.16 (16) COTRANSA 2: A Computer Program for Boiling Water Reactor Transient Analyses, ANF-913(P)(A) Volume 1 Revision 1 and Volume 1 Supplements 2, 3, and 4, Advanced Nuclear Fuels Corporation, August 1990.
- 5.6.5.b.17 (17) Advanced Nuclear Fuels Corporation Methodology for Boiling Water Reactors EXEM BWR Evaluation Model, ANF-91-048(P)(A), Advanced Nuclear Fuels Corporation, January 1993.
- 5.6.5.b.18 (18) Commonwealth Edison Topical Report NFSR-0091, "Benchmark of CASMO/MICROBURN BWR Nuclear Design Methods," Revision 0, Supplements 1 and 2, December 1991, March 1992, and May 1992, respectively; SER letter dated March 22, 1993.
- 5.6.5.b.19 (19) ANFB Critical Power Correlation Application for Coresident Fuel, EMF-1125(P)(A), Supplement 1, Appendix C, Siemens Power Corporation, August 1997.
- 5.6.5.b.20 (20) ANFB Critical Power Correlation Determination of ATRIUM-9B Additive Constant Uncertainties, ANF-1125(P)(A), Supplement 1, Appendix E, Siemens Power Corporation, September 1998.

5.6.5.c — c. The core operating limits shall be determined so that all applicable limits (e.g., fuel thermal-mechanical limits, core thermal-hydraulic limits, ECCS limits, nuclear limits such as shutdown margin, and transient and accident analysis limits) of the safety analysis are met. The CORE OPERATING LIMITS REPORT, including any mid-cycle revisions or supplements thereto, shall be provided upon issuance, for each reload cycle, to the NRC Document Control Desk with copies to the Regional Administrator and Resident Inspector. A.2

6.9.B Special Reports A.3

Special reports shall be submitted to the Regional Administrator of the NRC Regional Office within the time period specified for each report. A.2

A.8

CTS 6.11

ADMINISTRATIVE CONTROLS

6.11

RADIATION PROTECTION PROGRAM

Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained and adhered to for all operations involving personnel radiation exposure.

Radiation Protection Program 6.11

L.A.1

A.1

ADMINISTRATIVE CONTROLS

5.7 **6.12 HIGH RADIATION AREA**

5.7.1 6.12.A Pursuant to 10 CFR 20.1601(c), in lieu of the requirements of paragraph 20.1601 of 10 CFR Part 20, each high radiation area in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mrem/hr at 30 cm (12 in.) shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Work Permit (RWP)[™] (or equivalent document). Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. 1. A radiation monitoring device which continuously indicates the radiation dose rate in the area.
- b. 2. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate levels in the area have been established and personnel have been made knowledgeable of them; or
- c. 3. An individual qualified in radiation protection procedures with a radiation dose rate monitoring device, who is responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified in the RWP (or equivalent document).

5.7.2 6.12.B In addition to the requirements of 6.12.A, above, areas accessible to personnel with radiation levels greater than 1000 mrem/hr at 30 cm (12 in.) from the radiation source or from any surface which the radiation penetrates shall require the following:

- a. 1. Doors shall be locked to prevent unauthorized entry and shall not prevent individuals from leaving the area. In place of locking the door, direct or electronic surveillance that is capable of preventing unauthorized entry may be used. The keys shall be maintained under the administrative control of the Shift Engineer on duty ~~and/or health physics supervision.~~ Radiation protection A.2
- b. 2. Personnel access and exposure control requirements of activities being performed within these areas shall be specified by an approved RWP (or equivalent document).

Individuals qualified in radiation protection procedures A.2
such individuals

5.7.1 a Health physics personnel or personnel escorted by health physics personnel shall be exempt from the RWP issuance requirements during the performance of their assigned radiation protection duties, provided they are otherwise following plant radiation protection procedures for entry into high radiation areas.

ADMINISTRATIVE CONTROLS

A.1

- C B. Each person entering the area shall be provided with an alarming radiation monitoring device that continuously integrates the radiation dose rate (such as an electronic dosimeter.) Surveillance and radiation monitoring by a Radiation Protection Technician may be substituted for an alarming dosimeter. A.2

4. Deleted.

5.7.3

5. For individual HIGH RADIATION AREAS accessible to personnel with radiation levels of greater than 1000 mrem/h at 30 cm (12 in.) that are located within large areas where no enclosure exists for purposes of locking, and where no enclosure can be reasonably constructed around the individual areas, then such individual areas shall be barricaded, conspicuously posted, and a flashing light shall be activated as a warning device.

ADMINISTRATIVE CONTROLS

6.13 PROCESS CONTROL PROGRAM (PCP)

6.13.A Changes to the PCP:

1. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:
 - a. Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and,
 - b. A determination that the change will maintain the overall conformance of the solidified waste product to existing requirements of Federal, State, or other applicable regulations.
2. Shall become effective after review and acceptance, including approval by the Station Manager.

LA.1

A.1

ITS 5.5

ODCM 6.14

ADMINISTRATIVE CONTROLS

5.5.1 6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)

5.5.1.c 6.14.A Changes to the ODCM:

5.5.1.c.1 1. Shall be documented and records of reviews performed shall be retained. This documentation shall contain:

5.5.1.c.1(a) a. Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and,

5.5.1.c.1(b) b. A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.1302, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.

5.5.1.c.2 2. Shall become effective after review and acceptance, including approval by the Station L.A.6 Manager.

5.5.1.c.3 3. Shall be submitted to the Commission in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Radioactive Effluent Report for the period of the report in which any change to the ODCM was made effective. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.