

8.3 Onsite Power Systems

8.3.1 AC Power Systems

8.3.1.1 Description

The onsite ac power system is a non-Class 1E system comprised of a normal, preferred, maintenance and standby power supplies. The normal, preferred, and maintenance power supplies are included in the main ac power system. The standby power is included in the onsite standby power system. The Class 1E and non-Class 1E 208/120 Vac instrumentation power supplies are described in subsection 8.3.2 as a part of uninterruptible power supply in the dc power systems.

8.3.1.1.1 Onsite AC Power System

The main ac power system is a non-Class 1E system and does not perform any safety-related functions. It has nominal bus voltage ratings of 4.16 kV, 480 V, 277 V, 208 V, and 120 V.

Figure 8.3.1-1 shows the main generator, transformers, feeders, buses, and their connections. The ratings of major ac equipment are listed in Table 8.3.1-3.

During power generation mode, the turbine generator normally supplies electric power to the plant auxiliary loads through the unit auxiliary transformers. The plant is designed to sustain a load rejection from 100 percent power with the turbine generator continuing stable operation while supplying the plant houseloads. The load rejection feature does not perform any safety function.

During plant startup, shutdown, and maintenance the generator breaker remains open. The main ac power is provided by the preferred power supply from the high-voltage switchyard (switchyard voltage is site-specific) through the plant main stepup transformers and two unit auxiliary transformers. Each unit auxiliary transformer supplies power to about 50 percent of the plant loads.

A maintenance source is provided to supply power through a reserve auxiliary transformer. The maintenance source and the associated reserve auxiliary transformer primary voltage are site specific. The reserve auxiliary transformer is sized so that it can be used in place of either of the unit auxiliary transformers, if needed.

The unit auxiliary transformers have two identically rated 4.16 kV secondary windings. Secondaries of the auxiliary transformers are connected to the 4.16 kV switchgear buses by nonsegregated phase buses. The primary of the unit auxiliary transformer is connected to the main generator isolated phase bus duct tap. The 4.16 kV switchgear designation, location, connection, and connected loads are shown in Figure 8.3.1-1. The buses tagged with odd numbers (ES1, ES3, etc.) are connected to one unit auxiliary transformer and the buses tagged with even numbers (ES2, ES4, etc.) are connected to the other unit auxiliary transformer.

These 4.16 kV buses are provided with an access to the maintenance source through normally open circuit breakers connecting the bus to the reserve auxiliary transformer. Bus transfer to the maintenance source is manual.

The arrangement of the 4.16 kV buses permits feeding functionally redundant pumps or group of loads from separate buses and enhances the plant operational flexibility. The 4.16 kV switchgear powers large motors, and the load center transformers. There are four switchgear (ES1, ES2, ES5, and ES6) located in the annex building, and four (ES3, ES4, ES7, and ES8) in the turbine building.

The main stepup transformers have protective devices for sudden pressure, neutral overcurrent, and differential current. The unit auxiliary transformers have protective devices for sudden pressure, overcurrent, differential current, and neutral overcurrent. If these devices sense a fault condition the following actions will be automatically taken:

- Trip high-side (grid) breaker
- Trip generator breaker
- Trip exciter field breaker
- Trip the 4.16 kV buses connected to the faulted transformer

The reserve auxiliary transformer has protective devices for sudden pressure, overcurrent, and differential current. The reserve auxiliary transformer protective devices trip the reserve supply breaker and any 4.16 kV buses connected to the reserve auxiliary transformer.

The onsite standby power system powered by the two onsite standby diesel generators supplies power to selected loads in the event of loss of normal, and preferred ac power supplies. Those loads that are priority loads for defense-in-depth function based on their specific functions (permanent nonsafety loads) are assigned to buses ES1 and ES2. These plant permanent nonsafety loads are divided in two functionally redundant load groups (degree of redundancy for each load is described in the sections for the respective systems). Each load group is connected to either bus ES1 or ES2. Each bus is backed by a non-Class 1E onsite standby diesel generator. In the event of a loss of voltage on these buses, the diesel generators are automatically started and connected to the respective buses. The source incoming breakers on switchgear ES1 and ES2 are interlocked to prevent inadvertent connection of the onsite standby diesel generator and preferred/maintenance ac power sources to the 4.16 kV buses at the same time. The diesel generator however, is capable of being manually paralleled with the preferred power supply for periodic testing. Design provisions protect the diesel generators from excessive loading beyond the design maximum rating, should the preferred power be lost during periodic testing. The control scheme, while protecting the diesel generators from excessive loading, does not compromise the onsite power supply capabilities to support the defense-in-depth loads. See subsection 8.3.1.1.2 for starting and load sequencing of standby diesel generators.

Two separate 4.16 kV switchgear buses ES5 and ES6 located in the annex building power four reactor coolant pumps. Each pump is powered through two Class 1E circuit breakers

connected in series. These are the only Class 1E circuit breakers used in the main ac power system for the specific purpose of satisfying the safety-related tripping requirement of these pumps. The reactor coolant pumps connected to a common steam generator are powered from two different buses. The bus assignments for the reactor coolant pumps are shown in Figure 8.3.1-1.

The 480 V load centers supply power to selected 460 V motor loads and to motor control centers. Bus tie breakers are provided between two 480 V load centers each serving predominantly redundant loads. This intertie allows restoration of power to selected loads in the event of a failure or maintenance of a single load center transformer. The bus tie breakers are interlocked with the corresponding bus source incoming breakers so that one of the two bus source incoming breakers must be opened before the associated tie breaker is closed.

The 480 V motor control centers supply power to 460 V motors not powered directly from load centers, while the 480/277 V, and 208/120 V distribution panels provide power for miscellaneous loads such as unit heaters, space heaters, and lighting system. The motor control centers also provide ac power to the Class 1E battery chargers for the Class 1E dc power system as described in subsection 8.3.2.

Two ancillary ac diesel generators, located in the annex building, provide ac power for Class 1E post-accident monitoring, MCR lighting, MCR and I&C room ventilation, and pump power to refill the PCS water storage tank, and thus the spent fuel pool, when all other sources of power are not available.

Each ancillary ac generator output is connected to a distribution panel. The distribution panel is located in the room housing the diesel generators. The distribution panel has incoming and outgoing feeder circuit breakers as shown on Figure 8.3.1-3. The outgoing feeder circuit breakers are connected to cables which are routed to the divisions B and C voltage regulating transformers and to the PCS pumps. Each distribution panel has the following outgoing connections:

- Connection for Class 1E voltage regulating transformer to power the post-accident monitoring loads, the lighting in the main control room, and ventilation in the main control room and divisions B and C I&C rooms.
- Connection for PCS recirculation pump to refill the PCS water storage tank. The PCS water storage tank can then be used to refill the spent fuel pool.
- Connection for local loads to support operation of the ancillary generator (lighting and fuel tank heating).
- Temporary connection for a test load device (e.g., load resistor).

See Figure 8.3.1-3 for connections to post-72-hour loads.

8.3.1.1.1.1 Electric Circuit Protection

Protective relay schemes and direct acting trip devices on circuit breakers:

- Provide safety of personnel
- Minimize damage to equipment
- Minimize system disturbances
- Isolate faulted equipment and circuits from unfaulted equipment and circuits
- Maintain (selected) continuity of the power supply

Major types of protection systems employed for AP600 include the following:

Medium Voltage Switchgear

Differential Relaying

Each medium voltage switchgear bus is provided with a bus differential relay (device 87B) to protect against a bus fault. The actuation of this relay initiates tripping of the source incoming circuit breaker and all branch circuit load breakers. The differential protection scheme employs high-speed relays.

Motors rated 1500 hp and above are generally provided with a high dropout overcurrent relay (device 50D) for differential protection.

Overcurrent Relaying

To provide backup protection for the buses, the source incoming circuit breakers are equipped with an inverse time overcurrent protection on each phase and a residually connected inverse time ground overcurrent protection.

Each medium voltage motor feeder breaker is equipped with a motor protection relay which provides protection against various types of faults (phase and ground) and abnormal conditions such as locked rotor and phase unbalance. Motor overload condition is annunciated in the main control room.

Each medium voltage power feeder to a 480 V load center has multifunction relay. The relay provides overcurrent protection on each phase for short circuit and overload, and an instantaneous overcurrent protection for ground fault.

Undervoltage Relaying

Medium voltage buses are provided with a set of three undervoltage relays (device 27B) which trip motor feeder circuit breakers connected to the bus upon loss of bus voltage using two-out-of-three logic to prevent spurious actuation. In addition, a protective device is provided on the line side of incoming supply breakers of buses ES1 and ES2 to initiate an

alarm in the main control room if a sustained low or high voltage condition occurs on the utility supply system. The alarm is provided so that the operator can take appropriate corrective measures.

480-V Load Centers

Each motor-feeder breaker in load centers is equipped with a trip unit which has long time, instantaneous, and ground fault tripping features. Overload condition of motors is annunciated in the main control room.

The circuit breakers feeding the 480V motor control centers and other nonmotor loads have long time, short time, and ground fault tripping features.

Each load center bus has an undervoltage relay which initiates an alarm in the main control room upon loss of bus voltage.

Load center transformers have transformer winding temperature relays (device 49T) which give an alarm on transformer overload.

480-V Motor Control Center

Motor control center feeders for low-voltage (460 V) motors have molded case circuit breakers (magnetic or motor circuit protectors) and motor starters. Motor starters are provided with thermal units (overload heaters) or current sensors. Other feeders have molded case circuit breakers with thermal and magnetic trip elements for overload and short circuit protection.

Non-Class 1E ac motor operated valves are protected by thermal overload devices. Thermal overload devices are selected and sized so as to provide the necessary protection while minimizing the probability of spurious interruptions of valve actuation.

8.3.1.1.2 Standby AC Power Supply

8.3.1.1.2.1 Onsite Standby Diesel Generators

Two onsite standby diesel generator units, each furnished with its own support subsystems, provide power to the selected plant nonsafety-related ac loads. Power supplies to each diesel generator subsystem components are provided from separate sources to maintain reliability and operability of the onsite standby power system. These onsite standby diesel generator units and their associated support systems are classified as AP600 Class D, defense-in-depth systems.

The onsite standby diesel generator function to provide a backup source of electrical power to onsite equipment needed to support decay heat removal operation during reduced reactor

coolant system inventory, midloop, operation is identified as an RTNSS-significant function (Reference 14).

Each of the generators is directly coupled to the diesel engine. Each diesel generator unit is an independent self-contained system complete with necessary support subsystems that include:

- Diesel engine starting subsystem
- Combustion air intake and engine exhaust subsystem
- Engine cooling subsystem
- Engine lubricating oil subsystem
- Engine speed control subsystem
- Generator, static exciter, generator protection, monitoring instruments and controls subsystems

The diesel-generator starting air subsystem consists of an ac motor-driven, air-cooled compressor, a compressor inlet air filter, an air-cooled aftercooler, an in-line air filter, refrigerant dryer (with dewpoint at least 10°F less than the lowest normal diesel generator room temperature), and an air receiver with sufficient storage capacity for three diesel engine starts. The starting air subsystem will be consistent with manufacturer's recommendations regarding the devices to crank the engine, duration of the cranking cycle, the number of engine revolutions per start attempt, volume and design pressure of the air receivers, and compressor size. The interconnecting stainless steel piping from the compressor to the diesel engine dual air starter system includes air filters, moisture drainers, and pressure regulators to provide clean dry compressed air at normal diesel generator room temperature for engine starting.

The diesel-generator combustion air intake and engine exhaust subsystem provides combustion air directly from the outside to the diesel engine while protecting it from dust, rain, snow and other environmental particulates. It then discharges exhaust gases from the engine to the outside of the diesel generator building more than 20 feet higher than the air intake. The combustion air circuit is separate from the ventilation subsystems and includes weather protected dry type inlet air filters piped directly to the inlet connections of the diesel engine-mounted turbochargers. The combustion air filters are capable of reducing airborne particulate material, assuming the maximum expected airborne particulate concentration at the combustion air intake. Each engine is provided with two filters as shown in Figure 8.3.1-4. A differential pressure gauge is installed across each filter to determine the need for filter replacement. The engine exhaust gas circuit consists of the engine exhaust gas discharge pipes from the turbocharger outlets to a single vertically mounted outdoor silencer which discharges to the atmosphere. Manufacturer's recommendations are considered in the design of features to

protect the silencer module and other system components from possible clogging due to adverse atmospheric conditions, such as dust storms, rain, ice, and snow.

The diesel-generator engine cooling system is an independent closed loop cooling system, rejecting engine heat through two separate roof-mounted, fan-cooled radiators. The system consists of two separate cooling loops each maintained at a temperature required for optimum engine performance by separate engine-driven coolant water circulating pumps. One circuit cools the engine cylinder block, jacket, and head area, while the other circuit cools the oil cooler and turbocharger aftercooler. The cooling water in each loop passes through a three-way self-contained temperature control valve which modulates the flow of water through or around the radiator, as necessary, to maintain required water temperature. The temperature control valve has an expanding wax-type temperature-sensitive element or equivalent. The cooling circuit, which cools the engine cylinder blocks, jacket, and head areas, includes a keep-warm circuit consisting of a temperature controlled electric heater and an ac motor-driven water circulating pump.

The diesel-generator engine lubrication system is contained on the engine skid and includes an engine oil sump, a main engine driven oil pump and a continuous engine prelube system consisting of an ac and dc motor driven prelube pump and electric heater. The prelube system maintains the engine lubrication system in service when the diesel engine is in standby mode. The lube oil is circulated through the engine and various filters and coolers to maintain the lube oil properties suitable for engine lubrication.

The diesel generator engine fuel oil system consists of an engine-mounted, engine-driven fuel oil pump that takes fuel from the fuel oil day tank, and pumps through inline oil filters to the engine fuel injectors and a separate recirculation circuit with a fuel oil cooler. The recirculation circuit discharges back to the fuel oil day tank that is maintained at the proper fuel level by the diesel fuel oil storage and transfer system.

The onsite standby diesel generators are provided with necessary controls and indicators for local or remote monitoring of the operation of the units. Essential parameters are monitored and alarmed in the main control room via the plant data display and processing system as described in Chapter 7. Indications and alarms that will be available locally and in the main control room are listed in Table 8.3.1-5.

The design of the onsite standby diesel generators does not ensure functional operability or maintenance access or support plant recovery following design basis events. Maintenance accessibility is provided consistent with the system nonsafety-related functions and plant availability goals.

The piping and instrumentation diagrams for the onsite standby diesel generator units and the associated subsystems are shown on Figures 8.3.1-4 and 8.3.1-5.

The onsite standby power supply system is shown schematically on one line diagram, Figure 8.3.1-1.

The onsite diesel generators will be procured in accordance with an equipment specification which will include requirements based upon the manufacturer's standards and applicable recommendations from documents such as NUREG/CR-0660 (Reference 15). Capability to detect system leakage and to prevent crankcase explosions will be based upon manufacturer's recommendations. Control of moisture in the starting air system by the equipment described above will be based upon manufacturer's recommendations. Dust and dirt in the diesel generator room is controlled by the diesel generator building ventilation system described in subsection 9.4.10. Personnel training is addressed as part of overall plant training in subsection 13.2.1. Automatic engine prelube by the equipment described above will be based upon manufacturer's recommendations. Testing, test loading and preventive maintenance is addressed as part of overall plant testing and maintenance in Chapter 13. Instrumentation to support diagnostics during operation are shown on Figure 8.3.1-4. The overall diesel building ventilation design is described in subsection 9.4.10 and the combustion air systems are described above. The fuel oil storage and handling system is described in subsection 9.5.4. High temperature insulation will be based upon manufacturer's recommendations. Response to the effects of engine vibration will be based upon manufacturer's recommendations. Diesel building floor coatings are described in subsections 6.1.2.1.4 and 6.1.3.2. The diesel generators will be procured to be consistent with the diesel generator building HVAC system described in subsection 9.4.10.

8.3.1.1.2.2 Generator

Each generator is a direct-shaft driven, air-cooled self ventilated machine. The generator enclosure is open drip-proof type that facilitates free movement of ventilation air. The generator component design is in compliance with the NEMA MG-1 (Reference 1) requirements.

Each generator produces its rated power at 4160 V, 60 Hz. Each generator continuous rating is based on supplying the electrical ac loads listed in Tables 8.3.1-1 or 8.3.1-2. The loads shown on Tables 8.3.1-1 and 8.3.1-2 represent a set of nonsafety-related loads which provide shutdown capability using nonsafety-related systems. The generators can also provide power for additional investment protection ac loads. The plant operator would normally provide power to these loads by deenergizing one of those system components that are redundantly supplied by both the diesel generators. The diesel generator design is compatible with the step loading requirements identified in Tables 8.3.1-1 and 8.3.1-2. The generator exciter and voltage regulator systems are capable of providing full voltage control during operating conditions including postulated fault conditions.

Each generator has a set of potential and current transformers for protective relaying and metering purposes.

The following generator protection functions are provided via relays that are mounted on the local generator control panel:

Differential (87), overcurrent (50/51), reverse power (32), underfrequency (81), under/over voltage (27/59), loss of excitation (40), ground fault (51g), negative sequence (46), synchronization check (25), voltage balance (60).

Note: The number in the parentheses identifies the ANSI device designation.

8.3.1.1.2.3 Onsite Standby Power System Performance

The onsite standby power system provides reliable ac power to the various plant system electrical loads shown on Tables 8.3.1-1 and 8.3.1-2. These loads represent system components that enhance an orderly plant shutdown under emergency conditions. Additional loads that are for investment protection can be manually loaded on the standby power supply after the loads required for orderly shutdown have been satisfied. The values listed in the "Operating Load (kW)" column of Tables 8.3.1-1 and 8.3.1-2 represent nominal values of the actual plant loads.

Both the diesel engine and the associated generator are rated based on 104°F ambient temperature at 1000 ft elevation as standard site conditions. The selected unit rating has a design margin to accommodate possible derating resulting from other site conditions.

The diesel generator unit is able to reach the rated speed and voltage and be ready to accept electrical loads within 120 seconds after a start signal.

Each generator has an automatic load sequencer to enable controlled loading on the generator. The automatic load sequencer connects selected loads at predetermined intervals. This feature allows recuperation of generator voltage and frequency to rated values prior to the connection of the next load.

For sequential and manual loading of the onsite standby diesel generator, see Tables 8.3.1-1 and 8.3.1-2.

To enable periodic testing, each generator has synchronizing equipment at a local panel as well as in the main control room.

The logic diagram for diesel generator initiating circuit is shown in Figure 8.3.1-2.

8.3.1.1.3 Ancillary ac Diesel Generators

Power for Class 1E post-accident monitoring, MCR lighting, MCR and divisions B and C I&C room ventilation and for refilling the PCS water storage tank when no other sources of power are available is provided by two ancillary ac diesel generators located in the annex building. The ancillary generators are not needed for refilling the PCS water storage tank, post-accident monitoring or lighting for the first 72 hours following a loss of all other ac sources and are not needed for spent fuel pool makeup for the first 7 days following the loss of all other ac sources.

The generators are classified as AP600 Class D. The generators are commercial, skid-mounted, packaged units and can be easily replaced in the event of a failure. Generator control is manual from a control integral with the diesel skid package. These generators are

located in the portion of the Annex Building that is a Seismic Category II structure. Features of this structure which protect the function of the ancillary generators are analyzed and designed for Category 5 hurricanes, including the effects of sustained winds, maximum gusts, and associated wind-borne missiles.

The fuel for the ancillary generators is stored in a tank located in the same room as the generators. The tank is Seismic Category II and holds sufficient fuel for 4 days of operation.

8.3.1.1.4 Electrical Equipment Layout

The main ac power system distributes ac power to the reactor, turbine, and balance of plant (BOP) auxiliary electrical loads for startup, normal operation, and normal/emergency shutdown.

The medium voltage switchgear ES1, ES2, ES5, and ES6 are located in the electrical switchgear rooms 1 and 2 of the annex building. The incoming power is supplied from the unit auxiliary transformers ET2A and ET2B (X windings) via nonsegregated buses. The nonsegregated buses are routed from the transformer yard to the annex building in the most direct path practical.

The switchgear ES3, ES4, ES7, and ES8 are located in the turbine building electrical room. The incoming power is supplied from the unit auxiliary transformers ET2A and ET2B (Y windings) via nonsegregated buses.

The Class 1E medium voltage circuit breakers, ES51 through ES54 and ES61 through ES64, for four reactor coolant pumps are located in the auxiliary building.

The 480 V load centers are located in the turbine building electrical room and in the annex building electrical switchgear rooms 1 and 2 based on the proximity of loads and the associated 4.16 kV switchgear.

The 480 V motor control centers are located throughout the plant to effectively distribute power to electrical loads. The load centers and motor control centers are free standing with top or bottom cable entry and front access. The number of stacks/cubicles vary for each location.

8.3.1.1.5 Heat Tracing System

The electric heat tracing system is nonsafety-related and provides electrical heating where temperature above ambient is required for system operation and freeze protection.

The electric heat tracing system is part of the AP600 permanent nonsafety-related loads and is powered from the diesel backed 480 V ac motor control centers through 480 V - 208Y/120V transformers and distribution panels.

8.3.1.1.6 Containment Building Electrical Penetrations

The electrical penetrations are in accordance with IEEE 317 (Reference 2).

The penetrations conform to the same functional service level as the cables, (for example, low-level instrumentation is in a separate nozzle from power and control). The same separation requirements apply within inboard/outboard terminal boxes.

Individual electrical penetrations are provided for each electrical service level and follows the same raceway voltage grouping described in subsection 8.3.1.3.4. For modular-type penetrations (three penetration modules in one nozzle), it is permissible to assign:

- One module for low voltage power
- One module for 120/125V control and signal
- One module for instrumentation signal

It is possible to combine low voltage power with 120/125V control in the same module.

Penetrations carrying medium voltage power cables have thermocouples to monitor the temperature within the assembly at the spot expected to have the hottest temperature.

Electrical circuits passing through electrical penetrations have primary and backup protective devices. These devices coordinate with the thermal capability curves (I^2t) of the penetration assemblies. The penetrations are rated to withstand the maximum short-circuit currents available either continuously without exceeding their thermal limit, or at least longer than the field cables of the circuits so that the fault or overload currents are interrupted by the protective devices prior to a potential failure of a penetration. Penetrations are protected for the full range of currents up to the maximum short circuit current available.

Primary and backup protective devices protecting Class 1E circuits are Class 1E in accordance with IEEE 741 (Reference 10). Primary and backup protective devices protecting non-Class 1E circuits are non-Class 1E.

Penetration overcurrent protection coordination curves are generated based on the protection requirements specified by the penetration equipment manufacturer. When necessary, penetrations are protected for instantaneous overcurrent by current limiting devices such as current-limiting fuses, current-limiting breakers, or reactors.

8.3.1.1.7 Grounding System

The AP600 grounding system will comply with the guidelines provided in IEEE Standard 665-1987, "Guide for Generating Station Grounding." The grounding system consists of the following four subsystems:

- Station grounding grid

- System grounding
- Equipment grounding
- Instrument/computer grounding

The station grounding grid subsystem consists of buried, interconnected bare copper conductors and ground rods (Copperweld) forming a plant ground grid matrix. The subsystem will maintain a uniform ground potential and limit the step-and-touch potentials to safe values under all fault conditions.

The system grounding subsystem provides grounding of the neutral points of the main generator, main stepup transformers, auxiliary transformers, load center transformers, and onsite standby diesel generators. The main and diesel generator neutrals will be grounded through grounding transformers providing high-impedance grounding. The main stepup and load center transformer neutrals will be grounded solidly. The auxiliary (unit and reserve) transformer secondary winding neutrals will be resistance grounded.

The equipment grounding subsystem provides grounding of the equipment enclosures, metal structures, metallic tanks, ground bus of switchgear assemblies, load centers, MCCs, and control cabinets with two ground connections to the station ground grid.

The instrument/computer grounding subsystem provides plant instrument/computer grounding through separate radial grounding systems consisting of isolated instrumentation ground buses and insulated cables. The radial grounding systems are connected to the station grounding grid at one point only and are insulated from all other grounding circuits.

The design of the grounding grid system and the lightning protection system depends on the soil resistivity and lightning activity in the area. Therefore, the design of both systems is site-specific and is the responsibility of the combined license applicant.

8.3.1.1.8 Lightning Protection

The lightning protection system, consisting of air terminals and ground conductors, will be provided for the protection of exposed structures and buildings housing safety-related and fire protection equipment in accordance with Lightning Protection Code NFPA 780-1992. Also, lightning arresters are provided in each phase of the transmission lines and at the high-voltage terminals of the outdoor transformers. The isophase bus connecting the main generator and the main transformer and the medium-voltage switchgear is provided with lightning arresters. In addition, surge suppressors are provided to protect the plant instrumentation and monitoring system from lightning-induced surges in the signal and power cables connected to devices located outside.

Direct-stroke lightning protection for facilities is accomplished by providing a low-impedance path by which the lightning stroke discharge can enter the earth directly. The direct-stroke lightning protection system, consisting of air terminals, interconnecting cables, and down conductors to ground, are provided external to the facility in accordance with the guidelines

included in NFPA 780. The system is connected directly to the station ground to facilitate dissipation of the large current of a direct lightning stroke. The lightning arresters and the surge suppressors connected directly to ground provide a low-impedance path to ground for the surges caused or induced by lightning. Thus, fire or damage to facilities and equipment resulting from a lightning stroke is avoided.

The design of direct-stroke lightning protection and the associated grounding depends on the lightning activity at the plant site and the soil resistivity of the ground. It is site specific and is the responsibility of the Combined License applicant.

8.3.1.2 Analysis

The ac power system is non-Class 1E and is not required for safe shutdown. Compliance with existing regulatory guides and General Design Criteria is covered in Table 8.1-1 of Section 8.1.

8.3.1.3 Raceway/Cable

8.3.1.3.1 General

The raceway system for non-Class 1E ac circuits complies with IEEE 422 (Reference 3) in respect to installation and support of cable runs between electrical equipment including physical protection. Raceway systems consist primarily of cable tray and wireway.

8.3.1.3.2 Load Groups Segregation

There are two nonsafety-related load groups associated with different transformers, buses, and onsite standby diesel generators. No physical separation is required as these two ac load groups are non-Class 1E and nonsafety-related.

8.3.1.3.3 Cable Derating and Cable Tray Fill

Cable Derating

The power and control cable insulation is designed for a conductor temperature of 90°C. The allowable current carrying capacity of the cable is based on the insulation design temperature while the surrounding air is at an ambient temperature of 65°C for the containment and 40 to 50°C for other areas. Power cables, feeding loads from switchgear, load centers, motor control centers, and distribution panels are sized at 125 percent of the full-load current at a 100-percent load factor.

The power cable ampacities are in accordance with the Insulated Cable Engineers Association publications (References 4 and 11), and National Electric Code (Reference 5). The derating is based on the type of installation, the conductor and ambient temperature, the number of cables in a raceway, and the grouping of the raceways. A further derating of the cables is

applied for those cables which pass through a fire barrier. The method of calculating these derating factors is determined from the Insulated Cable Engineers Association publications and other applicable standards.

Instrumentation cable insulation is also designed for a conductor temperature of 90°C. The operating power of these cables is low (usually mV or mA) and does not cause cable overheating at the maximum design ambient temperature.

For circuits that are routed partly through conduit and partly through trays or underground ducts, the cable size is based on the ampacity in that portion of the circuit with the lowest indicated current carrying capacity.

Cable Tray Fill

Cable tray design is based on random cable fill of 40 percent of usable tray depth. If tray fill exceeds the above stated maximum fill, tray fill will be analyzed and the acceptability documented.

Conduit fill design is in compliance with Tables 1, 2, 3, and 4 of Chapter 9, National Electrical Code (Reference 5).

8.3.1.3.4 Raceway and Cable Routing

When cable trays are arranged in a vertical array they are arranged physically from top to bottom, in accordance with the function and voltage class of the cables as follows:

- Medium voltage power (4.16 kV)
- Low voltage power (480 Vac, 120 Vac, 125 Vdc)
- 120 Vac/125 Vdc signal and control (if used)
- Instrumentation (analog and digital)

480 Vac power cables may be mixed with 120 Vac/125 Vdc signal and control cables.

Separate raceways are provided for medium voltage power, low voltage power and control, as well as instrumentation cables.

Non-Class 1E raceways and supports installed in seismic Category I structures are designed and/or physically arranged so that the safe shutdown earthquake could not cause unacceptable structural interaction or failure of seismic Category I components.

Raceways are kept at a reasonable distance from heat sources such as steam piping, steam generators, boilers, high and low pressure heaters, and any other actual or potential heat source. Cases of heat source crossings are evaluated and supplemental heat shielding is used if necessary.

For Class 1E raceway and cable routing see subsection 8.3.2.

8.3.1.4 Inspection and Testing

Preoperational tests are conducted to verify proper operation of the ac power system. The preoperational tests include operational testing of the diesel load sequencer and diesel generator capacity testing.

8.3.1.4.1 Diesel Load Sequencer Operational Testing

The load sequencer for each standby diesel generator is tested to verify that it produces the appropriate sequencing signals within five (5) seconds of the times specified in Table 8.3.1-1 and 8.3.1-2. The five second margin is sufficient for proper diesel generator transient response.

8.3.1.4.2 Standby Diesel Generator Capacity Testing

Each standby diesel generator is tested to verify the capability to provide 3800 MW while maintaining the output voltage and frequency within the design tolerances of $4160 \pm 10\%$ Vac and $60 \pm 5\%$ Hz. The 3800 MW capacity is sufficient to meet the loads listed in Tables 8.3.1-1 and 8.3.1-2. The test duration will be the time required to reach engine temperature equilibrium plus 2.5 hours. This duration is sufficient to demonstrate long-term capability.

8.3.1.4.3 Ancillary Diesel Generator Capacity Testing

Each ancillary diesel generator is tested to verify the capability to provide 24 kW while maintaining the output voltage and frequency within the design tolerances of $480 \pm 10\%$ Vac and $60 \pm 5\%$ Hz. The 24 kW capacity is sufficient to meet the loads listed in Table 8.3.1-4. The test duration will be the time required to reach engine temperature equilibrium plus 2.5 hours. This duration is sufficient to demonstrate long-term capability.

8.3.2 DC Power Systems

8.3.2.1 Description

The plant dc power system is comprised of independent Class 1E and non-Class 1E dc power systems. Each system consists of ungrounded stationary batteries, dc distribution equipment, and uninterruptible power supply (UPS).

The Class 1E dc and UPS system provides reliable power for the safety-related equipment required for the plant instrumentation, control, monitoring, and other vital functions needed for shutdown of the plant. In addition, the Class 1E dc and UPS system provides power to the normal and emergency lighting in the main control room and in the remote shutdown workstation area.

The Class 1E dc and UPS system is capable of providing reliable power for the safe shutdown of the plant without the support of battery chargers during a loss of all ac power sources coincident with a design basis accident (DBA). The system is designed so that no single failure will result in a condition that will prevent the safe shutdown of the plant.

The non-Class 1E dc and UPS system provides continuous, reliable electric power to the plant non-Class 1E control and instrumentation loads and equipment that are required for plant operation and investment protection and to the hydrogen igniters located inside containment. Operation of the non-Class 1E dc and UPS system is not required for nuclear safety. See subsection 8.3.2.1.2.

The batteries for the Class 1E and non-Class 1E dc and UPS systems are sized in accordance with IEEE 485 (Reference 6). The operating voltage range of the batteries is 105 to 140 Vdc. The maximum equalizing charge voltage for batteries is 140 Vdc. The nominal system voltage is 125 Vdc.

8.3.2.1.1 Class 1E DC and UPS System

8.3.2.1.1.1 Class 1E DC Distribution

The Class 1E dc distribution is in compliance with applicable General Design Criteria, IEEE standards, and Regulatory Guides listed in subsection 8.1.4.3. The scope of compliance encompasses physical separation, electrical isolation, equipment qualification, effects of single active component failure, capacity of battery and battery charger, instrumentation and protective devices, and surveillance test requirements. The Class 1E dc components are housed in seismic Category I structures. For system configuration and equipment rating, see Class 1E dc one-line diagram, Figure 8.3.2-1. Nominal ratings of major Class 1E dc equipment are listed in Table 8.3.2-5.

There are four independent, Class 1E 125 Vdc divisions, A, B, C, and D. Divisions A and D are each comprising one battery bank, one switchboard, and one battery charger. The battery bank is connected to Class 1E dc switchboard through a set of fuses and a disconnect switch. Divisions B and C are each composed of two battery banks, two switchboards, and two battery chargers. The first battery bank in the four divisions, designated as 24-hour battery bank, provides power to the loads required for the first 24 hours following an event of loss of all ac power sources concurrent with a design basis accident (DBA). The second battery bank in divisions B and C, designated as 72-hour battery bank, is used for those loads requiring power for 72 hours following the same event. Each switchboard connected with a 24-hour battery bank supplies power to an inverter, a 125 Vdc distribution panel, and a 125 Vdc motor control center. Each switchboard connected with a 72 hour battery bank supplies power to an inverter. No load shedding or load management program is needed to maintain power during the required safety actuation periods.

A single spare battery bank with a spare battery charger is provided for the Class 1E dc and UPS system. In the case of a failure or unavailability of the normal battery bank and the

battery charger, permanently installed cable connections allow the spare to be connected to the affected bus by plug-in locking type disconnect along with kirk-key interlock switches. The plug-in locking type disconnect and kirk-key interlock switches permit connection of only one battery bank and battery charger at a time so that the independence of each battery division is preserved. The spare battery and the battery charger can also be utilized as a substitute when offline testing, maintenance and equalization of an operational battery bank is desired.

Each 125 Vdc Class 1E battery division and the spare battery bank are separately housed as described in subsection 8.3.2.1.3.

Each battery bank, including the spare, has a battery monitor system that detects battery open-circuit conditions and monitors battery voltage. The battery monitor provides a trouble alarm in the main control room. The battery monitors are not required to support any safety-related function. Monitoring and alarming of dc current and voltages is through the plant control system which includes a battery discharge rate alarm. AP600 generally uses fusible disconnect switches in the Class 1E dc system. If molded-case circuit breakers are used for dc applications, they will be sized to meet the dc interrupting rating requirements.

The Class 1E dc switchboards employ fusible disconnect switches and have adequate short circuit and continuous-current ratings. The main bus bars are braced to withstand mechanical forces resulting from a short-circuit current. Fused transfer switch boxes, equipped with double pole double throw transfer switches, are provided to facilitate battery testing, and maintenance.

Battery chargers are connected to dc switchboard buses. The input ac power for the Class 1E dc battery chargers is supplied from non-Class 1E 480 Vac diesel generator backed motor control centers. The battery chargers provide the required isolation between the non-1E ac and the Class 1E dc electrical systems. The battery chargers are qualified as isolation devices in accordance with IEEE 384 (Reference 7) and Regulatory Guide 1.75. Each battery charger has an input ac and output dc circuit breaker for the purpose of power source isolation and required protection. Each battery charger prevents the ac supply from becoming a load on the battery due to a power feedback as a result of the loss of ac power to the chargers. Each battery charger has a built-in current limiting circuit, adjustable between 110 to 125 percent of its rating to hold down the output current in the event of a short circuit or overload on the dc side. The output of the charger is ungrounded and filtered. The output float and equalizing voltages are adjustable. The battery chargers have an equalizing timer and a manual bypass switch to permit periodic equalizing charges. Each charger is capable of providing the continuous demand on its associated dc system while providing sufficient power to charge a fully discharged battery (as indicated by the nominal load requirements in Tables 8.3.2-1 through 8.3.2-4) within a 24-hour period. The battery chargers are provided with a common failure/trouble alarm.

The Class 1E dc motor control centers operate at 125 Vdc nominal two wire, ungrounded system. The dc motor control centers provide branch circuit protection for the dc motor-

operated valves. Motor-operated valves are protected by thermal overload devices in accordance with Regulatory Guide 1.106. Motor overload condition is annunciated in the main control room. The loads fed from the motor control centers are protected against a short-circuit fault by fusible disconnect switches. Reduced-voltage motor controllers limit the starting current to approximately 250 percent of rated current for motors equal to or larger than 5 HP.

The Class 1E dc distribution panels provide power distribution and tripping capability between the 125 Vdc power sources and the assigned safeguard loads indicated on Figure 8.3.2-1.

8.3.2.1.1.2 Class 1E Uninterruptible Power Supplies

The Class 1E UPS provides power at 208 Y/120 Vac to four independent divisions of Class 1E instrument and control power buses. Divisions A and D each consist of one Class 1E inverter associated with an instrument and control distribution panel and a backup voltage regulating transformer with a distribution panel. The inverter is powered from the respective 24-hour battery bank switchboard. Divisions B and C each consist of two inverters, two instrument and control distribution panels, and a voltage regulating transformer with a distribution panel. One inverter is powered by the 24-hour battery bank switchboard and the other by the 72-hour battery bank switchboard. For system configuration and equipment rating, see Figures 8.3.2-1 and 8.3.2-2. The nominal ratings of the Class 1E inverters and the voltage regulating transformers are listed in Table 8.3.2-5. Under normal operation, the Class 1E inverters receive power from the associated battery bank. If an inverter is inoperable or the Class 1E 125 Vdc input to the inverter is unavailable, the power is transferred automatically to the backup ac source by a static transfer switch featuring a make-before-break contact arrangement. The backup power is received from the diesel generator backed non-Class 1E 480 Vac bus through the Class 1E voltage regulating transformer. In addition, a manual mechanical bypass switch is provided to allow connection of backup power source when the inverter is removed from service for maintenance.

In order to supply power during the post-72-hour period following a design basis accident, provisions are made to connect an ancillary ac generator to the Class 1E voltage regulating transformers (divisions B and C only). This powers the Class 1E post-accident monitoring systems and the lighting in the main control room and ventilation in the MCR and divisions B and C I&C rooms. See subsection 8.3.1.1.1 for post-72-hour power distribution details, subsection 9.4.1 for post-72-hour ventilation, and subsection 9.5.3 for post-72-hour lighting details respectively.

8.3.2.1.2 Non-Class 1E DC and UPS System

The non-Class 1E dc and UPS system consists of the electric power supply and distribution equipment that provide dc and uninterruptible ac power to the plant non-Class 1E dc and ac loads that are critical for plant operation and investment protection and to the hydrogen igniters located inside containment. The non-class 1E dc and UPS system is comprised of two subsystems representing two separate power supply trains. The subsystems are located in

separate rooms in the annex building. Figure 8.3.2-3, non-Class 1E dc and UPS system one line diagram represents the distribution configuration.

Each subsystem consists of separate dc distribution buses. These two buses can be connected by a normally open circuit breaker to enhance the power supply source availability.

Each dc subsystem includes battery chargers, stationary batteries, dc distribution equipment, and associated monitoring and protection devices.

DC buses 1, 2, and 3 (See Figure 8.3.2-3) provide 125 Vdc power to the associated inverter units that supply the ac power to the non-Class 1E uninterruptible power supply ac system. An alternate regulated ac power source for the UPS buses is supplied from the associated regulating transformers. DC bus 4 supplies large dc motors and other dc panel loads but not inverter loads. This configuration helps prevent the large motor starting disturbances affecting the sensitive electronics equipment fed from the inverters.

The onsite standby diesel generator backed 480 Vac distribution system provides the normal ac power to the battery chargers. Industry standard stationary batteries that are similar to the Class 1E design are provided to supply the dc power source in case the battery chargers fail to supply the dc distribution bus system loads. The batteries are sized to supply the system loads for a period of at least two hours after loss of all ac power sources.

The dc distribution switchboard houses the dc feeder protection device, dc bus ground fault detection, and appropriate metering. The component design and the current interrupting device selection follows the circuit coordination principles.

Each non-Class 1E dc distribution subsystem bus has provisions to allow the connection of a spare non-Class 1E battery charger should its non-Class 1E battery charger be unavailable due to maintenance, testing, or failure.

The non-Class 1E dc system uses the Class 1E spare battery bank (Figure 8.3.2-1) as a temporary replacement for any primary non-Class 1E battery bank. In this design configuration, the spare Class 1E battery bank would be connected to the non-Class 1E dc bus but could not simultaneously supply Class 1E safety loads nor perform safety-related functions. Additionally, the design includes two current interrupting devices placed in series with the main feed from the spare battery that are fault-current activated. This will preserve the spare Class 1E battery integrity should the non-Class 1E bus experience an electrical fault. This arrangement will not degrade the electrical independence of the Class 1E safety circuits.

8.3.2.1.3 Separation and Ventilation

For the Class 1E dc system, the 24-hour and the 72-hour battery banks are housed in the auxiliary building in ventilated rooms apart from chargers and distribution equipment. The battery rooms are ventilated to limit hydrogen accumulation. Subsection 9.4.1 describes the ventilation system in the battery rooms. Each of the four divisions of dc systems are

electrically isolated and physically separated to prevent an event from causing the loss of more than one division.

8.3.2.1.4 Maintenance and Testing

Components of the 125 Vdc systems undergo periodic maintenance tests to determine the condition of the system. Batteries are checked for electrolyte level, specific gravity, and cell voltage, and are visually inspected.

The surveillance testing of the Class 1E 125 Vdc system is performed as required by the Technical Specifications.

8.3.2.2 Analysis

Compliance with General Design Criteria (GDC) and Regulatory Guides is discussed in Sections 3.1 and 1.9, respectively. Refer to Table 8.1-1 of Section 8.1 for guidelines and applicability of GDC, Regulatory Guides and IEEE Standards. A failure modes and effects analysis for the Class 1E dc and UPS system is provided in Table 8.3.2-7.

In the event of a loss of offsite power coincident with a main generator trip, ac power to the battery charger is provided from two separate non-Class 1E onsite standby diesel generators. Divisions A and C chargers receive their ac power from one diesel generator, ZOS MG 02A, and division B and D chargers from the second diesel generator, ZOS MG 02B. Provisions are also made to power the post accident monitoring systems and the main control room lighting loads in divisions B and C from ancillary ac generators during the post 72-hour period as described in subsection 8.3.2.1.1.2.

The Class 1E battery chargers and Class 1E voltage regulating transformers are designed to limit the input (ac) current to an acceptable value under faulted conditions on the output side. They have built-in circuit breakers at the input and output sides for protection and isolation. The circuit breakers are coordinated and periodically tested to verify their current-limiting characteristics. They are qualified as isolation devices between Class 1E and non-Class 1E circuits in accordance with IEEE 384 and Regulatory Guide 1.75.

The four divisions are independent, located in separate rooms, cannot be interconnected, and their circuits are routed in dedicated, physically separated raceways. This level of electrical and physical separation prevents the failure or unavailability of a single battery, battery charger, or inverter from affecting adversely a redundant division.

The Class 1E dc and UPS system is designed in accordance with IEEE 308 (Reference 8) and IEEE 946 (Reference 9). Important system component failures are annunciated. The battery monitoring system detects battery open circuit condition and monitors battery voltage. The Class 1E 208Y/120Vac distribution panels are equipped with undervoltage protection. The set of fuses located in the 125 Vdc switchboards provide selective tripping of circuits for a fault to limit the effects of the abnormal condition, minimize system disturbance and protect

the battery from complete accidental discharge through a short circuit fault. The Class 1E dc system is ungrounded, thus, a single ground fault does not cause immediate loss of the faulted system. Ground detections with alarms are provided for each division of power so that ground faults can be located and removed before a second ground fault could disable the affected circuit. A spare battery bank and charger enables testing, maintenance, and equalization of battery banks offline. This configuration provides the capability for each battery bank or battery charger to be separately tested and maintained (including battery discharge tests, battery cell replacement, battery charger replacement) without limiting continuous plant operation at 100-percent power.

Short circuit analyses will be performed in accordance with IEEE 946 (reference 9) and/or other acceptable industry standards or practices to determine fault currents. Circuit interrupting device coordination analyses will be performed in accordance with IEEE 141, 242 (References 16 and 17), and/or other acceptable industry standards or practices.

8.3.2.3 Physical Identification of Safety-Related Equipment

Each safety-related circuit and raceway is given a unique identification number to distinguish between circuits and raceways of different voltage level or separation groups. Each raceway is color coded with indelible ink, paint, or adhesive markers (adhesive markers are not used in the containment) at intervals of 15 feet or less along the length of the raceway and on both sides of floor or wall penetrations. Each cable is color coded at a maximum of 5 feet intervals along the length of the cable and cable markers showing the cable identification number are applied at each end of the cable.

The following color coding is used for identification purposes:

<u>Division</u>	<u>Color Code</u>
A	Brown
B	Green
C	Blue
D	Yellow

8.3.2.4 Independence of Redundant Systems

8.3.2.4.1 General

The routing of cable and the design of raceways prevents a single credible event from disabling a redundant safety-related plant function.

8.3.2.4.2 Raceway and Cable Routing

There are five separation groups for the cable and raceway system: group A, B, C, D, and N. Separation group A contains safety-related circuits from division A. Similarly, separation

group B contains safety-related circuits from division B; group C from division C; group D from division D; and group N from nonsafety-related circuits.

Cables of one separation group are run in separate raceway and physically separated from cables of other separation groups. Group N raceways are separated from safety-related groups A, B, C and D. Raceways from group N are routed in the same areas as the safety-related groups according to spatial separation stipulated in Regulatory Guide 1.75 and IEEE 384 with the following exceptions:

- Within the main control room and remote shutdown area (nonhazard areas), the minimum vertical separation for open top cable tray is 3 inches and the minimum horizontal separation is 1 inch.
- Within general plant areas (limited hazard areas), the minimum vertical separation is 12 inches, and the minimum horizontal separation is 6 inches for open top cable trays with low-voltage power circuits for cable sizes <2/0 AWG. For configurations that involve exclusively limited energy content cables (instrumentation and control), these minimum distances are reduced to 3 inches and 1 inch respectively.
- Within panels and control switchboards, the minimum horizontal separation between components or cables of different separation groups (both field-routed and vendor-supplied internal wiring) is 1 inch, and the minimum vertical separation distance is 6 inches.
- For configurations involving an enclosed raceway and an open raceway, the minimum vertical separation is 1 inch if the enclosed raceway is below the open raceway.

The exceptions to the guidance in Regulatory Guide 1.75 are based on test results used to support exceptions to the separation guidance for operating nuclear power plants. A summary of test results from ten electrical separation test programs is documented in Reference 13. These test programs support the AP600 exceptions.

Non-Class 1E circuits are electrically isolated from Class 1E circuits, and Class 1E circuits from different separation groups are electrically isolated by isolation devices, shielding and wiring techniques, physical separation (in accordance with Regulatory Guide 1.75 for circuits in raceways), or an appropriate combination thereof.

When isolation devices are used to isolate Class 1E circuits from non-Class 1E circuits, the circuits within or from the Class 1E equipment or devices are identified as Class 1E and are treated as such. Beyond the isolation device(s) these circuits are identified as non-Class 1E and are separated from Class 1E circuits in accordance with the above separation criteria.

Power and control cables are installed in conduits, solid bottom trays, or ventilated bottom trays (ladder-type). Solid tray covers are used in outdoor locations and indoors where trays run in areas where falling debris is a problem. Instrumentation cables are routed in conduit

or solid bottom cable tray with solid tray covers as required. The cables are derated for specific application in the location where they are installed as stated in subsection 8.3.1.3.3. The environmental design of electrical equipment including Class 1E cables under normal and abnormal operating conditions is discussed in Section 3.11.

Separate trays are provided for each voltage service level: 4.16 kV, low voltage power (480 Vac, 120 Vac, 125 Vdc), high-level signal and control (120 Vac, 125 Vdc), and low level signal (instrumentation). A tray designed for a single class of cables shall contain only cables of the same class except that low voltage power cables may be routed in raceways with high level signal and control cables if their respective sizes do not differ greatly and if they have compatible operating temperatures. When this is done in trays, the power cable ampacity is calculated as if all cables in the tray are power cable. Low voltage power cable and high level signal and control cable will not be routed in common raceways if the fault current, within the breaker or fuse clearing time, is sufficient to heat the insulation to the ignition point. Vertically stacked trays are arranged from top to bottom as stated in subsection 8.3.1.3.4. In general, a minimum of 12 inches vertical spacing is maintained between trays of different service levels within the stack.

The electrical penetrations are in accordance with IEEE 317 (Reference 2). Class 1E and non-Class 1E electrical penetration assemblies are maintained in a separate nozzle. The physical separation of the Class 1E electrical penetration assemblies are in accordance with Regulatory Guide 1.75. The containment building penetrations are described in subsection 8.3.1.1.5.

Raceways installed in seismic Category I structures have seismically designed supports or are shown not to affect safety-related equipment should they fail. Trays are not attached rigidly to seismic Category I equipment. Conduits may be attached to seismic Category I equipment with flexible type connections.

8.3.2.4.3 Hazard Protection

Where redundant safety-related and nonsafety-related raceway systems traverse each other, separation in accordance with Regulatory Guide 1.75 and IEEE 384 is maintained.

Where hazards to safety-related raceways are identified, a predetermined minimum separation is maintained between the break and/or missile source and any safety-related raceway, or a barrier designed to withstand the effects of the hazard is placed to prevent damage to raceway of redundant systems. For details of missile protection and high-energy line break protection, see Sections 3.5 and 3.6, respectively.

Where redundant circuits, devices or equipment (different separation groups) are exposed to the same external hazard(s), predetermined spatial separation is provided. Where the spatial separation cannot be met, qualified barriers are installed. For details on fire protection, see subsection 9.5.1.

See Section 3.4 for protection of raceways and the associated equipment against flooding.

8.3.2.4.4 Control of Compliance with Separation Criteria during Design and Installation

The separation group identification described in subsection 8.3.2.3 provides for the maintenance of separation in the routing of cables and the connection of control boards and panels. The separation group designation on the cable or raceway is assigned to maintain compatibility with a single line diagram channel designation and other cables or raceways routed. The routing is verified during installation. Color identification of equipment and cabling (discussed in subsection 8.3.2.3) assists field personnel in this effort.

8.3.2.5 Inspection and Testing

Preoperational tests are conducted to verify proper operation of the dc power systems. The preoperational tests include MOV terminal voltage testing and capacity testing of the batteries, chargers, inverters and regulating transformers.

8.3.2.5.1 Class 1E 24-Hour Battery Capacity Testing

Each Class 1E 24-hour battery is tested to verify the capability to provide its load for 24 hours while maintaining the battery terminal voltage above the minimum voltage specified in Table 8.3.2-5. Analysis will be performed based on the design duty cycle and testing will be performed with loads which envelope the analyzed battery bank design duty cycle. Each battery is connected to a charger maintained at 135 ± 1 V for a period of at least 24 hours prior to the test to assure the battery is fully charged.

8.3.2.5.2 Class 1E 72-Hour Battery Capacity Testing

Each Class 1E 72-hour battery is tested to verify the capability to provide its load for 72 hours while maintaining the battery terminal voltage above the minimum voltage specified in Table 8.3.2-5. Analysis will be performed based on the design duty cycle and testing will be performed with loads which envelope the analyzed battery bank design duty cycle. Each battery is connected to a charger maintained at 135 ± 1 V for a period of at least 24 hours prior to the test to assure the battery is fully charged.

8.3.2.5.3 Class 1E Spare Battery Capacity Testing

The Class 1E spare battery is tested to the same requirements as the division D battery. The division D battery discharge requirement is the most severe of the six division batteries.

8.3.2.5.4 Class 1E 24-Hour Inverter Capacity Testing

Each Class 1E 24-hour inverter is tested to verify the capability to provide 12 kW while maintaining the output voltage and frequency within the tolerances specified in Table 8.3.2-5. The 12 kW capacity is sufficient to meet the 24-hour inverter loads listed in Tables 8.3.2-1, 8.3.2-2, 8.3.2-3, and 8.3.2-4. The inverter input voltage will be no more than 105 Vdc during the test to represent the conditions at the battery end of life.

8.3.2.5.5 Class 1E 72-Hour Inverter Capacity Testing

Each Class 1E 72-hour inverter is tested to verify the capability to provide 7 kW while maintaining the output voltage and frequency within the tolerances specified in Table 8.3.2-5. The 7 kW capacity is sufficient to meet the 72-hour inverter loads listed in Tables 8.3.2-2 and 8.3.2-3. The inverter input voltage will be no more than 105 Vdc during the test to represent the conditions at the battery end of life.

8.3.2.5.6 Class 1E 24-Hour Charger Capacity Testing

Each Class 1E 24-hour charger is tested to verify the capability to provide 300 A while maintaining the output voltage within the range specified in Table 8.3.2-5. The 300 A is sufficient to meet the 24-hour loads listed in Tables 8.3.2-1, 8.3.2-2, 8.3.2-3, and 8.3.2-4 while maintaining the corresponding battery charged.

8.3.2.5.7 Class 1E 72-Hour Charger Capacity Testing

Each Class 1E 72-hour charger is tested to verify the capability to provide 250 A while maintaining the output voltage within the range specified in Table 8.3.2-5. The 250 A is sufficient to meet the 72-hour loads listed in Tables 8.3.2-2 and 8.3.2-3 while maintaining the corresponding battery charged.

8.3.2.5.8 Class 1E Regulating Transformer Capacity Testing

Each Class 1E regulating transformer is tested to verify the capability to provide 30 kW while maintaining the output voltage within the tolerance specified in Table 8.3.2-5. The 30 kW capacity is sufficient to meet the inverter loads listed in Tables 8.3.2-1, 8.3.2-2, 8.3.2-3 and 8.3.2-4.

8.3.2.5.9 Motor-Operated Valves Terminal Voltage Testing

The operating voltage supplied to Class 1E motor-operated valves is measured to verify the motor starter input terminal voltage is above the minimum design value of 100 Vdc. The battery terminal voltage will be no more than 105 Vdc during the test to represent the conditions at the battery end of life.

8.3.2.5.10 Non-Class 1E Battery Capacity Testing

Each load group 1, 2, and 3 non-Class 1E battery is tested to verify the capability to provide 500 A for two hours while maintaining the battery terminal voltage above the minimum voltage specified in Table 8.3.2-6. The 500 A is sufficient to meet the loads described in subsection 8.3.2.1.2. Each battery is connected to a charger maintained at 135 ± 1 V for a period of at least 24 hours prior to the test to assure the battery is fully charged.

8.3.2.5.11 Non-Class 1E Inverter Capacity Testing

Each load group 1, 2, and 3 non-Class 1E inverter is tested to verify the capability to provide 35 kW while maintaining the output voltage and frequency within the tolerances specified in Table 8.3.2-6. The 35 kW capacity is sufficient to meet the loads described in subsection 8.3.2.1.2.

8.3.2.5.12 Non-Class 1E Charger Capacity Testing

Each load group 1, 2, and 3 non-Class 1E charger is tested to verify the capability to provide 550 A while maintaining the output voltage within the range specified in Table 8.3.2-6. The 550 A is sufficient to meet the loads described in subsection 8.3.2.1.2 while maintaining the corresponding battery charged.

8.3.3 Combined License Information for Onsite Electrical Power

Combined License applicants referencing the AP600 certified design will address the design of grounding and lightning protection.

The Combined License applicant will establish plant procedures as required for:

- Clearing ground fault on the Class 1E dc system
- Checking sulfated battery plates or other anomalous conditions through periodic inspections
- Battery maintenance and surveillance (for battery surveillance requirements, refer to DCD Chapter 16, Section 3.8)
- Periodic testing of penetration protective devices
- Diesel generator operation, inspection, and maintenance in accordance with manufacturers' recommendations.

8.3.4 References

1. NEMA MG-1, "Motors and Generators," 1987.
2. IEEE Standard 317, "Electric Penetration Assemblies in Containment Structures for Nuclear Power Generating Stations," 1983.
3. IEEE Standard 422, "Guide for the Design and Installation of Cable Systems in Power Generating Stations," 1986.

4. ICEA Standard Publication P-54-440, "Ampacities of Cables in Open-Top Cable Trays," 1986.
5. National Electrical Code (NEC), 1990.
6. IEEE Standard 485, "IEEE Recommended Practice for Sizing Large Lead Storage Batteries for Generating Stations and Substations," 1983.
7. IEEE Standard 384, "IEEE Standard Criteria for Independence of Class 1E Equipment and Circuits," 1981.
8. IEEE Standard 308, "IEEE Standard Criteria for Class 1E Power Systems for Nuclear Power Generating Stations," 1980.
9. IEEE Standard 946, "IEEE Recommended Practice for the Design of Safety-Related dc Auxiliary Power Systems for Nuclear Power Generating Stations," 1985.
10. IEEE Standard 741, "IEEE Criteria for the Protection of Class 1E Power Systems and Equipment in Nuclear Power Generating Stations," 1990.
11. IPCEA Standard Publication P-46-426-1962, "Power Cable Ampacities, Volume I - Copper Conductors."
12. IEEE Standard 450, "IEEE Recommended Practice for Maintenance, Testing and Replacement of Large Storage Batteries for Generating Stations and Substations," 1987.
13. Young, G. L. et al., "Cable Separation - What Do Industry Programs Show?," IEEE Transactions of Energy Conversion, September 1990, Volume 5, Number 3, pp 585-602.
14. WCAP-13856, "AP600 Implementation of the Regulatory Treatment of Nonsafety-Related Systems Process," Revision 1, January 1998.
15. NUREG/CR-0660, "Enhancement of On-Site Emergency Diesel Generator Reliability," February 1979.
16. IEEE Standard 141, "IEEE Recommended Practice for Electric Power Distribution for Industrial Plants" (IEEE Red Book), 1986.
17. IEEE Standard 242, "IEEE Recommended Practice for Protection and Coordination of Industrial and Commercial Power Systems" (IEEE Buff Book), 1986.

Table 8.3.1-1 (Sheet 1 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02A NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
1.	0	D/G Start Signal is Initiated	-	-	-
2.	TBD	D/G Reaches IDLE Speed (Note 6)	-	-	-
3.	TBD	D/G Reaches Full Speed (Note 6)	-	-	-
4.	120	D/G Breaker Closes, Load Sequencer Starts	-	-	-
5.	120	Load Center Transformer EK11 (Note 7)	2500 kVA	7.5	AUTO
6.	120	Load Center Transformer EK12 (Note 7)	2500 kVA	7.5	AUTO
7.	120	Annex Bldg Lighting Panel (Note 8)	30 kVA	10	AUTO
8.	120	Annex Bldg Lighting Panel (Note 8)	30 kVA	10	AUTO
9.	120	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
10.	120	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
11.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
12.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
13.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
14.	120	D/G Bldg Lighting Panel (Note 8)	30 kVA	3	AUTO
15.	120	D/G 2A AC/OC Radiator Fan	25 hp	21	AUTO
16.	120	Diesel Oil Transfer Module Unit Heater A	15 kW	15	AUTO

Table 8.3.1-1 (Sheet 2 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02A NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
17.	120	Diesel Oil Transfer Module Exhaust Fan A	0.5 hp	0.5	AUTO
18.	120	D/G A Jacket Water Radiator Fan	25 hp	21	AUTO
19.	120	Non-1E Regulating XFMR EDS1-DT-1	75 kVA	25	AUTO
20.	120	Non-1E Regulating XFMR 3 EDS3-DT-1	75 kVA	25	AUTO
21.	120	Class 1E Div. A Regulating XFMR 1	45 kVA	15	AUTO
22.	120	Class 1E Div. C Regulating XFMR 1	45 kVA	15	AUTO
23.	120	Motor Operated Valves (Note 5)	-	-	AUTO
24.	120	D/G A Fuel Oil Transfer Pump	3 hp	3	AUTO
25.	120	D/G A Bldg Stdby Exhaust Fan 1A	3 hp	3	AUTO
26.	120	D/G A Bldg Stdby Exhaust Fan 2A	3 hp	3	AUTO
27.	120	D/G A Bldg Primary AHU MS 01A Fan	3 hp	3	AUTO
28.	120	D/G A Fuel Oil Cooler Fan	2 hp	2	AUTO
29.	140	Start-up Feed Water Pump A	600 hp	464	AUTO
30.	160	Load Center Transformer EK13 (Note 9)	2500 kVA	7.5	AUTO
31.	160	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
32.	160	Fuel Oil Day Tank Vault Exhaust Fan A	0.5 hp	0.5	AUTO
33.	160	Diesel Fuel Oil Transfer Heater A	90 kW	90	AUTO
34.	160	Service Water Pump A	300 hp	166	AUTO

Table 8.3.1-1 (Sheet 3 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02A NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
35.	180	Service Water Cooling TWR Cell Fan A	100 hp	83	AUTO
36.	180	Main Control Room AHU Supply Fan A	40 hp	34	AUTO
37.	180	Main Control Room AHU Return Fan A	25 hp	21	AUTO
38.	180	Div A/C Class 1E Electrical Room AHU Supply Fan A	40 hp	34	AUTO
39.	180	Div A/C Class 1E Electrical Room Return Fan A	25 hp	21	AUTO
40.	180	Div B/D Class 1E Electrical Room AHU Supply Fan D	25 hp	21	AUTO
41.	180	Div B/D Class 1E Electrical Room Return Fan D	25 hp	21	AUTO
42.	180	Air Cooled Chiller Pump 2	20 hp	17	AUTO
43.	200	Component Cooling Water Pump A	400 hp	332	AUTO
44.	220	Air Cooled Chiller 2	375 kW	375	AUTO
45.	240	Make-Up Pump A	600 hp	498	AUTO
46.	240	CVS Pump Room Fan A	1.5 hp	1.5	AUTO
47.	300	Normal Residual Heat Removal Pump A	200 hp	166	AUTO
48.	300	RNS Pump Room Fan A	1.5 hp	1.5	AUTO
49.	300	Annex Bldg Equipment Room Return/Exhaust Fan A	20 hp	17	AUTO
50.	300	Annex Bldg Equipment Room AHU MS02A Fan	40 hp	33	AUTO
51.	300	Annex Bldg Swgr Rm AHU MS 05A Fan	40 hp	33	AUTO
52.	300	Annex Bldg Swgr Rm Ret/Exhaust Fan 06A	25 hp	21	AUTO

Table 8.3.1-1 (Sheet 4 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02A NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
53.	360	Non-1E Battery Charger EDS1-DC-1	117 kVA	88	AUTO
54.	360	Non 1E Battery Room A Exhaust Fan	0.5 hp	0.5	AUTO
55.	360	Containment Recirculation Fan A	150 hp	21	AUTO
56.	420	Containment Recirculation Fan D	150 hp	21	AUTO
57.	420	Non-1E Battery Charger EDS3-DC-1	117 kVA	88	AUTO
58.	480	Class 1E Div. A Battery Charger 1	78 kVA	26	AUTO
59.	480	Class 1E Div. C Battery Charger 1	78 kVA	24.5	AUTO
60.	480	Class 1E Div. C Battery Charger 2	78 kVA	15	AUTO
61.	480	Div. A/C Class 1E Battery Room Exhaust Fan A	5 hp	5	AUTO
62.	480	Supplemental Air Filtration System Fan A	15 hp	15	AUTO
63.	480	Supplemental Air Filtration System Electric Heater A	20 kW	20	AUTO
64.	480	Instrument Air Compressor A	200 hp	166	AUTO
65.	540	Backup Group 4A Pressurizer Heaters	246 kW	246	AUTO
66.	--	CRDM Fan 01A	40 hp	33	MAN
67.	--	CRDM Fan 01B	40 hp	33	MAN
68.	--	Spent Fuel Cooling Pump A	75 hp	62	MAN
Total Diesel Operating Loads (kW)					
				3577.5	

Table 8.3.1-1 (Sheet 5 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02A NOMINAL LOADS**Notes:**

1. Loads listed are for diesel generator ZOS MG02A.
2. Loads identified with automatic (AUTO) loading will be loaded without operator action. Loads identified with manual (MAN) loading will be energized at operator discretion based on system needs. Automatic loads may not be started until there is a system need (for example, the make-up pump may not be started until make-up flow is required.)
3. Time Sequence is counted from the time a diesel generator receives the start signal.
4. The "Operating Load" column shows the load input power requirement from the diesel generator.
5. Motor operated valves (MOV) pertaining to various systems will be energized on closure of the diesel generator breaker. Normally the MOV power requirement is for a very short duration (a few seconds); hence, the MOV load will not affect the diesel generator capacity rating.
6. On receipt of the diesel generator start signal, the engine accelerates to a set idle speed. The engine operates at the idle speed for a time to allow bearing oil pressure buildup, proper lubrication of the moving parts, and engine warmup. After a set time delay (to be determined based on vendor selection), the engine will ramp up to the rated operating speed.
7. On restoring the power supply to the diesel backed bus ES1 by closing the diesel generator incoming breaker, the associated unit substation ECS EK 11 and 12 load center transformers are energized. The transformers draw magnetizing current and the no load losses (approx. 0.3 percent of the rating) from the bus.
8. Only a part of the building lighting load is automatically connected to the diesel generator bus. The remaining lighting load is connected via manual action at the operator's discretion.
9. Load Center ECS EK 13 transformer no load losses and magnetizing current is approximately 0.3 percent of the transformer rating.

Table 8.3.1-2 (Sheet 1 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02B NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
1.	0	D/G Start Signal is Initiated	-	-	-
2.	TBD	D/G Reaches IDLE Speed (Note 6)	-	-	-
3.	TBD	D/G Reaches Full Speed (Note 6)	-	-	-
4.	120	D/G Breaker Closes, Load Sequencer Starts	-	-	-
5.	120	Load Center Transformer EK21 (Note 7)	2500 kVA	7.5	AUTO
6.	120	Load Center Transformer EK22 (Note 7)	2500 kVA	7.5	AUTO
7.	120	Annex Bldg Lighting Panel (Note 8)	30 kVA	10	AUTO
8.	120	Annex Bldg Lighting Panel (Note 8)	30 kVA	10	AUTO
9.	120	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
10.	120	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
11.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
12.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
13.	120	Turbine Bldg Lighting Panel (Note 8)	40 kVA	7	AUTO
14.	120	D/G Bldg Lighting Panel (Note 8)	30 kVA	3	AUTO
15.	120	D/G 2B AC/OC Radiator Fan	25 hp	21	AUTO
16.	120	Diesel Oil Transfer Module Unit Heater B	15 kW	15	AUTO

Table 8.3.1-2 (Sheet 2 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02B NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
17.	120	Diesel Oil Transfer Module Exhaust Fan B	0.5 hp	0.5	AUTO
18.	120	D/G B Jacket Water Radiator Fan	25 hp	21	AUTO
19.	120	Non-1E Regulating XFMR EDS2-DT-1	75 kVA	25	AUTO
20.	120	Class 1E Div. B Regulating XFMR 1	45 kVA	11	AUTO
21.	120	Class 1E Div. D Regulating XFMR 1	45 kVA	15	AUTO
22.	120	Motor Operated Valves (Note 5)	-	-	AUTO
23.	120	D/G B Fuel Oil Transfer Pump	3 hp	3	AUTO
24.	120	D/G B Bldg Stdby Exhaust Fan 1B	3 hp	3	AUTO
25.	120	D/G B Bldg Stdby Exhaust Fan 2B	3 hp	3	AUTO
26.	120	D/G B Bldg. Primary AHU MS 01B Fan	3 hp	3	AUTO
27.	120	D/G B Fuel Oil Cooler Fan	2 hp	2	AUTO
28.	140	Start-up Feed Water Pump B	600 hp	464	AUTO
29.	160	Load Center Transformer EK23 (Note 9)	2500 kVA	7.5	AUTO
30.	160	Aux Bldg Lighting Panel (Note 8)	60 kVA	15	AUTO
31.	160	Fuel Oil Day Tank Vault Exhaust Fan B	0.5 hp	0.5	AUTO
32.	160	Diesel Fuel Oil Transfer Heater B	90 kW	90	AUTO
33.	160	Service Water Pump B	300 hp	166	AUTO
34.	180	Service Water Cooling TWR Cell Fan B	100 hp	83	AUTO

Table 8.3.1-2 (Sheet 3 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02B NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
35.	180	Main Control Room AHU Supply Fan B	40 hp	34	AUTO
36.	180	Main Control Room AHU Return Fan B	25 hp	21	AUTO
37.	180	Div. B/D Class 1E Electrical Room AHU Supply Fan B	25 hp	21	AUTO
38.	180	Div B/D Class 1E Electrical Room Return Fan B	25 hp	21	AUTO
39.	180	Div A/C Class 1E Electrical Room AHU Supply Fan C	40 hp	34	AUTO
40.	180	Div A/C Class 1E Electrical Room Return Fan C	25 hp	21	AUTO
41.	180	Air Cooled Chiller Pump 3	20 hp	17	AUTO
42.	200	Component Cooling Water Pump B	400 hp	332	AUTO
43.	220	Air Cooled Chiller 3	375 kW	375	AUTO
44.	240	Make-Up Pump B	600 hp	498	AUTO
45.	240	CVS Pump Room Fan B	1.5 hp	1.5	AUTO
46.	300	Normal Residual Heat Removal Pump B	200 hp	166	AUTO
47.	300	RNS Pump Room Fan B	1.5 hp	1.5	AUTO
48.	300	Annex Bldg Equipment Room Return/Exhaust Fan B	20 hp	17	AUTO
49.	300	Annex Bldg Equipment Room AHU MS02B Fan	40 hp	33	AUTO
50.	300	Annex Bldg Swgr Rm AHU MS 05B Fan	40 hp	33	AUTO
51.	300	Annex Bldg Swgr Rm Ret/Exhaust Fan 06B	25 hp	21	AUTO

Table 8.3.1-2 (Sheet 4 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02B NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
52.	360	Non-1E Battery Charger EDS2-DC-1	117 kVA	88	AUTO
53.	360	Non-1E Battery Room B Exhaust Fan 09B	0.5 hp	0.5	AUTO
54.	360	Containment Recirculation Fan B	150 hp	21	AUTO
55.	420	Containment Recirculation Fan C	150 hp	21	AUTO
56.	420	Non-1E Battery Charger EDS4-DC-1	117 kVA	88	AUTO
57.	480	Class 1E Div. B Battery Charger 1	78 kVA	24.5	AUTO
58.	480	Class 1E Div. B Battery Charger 2	78 kVA	15	AUTO
59.	480	Class 1E Div. D Battery Charger 1	78 kVA	26	AUTO
60.	480	Div. B/D Class 1E Battery Room Exhaust Fan B	1.5 hp	1.5	AUTO
61.	480	Supplemental Air Filtration System Fan B	15 hp	15	AUTO
62.	480	Supplemental Air Filtration System Electric Heater B	20 kW	20	AUTO
63.	480	Instrument Air Compressor B	200 hp	166	AUTO
64.	--	Backup Group 4B Pressurizer Heaters	246 kW	246	AUTO

Table 8.3.1-2 (Sheet 5 of 5)

ONSITE STANDBY DIESEL GENERATOR ZOS MG02B NOMINAL LOADS

Item No.	Time Seq. (sec)	Event or Load Description	Rating (hp/kW)	Operating Load (kW)	Loading Method
65.	--	CRDM Fan 01C	40 hp	33	MAN
66.	--	Spent Fuel Cooling Pump B	75 hp	62	MAN
Total Diesel Operating Loads (kW)				3512	

Notes:

1. Loads listed are for diesel generator ZOS MG02B.
2. Loads identified with automatic (AUTO) loading will be loaded without operator action. Loads identified with manual (MAN) loading will be energized at operator discretion based on system needs. Automatic loads may not be started until there is a system need (for example, the make-up pump may not be started until make-up flow is required.)
3. Time Sequence is counted from the time a diesel generator receives the start signal.
4. The "Operating Load" column shows the load input power requirement from diesel generator.
5. Motor operated valves (MOV) pertaining to various systems will be energized on closure of the diesel generator breaker. Normally the MOV power requirement is for a very short duration (few seconds), hence the MOV load will not affect the diesel generator capacity rating.
6. On receipt of the diesel generator start signal, the engine accelerates to a set idle speed. Engine operates at the idle speed for a time period to allow bearing oil pressure build up, proper lubrication of the moving parts, and engine warmup. After a set time delay (to be determined based on vendor selection), the engine will ramp up to the rated operating speed.
7. On restoring the power supply to the diesel backed bus ES2 by closing diesel generator incoming breaker, the associated unit substation ECS EK 21 and 22 load center transformers are energized. The transformers draw magnetizing current and the no load losses (approx. 0.3 percent of the rating) from the bus.
8. Only a part of the building lighting load is automatically connected to the diesel generator bus. The remaining lighting load is connected via manual action at the operator's discretion.
9. Load Center ECS EK 23 transformer no load losses and magnetizing current is approximately 0.3 percent of the transformer rating.

Table 8.3.1-3 (Sheet 1 of 2)

**COMPONENT DATA - MAIN AC POWER SYSTEM
(NOMINAL VALUES)**

1.	Main Stepup Transformer	<p>3 single phase, 290 MVA, FOA, 65°C rise, liquid filled LV = 22 kV - delta HV = (site-specific) - wye grounded</p>
2.	Unit Auxiliary Transformers (UATs)	<p>3 phase, 3 winding 22 - 4.16/4.16 kV H = 45 MVA, OA, 65°C X = 22.5 MVA, OA, 65°C Y = 22.5 MVA, OA, 65°C</p>
	Reserve Auxiliary Transformer (RAT)	<p>3 phase, 3 winding HV = site-specific LV = 4.16/4.16 kV, OA, 65°C H = 45 MVA, OA, 65°C X = 22.5 MVA, OA, 65°C Y = 22.5 MVA, OA, 65°C</p>
3.	4.16 kV Switchgear	<p>medium voltage metal-clad switchgear MVA Class - 350 MVA vacuum-type circuit breaker</p>

Table 8.3.1-3 (Sheet 2 of 2)

**COMPONENT DATA - MAIN AC POWER SYSTEM
(NOMINAL VALUES)**

4.	480 V Load Centers	
	Transformers - Indoor, Air-Cooled Ventilated Dry-Type, Fire Retardant:	2500 kVA, AA, 3 phase, 60 Hz 4160 - 480 V
	Main Bus Ampacity	4000 amperes continuous
	480V Breakers	metal enclosed draw-out circuit breaker or motor-starter (contactor) 65,000A RMS symmetrical interrupting rating
5.	480 V Motor Control Centers	
	Horizontal Bus	800A continuous rating 65,000A RMS symmetrical bracing
	Vertical Bus	300A continuous rating 65,000A RMS symmetrical bracing
	Breakers (molded case)	65,000A RMS symmetrical interrupting rating

Table 8.3.1-4

POST-72 HOURS NOMINAL LOAD REQUIREMENTS

Item No.	Description of Loads	Ancillary	Ancillary
		AC Generator 1	AC Generator 2
		Load (kW)	Load (kW)
1.	Post-Accident Monitoring (PAM) Emergency and Panel Lighting (Division B) in Main Control Room and ancillary fans		6.5
2.	Post-Accident Monitoring (PAM) Emergency and Panel Lighting (Division C) in Main Control Room and ancillary fans	6.5	
3. ^(a)	PCS Recirculation Pumps	10.5	10.5
4.	Ancillary Generator Room Lights	0.5	0.5
5.	Ancillary Generator Fuel Tank Heater	1.25 kW	1.25 kW
	Total	18.75 kW	18.75 kW

Note:

- a. There are two PCS pumps; however, only one pump will be operating at any point in time on each generator. In case of fire fighting, two pumps (one on each generator) may be used.

Table 8.3.1-5

**INDICATION AND ALARM POINTS
STANDBY DIESEL GENERATORS**

Parameter	Indication		Alarm	
	Control Room	Local	Control Room	Local
Lube Oil Pressure Low	No	Yes	Yes	Yes
Lube Oil Temperature High	No	Yes	Yes	Yes
Lube Oil Sump Level Low	No	Yes	No	Yes
Cooling Water Temperature High	Yes	Yes	Yes	Yes
Cooling Water Pressure Low	No	Yes	Yes	Yes
DG Starting Air Pressure Low	Yes	Yes	Yes	Yes

Table 8.3.2-1

**125V DC CLASS 1E DIVISION A BATTERY
NOMINAL LOAD REQUIREMENTS**

LOAD DESCRIPTION	Power Required (kW)	
	Momentary	Continuous
BUS IDSA DS 1 (24 hr Battery Bank)		
Inverter		
ESFAC (Bay 1, 2)	0	1.60
IPC (Bay 1, 2, 3, 4)	0	5.00
PLC (Bay 1)	0	0.75
PLC (Bay 2)	0	0.75
PLC (Bay 3)	0	0.75
Emergency Lighting	0	0.30
MCR (MUX) and Control Interface	0	0.85
Containment High Range Monitor	0	0.12
RSW (MUX) and Control Interface	0	0.85
Subtotal	0	10.97
125 Vdc Panel		
Reactor Trip Swgr & Solenoid Valves	7	0.50
125 Vdc MCC		
Motor Operated Valves	240	
Total	247	11.47

Table 8.3.2-2

**125V DC CLASS 1E DIVISION B BATTERY
NOMINAL LOAD REQUIREMENTS**

LOAD DESCRIPTION	Power Required (kW)	
	Momentary	Continuous
BUS IDSB DS 1 (24 hr Battery Bank)		
Inverter		
ESFAC (Bay 1, 2)	0	1.60
IPC (Bay 1, 2, 3, 4)	0	4.50
MCR (MUX) and Control Interface	0	0.85
PLC (Bay 1)	0	0.75
PLC (Bay 2)	0	0.75
PLC (Bay 3)	0	0.75
Emergency Lighting and Panel Lighting	0	0.53
RSW (MUX) and Control Interface	0	0.85
Subtotal	0	10.58
125 Vdc Panel		
Reactor Trip Swgr, RCP Trip & Solenoid Valves	12	0.75
125 Vdc MCC		
Motor Operated Valves	165	
Total	177	11.33
BUS IDSB DS 2 (72 hr Battery Bank)		
Inverter		
IPC (Bay 3)	0	1.30
MCR (QDPS Display)	0	0.15
QDPS Cabinet	0	0.95
QDPS I/O Cabinet	0	0.75
Emergency Lighting and Panel Lighting	0	0.63
Containment High Range Monitor	0	0.12
MCR Supply Duct Radiation Monitor	1.80	0.24
Total	1.8	4.14

Table 8.3.2-3

**125V DC CLASS 1E DIVISION C BATTERY
NOMINAL LOAD REQUIREMENTS**

LOAD DESCRIPTION	Power Required (kW)	
	Momentary	Continuous
BUS IDSC DS 1 (24 hr Battery Bank)		
Inverter		
ESFAC (Bay 1, 2)	0	1.60
IPC (Bay 1, 2, 3, 4)	0	4.50
MCR (MUX) and Control Interface	0	0.85
PLC (Bay 1)	0	0.75
PLC (Bay 2)	0	0.75
PLC (Bay 3)	0	0.75
Emergency Lighting and Panel Lighting	0	0.53
RSW (MUX) and Control Interface	0	0.85
Subtotal	0	10.58
125 Vdc Panel		
Reactor Trip Swgr, RCP Trip, & Solenoid Valves	12	0.50
125 Vdc MCC		
Motor Operated Valves	75	
Total	87	11.08
BUS IDSC DS 2 (72 hr Battery Bank)		
Inverter		
IPC (Bay 3)	0	1.30
MCR (QDPS Display)	0	0.15
QDPS Cabinet	0	0.95
QDPS I/O Cabinet	0	0.75
Emergency Lighting and Panel Lighting	0	0.63
Containment High Range Monitor	0	0.12
MCR Supply Duct Radiation Monitor	1.80	0.24
Total	1.80	4.14

Table 8.3.2-4

**125V DC CLASS 1E DIVISION D BATTERY
NOMINAL LOAD REQUIREMENTS**

LOAD DESCRIPTION	Power Required (kW)	
	Momentary	Continuous
BUS IDSD DS 1 (24 hr Battery Bank)		
Inverter		
ESFAC (Bay 1, 2)	0	1.60
IPC (Bay 1, 2, 3, 4)	0	5.00
PLC (Bay 1)	0	0.75
PLC (Bay 2)	0	0.75
PLC (Bay 3)	0	0.75
Emergency Lighting	0	0.36
MCR (MUX) and Control Interface	0	0.85
Containment High Range Monitor	0	0.12
RSW (MUX) and Control Interface	0	0.85
Subtotal	<hr/> 0	<hr/> 11.03
125 Vdc Panel		
Reactor Trip Swgr & Solenoid Valves	6	0.75
125 Vdc MCC		
Motor Operated Valves	150	
Total	<hr/> 156	<hr/> 11.78

Table 8.3.2-5

**COMPONENT DATA - CLASS 1E DC SYSTEM
(NOMINAL VALUES)****a. Battery Bank**

2-125 Vdc 60 lead calcium cells, 2400 A.h (8 hrs to 1.75 V per cell @ 77°F).

b. Charger

AC input-480 V, 3-phase, 60 Hz; dc output-125 Vdc, 400 A continuous; float voltage 2.20 to 2.25 V/cell; equalizing charge voltage 2.33 V/cell.

c. Switchboard

Main bus 1,200 A continuous, 100,000 A short circuit bracing; fuse disconnect switch 100,000 A interrupting rating, continuous ratings 400 and 600 A.

d. Motor Control Center

Main Bus 600 A continuous, vertical bus 300 A continuous, 50,000 A short circuit bracing.

e. Spare Battery Bank

2-125V dc 60 lead calcium cells, 2400 A.h (8 hrs to 1.75 V per cell @ 77°F).

f. Spare Charger

AC input - 480 V, 3-phase, 60 Hz; dc output - 125 Vdc, 400 A continuous; float voltage 2.20 to 2.25 V/cell; equalizing charge voltage - 2.33 V/cell.

g. Uninterruptible Power Supply (UPS)**i) Inverter**

15 KVA with 125 Vdc input and 208Y/120 Vac, 3-phase, 4-wire, 60 Hz output; ac output voltage regulation of $\pm 2\%$ steady state; output frequency variation within 0.5% of nominal 60 Hz.

ii) Voltage Regulating Transformer

45 KVA, 480 V - 208Y/120V, 3-phase, 4-wire.

Note:

Refer to Figures 8.3.2-1 and 8.3.2-2 for the system component configuration.

Table 8.3.2-6

**COMPONENT DATA - NON-CLASS 1E DC SYSTEM
(NOMINAL VALUES)****a. Battery Bank**

125 Vdc 60 lead calcium cells, 2400 A.h (8 hrs to 1.75 V per cell @ 77°F).

b. Charger

AC input-480V, 3-phase, 60 Hz; dc output-125 Vdc, 600 A continuous; float voltage - 2.20 to 2.25 V/cell; equalizing charge voltage - 2.33 V/cell.

c. Switchgear

Main bus 1,000 A continuous, 50,000 A short circuit bracing; breaker 1000A frame size.

d. Spare Charger

AC input - 480 V, 3-phase, 60 Hz; dc output - 125 Vdc, 600A continuous; float voltage - 2.20 to 2.25 V/cell; equalizing charge voltage - 2.33 V/cell.

e. Uninterruptible Power Supply (UPS)**i) Inverter**

50 KVA with 125 Vdc input and 208 Y/120 Vac, 3-phase, 4-wire, 60 Hz output; ac output voltage regulation of $\pm 2\%$ steady state; output frequency variation within 0.5% of nominal 60 Hz.

ii) Voltage Regulating Transformer

75 KVA, 480 V - 208 Y/120 V, 3-phase, 4-wire.

Note:

Refer to Figure 8.3.2-3 for the system component configuration.

Table 8.3.2-7 (Sheet 1 of 4)

**CLASS 1E 125V DC AND CLASS 1E UNINTERRUPTIBLE POWER SUPPLIES
FAILURE MODES AND EFFECTS ANALYSIS**

Item No.	Description of Components	Safety Function	Plant Operating Mode	Failure Mode(s)	Method of Failure Detection	Failure Effect on System Safety Function Capability	General Remarks
1.	Battery Charger Division A, IDSA DC 1 Division B, IDSB DC 1, 2 Division C, IDSC DC 1, 2 Division D, OUTSET DC 1	Provide dc power when ac power available and maintain battery in a charged condition.	A,B	No output	Annunciator in main control room; battery charger failure alarm for ac power failure, dc output under/over voltage, dc input/output breaker open.	None; Battery can provide power for 24 and 72 hours without charger; other divisions available. Spare battery charger available for connection.	Failure of only one div. chgr. falls into single failure criteria and the other three div. are still available.
2.	Battery Division A, IDSA DB 1A,1B Division B, IDSB DB 1A,1B,2A,2B Division C, IDSC DB 1A,1B,2A,2B Division D, OUTSET db 1a,1b	Backup to battery charger during load cycling (in-rush current) and provide dc power for 24 and 72 hours without battery charger.	A,B	No output or low voltage	Battery monitor provides annunciation in main control room; switch-board failure alarm in main control room for ground detection and bus undervoltage.	None; Battery can provide power for 24 and 72 hours without charger.	This component inoperable during blackout.
3.	Fused transfer switch box Division A, IDSA DF 1 Division B, IDSB DF 1,2 Division C, IDSC DF 1,2 Division D, OUTSET DF 1	Provide circuit continuity and protection between Item 2 battery and Item 4 switch-board.	A,B,C	No output or low voltage	Switchboard failure alarm in main control room for ground detection and bus undervoltage.	None; Other divisions available; spare battery available.	Power still available with a single ground. Loss of entire battery function is single failure and the other divisions are available.

Table 8.3.2-7 (Sheet 2 of 4)

**CLASS 1E 125V DC AND CLASS 1E UNINTERRUPTIBLE POWER SUPPLIES
FAILURE MODES AND EFFECTS ANALYSIS**

Item No.	Description of Components	Safety Function	Plant Operating Mode	Method of Failure Mode(s)	Failure Effect on Failure Detection	System Safety Function Capability	General Remarks
4.	125V DC Switchboard Division A, IDSA DS 1 Division B, IDSB DS 1,2 Division C, IDSC DS 1,2 Division D, OUTSET DS 1	Distribute power via fusible disconnects to loads from chargers and battery	A,B,C	Bus ground fault	Switchboard failure alarm in main control room for ground detection and bus undervoltage.	None; Other divisions available.	
5.	Fusible disconnect Division A, for Charger 1 Division B, for Charger 1,2 Division C, for Charger 1,2 Division D, for Charger 1	Provide circuit continuity and protection between Item 1 and 4	A,B	Inadvertent opening (blown fuse)	Alarm in main control room for charger failure (dc no charge).	None; Battery can provide power for 24 and 72 hours without chargers. Other divisions available.	
6.	Fusible disconnect Division A, for Inverter 1 Division B, for Inverter 1,2 Division C, for Inverter 1,2 Division D, for Inverter 1	Provide circuit continuity and protection between Item 4 switchboard and Item 9 inverters	A,B,C	Inadvertent opening (blown fuse)	Inverter trouble alarm in main control room for loss of dc input, input, output and backup power supply breaker open.	None; System safety function can be met with loss of one division.	None; Battery can provide power for 24 and 72 hours without chargers.
7.	Fusible disconnect for DC MCC Division A Division B Division C Division D	Provide circuit continuity and protection between Item 4 switchboard and Item 13 DC MCC	A,B,C	Inadvertent opening (blown fuse)	DC MCC trouble alarm in main control room for bus undervoltage.	None; Other divisions available.	

Table 8.3.2-7 (Sheet 3 of 4)

**CLASS 1E 125V DC AND CLASS 1E UNINTERRUPTIBLE POWER SUPPLIES
FAILURE MODES AND EFFECTS ANALYSIS**

Item No.	Description of Components	Safety Function	Plant Operating Mode	Method of Failure Mode(s)	Failure Effect on Failure Detection	System Safety Function Capability	General Remarks
8.	Fusible disconnect for DC dist panel Division A Division B Division C Division D	Provide circuit continuity and protection between Item 4 switchboard and Item 14 dc panel.	A,B,C	Inadvertent opening (blown fuse)	DC dist. panel trouble alarm in main control room for bus undervoltage.	None; Other divisions available	
9.	Inverter Division A, IDSA DU 1 Division B, IDSB DU 1,2 Division C, IDSC DU 1,2 Division D, OUTSET DU 1	Convert 125V DC to 208Y/120V AC and provide 120V AC power	A,B,C	No output	Alarm in main control room for common UPS trouble, for loss of dc input, loss of ac output; input, output and backup power supply breakers open.	None; System safety function can be met with loss of one division.	
10.	Voltage regulating transformer Division A, IDSA DT 1 Division B, IDSB DT 1 Division C, IDSC DT 1 Division D, OUTSET DT 1	Backup to inverter (Item 9) when it is bypassed for maintenance or malfunction (local manual switching at inverter)	A,B	No output	Alarm in main control room for input and output power supply breakers open. And bus undervoltage.	None; Other divisions available.	For single failure analysis: These components are redundant to Item 1. These components are redundant to Item 9.
11.	208Y/120V AC distr. panel Division A, IDSA EA 1 Division B, IDSB EA 1, 3 Division C, IDSC EA 1, 3 Division D, OUTSET EA 1	Distribute power via breakers to loads	C	No input	Bus under-voltage	None	This component cannot function during blackout.
			A,B,C	Ground and bus fault	Alarm in main control room for under-voltage.	None; System safety function can be met with loss of one division.	

Table 8.3.2-7 (Sheet 4 of 4)

**CLASS 1E 125V DC AND CLASS 1E UNINTERRUPTIBLE POWER SUPPLIES
FAILURE MODES AND EFFECTS ANALYSIS**

Item No.	Description of Components	Safety Function	Plant Operating Mode	Method of Failure Mode(s)	Failure Effect on Detection	System Safety Function Capability	General Remarks
12.	208Y/120V AC Distr. Panel Div. A, IDSA EA 2 Div. B, IDSB EA 2 Div. C, IDSC EA 2 Div. D, OUTSET EA 2	Backup to inverter (Item 9) when it is bypassed for maintenance or malfunction (local manual switching at inverter)	A,B,C	Ground and bus fault	Alarm in main control room for bus undervoltage.	None; Other divisions available	
13.	DC MCC DIV. A, IDSA DK 1 DIV. B, IDSB DK 1 DIV. C, IDSC DK 1 DIV. D, OUTSET DK 1	Distribute power via fusible disconnect to loads	A,B,C	Ground and bus fault undervoltage and	MCC trouble alarm per MCC in main control room for bus ground detection.	None; Other divisions available	Power still available with a single ground.
14.	DC DISTR. Panel Div. A, IDSA DD1 Div. B, IDSB DD1 Div. C, IDSC DD1 Div. D, OUTSET DD1	Distribute power via fusible disconnect to loads	A,B,C	Ground and bus fault	Panel trouble alarm per panel in main control room for bus undervoltage and ground detection.	None; Other divisions available	Power still available with a single ground.

- Plant operating modes are represented as follows:

- A - Normal and preferred power available.

- B - Loss of preferred power and onsite standby diesel generator available.

- C - Blackout (loss of all ac systems, except 208Y/120-V AC UPS system).

System success criteria are as follows:

- 125-V DC System - Three out of four (Division A, B, C or D) divisions required.

- 208Y/120-V AC UPS System - Three out of four divisions required.

- The failure of any one fusible disconnect or opening of one circuit breaker under a fault condition results in only the loss of the associated division. The other redundant divisions still remain available.

[This page intentionally blank]

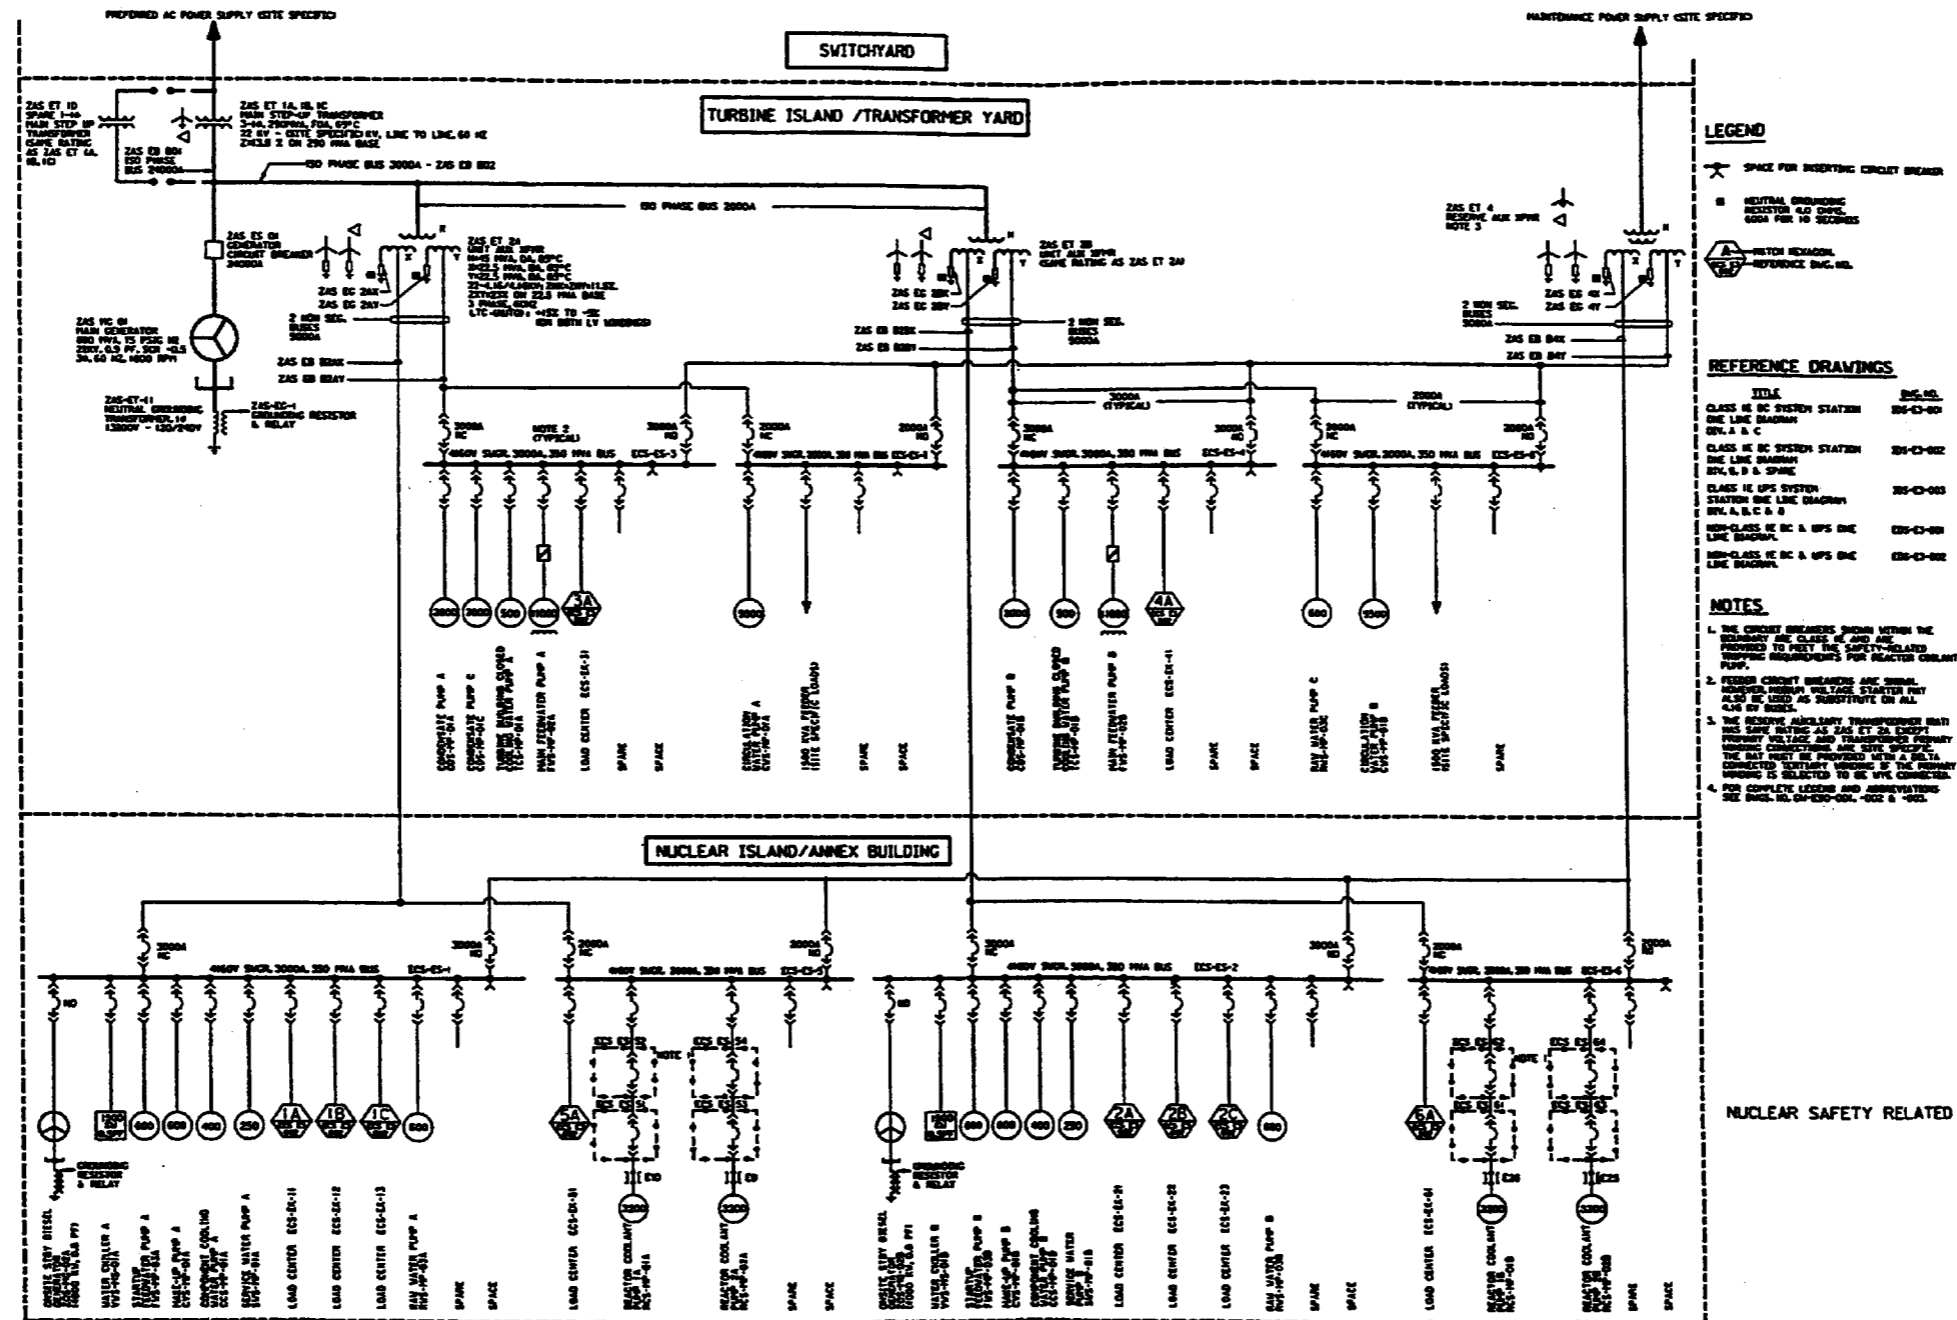


Figure 8.3.1-1

AC Power Station One Line Diagram

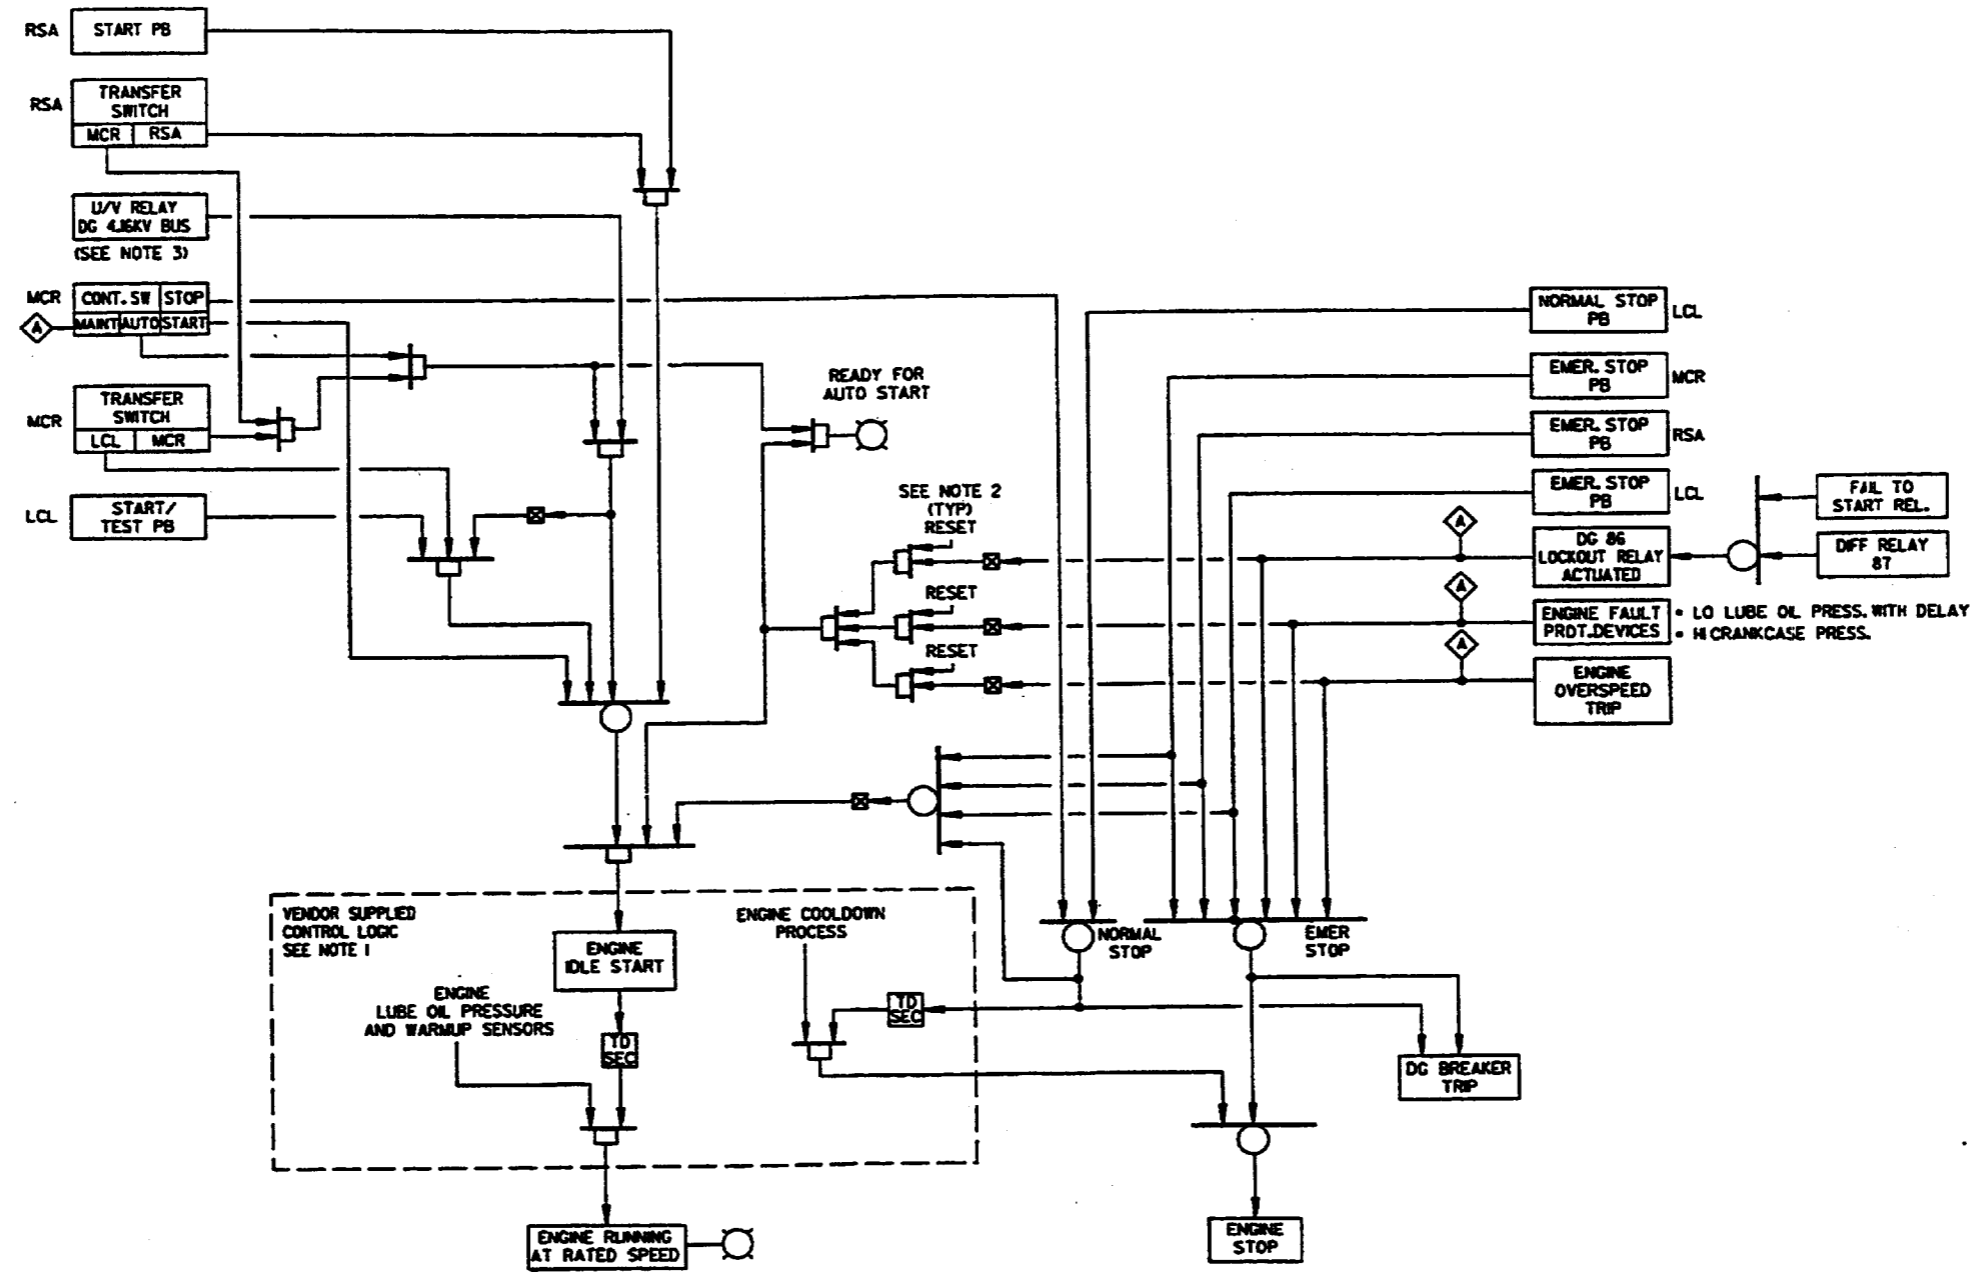


Figure 8.3.1-2

On-Site Standby Diesel Generator Initiating Circuit Logic Diagram


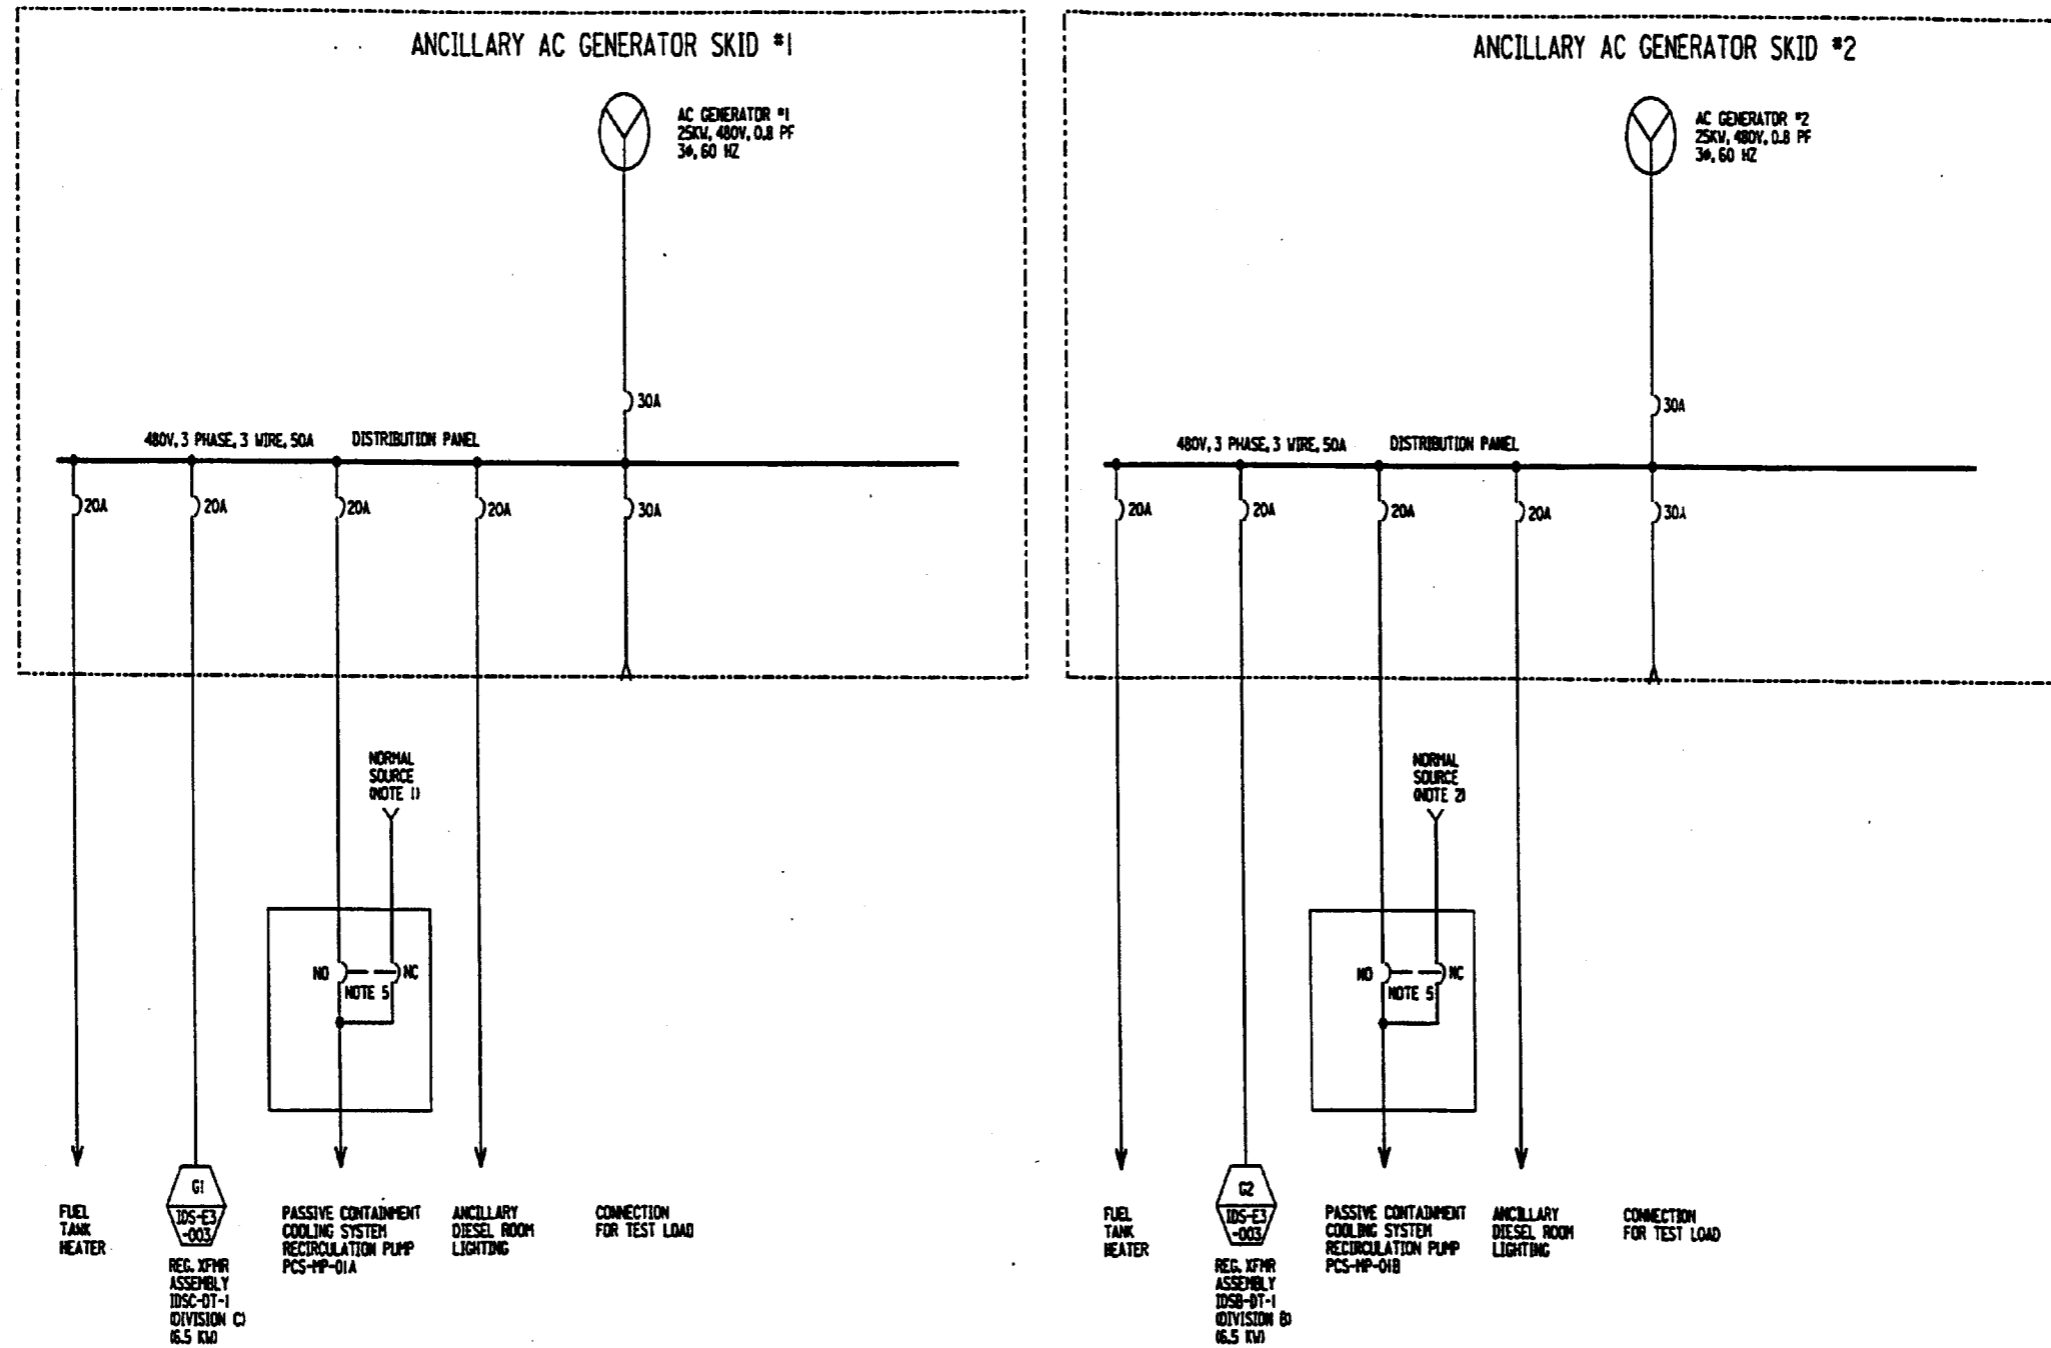


Figure 8.3.1-3

Post 72 Hour Temporary Electric Power
One Line Diagram

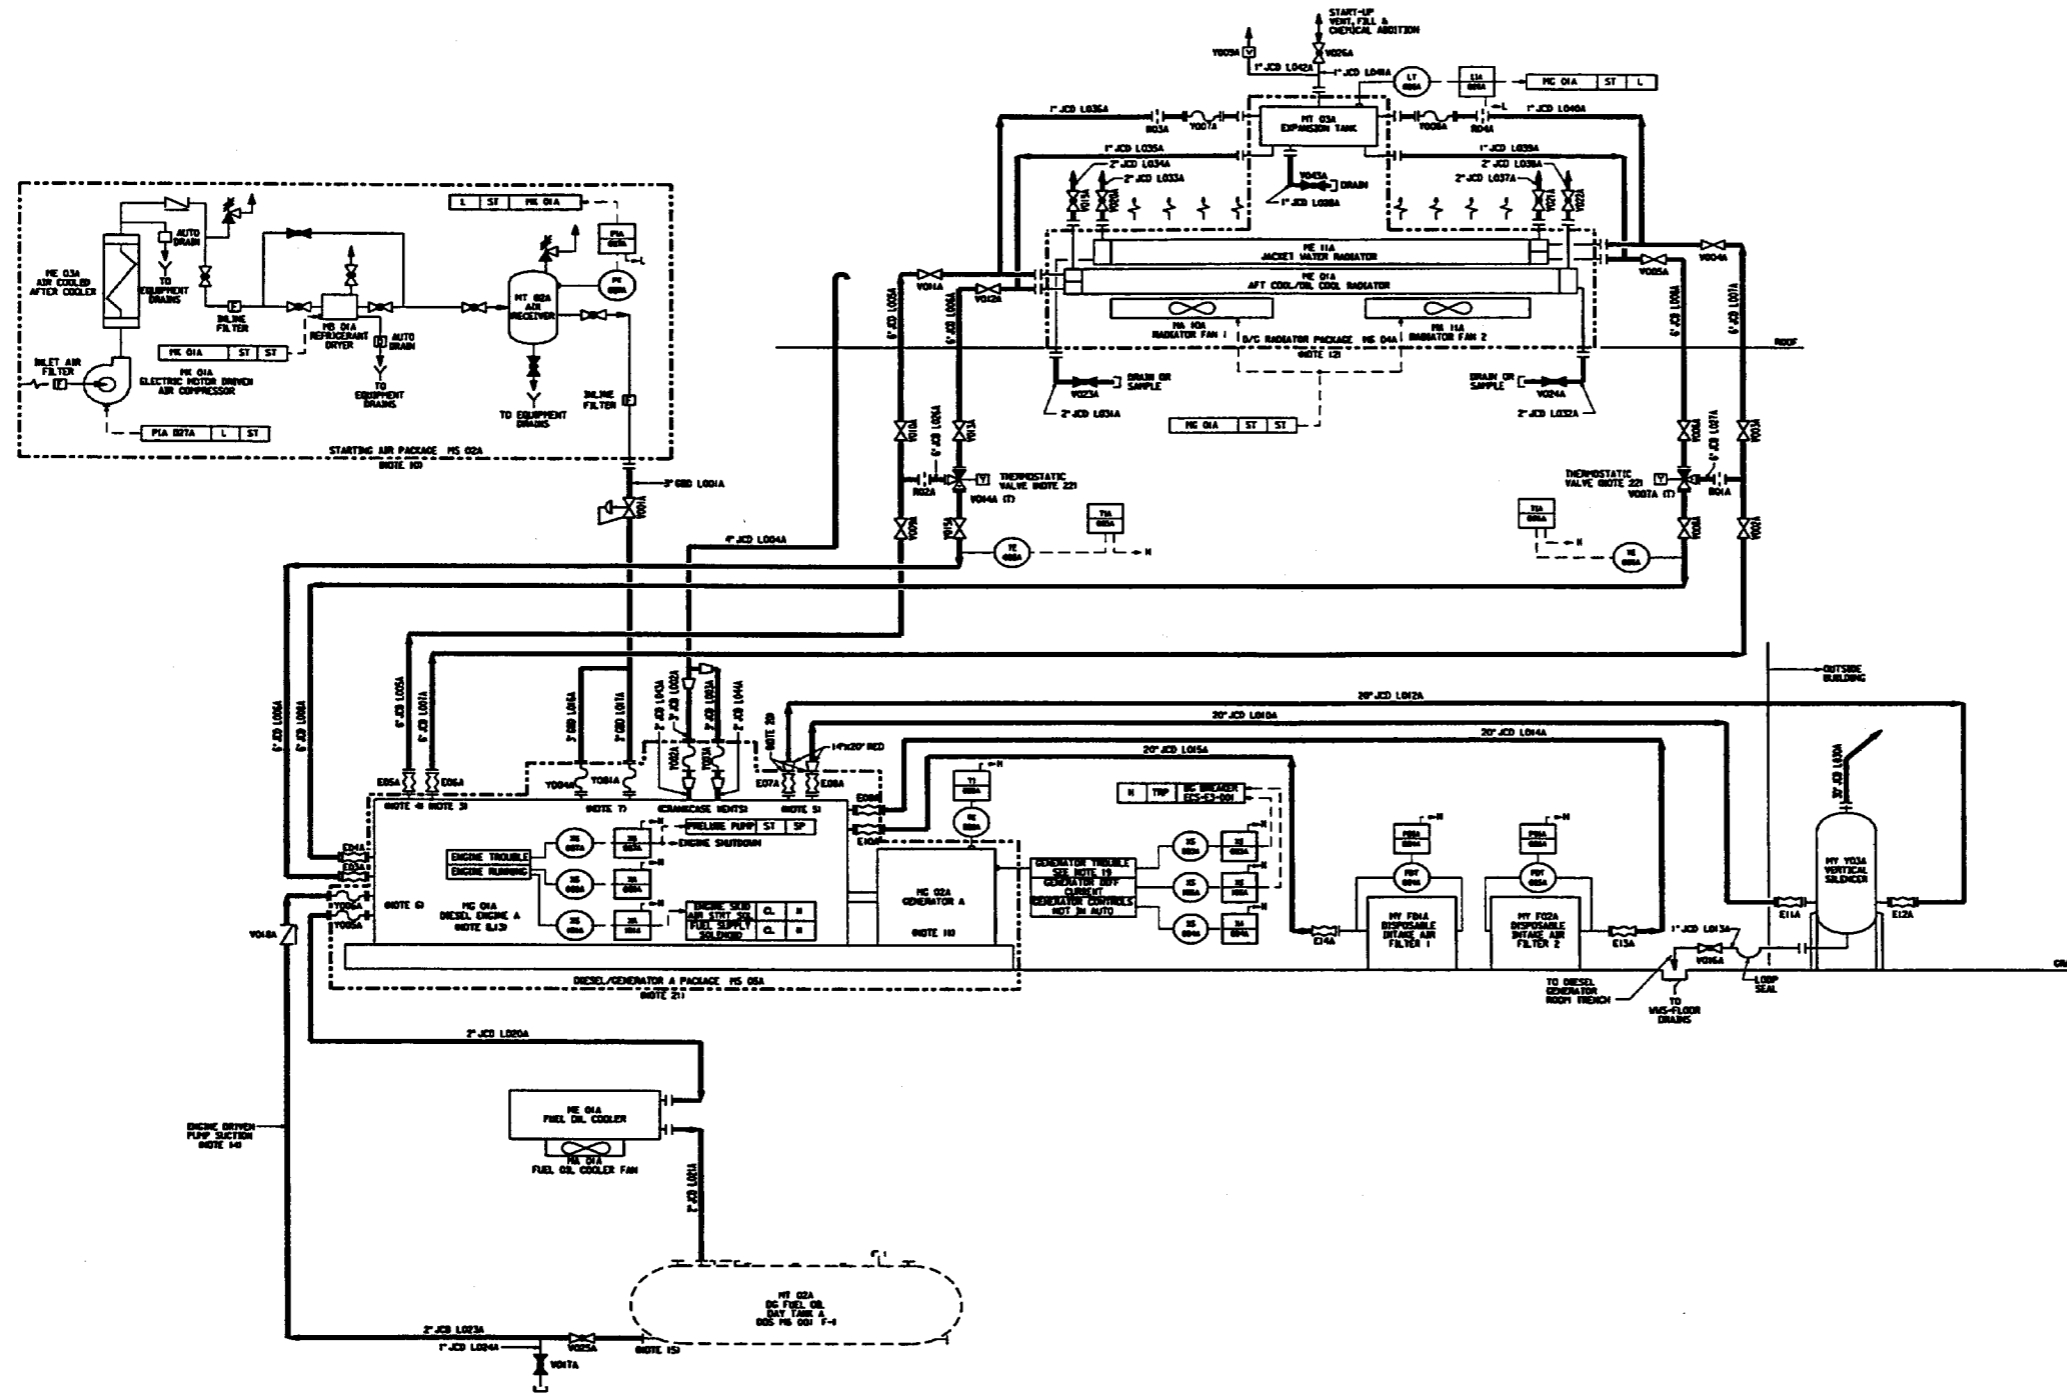

NOTES


1. THIS DESIGN IS TYPICAL AND FUNCTIONAL FOR ANY OFFERED DIESEL GENERATOR MANUFACTURER.
2. THE SYSTEM LOCATOR CODE ZOS HAS BEEN OMITTED FROM ALL COMPONENT NUMBERS, EXCEPT FOR EQUIPMENT, THE COMPONENT TYPE CODE HAS ALSO BEEN OMITTED.
3. DIESEL ENGINE JACKET WATER COOLING CIRCUIT INCLUDES ENGINE DRIVEN JACKET WATER PUMP PP 02A AND SEPARATE KEEP WARM CIRCUIT WITH ELECTRIC MOTOR DRIVEN JACKET WATER HEATER EH 02A.
4. DIESEL ENGINE AFTER COOLER/CIR. COOLER CIRCUIT INCLUDES ENGINE DRIVEN AFTER COOLER WATER PUMP PP 02A AND TURBO CHARGERS AFTER COOLER HE 02A AND LUBE OIL COOLERS HE 02A & HE 02A.
5. DIESEL ENGINE EXHAUST GAS DRIVEN TURBO CHARGERS HE 02A AND HE 02A COMPRESS COMBUSTION AIR TO THE DIESEL ENGINE.
6. DIESEL ENGINE FUEL OIL SYSTEM INCLUDES ENGINE DRIVEN FUEL OIL PUMP PP 02A.
7. DIESEL ENGINE STARTING AIR SYSTEM INCLUDES STARTING AIR MOTOR MS 02A AND HE 02A.
8. DIESEL ENGINE LUBE OIL SYSTEM INCLUDES ENGINE DRIVEN MAIN LUBE OIL PUMP PP 02A AND AC MOTOR PRELUBE OIL PUMP PP 02A, AC MOTOR PRELUBE PUMP PP 02A AND KEEP WARM LUBE OIL HEATER EH 02A.
9. EQUIPMENT VENDOR SHALL FURNISH ALL SMALL SPECIALTIES, VALVES ETC. IN EITHER 1" OR 2" SIZE AS REQUIRED FOR SERVICE CONDITIONS.
10. STARTING AIR SYSTEM IS SKID MOUNTED PACKAGE.
11. STARTER IS EQUIPPED WITH A SPACE HEATER FOR FREEZE PROTECTION.
12. JACKET WATER AND AFT COOL/OIL COOL RADIATORS IS SKID MOUNTED PACKAGE. PACKAGE SHARES RADIATOR FANS 1 AND 2.
13. LOCAL AND REMOTE DIESEL GENERATOR ALARM AND ANNUNCIATION POINTS ARE AS RECOMMENDED BY VENDOR.
14. DIESEL FUEL LINE TO ENGINE IS ROUTED IN TRENCH.
15. FUEL OIL SUCTION CONNECTION FROM DAY TANK SIDE IS ABOVE POTENTIAL RESERVE LEVEL.
16. ALL INSTRUMENTATION AND EQUIPMENT FOR SYSTEM PACKAGE IS FURNISHED BY DIESEL GENERATOR VENDOR.
17. SIGNAL INTERFACES ORIGINATING FROM THE DIESEL GENERATOR PACKAGES ARE IDENTIFIED BY SSS Y02S ER 02L.
18. TEST AND SAMPLE POINTS NOT SHOWN.
19. GENERATOR TROUBLE SIGNAL IS ACTIVATED ON OCCURRENCE OF ANY OF THE FOLLOWING CONDITIONS. THE CONDITIONS ARE ALARMED THROUGH PCS:
 1. LOSS OF GENERATOR FIELD AND
 2. GENERATOR OVERCURRENT (OVI)
 3. GENERATOR RES. SEC. OVERCURRENT AND
 4. GENERATOR REV. PAIR ACTIVATION (C3)
20. EQUIPMENT CONNECTION FLANGE ONLY.
21. DIESEL ENGINE AND GENERATOR ARE SKID MOUNTED AS A SINGLE MECHANICAL PACKAGE.
22. SELF-CONTAINED, SELF-POWERED, THREE-WAY THERMOSTATIC VALVE.

Inside Diesel Generator Building

Figure 8.3.1-4 (Sheet 1 of 2)

Diesel Generator System
Piping and Instrumentation Diagram

(REF) ZOS 001

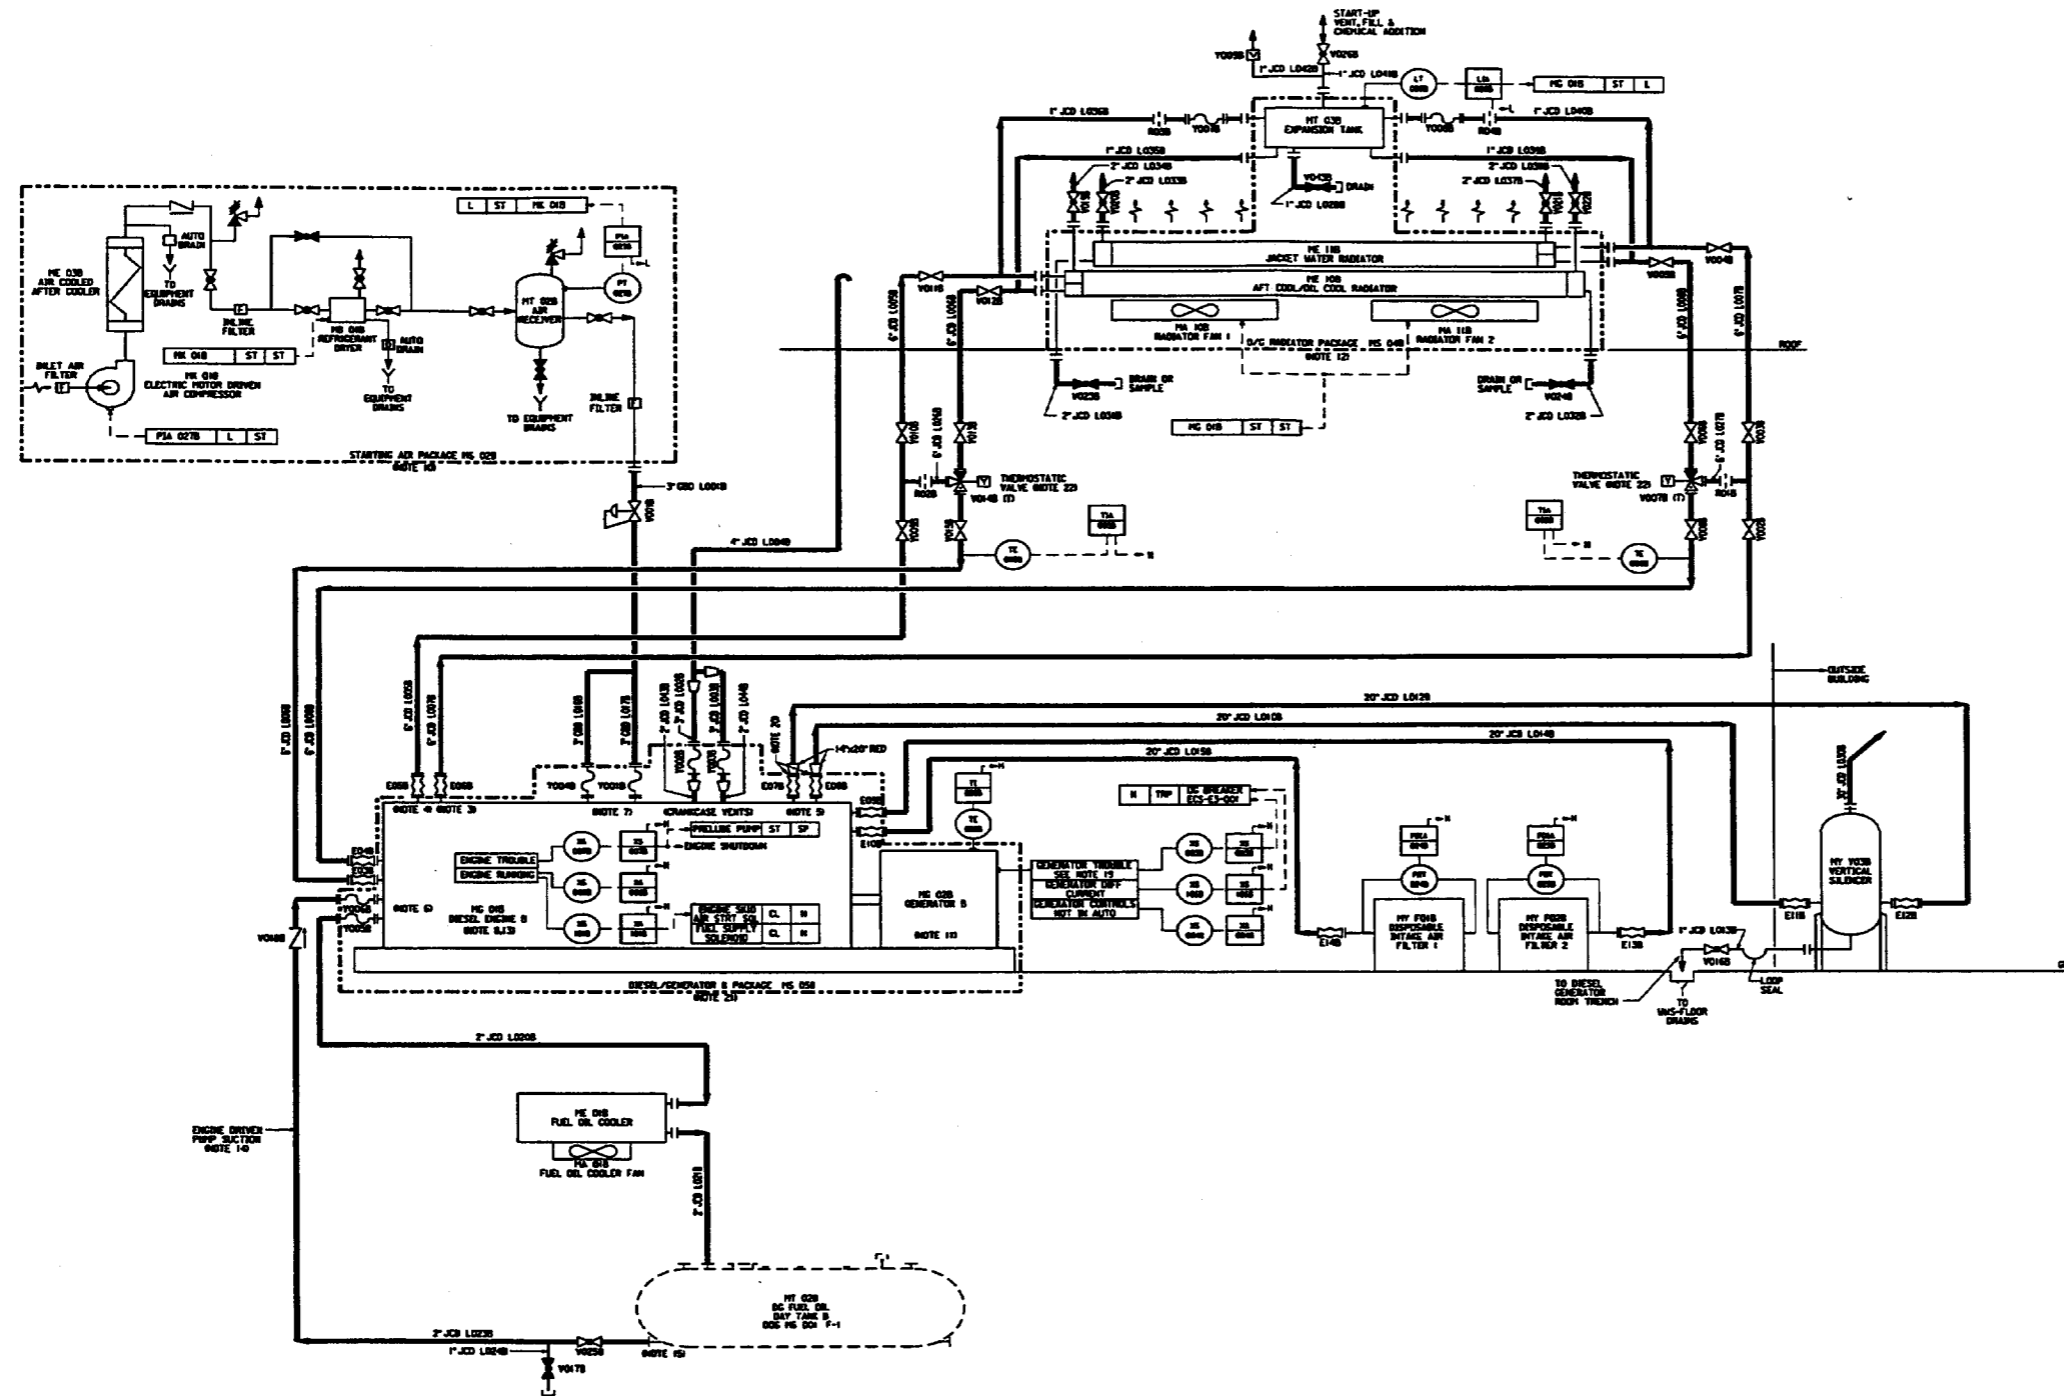

- NOTES**
1. THIS DESIGN TYPICAL AND FUNCTIONAL FOR ANY OFFERED DIESEL GENERATOR MANUFACTURER.
 2. THE SYSTEM LOCATOR CODE ZOS HAS BEEN OMITTED FROM ALL COMPONENT NUMBERS, EXCEPT FOR EQUIPMENT, THE COMPONENT TYPE CODE HAS ALSO BEEN OMITTED.
 3. DIESEL ENGINE JACKET WATER COOLING CIRCUIT INCLUDES ENGINE DRIVEN JACKET WATER PUMP HP 028 AND SEPARATE KEEP WARM CIRCUIT WITH ELECTRIC MOTOR DRIVEN JACKET WATER HEATER PUMP HP 028 AND ELECTRIC JACKET WATER HEATER ON 028.
 4. DIESEL ENGINE AFTER COOLER/OIL COOLER CIRCUIT INCLUDES ENGINE DRIVEN AC/DC WATER PUMP HP 028 AND TURBO CHARGERS AFTER COOLER HE 028 AND LUBE OIL COOLERS HE 028 & HE 028.
 5. DIESEL ENGINE EXHAUST GAS DRIVEN TURBO CHARGERS HE 028 AND HE 028 COMPRESS COGNITION AIR TO THE DIESEL ENGINE.
 6. DIESEL ENGINE FUEL OIL SYSTEM INCLUDES ENGINE DRIVEN FUEL OIL PUMP HP 028.
 7. DIESEL ENGINE STARTING AIR SYSTEM INCLUDES STARTING AIR MOTORS HE 028 AND HE 028.
 8. DIESEL ENGINE LUBE OIL SYSTEM INCLUDES ENGINE DRIVEN MAIN LUBE OIL PUMP HP 028 AND AC MOTOR FUEL LUBE OIL PUMP HP 028, DC MOTOR FUEL LUBE OIL PUMP HP 028 AND KEEP WARM LUBE OIL HEATER ON 028.
 9. EQUIPMENT VENDOR SHALL FURNISH ALL SMALL SPECIALTIES, VALVES ETC BY EITHER 1" OR 2" SIZE AS REQUIRED FOR SERVICE CONDITIONS.
 10. STARTING AIR SYSTEM IS SKID MOUNTED PACKAGE.
 11. GENERATOR IS EQUIPPED WITH A SPACE HEATER FOR FREEZE PROTECTION.
 12. JACKET WATER AND AFT COOL/OIL COOL RADIATORS IS SKID MOUNTED PACKAGE, PACKAGE SHARES RADIATOR FANS 1 AND 2.
 13. LOCAL AND REMOTE DIESEL GENERATOR ALARM AND ANNUNCIATION POINTS ARE AS RECOMMENDED BY VENDOR.
 14. DIESEL FUEL LINE TO ENGINE IS ROUTED IN TRENCH.
 15. FUEL OIL SUCTION CONNECTION FROM DAY TANK SIDE IS ABOVE POTENTIAL FLOODING LEVEL.
 16. ALL INSTRUMENTATION AND EQUIPMENT FOR SYSTEM PACKAGE IS FURNISHED BY DIESEL GENERATOR VENDOR.
 17. SIGNAL INTERFACES ORIGINATING FROM THE DIESEL GENERATOR PACKAGES ARE IDENTIFIED BY SLD *ZOS EX 028.
 18. TEST AND SAMPLE POINTS NOT SHOWN.
 19. GENERATOR TRENCH SIGNAL IS ACTIVATED ON OCCURRENCE OF ANY OF THE FOLLOWING CONDITIONS, THE CONDITIONS ARE ALIGNED THROUGH SCS:
 1. LOSS OF GENERATOR FIELD AND
 2. GENERATOR OVERCURRENT (OV) AND
 3. GENERATOR REC. SCS DISCONNECT AND
 4. GENERATOR REV. PWR ACTIVATION (CV)
 20. EQUIPMENT CONNECTION FLANGE ONLY.
 21. DIESEL ENGINE AND GENERATOR ARE SKID MOUNTED AS A SINGLE MECHANICAL PACKAGE.
 22. SELF-CONTAINED, SELF-POWERED, THREE-WAY THERMOSTATIC VALVE.

Inside Diesel Generator Building


Figure 8.3.1-4 (Sheet 2 of 2)

**Diesel Generator System
Piping and Instrumentation Diagram**

(REF) ZOS 002

NOTES

- 1. THIS DESIGN TYPICAL AND FUNCTIONAL FOR ANY OFFERED DIESEL GENERATOR MANUFACTURER.
- 2. TEST AND SAMPLE POINTS NOT SHOWN.
- 3. ALL SKID MOUNTED PIPING SYSTEMS INTERFACE WITH ZOS-PE-001.
- 4. ALL PIPING SYSTEMS AND INSTRUMENTATION/CONTROLS ARE MANUFACTURER'S STANDARD.

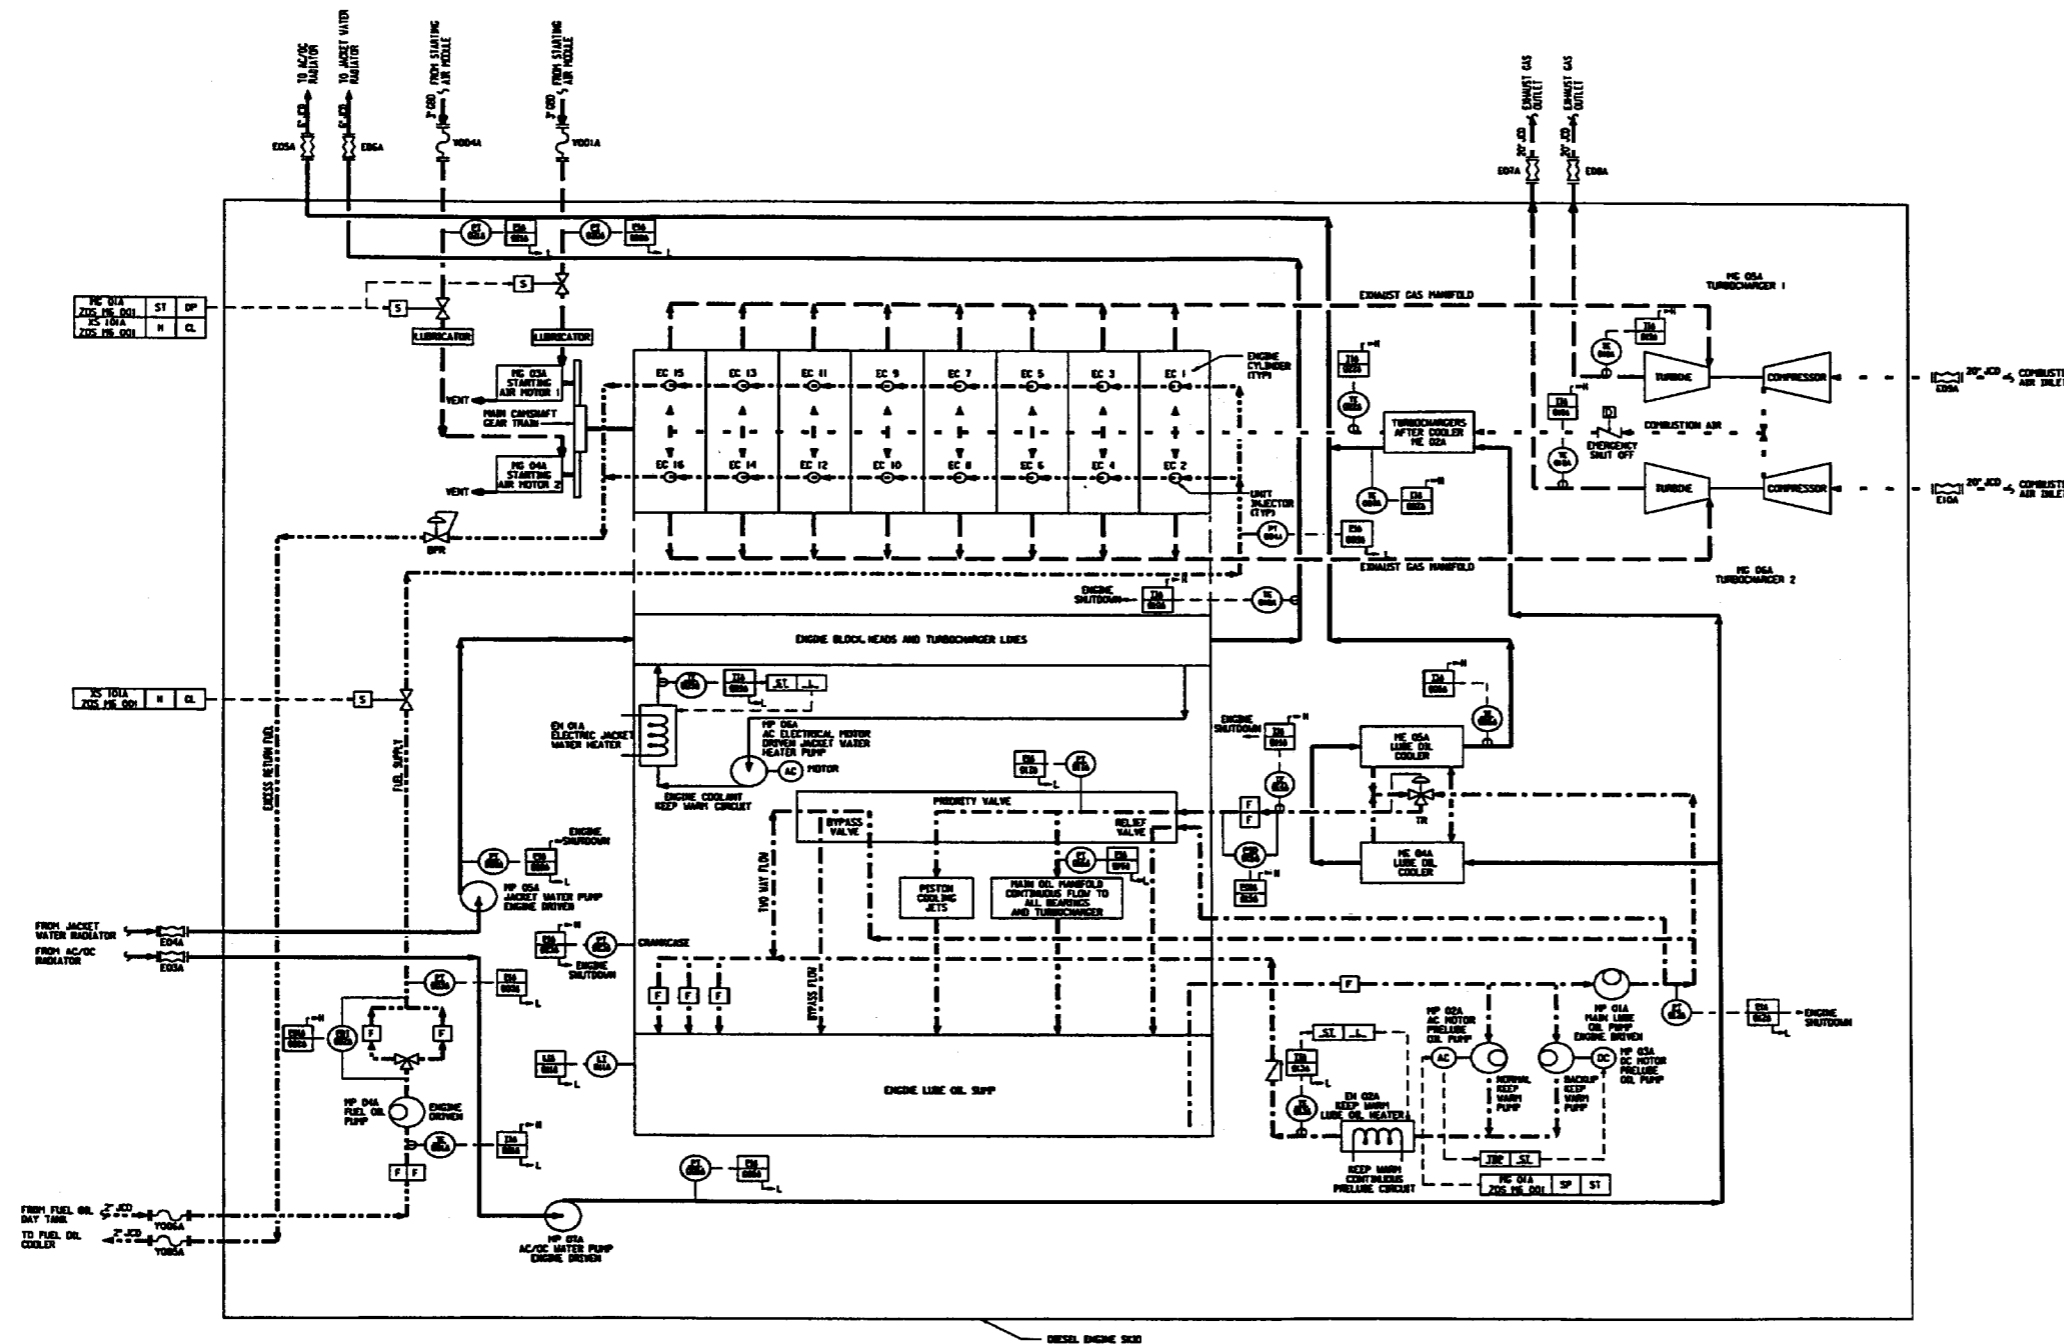

LEGEND

- COMBUSTION AIR INLET SYSTEM
- EXHAUST GAS SYSTEM
- AC/DC & JACKET WATER COOLING SYSTEM
- FUEL OIL SYSTEM
- ENGINE LUBE OIL SYSTEM
- STARTING AIR SYSTEM

Inside Diesel Generator Building


Figure 8.3.1-5 (Sheet 1 of 2)

Diesel Engine Skid Mounted System

(REF) ZOS K001

NOTES

- 1. THIS DESIGN TYPICAL AND FUNCTIONAL FOR ANY OFFERED DIESEL GENERATOR MANUFACTURER.
- 2. TEST AND SAMPLE POINTS NOT SHOWN.
- 3. ALL SKID MOUNTED PIPING SYSTEMS INTERFACE WITH ZOS-PSE-002.
- 4. ALL PIPING SYSTEMS AND INSTRUMENTATION/CONTROLS ARE MANUFACTURER'S STANDARD.

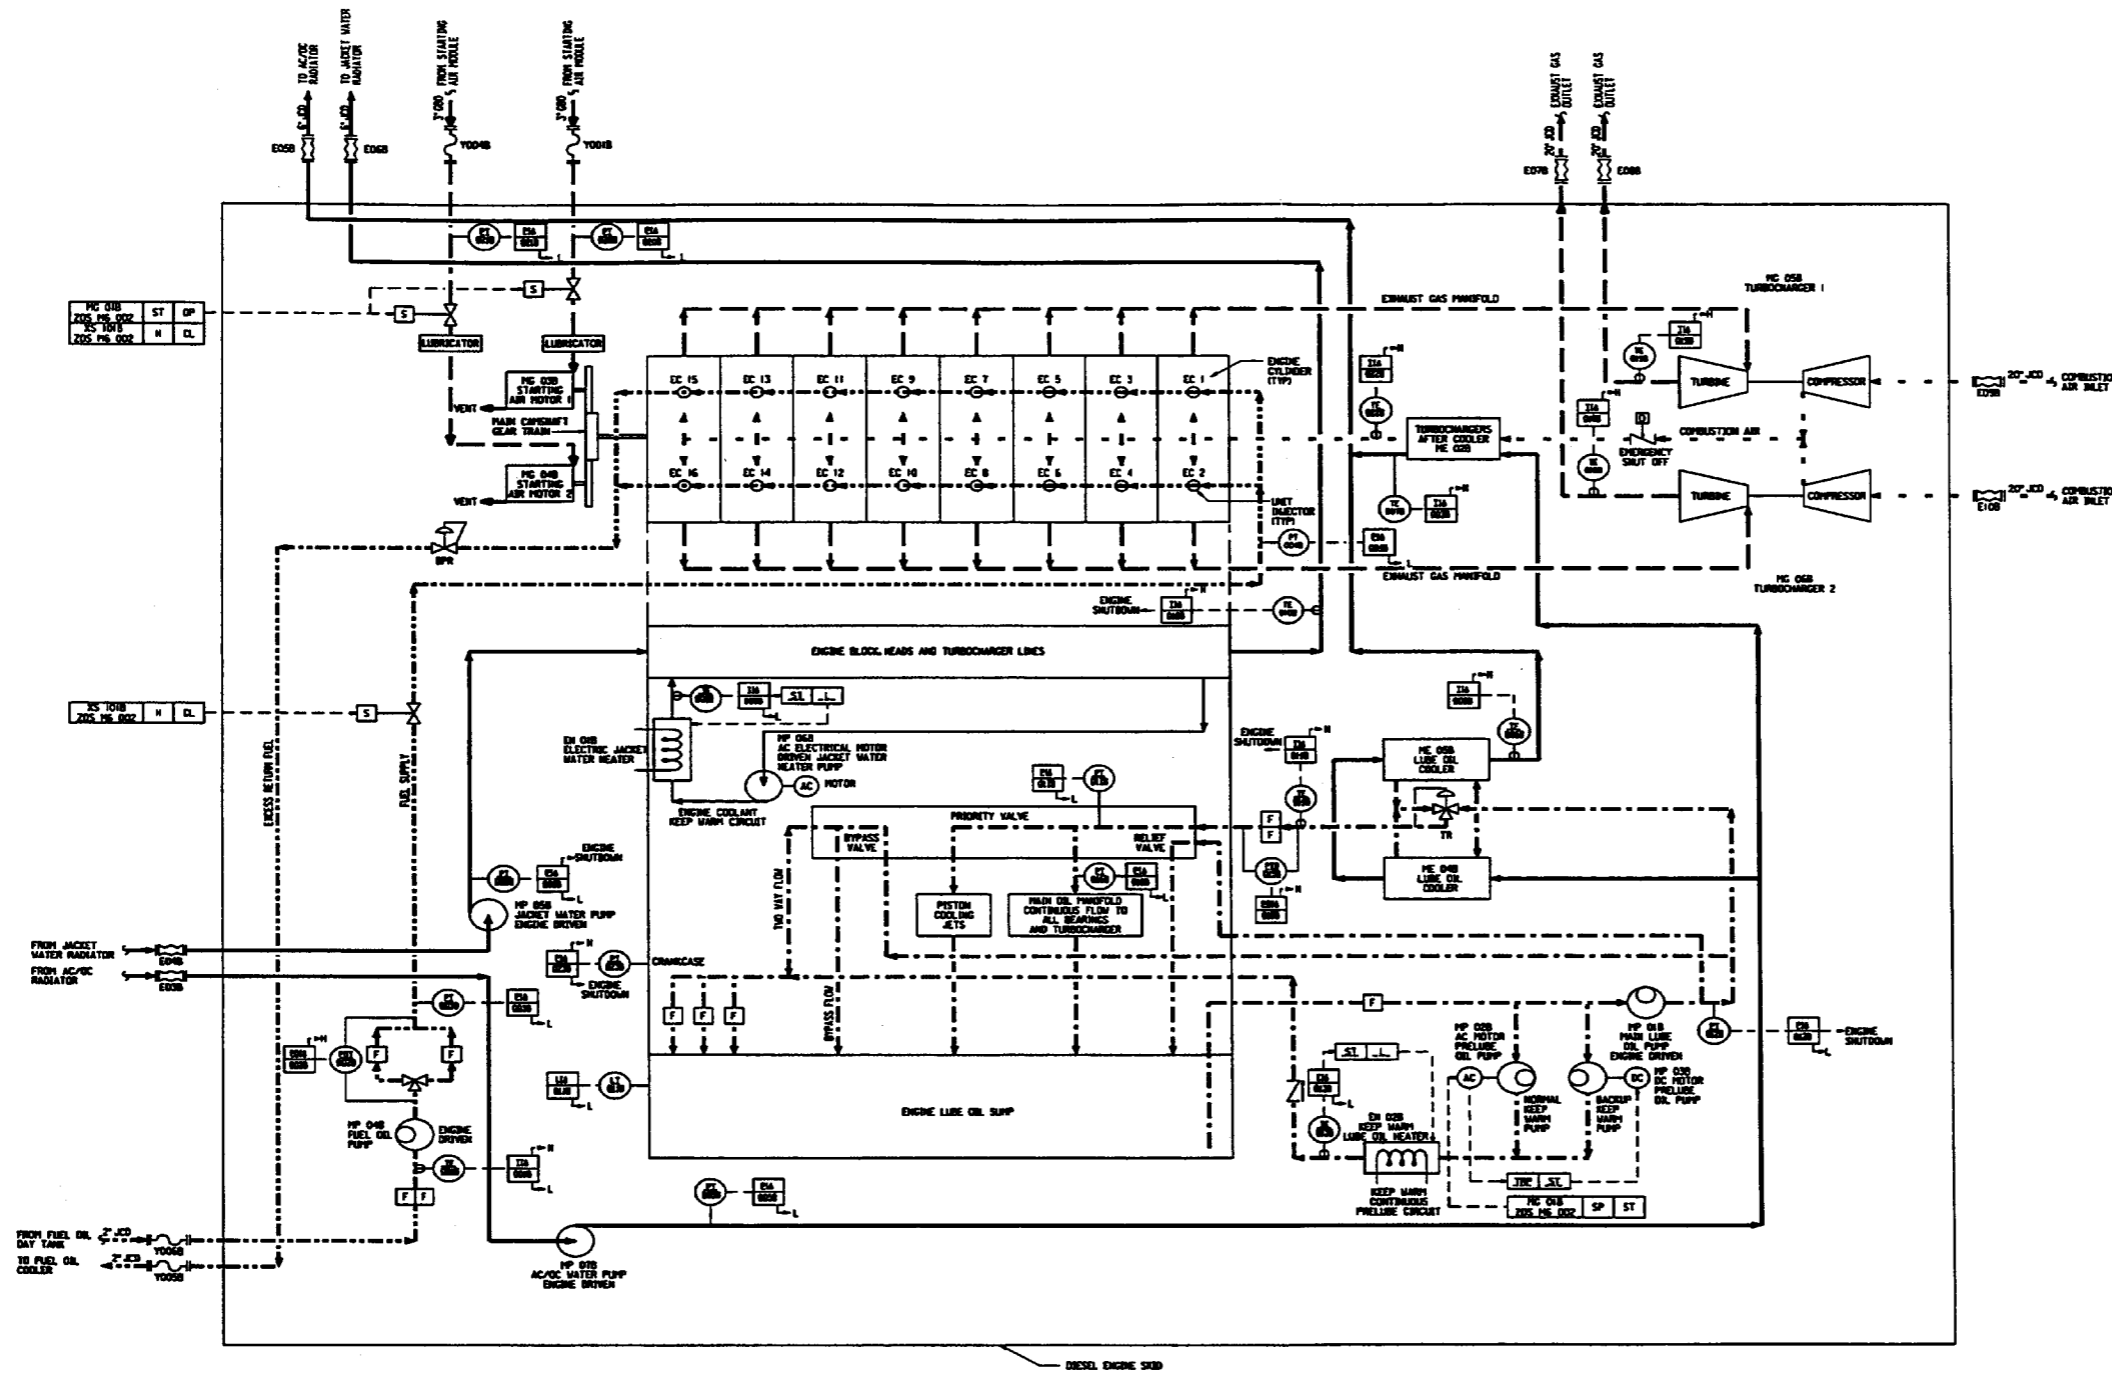


Inside Diesel Generator Building


Figure 8.3.1-5 (Sheet 2 of 2)

Diesel Engine Skid Mounted System


(REF) ZOS K002

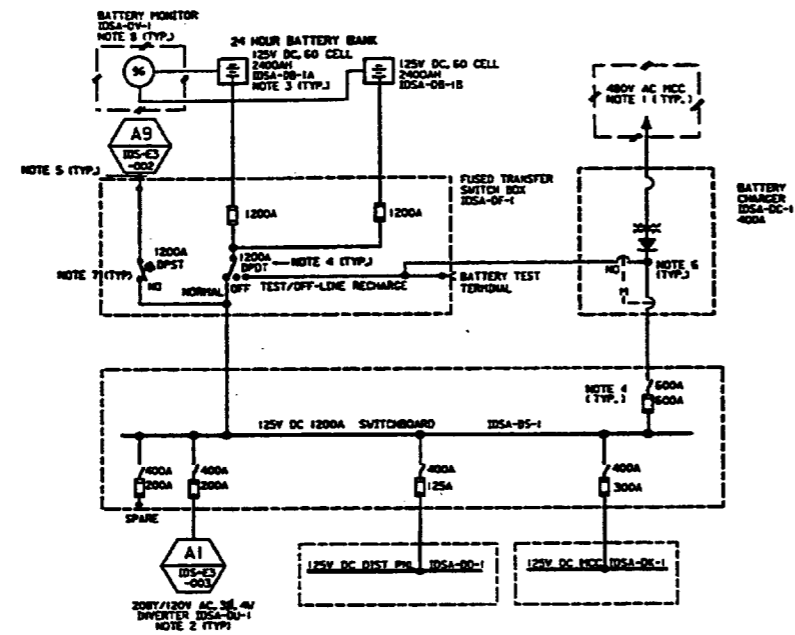

24 HOUR BATTERY BANK (DIVISION A)

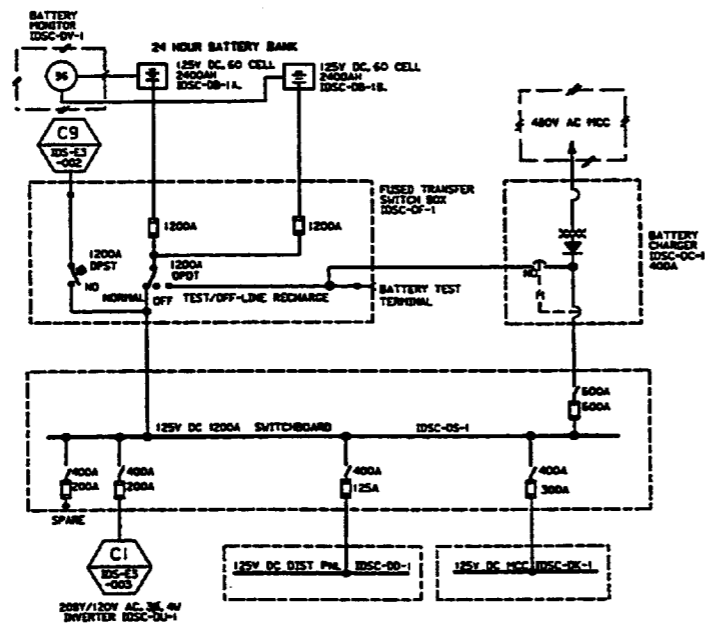

24 HOUR BATTERY BANK (DIVISION C)

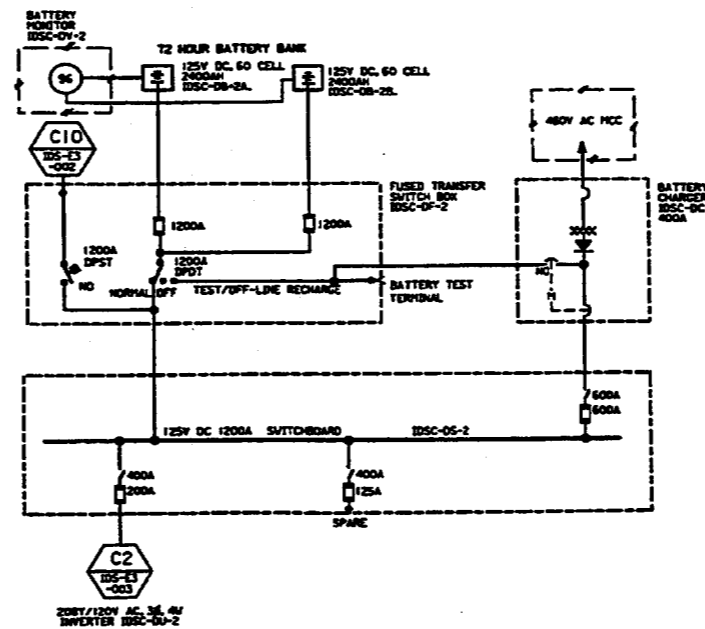

72 HOUR BATTERY BANK (DIVISION C)

NOTES

1. 480V AC INPUT POWER TO BATTERY CHARGERS IS PROVIDED FROM ON-SITE STANDBY DIESEL GENERATOR BACKED MCC.
2. SEE DMC NO. IDS-E3-003 FOR UPS CONFIGURATION.
3. BATTERY AMPERE-HOUR RATING IS BASED ON 8 HOURS DISCHARGE RATE.
4. ALL FUSIBLE DISCONNECT SWITCHES ARE RATED FOR 100 KA SHORT CIRCUIT RATING. THE 1200A SWITCH RATING IS CAPABLE OF CARRYING 2000A FOR UP TO 2 HOURS.
5. SPARE CLASS 1E BATTERY BANK WITH SPARE CLASS 1E BATTERY CHARGER IS UTILIZED FOR CLASS 1E DC SYSTEM AS A TEMPORARY REPLACEMENT FOR ANY 24 HR OR 72 HR BATTERY BANK ONE AT A TIME. SPARE CLASS 1E BATTERY BANK WITHOUT SPARE CLASS 1E BATTERY CHARGER CAN BE USED AS A TEMPORARY POWER SOURCE FOR NON-CLASS 1E DC SYSTEM.
6. MECHANICAL INTERLOCK IS PROVIDED TO PERMIT CLOSING ONLY ONE CIRCUIT BREAKER AT A TIME.
7. LEM-KEY INTERLOCK SWITCH IS PROVIDED TO PREVENT TRANSFER OPERATION OF MORE THAN ONE SWITCHBOARD AT A TIME.
8. FOR LEGEND AND ABBREVIATION SEE DMS CH-E3-001, -002 AND -003.

REFERENCE DRAWINGS

TITLE	DWG. NO.
AC POWER SYSTEM - STATION ONE LINE DIAGRAM	ECS-E3-001 & 2
CLASS 1E DC SYSTEM - STATION ONE LINE DIAGRAM DIV. B, D & SPARE	DS-E3-002
CLASS 1E UPS SYSTEM - STATION ONE LINE DIAGRAM DIV. A, B, C & D	IDS-E3-003
CLASS 1E DC SYSTEM ONE LINE METER & RELAY DIAGRAM	IDS-E3-004 TRNG 010

Figure 8.3.2-1 (Sheet 1 of 2)

Class 1E DC System One Line Diagram

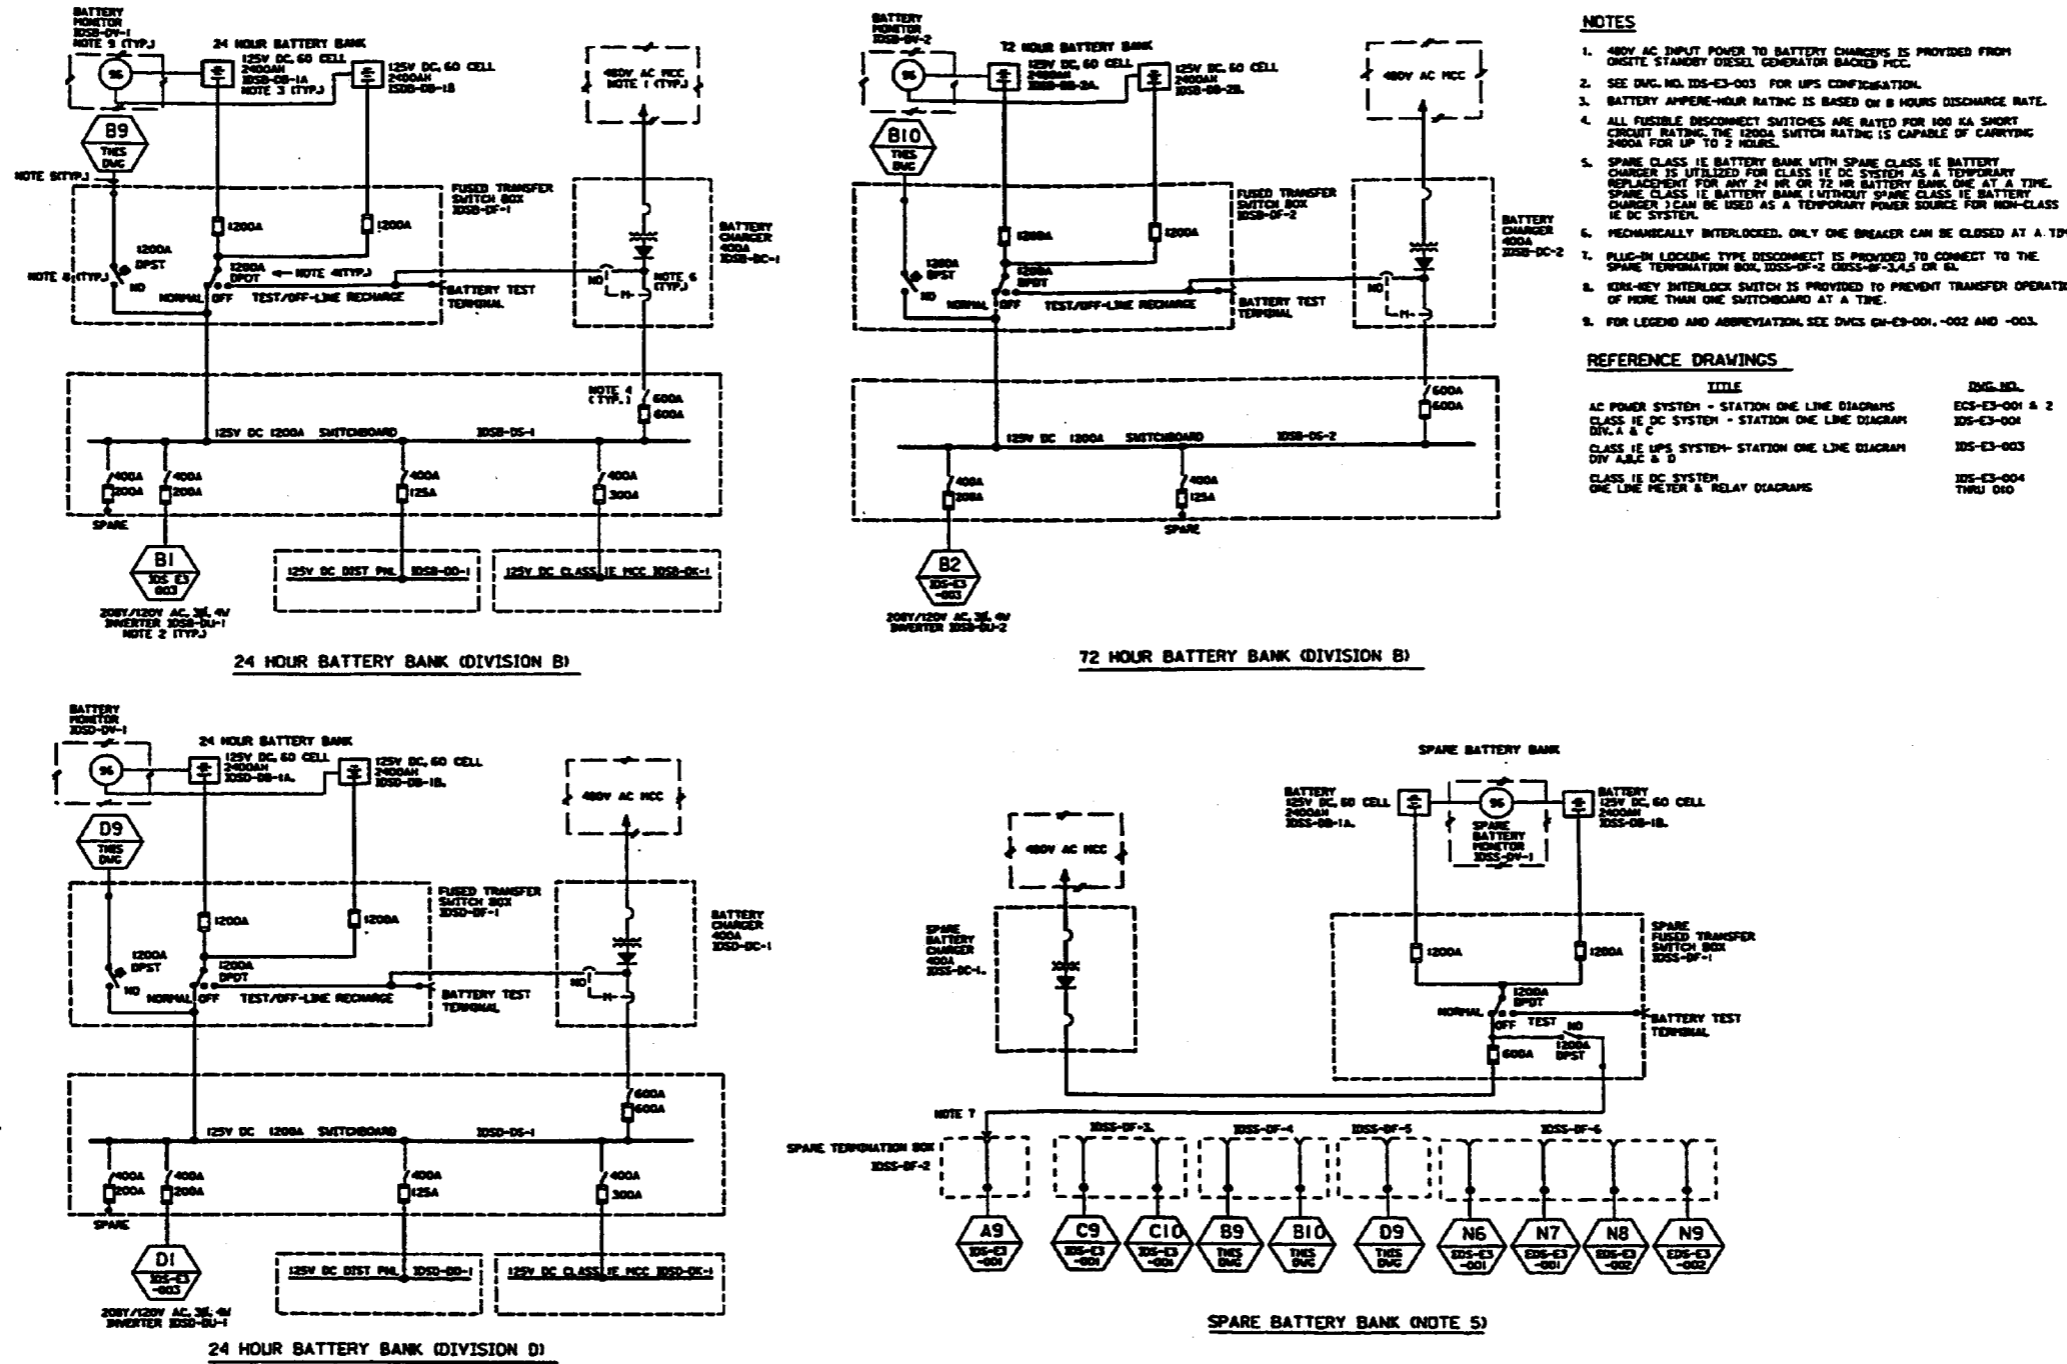


Figure 8.3.2-1 (Sheet 2 of 2)

Class 1E DC System One Line Diagram


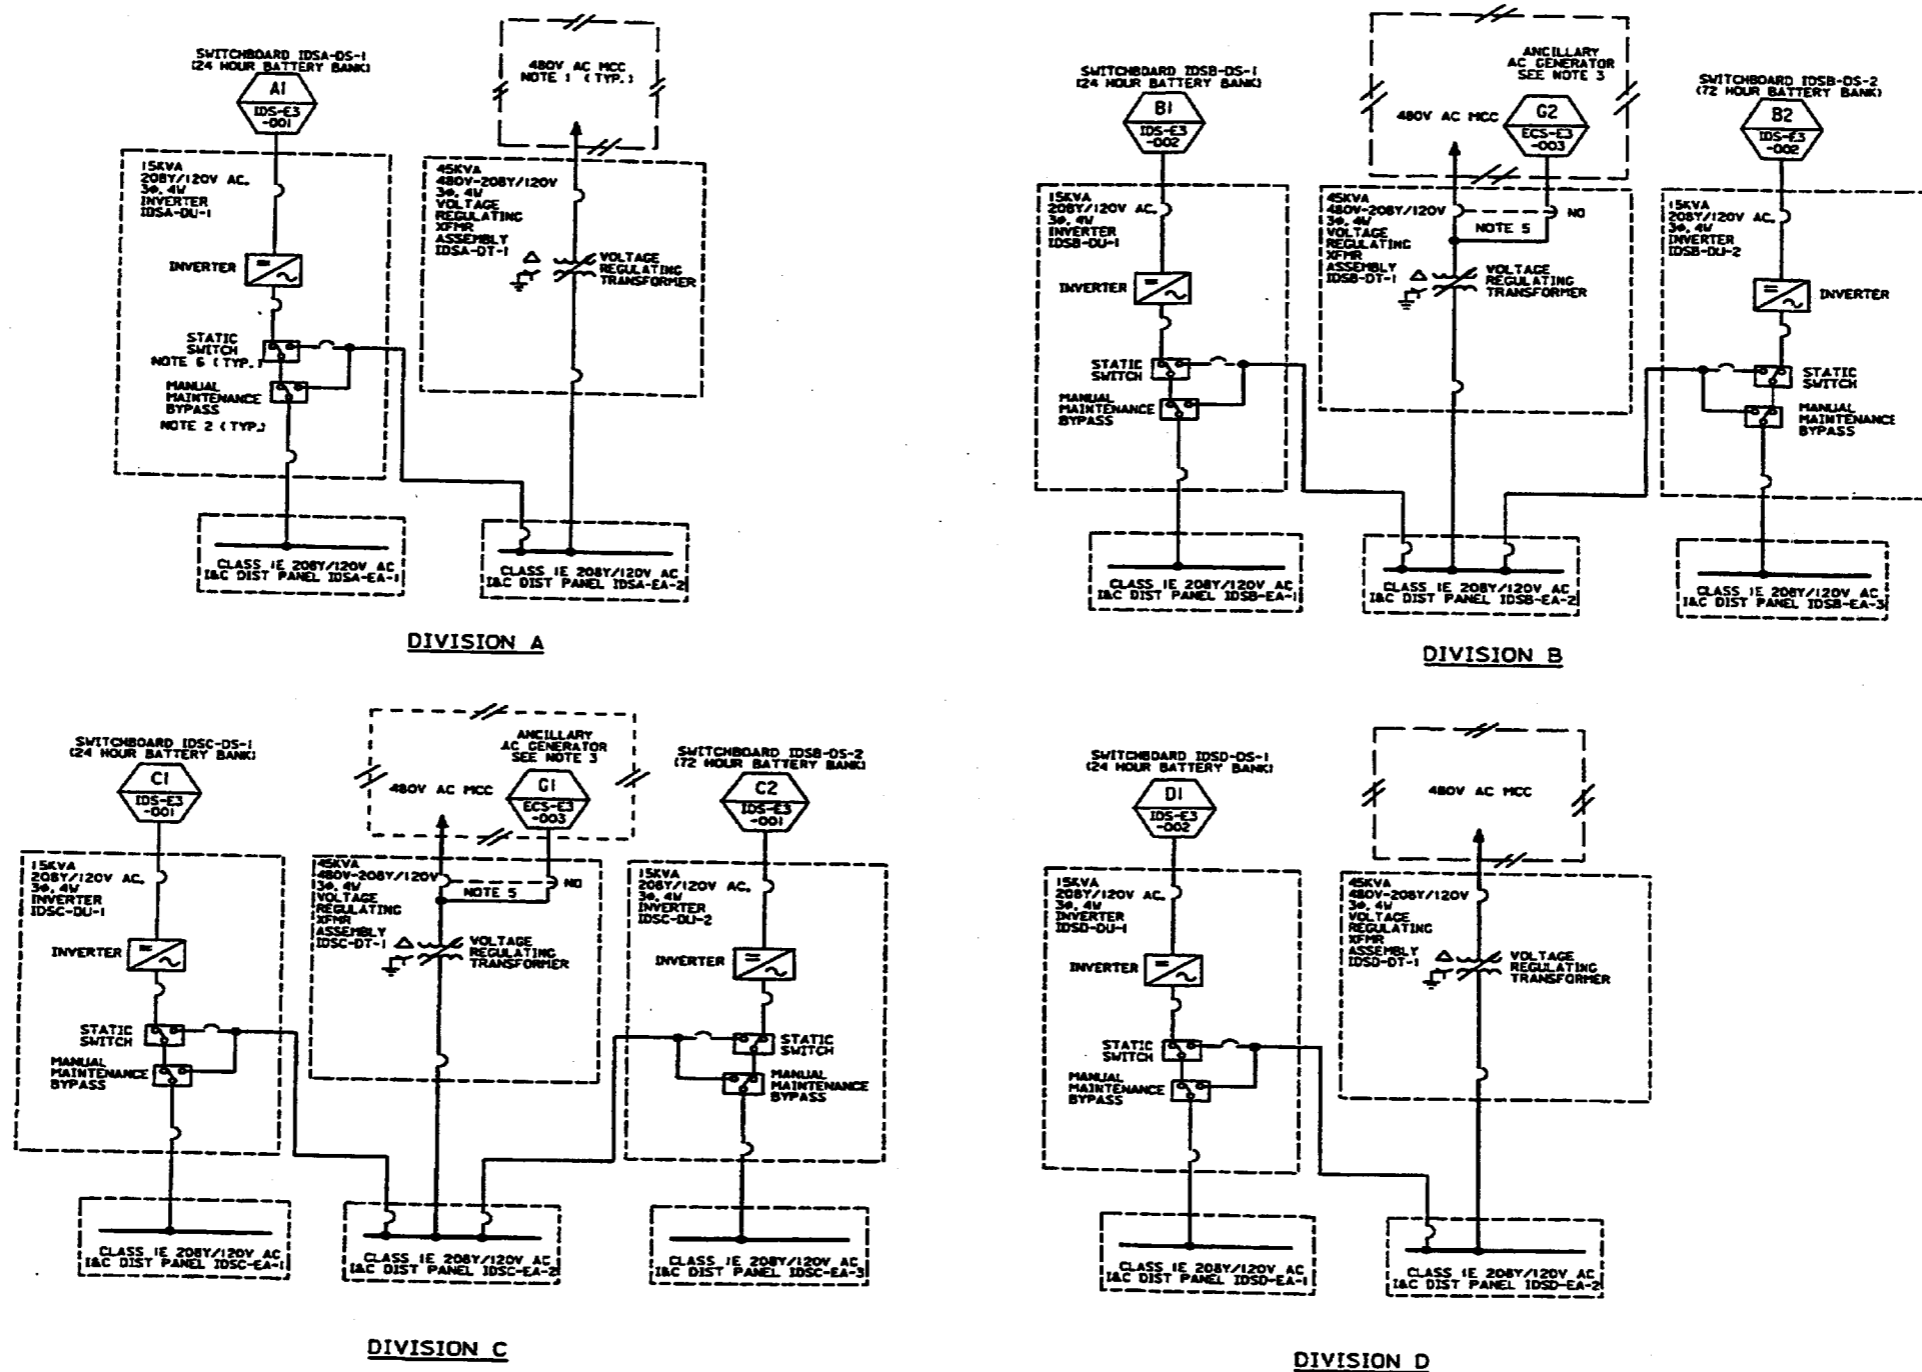


Figure 8.3.2-2

Class 1E 208y/120V UPS One Line Diagram

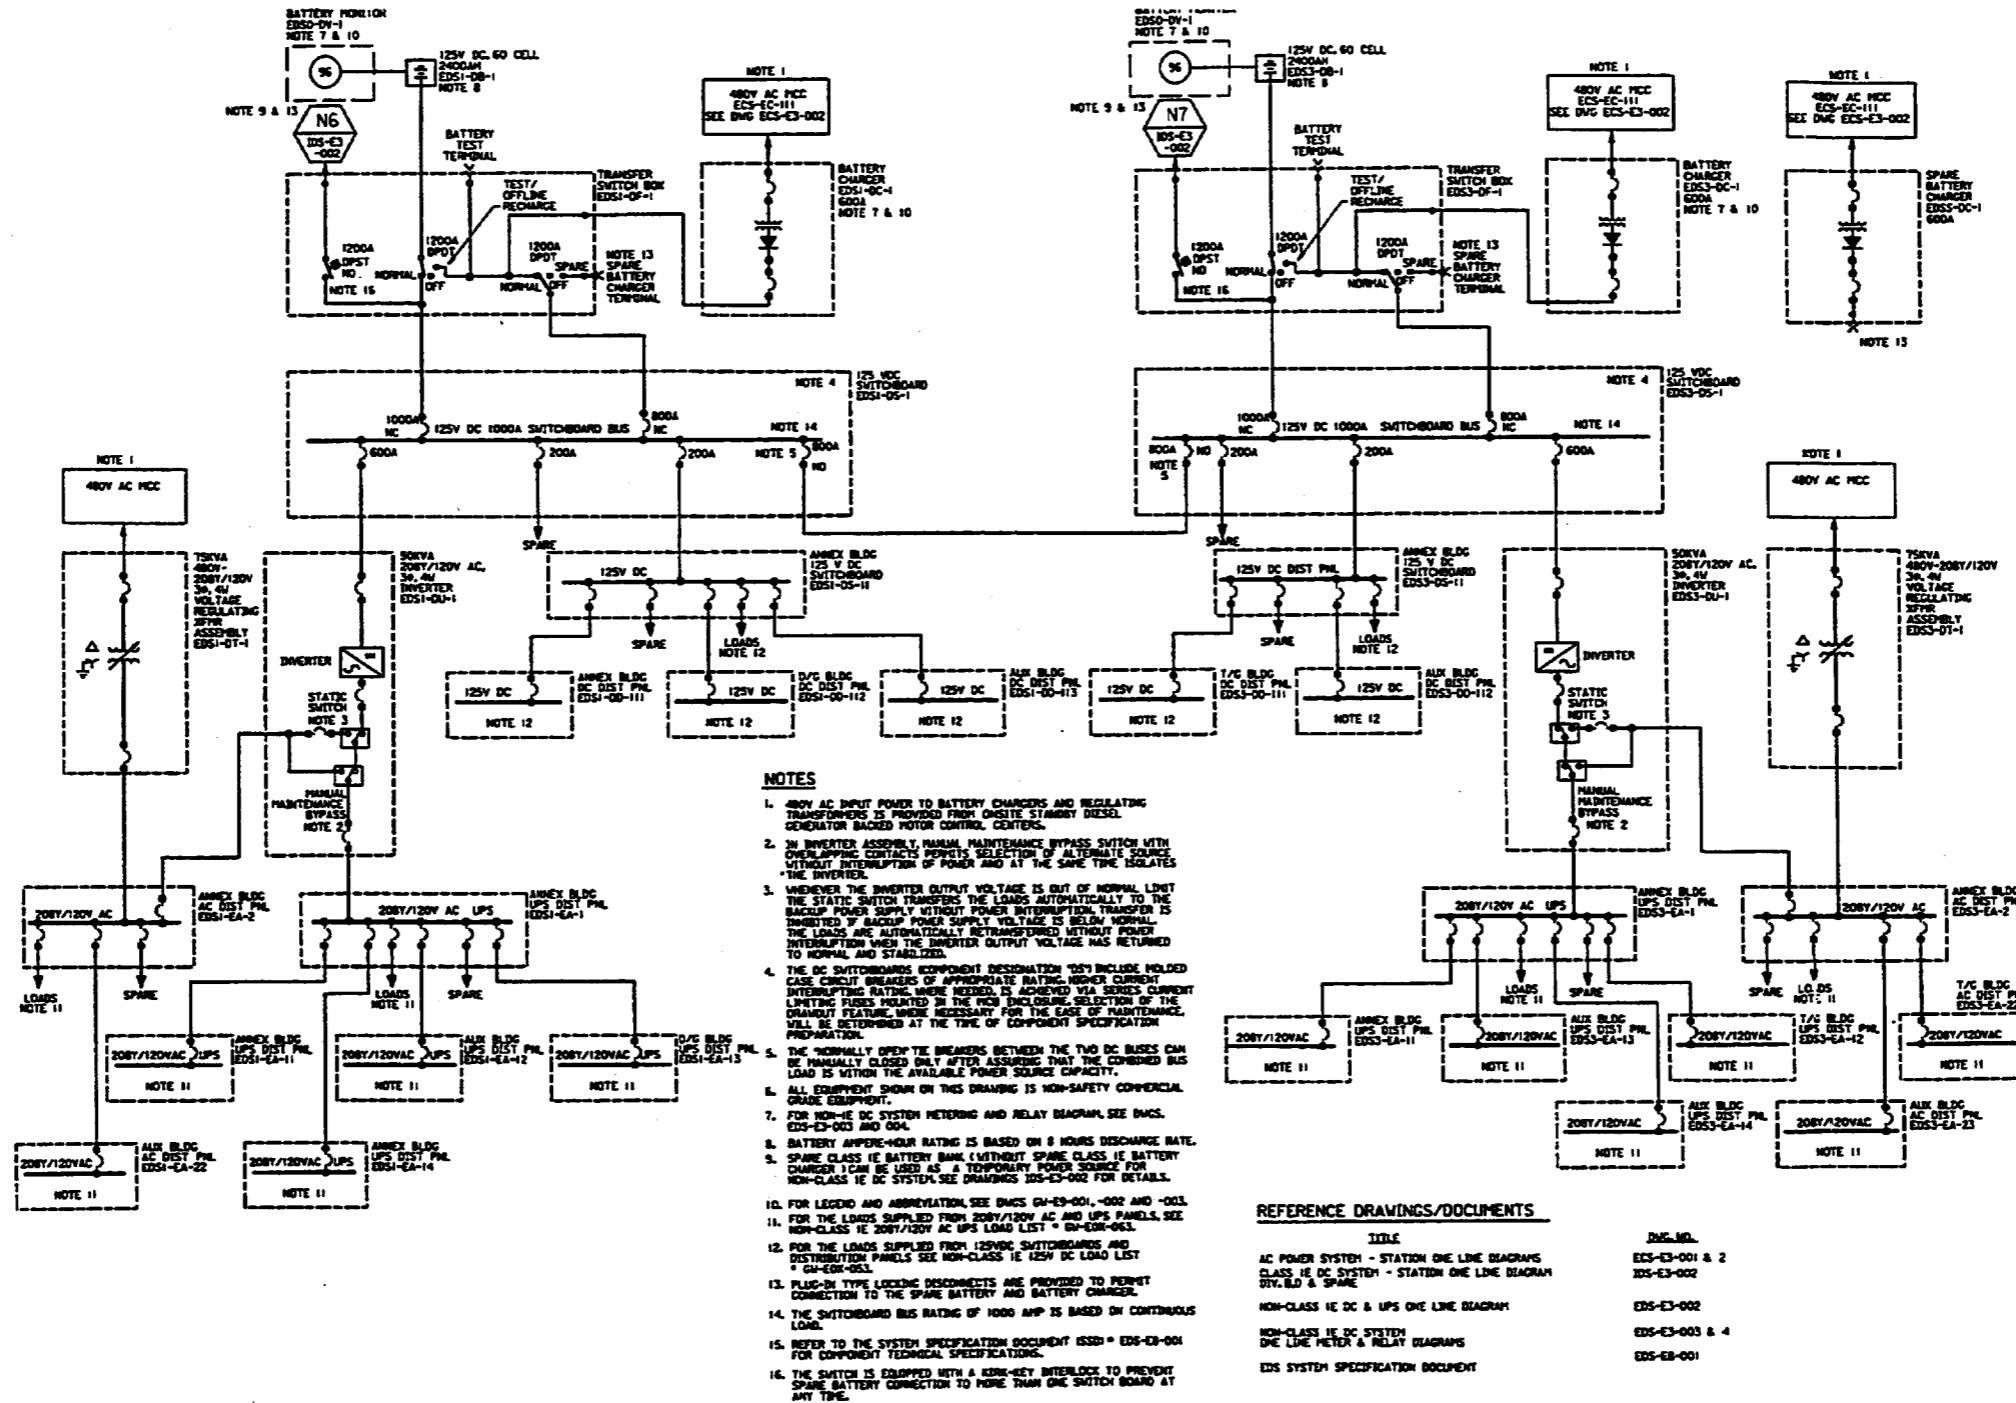


- NOTES**
- 480V AC INPUT POWER TO BATTERY CHARGERS AND REGULATING TRANSFORMERS IS PROVIDED FROM ON-SITE STANDBY DIESEL GENERATOR BACKED MOTOR CONTROL CENTERS.
 - IN INVERTER ASSEMBLY, MANUAL MAINTENANCE BYPASS SWITCH WITH OVERLAPPING CONTACTS PERMITS SELECTION OF ALTERNATE SOURCE WITHOUT INTERRUPTION OF POWER AND AT THE SAME TIME ISOLATES THE INVERTER.
 - WHENEVER THE INVERTER OUTPUT VOLTAGE IS OUT OF NORMAL LIMIT THE STATIC SWITCH TRANSFERS THE LOADS AUTOMATICALLY TO THE BACKUP POWER SUPPLY WITHOUT POWER INTERRUPTION. TRANSFER IS INHIBITED IF BACKUP POWER SUPPLY VOLTAGE IS BELOW NORMAL. THE LOADS ARE AUTOMATICALLY RETRANSFERRED WITHOUT POWER INTERRUPTION WHEN THE INVERTER OUTPUT VOLTAGE HAS RETURNED TO NORMAL AND STABILIZED.
 - THE DC SWITCHBOARDS COMPONENT DESIGNATION 'OS' INCLUDES MOULDED CASE CIRCUIT BREAKERS OF APPROPRIATE RATING, HIGHER CURRENT INTERRUPTING RATING, WHERE NEEDED, IS ACHIEVED VIA SERIES CURRENT LIMITING FUSES INSTALLED IN THE FUSE INCLUDING SELECTION OF THE DRAWOUT FEATURE, WHERE NECESSARY FOR THE EASE OF MAINTENANCE, WILL BE DETERMINED AT THE TIME OF EQUIPMENT SPECIFICATION PREPARATION.
 - THE NORMALLY OPEN TYPE BREAKERS BETWEEN THE TWO DC BUSES CAN BE MANUALLY CLOSED ONLY AFTER ASSURING THAT THE CONNECTED BUS LOAD IS WITHIN THE AVAILABLE POWER SOURCE CAPACITY.
 - ALL EQUIPMENT SHOWN ON THIS DRAWING IS NON-SAFETY COMMERCIAL GRADE EQUIPMENT.
 - FOR NON-IE DC SYSTEM METERING AND RELAY DIAGRAM, SEE DWGS. EDS-ES-003 AND 004.
 - BATTERY AMPERE-HOUR RATING IS BASED ON 8 HOURS DISCHARGE RATE.
 - SPARE CLASS 1E BATTERY BANK (WITHIN SPARE CLASS 1E BATTERY CHARGER) CAN BE USED AS A TEMPORARY POWER SOURCE FOR NON-CLASS 1E DC SYSTEM. SEE DRAWINGS EDS-E3-002 FOR DETAILS.
 - FOR LEGEND AND ABBREVIATION, SEE DWGS. GW-E3-001, -002 AND -003.
 - FOR THE LOADS SUPPLIED FROM 208Y/120V AC AND UPS PANELS, SEE NON-CLASS 1E 208Y/120V AC UPS LOAD LIST - GW-E08-063.
 - FOR THE LOADS SUPPLIED FROM 125VDC SWITCHBOARDS AND DISTRIBUTION PANELS SEE NON-CLASS 1E 125V DC LOAD LIST - GW-E08-063.
 - PLUG-IN TYPE LOCKING DISCONNECTS ARE PROVIDED TO PERMIT CONNECTION TO THE SPARE BATTERY AND BATTERY CHARGER.
 - THE SWITCHBOARD BUS RATING OF 1000 AMP IS BASED ON CONTINUOUS LOAD.
 - REFER TO THE SYSTEM SPECIFICATION DOCUMENT ISSD - EDS-E3-004 FOR COMPONENT TECHNICAL SPECIFICATIONS.
 - THE SWITCH IS EQUIPPED WITH A KEY-KEY INTERLOCK TO PREVENT SPARE BATTERY CONNECTION TO MORE THAN ONE SWITCH BOARD AT ANY TIME.

REFERENCE DRAWINGS/DOCUMENTS

TITLE	DWG. NO.
AC POWER SYSTEM - STATION ONE LINE DIAGRAMS	ECS-E3-001 & 2
CLASS 1E DC SYSTEM - STATION ONE LINE DIAGRAM DIV. BLD & SPARE	IDS-E3-002
NON-CLASS 1E DC & UPS ONE LINE DIAGRAM	EDS-E3-002
NON-CLASS 1E DC SYSTEM ONE LINE METER & RELAY DIAGRAMS	EDS-E3-003 & 4
DC SYSTEM SPECIFICATION DOCUMENT	EDS-E3-001

Figure 8.3.2-3 (Sheet 1 of 2)

Non-Class 1E DC & UPS System One Line Diagram

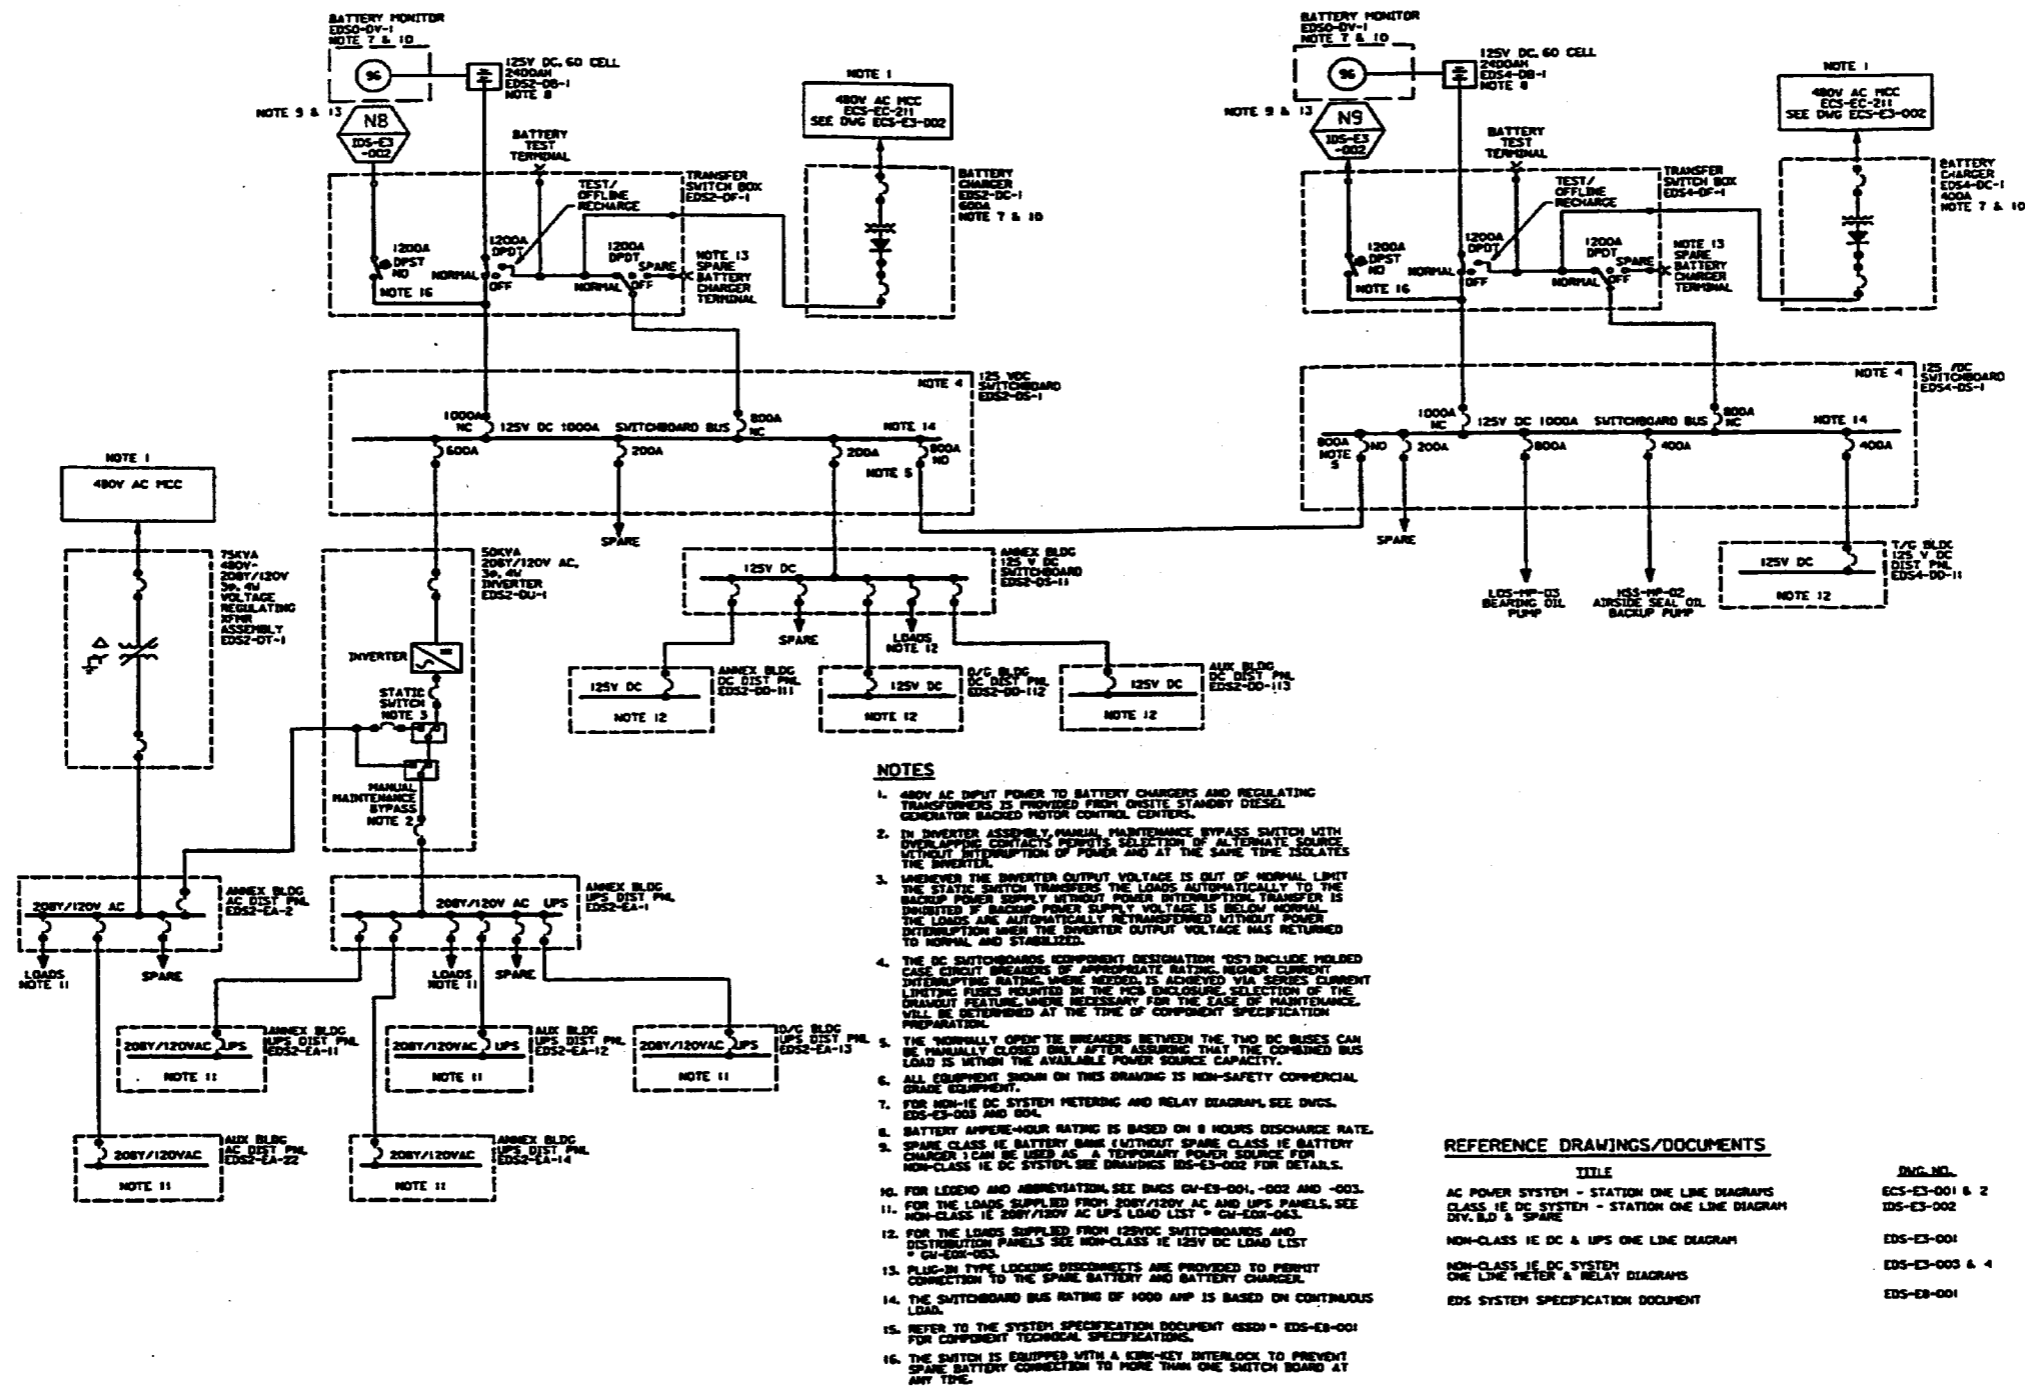

NOTES

- 480V AC DPDT POWER TO BATTERY CHARGERS AND REGULATING TRANSFORMERS IS PROVIDED FROM ONSITE STANDBY DIESEL GENERATOR BACKED MOTOR CONTROL CENTERS.
- IN INVERTER ASSEMBLY, MANUAL MAINTENANCE BYPASS SWITCH WITH OVERLAPPING CONTACTS PERMITS ISOLATION OF ALTERNATE SOURCE WITHOUT INTERRUPTION OF POWER AND AT THE SAME TIME ISOLATES THE INVERTER.
- WHENEVER THE INVERTER OUTPUT VOLTAGE IS OUT OF NORMAL LIMIT THE STATIC SWITCH TRANSFERS THE LOADS AUTOMATICALLY TO THE BACKUP POWER SUPPLY WITHOUT POWER INTERRUPTION. TRANSFER IS INVERTED IF BACKUP POWER SUPPLY VOLTAGE IS BELOW NORMAL. THE LOADS ARE AUTOMATICALLY RETRANSFERRED WITHOUT POWER INTERRUPTION WHEN THE INVERTER OUTPUT VOLTAGE HAS RETURNED TO NORMAL AND STABILIZED.
- THE DC SWITCHBOARDS EQUIPMENT DESIGNATION 'DS' INCLUDE HEATED CASE CIRCUIT BREAKERS OF APPROPRIATE RATING, HIGHER CURRENT INTERRUPTING RATING, WHERE NEEDED, IS ACHIEVED VIA SERIES CURRENT LIMITING FUSES INSTALLED IN THE PCB ENCLOSURE. SELECTION OF THE DRAWOUT FEATURE, WHERE NECESSARY FOR THE EASE OF MAINTENANCE, WILL BE DETERMINED AT THE TIME OF COMPONENT SPECIFICATION PREPARATION.
- THE NORMALLY OPEN BREAKERS BETWEEN THE TWO DC BUSES CAN BE MANUALLY CLOSED ONLY AFTER ASSURING THAT THE COMBINED BUS LOAD IS WITHIN THE AVAILABLE POWER SOURCE CAPACITY.
- ALL EQUIPMENT SHOWN ON THIS DRAWING IS NON-SAFETY COMMERCIAL GRADE EQUIPMENT.
- FOR NON-1E DC SYSTEM METERING AND RELAY DIAGRAM, SEE DWGS. EDS-ES-003 AND 004.
- BATTERY AMPERE-HOUR RATING IS BASED ON 8 HOURS DISCHARGE RATE.
- SPARE CLASS 1E BATTERY BANK (WITHOUT SPARE CLASS 1E BATTERY CHARGER) CAN BE USED AS A TEMPORARY POWER SOURCE FOR NON-CLASS 1E DC SYSTEM. SEE DRAWINGS EDS-ES-002 FOR DETAILS.
- FOR LEGEND AND ABBREVIATIONS, SEE DWGS. GN-ES-001, -002 AND -003. FOR THE LOADS SUPPLIED FROM 208Y/120V AC AND UPS PANELS, SEE NON-CLASS 1E 208Y/120V AC UPS LOAD LIST - GN-ES-003.
- FOR THE LOADS SUPPLIED FROM 125VDC SWITCHBOARDS AND DISTRIBUTION PANELS SEE NON-CLASS 1E 125V DC LOAD LIST - GN-ES-003.
- PLUG-IN TYPE LOCKING DISCONNECTS ARE PROVIDED TO PERMIT CONNECTION TO THE SPARE BATTERY AND BATTERY CHARGER.
- THE SWITCHBOARD BUS RATING OF 1000 AMP IS BASED ON CONTINUOUS LOAD.
- REFER TO THE SYSTEM SPECIFICATION DOCUMENT (SSD) - EDS-ES-001 FOR COMPONENT TECHNICAL SPECIFICATIONS.
- THE SWITCH IS EQUIPPED WITH A COIN-KEY INTERLOCK TO PREVENT SPARE BATTERY CONNECTION TO MORE THAN ONE SWITCH BOARD AT ANY TIME.

REFERENCE DRAWINGS/DOCUMENTS

TITLE	DWG. NO.
AC POWER SYSTEM - STATION ONE LINE DIAGRAMS	ECS-ES-001 & 2
CLASS 1E DC SYSTEM - STATION ONE LINE DIAGRAM DIV. B.D. & SPARE	EDS-ES-002
NON-CLASS 1E DC & UPS ONE LINE DIAGRAM	EDS-ES-001
NON-CLASS 1E DC SYSTEM ONE LINE METER & RELAY DIAGRAMS	EDS-ES-003 & 4
EDS SYSTEM SPECIFICATION DOCUMENT	EDS-ES-001

Figure 8.3.2-3 (Sheet 2 of 2)

Non-Class 1E DC & UPS System One Line Diagram