



Entergy Operations, Inc.
1448 S.R. 333
Russellville, AR 72801
Tel 501 858-5000

10CFR72.48(d)(3)

February 28, 2000

OCAN020005

U. S. Nuclear Regulatory Commission
Document Control Desk
Mail Station OP1-17
Washington, DC 20555

Subject: Arkansas Nuclear One - Units 1 and 2
Docket Nos. 50-313 and 50-368
License Nos. DPR-51 and NPF-6
Annual Radioactive Effluent Release Report for 1999

Gentlemen:

Arkansas Nuclear One (ANO), Units 1 and 2 Technical Specifications 6.12.2.6 and 6.9.3, respectively, require the submittal of an annual Radioactive Effluent Release Report. 10CFR72.44(d)(3) also requires an annual submittal of a summary of effluents from the independent spent fuel storage facility. The purpose of this letter is to complete this reporting requirement for the 1999 calendar year at ANO. Liquid and gaseous release data show that the dose from both ANO-1 and ANO-2 is considerably below the Offsite Dose Calculation Manual limits, while the independent spent fuel storage installation had no effluents. This data reveals that the radioactive effluents have an overall minimal dose contribution to the surrounding environment. Should you have any questions, please contact me.

Very truly yours,

Jimmy D. Vandergrift
Director, Nuclear Safety Assurance

JDV/SLP
Attachments

IE48

cc: Mr. Ellis W. Merschoff
Regional Administrator
U. S. Nuclear Regulatory Commission
Region IV
611 Ryan Plaza Drive, Suite 400
Arlington, TX 76011-8064

NRC Senior Resident Inspector
Arkansas Nuclear One
P.O. Box 310
London, AR 72847

Mr. Christopher Nolan
NRR Project Manager Region IV/ANO-1
U. S. Nuclear Regulatory Commission
NRR Mail Stop 04-D-03
One White Flint North
11555 Rockville Pike
Rockville, MD 20852

Mr. Thomas Alexion
NRR Project Manager Region IV/ANO-2
U. S. Nuclear Regulatory Commission
NRR Mail Stop 04-D-03
One White Flint North
11555 Rockville Pike
Rockville, MD 20852

Dr. Carl J Paperiello, Director
Office of Nuclear Material Safety and Safeguards
U. S. Nuclear Regulatory Commission
Washington, DC 20555

Mr. David D. Snellings
Arkansas Department of Health
Division of Radiation Control
and Emergency Management
4815 West Markham Street
Little Rock, AR 72205

ARKANSAS NUCLEAR ONE

UNIT 1 AND UNIT 2

OPERATING LICENSE NOS. DPR-51 AND NPF-6

ANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

JANUARY 1 THROUGH DECEMBER 31, 1999

TABLE OF CONTENTS

1. INTRODUCTION-----	3
2. REGULATORY LIMITS-----	3
3. SUMMARY OF LIQUID EFFLUENT DATA -----	6
4. SUMMARY OF GASEOUS EFFLUENT DATA -----	15
5. SUMMARY OF RADIATION DOSES -----	24
6. SUMMARY OF DOSE TO MEMBERS OF THE PUBLIC -----	26
7. HISTORICAL EFFLUENT DATA -----	27
8. SOLID WASTE SUMMARY-----	37
9. UNPLANNED RELEASES-----	41
10. RADIATION INSTRUMENTATION -----	42
11. CHANGES TO THE PROCESS CONTROL PROGRAM-----	42
12. CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL-----	42
13. LLD LEVELS -----	43
14. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM -----	44
15. SUMMARY OF HOURLY METEOROLOGICAL DATA -----	44
16. DESCRIPTION OF MAJOR CHANGES TO RADWASTE SYSTEMS-----	44
17. INDEPENDENT SPENT FUEL STORAGE INSTALLATION EFFLUENT RELEASES-----	45

1. INTRODUCTION

Arkansas Nuclear One (ANO) is a two unit site consisting of a Babcock & Wilcox (Unit 1) and a Combustion Engineering (Unit 2) nuclear steam supply system. Both liquid and gaseous effluents are released in accordance with the Offsite Dose Calculation Manual (ODCM). This report is a summary of the effluent data in accordance with Unit 1 TS 6.12.2.6 and Unit 2 TS 6.9.3. This report provides the following information:

- A. Routine radioactive effluent release reports covering the operation of the units and the independent spent fuel storage installation (ISFSI) during the reporting period.
- B. Description of unplanned releases to unrestricted areas.
- C. Description of changes to the Offsite Dose Calculation Manual (ODCM).
- D. Description of changes to the Process Control Program (PCP).
- E. Summary of radiation doses due to radiological effluents during the previous calendar year.
- F. Radiation dose to members of the public due to activities inside the site boundary.
- G. Description of licensee initiated major changes to the radioactive waste systems during the previous calendar year.
- H. Items to be reported in the annual Radioactive Effluent Release Report per other miscellaneous ODCM requirements.

This report covers the period from January 1 through December 31, 1999.

2. REGULATORY LIMITS

The ODCM contains the limits to which ANO must adhere. Because of the "as low as reasonably achievable" (ALARA) philosophy at ANO, an attempt is made to reduce the amount of radiation released to the environment. Liquid and gaseous release data show that the dose from both Unit 1 and Unit 2 is considerably below the ODCM limits. This data reveals that the radioactive effluents have an overall minimal dose contribution to the surrounding environment. The following are the limits required by the ODCM:

A. Gaseous Effluents

1. Dose rate due to radioactive materials released in gaseous effluent to unrestricted areas shall be limited to the following:

- a. Noble gases

- Less than or equal to 500 mrem/year to the total body
 - Less than or equal to 3000 mrem/year to the skin

- b. Iodine-131, tritium, and for all radionuclides in particulate form with half lives greater than 8 days

- Less than or equal to 1500 mrem/yr to any organ

2. Dose - Noble Gases

- Quarterly

- Less than or equal to 5 mrad gamma
 - Less than or equal to 10 mrad beta

- Yearly

- Less than or equal to 10 mrad gamma
 - Less than or equal to 20 mrad beta

3. Dose - Iodine-131, Tritium, and Radionuclides in Particulate Form

- Quarterly

- Less than or equal to 7.5 mrem to any organ

- Yearly

- Less than or equal to 15 mrem to any organ

B. Liquid Effluents

1. Concentration

The concentration of radioactive material released to the discharge canal shall be limited to the concentration specified in 10CFR20, Appendix B, Table II, Column 2, for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the total concentration released shall be limited to $2E-4$ microcuries/ml.

2. Dose

Quarterly

Less than or equal to 1.5 mrem total body
Less than or equal to 5 mrem critical organ

Yearly

Less than or equal to 3 mrem total body
Less than or equal to 10 mrem critical organ

3. SUMMARY OF LIQUID EFFLUENT DATA

As required by Regulatory Guide 1.21, Rev. 1, *Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants*, a summary of data for liquid releases is provided in the annual Radioactive Effluent Release Report. This summary covers releases from January 1 through December 31, 1999. The summary of liquid effluents for both Unit 1 and Unit 2 is as follows:

	<u>Unit 1</u>	<u>Unit 2</u>
Number of releases:	790	249
Total time for all releases (minutes):	249090	547486
Maximum time for a release (minutes):	10165	11635
Average time for a release (minutes):	345	2214
Minimum time for a release (minutes):	10	2

The Unit 1 liquid releases consisted of:

- 789 Planned Releases
- 1 Unplanned Releases

The Unit 2 liquid releases consisted of:

- 249 Planned Releases
- 0 Unplanned Releases

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL LIQUID EFFLUENTS)
 January 1 through June 30, 1999**

Unit 1				
Type of Effluent	Units	Quarter 1	Quarter 2	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Curies	1.622E-02	7.060E-03	0
2. Average Diluted Concentration During Period	μCi/ml	6.499E-11	2.074E-11	
3. Percent of Applicable Limit	%	2.166E-02	6.913E-03	
<u>B. Tritium</u>				
1. Total Release	Curies	1.693E+02	1.889E+02	0
2. Average Diluted Concentration During Period	μCi/ml	6.782E-07	5.548E-07	
3. Percent of Applicable Limit	%	2.261E-02	1.849E-02	
<u>C. Dissolved and Entrained Gases</u>				
1. Total Release	Curies	1.338E-02	3.269E-02	0
2. Average Diluted Concentration During Period	μCi/ml	5.362E-11	9.601E-11	
3. Percent of Applicable Limit	%	2.681E-05	4.800E-05	
<u>D. Gross Alpha Radioactivity</u>				
1. Total Release	Curies	0.000E+00	0.000E+00	0
<u>E. Waste Vol Released (Pre-Dilution)</u>				
	Liters	2.125E+07	1.852E+07	0
<u>F. Volume of Dilution Water Used</u>				
	Liters	2.495E+11	3.404E+11	0

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL LIQUID EFFLUENTS)
 July 1 through December 31, 1999**

Unit 1				
Type of Effluent	Units	Quarter 3	Quarter 4	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Curies	9.383E-02	2.508E-01	0
2. Average Diluted Concentration During Period	μCi/ml	2.717E-10	8.276E-10	
3. Percent of Applicable Limit	%	9.058E-02	2.759E-01	
<u>B. Tritium</u>				
1. Total Release	Curies	2.731E+02	3.619E+01	0
2. Average Diluted Concentration During Period	μCi/ml	7.909E-07	1.194E-07	
3. Percent of Applicable Limit	%	2.636E-02	3.981E-03	
<u>C. Dissolved and Entrained Gases</u>				
1. Total Release	Curies	3.335E-01	6.802E-04	0
2. Average Diluted Concentration During Period	μCi/ml	9.659E-10	2.244E-12	
3. Percent of Applicable Limit	%	4.829E-04	1.122E-06	
<u>D. Gross Alpha Radioactivity</u>				
1. Total Release	Curies	5.498E-04	1.371E-03	0
<u>E. Waste Vol Released (Pre-Dilution)</u>				
	Liters	1.431E+07	1.903E+07	0
<u>F. Volume of Dilution Water Used</u>				
	Liters	3.453E+11	3.030E+11	0

UNIT 1

**REPORT CATEGORY : ANNUAL LIQUID CONTINUOUS AND BATCH
 RELEASES**
: TOTALS FOR EACH NUCLIDE RELEASED
TYPE OF ACTIVITY : ALL RADIONUCLIDES
REPORTING PERIOD : QUARTER # 1 AND QUARTER # 2 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 1	QUARTER 2	QUARTER 1	QUARTER 2
ZR-95	CURIES	0.00E+00	0.00E+00	5.55E-05	0.00E+00
AG-110M	CURIES	0.00E+00	0.00E+00	6.42E-07	1.53E-06
I-135	CURIES	0.00E+00	0.00E+00	2.95E-04	5.72E-06
NB-95	CURIES	0.00E+00	0.00E+00	1.66E-04	7.00E-06
CO-57	CURIES	0.00E+00	0.00E+00	4.27E-05	1.13E-05
TE-132	CURIES	0.00E+00	0.00E+00	7.31E-05	1.82E-05
I-132	CURIES	0.00E+00	0.00E+00	8.64E-05	2.50E-05
I-133	CURIES	0.00E+00	0.00E+00	3.27E-04	3.58E-05
MN-54	CURIES	0.00E+00	0.00E+00	0.00E+00	4.25E-05
I-134	CURIES	0.00E+00	0.00E+00	4.75E-05	4.34E-05
CS-134	CURIES	0.00E+00	0.00E+00	1.65E-04	5.45E-05
XE-135	CURIES	0.00E+00	0.00E+00	0.00E+00	7.02E-05
XE-133M	CURIES	0.00E+00	0.00E+00	0.00E+00	9.30E-05
CS-138	CURIES	0.00E+00	0.00E+00	0.00E+00	1.51E-04
I-131	CURIES	0.00E+00	0.00E+00	2.17E-04	1.69E-04
SB-125	CURIES	0.00E+00	0.00E+00	5.58E-03	6.62E-04
CO-60	CURIES	0.00E+00	0.00E+00	9.13E-04	8.59E-04
NA-24	CURIES	0.00E+00	0.00E+00	1.77E-03	1.27E-03
CO-58	CURIES	0.00E+00	0.00E+00	3.76E-03	1.64E-03
CS-137	CURIES	0.00E+00	0.00E+00	2.72E-03	2.06E-03
XE-133	CURIES	0.00E+00	0.00E+00	1.34E-02	3.25E-02
H-3	CURIES	0.00E+00	0.00E+00	1.69E+02	1.89E+02
Total for Period	CURIES	0.00E+00	0.00E+00	1.69E+02	1.89E+02

UNIT 1

**REPORT CATEGORY : ANNUAL LIQUID CONTINUOUS AND BATCH
 RELEASES**
: TOTALS FOR EACH NUCLIDE RELEASED
TYPE OF ACTIVITY : ALL RADIONUCLIDES
REPORTING PERIOD : QUARTER # 3 AND QUARTER # 4 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 3	QUARTER 4	QUARTER 3	QUARTER 4
NB-97	CURIES	0.00E+00	0.00E+00	1.32E-05	0.00E+00
LA-140	CURIES	0.00E+00	0.00E+00	1.90E-05	0.00E+00
SB-122	CURIES	0.00E+00	0.00E+00	5.82E-05	0.00E+00
XE-133M	CURIES	0.00E+00	0.00E+00	5.60E-03	0.00E+00
KR-85	CURIES	0.00E+00	0.00E+00	1.41E-02	0.00E+00
I-133	CURIES	0.00E+00	0.00E+00	3.50E-05	1.16E-06
MN-54	CURIES	0.00E+00	0.00E+00	8.52E-06	2.21E-06
ZR-95	CURIES	0.00E+00	0.00E+00	1.06E-05	6.99E-06
CS-134	CURIES	0.00E+00	0.00E+00	3.17E-04	3.33E-05
CO-57	CURIES	0.00E+00	0.00E+00	0.00E+00	5.73E-05
AG-110M	CURIES	0.00E+00	0.00E+00	1.06E-04	8.22E-05
SE-75	CURIES	0.00E+00	0.00E+00	0.00E+00	9.18E-05
I-132	CURIES	0.00E+00	0.00E+00	0.00E+00	9.20E-05
NB-95	CURIES	0.00E+00	0.00E+00	1.10E-05	9.99E-05
CR-51	CURIES	0.00E+00	0.00E+00	2.52E-03	1.07E-04
FE-59	CURIES	0.00E+00	0.00E+00	6.60E-05	2.40E-04
XE-135	CURIES	0.00E+00	0.00E+00	1.42E-02	2.52E-04
XE-133	CURIES	0.00E+00	0.00E+00	3.00E-01	4.28E-04
CS-137	CURIES	0.00E+00	0.00E+00	2.42E-03	8.77E-04
G-ALPHA	CURIES	0.00E+00	1.01E-03	5.50E-04	3.60E-04
I-131	CURIES	0.00E+00	0.00E+00	9.43E-04	1.91E-03
CO-60	CURIES	0.00E+00	0.00E+00	1.17E-03	2.92E-03
NA-24	CURIES	0.00E+00	3.25E-03	9.59E-04	9.55E-04
SB-124	CURIES	0.00E+00	0.00E+00	3.61E-04	7.07E-03
SB-125	CURIES	0.00E+00	0.00E+00	7.60E-02	5.15E-02
CO-58	CURIES	0.00E+00	0.00E+00	8.81E-03	1.82E-01
H-3	CURIES	0.00E+00	4.05E-02	2.73E+02	3.62E+01
Total for Period	CURIES	0.00E+00	4.48E-02	2.74E+02	3.64E+01

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL LIQUID EFFLUENTS)
 January 1 through June 30, 1999**

Type of Effluent	Unit 2			
	Units	Quarter 1	Quarter 2	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Curies	4.086E-02	3.035E-03	0
2. Average Diluted Concentration During Period	µCi/ml	1.637E-10	8.915E-12	
3. Percent of Applicable Limit	%	5.458E-02	2.972E-03	
<u>B. Tritium</u>				
1. Total Release	Curies	4.593E+01	5.043E+01	0
2. Average Diluted Concentration During Period	µCi/ml	1.840E-07	1.481E-07	
3. Percent of Applicable Limit	%	6.134E-03	4.937E-03	
<u>C. Dissolved and Entrained Gases</u>				
1. Total Release	Curies	1.148E-02	1.130E-03	0
2. Average Diluted Concentration During Period	µCi/ml	4.601E-11	3.320E-12	
3. Percent of Applicable Limit	%	2.300E-05	1.660E-06	
<u>D. Gross Alpha Radioactivity</u>				
1. Total Release	Curies	0.000E+00	4.389E-04	0
<u>E. Waste Vol Released (Pre-Dilution)</u>				
	Liters	1.704E+07	1.448E+07	0
<u>F. Volume of Dilution Water Used</u>				
	Liters	2.495E+11	3.404E+11	0

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL LIQUID EFFLUENTS)
 July 1 through December 31, 1999**

Unit 2

Type of Effluent	Units	Quarter 3	Quarter 4	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release (Not Including Tritium, Gases, Alpha)	Curies	7.849E-03	3.344E-02	0
2. Average Diluted Concentration During Period	µCi/ml	2.273E-11	1.103E-10	
3. Percent of Applicable Limit	%	7.577E-03	3.678E-02	
<u>B. Tritium</u>				
1. Total Release	Curies	1.460E+02	3.453E+02	0
2. Average Diluted Concentration During Period	µCi/ml	4.229E-07	1.139E-06	
3. Percent of Applicable Limit	%	1.410E-02	3.798E-02	
<u>C. Dissolved and Entrained Gases</u>				
1. Total Release	Curies	7.075E-04	9.487E-03	0
2. Average Diluted Concentration During Period	µCi/ml	2.049E-12	3.130E-11	
3. Percent of Applicable Limit	%	1.024E-06	1.565E-05	
<u>D. Gross Alpha Radioactivity</u>				
1. Total Release	Curies	0.000E+00	0.000E+00	0
<u>E. Waste Vol Released (Pre-Dilution)</u>				
	Liters	2.099E+07	2.795E+07	0
<u>F. Volume of Dilution Water Used</u>				
	Liters	3.453E+11	3.030E+11	0

UNIT 2

**REPORT CATEGORY : ANNUAL LIQUID CONTINUOUS AND BATCH
 RELEASES**
: TOTALS FOR EACH NUCLIDE RELEASED
TYPE OF ACTIVITY : ALL RADIONUCLIDES
REPORTING PERIOD : QUARTER # 1 AND QUARTER # 2 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 1	QUARTER 2	QUARTER 1	QUARTER 2
NB-97	CURIES	0.00E+00	0.00E+00	3.02E-05	0.00E+00
ZR-95	CURIES	0.00E+00	0.00E+00	4.39E-05	0.00E+00
SN-117M	CURIES	0.00E+00	0.00E+00	7.30E-05	0.00E+00
I-133	CURIES	0.00E+00	0.00E+00	9.64E-05	0.00E+00
SB-125	CURIES	0.00E+00	0.00E+00	1.35E-04	0.00E+00
I-131	CURIES	0.00E+00	0.00E+00	2.27E-04	0.00E+00
FE-59	CURIES	0.00E+00	0.00E+00	2.67E-04	0.00E+00
NA-24	CURIES	0.00E+00	0.00E+00	4.14E-04	0.00E+00
CR-51	CURIES	0.00E+00	0.00E+00	1.25E-03	0.00E+00
FE-55	CURIES	0.00E+00	0.00E+00	3.19E-02	0.00E+00
CS-134	CURIES	0.00E+00	0.00E+00	1.75E-04	1.31E-06
XE-135	CURIES	0.00E+00	0.00E+00	0.00E+00	1.52E-06
LA-140	CURIES	0.00E+00	0.00E+00	2.19E-05	1.10E-05
CO-60	CURIES	0.00E+00	0.00E+00	4.57E-04	5.60E-05
MN-54	CURIES	0.00E+00	0.00E+00	5.61E-05	6.88E-05
CS-137	CURIES	0.00E+00	0.00E+00	3.61E-04	7.10E-05
CO-58	CURIES	0.00E+00	0.00E+00	3.66E-03	3.56E-04
G-ALPHA	CURIES	0.00E+00	0.00E+00	0.00E+00	4.39E-04
XE-133	CURIES	0.00E+00	0.00E+00	1.15E-02	1.13E-03
AG-110M	CURIES	0.00E+00	0.00E+00	1.65E-03	2.47E-03
H-3	CURIES	0.00E+00	0.00E+00	4.59E+01	5.04E+01
Total for Period	CURIES	0.00E+00	0.00E+00	4.60E+01	5.04E+01

UNIT 2

**REPORT CATEGORY : ANNUAL LIQUID CONTINUOUS AND BATCH
 RELEASES**
: TOTALS FOR EACH NUCLIDE RELEASED
TYPE OF ACTIVITY : ALL RADIONUCLIDES
REPORTING PERIOD : QUARTER # 3 AND QUARTER # 4 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 3	QUARTER 4	QUARTER 3	QUARTER 4
NA-24	CURIES	0.00E+00	0.00E+00	1.98E-04	0.00E+00
MN-54	CURIES	0.00E+00	0.00E+00	0.00E+00	3.11E-05
SB-126	CURIES	0.00E+00	0.00E+00	0.00E+00	6.08E-05
ZR-95	CURIES	0.00E+00	0.00E+00	0.00E+00	8.02E-05
TE-132	CURIES	0.00E+00	0.00E+00	0.00E+00	8.82E-05
LA-140	CURIES	0.00E+00	0.00E+00	0.00E+00	1.89E-04
I-132	CURIES	0.00E+00	0.00E+00	0.00E+00	2.11E-04
CS-137	CURIES	0.00E+00	0.00E+00	1.49E-04	2.35E-04
CO-60	CURIES	0.00E+00	0.00E+00	2.21E-04	3.38E-04
BE-7	CURIES	0.00E+00	0.00E+00	2.57E-04	4.11E-04
CR-51	CURIES	0.00E+00	0.00E+00	0.00E+00	9.55E-04
CO-58	CURIES	0.00E+00	0.00E+00	2.63E-04	1.03E-03
AG-110M	CURIES	0.00E+00	0.00E+00	4.52E-03	1.17E-03
SB-124	CURIES	0.00E+00	0.00E+00	2.51E-05	1.25E-03
FE-59	CURIES	0.00E+00	0.00E+00	0.00E+00	1.56E-03
XE-133	CURIES	0.00E+00	0.00E+00	7.07E-04	9.49E-03
SB-125	CURIES	0.00E+00	0.00E+00	2.21E-03	2.58E-02
H-3	CURIES	0.00E+00	4.85E-01	1.46E+02	3.44E+02
Total for Period	CURIES	0.00E+00	4.85E-01	1.46E+02	3.44E+02

4. SUMMARY OF GASEOUS EFFLUENT DATA

As required by Regulatory Guide 1.21, Rev. 1, a summary of data for gaseous releases is provided in the annual Radioactive Effluent Release Report. This summary covers releases from January 1 to December 31, 1999. The summary of gaseous effluents for both Unit 1 and Unit 2 is as follows:

	<u>Unit 1</u>	<u>Unit 2</u>
Number of releases:	125	165
Total time for all releases (minutes):	777337	1084332
Maximum time for a release (minutes):	10828	16295
Average time for a release (minutes):	6266	6590
Minimum time for a release (minutes):	1	3

The Unit 1 gaseous releases consisted of:

- 125 Planned vent & tank releases
- 0 Unplanned releases

The Unit 2 gaseous releases consisted of:

- 163 Planned vent & tank releases
- 2 Unplanned releases

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL AIRBORNE EFFLUENTS)
 January 1 through June 30, 1999**

Type of Effluent	Unit 1			Est. Total Error %
	Units	Quarter 1	Quarter 2	
<u>A. Fission and Activation Products</u>				
1. Total Release	Curies	9.238E+01	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	1.188E+01	0.000E+00	
3. Percent of Applicable Limit	%	1.663E-01	0.000E+00	
<u>B. Radioiodines</u>				
1. Total Iodine-131	Curies	0.000E+00	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	0.000E+00	0.000E+00	
3. Percent of Applicable Limit	%	0.000E+00	0.000E+00	
<u>C. Particulates</u>				
1. Particulates (Half-Lives > 8 Days)	Curies	0.000E+00	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	0.000E+00	0.000E+00	
3. Percent of Applicable Limit	%	0.000E+00	0.000E+00	
4. Gross Alpha Radioactivity	Curies	0.000E+00	0.000E+00	
<u>D. Tritium</u>				
1. Total Release	Curies	3.133E+00	2.525E+00	0
2. Average Release Rate for Period	μCi/Sec	4.029E-01	3.211E-01	
3. Percent of Applicable Limit	%	5.640E-04	4.496E-04	

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL AIRBORNE EFFLUENTS)
 July 1 through December 31, 1999**

Unit 1				
Type of Effluent	Units	Quarter 3	Quarter 4	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release	Curies	3.587E+00	4.179E+01	0
2. Average Release Rate for Period	μCi/Sec	4.513E-01	5.257E+00	
3. Percent of Applicable Limit	%	6.318E-03	7.360E-02	
<u>B. Radioiodines</u>				
1. Total Iodine-131	Curies	1.164E-06	1.100E-07	0
2. Average Release Rate for Period	μCi/Sec	1.465E-07	1.383E-08	
3. Percent of Applicable Limit	%	4.101E-07	3.873E-08	
<u>C. Particulates</u>				
1. Particulates (Half-Lives > 8 Days)	Curies	0.000E+00	3.319E-07	0
2. Average Release Rate for Period	μCi/Sec	0.000E+00	4.175E-08	
3. Percent of Applicable Limit	%	0.000E+00	1.169E-07	
4. Gross Alpha Radioactivity	Curies	0.000E+00	0.000E+00	
<u>D. Tritium</u>				
1. Total Release	Curies	5.137E+00	5.903E+00	0
2. Average Release Rate for Period	μCi/Sec	6.462E-01	7.427E-01	
3. Percent of Applicable Limit	%	9.047E-04	1.040E-03	

UNIT 1

**REPORT CATEGORY : ANNUAL AIRBORNE GROUND LEVEL
 CONTINUOUS AND BATCH RELEASES
 : TOTALS FOR EACH NUCLIDE RELEASED**
TYPE OF ACTIVITY : FISSION GASES, IODINES, AND PARTICULATES
REPORTING PERIOD : QUARTER # 1 AND QUARTER # 2 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 1	QUARTER 2	QUARTER 1	QUARTER 2

Fission Gases

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
XE-135	CURIES	0.00E+00	0.00E+00	4.26E-01	0.00E+00
XE-133	CURIES	0.00E+00	0.00E+00	9.19E+01	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	9.24E+01	0.00E+00

Iodines

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
None	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Particulates

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
None	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Other

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
H-3	CURIES	0.00E+00	0.00E+00	3.13E+00	2.52E+00
Total for Period	CURIES	0.00E+00	0.00E+00	3.13E+00	2.52E+00

UNIT 1

**REPORT CATEGORY : ANNUAL AIRBORNE GROUND LEVEL
 CONTINUOUS AND BATCH RELEASES
 : TOTALS FOR EACH NUCLIDE RELEASED**
TYPE OF ACTIVITY : FISSION GASES, IODINES, AND PARTICULATES
REPORTING PERIOD : QUARTER # 3 AND QUARTER # 4 YEAR 1999

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 3	QUARTER 4	QUARTER 3	QUARTER 4

Fission Gases

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
AR-41	CURIES	0.00E+00	0.00E+00	9.30E-02	0.00E+00
XE-135	CURIES	0.00E+00	0.00E+00	1.91E+00	0.00E+00
XE-131M	CURIES	0.00E+00	0.00E+00	0.00E+00	3.09E-03
KR-85	CURIES	0.00E+00	0.00E+00	8.59E-04	4.25E-01
XE-133	CURIES	0.00E+00	0.00E+00	1.58E+00	4.14E+01
Total for Period	CURIES	0.00E+00	0.00E+00	3.59E+00	4.18E+01

Iodines

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
I-131	CURIES	0.00E+00	0.00E+00	1.16E-06	1.10E-07
Total for Period	CURIES	0.00E+00	0.00E+00	1.16E-06	1.10E-07

Particulates

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
CO-57	CURIES	0.00E+00	0.00E+00	0.00E+00	3.32E-07
Total for Period	CURIES	0.00E+00	0.00E+00	0.00E+00	3.32E-07

Other

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
H-3	CURIES	0.00E+00	0.00E+00	5.14E+00	5.90E+00
Total for Period	CURIES	0.00E+00	0.00E+00	5.14E+00	5.90E+00

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL AIRBORNE EFFLUENTS)
 January 1 through June 30, 1999**

Type of Effluent	Unit 2			
	Units	Quarter 1	Quarter 2	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release	Curies	7.598E+00	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	9.771E-01	0.000E+00	
3. Percent of Applicable Limit	%	1.368E-02	0.000E+00	
<u>B. Radioiodines</u>				
1. Total Iodine-131	Curies	0.000E+00	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	0.000E+00	0.000E+00	
3. Percent of Applicable Limit	%	0.000E+00	0.000E+00	
<u>C. Particulates</u>				
1. Particulates (Half-Lives > 8 Days)	Curies	3.738E-05	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	4.807E-06	0.000E+00	
3. Percent of Applicable Limit	%	1.346E-05	0.000E+00	
4. Gross Alpha Radioactivity	Curies	0.000E+00	0.000E+00	
<u>D. Tritium</u>				
1. Total Release	Curies	5.039E+00	4.217E+00	0
2. Average Release Rate for Period	μCi/Sec	6.480E-01	5.364E-01	
3. Percent of Applicable Limit	%	9.072E-04	7.509E-04	

**ANNUAL SUMMATION FOR ALL RELEASES BY QUARTER
 (ALL AIRBORNE EFFLUENTS)
 July 1 through December 31, 1999**

Unit 2

Type of Effluent	Units	Quarter 3	Quarter 4	Est. Total Error %
<u>A. Fission and Activation Products</u>				
1. Total Release	Curies	7.763E+00	2.383E+01	0
2. Average Release Rate for Period	μCi/Sec	9.766E-01	2.998E+00	
3. Percent of Applicable Limit	%	1.367E-02	4.197E-02	
<u>B. Radioiodines</u>				
1. Total Iodine-131	Curies	0.000E+00	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	0.000E+00	0.000E+00	
3. Percent of Applicable Limit	%	0.000E+00	0.000E+00	
<u>C. Particulates</u>				
1. Particulates (Half-Lives > 8 Days)	Curies	1.112E-06	0.000E+00	0
2. Average Release Rate for Period	μCi/Sec	1.399E-07	0.000E+00	
3. Percent of Applicable Limit	%	3.916E-07	0.000E+00	
4. Gross Alpha Radioactivity	Curies	0.000E+00	0.000E+00	
<u>D. Tritium</u>				
1. Total Release	Curies	5.632E+00	2.179E+01	0
2. Average Release Rate for Period	μCi/Sec	7.085E-01	2.741E+00	
3. Percent of Applicable Limit	%	9.920E-04	3.837E-03	

UNIT 2

**REPORT CATEGORY : ANNUAL AIRBORNE GROUND LEVEL
 CONTINUOUS AND BATCH RELEASES
 : TOTALS FOR EACH NUCLIDE RELEASED
 TYPE OF ACTIVITY : FISSION GASES, IODINES, AND PARTICULATES
 REPORTING PERIOD : QUARTER # 1 AND QUARTER # 2 YEAR 1999**

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 1	QUARTER 2	QUARTER 1	QUARTER 2

Fission Gases

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
XE-135	CURIES	0.00E+00	0.00E+00	3.57E-03	0.00E+00
KR-85	CURIES	0.00E+00	0.00E+00	1.36E+00	0.00E+00
XE-133	CURIES	0.00E+00	0.00E+00	6.23E+00	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	7.60E+00	0.00E+00

Iodines

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
None	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Particulates

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
CS-137	CURIES	0.00E+00	0.00E+00	3.74E-05	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	3.74E-05	0.00E+00

Other

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 1	CONTINUOUS RELEASES QUARTER 2	BATCH RELEASES QUARTER 1	BATCH RELEASES QUARTER 2
H-3	CURIES	0.00E+00	0.00E+00	5.04E+00	4.22E+00
Total for Period	CURIES	0.00E+00	0.00E+00	5.04E+00	4.22E+00

UNIT 2

**REPORT CATEGORY : ANNUAL AIRBORNE GROUND LEVEL
 CONTINUOUS AND BATCH RELEASES
 : TOTALS FOR EACH NUCLIDE RELEASED
 TYPE OF ACTIVITY : FISSION GASES, IODINES, AND PARTICULATES
 REPORTING PERIOD : QUARTER # 3 AND QUARTER # 4 YEAR 1999**

NUCLIDE	UNIT	CONTINUOUS RELEASES		BATCH RELEASES	
		QUARTER 3	QUARTER 4	QUARTER 3	QUARTER 4

Fission Gases

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
XE-135	CURIES	0.00E+00	0.00E+00	0.00E+00	3.33E-03
XE-133	CURIES	0.00E+00	0.00E+00	7.76E+00	2.38E+01
Total for Period	CURIES	0.00E+00	0.00E+00	7.76E+00	2.38E+01

Iodines

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
NONE	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Particulates

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
CO-58	CURIES	0.00E+00	0.00E+00	1.11E-06	0.00E+00
Total for Period	CURIES	0.00E+00	0.00E+00	1.11E-06	0.00E+00

Other

NUCLIDE	UNIT	CONTINUOUS RELEASES QUARTER 3	CONTINUOUS RELEASES QUARTER 4	BATCH RELEASES QUARTER 3	BATCH RELEASES QUARTER 4
H-3	CURIES	0.00E+00	0.00E+00	5.63E+00	2.18E+01
Total for Period	CURIES	0.00E+00	0.00E+00	5.63E+00	2.18E+01

5. SUMMARY OF RADIATION DOSES

The following is a summary of the annual radiation doses due to radiological effluents during 1999 calculated in accordance with the Offsite Dose Calculation Manual.

UNIT 1

Liquid Radwaste Effluents

Dose Limits (mRem): Total Body = 1.5/Qtr 3/Yr, Other Organs = 5/Qtr 10/Yr

<u>Organ</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
TBody	0.0027	0.18	0.0013	0.09	0.0016	0.10	0.0009	0.06	0.0065	0.22
Bone	0.0024	0.05	0.0011	0.02	0.0012	0.02	0.0006	0.01	0.0052	0.05
Liver	0.0038	0.08	0.0018	0.04	0.0021	0.04	0.0010	0.02	0.0087	0.09
Thyroid	0.0007	0.01	0.0004	0.01	0.0012	0.02	0.0013	0.03	0.0031	0.03
Kidney	0.0016	0.03	0.0008	0.02	0.0010	0.02	0.0003	0.01	0.0037	0.04
Lung	0.0008	0.02	0.0005	0.01	0.0006	0.01	0.0002	0.00	0.0020	0.02
GI-LLI	0.0030	0.06	0.0005	0.01	0.0006	0.01	0.0043	0.09	0.0084	0.08

Gaseous Radwaste Effluents

Iodine, H-3, and Particulate (ITP) - Dose Limits (mRem) = 7.5/Qtr 15/Yr

<u>Organ</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
TBody	0.0019	0.03	0.0016	0.02	0.0032	0.04	0.0036	0.05	0.0103	0.07
Bone	0.0000	0.00	0.0000	0.00	0.0000	0.00	0.0000	0.00	0.0000	0.00
Liver	0.0019	0.03	0.0016	0.02	0.0032	0.04	0.0036	0.05	0.0103	0.07
Thyroid	0.0019	0.03	0.0016	0.02	0.0034	0.05	0.0037	0.05	0.0106	0.07
Kidney	0.0019	0.03	0.0016	0.02	0.0032	0.04	0.0036	0.05	0.0103	0.07
Lung	0.0019	0.03	0.0016	0.02	0.0032	0.04	0.0036	0.05	0.0103	0.07
GI-LLI	0.0019	0.03	0.0016	0.02	0.0032	0.04	0.0036	0.05	0.0103	0.07

Noble Gas Air Dose Limits (mRad) = Gamma 5/Qtr 10/Yr, Beta 10/Qtr 20/Yr

<u>Type</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
Gamma	0.0030	0.06	0.0000	0.00	0.0005	0.01	0.0013	0.03	0.0047	0.05
Beta	0.0087	0.09	0.0000	0.00	0.0006	0.01	0.0039	0.04	0.0132	0.07

UNIT 2

Liquid Radwaste Effluents

Dose Limits (mRem): Total Body = 1.5/Qtr 3/Yr, Other Organs = 5 /Qtr 10/Yr

<u>Organ</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
TBody	0.0006	0.04	0.0001	0.01	0.0003	0.02	0.0007	0.05	0.0017	0.06
Bone	0.0006	0.01	0.0000	0.00	0.0001	0.00	0.0001	0.00	0.0009	0.01
Liver	0.0009	0.02	0.0001	0.00	0.0003	0.01	0.0008	0.02	0.0021	0.02
Thyroid	0.0003	0.01	0.0001	0.00	0.0001	0.00	0.0006	0.01	0.0012	0.01
Kidney	0.0003	0.01	0.0001	0.00	0.0002	0.00	0.0007	0.01	0.0013	0.01
Lung	0.0003	0.01	0.0001	0.00	0.0002	0.00	0.0006	0.01	0.0012	0.01
GI-LLI	0.0004	0.01	0.0001	0.00	0.0002	0.00	0.0008	0.02	0.0014	0.01

Gaseous Radwaste Effluents

Iodine, H-3, and Particulate - Dose Limits (mRem) = 7.5/Qtr 15/Yr

<u>Organ</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
Tbody	0.0035	0.05	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0230	0.15
Bone	0.0012	0.02	0.0000	0.00	0.0000	0.00	0.0000	0.00	0.0012	0.01
Liver	0.0043	0.06	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0237	0.16
Thyroid	0.0033	0.04	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0228	0.15
Kidney	0.0036	0.05	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0231	0.15
Lung	0.0035	0.05	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0229	0.15
GI-LLI	0.0034	0.04	0.0026	0.03	0.0035	0.05	0.0134	0.18	0.0228	0.15

Noble Gas Air Dose Limits (mRad) = Gamma 5/Qtr 10/Yr, Beta 10/Qtr 20/Yr

<u>Type</u>	<u>Qtr 1</u>	<u>%</u>	<u>Qtr 2</u>	<u>%</u>	<u>Qtr 3</u>	<u>%</u>	<u>Qtr 4</u>	<u>%</u>	<u>Year</u>	<u>%</u>
Gamma	0.0002	0.00	0.0000	0.00	0.0002	0.00	0.0007	0.01	0.0012	0.01
Beta	0.0008	0.01	0.0000	0.00	0.0007	0.01	0.0022	0.02	0.0038	0.02

6. SUMMARY OF DOSE TO MEMBERS OF THE PUBLIC

The following is a summary of the annual radiation dose to members of the public (in mrem) due to activities inside the site boundary.

UNIT 1

	<u>BONE</u>	<u>LIVER</u>	<u>TBODY</u>	<u>THYROID</u>	<u>KIDNEY</u>	<u>GI-LLI</u>	<u>LUNG</u>	<u>SKIN</u>
<u>Gaseous Effluent</u>								
Iodine/Tritium Particulate	3.67E-07	4.49E-03	4.49E-03	4.61E-03	4.49E-03	4.49E-03	4.49E-03	
Noble Gas			1.21E-03					2.84E-03
<u>Liquid Effluent</u>								
Fish Sediment	5.21E-03	8.70E-03	6.45E-03 2.01E-04	3.13E-03	3.68E-03	2.00E-03	8.42E-03	2.35E-04
Unit 1 Total	5.21E-03	1.32E-02	1.22E-02	7.75E-03	8.18E-03	6.49E-03	1.29E-02	3.08E-03




UNIT 2

<u>Gaseous Effluent</u>								
Iodine/Tritium Particulate	5.20E-04	1.04E-02	1.00E-02	9.97E-03	1.01E-02	1.00E-02	9.98E-03	
Noble Gas			3.03E-04					7.64E-04
<u>Liquid Effluent</u>								
Fish Sediment	8.68E-04	2.15E-03	1.72E-03 4.81E-05	1.19E-03	1.31E-03	1.18E-03	1.43E-03	5.62E-05
Unit 2 Total	1.39E-03	1.25E-02	1.21E-02	1.12E-02	1.14E-02	1.12E-02	1.14E-02	8.21E-04


Site Total	6.60E-03	2.57E-02	2.42E-02	1.89E-02	1.96E-02	1.77E-02	2.43E-02	3.90E-03
Limit (40CFR190)	25	25	25	75	25	25	25	25
% Limit	2.64E-02	1.03E-01	9.69E-02	2.52E-02	7.84E-02	7.08E-02	9.73E-02	1.56E-02

7. HISTORICAL EFFLUENT DATA


The following graphs show the historical release data for both units on a yearly basis. These graphs compare data from 1990 through 1999.

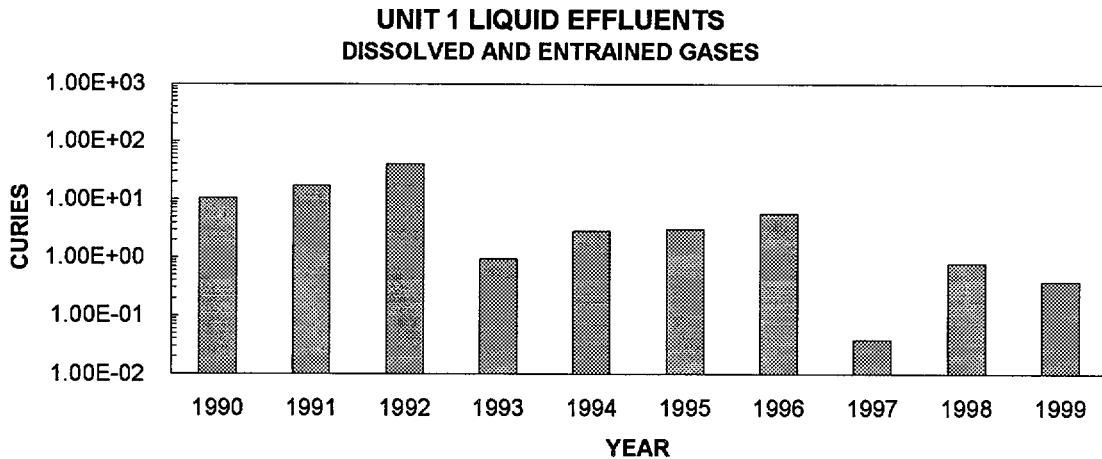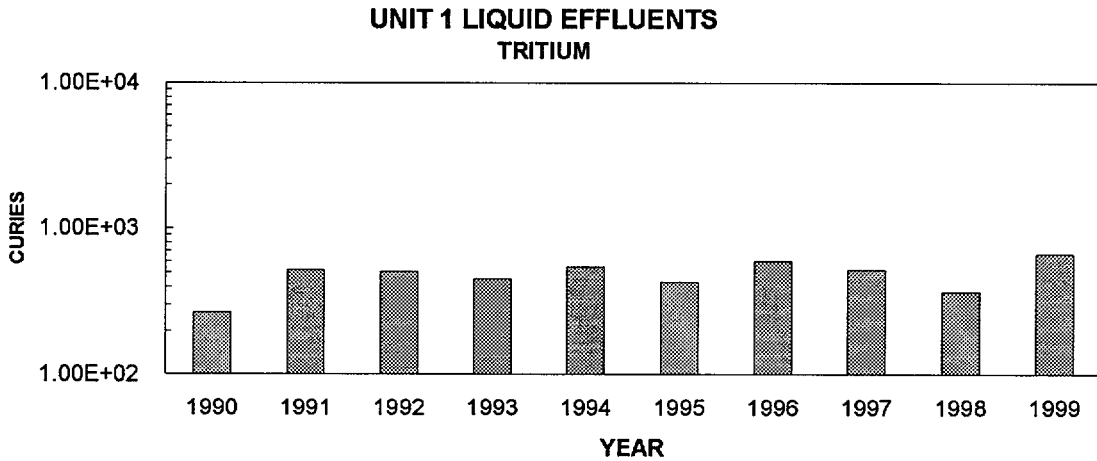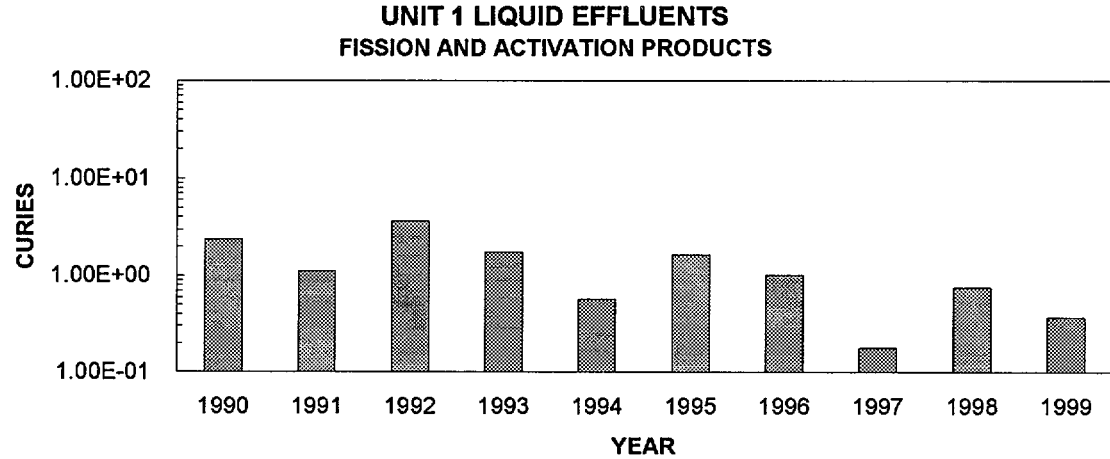


**UNIT 1 LIQUID EFFLUENTS
TOTAL VOLUME RELEASED**

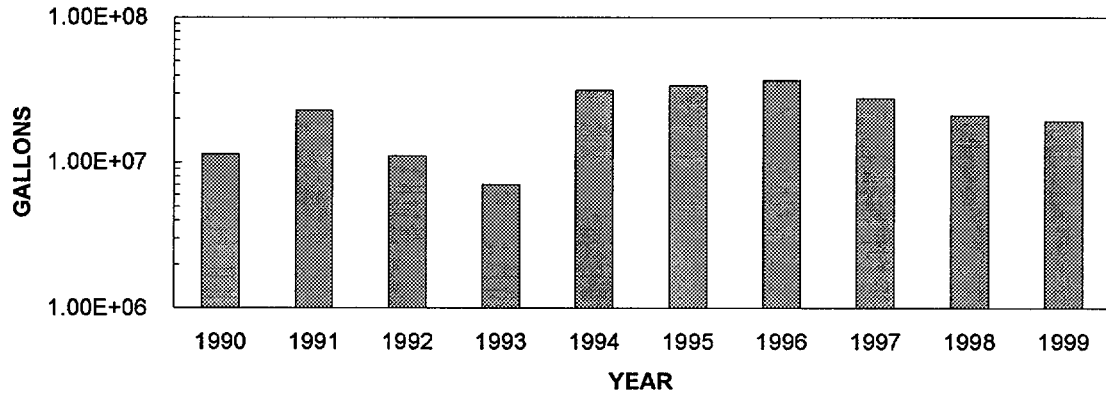


**UNIT 1 LIQUID EFFLUENTS
TOTAL BODY DOSE**

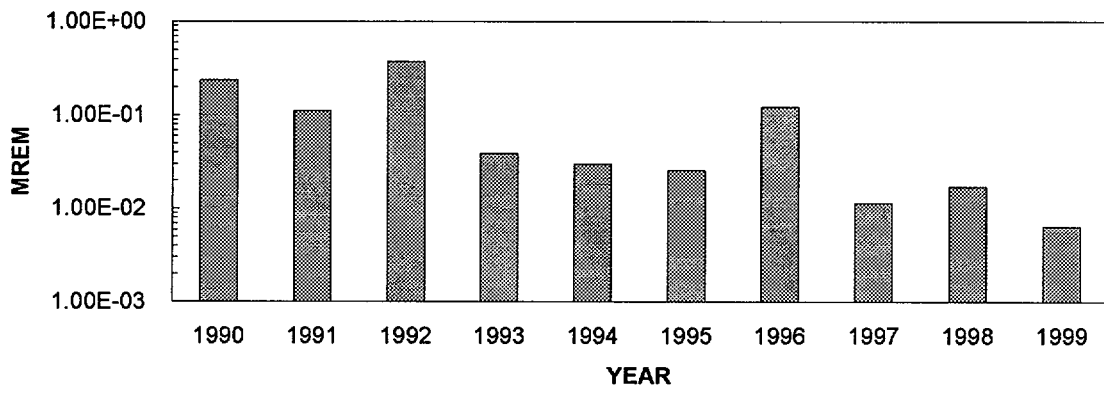


**UNIT 1 LIQUID EFFLUENTS
CRITICAL ORGAN DOSE**

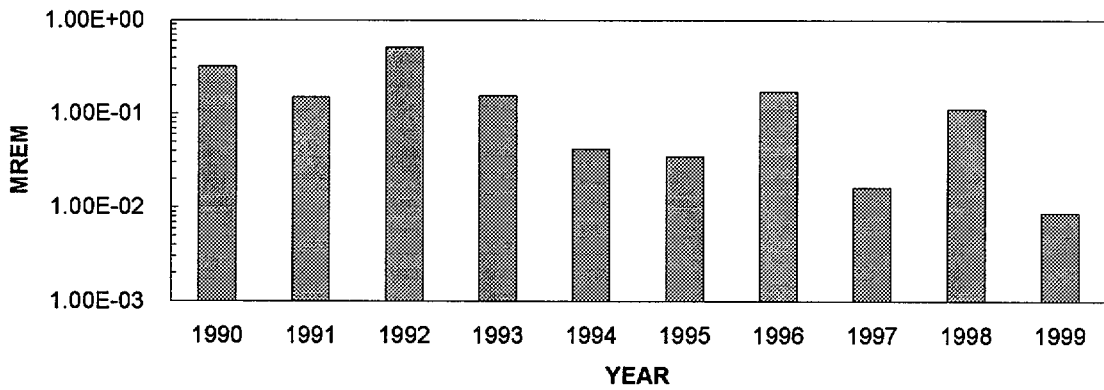


**UNIT 2 LIQUID EFFLUENTS
FISSION AND ACTIVATION PRODUCTS**

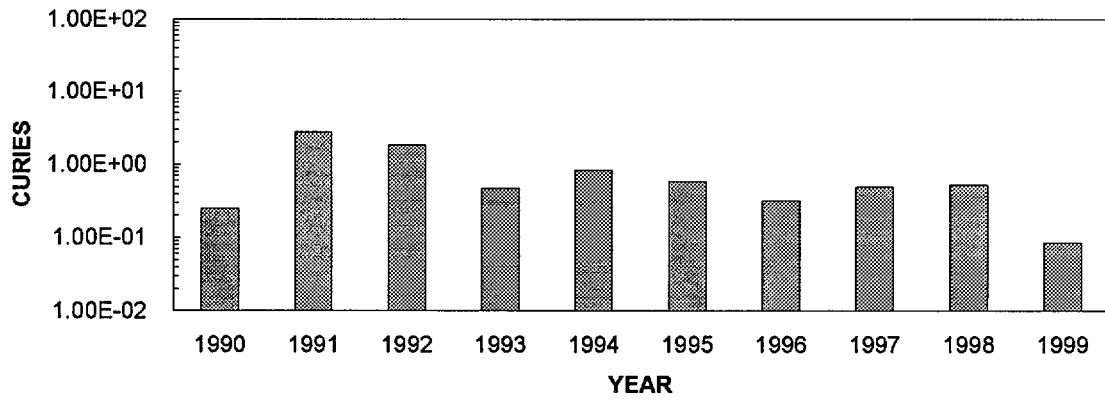


**UNIT 2 LIQUID EFFLUENTS
TRITIUM**

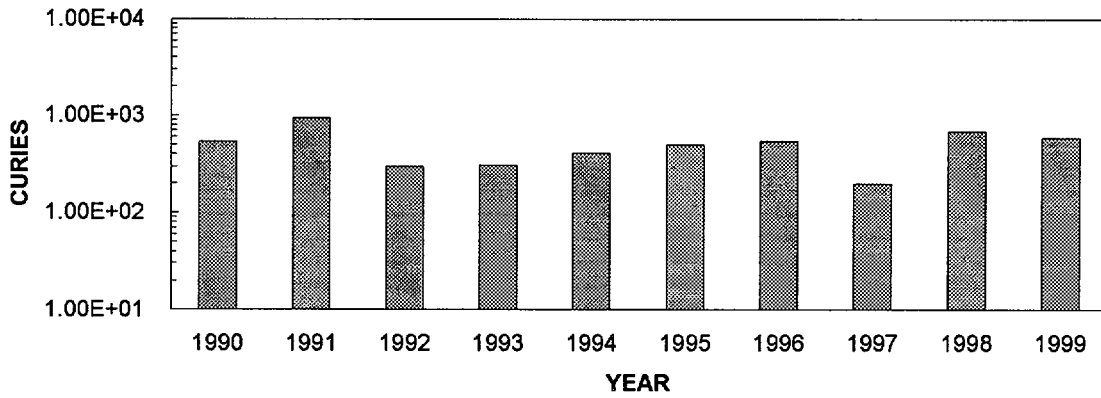


**UNIT 2 LIQUID EFFLUENTS
DISSOLVED AND ENTRAINED GASES**

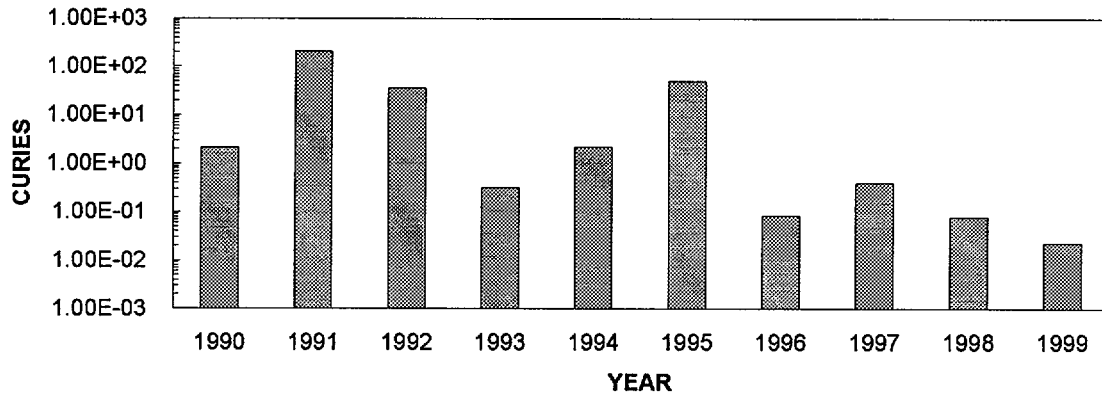


**UNIT 2 LIQUID EFFLUENTS
TOTAL VOLUME RELEASED**

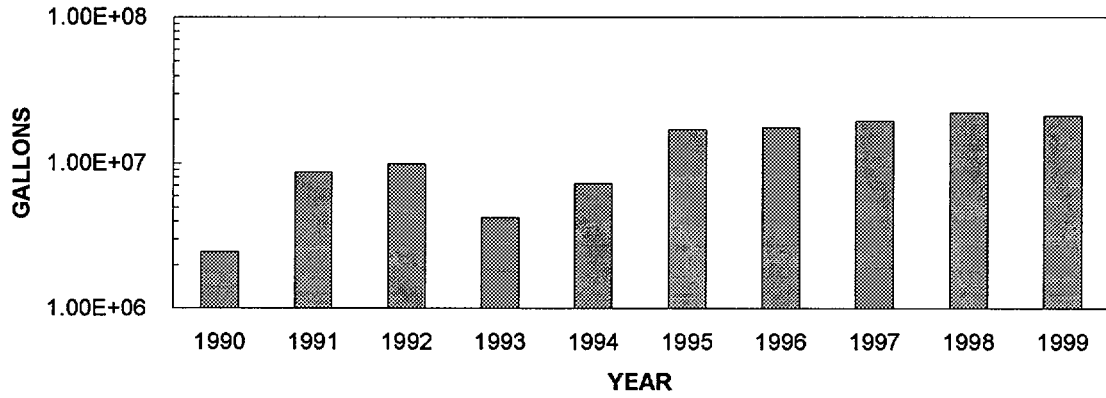


**UNIT 2 LIQUID EFFLUENTS
TOTAL BODY DOSE**

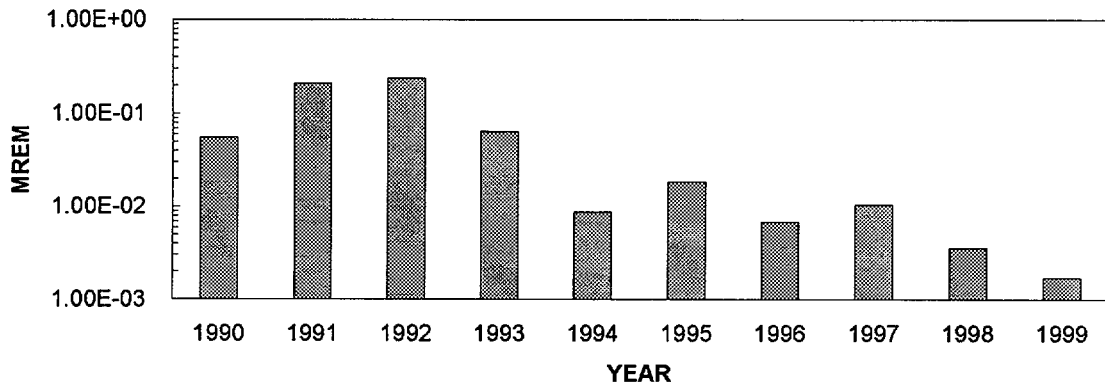


**UNIT 2 LIQUID EFFLUENTS
CRITICAL ORGAN DOSE**

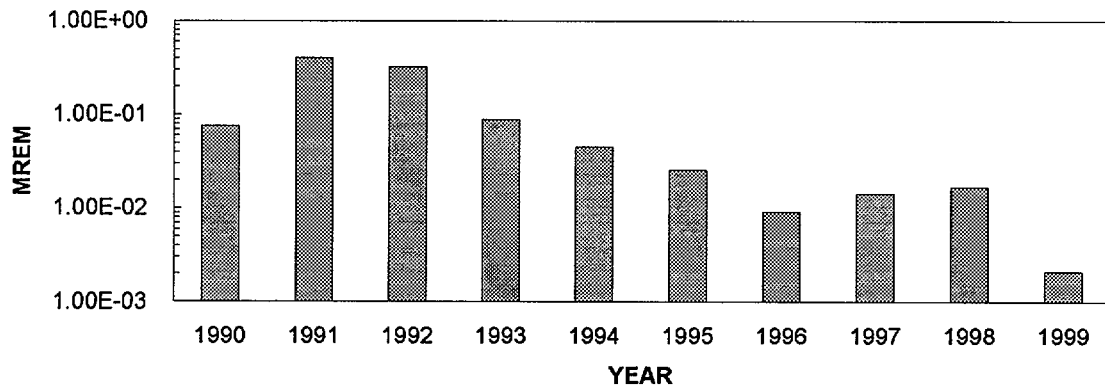


UNIT 1 GASEOUS EFFLUENTS FISSION AND ACTIVATION PRODUCTS

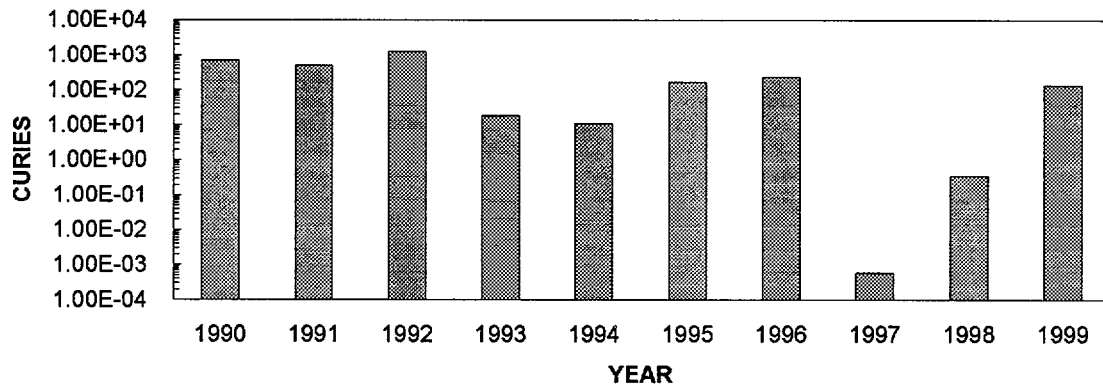


UNIT 1 GASEOUS EFFLUENTS RADIOIODINES

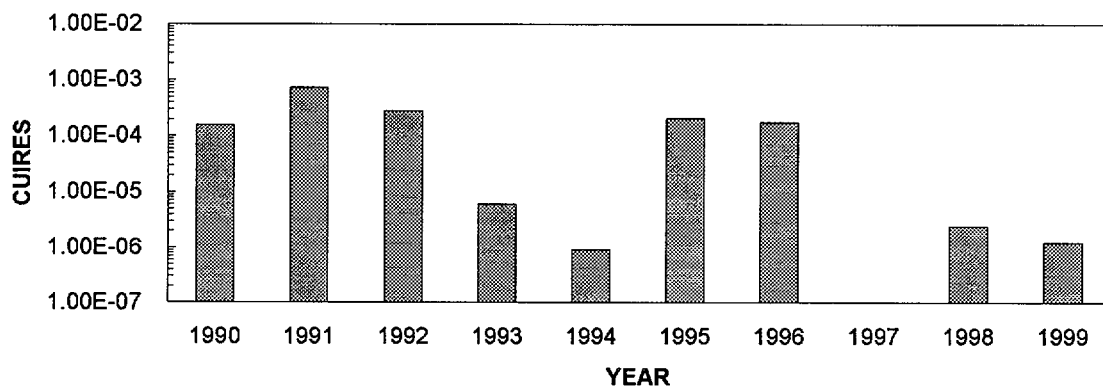


UNIT 1 GASEOUS EFFLUENTS PARTICULATES

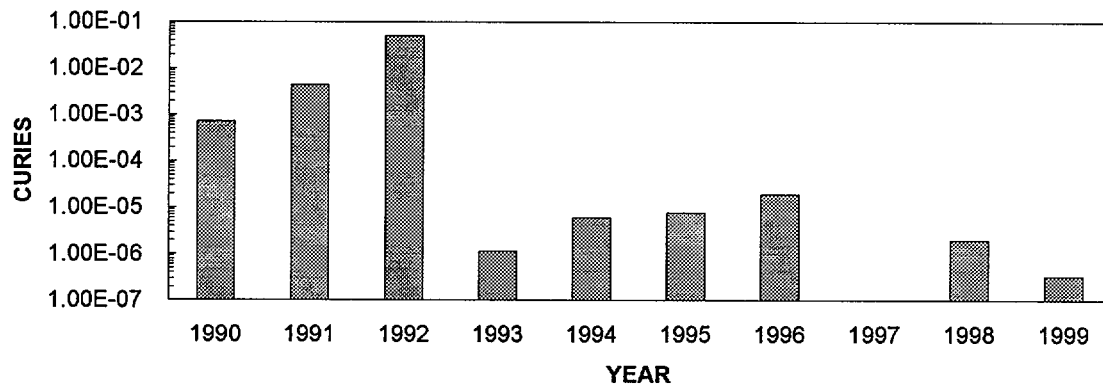


**UNIT 1 GASEOUS EFFLUENTS
TRITIUM**

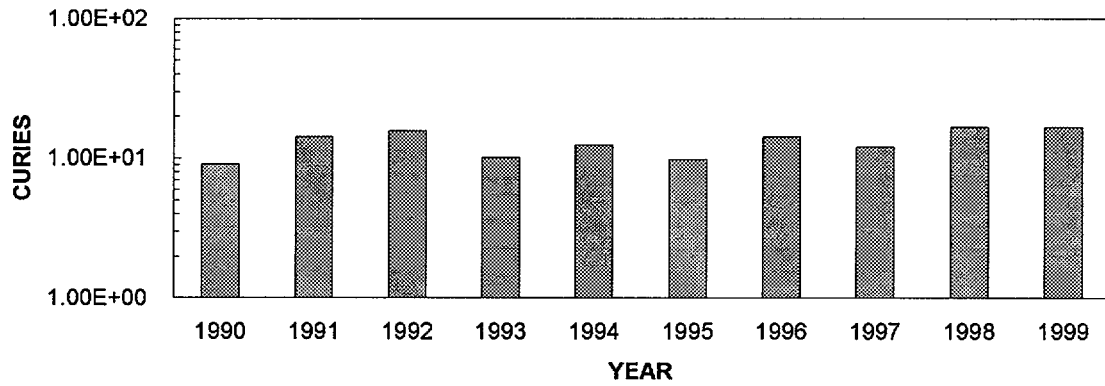


**UNIT 1 GASEOUS EFFLUENTS
GAMMA DOSE**

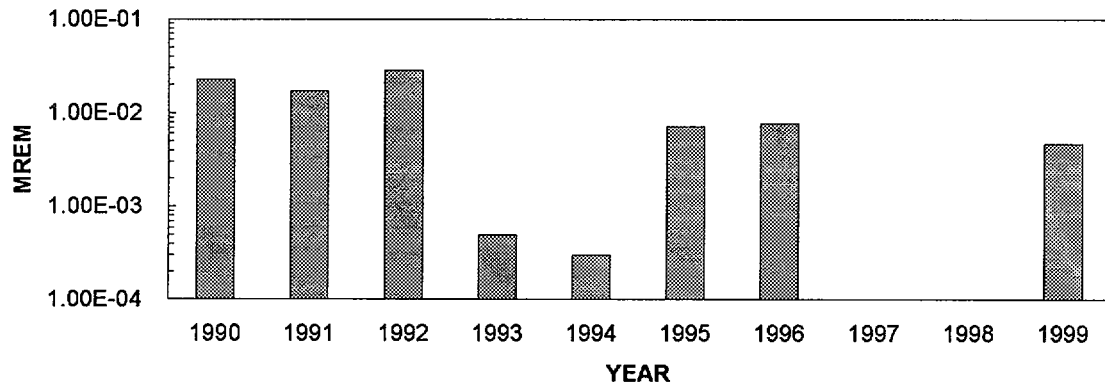


**UNIT 1 GASEOUS EFFLUENTS
BETA DOSE**

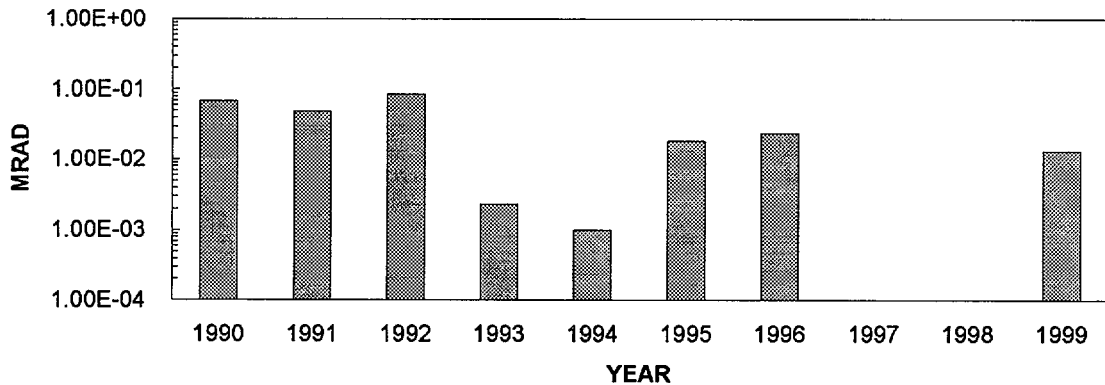


**UNIT 1 GASEOUS EFFLUENTS
TOTAL BODY DOSE**

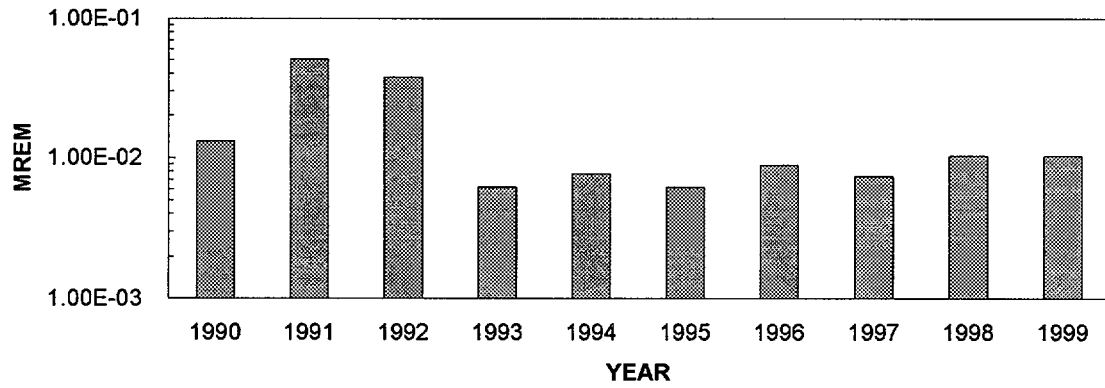


**UNIT 1 GASEOUS EFFLUENTS
CRITICAL ORGAN DOSE**

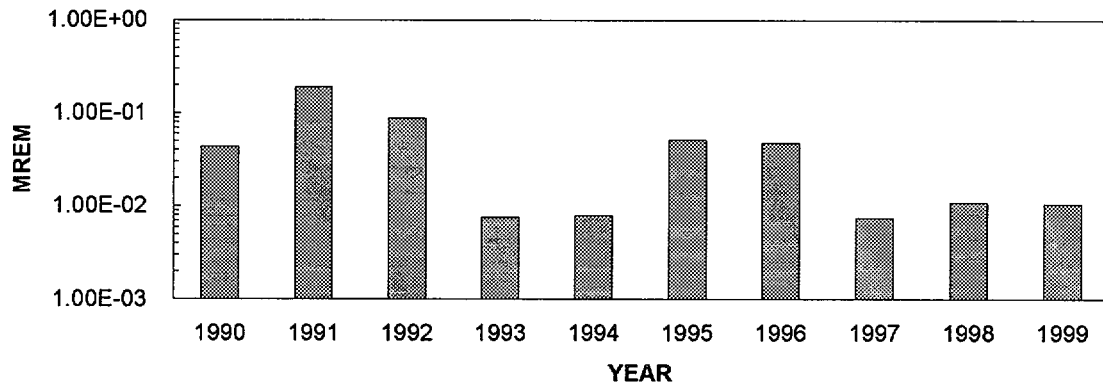


**UNIT 2 GASEOUS EFFLUENTS
FISSION AND ACTIVATION PRODUCTS**

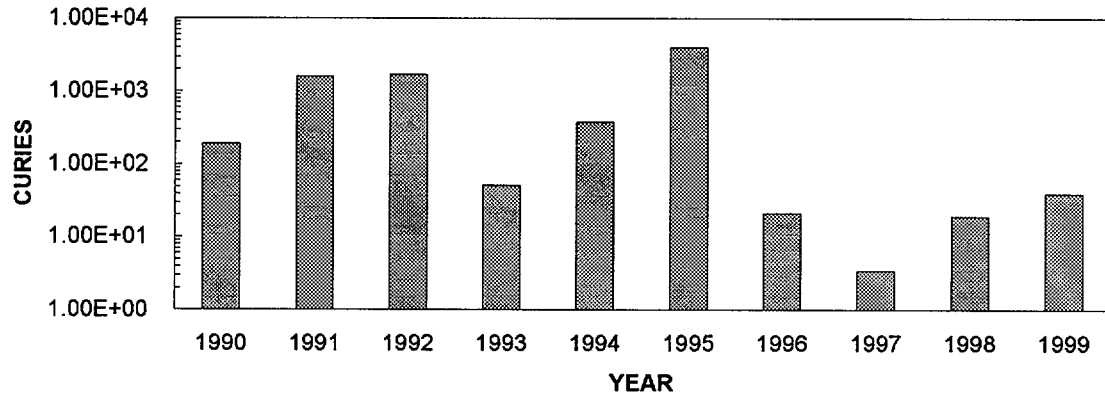


**UNIT 2 GASEOUS EFFLUENTS
RADIOIODINES**

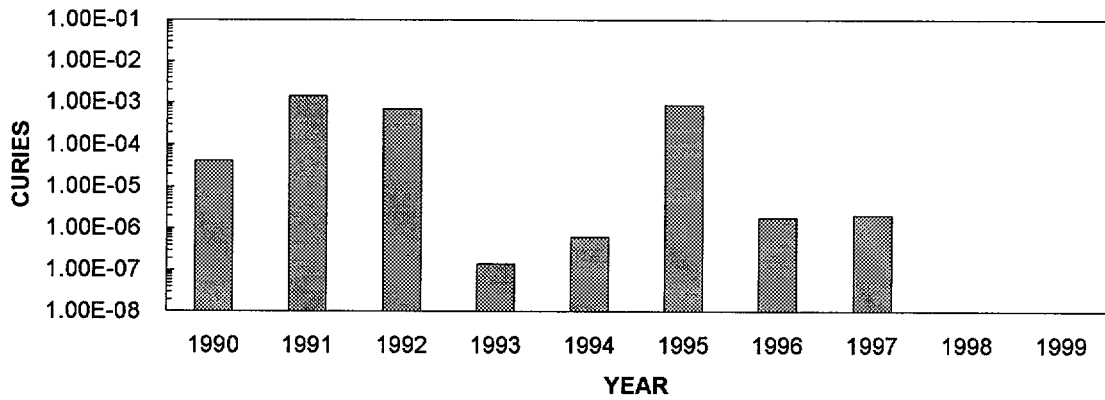


**UNIT 2 GASEOUS EFFLUENTS
PARTICULATES**

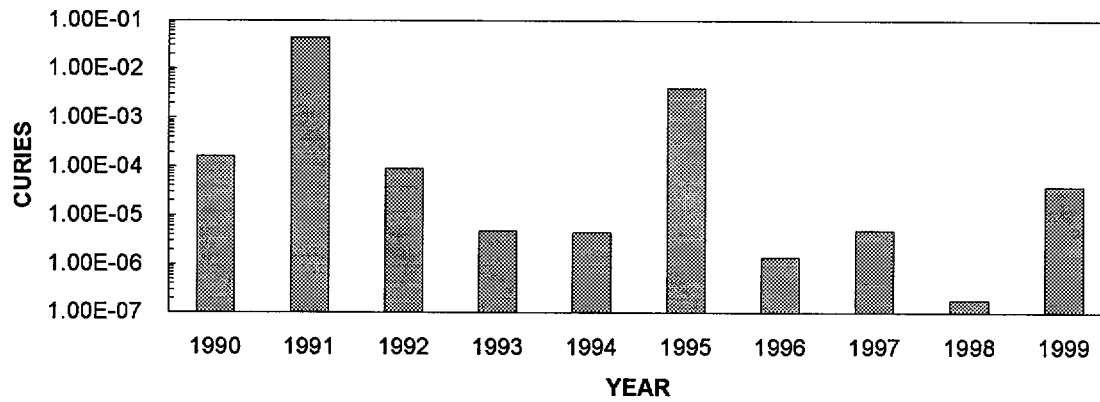


**UNIT 2 GASEOUS EFFLUENTS
TRITIUM**

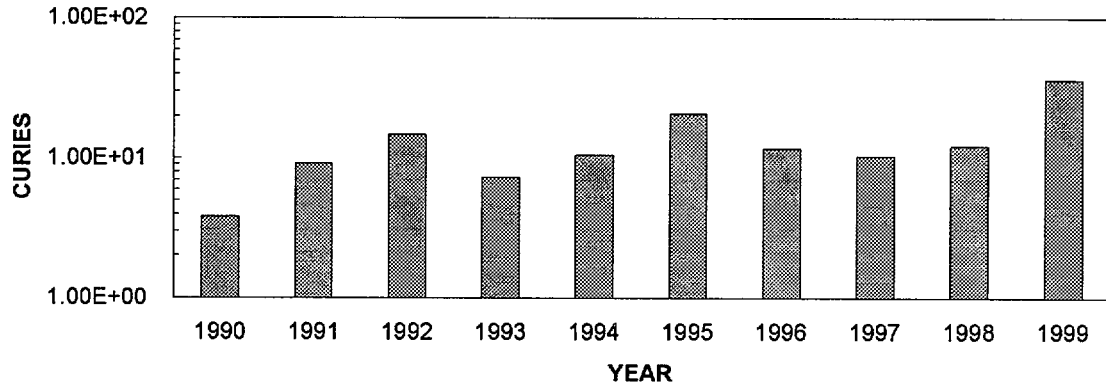


**UNIT 2 GASEOUS EFFLUENTS
GAMMA DOSE**

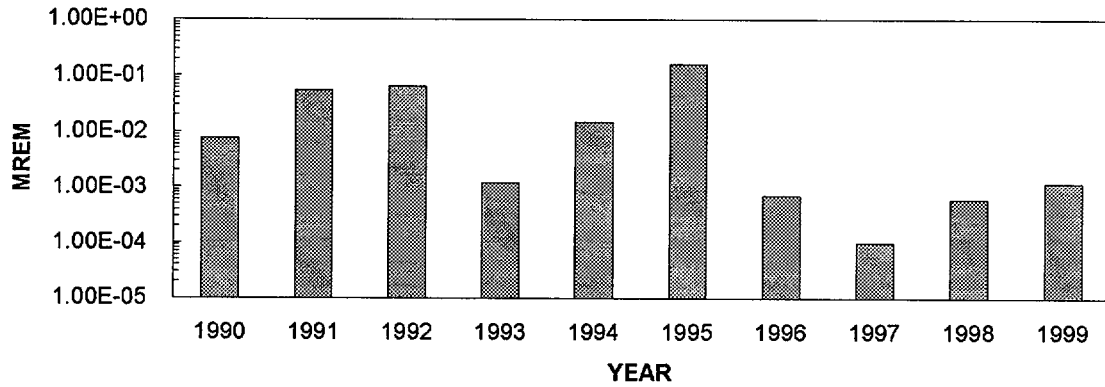


**UNIT 2 GASEOUS EFFLUENTS
BETA DOSE**

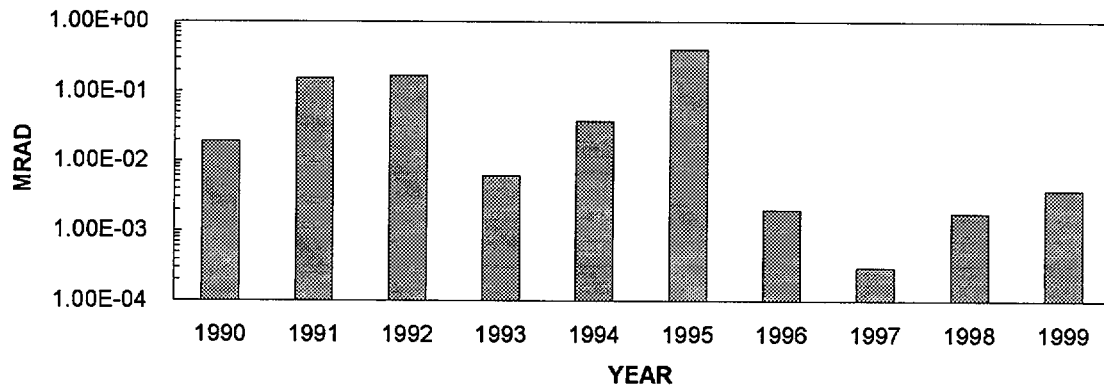

**UNIT 2 GASEOUS EFFLUENTS
TOTAL BODY DOSE**

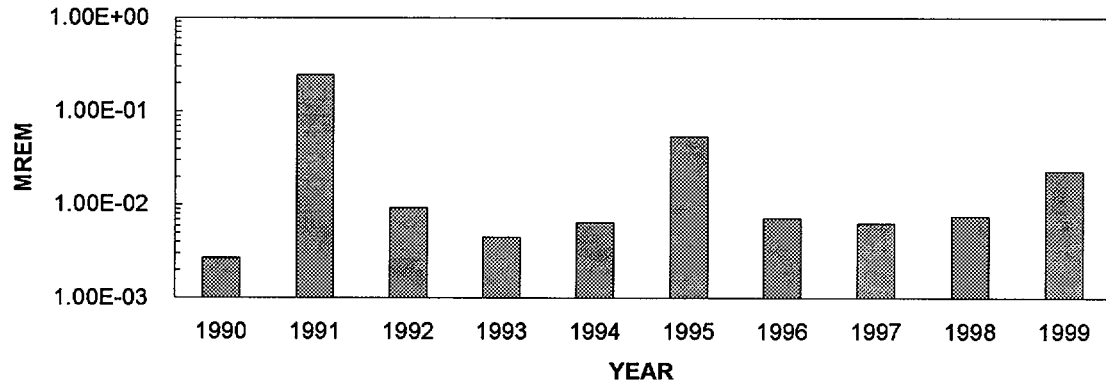

**UNIT 2 GASEOUS EFFLUENTS
CRITICAL ORGAN DOSE**

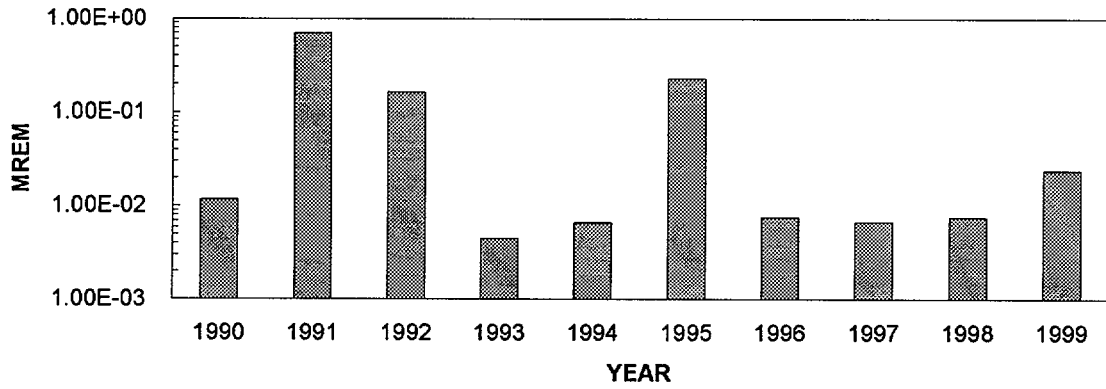

8. SOLID WASTE SUMMARY

As required by Regulatory Guide 1.21, Rev. 1, a summary of data for solid wastes shipped offsite is provided in the annual Radioactive Effluent Release Report.

This summary covers shipments from January 1 through December 31, 1999. The summary for solid waste shipments is as follows:

REGULATORY GUIDE 1.21 REPORT
WASTE DISPOSAL ANNUAL SUMMARY REPORT
SOLID WASTE AND IRRADIATED FUEL SHIPMENTS
JANUARY 1, 1999 THROUGH JUNE 30, 1999

A. Solid Waste Shipped Offsite for Burial or Disposal (Not Irradiated Fuel)

1. Type of Waste	Unit	6-Month Period	Est. Total Error, %
a. Spent resins, filter sludge, evaporator bottoms, etc.	m ³ Ci	0.00E+00 0.00E+00	0.00E+00
b. Dry compressible waste, contaminated equipment, etc.	m ³ Ci	8.83E+01 7.26E-01	±2.5E+01
c. Irradiated components, control rods, etc.	m ³ Ci	0.00E+00 0.00E+00	0.00E+00
d. Other (describe)	m ³ Ci	0.00E+00 0.00E+00	0.00E+00

2. Estimate of Major Nuclide Composition (by Type of Waste)

a. Spent resins, filter sludges, evaporator bottoms, etc.

None

b. Dry compressible waste, contaminated equipment, etc.

	%	Curies
CS-137	79.07	5.74E-01
CE-144	5.12	3.72E-02
CO-60	4.76	3.46E-02
FE-55	4.40	3.20E-02
NI-63	4.36	3.17E-02
C-14	2.29	1.66E-02

c. Irradiated components, control rods, etc.

None

d. Other

None

3. Solid Waste Disposition

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
2	Flatbed/Sea Van	Oak Ridge, TN

B. Irradiated Fuel Shipments (Disposition)

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None		

REGULATORY GUIDE 1.21 REPORT
WASTE DISPOSAL ANNUAL SUMMARY REPORT
SOLID WASTE AND IRRADIATED FUEL SHIPMENTS
JULY 1, 1999 THROUGH DECEMBER 31, 1999

A. Solid Waste Shipped Offsite for Burial or Disposal (Not Irradiated Fuel)

1.	Type of Waste	Unit	6-Month Period	Est. Total Error, %
a.	Spent resins, filter sludges, evaporator bottoms, etc.	m ³ Ci	3.22E+02 1.86E-01	±2.5E+01
b.	Dry compressible waste, contaminated equip, etc.	m ³ Ci	4.56E+02 2.69E+00	±2.5E+01
c.	Irradiated components, control rods, etc.	m ³ Ci	0.00E+00 0.00E+00	0
d.	Other (describe): Waste Oil	m ³ Ci	1.14E+01 8.18E-03	±2.5E+01

2. Estimate of Major Nuclide Composition (by Type of Waste from Section 8.A.1)

a. Spent resins, filter sludges, evaporator bottoms, etc.

	%	Curies
C-14	80.07	1.49E-01
H-3	9.35	1.74E-02
CS-137	8.25	1.54E-02
CS-134	2.00	3.74E-03
NI-63	0.17	3.20E-04
CO-60	0.14	2.54E-04
SB-125	0.02	2.99E-05
MN-54	0.00	6.03E-06
RU-103	0.00	6.14E-07

b. Dry compressible waste, contaminated equipment, etc.

	%	Curies
CS-137	83.63	2.26E+00
CO-60	4.81	1.30E-01
NI-63	4.50	1.21E-01
FE-55	4.41	1.20E-01
C-14	1.89	5.09E-02
CE-144	0.76	2.06E-02

c. Irradiated components, control rods, etc.

None

d. Other (Waste Oil)

	%	Curies
CS-137	39.84	3.26E-03
C-14	24.23	1.98E-03
NI-63	14.31	1.17E-03
CO-60	11.51	9.42E-04
FE-55	10.11	8.27E-04

3. Solid Waste Disposition

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
30	Flatbed/Sea Van	Oak Ridge, TN

B. Irradiated Fuel Shipments (Disposition)

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None		

9. UNPLANNED RELEASES

An unplanned release is defined as any release of radioactive material to the environment that does not meet the following criteria:

- A. Sample analysis prior to release, and
- B. Release calculations performed prior to release.

During 1999, there were three unplanned releases to an unrestricted area.

On June 13, 1999, ANO personnel noted water dripping at a rate of 2 drops and 15 drops per minute from pipe caps located on the blowdown lines for Unit 1 Main Steam line traps ST-6 and ST-7. ST-6 and ST-7 are located in Room 40 beneath the ICW coolers. The water was found to be leaking to the discharge flume via a floor drain located in Room 40. Immediate actions included installation of new pipe caps which successfully secured the unmonitored release. Samples of the liquid were collected and analyzed for release purposes. It was found that only trace amounts of tritium were detected in samples. Chemistry generated a release permit to account for the unmonitored and unplanned release. A Condition Report was issued to document and track the corrective actions. Additionally, an Engineering Request (ER) has been initiated to reroute the floor drain to a monitored pathway and plug the existing floor drain in Room 40. There were no ODCM limits exceeded as a result of this condition. A copy of the release permit 1LR1999-0440 is included in Attachment 1.

On November 29, 1999, it was identified that the Unit 2 Waste Gas Decay Tank pressures for 2T18B and 2T18C had been decreasing over the previous several days. 2T18B was measured to be losing 6 to 10 pounds of pressure a day and 2T18C was measured to be losing 3 pounds of pressure per day. A Condition Report was issued to document and issue required corrective actions. A review of the condition concluded that the Nitrogen Supply Isolation Valves 2N2-19A, B, and C were leaking allowing pressure to escape from 2T18B and C. 2T18A had been previously declared inoperable and had no pressure at the time of the unplanned releases. 2T18B and C were declared inoperable due to the leakage. Gaseous Radwaste Release Permits were generated for the gas already released from 2T18B and 2T18C using the tanks initial pressures and sample analysis of the gas remaining in the tank. Additional permits were generated to release the remaining contents of 2T18B and C. A Condition Report Action was issued to Unit 2 Maintenance to follow up on a previously submitted MAI 15604 that documented the degraded valve internals of 2N2-19A. The Waste Gas Decay Tanks will remain out of service until the Nitrogen Supply Isolation Valves are repaired. Although the leakage was monitored by SPING 6 on the Aux. Bldg. exhaust plenum, this condition does not meet the definition of an Unplanned Release as defined in Chemistry Procedure 1604.016, "Analysis of Gaseous Waste Decay Tanks". There were no ODCM limits exceeded as a result of this condition. Copies of the unplanned release permits (2GR1999-0153 and 2GR1999-0155) are included in Attachment 2.

10. RADIATION INSTRUMENTATION

As required by ODCM Appendices 1 and 2, any radioactive effluent instrumentation inoperable for more than 30 days shall be reported in the annual Radioactive Effluent Release Report.

During 1999, RX-9820 (SPING 1 Unit 1 Containment Purge Super Particulate Iodine and Noble Gas ventilation effluent monitor) remained out of service until September 17, 1999. SPING 1 originally exceeded the 30 day out of service time clock on May 1, 1998, which was described in Section 10 of the 1998 Annual Radioactive Effluent Report. In summary, SPING 1 was taken out of service from April 2, 1998, at 1430 hours until May 1, 1998, at 0355 hours in support of a modification to the reactor building purge isolation valves. During modification testing on May 2, 1998, at 0627 hours, Channel 10 (ventilation flow rate) of the SPING monitor indicated zero (0) CFM while indication on process monitor RR-4830 indicated the flow rate to be 1.8E4 CFM. The design modification caused a reduction in the actual flow rate to approximately 1/4 of the design flow rate. This flow rate was below the cutoff set point of ~45% of design flow rate for the SPING monitor. Channel 10 is an input parameter for dose assessment determination. An evaluation (ER951020-E104) was performed during 1R15 to establish a new design flow rate for the containment purge pathway. Based on this evaluation of the flow, Chemistry Procedures 1604.014, "Reactor Building Purge Analysis" and 1604.051, "Eberline Radiation Monitoring System" were revised to include the design flows determined by ER951020-E104. SPING 1 channel 10 was declared operable on September 17, 1999.

No other radioactive effluent instrumentation was inoperable for longer than 30 days during 1999.

11. CHANGES TO THE PROCESS CONTROL PROGRAM

As required by ODCM Appendices 1 and 2, a description of changes made to the Process Control Program (PCP) shall be included in the annual Radioactive Effluent Release Report for the period in which the change was made effective.

During 1999, there were no changes made to the PCP.

12. CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL

In accordance with Unit 1 and Unit 2 TS, changes to the ODCM shall be included in the annual Radioactive Effluent Release Report for the period in which the change(s) was made effective.

During 1999, two changes were made to the ODCM as follows:

Revision 13 PC-2

This change established a minimum circulating water pump dilution flow of no less than 100,000 gpm when releasing radioactive liquid from the site. Normally, two or more circulating water pumps are in operation. However, there are certain occasions when it is necessary to throttle the condenser waterbox inlet valves (CV-3630, CV-3626, CV-3622, and CV-3618). With these valves throttled, the circulating water pump flow is reduced below the normal 191,500 gpm. Additionally, Appendix 1 Limitation L3.3.1 and Appendix 2 Limitation L3.3.1 were revised to correct a grammatical error that was introduced during Revision 13. The words "prior to" were replaced with "by" to be consistent with what is found in U1 TS Section 6.12.2.5 and Unit 2 TS Section 6.9.4. The error occurred while moving the Radiological Effluent Technical Specifications into the ODCM.

Revision 13 PC-3

This change added definitions for "Batch" and "Continuous" releases to the Definitions section of Appendices 1 & 2. Table 2.3-1 of both Appendices was revised to include requirements concerning "Continuous" release sampling frequencies, type and minimum analysis frequencies, and lower limit of detection data.

Additionally, ODCM Revision 13, PC-3 revised Section 2.6, Table 2.6-1 and Table 2.6-2 of Appendices 1 & 2 [Radiological Environmental Monitoring Program (REMP)] to be consistent with the format of the NRC Branch Technical Position, Revision 1, November 1979, for Regulatory Guide 4.8, "Environmental Technical Specifications for Nuclear Power Plants" (BTP). In accordance with the BTP, Program Requirements, ANO modified the REMP using historical analytical data as justification. These changes are also represented in Section 2.6, Table 2.6-1 and Table 2.6-2 of Appendices 1 & 2 and Table 4-1.

A current copy of the ODCM (with this past year's changes indicated) is being forwarded to you along with this report as required by Unit 1 and Unit 2 Technical Specifications. The ODCM is included in Attachment 3.

13. LLD LEVELS

In accordance with ODCM Appendices 1 and 2, lower limits of detection (LLDs) higher than required shall be documented in the annual Radioactive Effluent Release Report.

During 1999, there were no LLDs higher than required.

14. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

In accordance with ODCM Appendices 1 and 2 Limitations L2.6.1.A and L2.6.2.A, unavailability of milk or fresh, leafy vegetable samples, or an increase in an environmental sample location's calculated dose commitment must be identified in the annual Radioactive Effluent Release Report.

A. Changes in Sample Locations

During 1999, there were no instances where milk or fresh leafy vegetable samples were unavailable. However, there were ten environmental sampling location changes that affected the milk and fresh leafy vegetable sample stations during the reporting period. The changes were incorporated in ODCM Revision 13, PC-3, which was implemented on October 25, 1999.

Attachment 3 contains the revised pages of Table 4-1.

B. Increase in Calculated Dose Commitment

There were no environmental sampling locations identified during 1999 that would yield a calculated dose commitment greater than the values currently being calculated.

15. SUMMARY OF HOURLY METEOROLOGICAL DATA

In accordance with ODCM Appendices 1 and 2 Limitations L3.2.1.D.1, in lieu of including a summary of the meteorological data in this report, the 1999 data is retained at ANO. This data is available for NRC review.

16. DESCRIPTION OF MAJOR CHANGES TO RADIOACTIVE WASTE SYSTEMS

There were no major changes made to the Unit 1 liquid and gaseous or Unit 2 liquid and gaseous radwaste systems during 1999. However it was identified on 4/14/99 that charcoal cartridges used to collect unit vent iodine samples have historically been positioned backwards in the collection chamber of the Eberline Super Particulate Iodine Noble Gas (SPING) monitors. In the reversed position, the iodine collected on the backside of the charcoal cartridge instead of the face side. Furthermore, the charcoal cartridge was counted with the face side toward the gamma spectroscopy detector. A Condition Report Action was issued to evaluate what effects, if any, the reversed position of the charcoal cartridge would have on determining the amount of iodine activity present on the cartridge. A test, consisting of counting the charcoal efficiency standard in the normal configuration and then in the reverse direction, was performed to determine the error introduced by reversing the cartridge. It was

determined that the average error ranged from 38% to 50%. For comparison purposes, previous years iodine, particulate, and tritium (ITP) doses were increased by 50% to determine what impact the increase would have on ODCM release limits. Based on the evaluation, it was found that even with the previous years ITP doses increased by 50%, the values remained far below the ODCM limit of 1500 mRem/yr. Additionally, it was determined that LLDs remained well below the required ODCM levels even when increased by 50%.

**17. INDEPENDENT SPENT FUEL STORAGE INSTALLATION (ISFSI)
EFFLUENT RELEASES**

No effluent releases occurred from the ISFSI during 1999.