

Dave Morey
Vice President
Farley Project

**Southern Nuclear
Operating Company**
P.O. Box 1295
Birmingham, Alabama 35201
Tel 205.992.5131

March 10, 2000



Energy to Serve Your WorldSM

NEL-00-0062

Docket Nos: 50-348
50-364

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001

**Joseph M. Farley Nuclear Plant
Pressure Temperature Limits Reports and
Unit 2 Reactor Vessel Surveillance Capsule Z Results**

Ladies and Gentlemen:

In accordance with Farley Units 1 and 2 Technical Specifications 5.6.6, Southern Nuclear Operating Company (SNC) hereby submits revisions to the Unit 1 and Unit 2 Pressure Temperature Limits Reports (PTLRs). Revision 1 was issued to each PTLR to support transition to the Improved Technical Specifications (ITS) and each revision contains only editorial changes.

In a related matter, SNC submitted Westinghouse report WCAP-15171, "Analysis of Capsule Z from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program" by letter dated March 19, 1999. In that letter, SNC committed to revise the Unit 2 PTLR within one year if necessary following review of the Capsule Z test results. Changes have been made to the Capsule Z analysis previously submitted, therefore SNC hereby submits Revision 1 of WCAP-15171 in accordance with the provisions of 10 CFR 50 Appendix H. Review of this revised Capsule Z analysis has been completed and no revision of the Unit 2 PTLR was necessary since the existing heatup and cooldown limit curves remain conservative.

This letter contains no commitments. Please advise if you have any questions or need additional information.

Respectfully submitted,


Dave Morey

DWD/maf: PTLR&CapZltr.doc

Attachments:

- 1) Joseph M. Farley Nuclear Plant Unit 1 Pressure Temperature Limits Report, Rev. 1
- 2) Joseph M. Farley Nuclear Plant Unit 2 Pressure Temperature Limits Report, Rev. 1
- 3) WCAP-15171, Rev. 1, "Analysis of Capsule Z from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program"

A001

Page 2

U. S. Nuclear Regulatory Commission

cc: Southern Nuclear Operating Company
Mr. L. M. Stinson, General Manager - Farley

U. S. Nuclear Regulatory Commission, Washington, D. C.
Mr. L. M. Padovan, Licensing Project Manager – Farley – w/3 WCAPs

U. S. Nuclear Regulatory Commission, Region II
Mr. L. A. Reyes, Regional Administrator
Mr. T. P. Johnson, Senior Resident Inspector – Farley

ATTACHMENT 1

**Joseph M. Farley Nuclear Plant Unit 1
Pressure Temperature Limits Report, Rev. 1**

Joseph M. Farley Nuclear Plant

Unit 1

Pressure Temperature Limits Report

REVISION 1

APPROVED FOR ISSUE


OPERATIONS MANAGER


DATE

Table Of Contents

List of Tables	iii
List of Figures	iv
1.0 RCS Pressure Temperature Limits Report (PTLR)	1
2.0 Operating Limits	1
2.1 RCS Pressure/Temperature (P/T) Limits (LCO - 3.4.3).....	1
2.2 RCP Operation Limits.....	1
3.0 Reactor Vessel Material Surveillance Program	6
4.0 Reactor Vessel Surveillance Data Credibility	7
5.0 Supplemental Data Tables	12
6.0 References	19

List of Tables

2-1 Farley Unit 1 21.9 EFPY Heatup Curve Data Points4

2-2 Farley Unit 1 21.9 EFPY Cooldown Curve Data Points.....5

3-1 Surveillance Capsule Withdrawal Schedule.....6

**4-1 Surveillance Capsule Data Calculation of Best-Fit Line as Described in Position 2.1
of Regulatory Guide 1.99, Revision 2.....10**

4-2 Scatter of ΔRT_{NDT} Values About a Best-Fit Line for Surveillance Plate Material.....11

4-3 Scatter of ΔRT_{NDT} Values About a Best-Fit Line for Surveillance Weld Material11

**5-1 Comparison of Surveillance Material 30 FT-LB Transition Temperature Shifts and
Upper Shelf Energy Decreases with Regulatory Guide 1.99, Revision 2, Predictions.....13**

5-2 Calculation of Chemistry Factors Using Surveillance Capsule Data14

5-3 Reactor Vessel Toughness Table (Unirradiated).....15

5-4 Reactor Vessel Fluence Projections15

**5-5 Summary of Adjusted Reference Temperatures (ARTs) for Reactor Vessel
Beltline Materials at the 1/4-T and 3/4-T Locations for 21.9 EFPY.....16**

**5-6 Calculation of Adjusted Reference Temperature at 21.9 EFPY for the Limiting
Reactor Vessel Material - Lower Shell Plate B6919-1.....17**

5-7 Pressurized Thermal Shock (RT_{PTS}) Values for 36 EFPY.....18

PRESSURE TEMPERATURE LIMITS REPORT

List of Figures

2-1 Farley Unit 1 Reactor Coolant System Heatup Limitations.....2

2-2 Farley Unit 1 Reactor Coolant System Cooldown Limitations3

PRESSURE TEMPERATURE LIMITS REPORT

1.0 RCS Pressure Temperature Limits Report (PTLR)

This PTLR for Farley Nuclear Plant - Unit 1 has been prepared in accordance with the requirement of Technical Specification (TS) 5.6.6. Revisions to the PTLR shall be provided to the NRC after issuance.

This report affects TS 3.4.3, RCS Pressure/Temperature Limits (P/T) Limits. All TS requirements associated with low temperature overpressure protection (LTOP) are contained in TS 3.4.12, RCS Overpressure Protection Systems.

2.0 Operating Limits

The limits for TS 3.4.3 are presented in the subsection which follows and were developed using the methodologies specified in TS 5.6.6. The operability requirements associated with LTOP are specified in TS LCO 3.4.12 and were determined to adequately protect the RCS against brittle fracture in the event of an LTOP transient in accordance with the methodology specified in TS 5.6.6. The limitation on the number of operating reactor coolant pumps (RCPs) is necessary to assure operation consistent with the pressure corrections incorporated in the P/T limits for flow losses associated with the RCPs.

2.1 RCS Pressure/Temperature (P/T) Limits (LCO - 3.4.3)

- 2.1.1 The minimum boltup temperature is 75°F.
- 2.1.2 The RCS temperature rate-of-change limits are:
 - a. A maximum heatup of 100°F in any one hour period.
 - b. A maximum cooldown of 100°F in any one hour period.
 - c. A maximum temperature change of less than or equal to 10°F in any one hour period during inservice hydrostatic and leak testing operations above the heatup and cooldown limit curves.
- 2.1.3 The RCS P/T limits for heatup and cooldown are specified by Figures 2-1 and 2-2, respectively.

2.2 RCP Operation Limits

- 2.2.1 The number of operating RCPs is limited to one at RCS temperatures less than 110°F with the exception that a second pump may be started for the purpose of maintaining continuous flow while taking the operating pump out of service.

PRESSURE TEMPERATURE LIMITS REPORT

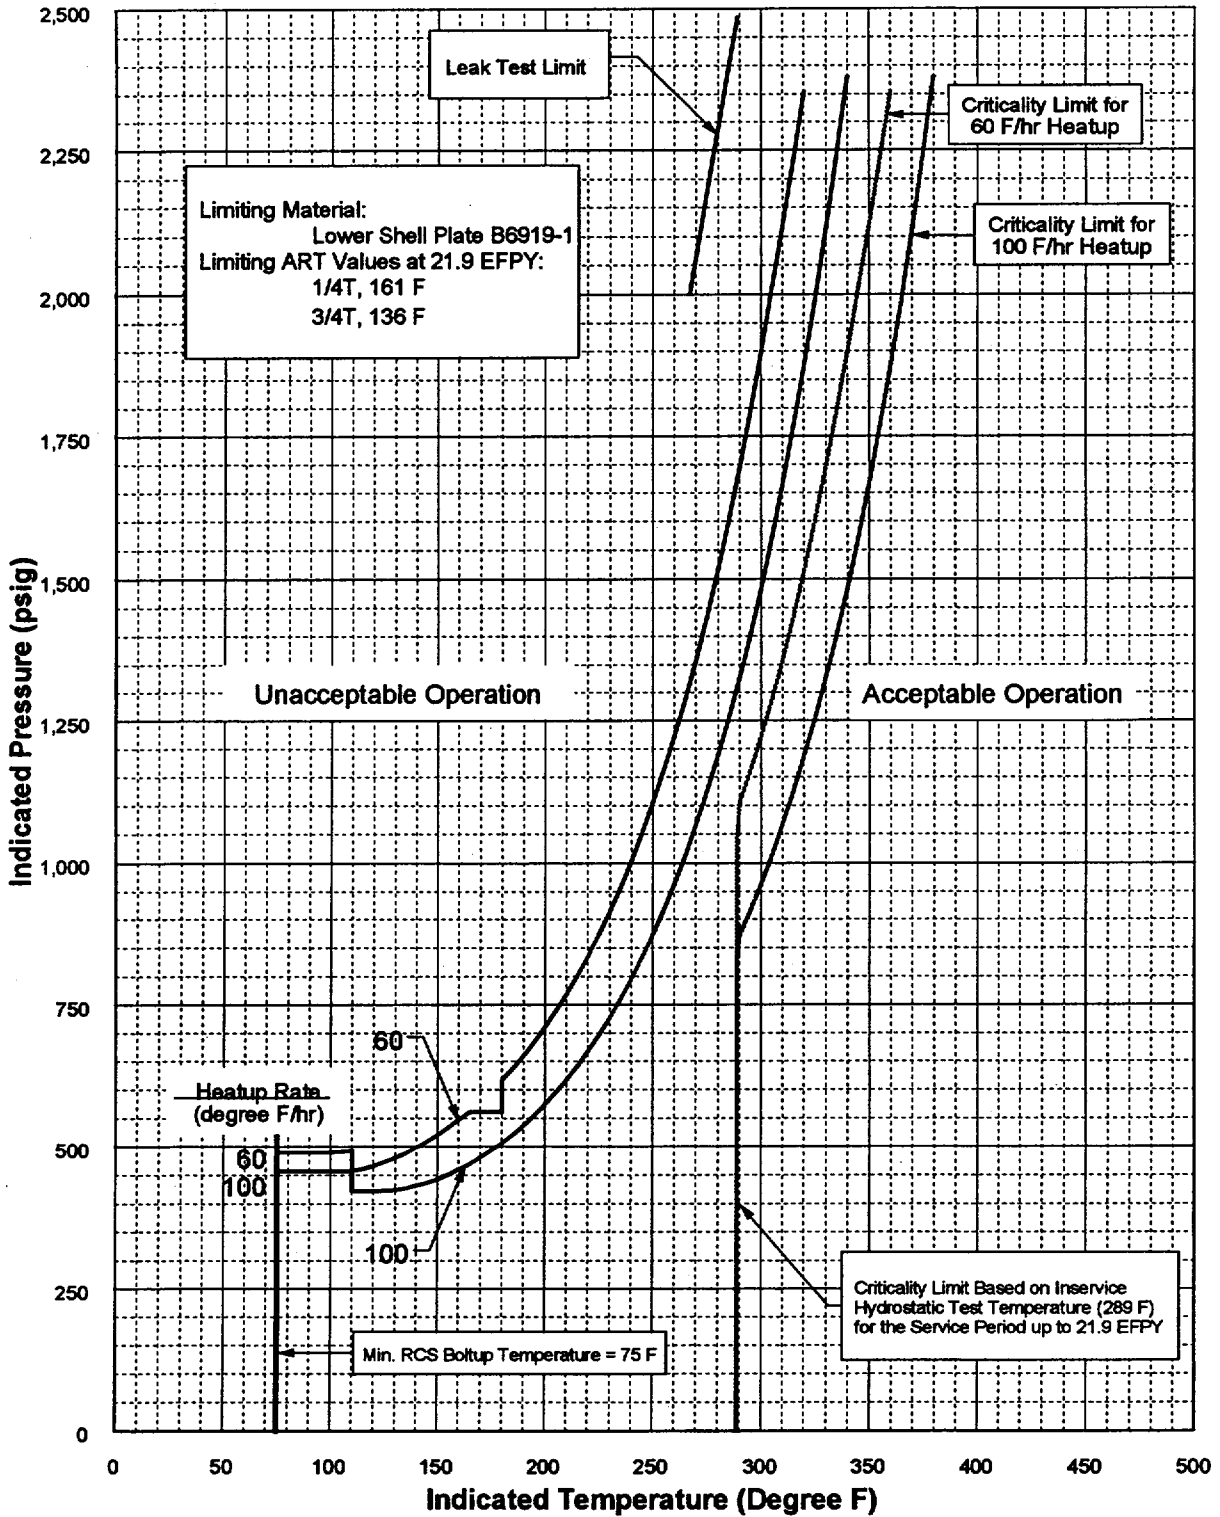


Figure 2-1

Farley Unit 1 Reactor Coolant System Heatup Limitations (Heatup Rates up to 100°F/hr)
 Applicable to 21.9 EFPY (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27
 psi ΔP for RCS temperatures < 110°F). Includes vessel flange requirements of 180°F and 561
 psig per 10 CFR 50, Appendix G. [1]

PRESSURE TEMPERATURE LIMITS REPORT

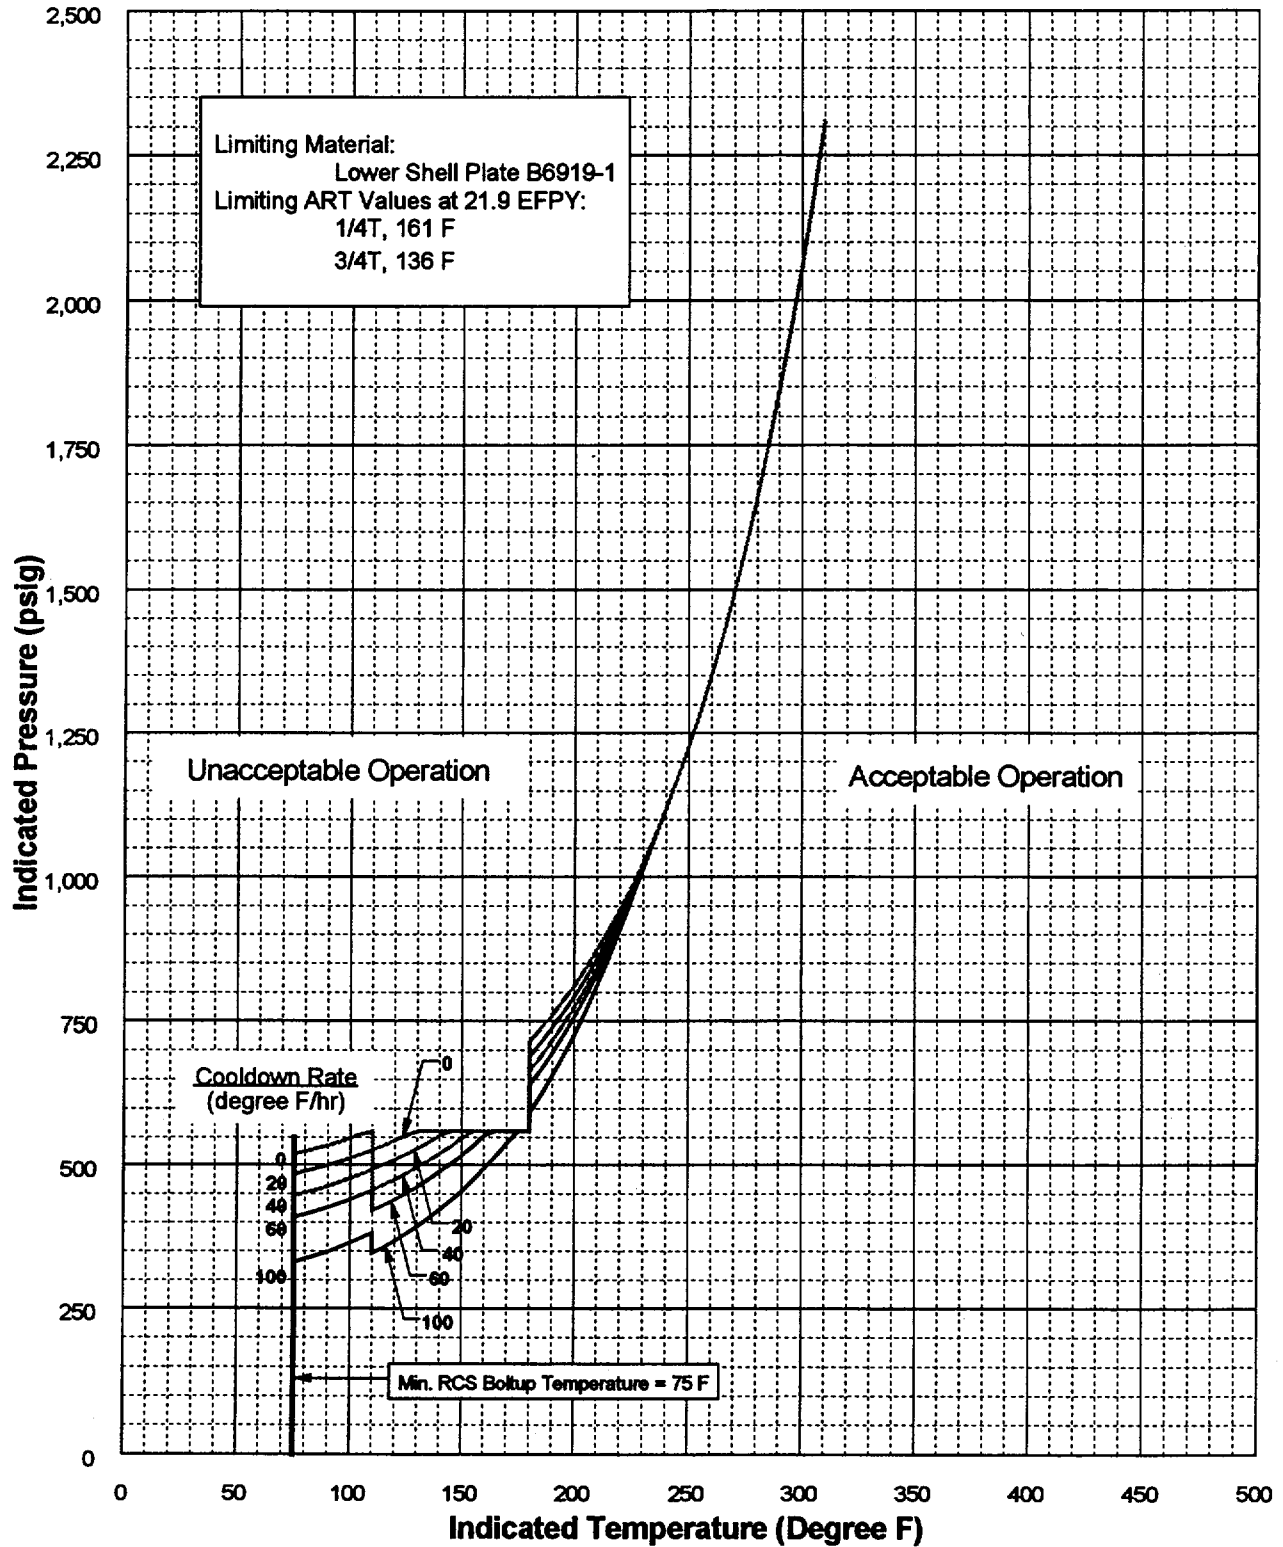


Figure 2-2

Farley Unit 1 Reactor Coolant System Cooldown Limitations (Cooldown Rates up to 100°F/hr)
Applicable to 21.9 EFPY (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27 psi ΔP for RCS temperatures < 110°F). Includes vessel flange requirements of 180°F and 561 psig per 10 CFR 50, Appendix G. ^[1]

PRESSURE TEMPERATURE LIMITS REPORT

60 °F		60 °F Criticality Limit		100 °F		100 °F Criticality Limit		Leak Test	
T	P	T	P	T	P	T	P	T	P
75	488	289	0	75	455	289	0	267	2000
80	488	289	480	80	455	289	481	289	2485
85	488	289	469	85	455	289	466		
90	488	289	462	90	455	289	454		
95	488	289	457	95	455	289	444		
100	488	289	455	100	455	289	436		
105	489	289	456	105	455	289	430		
110	491	289	458	110	455	289	426		
110	458	289	461	110	422	289	423		
115	461	289	466	115	422	289	422		
120	466	289	473	120	422	289	423		
125	473	289	480	125	423	289	424		
130	480	289	488	130	424	289	427		
135	488	289	498	135	427	289	432		
140	498	289	509	140	432	289	437		
145	509	289	521	145	437	289	443		
150	521	289	534	150	443	289	451		
155	534	289	547	155	451	289	460		
160	547	289	563	160	460	289	469		
165	561	289	579	165	469	289	481		
170	561	289	597	170	481	289	493		
175	561	289	617	175	493	289	506		
180	561	289	637	180	506	289	521		
180	617	289	660	185	521	289	537		
185	637	289	684	190	537	289	555		
190	660	289	710	195	555	289	574		
195	684	289	738	200	574	289	595		
200	710	289	768	205	595	289	617		
205	738	289	800	210	617	289	641		
210	768	289	835	215	641	289	668		
215	800	289	873	220	668	289	696		
220	835	289	913	225	696	289	726		
225	873	289	956	230	726	289	759		
230	913	289	1002	235	759	289	794		
235	956	289	1051	240	794	289	832		
240	1002	290	1105	245	832	290	872		
245	1051	295	1162	250	872	295	916		
250	1105	300	1223	255	916	300	963		
255	1162	305	1288	260	963	305	1013		
260	1223	310	1358	265	1013	310	1068		
265	1288	315	1434	270	1068	315	1125		
270	1358	320	1515	275	1125	320	1188		
275	1434	325	1601	280	1188	325	1254		
280	1515	330	1694	285	1254	330	1326		
285	1601	335	1793	290	1326	335	1402		
290	1694	340	1899	295	1402	340	1484		
295	1793	345	2012	300	1484	345	1572		
300	1899	350	2120	305	1572	350	1666		
305	2012	355	2233	310	1666	355	1767		
310	2120	360	2354	315	1767	360	1874		
315	2233			320	1874	365	1988		
320	2354			325	1988	370	2111		
				330	2111	375	2241		
				335	2241	380	2380		
				340	2380				

Table 2-1

Farley Unit 1 21.9 EFPY Heatup Curve Data Points (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27 psi ΔP for RCS temperatures < 110°F)^[1]

PRESSURE TEMPERATURE LIMITS REPORT

0 °F		20 °F		40 °F		60 °F		100 °F	
T	P	T	P	T	P	T	P	T	P
75	519	75	482	75	445	75	407	75	329
80	523	80	487	80	450	80	412	80	335
85	529	85	492	85	455	85	418	85	341
90	534	90	498	90	461	90	424	90	347
95	540	95	504	95	468	95	431	95	355
100	547	100	511	100	475	100	438	100	363
105	554	105	518	105	482	105	446	105	371
110	559	110	526	110	490	110	454	110	380
110	528	110	493	110	457	110	421	110	347
115	536	115	501	115	466	115	430	115	357
120	545	120	510	120	475	120	440	120	368
125	554	125	520	125	485	125	451	125	380
130	561	130	530	130	496	130	462	130	393
135	561	135	541	135	508	135	475	135	407
140	561	140	553	140	521	140	488	140	422
145	561	145	561	145	534	145	502	145	438
150	561	150	561	150	549	150	518	150	455
155	561	155	561	155	561	155	535	155	474
160	561	160	561	160	561	160	553	160	494
165	561	165	561	165	561	165	561	165	516
170	561	170	561	170	561	170	561	170	540
175	561	175	561	175	561	175	561	175	561
180	561	180	561	180	561	180	561	180	561
180	715	180	689	180	664	180	640	180	593
185	737	185	713	185	689	185	666	185	623
190	760	190	738	190	716	190	694	190	655
195	786	195	765	195	744	195	725	195	690
200	813	200	794	200	775	200	758	200	727
205	842	205	825	205	808	205	793	205	767
210	874	210	858	210	844	210	831	210	811
215	908	215	894	215	882	215	872	215	857
220	944	220	933	220	923	220	916	220	908
225	983	225	974	225	968	225	963	225	962
230	1025	230	1019	230	1015	230	1014	230	1020
235	1070	235	1067	235	1066	235	1069		
240	1119	240	1118						
245	1171								
250	1226								
255	1286								
260	1351								
265	1420								
270	1494								
275	1573								
280	1658								
285	1749								
290	1846								
295	1951								
300	2062								
305	2182								
310	2309								

Table 2-2

Farley Unit 1 21.9 EFPY Cooldown Curve Data Points (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 25 psi ΔP for RCS temperatures < 110°F)^[1]

PRESSURE TEMPERATURE LIMITS REPORT

3.0 Reactor Vessel Material Surveillance Program

The reactor vessel material surveillance program is in compliance with 10 CFR 50, Appendix H, and is described in Section 5.4.3.6 of the Farley FSAR. The removal schedule is provided in Table 3-1. The results of these examinations shall be used to update Figures 2-1 and 2-2 if the results indicate that the adjusted reference temperature (ART) for the limiting beltline material exceeds the ART used to generate the P/T limits shown in Figures 2-1 and 2-2 for the specified fluence period.

**Table 3-1
SURVEILLANCE CAPSULE WITHDRAWAL SCHEDULE ^(a)**

Capsule	Capsule Location (Degree)	Lead Factor	Removal EFPY ^(b)	Fluence (n/cm²)
Y ^(c)	343	3.11	1.13	6.42 x 10 ¹⁸
U ^(c)	107	3.18	3.02	1.81 x 10 ¹⁹
X ^(c)	287	3.30	6.12	3.24 x 10 ¹⁹
W ^(c)	110	3.02	12.43	5.17 x 10 ¹⁹
V	290	3.02	Standby	--
Z	340	3.02	Standby	--

NOTES:

- (a) WCAP-14689, Revision 4 ^[1]
- (b) Effective Full Power Years (EFPY) from plant startup
- (c) Plant-specific evaluation

PRESSURE TEMPERATURE LIMITS REPORT

4.0 Reactor Vessel Surveillance Data Credibility

Regulatory Guide 1.99, Revision 2, describes general procedures acceptable to the NRC staff for calculating the effects of neutron radiation embrittlement of the low-alloy steels currently used for light-water-cooled reactor vessels. Position C.2 of Regulatory Guide 1.99, Revision 2, describes the methodology for calculating the adjusted reference temperature and Charpy upper-shelf energy of reactor vessel beltline materials using surveillance capsule data. The methods of Position C.2 can only be applied when two or more credible surveillance data sets become available from the reactor in question.

To date, there have been four surveillance capsules removed from the Farley Unit 1 reactor vessel. In accordance with the discussion of Regulatory Guide 1.99, Revision 2, there are five requirements that must be met for the surveillance data to be judged credible.

The purpose of this evaluation is to apply the credibility requirements of Regulatory Guide 1.99, Revision 2, to the Farley Unit 1 reactor vessel surveillance data and determine if the Farley Unit 1 surveillance data is credible.

Criterion 1: Materials in the capsules should be those judged most likely to be controlling with regard to radiation embrittlement.

The beltline region of the reactor vessel is defined in Appendix G to 10 CFR 50, Fracture Toughness Requirements, December 19, 1995, to be:

the reactor vessel (shell material including welds, heat affected zones, and plates or forgings) that directly surrounds the effective height of the active core and adjacent regions of the reactor vessel that are predicted to experience sufficient neutron radiation damage to be considered in the selection of the most limiting material with regard to radiation damage.

The Farley Unit 1 reactor vessel consists of the following beltline region materials:

- Intermediate shell plates B6903-2 and B6903-3;
- Lower shell plates B6919-1 and B6919-2;
- Intermediate shell longitudinal weld seams 19-894 A & B, heat number 33A277, Linde 1092 flux, flux lot 3889;
- Lower shell longitudinal weld seams 20-894 A & B, heat number 90099, Linde 0091 flux, flux lot 3977; and
- Circumferential weld 11-894, heat number 6329637, Linde 0091 flux, flux lot 3999.

PRESSURE TEMPERATURE LIMITS REPORT

Per WCAP-8810^[5], the Unit 1 surveillance program was based on ASTM E185-73, Standard Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels. Per Section 4.1 of ASTM E185-73, the base metal and weld metal to be included in the program should represent the material that may limit the operation of the reactor during its lifetime. The test material should be selected on the basis of initial transition temperature, upper shelf energy level, and estimated increase in transition temperature considering chemical composition (copper and phosphorus) and neutron fluence.

Therefore, at the time the Farley Unit 1 surveillance capsule program was developed, lower shell plate B6919-1 was judged to be most limiting based on the above recommendations and was utilized in the surveillance program.

The surveillance program weld for Farley Unit 1 was fabricated using the same heat of weld wire used to fabricate the middle shell axial seams 19-894 A & B (heat 33A277). The results of mechanical property tests performed on the surveillance weld are considered to be representative of the property changes expected in the reactor vessel beltline seams.

Therefore, the materials selected for use in the Farley Unit 1 surveillance program were those judged to be most likely controlling with regard to radiation embrittlement according to the accepted methodology at the time the surveillance program was developed. Based on the above, the Farley Unit 1 surveillance program meets the requirements of Criterion 1.

Criterion 2: Scatter in the plots of Charpy energy versus temperature for the irradiated and unirradiated conditions should be small enough to permit the determination of the 30 ft-lb temperature and upper shelf energy, unambiguously.

Plots of Charpy energy versus temperature for the unirradiated condition are presented in the Unit 1 reactor vessel surveillance program description contained in WCAP-8810^[5].

Plots of Charpy energy versus temperature for the irradiated conditions are presented in the reactor vessel surveillance capsule reports for capsules Y^[6], U^[7], X^[8], and W^[2].

Based on engineering judgment, the scatter in the data presented in these plots is small enough to determine the 30 ft-lb temperature and upper shelf energy of the Farley Unit 1 surveillance materials unambiguously. Therefore, the Farley Unit 1 surveillance program meets the requirements of Criterion 2.

PRESSURE TEMPERATURE LIMITS REPORT

Criterion 3: When there are two or more sets of surveillance data from one reactor, the scatter of ΔRT_{NDT} values about a best-fit line drawn as described in Regulatory Position 2.1 normally should be less than 28°F for welds and 17°F for base metal. Even if the fluence range is large (two or more orders of magnitude), the scatter should not exceed twice those values. Even if the data fail this criterion for use in shift calculations, they may be credible for determining decrease in upper shelf energy if the upper shelf can be clearly determined, following the definition given in ASTM E185-82.

The least squares method, as described in Regulatory Position 2.1, will be utilized in determining a best-fit line for this data to determine if this criterion is met.

[Continued on the following page]

PRESSURE TEMPERATURE LIMITS REPORT

Table 4-1

SURVEILLANCE CAPSULE DATA CALCULATION OF BEST-FIT LINE AS DESCRIBED IN POSITION 2.1 OF REGULATORY GUIDE 1.99, REVISION 2^(a)

Material	Capsule	F ^(b)	FF ^(c) (x)	ΔRT_{NDT} (y)	FF x ΔRT_{NDT} (xy)	FF ² (x ²)	
Lower Shell Plate B6919-1 (Longitudinal)	Y	0.642	0.876	85	74.5	0.767	
	U	1.81	1.16	105	121.8	1.35	
	X	3.24	1.31	135	176.9	1.72	
	W	5.17	1.41	155	218.6	1.99	
Lower Shell Plate B6919-1 (Transverse)	Y	0.642	0.876	55	48.2	0.767	
	U	1.81	1.16	90	104.4	1.35	
	X	3.24	1.31	105	137.6	1.72	
	W	5.17	1.41	145	204.5	1.99	
	$\sum_{i=1}^n$					1086.5	11.65
	$CF = \Sigma(FF * \Delta RT_{NDT}) \div \Sigma(FF^2) = 93.3^{\circ}F$						
Weld Metal	Y	0.642	0.876	80	70.1	0.767	
	U	1.81	1.16	80	92.8	1.35	
	X	3.24	1.31	100	131.0	1.72	
	W	5.17	1.41	95	134.0	1.99	
	$\sum_{i=1}^n$					427.9	5.83
	$CF = \Sigma(FF * \Delta RT_{NDT}) \div \Sigma(FF^2) = 73.4^{\circ}F$						

NOTES:

- (a) WCAP-14689, Revision 4^[1]
- (b) F = Fluence (10^{19} n/cm², E > 1.0 MeV)
- (c) FF = Fluence Factor = $F^{(0.28 - 0.1 \log F)}$

PRESSURE TEMPERATURE LIMITS REPORT

Table 4-2

SCATTER OF ΔT_{NDT} VALUES ABOUT A BEST-FIT LINE
FOR SURVEILLANCE PLATE MATERIAL ^(a)

Lower Shell Plate B6919-1 Orientation	FF	ΔT_{NDT} (30 ft-lb) (°F)	Best Fit ΔT_{NDT} (°F)	Scatter of ΔT_{NDT} (°F)
Longitudinal	0.876	85	81.7	-3.3
	1.16	105	108.2	3.2
	1.31	135	122.2	-12.8
	1.41	155	131.6	-23.4
Transverse	0.876	55	81.7	26.7
	1.16	90	108.2	18.2
	1.31	105	122.2	17.2
	1.41	145	131.6	-13.4

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

The scatter of ΔT_{NDT} values about a best-fit line drawn with the y-intercept equal to zero, as described in Regulatory Position 2.1, should be less than 17°F for base metal. As shown above, the scatter of four of the data points are not within 17°F of the best-fit line. Therefore, this criteria is not met for the Farley Unit 1 surveillance plate material. Since all of the data is not within 17°F of the best fit line, SNC has chosen to use the CF from this surveillance data along with a σ_{Δ} of 17°F when predicting the Farley Unit 1 vessel properties.

Table 4-3

SCATTER OF ΔT_{NDT} VALUES ABOUT A BEST-FIT LINE
FOR SURVEILLANCE WELD MATERIAL ^(a)

Material	FF	ΔT_{NDT} (30 ft-lb) (°F)	Best Fit ΔT_{NDT} (°F)	Scatter of ΔT_{NDT} (°F)
Weld Metal	0.876	80	64.3	-15.7
	1.16	80	85.1	5.1
	1.31	100	96.2	-3.8
	1.41	95	103.5	8.5

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

PRESSURE TEMPERATURE LIMITS REPORT

The scatter of ΔRT_{NDT} values about a best-fit line drawn with the y-intercept equal to zero, as described in Regulatory Position 2.1, is less than 28°F as shown above. Therefore, Criterion 3 is met for the Farley Unit 1 surveillance weld material.

Criterion 4: The irradiation temperature of the Charpy specimens in the capsule should match the vessel wall temperature at the cladding/base metal interface within $\pm 25^\circ\text{F}$.

The Farley Unit 1 capsule specimens are located in the reactor between the neutron shielding pads and the vessel wall and are positioned opposite the center of the core. The test capsules are in guide tubes attached to the neutron shielding pads. The location of the specimens with respect to the reactor vessel beltline provides assurance that the reactor vessel wall and the specimens experience equivalent operating conditions and will not differ by more than 25°F. Therefore, the Farley surveillance program meets the requirements of Criterion 4.

Criterion 5: The surveillance data for the correlation monitor material in the capsule should fall within the scatter band of the data base for that material.

The Farley Unit 1 surveillance program does not include correlation monitor material. Therefore, Criterion 5 is not applicable to Farley Unit 1.

CONCLUSION:

Based on the preceding responses to the criteria of Regulatory Guide 1.99, Revision 2, Section B, and the application of engineering judgment, the Farley Unit 1 surveillance plate material data is not credible and the Farley Unit 1 surveillance weld data is credible.

5.0 Supplemental Data Tables

Table 5-1 contains a comparison of measured surveillance material 30 ft-lb transition temperature shifts and upper shelf energy decreases with Regulatory Guide 1.99, Revision 2, predictions.

Table 5-2 shows the calculation of the surveillance material chemistry factors using surveillance capsule data.

Table 5-3 provides the unirradiated Farley Unit 1 reactor vessel toughness data.

Table 5-4 provides a summary of the fluences used in the PTS evaluation.

Table 5-5 provides a summary of the adjusted reference temperatures (ARTs) of the Farley Unit 1 reactor vessel beltline materials at the 1/4-T and 3/4-T locations for 21.9 EFPY.

Table 5-6 shows the calculation of the ART at 21.9 EFPY for the limiting Farley Unit 1 reactor vessel material (lower shell plate B6919-1).

Table 5-7 provides RT_{PTS} values for Farley Unit 1 for 36 EFPY.

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-1

COMPARISON OF SURVEILLANCE MATERIAL 30 FT-LB TRANSITION TEMPERATURE SHIFTS
AND UPPER SHELF ENERGY DECREASES WITH REGULATORY GUIDE 1.99, REVISION 2,
PREDICTIONS^(a)

Material	Capsule	Fluence ($\times 10^{19}$ n/cm ² , E > 1.0 MeV)	30 ft-lb Transition Temperature Shift		Upper Shelf Energy Decrease	
			Predicted (°F)	Measured (°F)	Predicted (%)	Measured (%)
Plate B6919-1 (Longitudinal)	Y	0.642	85.7	85	21	9
	U	1.81	113.7	105	27	21
	X	3.24	128.0	135	31	19
	W	5.17	137.8	155	34	22
Plate B6919-1 (Transverse)	Y	0.642	85.7	55	21	0
	U	1.81	113.7	90	27	9
	X	3.24	128.0	105	31	11
	W	5.17	137.8	145	34	16
Weld Metal	Y	0.642	68.4	80	25	13
	U	1.81	90.8	80	33	28
	X	3.24	102.2	100	38	23
	W	5.17	110.0	95	42	26
HAZ Metal	Y	0.642	--	60	--	11
	U	1.81	--	120	--	26
	X	3.24	--	125	--	19
	W	5.17	--	110	--	14

NOTES:

(a) WCAP-14689, Revision 4^[1]

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-2

CALCULATION OF CHEMISTRY FACTORS USING SURVEILLANCE CAPSULE DATA ^(a)

Material	Capsule	f ^(b)	FF ^(c)	ΔRT _{NDT}	FF * ΔRT _{NDT}	FF ²	
Lower Shell Plate B6919-1 (Longitudinal)	Y	0.642	0.876	85	74.5	0.767	
	U	1.81	1.16	105	121.8	1.35	
	X	3.24	1.31	135	176.9	1.72	
	W	5.17	1.41	155	218.6	1.99	
Lower Shell Plate B6919-1 (Transverse)	Y	0.642	0.876	55	48.2	0.767	
	U	1.81	1.16	90	104.4	1.35	
	X	3.24	1.31	105	137.6	1.72	
	W	5.17	1.41	145	204.5	1.99	
	Sum:					1086.5	11.65
Chemistry Factor (CF) = Σ (FF * ΔRT _{NDT}) ÷ Σ (FF ²) = 93.3°F							
Weld Metal ^(d)	Y	0.642	0.876	129.6	113.5	0.767	
	U	1.81	1.16	129.6	150.3	1.35	
	X	3.24	1.31	162.0	212.2	1.72	
	W	5.17	1.41	153.9	217.0	1.99	
	Sum:					693.0	5.83
	Chemistry Factor (CF) = Σ (FF * ΔRT _{NDT}) ÷ Σ (FF ²) = 118.9°F						

NOTES:

- (a) WCAP-14689, Revision 4 ⁽¹⁾
- (b) f = fluence (x 10¹⁹ n/cm², E > 1.0 MeV)
- (c) FF = fluence factor = f^(0.28 - 0.1 log f)
- (d) ΔRT_{NDT} values were multiplied by a ratio factor of 1.62
(CF_{vessel} ÷ CF_{surv weld} = 126.2 ÷ 78.1 = 1.62)

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-3
 REACTOR VESSEL TOUGHNESS TABLE (UNIRRADIATED)^(a)

Beltline Material	Cu Weight %	Ni Weight %	IRT _{NDT} (°F)
Closure Head Flange	--	--	60
Vessel Flange	--	--	60
Intermediate Shell Plate B6903-2	0.13	0.60	0
Intermediate Shell Plate B6903-3	0.12	0.56	10
Lower Shell Plate B6919-1	0.14	0.55	15
Lower Shell Plate B6919-2	0.14	0.56	5
Intermediate Shell Longitudinal Weld Seams 19-894 A & B ^(b) (Heat # 33A277)	0.258	0.165	-56
Surveillance Weld ^(c)	0.14	0.19	--
Circumferential Weld Seam 11-894 ^(b) (Heat # 6329637)	0.205	0.105	-56
Lower Shell Longitudinal Weld Seams 20-894 A & B ^(b) (Heat # 90099)	0.197	0.060	-56

NOTES:

- (a) WCAP-14689, Revision 4^[1]
- (b) Best-estimate copper and nickel from CE NPSD-1039^[9]
- (c) The surveillance weld is representative of intermediate shell longitudinal welds 19-894 A & B. Best-estimate copper and nickel values represent a single chemical analysis documented in WCAP-8810^[5]

Table 5-4
 REACTOR VESSEL FLUENCE PROJECTIONS FOR 36 EPFY^(a, b)

EPFY	0°	15°	15° ^(c)	30°	30° ^(c)	45°
36	4.34	2.68	2.14	2.01	1.93	1.35

NOTES:

- (a) WCAP-14689, Revision 4^[1]
- (b) Fluence in 10¹⁹ n/cm² (E > 1.0 MeV)
- (c) Indicates location in octants with a 26° neutron pad span.

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-5

SUMMARY OF ADJUSTED REFERENCE TEMPERATURES (ARTs) FOR REACTOR VESSEL
BELTLINE MATERIALS AT THE 1/4-T AND 3/4-T LOCATIONS FOR 21.9 EF¹⁹ ^(a, b)

Material	1/4-T (°F)	3/4-T (°F)
Intermediate Shell Plate B6903-2	138	114
Intermediate Shell Plate B6903-3	138	115
Lower Shell Plate B6919-1	161 ^(c)	135 ^(c)
Lower Shell Plate B6919-1 Using S/C Data	156	131
Lower Shell Plate B6919-2	151	126
Intermediate Shell Longitudinal Weld Seams 19-894 A & B (Heat # 33A277)	113 ^(d)	82 ^(d)
Intermediate Shell Longitudinal Weld Seams 19-894 A & B (Heat # 33A277) Using S/C Data	85 ^(d)	56 ^(d)
Circumferential Weld 11-894 (Heat # 6329637)	123	97
Lower Shell Longitudinal Weld Seams 20- 894 A & B (Heat # 90099)	85 ^(d)	62 ^(d)

NOTES:

- (a) WCAP-14689, Revision 4 ^[1]
- (b) The ARTs presented here are based on the peak reactor vessel surface fluence of 2.718×10^{19} n/cm² (E > 1.0 MeV) unless otherwise noted.
- (c) Limiting 1/4-T and 3/4-T ART values. The P/T limit curves are those previously generated based on a 1/4T ART of 161°F and a 3/4-T ART value of 136°F which bounds the limiting 1/4-T and 3/4-T ARTs shown above.
- (d) ARTs calculated using the peak vessel fluence of 0.8307×10^{19} n/cm² (E > 1.0 MeV) at 45°

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-6

CALCULATION OF ADJUSTED REFERENCE TEMPERATURE AT 21.9 EFPY FOR THE LIMITING REACTOR VESSEL MATERIAL - LOWER SHELL PLATE B6919-1 ^(a)

Parameter	21.9 EFPY	
Operating Period	21.9 EFPY	
Location	1/4-T	3/4-T
Chemistry Factor, CF (°F)	97.8	97.8
Fluence, f (10^{19} n/cm ²) ^(b)	1.695	0.659
Fluence Factor, FF	1.145	0.883
$\Delta RT_{NDT} = CF \times FF$ (°F)	112.0	86.4
Initial RT_{NDT} , I (°F)	15	15
Margin, M (°F)	34	34
Adjusted Reference Temperature (ART), (°F) per Regulatory Guide 1.99, Revision 2	161	135

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

(b) Fluence is based on f_{surf} (10^{19} n/cm², $E > 1.0$ MeV) = 2.718 at 21.9 EFPY. The Farley Unit 1 reactor vessel wall thickness is 7.875 inches in the beltline region.

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-7

PRESSURIZED THERMAL SHOCK (RT_{PTS}) VALUES FOR 36 EF_{PT}Y^(a)

Material	CF	Surface Fluence (10 ¹⁹ n/cm ² , E > 1.0 MeV)	FF	ΔRT _{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Intermediate Shell Plate B6903-2	91.0	4.34	1.374	125.0	0	34	159
Intermediate Shell Plate B6903-3	82.2	4.34	1.374	112.9	10	34	157
Lower Shell Plate B6919-1	97.8	4.34	1.374	134.4	15	34	183
Lower Shell Plate B6919-1 Using S/C Data	93.3	4.34	1.374	128.2	15	34 ^(b)	177
Lower Shell Plate B6919-2	98.2	4.34	1.374	134.9	5	34	174
Intermediate Shell Longitudinal Welds 19-894 A & B (Heat # 33A277)	126.2	1.35	1.083	136.7	-56	66	147
Intermediate Shell Longitudinal Welds 19-894 A & B (Heat # 33A277) Using S/C Data	118.9	1.35	1.083	128.8	-56	44	117
Circumferential Weld 11-894 (Heat # 6329637)	98.4	4.34	1.374	135.2	-56	66	145
Lower Shell Longitudinal Welds 20-894 A & B (Heat # 90099)	91.4	1.35	1.083	99.0	-56	66	109

NOTES:

(a) WCAP-14689, Revision 4^[1]

(b) $\sigma_{\Delta} = 17^{\circ}\text{F}$ since the plate surveillance data did not meet credibility criteria

PRESSURE TEMPERATURE LIMITS REPORT

6.0 References

1. WCAP-14689, Revision 4, Farley Units 1 and 2 Heatup and Cooldown Limit Curves for Normal Operation and PTLR Support Documentation, E. Terek, April 1998.
2. WCAP-14196, Analysis of Capsule W from the Alabama Power Company Farley Unit 1 Reactor Vessel Radiation Surveillance Program, P. A. Peters, et al., February 1995.
3. WCAP-14687, Joseph M. Farley Units 1 and 2 Radiation Analysis and Neutron Dosimetry Evaluation, R. L. Bencini, June 1996.
4. WCAP-14040-NP-A, Revision 2, Methodology Used to Develop Cold Overpressure Mitigating System Setpoints and RCS Heatup and Cooldown Limit Curves, January 1996.
5. WCAP-8810, Southern Alabama Power Company Joseph M. Farley Nuclear Plant Unit No. 1 Reactor Vessel Radiation Surveillance Program, J. A. Davidson, et al., December 1976
6. WCAP-9717, Analysis of Capsule Y from the Alabama Power Company Farley Unit No. 1 Reactor Vessel Radiation Surveillance Program, S. E. Yanichko, et al., June 1980.
7. WCAP-10474, Analysis of Capsule U from the Alabama Power Company Joseph M. Farley Unit 1 Reactor Vessel Radiation Surveillance Program, R. S. Boggs, et al., February 1984.
8. WCAP-12471, Analysis of Capsule X from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program, E. Terek, et al., December 1989.
9. CE NPSD-1039, Revision 2, Best Estimate Copper and Nickel Values in CE Fabricated Reactor Vessel Welds, Combustion Engineering Owners Group, June 1997.

ATTACHMENT 2

**Joseph M. Farley Nuclear Plant Unit 2
Pressure Temperature Limits Report, Rev. 1**

Joseph M. Farley Nuclear Plant

Unit 2

Pressure Temperature Limits Report

REVISION 1

APPROVED FOR ISSUE

Michael Fox 3/1/03
OPERATIONS MANAGER DATE

Table Of Contents

List of Tables	iii
List of Figures	iv
1.0 RCS Pressure Temperature Limits Report (PTLR)	1
2.0 Operating Limits	1
2.1 RCS Pressure/Temperature (P/T) Limits (LCO - 3.4.3).....	1
2.2 RCP Operation Limits.....	1
3.0 Reactor Vessel Material Surveillance Program	6
4.0 Reactor Vessel Surveillance Data Credibility	7
5.0 Supplemental Data Tables	12
6.0 References	19

PRESSURE TEMPERATURE LIMITS REPORT

List of Tables

2-1 Farley Unit 2 33.8 EFPY Heatup Curve Data Points4

2-2 Farley Unit 2 33.8 EFPY Cooldown Curve Data Points5

3-1 Surveillance Capsule Withdrawal Schedule6

4-1 Surveillance Capsule Data Calculation of Best-Fit Line as Described in Position 2.1
of Regulatory Guide 1.99, Revision 210

4-2 Scatter of ΔRT_{NDT} Values About a Best-Fit Line for Surveillance Plate Material11

4-3 Scatter of ΔRT_{NDT} Values About a Best-Fit Line for Surveillance Weld Material11

5-1 Comparison of Surveillance Material 30 Ft-Lb Transition Temperature Shifts and
Upper Shelf Energy Decrease with Regulatory Guide 1.99, Revision 2, Predictions13

5-2 Calculation of Chemistry Factors Using Surveillance Capsule Data14

5-3 Reactor Vessel Toughness Table (Unirradiated)15

5-4 Reactor Vessel Fluence Projections for 36 EFPY16

5-5 Summary of Adjusted Reference Temperatures (ARTs) for Reactor Vessel
Beltline Materials at the 1/4-T and 3/4-T Locations for 33.8 EFPY16

5-6 Calculation of Adjusted Reference Temperature at 33.8 EFPY for the Limiting
Reactor Vessel Material17

5-7 Pressurized Thermal Shock (RT_{PTS}) Values for 36 EFPY18

PRESSURE TEMPERATURE LIMITS REPORT

List of Figures

2-1 Farley Unit 2 Reactor Coolant System Heatup Limitations.....2

2-2 Farley Unit 2 Reactor Coolant System Cooldown Limitations3

PRESSURE TEMPERATURE LIMITS REPORT

1.0 RCS Pressure Temperature Limits Report (PTLR)

This PTLR for Farley Nuclear Plant - Unit 2 has been prepared in accordance with the requirement of Technical Specification (TS) 5.6.6. Revisions to the PTLR shall be provided to the NRC after issuance.

This report affects TS 3.4.3, RCS Pressure/Temperature Limits (P/T) Limits. All TS requirements associated with low temperature overpressure protection (LTOP) are contained in TS 3.4.12, RCS Overpressure Protection Systems.

2.0 Operating Limits

The limits for TS 3.4.3 are presented in the subsection which follows and were developed using the NRC-approved methodologies specified in TS 5.6.6. The operability requirements associated with LTOP are specified in TS LCO 3.4.12 and were determined to adequately protect the RCS against brittle fracture in the event of an LTOP transient in accordance with the methodology specified in TS 5.6.6. The limitation on the number of operating reactor coolant pumps (RCPs) is necessary to assure operation consistent with the pressure corrections incorporated in the P/T limits for flow losses associated with the RCPs.

2.1 RCS Pressure/Temperature (P/T) Limits (LCO - 3.4.3)

- 2.1.1 The minimum boltup temperature is 75°F.
- 2.1.2 The RCS temperature rate-of-change limits are:
 - a. A maximum heatup of 100°F in any one hour period.
 - b. A maximum cooldown of 100°F in any one hour period.
 - c. A maximum temperature change of less than or equal to 10°F in any one hour period during inservice hydrostatic and leak testing operations above the heatup and cooldown limit curves.
- 2.1.3 The RCS P/T limits for heatup and cooldown are specified by Figures 2-1 and 2-2, respectively.

2.2 RCP Operation Limits

- 2.2.1 The number of operating RCPs is limited to one at RCS temperatures less than 110°F with the exception that a second pump may be started for the purpose of maintaining continuous flow while taking the operating pump out of service.

PRESSURE TEMPERATURE LIMITS REPORT

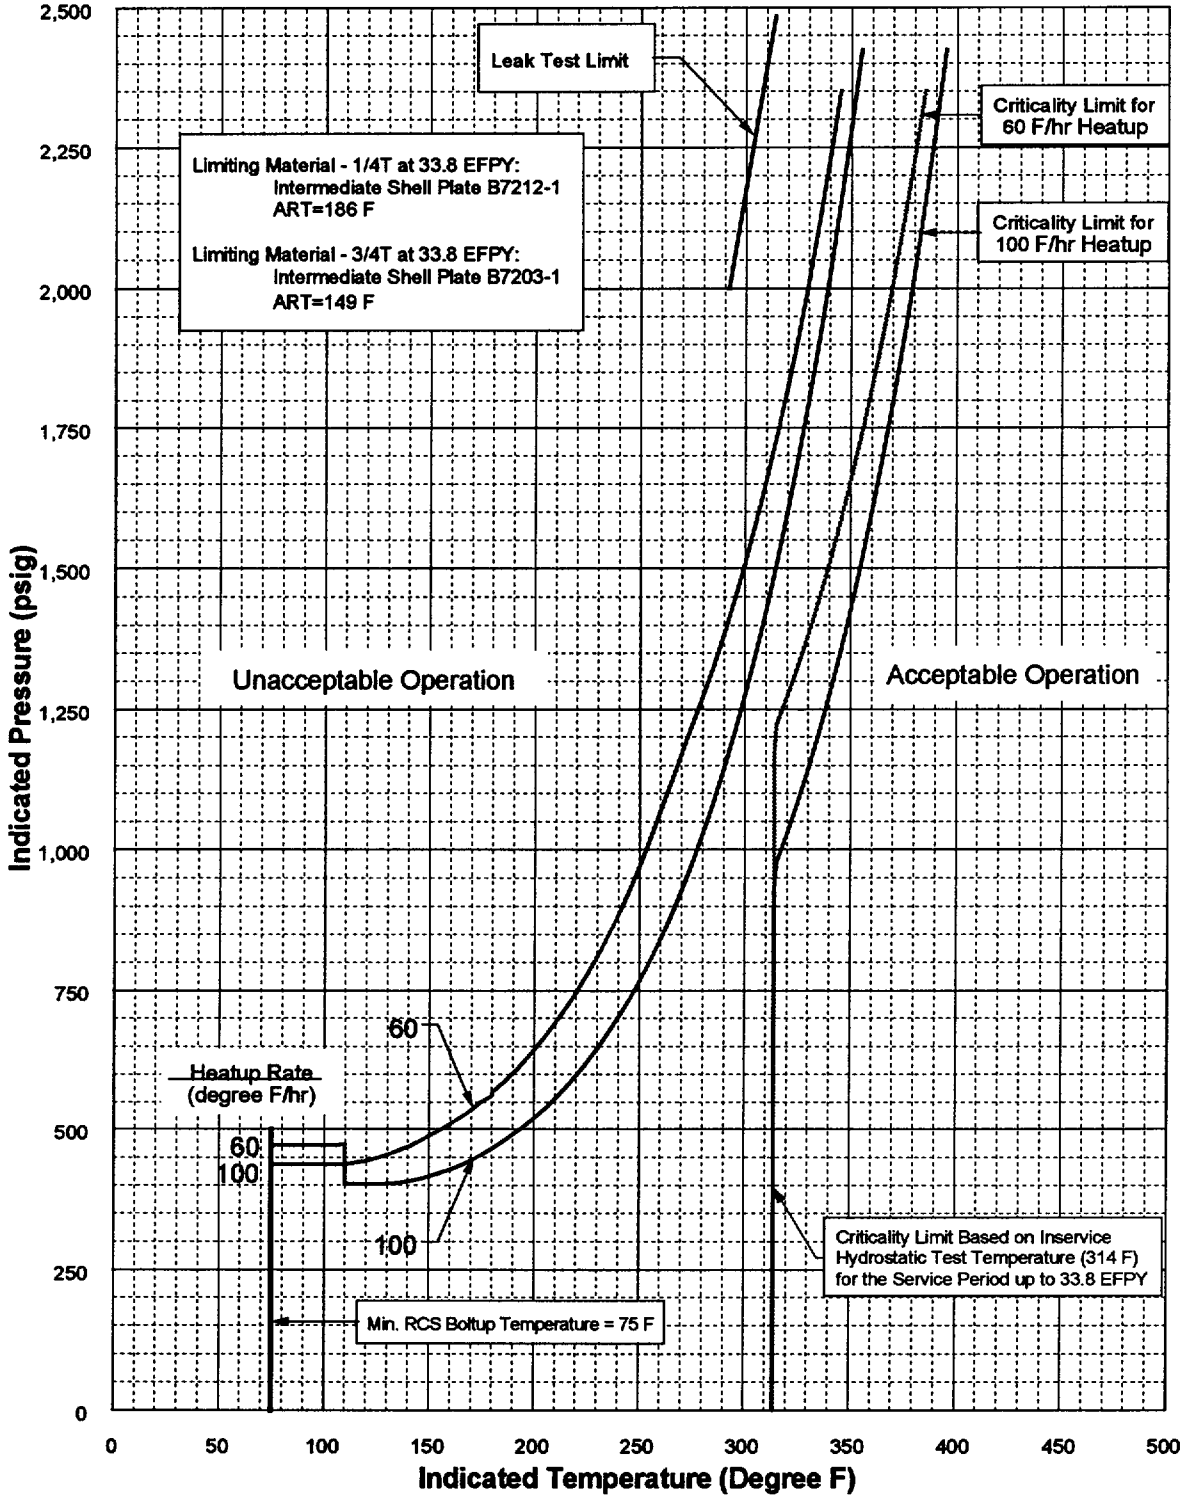


Figure 2-1

Farley Unit 2 Reactor Coolant System Heatup Limitations (Heatup Rates up to 100°F/hr)
 Applicable to 33.8 EFPY (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27 psi ΔP at RCS temperatures < 110°F). Includes vessel flange requirements of 180°F and 561 psig per 10 CFR 50, Appendix G. [1]

PRESSURE TEMPERATURE LIMITS REPORT

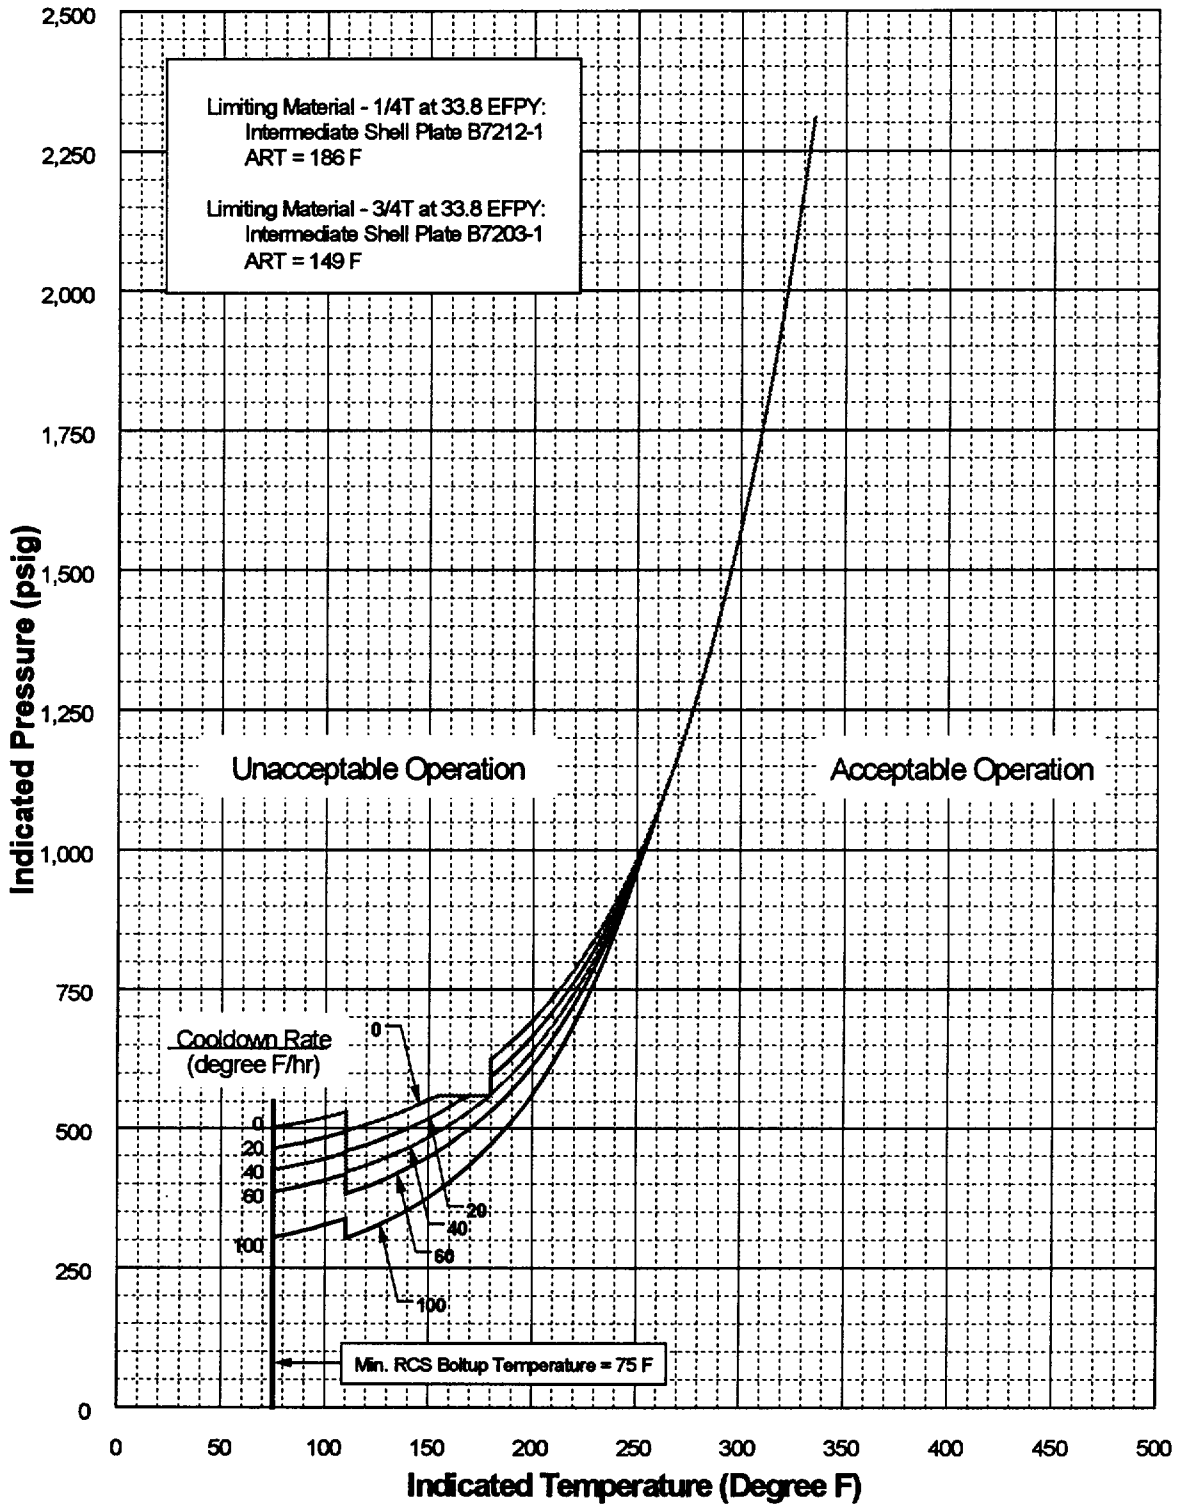


Figure 2-2

Farley Unit 2 Reactor Coolant System Cooldown Limitations (Cooldown Rates up to 100°F/hr)
Applicable to 33.8 EFPY (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27
psi ΔP at RCS temperatures < 110°F). Includes vessel flange requirements of 180°F and 561
psig per 10 CFR 50, Appendix G. ^[1]

PRESSURE TEMPERATURE LIMITS REPORT

60 °F		60 °F Criticality Limit		100 °F		100 °F Criticality Limit		Leak Test	
T	P	T	P	T	P	T	P	T	P
75	470	314	0	75	435	314	0	292	2000
80	470	314	465	80	435	314	467	314	2485
85	470	314	454	85	435	314	451		
90	470	314	446	90	435	314	438		
95	470	314	441	95	435	314	428		
100	470	314	438	100	435	314	419		
105	470	314	437	105	435	314	413		
110	471	314	438	110	435	314	408		
110	438	314	441	110	402	314	405		
115	441	314	444	115	402	314	403		
120	444	314	449	120	402	314	402		
125	449	314	455	125	402	314	403		
130	455	314	462	130	403	314	404		
135	462	314	469	135	404	314	407		
140	469	314	478	140	407	314	411		
145	478	314	488	145	411	314	416		
150	488	314	498	150	416	314	422		
155	498	314	510	155	422	314	428		
160	510	314	522	160	428	314	436		
165	522	314	536	165	436	314	445		
170	536	314	551	170	445	314	455		
175	551	314	567	175	455	314	466		
180	561	314	584	180	466	314	478		
180	567	314	602	185	478	314	491		
185	584	314	622	190	491	314	505		
190	602	314	644	195	505	314	521		
195	622	314	667	200	521	314	538		
200	644	314	692	205	538	314	556		
205	667	314	719	210	556	314	576		
210	692	314	747	215	576	314	598		
215	719	314	778	220	598	314	621		
220	747	314	811	225	621	314	646		
225	778	314	847	230	646	314	673		
230	811	314	885	235	673	314	702		
235	847	314	926	240	702	314	733		
240	885	314	970	245	733	314	767		
245	926	314	1018	250	767	314	803		
250	970	314	1069	255	803	314	842		
255	1018	314	1119	260	842	314	883		
260	1069	314	1171	265	883	314	928		
265	1119	315	1223	270	928	315	976		
270	1171	320	1273	275	976	320	1028		
275	1223	325	1326	280	1028	325	1083		
280	1273	330	1383	285	1083	330	1143		
285	1326	335	1445	290	1143	335	1206		
290	1383	340	1510	295	1206	340	1275		
295	1445	345	1580	300	1275	345	1348		
300	1510	350	1656	305	1348	350	1426		
305	1580	355	1736	310	1426	355	1510		
310	1656	360	1822	315	1510	360	1599		
315	1736	365	1914	320	1599	365	1695		
320	1822	370	2013	325	1695	370	1798		
325	1914	375	2118	330	1798	375	1908		
330	2013	380	2231	335	1908	380	2025		
335	2118	385	2351	340	2025	385	2150		
340	2231			345	2150	390	2283		
345	2351			350	2283	395	2425		
				355	2425				

Table 2-1

Farley Unit 2 - 33.8 EFPY Heatup Curve Data Points (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27 psi ΔP at RCS temperatures < 110°F)^[1]

PRESSURE TEMPERATURE LIMITS REPORT

0 °F		20 °F		40 °F		60 °F		100 °F	
T	P	T	P	T	P	T	P	T	P
75	499	75	461	75	423	75	384	75	303
80	503	80	465	80	426	80	387	80	306
85	506	85	469	85	430	85	391	85	310
90	510	90	472	90	434	90	395	90	315
95	514	95	477	95	438	95	400	95	319
100	519	100	481	100	443	100	404	100	325
105	523	105	486	105	448	105	410	105	330
110	529	110	492	110	454	110	415	110	336
110	496	110	459	110	421	110	382	110	303
115	501	115	464	115	427	115	389	115	310
120	507	120	470	120	433	120	395	120	317
125	514	125	477	125	440	125	402	125	325
130	521	130	484	130	448	130	410	130	334
135	528	135	492	135	456	135	419	135	343
140	536	140	500	140	464	140	428	140	353
145	545	145	509	145	474	145	438	145	364
150	554	150	519	150	484	150	448	150	376
155	561	155	529	155	495	155	460	155	389
160	561	160	541	160	507	160	472	160	403
165	561	165	553	165	519	165	486	165	418
170	561	170	561	170	533	170	500	170	434
175	561	175	561	175	548	175	516	175	452
180	561	180	561	180	561	180	533	180	471
180	626	180	595	180	564	185	551	185	491
185	641	185	611	185	581	190	570	190	513
190	658	190	628	190	599	195	591	195	537
195	675	195	647	195	619	200	614	200	563
200	694	200	667	200	640	205	638	205	591
205	715	205	689	205	663	210	665	210	621
210	737	210	712	210	688	215	693	215	653
215	760	215	737	215	715	220	723	220	688
220	786	220	764	220	743	225	756	225	725
225	813	225	793	225	774	230	792	230	766
230	842	230	824	230	807	235	830	235	809
235	874	235	858	235	843	240	871	240	856
240	908	240	894	240	881	245	915	245	907
245	944	245	932	245	923	250	962	250	961
250	983	250	974	250	967	255	1013	255	1019
255	1025	255	1019	255	1015	260	1068		
260	1070	260	1067	260	1066				
265	1119	265	1118						
270	1171								
275	1226								
280	1286								
285	1351								
290	1420								
295	1494								
300	1573								
305	1658								
310	1749								
315	1846								
320	1951								
325	2062								
330	2182								
335	2309								

Table 2-2

Farley Unit 2 - 33.8 EFPY Cooldown Curve Data Points (adjusted to include 60 psi ΔP at RCS temperatures ≥ 110°F and 27 psi ΔP at RCS temperatures < 110°F)^[1]

PRESSURE TEMPERATURE LIMITS REPORT

3.0 Reactor Vessel Material Surveillance Program

The reactor vessel material surveillance program is in compliance with 10 CFR 50, Appendix H, and is described in Section 5.4.3.6 of the Farley FSAR. The removal schedule is provided in Table 3-1. Consistent with specific requirements for Farley Unit 2 associated with the granting of an exemption to Appendix H of 10 CFR 50 documented in NUREG-0117^[4], Figures 2-1 and 2-2 are based on the greater, or limiting value, of the following: (1) the actual shift in reference temperature for plate B7212-1 as determined by impact testing, or (2) the predicted shift in reference temperature for weld seam 11-923 as determined by Regulatory Guide 1.99, Revision 2. Results from the reactor vessel surveillance program will be used to update Figures 2-1 and 2-2 if the results indicate that the adjusted reference temperature (ART) for the limiting beltline material exceeds the ART used to generate the P/T limits shown in Figures 2-1 and 2-2 for the specified fluence period.

Table 3-1

SURVEILLANCE CAPSULE WITHDRAWAL SCHEDULE ^(a)

Capsule	Capsule Location (Degree)	Lead Factor	Removal EFPY ^(b)	Fluence (n/cm ²)
U ^(c)	343	3.11	1.10	6.39 x 10 ¹⁸
W ^(c)	110	2.69	3.97	1.85 x 10 ¹⁹
X ^(c)	287	3.21	6.41	3.18 x 10 ¹⁹
Z	340	2.77	12.2	4.39 x 10 ¹⁹
V	107	3.21	17.2	6.52 x 10 ¹⁹
Y	290	2.77	Standby	--

NOTES:

- (a) WCAP-14689, Revision 4 ^[1]
- (b) Effective Full Power Years (EFPY) from plant startup
- (c) Plant-specific evaluation

PRESSURE TEMPERATURE LIMITS REPORT

4.0 Reactor Vessel Surveillance Data Credibility

Regulatory Guide 1.99, Revision 2, describes general procedures acceptable to the NRC staff for calculating the effects of neutron radiation embrittlement of the low-alloy steels currently used for light-water-cooled reactor vessels. Position C.2 of Regulatory Guide 1.99, Revision 2, describes the methodology for calculating the adjusted reference temperature and Charpy upper-shelf energy of reactor vessel beltline materials using surveillance capsule data. The methods of Position C.2 can only be applied when two or more credible surveillance data sets become available from the reactor in question.

To date, there have been three capsules removed from the Farley Unit 2 vessel. In accordance with the discussion of Regulatory Guide 1.99, Revision 2, there are five requirements that must be met for the surveillance data to be judged credible.

The purpose of this evaluation is to apply the credibility requirements of Regulatory Guide 1.99, Revision 2, to the Farley Unit 2 reactor vessel surveillance data and determine if the Farley Unit 2 surveillance data is credible.

Criterion 1: Materials in the capsules should be those judged most likely to be controlling with regard to radiation embrittlement.

The beltline region of the reactor vessel is defined in Appendix G to 10 CFR 50, Fracture Toughness Requirements, December 19, 1995, to be:

the reactor vessel (shell material including welds, heat affected zones, and plates or forgings) that directly surrounds the effective height of the active core and adjacent regions of the reactor vessel that are predicted to experience sufficient neutron radiation damage to be considered in the selection of the most limiting material with regard to radiation damage.

The Farley Unit 2 reactor vessel consists of the following beltline region materials:

- Intermediate shell plates B7203-1 and B7212-1;
- Lower shell plates B7210-1 and B7210-2;
- Intermediate shell longitudinal weld seams 19-923 A, heat number HODA;
- Intermediate shell longitudinal weld seams 19-923 B, heat number BOLA;
- Lower shell longitudinal weld seams 20-923 A & B, heat number 83640, Linde 0091 flux, flux lot 3490; and
- Circumferential weld 11-923, heat number 5P5622, Linde 0091 flux, flux lot 1122.

PRESSURE TEMPERATURE LIMITS REPORT

Per WCAP-8956^[5], the Farley Unit 2 surveillance program was based on ASTM E185-73, Standard Recommended Practice for Surveillance Tests for Nuclear Reactor Vessels. Per Section 4.1 of ASTM E185-73, the base metal and weld metal to be included in the program should represent the material that may limit the operation of the reactor during its lifetime. The test material should be selected on the basis of initial transition temperature, upper shelf energy level, and estimated increase in transition temperature considering chemical composition (copper and phosphorus) and neutron fluence.

At the time the Farley Unit 2 surveillance capsule program was developed, intermediate shell plate B7212-1 was judged to be most limiting and was therefore, utilized in the surveillance program.

The surveillance program weld for Farley Unit 2 was fabricated using the shielded metal arc welding process and E8018 stick electrodes, in a manner similar to that used to fabricate intermediate shell longitudinal seams 19-923 A (heat HODA) and B (heat BOLA). These electrodes were not copper-coated and do not exhibit the chemical variability found in copper-coated submerged arc weld wire. Although the surveillance weld material does not represent the limiting reactor vessel beltline weld, the results of mechanical property tests performed on the surveillance weld are considered to be representative of the property changes expected in the reactor vessel beltline seams. The NRC explicitly approved the selection of the Farley Unit 2 surveillance weld material on the basis that the limiting beltline material (i.e., intermediate plate B7212-1) was included in the surveillance program and conservative methods of analysis contained in Regulatory Guide 1.99 were available to predict the radiation characteristics of the limiting beltline weld. The NRC incorporated an exemption to the requirements of Appendix H to 10 CFR Part 50 in the Farley Unit 2 Operating License, thereby approving the selected surveillance weld material based on the NRC evaluation provided in Section 5.2.1 of NUREG-0117.^[4]

Although the Farley Unit 2 surveillance weld material does not meet the requirements of Criterion 1, conservative methods of analysis are available to predict the radiation characteristics of the limiting beltline weld. The limiting beltline plate material is intermediate plate B7212-1 which is more limiting than any of the reactor vessel beltline welds and is included in the reactor vessel material surveillance program. Therefore, the Farley Unit 2 reactor vessel material surveillance program provides assurance that the radiation damage to the vessel can be adequately determined and the integrity of the Farley Unit 2 reactor vessel will be ensured during normal plant operations and anticipated operational occurrences. Therefore, the Farley Unit 2 reactor vessel surveillance program meets the intent of Criterion 1.

PRESSURE TEMPERATURE LIMITS REPORT

Criterion 2: Scatter in the plots of Charpy energy versus temperature for the irradiated and unirradiated conditions should be small enough to permit the determination of the 30 ft-lb temperature and upper shelf energy, unambiguously.

Plots of Charpy energy versus temperature for the unirradiated condition are presented in WCAP-8956 ^[5], Alabama Power Company Joseph M. Farley Nuclear Plant Unit No. 2 Reactor Vessel Radiation Surveillance Program, dated August 1977.

Plots of Charpy energy versus temperature for the irradiated conditions are presented in the reactor vessel surveillance capsule reports for Capsules U ^[6], W ^[7], and X ^[2].

Based on engineering judgment, the scatter in the data presented in these plots is small enough to determine the 30 ft-lb temperature and upper shelf energy of the Farley Unit 2 surveillance materials unambiguously. Therefore, the Farley Unit 2 surveillance program meets the requirements of Criterion 2.

Criterion 3: When there are two or more sets of surveillance data from one reactor, the scatter of ΔRT_{NDT} values about a best-fit line drawn as described in Regulatory Position 2.1 normally should be less than 28°F for welds and 17°F for base metal. Even if the fluence range is large (two or more orders of magnitude), the scatter should not exceed twice those values. Even if the data fail this criterion for use in shift calculations, they may be credible for determining decrease in upper shelf energy if the upper shelf can be clearly determined, following the definition given in ASTM E185-82.

The least squares method, as described in Regulatory Position 2.1 will be utilized in determining a best-fit line for this data to determine if this criterion is met.

[Continued on following page]

PRESSURE TEMPERATURE LIMITS REPORT

TABLE 4-1

SURVEILLANCE CAPSULE DATA CALCULATION OF BEST-FIT LINE AS DESCRIBED IN POSITION 2.1 OF REGULATORY GUIDE 1.99, REVISION 2^(a)

Material	Capsule	F ^(b)	FF ^(c) (x)	ΔRT_{NDT} (y)	FF x ΔRT_{NDT} (xy)	FF ² (x ²)	
Intermediate Shell Plate B7212-1 (Longitudinal)	U	0.639	0.874	103	90.0	0.764	
	W	1.85	1.17	165	193.1	1.37	
	X	3.18	1.30	180	234.0	1.69	
Intermediate Shell Plate B7212-1 (Transverse)	U	0.639	0.874	133	116.2	0.764	
	W	1.85	1.17	165	193.1	1.37	
	X	3.18	1.30	190	247.0	1.69	
					$\sum_{i=1}^n$	1073.4	7.65
	$CF = \Sigma(FF * \Delta RT_{NDT}) \div \Sigma(FF^2) = 140.3 \text{ }^\circ\text{F}$						
Weld Metal	U	0.639	0.874	10	8.74	0.764	
	W	1.85	1.17	10	11.7	1.37	
	X	3.18	1.30	10	13.0	1.69	
					$\sum_{i=1}^n$	33.4	3.82
	$CF = \Sigma(FF * \Delta RT_{NDT}) \div \Sigma(FF^2) = 8.7 \text{ }^\circ\text{F}$						

NOTES:

- (a) WCAP-14689, Revision 4^[1]
- (b) F = Fluence (10^{19} n/cm², E > 1.0 MeV)
- (c) FF = Fluence Factor = $F^{(0.28 - 0.1 \log F)}$

PRESSURE TEMPERATURE LIMITS REPORT

TABLE 4-2
SCATTER OF ΔT_{NDT} VALUES ABOUT A BEST-FIT LINE
FOR SURVEILLANCE PLATE MATERIAL ^(a)

Intermediate Shell Plate B7212-1 Orientation	FF	ΔT_{NDT} (30 ft-lb) (°F)	Best Fit ΔT_{NDT} (°F)	Scatter of ΔT_{NDT} (°F)
Longitudinal	0.874	103	122.6	19.6
	1.17	165	164.2	-0.8
	1.30	180	182.4	2.4
Transverse	0.874	133	122.6	-10.4
	1.17	165	164.2	-0.8
	1.30	190	182.4	-7.6

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

The scatter of ΔT_{NDT} values about a best-fit line drawn with the y-intercept equal to zero, as described in Regulatory Position 2.1, should be less than one σ (17°F) for base metal. From a statistical point of view, \pm one σ (17°F) should encompass approximately 68% of the data and one would expect at least one data point to be outside the \pm one σ limits. As shown above, the scatter is within 17°F of the best-fit line for all data points except one. The one point that is not within the scatter is 19.6°F below the best-fit line (i.e., the best-fit line over predicts this data point). Based on the above discussion and engineering judgment, the Farley Unit 2 surveillance program conservatively predicts the material properties changes for the beltline plate. Therefore, the intent of Criterion 3 is met for the Farley Unit 2 surveillance plate material.

TABLE 4-3
SCATTER OF ΔT_{NDT} VALUES ABOUT A BEST-FIT LINE
FOR SURVEILLANCE WELD MATERIAL ^(a)

Material	FF	ΔT_{NDT} (30 ft-lb) (°F)	Best Fit ΔT_{NDT} (°F)	Scatter of ΔT_{NDT} (°F)
Weld Metal	0.874	10	7.6	-2.4
	1.17	10	10.2	0.2
	1.30	10	11.3	1.3

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

PRESSURE TEMPERATURE LIMITS REPORT

The scatter of ΔRT_{NDT} values about a best-fit line drawn with the y-intercept equal to zero, as described in Regulatory Position 2.1, is less than 28°F as shown above. Therefore, Criterion 3 is met for the Farley Unit 2 surveillance weld material.

Criterion 4: The irradiation temperature of the Charpy specimens in the capsule should match the vessel wall temperature at the cladding/base metal interface within $\pm 25^\circ\text{F}$.

The Farley Unit 2 capsule specimens are located in the reactor between the neutron shielding pads and the vessel wall and are positioned opposite the center of the core. The test capsules are in guide tubes attached to the neutron shielding pads. The location of the specimens with respect to the reactor vessel beltline provides assurance that the reactor vessel wall and the specimens experience equivalent operating conditions and will not differ by more than 25°F. Therefore, the Farley reactor vessel surveillance program meets the requirements of Criterion 4.

Criterion 5: The surveillance data for the correlation monitor material in the capsule should fall within the scatter band of the data base for that material.

The Farley Unit 2 surveillance program does not include correlation monitor material. Therefore, this criterion is not applicable to Farley Unit 2.

CONCLUSION:

Based on the preceding responses to the criteria of Regulatory Guide 1.99, Revision 2, Section B, and the application of engineering judgment, the Farley Unit 2 surveillance data is credible.

5.0 Supplemental Data Tables

Table 5-1 contains a comparison of measured surveillance material 30 ft-lb transition temperature shifts and upper shelf energy decreases with Regulatory Guide 1.99, Revision 2, predictions.

Table 5-2 shows the calculation of the surveillance material chemistry factors using surveillance capsule data.

Table 5-3 provides the unirradiated Farley Unit 2 reactor vessel toughness data.

Table 5-4 provides a summary of the fluences used in the PTS evaluation.

Table 5-5 provides a summary of the adjusted reference temperatures (ARTs) of the Farley Unit 2 reactor vessel beltline materials at the 1/4-T and 3/4-T locations for 33.8 EFPY.

Table 5-6 shows the calculation of the ART at 33.8 EFPY for the limiting Farley Unit 2 reactor vessel material.

Table 5-7 provides RT_{PTS} values for Farley Unit 2 for 36 EFPY.

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-1

COMPARISON OF SURVEILLANCE MATERIAL 30 FT-LB TRANSITION TEMPERATURE SHIFT
AND UPPER SHELF ENERGY DECREASE WITH REGULATORY GUIDE 1.99, REVISION 2,
PREDICTIONS ^(a)

Material	Capsule	Fluence ($\times 10^{19}$ n/cm ² , E > 1.0 MeV)	30 ft-lb Transition Temperature Shift		Upper Shelf Energy Decrease	
			Predicted (°F)	Measured (°F)	Predicted (%)	Measured (%)
Plate B7212-1 (Longitudinal)	U	0.639	130.2	103	26	28
	W	1.85	174.2	165	34	22
	X	3.18	194.3	180	39	28
Plate B7212-1 (Transverse)	U	0.639	130.2	133	26	27
	W	1.85	174.2	165	34	20
	X	3.18	194.3	190	39	27
Weld Metal	U	0.639	33.4	10	17	8
	W	1.85	44.7	10	22	0
	X	3.18	49.8	10	25	0
HAZ Metal	U	0.639	--	58	--	30
	W	1.85	--	109	--	20
	X	3.18	--	110	--	20

NOTES:

(a) WCAP-14689, Revision 4^[1]

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-2
CALCULATION OF CHEMISTRY FACTORS USING
SURVEILLANCE CAPSULE DATA ^(a)

Material	Capsule	f ^(b)	FF ^(c)	ΔRT _{NDT}	FF * ΔRT _{NDT}	FF ²
Intermediate Shell Plate B7212-1 (Longitudinal)	U	0.639	0.874	103	90.0	0.764
	W	1.85	1.17	165	193.1	1.37
	X	3.18	1.30	180	234.0	1.69
Intermediate Shell Plate B7212-1 (Transverse)	U	0.639	0.874	133	116.2	0.764
	W	1.85	1.17	165	193.1	1.37
	X	3.18	1.30	190	247.0	1.69
	Sum:				1073.4	7.65
Chemistry Factor = $\Sigma (FF * \Delta RT_{NDT}) \div \Sigma (FF^2) = 140.3 \text{ } ^\circ\text{F}$						
Weld Metal ^(d)	U	0.639	0.874	9.6	8.4	0.764
	W	1.85	1.17	9.6	11.2	1.37
	X	3.18	1.30	9.6	12.5	1.69
	Sum:				32.1	3.82
	Chemistry Factor = $\Sigma (FF * \Delta RT_{NDT}) \div \Sigma (FF^2) = 8.4 \text{ } ^\circ\text{F}$					

NOTES:

- (a) WCAP-14689, Revision 4 ^[1]
- (b) f = fluence (x 10¹⁹ n/cm², E > 1.0 MeV)
- (c) FF = fluence factor = f^(0.28 - 0.1 log f)
- (d) ΔRT_{NDT} values were multiplied by a ratio of 0.96
(CF_{vessel} ÷ CF_{surv weld} = 36.8 ÷ 38.2 = 0.96)

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-3
 REACTOR VESSEL TOUGHNESS TABLE (UNIRRADIATED)^(a)

Beltline Material	Cu Weight %	Ni Weight %	IRT _{NDT} (°F)
Closure Head Flange	--	--	60
Vessel Flange	--	--	60
Inter. Shell Plate B7203-1	0.14	0.60	15
Inter. Shell Plate B7212-1	0.20	0.60	-10
Lower Shell Plate B7210-1	0.13	0.56	18
Lower Shell Plate B7210-2	0.14	0.57	10
Inter. Shell Longitudinal Weld Seam 19-923 A ^(b) (Heat # HODA)	0.027	0.947	-56
Inter. Shell Longitudinal Weld Seam 19-923 B ^(b) (Heat # BOLA)	0.027	0.913	-60
Surveillance Weld ^(c)	0.028	0.89	--
Circumferential Weld Seam 11-923 ^(b) (Heat # 5P5622)	0.153	0.077	-40
Lower Shell Longitudinal Weld Seams 20-923 A & B ^(b) (Heat # 83640)	0.051	0.096	-70

NOTES:

- (a) WCAP-14689, Revision 4^[1]
- (b) Best-estimate copper and nickel from CE NPSD-1039^[9]
- (c) The best-estimate copper and nickel value represents the average of two chemistry measurements performed on the surveillance weld and documented in WCAP-8956^[5] and WCAP-11438^[7]. The surveillance weld is representative of intermediate shell longitudinal weld 19-923B

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-4
REACTOR VESSEL FLUENCE PROJECTIONS FOR 36 EFPY ^(a,b)

EFPY	0°	15°	15° ^(c)	30°	30° ^(c)	45°
36	4.39	2.61	2.09	1.98	1.91	1.40

NOTES:

- (a) WCAP-14689, Revision 4 ⁽¹⁾
- (b) Fluence in 10^{19} n/cm² (E > 1.0 MeV)
- (c) Indicates location in octants with a 26° neutron pad span.

Table 5-5
SUMMARY OF ADJUSTED REFERENCE TEMPERATURES (ARTs) FOR REACTOR VESSEL BELTLINE MATERIALS AT THE 1/4-T AND 3/4-T LOCATIONS FOR 33.8 EFPY ^(a,b)

Material	1/4-T (°F)	3/4-T (°F)
Intermediate Shell Plate B7203-1	174	149 ^(c)
Intermediate Shell Plate B7212-1	211	173
Intermediate Shell Plate B7212-1 Using S/C Data	183 ^(c)	147
Lower Shell Plate B7210-1	165	142
Lower Shell Plate B7210-2	168	143
Intermediate Shell Longitudinal Weld Seam 19-923 A (Heat # HODA)	28 ^(d)	12 ^(d)
Intermediate Shell Longitudinal Weld Seam 19-923 B (Heat # BOLA)	10 ^(d)	-9 ^(d)
Intermediate Shell Longitudinal Weld Seam 19-923 B (Heat # BOLA) Using S/C Data	-44 ^(d)	-48 ^(d)
Circumferential Weld 11-923 (Heat # 5P5622)	109	90
Lower Shell Longitudinal Weld Seams 20-923 A & B (Heat # 83640)	0 ^(d)	-19 ^(d)

NOTES:

- (a) WCAP-14689, Revision 4 ⁽¹⁾
- (b) The ARTs presented here are based on the peak reactor vessel surface fluence of 4.127×10^{19} n/cm² (E > 1.0 MeV) unless otherwise noted.
- (c) Limiting 1/4-T and 3/4-T ART values. The P/T limit curves are those previously generated based on 1/4-T ART of 186°F and 3/4-T ART of 149°F which bounds the limiting 1/4-T and 3/4-T ARTs shown above.
- (d) ARTs calculated using the peak vessel fluence of 1.32×10^{19} n/cm² (E > 1.0 MeV) at 45°

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-6

CALCULATION OF ADJUSTED REFERENCE TEMPERATURE AT 33.8 EFPY FOR THE LIMITING REACTOR VESSEL MATERIAL ^(a)

Parameter	Intermediate Shell Plate B7212-1		Intermediate Shell Plate B7203-1	
	1/4-T	3/4-T	1/4-T	3/4-T
Operating Period	33.8 EFPY		33.8 EFPY	
Location	1/4-T	3/4-T	1/4-T	3/4-T
Chemistry Factor, CF (°F)	140.3	140.3	100.0	100.0
Fluence, f (10 ¹⁹ n/cm ²) ^(b)	2.573	1.00	2.573	1.00
Fluence Factor, FF	1.253	1.00	1.253	1.00
$\Delta RT_{NDT} = CF \times FF$ (°F)	175.8	140.3	125.3	100.0
Initial RT _{NDT} , I (°F)	-10	-10	15	15
Margin, M (°F) ^(c)	17	17	34	34
Adjusted Reference Temperature (ART), (°F) per Regulatory Guide 1.99, Revision 2	183	147	174	149

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

(b) Fluence is based on f_{surf} (10¹⁹ n/cm², E > 1.0 MeV) = 4.127 at 33.8 EFPY. The Farley Unit 2 reactor vessel wall thickness is 7.875 inches in the beltline region.

(c) Margin is calculated as $M = 2(\sigma_i^2 + \sigma_{\Delta}^2)^{0.5}$. The standard deviation for the initial RT_{NDT} margin term, σ_i , is 0°F since the initial RT_{NDT} is a measured value. The standard deviation for the ΔRT_{NDT} term, σ_{Δ} , is 17°F for the plate, except that σ_{Δ} need not exceed 0.5 times the mean value of ΔRT_{NDT} . In accordance with Regulatory Guide 1.99, Revision 2, Position 2.1, values of σ_{Δ} may be cut in half when based on credible surveillance data.

PRESSURE TEMPERATURE LIMITS REPORT

Table 5-7
PRESSURIZED THERMAL SHOCK (RT_{PTS}) VALUES FOR 36 EFPY ^(a)

Material	CF	Surface Fluence (10 ¹⁹ n/cm ² , E > 1.0 MeV)	FF	ΔRT_{NDT} (CF x FF) (°F)	I (°F)	M (°F)	RT _{PTS} (°F)
Intermediate Shell Plate B7203-1	100.0	4.39	1.38	138.0	15	34	187
Intermediate Shell Plate B7212-1	149.0	4.39	1.38	205.6	-10	34	230
Intermediate Shell Plate B7212-1 Using S/C Data	140.3	4.39	1.38	193.6	-10	17	201
Lower Shell Plate B7210-1	89.8	4.39	1.38	123.9	18	34	176
Lower Shell Plate B7210-2	98.7	4.39	1.38	136.2	10	34	180
Intermediate Shell Longitudinal Welds 19-923 A (Heat # HODA)	36.8	1.40	1.09	40.1	-56	52.6	37
Intermediate Shell Longitudinal Welds 19-923 B (Heat # BOLA)	36.8	1.40	1.09	40.1	-60	40.1	20
Intermediate Shell Longitudinal Welds 19-923 B (Heat # BOLA) Using S/C Data	8.4	1.40	1.09	9.2	-60	9.2	-42
Circumferential Weld 11-923 (Heat # 5P5622)	74.1	4.39	1.38	102.3	-40	56	118
Lower Shell Longitudinal Welds 20-923 A & B (Heat # 83640)	37.3	1.40	1.09	40.7	-70	40.7	11

NOTES:

(a) WCAP-14689, Revision 4 ^[1]

PRESSURE TEMPERATURE LIMITS REPORT

6.0 References

1. WCAP-14689, Revision 4, Farley Units 1 and 2 Heatup and Cooldown Limit Curves for Normal Operation and PTLR Support Documentation, E. Terek, April 1998.
2. WCAP-12471, Analysis of Capsule X from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program, E. Terek, et al., December 1989.
3. WCAP-14687, Joseph M. Farley Units 1 and 2 Radiation Analysis and Neutron Dosimetry Evaluation, R. L. Bencini, June 1996.
4. NUREG-0117, Supplement 5 to the Safety Evaluation Report (NUREG-75/034), Office of Nuclear Reactor Regulation, U. S. Nuclear Regulatory Commission in the matter of Alabama Power Company Joseph M. Farley Nuclear Plant Unit 2, Docket No. 50-364., March 19, 1981.
5. WCAP-8956, Alabama Power Company Joseph M. Farley Nuclear Plant Unit No. 2 Reactor Vessel Radiation Surveillance Program, J. A. Davidson, et al., August 1977.
6. WCAP-10425, Analysis of Capsule U from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program, S. E. Yanichko, et al., October 1983.
7. WCAP-11438, Analysis of Capsule W from the Alabama Power Company Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program, S. E. Yanichko, et al., April 1987.
8. WCAP-14040-NP-A, Revision 2, Methodology Used to Develop Cold Overpressure Mitigating System Setpoints and RCS Heatup and Cooldown Limit Curves, January 1996.
9. CE NPSD-1039, Revision 2, Best Estimate Copper and Nickel Values in CE Fabricated Reactor Vessel Welds, Combustion Engineering Owners Group, June 1997.

ATTACHMENT 3

WCAP-15171, Rev. 1

**“Analysis of Capsule Z from the Alabama Power Company
Joseph M. Farley Unit 2 Reactor Vessel Radiation Surveillance Program”**