

March 15, 2000

Template = NRR-106

MEMORANDUM TO: File

FROM: Thomas W. Alexion, Project Manager, Section 1 /RA/
Project Directorate IV & Decommissioning
Division of Licensing Project Management

SUBJECT: ARKANSAS NUCLEAR ONE, UNIT 2 RE: PROPOSED LICENSE
AMENDMENT ON CONTAINMENT UPRATE (TAC NO. MA7044)

The U. S. Nuclear Regulatory Commission (NRC) staff has had discussions with Entergy Operations, Inc., the licensee, on its November 3, 1999, application for a "Proposed Technical Specification Change Request Supporting Containment Building Design Pressure Increase to 59 Psig [pounds per square inch gauge]." The proposed amendment addresses the containment post-accident response resulting from the new replacement steam generators that will be installed for operation beginning with Cycle 15.

In order to facilitate future discussions between the licensee and the NRC staff, the licensee provided the information in the attachment. The purpose of this memorandum is to place the attachment in the Public Document Room.

Docket No. 50-368

Attachment: As stated

DISTRIBUTION:

File Center
PUBLIC
PDIV-1 RF

To receive a copy of this document, indicate "C" in the box			
OFFICE	PDIV-1/PM	<input checked="" type="checkbox"/>	PDIV-D/LA
NAME	TAlexion <i>td</i>		DJohnson <i>dj</i>
DATE	03/14/00		3/14/00

DOCUMENT NAME: G:\PDIV-1\ANO2\MEMA7044.WPD
OFFICIAL RECORD COPY

DF01

FORM TITLE:

GENERAL DESCRIPTION OF DESIGN


FORM NO.

REV.

NC-2

5/18/98

Sketch Two
MSIS and CSAS Isolation of MFW and MS
(contacts shown for power operation)

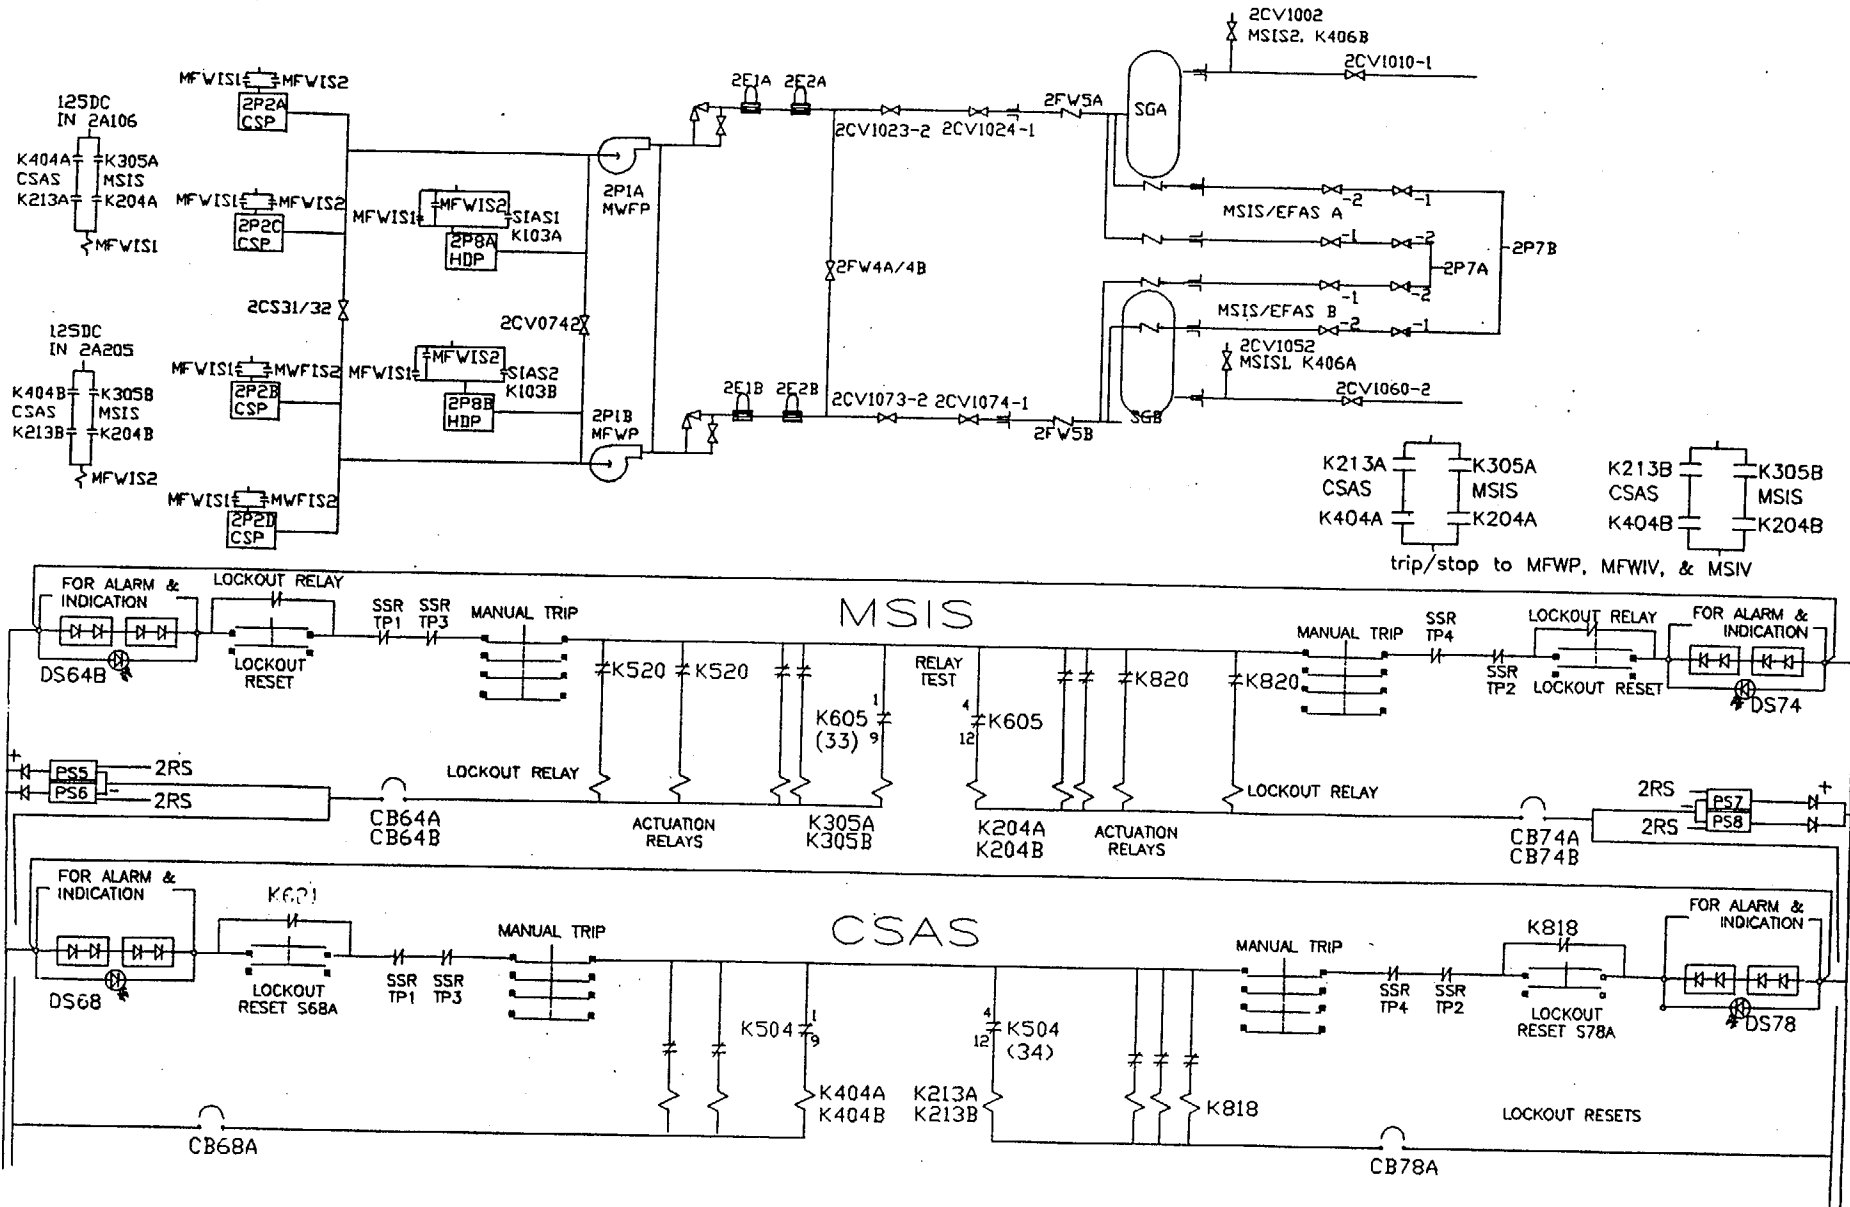

ATTACHMENT