


PID-1-AS-D20569

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID - LEGEND 1 AND P&ID - LEGEND 2

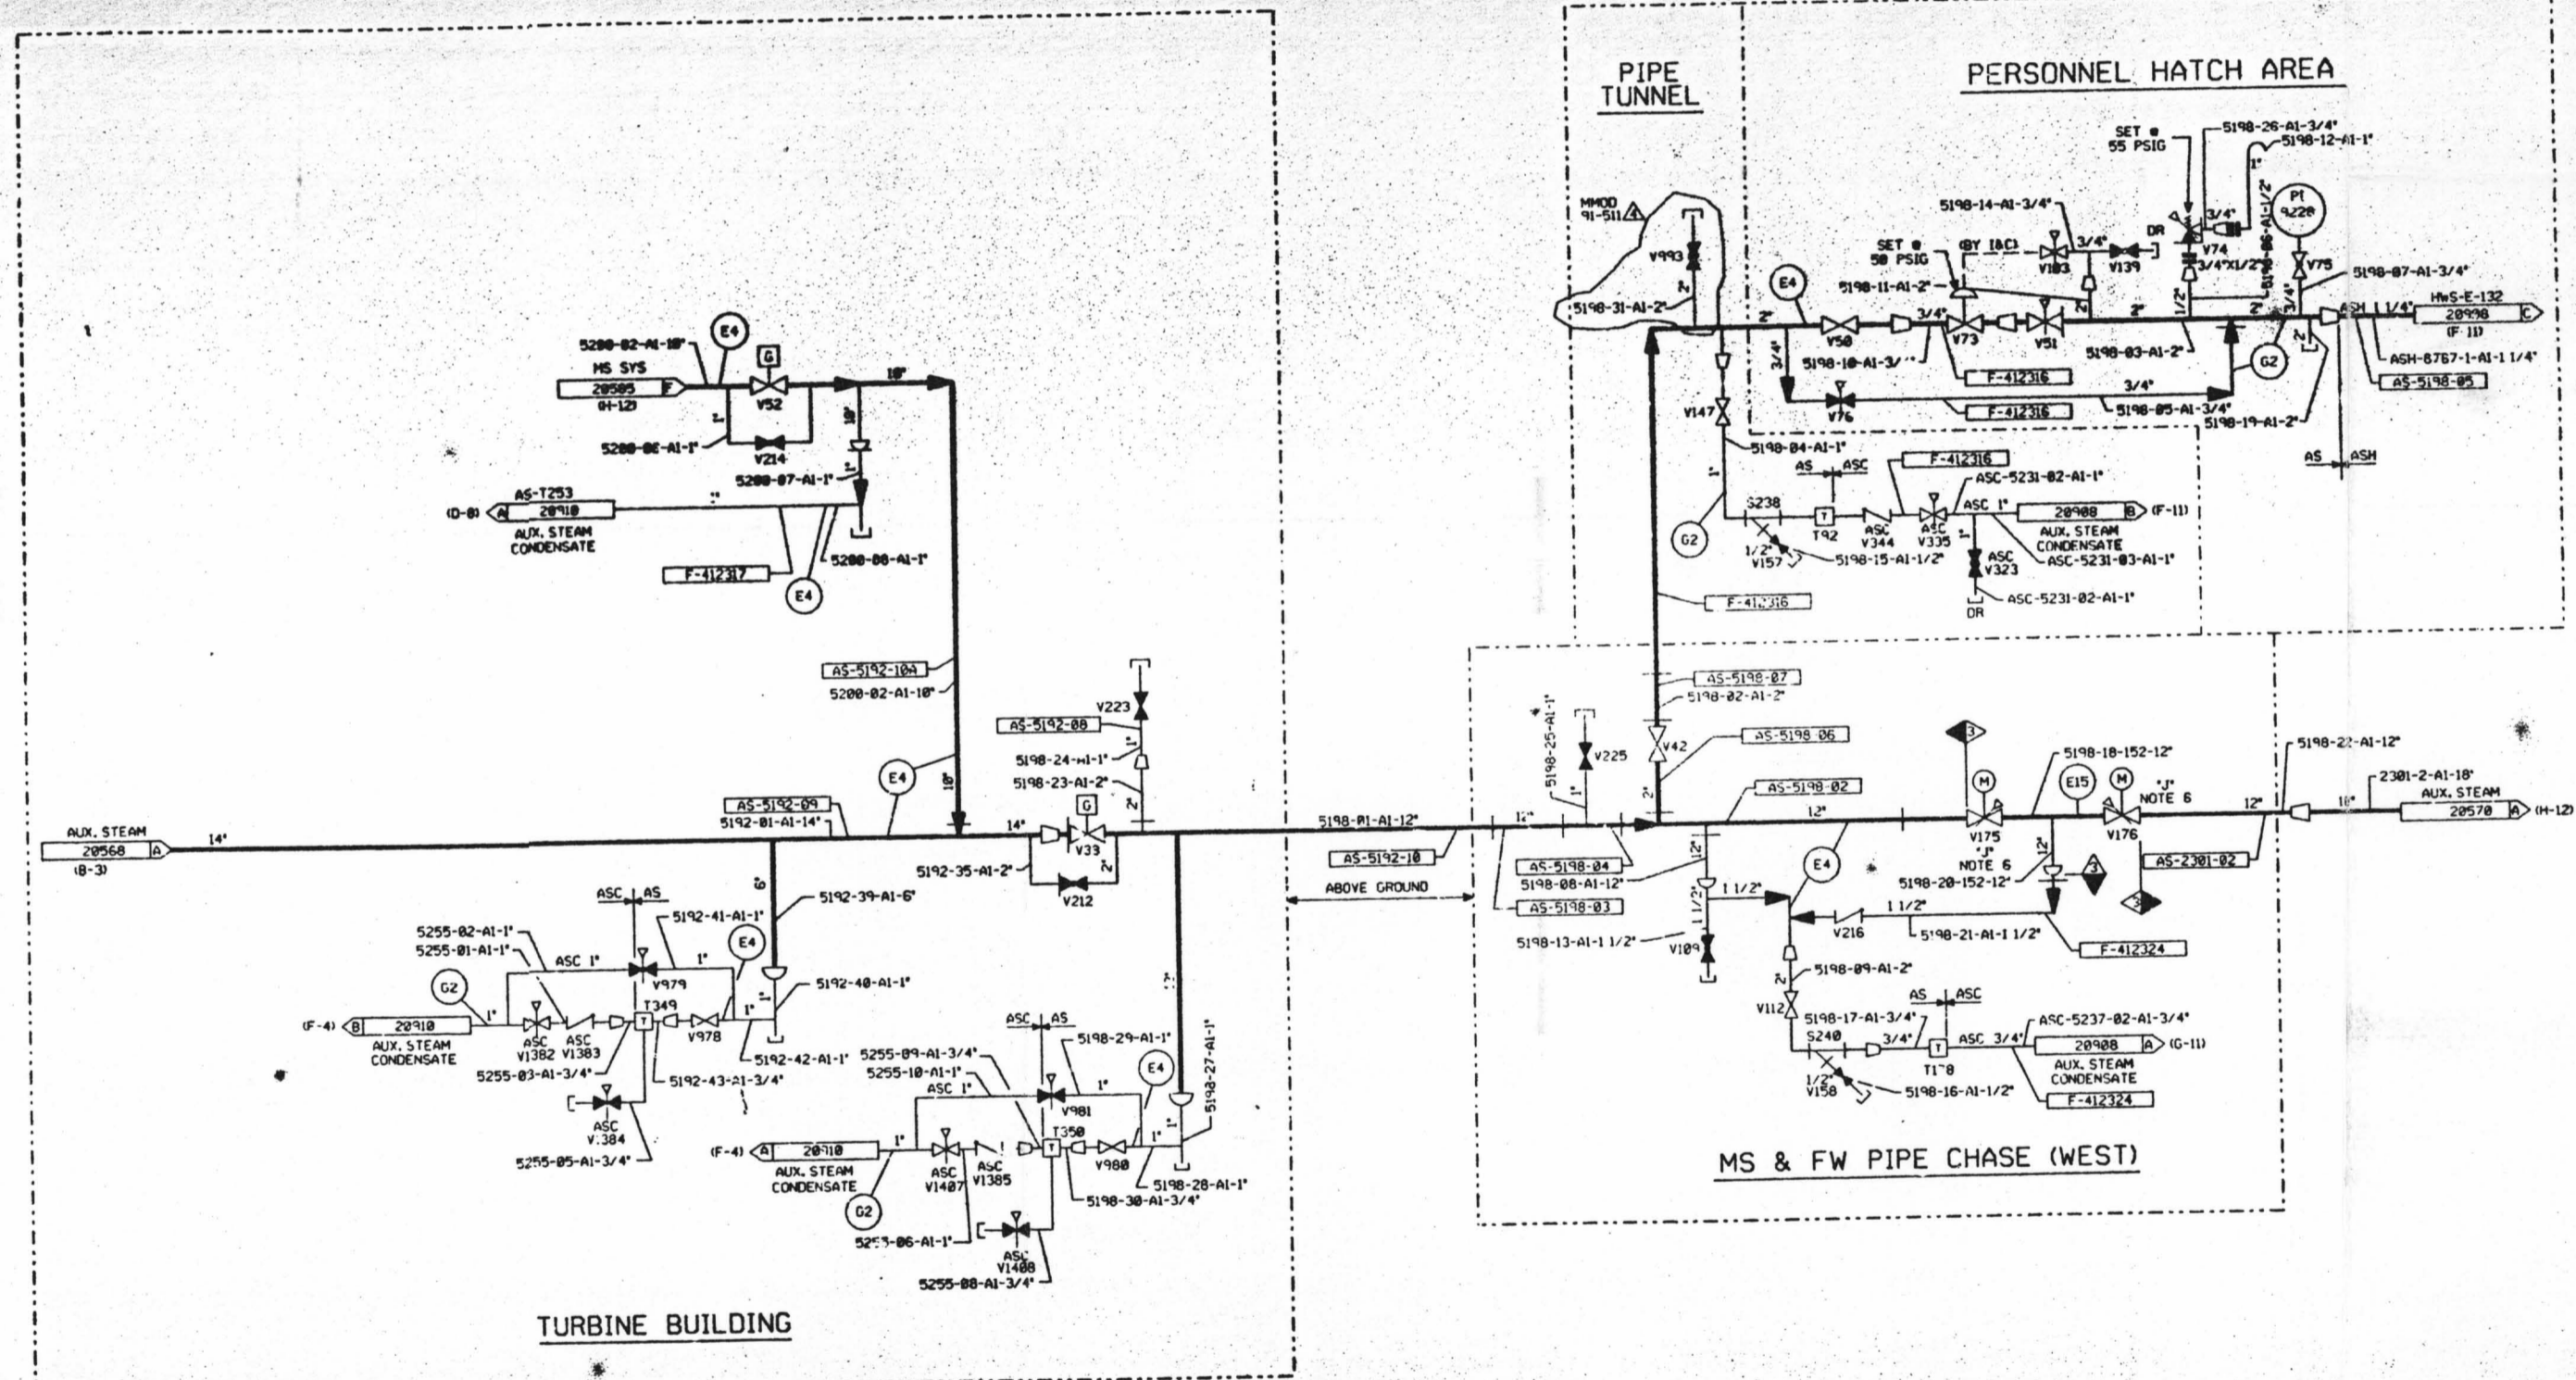

LEGEND				
	DESIGN PRESSURE	TEST PRESSURE	MIN. TEST TEMP.	TEST MEDIA
Y				TEST BOUNDARY
E15	188 PSIG	1.5/238 PSIG	35	DM WATER
E4	158 PSIG	225/245 PSIG	35	DM WATER
G2	58 PSIG	75/95 PSIG	38	DM WATER

NOTE: A. VENTS & DRAINS WITH CAPS/BLIND FLANGES ETC. ASME CL. 28.3, NMS SHALL BE TESTED TO THE LAST ISOLATION VALVE.

- NOTES:
- ALL LINES, EQUIPMENT, COMPONENTS AND INSTRUMENTS HAVE SYSTEM PREFIX 'AS' UNLESS NOTED OTHERWISE.
 - WORK THIS DRAWING WITH DRAWINGS 20564 THRU 20568 AND 20578 THRU 20576.
 - FOR CONDENSATE TRAP DESCRIPTION & DETAILS SEE DWG. 1-AS-20576.
 - ALL LINES, EQUIPMENT, COMPONENTS AND INSTRUMENTS ARE SAFETY CLASS NMS UNLESS NOTED OTHERWISE.
 - CLEANLINESS CLASS 'C'.
 - THE IDENTIFICATION 'J' NEAR A VALVE DENOTES THAT VALVE IS DESIGNATED FOR INSERVICE TESTING.
 - INDICATES REVISION LEVEL.
 - SYSTEM DESCRIPTION NUMBER SD-3

PORTIONS OF THIS DRAWING ARE
NUCLEAR SAFETY RELATED

REV	DATE	BY	CHKD	APP	DESCRIPTION
4	3/15/92	HRB	FCB	JM	INCOMP. DCR 08-183
3	4/23/91	HRB	FCB	JM	INCOMP. DCR 08-183
2	5/26/91	CPM	FCB	HRB	INCOMP. DCR 08-183
1	12/1/88	MPV	DVS	HRB	ISSUED FOR OPERATIONS

REV	DATE	BY	CHKD	APP	DESCRIPTION
4	3/15/92	HRB	FCB	JM	INCOMP. DCR 08-183
3	4/23/91	HRB	FCB	JM	INCOMP. DCR 08-183
2	5/26/91	CPM	FCB	HRB	INCOMP. DCR 08-183
1	12/1/88	MPV	DVS	HRB	ISSUED FOR OPERATIONS

PSNH PUBLIC SERVICE OF NEW HAMPSHIRE

AUXILIARY STEAM DETAIL

SEABROOK STATION PID-1-AS-D20569

22"
7"
58"
8.5"
11"
17"

12 11 10 9 8 7 6 5 4 3 2 1

H
G
F
E
D
C
B
A

05/84/92 12 11 10 9 8 7 6 5 4 3 2 1