FOR INFORMATION ONLY

NMY PID:20459.DGN#01

PID- 1-DG-D20459

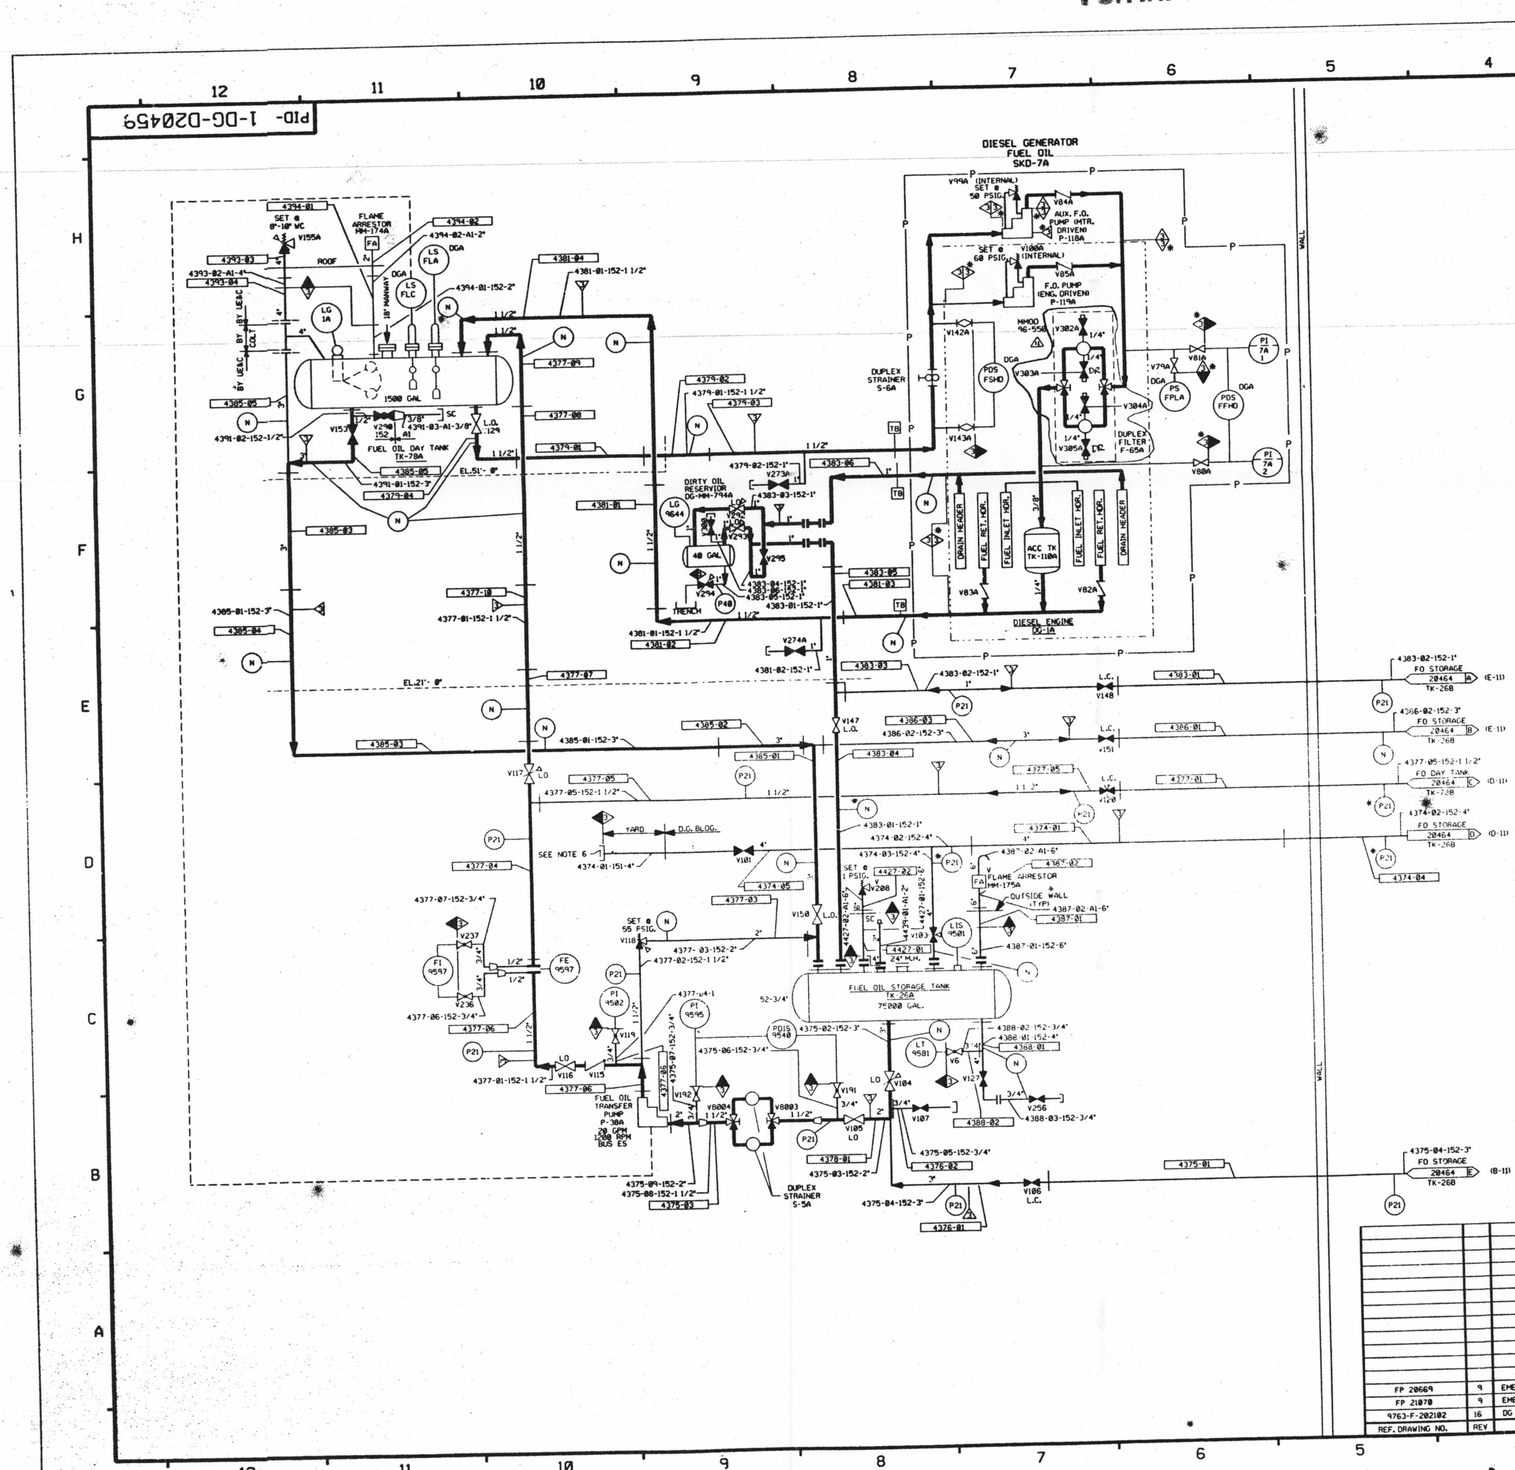

FOR P&ID REFERENCE DRAWINGS, SYMBOLS AND ABBREVIATIONS REFER TO DRAWINGS P&ID - LEGEND 1 AND P&ID - LEGEND 2

LEGEND

		DESIGN PRESSURE	TEST PRESSURE	MIN. TEST TEMP. F	TEST MEDIUM
	TEST BOUNDARY				
TB	TEMPORARY TEST BOUNDARY				
P21	INTEGRITY TEST	60 PSIG	75/79.5 PSIG	35	AIR/N_2
P21 *	INTEGRITY TEST	60 PSIG	66 PSIG (NOTE B)	35	AIR/N_2
P48	INTEGRITY TEST	0 PSIG	50 PSIG	35	AIR/N_2
N	NO TEST REQUIRED				

NOTE: A) VENTS AND DRAINS (ASME CL.2&3, NNS) WITH CAPS/BLIND FLANGES ETC. SHALL BE TESTED TO THE LAST ISOLATION VALVE.

B) TEST PRESSURE PER ASME SEC.XI

PORTIONS OF THIS DRAWING ARE

NUCLEAR SAFETY RELATED

NOTES:

1. WORK THIS DRAWING WITH DRAWINGS 20456, 20457, 20458, 20460, 20461, 20462 & 20464.
2. ALL LINES, EQUIPMENT, COMPONENTS AND INSTRUMENTATION HAVE SYSTEM PREFIX DG UNLESS NOTED OTHERWISE.
3. DELETED.
4. DELETED.
5. CLEANLINESS CLASS 'C'.
6. NPT QUICK DISCONNECT FITTING PROVIDED BY OWNER FOR DIESEL FUEL CONNECTION.
7. DELETED
8. SD NO IS SD-10
9. △ INDICATES REVISION LEVEL.
10. VENTS, DRAINS AND TEST CONN., SAFETY CLASS AND CODE BREAKS ARE AT THE DOWN STREAM END OF THE OUTER ISOLATION VALVE PER 1-NHY-8051!! UNLESS NOTED OTHERWISE.

REV	DATE	DSGN	DRWN	CHKD	CDE	SES	DESCRIPTION
11	10/30/96	MPW	---	---	DWS	VWS	INCORP. MMOD 96-550 CAB
10	11/1/95	BCL	---	MPW	MRB	RSG	INCORP. DCR 94-12 CA0, 01, MMOD 95-583 CA-0
9	5/27/94	MPW	---	JCM	BCL	GRM	INCORP. MMOD 92-546 CA0
8	7/23/92	MRB	---	BCL	DWS	DJM	INCORP. DCR 90-813 CA5
7	5/26/92	MRB	---	BCL	MPW	DJM	PARTIAL INCORP. DCR 90-813 CA8
6	4/28/92	MRB	---	BCL	DWS	RRB	INCORP. MMOD 91-515 CA0
5	08/24/91	MRB	FCB	JM	GFM	RRC	INCORP. DCR 90-49 CA0 ADDED SYSTEM & TRAIN DESIGNATION PER 1-NHY-586397 & 586399
4	05/25/90	MRB	MRB	APL	WCL	RRC	INCORP DRR 90-68 REV 0
3	9/14/89	MRB	FCB	APL	BCL	MAC	INCORP. DCR 89-33 CA 03 ADDED LEGEND NOTE A PER 9763-F-900000 & ANSI B31.1 1977 SEC 137.1.2(B) DELETED CODE BREAKS PER NOTE NO. 7 TEST BOUND. PER LEGEND NOTE A.
2	1/7/87	MRJ	OPO	WRO	MPW	RRC	CORRECTED TAG NO. OF TK-26 REVISED DUPLEX STRAINER ARRGT. PER NCR 82/10868, REVISED CODE FLAG PER SSP-86-076, CORRECTED DRAFTING ERROR ADDED REF. DWGS.
1	10/3/86	MAP	OPO	JDM	VNK	RRC	ADDED CONT. COORDINATES, REVISED PSP 'PIPING ERECTION ISO'S ADDED CODE BREAKS REV. LG-1A IN ERROR DELETED 'B' DESIGNATION IN NOTE 1 ADDED NOTE B & METD DWG TO REF INCORP. NCR 73/35A
0	6/25/86	WAL	WAL	VNK	JMS	RRC	ISSUED FOR OPERATIONS

REF. DRAWING NO.	REV	TITLE
FP 20669	9	EMERG. DIESEL GEN. JACKET WTR. EXP. TANK
FP 21070	9	EMERG. DIESEL GEN. FUEL OIL DAY TANK
9763-F-202102	16	DG FUEL & LUBE OIL P&I DIAGRAM

North Atlantic Energy Service Corporation

SEABROOK STATION

DIESEL GENERATOR FUEL OIL SYSTEM TRAIN "A" DETAIL

PID- 1-DG-D20459

10/30/96

D-22