

Facility: Browns Ferry NPP Scenario No.: A Op-Test No.: ILT 1102

FINAL

| | | | |
|------------|--|------------|-------------|
| Examiners: | | Operators: | SRO: |
| | | | ATC: |
| | | | BOP: |

Initial Conditions: IC190 / Unit 3 Reactor Power 83% / RHRSW Pump B2 is tagged out of service / APRM 3 is bypassed for Surveillance Testing

Turnover: Alternate Bus Duct Cooling Fans per 3-OI-47 Section 6.11.1[2]. Raise Reactor Power to 90% with Reactor Recirculation.

| Event No. | Malf. No. | Event Type* | Event Description |
|-----------|--------------|-----------------|---|
| 1 | | N-BOP N-SRO | Bus Duct Cooling Fan rotation 3-OI-47 Section 6.11.1[2] |
| 2 | | R-ATC R-SRO | Raise Reactor Power with Recirc |
| 3 | rd01a | C-ATC C-SRO | CRD Pump 3A Trip |
| 4 | og05a | I-BOP TS-SRO | HWC Malfunction |
| 5 | th12a | C-ATC C-SRO | Recirc Pump 3A High Vibration |
| 6 | hp01 | C-BOP TS-SRO | HPCI Inadvertent Initiation |
| 7 | hp08 hp09 | M-ALL | HPCI Steam Leak Fail to isolate / Loss of 480 V RMOV Bd 3A/ ED on Temps |
| 8 | ad03b | C | 1 ADS Valve fails to operate |
| 9 | fw12 | C | Startup Level Control Valve Failure |

* (N)ormal, (R)eactivity, (I)nstrument, (C)omponent, (M)ajor

Critical Tasks - Two

CT#1-With reactor at power and with a primary system discharging into the secondary containment, manually scram the reactor before any area exceeds the maximum safe operating level.

1. Safety Significance:

Scram reduces to decay heat energy that the RPV may be discharging into the secondary containment.

2. Cues:

Procedural compliance.

Secondary containment area temperature, level, and radiation indication.

Field reports.

3. Measured by:

Observation - With a primary system discharging into secondary containment, a reactor scram is initiated before a maximum safe condition is reached.

OR

Observation - With a primary system discharging into secondary containment, US transitions to EOP-1 and RO initiates scram upon report that a maximum safe condition has been reached.

4. Feedback:

Control rod positions.

Reactor power decrease.

CT#2-With a primary system discharging into the secondary containment, when two or more areas are greater than their maximum safe operating values for the same parameter, RO initiates Emergency Depressurization as directed by US.

1. Safety Significance:

Places the primary system in the lowest possible energy state, rejects heat to the suppression pool in preference to outside the containment. and reduces driving head and flow of system discharging into the secondary containment.

2. Cues:

Procedural compliance.

Secondary containment area temperatures, level, and radiation indication.

Field reports.

3. Measured by:

Observation - US transitions to C-2 and RO opens at least 6 SRV's when two or more areas are greater than their maximum safe operating values for the same parameter.

4. Feedback:

RPV pressure trend.

SRV status indications.

Scenario Summary:

With the unit at 83% power, the BOP operator will rotate Bus Duct Cooling Fans IAW 3-OI-47 section 6.11.1[2]. Upon completion the ATC will commence power increase with flow.

When the NRC is satisfied with the reactivity manipulation, CRD Pump 3A will trip. ATC will perform 3-AOI-85-3 actions to start the Standby CRD Pump.

Once the Standby CRD Pump is started and CRD parameters are restored, the Hydrogen Water Injection system will malfunction resulting in high hydrogen concentration in Off Gas. The crew will respond IAW with ARPs and 3-AOI-66-1 and shutdown the Hydrogen Water Chemistry System. The SRO will address TRM 3.7.2 and Enter Condition A.

After shutdown of the HWC System, high vibration alarms on Reactor Recirculation Pump 3A will have the crew respond IAW the ARPs. The ARPs will direct the operators to adjust RR Pump 3A speed in an attempt to lower vibrations on RR Pump 3A. Once speed is adjusted, high vibration alarm will clear and vibrations will lower.

After the RR Pump 3A vibrations is addressed, HPCI will inadvertently initiate. The crew will verify the initiation is inadvertent and trip and lockout HPCI. The SRO will address Technical Specification 3.5.1 and Enter Condition C.

Shortly after the HPCI initiation a steam leak will develop in the HPCI Room, HPCI will fail to automatically and manually isolate. When attempting to manually isolate HPCI steam valve 73-2 the 3A RMOV Board will be lost due to an electrical fault.

The crew will enter EOI-3 and scram the Reactor. All rods will insert on the scram and level and pressure will be controlled IAW EOI-1. The crew should lower reactor pressure. As the second MAX safe temperature is approached, the crew should anticipate Emergency Depressurization and when the second MAX safe temperature is reached the crew will Emergency Depressurize.

During ED one ADS valve will fail and the operator will open an additional SRV. After ED, the startup level controller will fail. The crew will control level with Core Spray Loop 2 and place RHR Loop 2 in Suppression Pool Cooling.

The Emergency classification is 3.1-S

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization complete.

Reactor Level is restored and maintained.

SCENARIO REVIEW CHECKLIST

SCENARIO NUMBER: 3-A

- 7 Total Malfunctions Inserted: List (4-8)
- 3 Malfunctions that occur after EOI entry: List (1-4)
- 4 Abnormal Events: List (1-3)
- 1 Major Transients: List (1-2)
- 4 EOI's used: List (1-3)
- 1 EOI Contingencies used: List (0-3)
- 60 Validation Time (minutes)
- 2 Crew Critical Tasks: (2-5)

YES Technical Specifications Exercised (Yes/No) Scenario Tasks

| <u>EVENT</u> | <u>TASK NUMBER</u> | <u>K/A</u> | <u>RO</u> | <u>SRO</u> |
|--------------|--|--------------|-----------|------------|
| 1. | Rotate Bus Duct Cooling Fans | | | |
| | RO U-047-NO-27 | 400000A4.01 | 3.1 | 3.0 |
| 2 | Raise Power with Recirc Flow | | | |
| | RO U-068-NO-17 | | | |
| | SRO S-000-NO-138 | 2.1.23 | 4.3 | 4.4 |
| 3 | CRD Pump Trip | | | |
| | RO U-085-AL-07 | 201001A2.01 | 3.2 | 3.3 |
| | SRO S-085-AB-03 | | | |
| 4 | Hydrogen Water Chemistry Malfunction | | | |
| | RO U-066-AL-10 | 271000A1.13 | 3.2 | 3.7 |
| | SRO S-066-AB-01 | | | |
| 5 | Reactor Recirculation Pump High Vibrations | | | |
| | RO U-068-AL-11 | 202001A4.05 | 3.3 | 3.3 |
| 6 | HPCI Inadvertent Start | | | |
| | RO U-073-NO-05 | 206000A2.17 | 3.9 | 4.3 |
| 7 | HPCI Steam Leak | | | |
| | RO U-073-AL-06 | 295032EA2.03 | 3.8 | 4.0 |
| | SRO S-000-AB-03 | | | |
| | SRO S-000-EM-12 | | | |
| | SRO T-000-EM-15 | | | |

Procedures Used/Referenced:

| Procedure Number | Procedure Title | Procedure Revision |
|--------------------|--|--------------------|
| 3-OI-47 | Turbine-Generator System | Revision 91 |
| 3-GOI-100-12 | Power Maneuvering | Revision 35 |
| 3-OI-68 | Reactor Recirculation System | Revision 80 |
| 3-AOI-85-3 | CRD System Failure | Revision 10 |
| 3-ARP-9-53 | Alarm Response Procedure Panel 3-9-53 | Revision 24 |
| 3-AOI-66-1 | Off Gas Hydrogen High | Revision 6 |
| TRM 3.7.2 | Airborne Effluents | Revision 0 |
| 3-ARP-9-4A | Alarm Response Procedure Panel 3-9-4A | Revision 39 |
| TS 3.5.1 | ECCS – Operating | Amendment 244 |
| 3-OI-3 | Reactor Feedwater System | Revision 82 |
| 3-EOI-2 | Primary Containment Control Flowchart | Revision 7 |
| 3-EOI-APPENDIX-18 | Suppression Pool Water Inventory Removal and Makeup | Revision 2 |
| 3-ARP-9-3F | Alarm Response Procedure Panel 3-9-3F | Revision 28 |
| 3-EOI-3 | Secondary Containment Control Flowchart | Revision 9 |
| 3-EOI-APPENDIX-8F | Restoring Refuel Zone and Reactor Zone Ventilation Following Group 6 Isolation | Revision 2 |
| 3-EOI-1 | RPV Control Flowchart | Revision 8 |
| 3-EOI-3-C-2 | Emergency RPV Depressurization Flowchart | Revision 8 |
| 3-EOI-APPENDIX-5A | Injection Systems Lineup Condensate/Feedwater | Revision 5 |
| 3-EOI-APPENDIX-6A | Injection Subsystems Lineup Condensate | Revision 2 |
| 3-EOI-APPENDIX-6B | Injection Subsystems Lineup RHR System I LPCI Mode | Revision 3 |
| 3-EOI-APPENDIX-6C | Injection Subsystems Lineup RHR System II LPCI Mode | Revision 3 |
| 3-EOI-APPENDIX-6D | Injection Subsystems Lineup Core Spray System I | Revision 3 |
| 3-EOI-APPENDIX-6E | Injection Subsystems Lineup Core Spray System II | Revision 3 |
| EPIP-1 | Emergency Classification Procedure Event Classification Matrix | Revision 46 |
| EPIP-4 | Site Area Emergency | Revision 32 |
| 3-EOI-APPENDIX-19 | H2/O2 Analyzer Operation | Revision 0 |
| 3-EOI-APPENDIX-17A | RHR System Operation Suppression Pool Cooling | Revision 5 |
| 3-AOI-100-1 | Reactor Scram | Revision 53 |

Console Operator Instructions

A. Scenario File Summary

1. File: batch and trigger files for scenario 3-A

Batch nrc2011aR1

#rhrsw pump B2 clearance
ior ypobkrrhrswpb2 fail_tcoil
ior zlohs2319a[1] off

#aprm 3 bypassed for 3-sr-3.3.1.1.16

#crd a pump trip
imf rd01a (e1 0)

#hpci Initiation
imf hp01 (e5 0)

#recirc pump a vibration high
imf th12a (e10 0)

#hwc malfunction
imf og05a (e15 60) 99
ior xa5553a[10] (e15 0) alarm_on
trg 16 nrc20110440
trg 16 = mmf og05a 100 360 99

Trigger nrc20110440
zdihs0440a[1].eq.1

#HPCI Steam Leak/major (have to manually modify fp02 to close)
mrf fp02 (e20 0) close
imf hp09
imf hp08 (e20 0) 8 600 4
trg 21 nrc2011732
trg 21 = imf ed12a
ior ypovfcv733 (e20 0) fail_now
imf fw12
imf ad03b

#if crew anticipates ED, may have to raise severity

Trigger nrc2011732
zdihs732[1].eq.1

Console Operator Instructions

Scenario 3-A

| | | <u>DESCRIPTION/ACTION</u> |
|-----------------|------------|-----------------------------|
| Simulator Setup | manual | Reset to IC 190 |
| Simulator Setup | Load Batch | Bat nrc2011aR1 |
| Simulator Setup | manual | Place APRM 3 in Bypass |
| Simulator Setup | manual | Clearance out RHRSW Pump B2 |
| Simulator Setup | | Verify Batch file loaded |

RCP required (83% - 90% w/Recirc flow) – Provide marked up copy of 3-GOI-100-12 and RCP for Urgent Load Reduction.

Simulator Event Guide:

Event 1 Normal: Bus Duct Cooling Fan rotation, 3-OI-47, Section 6.11.1[2]

| | | |
|--|---------------|--|
| | SRO | Directs BOP to rotate Bus Duct Cooling Fans. |
| | BOP | Rotate Bus Duct Cooling Fans, IAW 3-OI-47, Section 6.11.1[2] |
| | | <p>[2] PERFORM the following to SWAP from Bus Duct Cooling Fan A to Fan B:</p> <p>[2.1] VERIFY U-3 GEN BUS DUCT HTX B INLET VANE DMPR, 3-DMP-262-0057, is fully OPEN.</p> <p>[2.2] DRAIN water from 3B bus duct fan housing as follows: [2.2.1] Simultaneously OPEN GEN MAIN BUS COOLING FAN B DRAIN VALVE, 3-DRV-262-0002, and OBSERVE GEN MAIN BUS COOLING FAN B DRAIN SIGHT GLASS, 3-LG-262-0002, for water.</p> <p>[2.2.2] WHEN GEN MAIN BUS COOLING FAN B DRAIN SIGHT GLASS, 3-LG-262-0002, no longer indicates water flow, THEN CLOSE GEN MAIN BUS COOLING FAN B DRAIN VALVE, 3-DRV-262-0002.</p> |
| | DRIVER | Pre start walk down complete Inlet Damper is Fully Open, Water has been drained from fan housing, B Fan is not rotating. |
| | BOP | <p>[2.3] On Panel 9-7, MOMENTARILY PLACE GEN BUS DUCT HX FAN A, 3-HS-262-0001A, in STOP.</p> <p>[2.4] On Panel 9-7, MOMENTARILY PLACE GEN BUS DUCT HX FAN B, 3-HS-262-0002A, in START.</p> |
| | | |
| | | |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Flow

| | | |
|--|--------|---|
| | SRO | Notifies ODS of power increase. |
| | | Directs Power increase using Recirc Flow, per 3-GOI-100-12. [21] WHEN desired to restore Reactor power to 100%, THEN PERFORM the following as directed by Unit Supervisor and recommended by the Reactor Engineer: <ul style="list-style-type: none"> • RAISE power using control rods or core flow changes. REFER TO 3-SR-3.3.5(A) and 3-OI-68. |
| | ATC | Raise Power w/Recirc, IAW 3-OI-68, Section 6.2 |
| | | [1] IF desired to control Recirc Pumps 3A and/or 3B speed with Recirc Individual Control, THEN PERFORM the following: <ul style="list-style-type: none"> • Raise Recirc Pump 3A using, RAISE SLOW (MEDIUM), 3-HS-96-15A(15B). AND/OR <ul style="list-style-type: none"> • Raise Recirc Pump 3B using, RAISE SLOW (MEDIUM), 3-HS-96-16A(16B). |
| | | [2] WHEN desired to control Recirc Pumps 3A and/or 3B speed with the RECIRC MASTER CONTROL, THEN ADJUST Recirc Pump speed 3A & 3B using the following push buttons as required: RAISE SLOW, 3-HS-96-31 RAISE MEDIUM, 3-HS-96-32 |
| | NRC | When satisfied with Reactivity Manipulation, CRD Pump Trip |
| | DRIVER | When directed by lead examiner, Trigger 1 CRD Pump Trip |
| | | |

Simulator Event Guide:

Event 3 Component: CRD Pump 3A Trip

| | | |
|--|---------------|---|
| | ATC | Reports Trip of CRD Pump 3A. |
| | SRO | Announces entry into 3-AOI-85-3, "CRD System Failure". |
| | | |
| | | <p>4.1 Immediate Actions</p> <p>[1] IF operating CRD PUMP has failed AND the standby CRD Pump is available, THEN PERFORM the following at Panel 3-9-5:</p> <p>[1.1] PLACE CRD SYSTEM FLOW CONTROL, 3-FIC-85-11, in MAN at minimum setting.</p> <p>[1.2] START associated standby CRD Pump using one of the following:</p> <ul style="list-style-type: none"> • CRD PUMP 3B, using 3-HS-85-2A <p>[1.3] ADJUST CRD SYSTEM FLOW CONTROL, 3-FIC-85-11, to establish the following conditions:</p> <ul style="list-style-type: none"> • CRD CLG WTR HDR DP, 3-PDI-85-18A, approximately 20 psid. • CRD SYSTEM FLOW CONTROL, 3-FIC-85-11, between 40 and 65 gpm. <p>[1.4] BALANCE CRD SYSTEM FLOW CONTROL, 3-FIC-85-11, and PLACE in AUTO or BALANCE.</p> |
| | | |
| | DRIVER | <p>If Dispatched to CRD Pump 3A, pump is extremely hot to touch.</p> <p>CRD Pump 3B - oil levels in band, pump ready for start, conditions normal after the start.</p> <p>CRD 3A - report breaker tripped on over current, Electrical Maint called.</p> |
| | | |
| | | |
| | NRC | When ready, HWC Malfunction. |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 15 for HWC Malfunction. |

Simulator Event Guide:

Event 4 Instrument: HWC Malfunction

| | | |
|--|--------|---|
| | BOP | Respond to Off Gas Panel Alarms 9-53-10, 3, and 13 |
| | | 53-10, H2 Water Chemistry Abnormal A. Checks H2 concentration on H2 analyzer on 3-9-53. B. Dispatches personnel. |
| | | 53-3 and 13, High Offgas % H2 Train A and B A. CHECK H2 concentration on OFF-GAS HYDROGEN ANALYZER, at 3-H2R-66-96 (CH2), on Panel 3-9-53 to verify H2 concentration.. B. IF alarm is valid, THEN REFER TO 3-AOI-66-1. |
| | SRO | Announces entry into 3-AOI-66-1, "Off Gas H2 High". |
| | DRIVER | When dispatched to Panel report, "H2 injection rates above (high) setpoint cannot adjust" |
| | BOP | 3-AOI-66-1, "Off Gas H2 High" [2] IF HWC System injection is in service, THEN PERFORM the following [2.1] At HYDROGEN WATER CHEMISTRY CONTROL PANEL, 3-LPNL-925-0589, VERIFY that H2 and O2 injection rates are normal at Operator Interface Unit (OIU). (H2 injection rate should match the setpoint on the OIU. The O2 injection rate should match the setpoint on the OIU, which should be half of the H2 injection rate during normal steady state conditions.) [2.2] IF H2 and O2 injection rates do NOT meet the above conditions, THEN NOTIFY the Unit Supervisor and INITIATE a HWC System shut down using either: <ul style="list-style-type: none"> • 3-HS-4-40A H2 WATER CHEMISTRY CONTROL [Panel 3-9-53] or • 3-HS-4-40B H2 WATER CHEMISTRY CONTROL [Panel 3-9-5] or • 3-HS-4-39 HWC SHUTDOWN SWITCH [3-LPNL-925-0588]. |
| | DRIVER | If directed to perform HWC Shutdown locally, inform Control Room that scaffold is in the way cannot access switch. ONCE HWC is shutdown and H2 concentration is above 4% THEN delete failure IMF OG5A |
| | BOP | Shutdown HWC System using either 3-HS-4-40A at panel 9-53 or 3-HS-4-40B at panel 9-5 |
| | SRO | [4] IF hydrogen concentration is $\geq 4\%$, THEN REFER TO TRM 3.7.2 |
| | NRC | Once HWC is Shutdown, H2 Concentration will begin to lower slowly |

Simulator Event Guide:

Event 4 Instrument: HWC Malfunction

| | | |
|--|--------|---|
| | SRO | 3-AOI-66-1, "Off Gas H2 High" |
| | SRO | <p style="text-align: center;">NOTE</p> <p>Fuel failure is indicated by, but NOT limited to, rising activity on the following:</p> <ul style="list-style-type: none"> • OFF-GAS PRETREATMENT RADIATION recorder, 3-RR-90-157 (Panel 3-9-2) • MAIN STEAM LINE RADIATION recorder, 3-RR-90-135 (Panel 3-9-2) • OFFGAS POST-TREATMENT RADIATION recorder, 3-RR-90-265 • On MAIN CONDENSERS (MN COND) ICS display: Offgas pretreatment, post treatment, and stack radiation <p>[5] IF high hydrogen concentration is a result of possible fuel failure, THEN REDUCE core flow to 50 - 60 % (otherwise N/A).</p> |
| | NRC | No indication of Fuel Failure Exists, step 5 should be NA. |
| | BOP | Report H2 Concentration lowering slowly. |
| | SRO | <p>[7] WHEN any of the following conditions exist, THEN INITIATE actions to reduce hydrogen concentration within 48 hours</p> <ul style="list-style-type: none"> • Hydrogen Analyzer on Panel 3-9-53 indicates $\geq 4\%$ hydrogen. |
| | SRO | REFER TO TRM 3.7.2 |
| | | <p>Condition A: With the concentration of hydrogen > 4% by volume</p> <p>Required Action A.1: Restore the concentration to within the limit</p> <p>Completion Time: 48 hours</p> |
| | | |
| | | |
| | | |
| | NRC | When ready, Recirc Pump 3A High Vibration. |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 10 for Recirc Pump 3A High Vibration. |

Simulator Event Guide:

Event 5 Component: Recirc Pump 3A High Vibration

| | | |
|--|---------|--|
| | ATC | Responds to alarm, RECIRC PUMP MTR A VIBRATION HIGH. |
| | BOP/ATC | <p>A. CHECKS temperatures for RECIRC PMP MTR 3A/3B WINDING AND BRG TEMP recorder, 3-TR-68-71 on Panel 3-9-21 are below:</p> <ul style="list-style-type: none"> • Pump motor bearing temperatures (< 190°F) • Pump motor winding temperatures (< 255°F) • Pump Seal Cavity temperatures (< 180°F) • Pump cooling water from Seal Cooling temperature (< 140°F) • Pump motor cooling water from bearing temperature (< 140°F) <p>B. CHECKS for a rise in Drywell equip sump pumpout rate, due to seal leakage.</p> <p>C. DISPATCHES personnel to 3-LPNL-925-0712, (Vibration Mon. System) on EL 565' (S-R17), to REPORT the Vibration Data for Pump A and any other alarm indications, to the Unit Operator. The person shall advise the Unit Operator of any changes in the vibration values.</p> <p>D. IF alarm seals in, THEN ADJUST pump speed slightly to try reset the alarm.</p> <p>E. IF unable to reset alarm, THEN CONSULT with Unit Supervisor, and with his concurrence, SHUTDOWN the Recirc pump and REFER TO 3-AOI-68-1A or 3-AOI-68-1B.</p> <p>F. IF pump operation continues, THEN RECORD pump 3A seal parameters hourly on Attachment 1, Page 22 of this ARP.</p> |
| | DRIVER | When dispatched, report all vibration points are elevated and point 3-XI-068-0059D is at 12.5 mils. After speed is lowered, vibration reading lowered slightly, point 59D is 12 mils. If speed is lowered greater than 20 RPM initially delete th12a and inform that 59D is 10 mils |
| | ATC | Lowers Pump Speed in an attempt to reset high vibration alarm. |
| | DRIVER | IF Speed is lowered a second time, vibration readings lowered again and point 59D is 10 mils. THEN Delete th12 a |
| | SRO | Determine whether to remove RR Pump 3A. |
| | ATC | Records seal parameters hourly for RR Pump 3A. |
| | | |
| | NRC | When ready, HPCI Inadvertent Initiation. |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 5 for HPCI Initiation. |

Simulator Event Guide:

Event 5 Component: Contingent if SRO removes RR Pump 3A

| | | | | | | | | | | | | | | |
|----------------------|---------------|--|---------------------|-----------|--------------------|-------------|----------------------|-------------|--------------------|-------------|----------------------|-------------|--------------------|-------------|
| | SRO | Directs RR Pump 3A Shutdown, IAW 3-OI-68, Section 7.2. | | | | | | | | | | | | |
| | NRC | NOTE: Tripping of the Reactor Recirc pump under these conditions is an undesirable action | | | | | | | | | | | | |
| | ATC | <p>7.2 Stopping a Recirc Pump (Mode 1) & Single Loop Operation</p> <p style="text-align: center;">CAUTIONS</p> <p>1) Prior to stopping a Recirc Pump, all attempts should be made to evaluate where the plant conditions will end up, when a Recirc Pump is removed from service. If practical, the control rod line should always be below 95.2% before stopping a Recirc Pump. At BFN, deliberate entry into Regions 1, 2, or 3 is NOT permitted.</p> <p>2) Per Technical Specifications, the reactor CAN BE operated indefinitely with one Recirc loop out of service, provided the requirements of T.S. 3.4.1 are implemented within 24 hours of entering single loop operations.</p> | | | | | | | | | | | | |
| | ATC | [1] IF stopping of the 3A Recirc Pump is immediately required, THEN PERFORM the following: (Otherwise N/A) | | | | | | | | | | | | |
| | ATC | [4] REDUCE reactor power by a combination of control rod insertions and core flow changes, as recommended by the Reactor Engineer/Unit Supervisor, to maintain operating recirc pump flow less than 46,600 gpm. REFER TO 3-GOI-100-12, 3-GOI-100-12A, and 3-SR-3.1.3.5(A). | | | | | | | | | | | | |
| | ATC | <p>[5] WHEN desired to control Recirc Pumps 3A and/or 3B speed in preparation for shutting down a recirc drive, THEN ADJUST Recirc Pump speed 3A and/or 3B using the following push buttons as required:</p> <table border="0"> <tr> <td>Recirc Drive</td> <td>3A</td> </tr> <tr> <td>RAISE SLOW,</td> <td>3-HS-96-15A</td> </tr> <tr> <td>RAISE MEDIUM,</td> <td>3-HS-96-15B</td> </tr> <tr> <td>LOWER SLOW,</td> <td>3-HS-96-17A</td> </tr> <tr> <td>LOWER MEDIUM,</td> <td>3-HS-96-17B</td> </tr> <tr> <td>LOWER FAST,</td> <td>3-HS-96-17C</td> </tr> </table> | Recirc Drive | 3A | RAISE SLOW, | 3-HS-96-15A | RAISE MEDIUM, | 3-HS-96-15B | LOWER SLOW, | 3-HS-96-17A | LOWER MEDIUM, | 3-HS-96-17B | LOWER FAST, | 3-HS-96-17C |
| Recirc Drive | 3A | | | | | | | | | | | | | |
| RAISE SLOW, | 3-HS-96-15A | | | | | | | | | | | | | |
| RAISE MEDIUM, | 3-HS-96-15B | | | | | | | | | | | | | |
| LOWER SLOW, | 3-HS-96-17A | | | | | | | | | | | | | |
| LOWER MEDIUM, | 3-HS-96-17B | | | | | | | | | | | | | |
| LOWER FAST, | 3-HS-96-17C | | | | | | | | | | | | | |
| | DRIVER | If Reactor Engineer is contacted, inform crew to follow Urgent Load Reduction RCP. | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | NRC | When ready, HPCI Inadvertent Initiation. | | | | | | | | | | | | |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 5 for HPCI Initiation. | | | | | | | | | | | | |

Simulator Event Guide:

Event 5 Component: Contingent if SRO removes RR Pump 3A

| | | |
|--|---------------|---|
| | NRC | NOTE: Tripping of the Reactor Recirc pump under these conditions is an undesirable action |
| | SRO | Directs RR Pump 3A Shutdown, IAW 3-OI-68, Section 7.2. |
| | ATC | [6] To shutdown Recirc Drive 3A: PERFORM the following: (Otherwise N/A) [6.1] FIRMLY DEPRESS RECIRC PUMP 3A SHUTDOWN, 3-HS-96-19. [6.2] VERIFY Recirc Drive shuts down. [6.3] VERIFY DRIVE RUNNING, 3-IL-96-41 is extinguished. |
| | ATC | [8] WHEN RECIRC LOOP A DIFF PRESS LOW 3-PDA-68-65 "ALARMS", CLOSE , RECIRC PUMP 3A DISCHARGE VALVE, 3-HS-68-3A. |
| | | [10] WHEN conditions allow, THEN MAINTAIN operating jet pump loop flow greater than 41 x 106 lbm/hr (3-FI-68-46 or 3-FI-68-48). |
| | | |
| | NRC | When ready, HPCI Inadvertent Initiation |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 5 for HPCI Initiation. |

Simulator Event Guide:

Event 6 Component: HPCI Inadvertent Initiation

| | | |
|--|---------------|--|
| | BOP | Recognizes and responds to an inadvertent HPCI initiation and reports it to the SRO. |
| | | Verifies by multiple indications that the initiation signal is not valid and reports it to the SRO. |
| | SRO | Directs BOP to trip HPCI and place the Aux Oil Pump in Pull-to-Lock. |
| | BOP | Trips HPCI and places the Aux Oil Pump in Pull-to-Lock (after turbine stops). |
| | ATC | Reports power / level/ pressure stable after HPCI secured. |
| | | Reports FWLC system transferred from 3-element control to single-element control. |
| | SRO | Refer to Technical Specification 3.5.1 Condition C: HPCI System Inoperable Required Action C.1: Verify by administrative means RCIC System is Operable C.2: Restore HPCI System to Operable status Completion Time C.1: Immediately C.2: 14 Days |
| | | Directs Instrument Mechanics to investigate the HPCI initiation logic. |
| | DRIVER | Acknowledge Notifications and directions. |
| | ATC | Places FWLC system back in 3-element control per 3-OI-3. |
| | | [1] IF desired to transfer level control from Single Element to Three Element, THEN PERFORM the following: (Otherwise N/A) [1.1] VERIFY conditions in Note 2 are met for placing level control in Three Element. [1.2] OBSERVE stable steam flow and Feedwater flow. [1.3] DEPRESS THREE ELEMENT push-button, 3-HS-46-6/3. • VERIFY green backlight for push-button illuminates. [1.4] VERIFY extinguished green backlight for SINGLE ELEMENT push-button, 3-HS-46-6/1. [1.5] CHECK Reactor water level stable. |
| | | Reports to US that FWLC placed back in 3-element control. |
| | NRC | When Ready, Major HPCI Steam Leak. |
| | DRIVER | Prior to starting HPCI steam leak modify fp02 to CLOSE, THEN initiate Trigger 20 for HPCI Steam Leak. |

Simulator Event Guide:

Event 6 Component: HPCI Inadvertent Initiation

| | | |
|--|---------------|---|
| | NRC | NOTE: Suppression Pool Level should not reach this point |
| | BOP | Reports Suppression Chamber Water Level Abnormal, greater than (-) 1". |
| | SRO | Enters EOI-2. |
| | | Monitor and Control Suppression Pool Level between -1 inch and -6inch, (Appendix 18). |
| | BOP | Checks ECCS systems for sources of water. |
| | | Reports HPCI minimum flow 73-30 open, attempts close valve. (Valve will NOT remain closed with initiation signal in.) |
| | Crew | Directs AUO to valve locally to isolate. |
| | DRIVER | When dispatched, wait 3 minutes and report ready to isolate at breaker. When directed by operator, GO TO Component Override, THEN System 73, THEN FCV-73-30 Fail Now. |
| | SRO | Directs pump down of Torus per App 18. |
| | SRO | Can Suppression Pool Level Be Maintained Above -6 inches? - YES Can Suppression Pool Level Be Maintained Below -1 inches? - YES |
| | BOP/ATC | Appendix 18 |
| | BOP/ATC | IF Directed by SRO, THEN REMOVE water from Suppression Pool as follows: DISPATCH personnel to perform the following (Unit 3 RB, El 519 ft, Torus Area): |
| | DRIVER | When dispatched, wait 8 minutes and report lined up locally to pump torus. |
| | BOP | Aligns to pump down torus in Control Room, per Appendix 18. b. IF Main Condenser is desired drain path, THEN OPEN 3-FCV-74-62, RHR MAIN CNDR FLUSH VALVE. c. IF Radwaste is desired drain path, THEN PERFORM the following: 1) ESTABLISH communications with Radwaste. 2) OPEN 3-FCV-74-63, RHR RADWASTE SYS FLUSH VALVE. |
| | BOP | Directs AUO to Start RHR Drain Pump. |
| | DRIVER | When directed to start RHR Drain Pump, IRF RH09 or RH10 and RH11A or B |
| | NRC | When Ready, Major HPCI Steam Leak. |
| | DRIVER | Prior to starting HPCI steam leak modify fp02 to CLOSE, THEN initiate Trigger 20 for HPCI Steam Leak. |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|---------------|--|
| | Crew | Recognize rising HPCI Room Temperatures and Radiation Levels. HPCI LEAK DETECTION TEMP HIGH A. CHECK HPCI temperature switches on LEAK DETECTION SYSTEM TEMPERATURE, 3-TI-69-29 on Panel 3-9-21. B. IF high temperature is confirmed, THEN ENTER 3-EOI-3 Flowchart. C. CHECK following on Panel 3-9-11 and NOTIFY RADCON if rising radiation levels are observed: 1. HPCI ROOM EL 519 RX BLDG radiation indicator, 3-RI-90-24A. 2. RHR WEST ROOM EL 519 RX BLDG radiation indicator, 3-RI-90-25A. |
| | ATC/BOP | VERIFIES HPCI STEAM LINE INBD ISOL VLV, 3-FCV-73-2 AND HPCI STEAM LINE OUTBD ISOL VLV, 3-FCV-73-3 CLOSE . |
| | | Attempts to isolate HPCI Steam Supply Valves. |
| | | Reports HPCI fails to isolate. |
| | ATC/BOP | During attempts to isolate HPCI Steam Supply Valves, report a loss of 3A RMOV Board. (Loop 1RHR and Loop 1 Core Spray unavailable.) |
| | Crew | Contacts personnel to investigate loss of 3A RMOV Board. |
| | Crew | Dispatches personnel to transfer RPS A to alternate. |
| | DRIVER | When requested, wait 4 minutes and place RPS A on alternate IRF RP04 and RP03. |
| | Crew | PA announcement to evacuate the HPCI quad or Reactor Building |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|---------------|---|
| | SRO | Enters EOI-3 on Secondary Containment (Area Radiation or Temperature). |
| | SRO | IF Reactor Zone or Refuel Zone Exhaust Ventilation isolated and ventilation radiation levels are below 72 mr/hr THEN Restart Reactor Zone and Refuel Zone Ventilation, per Appendix 8F. Defeat isolation interlocks if necessary, Appendix 8E. |
| | | If ventilation isolated and below 72 mr/hr, directs Operator to perform Appendix 8F. |
| | DRIVER | If requested, wait 3 minutes and report Appendix 8E complete, enter bat app08e |
| | | |
| | CT#1 | Enters EOI-1 RPV Control and directs Reactor Scram before any temperature exceeds MAX Safe. |
| | | |
| | CT#2 | Stops at Stop sign When temperatures in two or more areas are above Max Safe, Then Emergency Depressurization is required. |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|---------------|--|
| | | |
| | CT#1 | Enters EOI-1 RPV Control and directs Reactor Scram before any temperature exceeds MAX Safe. |
| | | |
| | CT#2 | Stops at Stop sign When temperatures in two or more areas are above Max Safe, Then Emergency Depressurization is required. |
| | SRO | EOI-3 Secondary Containment (Temperature) |
| | | Monitor and Control Secondary Containment Temperature. |
| | | |
| | | Is Any Area Temp Above Max Normal? - YES |
| | | Isolate all systems that are discharging into the area except systems required to: <ul style="list-style-type: none"> • Be operated by EOIs OR • Suppress a Fire |
| | | Will Emergency Depressurization Reduce Discharge Into Secondary Containment? - YES |
| | | Proceeds to the STOP sign Before any area temp rises to Max Safe (table 5) Continue: |
| | Crew | Monitors for Max Safe Temperatures, reports when two areas are above MAX Safe (HPCI Room greater than 270°F and RHR System II Pump Room greater than 215°F) |
| | SRO | EOI-3 Secondary Containment (Level) |
| | | Monitor and Control Secondary Containment Water Levels. |
| | | Is Any Floor Drain Sump Above 66 inches? - NO Is Any Area Water Level Above 2 inches? - NO |
| | DRIVER | IF ED is Anticipated be ready to raise HPCI Steam Leak IMF HP08 to 15 and take out the ramp to ensure we get greater than 215 degrees. |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|---------------|---|
| | SRO | EOI-3 Secondary Containment (Radiation) |
| | | Monitor and Control Secondary Containment Radiation Levels. |
| | | Is Any Area Radiation Level Max Normal? - YES |
| | | Isolate all systems that are discharging into the area except systems required to: <ul style="list-style-type: none"> • Be operated by EOIs OR • Suppress a Fire |
| | | Will Emergency Depressurization Reduce Discharge Into Secondary Containment? - YES |
| | | Proceeds to the STOP sign Before any area radiation rises to Max Safe (table 4) Continue |
| | | |
| | | |
| | DRIVER | IF ED is Anticipated be ready to raise HPCI Steam Leak IMF HP08 to 15 and take out the ramp to ensure we get greater than 215 degrees |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|-------------|--|
| | CT#1 | Enters EOI-1, "RPV Control" and directs Reactor Scram. |
| | CT#1 | Scrams the Reactor and places the Mode Switch in Shutdown. |
| | | |
| | SRO | Reactor Pressure |
| | | Monitor and Control Reactor Pressure |
| | | IF Drywell Pressure Above 2.4 psig ?- NO |
| | | IF Emergency Depressurization is Anticipated and the Reactor will remain subcritical without boron under all conditions, THEN Rapidly depressurize the RPV with the Main Turbine Bypass Valves irrespective of cooldown rate. Should Answer YES; during Scenario and direct Bypass Valves opened. |
| | CT#2 | IF Emergency Depressurization is required, THEN exit RC/P and enter C2 Emergency Depressurization. Answers YES; when two area temperatures have reached MAX Safe. (SEE PAGE: 27) |
| | | IF RPV water level cannot be determined? - NO |
| | | Is any MSRV Cycling? - NO |
| | | IF Steam cooling is required? - NO |
| | | IF Suppression Pool level and temperature cannot be maintained in the safe area of Curve 3? - NO |
| | | IF Suppression Pool level cannot be maintained in the safe area of Curve 4? - NO |
| | | IF Drywell Control air becomes unavailable? - NO |
| | | IF Boron injection is required? - NO |
| | SRO | Directs a Pressure Band. Should begin to lower Reactor Pressure with bypass valves, not to exceed 100° cooldown; until SRO decides that ED is anticipated. |
| | ATC/BOP | Controls Reactor Pressure as directed with Bypass Valves. |
| | | When directed to Anticipate ED, Opens all bypass valves. |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|-----|---|
| | ATC | Maintains the prescribed level band, IAW Appendix 5A. |
| | | <ol style="list-style-type: none"> 1. IF It is desired to use a reactor feed pump that is in operation, THEN CONTINUE at step 12 to control the operating pump. 2. VERIFY Condensate system in service, supplying suction to RFPs. 3. VERIFY OPEN 3-FCV-1-125(133)(141), RFPT 3A(3B)(3C) HP STEAM SUPPLY VALVE. 4. DEPRESS 3-HS-46-8A(9A)(10A), RFPT 3A(3B)(3C) SPEED CONT RAISE/LOWER, and VERIFY amber light is illuminated. 5. VERIFY a Main Oil Pump is running for RFPT to be started. 6. VERIFY that the green light is illuminated and the red light is extinguished above the following on Panel 3-9-5 3-HS-3-208A, RX WTR LVL CH A HI RFPT/MT TRIP RESET 3-HS-3-208B, RX WTR LVL CH B HI RFPT/MT TRIP RESET. |
| | | <ol style="list-style-type: none"> 7. VERIFY OPEN the following valves: 3-FCV-3-75, HP HTR 3A1 FW OUTLET ISOL VLV 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VLV 3-FCV-3-77, HP HTR 3C1 FW OUTLET ISOL VLV 8. DEPRESS 3-HS-3-124A(150A)(175A), RFPT 3A(3B)(3C) TRIP RESET, and Verify that the turbine trip is RESET. |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|-----|---|
| | ATC | Maintains the prescribed level band, IAW Appendix 5A. |
| | | 9. VERIFY OPEN 3-FSV-3-20(13)(6), RFP 3A(3B)(3C) MIN FLOW VALVE. |
| | | 10. PLACE 3-HS-46-112A(138A)(163A), RFPT 3A(3B)(3C) START/LOCAL ENABLE, in START, AND VERIFY RFPT speed increases to approximately 600 rpm. |
| | | 11. VERIFY OPEN 3-FCV-3-19(12)(5), RFP 3A(3B)(3C) DISCHARGE VALVE. |
| | | 12. SLOWLY ADJUST RFPT speed UNTIL feedwater flow to the RPV is indicated, using ANY of the following methods on Panel 3-9-5: <ul style="list-style-type: none"> • Individual 3-HS-46-8A(9A)(10A), RFPT 3A(3B)(3C) SPEED CONT RAISE/LOWER switch in MANUAL GOVERNOR, OR • Individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in MANUAL, OR • 3-LIC-46-5, REACTOR WATER LEVEL CONTROL, in MANUAL with individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in AUTO. |
| | | 13. ADJUST RFPT speed as necessary to control injection using the methods of step 12. |
| | | 14. WHEN RPV level is approximately equal to desired level AND automatic level control is desired, THEN PLACE 3-LIC-46-5, REACTOR WATER LEVEL CONTROL, in AUTO with individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in AUTO. |

Simulator Event Guide:

Event 8 Component: 1 ADS Valve Fails to Operate

| | | |
|--|-------------|--|
| | CT#2 | Enters 3-C-2, "Emergency Depressurization". |
| | | Will the Reactor Remain Subcritical Without Boron Under All Conditions ?- YES |
| | | Is Drywell Pressure Above 2.4 psig? - NO |
| | | Is Suppression Pool Level Above 5.5 feet? - YES |
| | | Directs All ADS Valves Open. |
| | CT#2 | Opens 6 ADS Valves. |
| | | Reports 1 ADS Valve failed to Open. |
| | SRO | Can 6 ADS Valves Be Opened? - NO |
| | | Directs Opening of Additional MSRVs, as necessary, to establish 6 MSRVs Open. |
| | ATC/BOP | Opens 1 additional MSRV. |
| | SRO | Are At Least 4 MSRVs Open? - YES |
| | | |
| | SRO | Directs Reactor Level Restored to (+) 2 to (+) 51 inches with Condensate (Appendix 6A) or Core Spray (Appendix 6D, 6E) or LPCI (Appendix 6B, 6C) |
| | ATC/BOP | Restores Reactor Level to prescribed level band, reports Startup Level Controller failure and restores level with Core Spray Loop 2 or RHR Loop 2. |
| | | |
| | SRO | Emergency Plan Classification is 3.1-S. |
| | | |
| | | |

Simulator Event Guide:

Event 9 Component: Startup Level Control Valve Failure

| | ATC | Appendix 6A Injection with Condensate |
|--|-----|--|
| | | 1. VERIFY CLOSED the following Feedwater heater return valves: <ul style="list-style-type: none"> • 3-FCV-3-71, HP HTR 3A1 LONG CYCLE TO CNDR • 3-FCV-3-72, HP HTR 3B1 LONG CYCLE TO CNDR • 3-FCV-3-73, HP HTR 3C1 LONG CYCLE TO CNDR |
| | | 2. VERIFY CLOSED the following RFP discharge valves: <ul style="list-style-type: none"> • 3-FCV-3-19, RFP 3A DISCHARGE VALVE • 3-FCV-3-12, RFP 3B DISCHARGE VALVE • 3-FCV-3-5, RFP 3C DISCHARGE VALVE |
| | | 3. VERIFY OPEN the following drain cooler inlet valves: <ul style="list-style-type: none"> • 3-FCV-2-72, DRAIN COOLER 3A5 CNDS INLET ISOL VLV • 3-FCV-2-84, DRAIN COOLER 3B5 CNDS INLET ISOL VLV • 3-FCV-2-96, DRAIN COOLER 3C5 CNDS INLET ISOL VLV |
| | | 4. VERIFY OPEN the following heater outlet valves: <ul style="list-style-type: none"> • 3-FCV-2-124, LP HEATER 3A3 CNDS OUTL ISOL VLV • 3-FCV-2-125, LP HEATER 3B3 CNDS OUTL ISOL VLV • 3-FCV-2-126, LP HEATER 3C3 CNDS OUTL ISOL VLV |
| | | 5. VERIFY OPEN the following heater isolation valves: <ul style="list-style-type: none"> • 3-FCV-3-38, HP HTR 3A2 FW INLET ISOL VLV • 3-FCV-3-31, HP HTR 3B2 FW INLET ISOL VLV • 3-FCV-3-24, HP HTR 3C2 FW INLET ISOL VLV • 3-FCV-3-75, HP HTR 3A1 FW OUTLET ISOL VLV • 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VLV • 3-FCV-3-77, HP HTR 3C1 FW OUTLET ISOL VLV |
| | | 6. VERIFY OPEN the following RFP suction valves: <ul style="list-style-type: none"> • 3-FCV-2-83, RFP 3A SUCTION VALVE • 3-FCV-2-95, RFP 3B SUCTION VALVE • 3-FCV-2-108, RFP 3C SUCTION VALVE |
| | | 7. VERIFY at least one condensate pump running. |
| | | 8. VERIFY at least one condensate booster pump running. |
| | | 9. ADJUST 3-LIC-3-53, RFW START-UP LEVEL CONTROL, to control injection. |
| | ATC | Reports failure of Start Up Level controller. |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | ATC/BOP | Appendix 6E Injection with Core Spray Loop 2 |
|--|---------|--|
| | | 1. VERIFY OPEN the following valves: <ul style="list-style-type: none"> • 3-FCV-75-30, CORE SPRAY PUMP 3B SUPPR POOL SUCT VLV • 3-FCV-75-39, CORE SPRAY PUMP 3D SUPPR POOL SUCT VLV • 3-FCV-75-51, CORE SPRAY SYS II OUTBD INJECT VALVE. |
| | | 2. VERIFY CLOSED 3-FCV-75-50, CORE SPRAY SYS II TEST VALVE. |
| | | 3. VERIFY CS Pump 3B and/or 3D RUNNING. |
| | | 4. WHEN RPV pressure is below 450 psig, THEN THROTTLE 3-FCV-75-53, CORE SPRAY SYS II INBD INJECT VALVE, as necessary to control injection at or below 4000 gpm per pump. |
| | | 5. MONITOR Core Spray Pump NPSH using Attachment 1. |
| | | Restores Level (+) 2 to (+) 51 inches. |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | ATC/BOP | Appendix 6C Injection with RHR Loop 2 LPCI Mode |
|--|---------|--|
| | | 1. IF Adequate core cooling is assured, AND it becomes necessary to bypass the LPCI injection valve auto open signal to control injection, THEN PLACE 3-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS . |
| | | 2. VERIFY OPEN 3-FCV-74-24, RHR PUMP 3B SUPPR POOL SUCT VLV. |
| | | 3. VERIFY OPEN 3-FCV-74-35, RHR PUMP 3D SUPPR POOL SUCT VLV. |
| | | 4. VERIFY CLOSED the following valves: <ul style="list-style-type: none"> • 3-FCV-74-75, RHR SYS II DW SPRAY INBD VLV • 3-FCV-74-74, RHR SYS II DW SPRAY OUTBD VLV • 3-FCV-74-71, RHR SYS II SUPPR CHBR/POOL ISOL VLV • 3-FCV-74-72, RHR SYS II SUPPR CHBR SPRAY VALVE • 3-FCV-74-73, RHR SYS II SUPPR POOL CLG/TEST VLV |
| | | 5. VERIFY RHR Pump 3B and/or 3D running. |
| | | 6. WHEN RPV pressure is below 450 psig, THEN VERIFY OPEN 3-FCV-74-67, RHR SYS II LPCI INBD INJECT VALVE. |
| | | 7. IF RPV pressure is below 230 psig, THEN VERIFY CLOSED 3-FCV-68-3, RECIRC PUMP 3A DISCHARGE VALVE. |
| | | 8. THROTTLE 3-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE, as necessary to control injection. |
| | | 9. MONITOR RHR Pump NPSH using Attachment 1. |
| | | 10. PLACE RHRSW pumps in service, as soon as possible, on ANY RHR Heat Exchangers discharging to the RPV. |
| | | 11. THROTTLE the following in-service RHRSW outlet valves to maintain flow between 1350 and 4500 gpm: <ul style="list-style-type: none"> • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV • 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV. |
| | | Restores Level (+) 2 to (+) 51 inches. |
| | | |

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | | |
|--|---------|---|
| | SRO | Continues to evaluate Suppression Pool Level and other legs of EOI-2. |
| | | EOI-2 (Drywell Temperature) |
| | SRO | Monitor and Control DW Temp Below 160°F, using available DW Cooling. |
| | | Can Drywell Temp Be Maintained Below 160°F? - YES |
| | | |
| | SRO | Verify H2O2 Analyzers placed in service, Appendix 19. |
| | BOP | Places H2O2 analyzers in service, IAW Appendix 19. |
| | | |
| | SRO | EOI-2 Primary Containment (Pressure) |
| | | Monitor and Control PC Pressure Below 2.4 psig, Using the Vent System As Necessary. (Appendix 12) |
| | | Can Primary Containment pressure be maintained below 2.4 psig? - YES |
| | | |
| | SRO | EOI-2 Suppression Pool (Temperature) |
| | | Monitor and Control Suppression Pool Temperature Below 95°F, Using Available Suppression Pool Cooling As Necessary. (Appendix 17A) |
| | | Can Suppression Pool Temperature Be Maintained Below 95°F? - NO |
| | | Operate all available suppression pool cooling using only RHR Pumps not required to assure adequate core cooling by continuous injection (Appendix 17A) |
| | BOP/ATC | Start RHR Loop 2 in Suppression Pool Cooling, if not being used for level control, IAW Appendix 17A |
| | | |
| | | |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization complete.

Reactor Level is restored and maintained.

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | ATC/BOP | Initiates Suppression Pool Cooling per Appendix 17A |
|--|---------|--|
| | | <p>1. IF Adequate core cooling is assured, OR Directed to cool the Suppression Pool irrespective of adequate core cooling, THEN BYPASS LPCI injection valve auto open signal as necessary, by PLACING 3-HS-74-155A(B), LPCI SYS I(II) OUTBD INJ VLV BYPASS SEL in BYPASS.</p> |
| | | <p>2. PLACE RHR SYSTEM I(II) in Suppression Pool Cooling as follows:</p> <p>a. VERIFY at least one RHRSW pump supplying each EECW header.</p> <p>b. VERIFY RHRSW pump supplying desired RHR Heat Exchanger(s).</p> <p>c. THROTTLE the following in-service RHRSW outlet valves to obtain between 1350 and 4500 gpm RHRSW flow:</p> <ul style="list-style-type: none"> • 3-FCV-23-34, RHR HX 3A RHRSW OUTLET VLV • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV • 3-FCV-23-40, RHR HX 3C RHRSW OUTLET VLV • 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV <p>d. IF Directed by SRO, THEN PLACE 3-XS-74-122(130), RHR SYS I(II) LPCI 2/3 CORE HEIGHT OVRD in MANUAL OVERRIDE.</p> <p>e. IF LPCI INITIATION Signal exists, THEN MOMENTARILY PLACE 3-XS-74-121(129), RHR SYS I(II) CTMT SPRAY/CLG VLV SELECT in SELECT.</p> |
| | | <p>f. IF 3-FCV-74-53(67), RHR SYS I(II) LPCI INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 3-FCV-74-52(66), RHR SYS I(II) LPCI OUTBD INJECT VALVE.</p> <p>g. OPEN 3-FCV-74-57(71), RHR SYS I(II) SUPPR CHBR/POOL ISOL VLV.</p> <p>h. VERIFY desired RHR pump(s) for Suppression Pool Cooling are operating.</p> |
| | | |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization complete.

Reactor Level is restored and maintained.

Simulator Event Guide:

Event 7 Major: HPCI Steam Leak

| | BOP | Places H2O2 analyzers in service, IAW Appendix 19. |
|--|-----|--|
| | | 5. IF H2/O2 Analyzer is in STANDBY at 3-MON-76-110 (Panel 3-9-55), THEN PLACE H2/O2 Analyzer in service at as follows: (Touch screen actions unavailable in the simulator) |
| | | 6. VERIFY H2/O2 ANALYZER SAMPLE PUMP running using 3-XI-76-110 (Panel 3-9-55). 7. VERIFY red LOW FLOW indicating light extinguished at 3-MON-76-110, H2/O2 ANALYZER (Panel 3-9-55). |
| | | 8. WHEN H2/O2 Analyzer has been aligned and sampling for 10 minutes or greater, THEN OBTAIN H2 and O2 readings from 3-XR-76-110 H2/O2 CONCENTRATION recorder (Panel 3-9-54). |
| | | |
| | | |
| | | |
| | | |
| | | |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization complete.

Reactor Level is restored and maintained.

SHIFT TURNOVER SHEET

Equipment Out of Service/LCO's:

RHRSW Pump B2 is out of service and tagged out.

APRM 3 is bypassed for IMD Surveillance testing.

Operations/Maintenance for the Shift:

Rotate Bus Duct Cooling Fans IAW 3-OI-47 Section 6.11.1[2].

Once completed raise power with flow to 90% IAW 3-GOI-100-12 section 5.0 step 21
and the Reactivity Control Plan.

Units 1 and 2 are at 90% power.

Unusual Conditions/Problem Areas:

None

E01-3

UNIT 3


E01-3




| NO. | UNIT OR SYSTEM | WATER USE (GPM) | WATER USE (MGD) | WATER USE (MGD) | WATER USE (MGD) |
|-----|--------------------|-----------------|-----------------|-----------------|-----------------|
| 1 | AS FRESH WATER | 1000 | 0.000 | 0.000 | 0.000 |
| 2 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |
| 3 | WATER STORAGE | 1000 | 0.000 | 0.000 | 0.000 |
| 4 | WATER DISTRIBUTION | 1000 | 0.000 | 0.000 | 0.000 |
| 5 | WATER CONSUMPTION | 1000 | 0.000 | 0.000 | 0.000 |
| 6 | WATER REUSE | 1000 | 0.000 | 0.000 | 0.000 |
| 7 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |

| NO. | UNIT OR SYSTEM | WATER USE (GPM) | WATER USE (MGD) | WATER USE (MGD) | WATER USE (MGD) |
|-----|--------------------|-----------------|-----------------|-----------------|-----------------|
| 1 | AS FRESH WATER | 1000 | 0.000 | 0.000 | 0.000 |
| 2 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |
| 3 | WATER STORAGE | 1000 | 0.000 | 0.000 | 0.000 |
| 4 | WATER DISTRIBUTION | 1000 | 0.000 | 0.000 | 0.000 |
| 5 | WATER CONSUMPTION | 1000 | 0.000 | 0.000 | 0.000 |
| 6 | WATER REUSE | 1000 | 0.000 | 0.000 | 0.000 |
| 7 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |

| NO. | UNIT OR SYSTEM | WATER USE (GPM) | WATER USE (MGD) | WATER USE (MGD) | WATER USE (MGD) |
|-----|--------------------|-----------------|-----------------|-----------------|-----------------|
| 1 | AS FRESH WATER | 1000 | 0.000 | 0.000 | 0.000 |
| 2 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |
| 3 | WATER STORAGE | 1000 | 0.000 | 0.000 | 0.000 |
| 4 | WATER DISTRIBUTION | 1000 | 0.000 | 0.000 | 0.000 |
| 5 | WATER CONSUMPTION | 1000 | 0.000 | 0.000 | 0.000 |
| 6 | WATER REUSE | 1000 | 0.000 | 0.000 | 0.000 |
| 7 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |

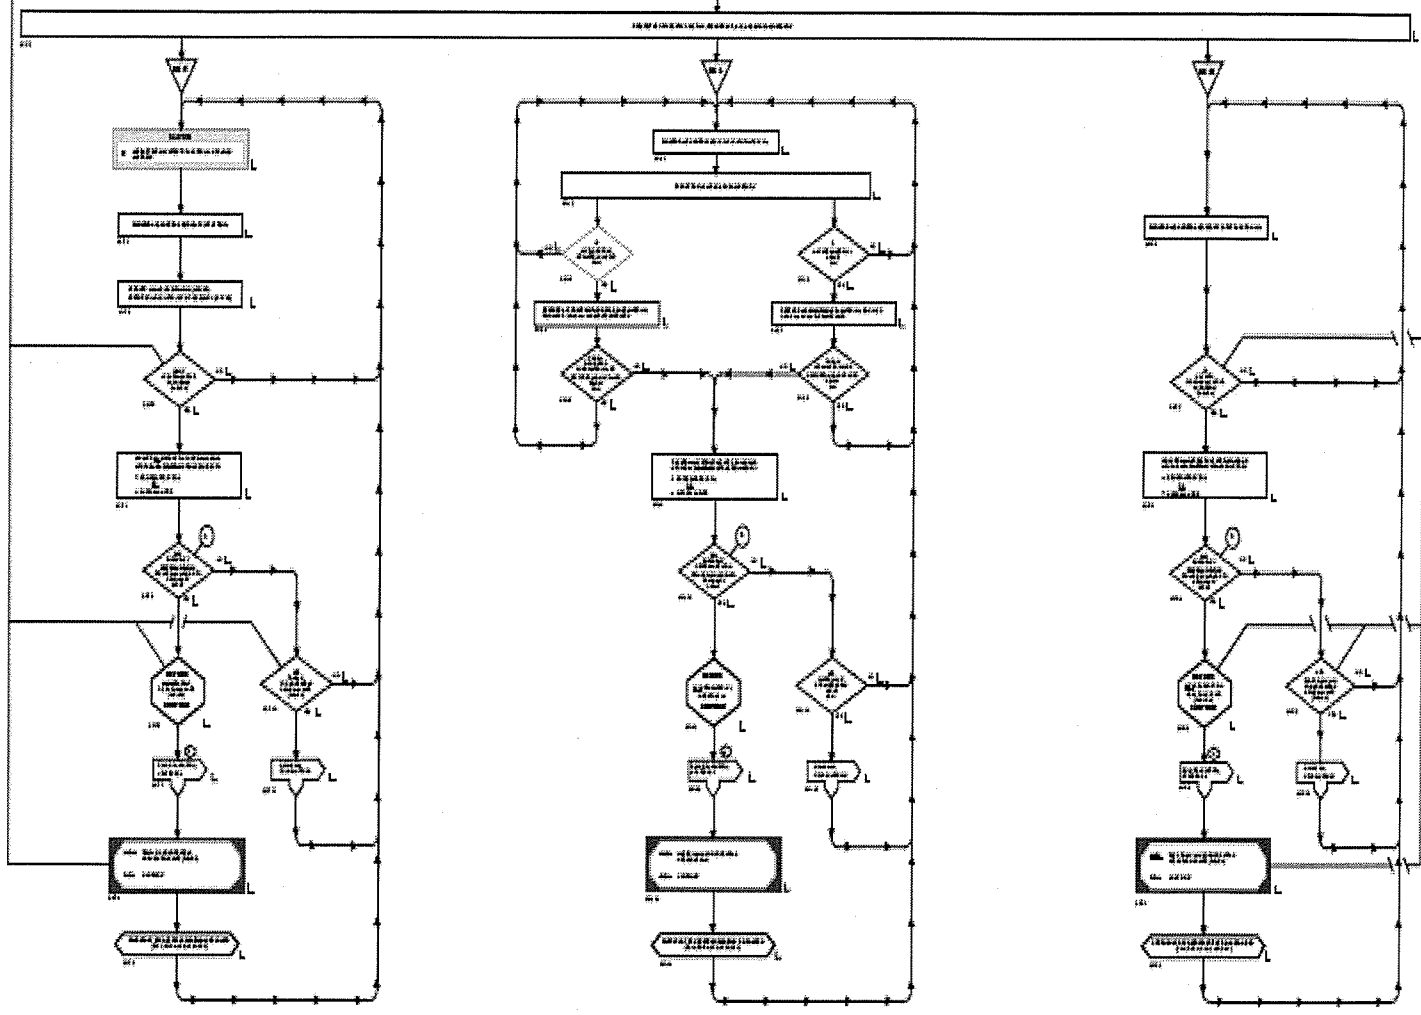

| NO. | UNIT OR SYSTEM | WATER USE (GPM) | WATER USE (MGD) | WATER USE (MGD) | WATER USE (MGD) |
|-----|--------------------|-----------------|-----------------|-----------------|-----------------|
| 1 | AS FRESH WATER | 1000 | 0.000 | 0.000 | 0.000 |
| 2 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |
| 3 | WATER STORAGE | 1000 | 0.000 | 0.000 | 0.000 |
| 4 | WATER DISTRIBUTION | 1000 | 0.000 | 0.000 | 0.000 |
| 5 | WATER CONSUMPTION | 1000 | 0.000 | 0.000 | 0.000 |
| 6 | WATER REUSE | 1000 | 0.000 | 0.000 | 0.000 |
| 7 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |




| NO. | UNIT OR SYSTEM | WATER USE (GPM) | WATER USE (MGD) | WATER USE (MGD) | WATER USE (MGD) |
|-----|--------------------|-----------------|-----------------|-----------------|-----------------|
| 1 | AS FRESH WATER | 1000 | 0.000 | 0.000 | 0.000 |
| 2 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |
| 3 | WATER STORAGE | 1000 | 0.000 | 0.000 | 0.000 |
| 4 | WATER DISTRIBUTION | 1000 | 0.000 | 0.000 | 0.000 |
| 5 | WATER CONSUMPTION | 1000 | 0.000 | 0.000 | 0.000 |
| 6 | WATER REUSE | 1000 | 0.000 | 0.000 | 0.000 |
| 7 | WATER TREATMENT | 1000 | 0.000 | 0.000 | 0.000 |

E01-3

WATER USE BY UNIT OR SYSTEM


TABLE 6
WATER USE BY UNIT OR SYSTEM

3-C-2 EMERGENCY RPV DEPRESSURIZATION

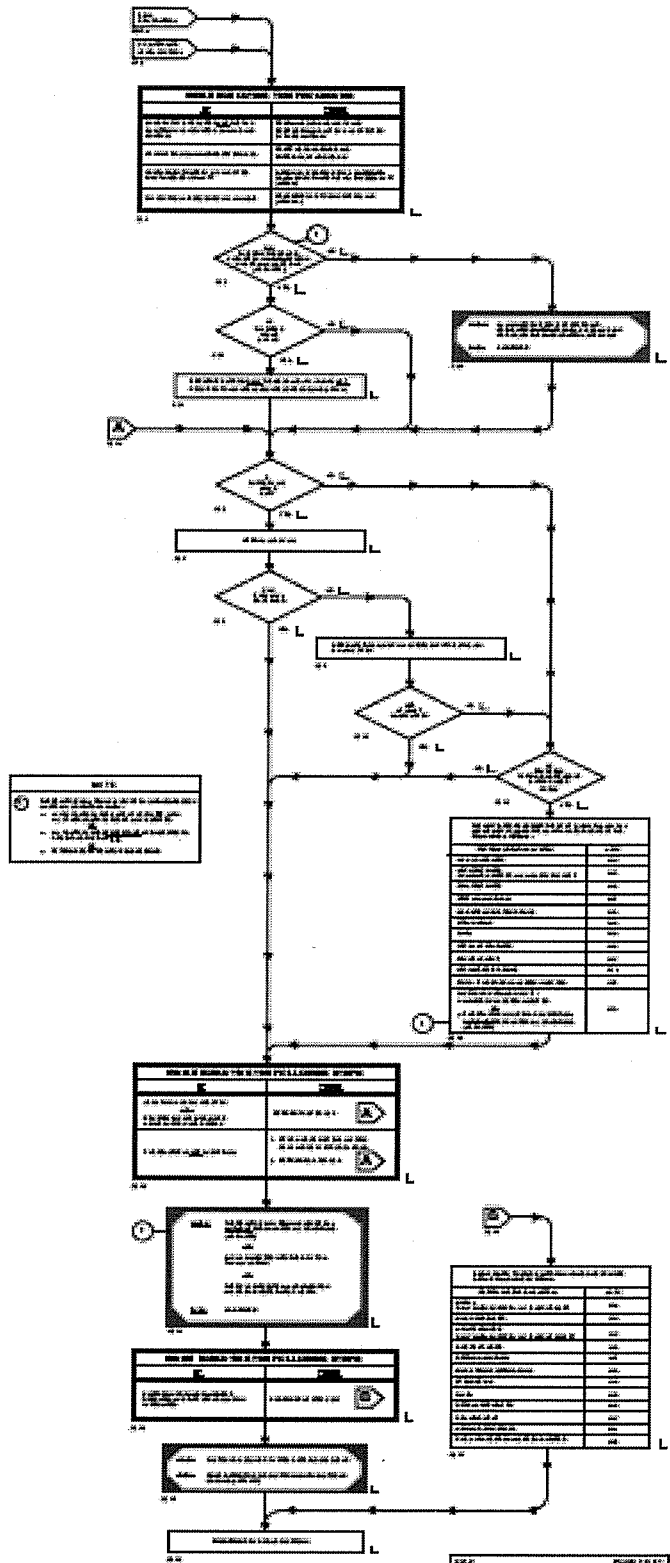

C-2

TABLE 1: OPERATIONAL MODES
TABLE 2: OPERATIONAL MODES
EMERGENCY RPV DEPRESSURIZATION
REVISION: 1

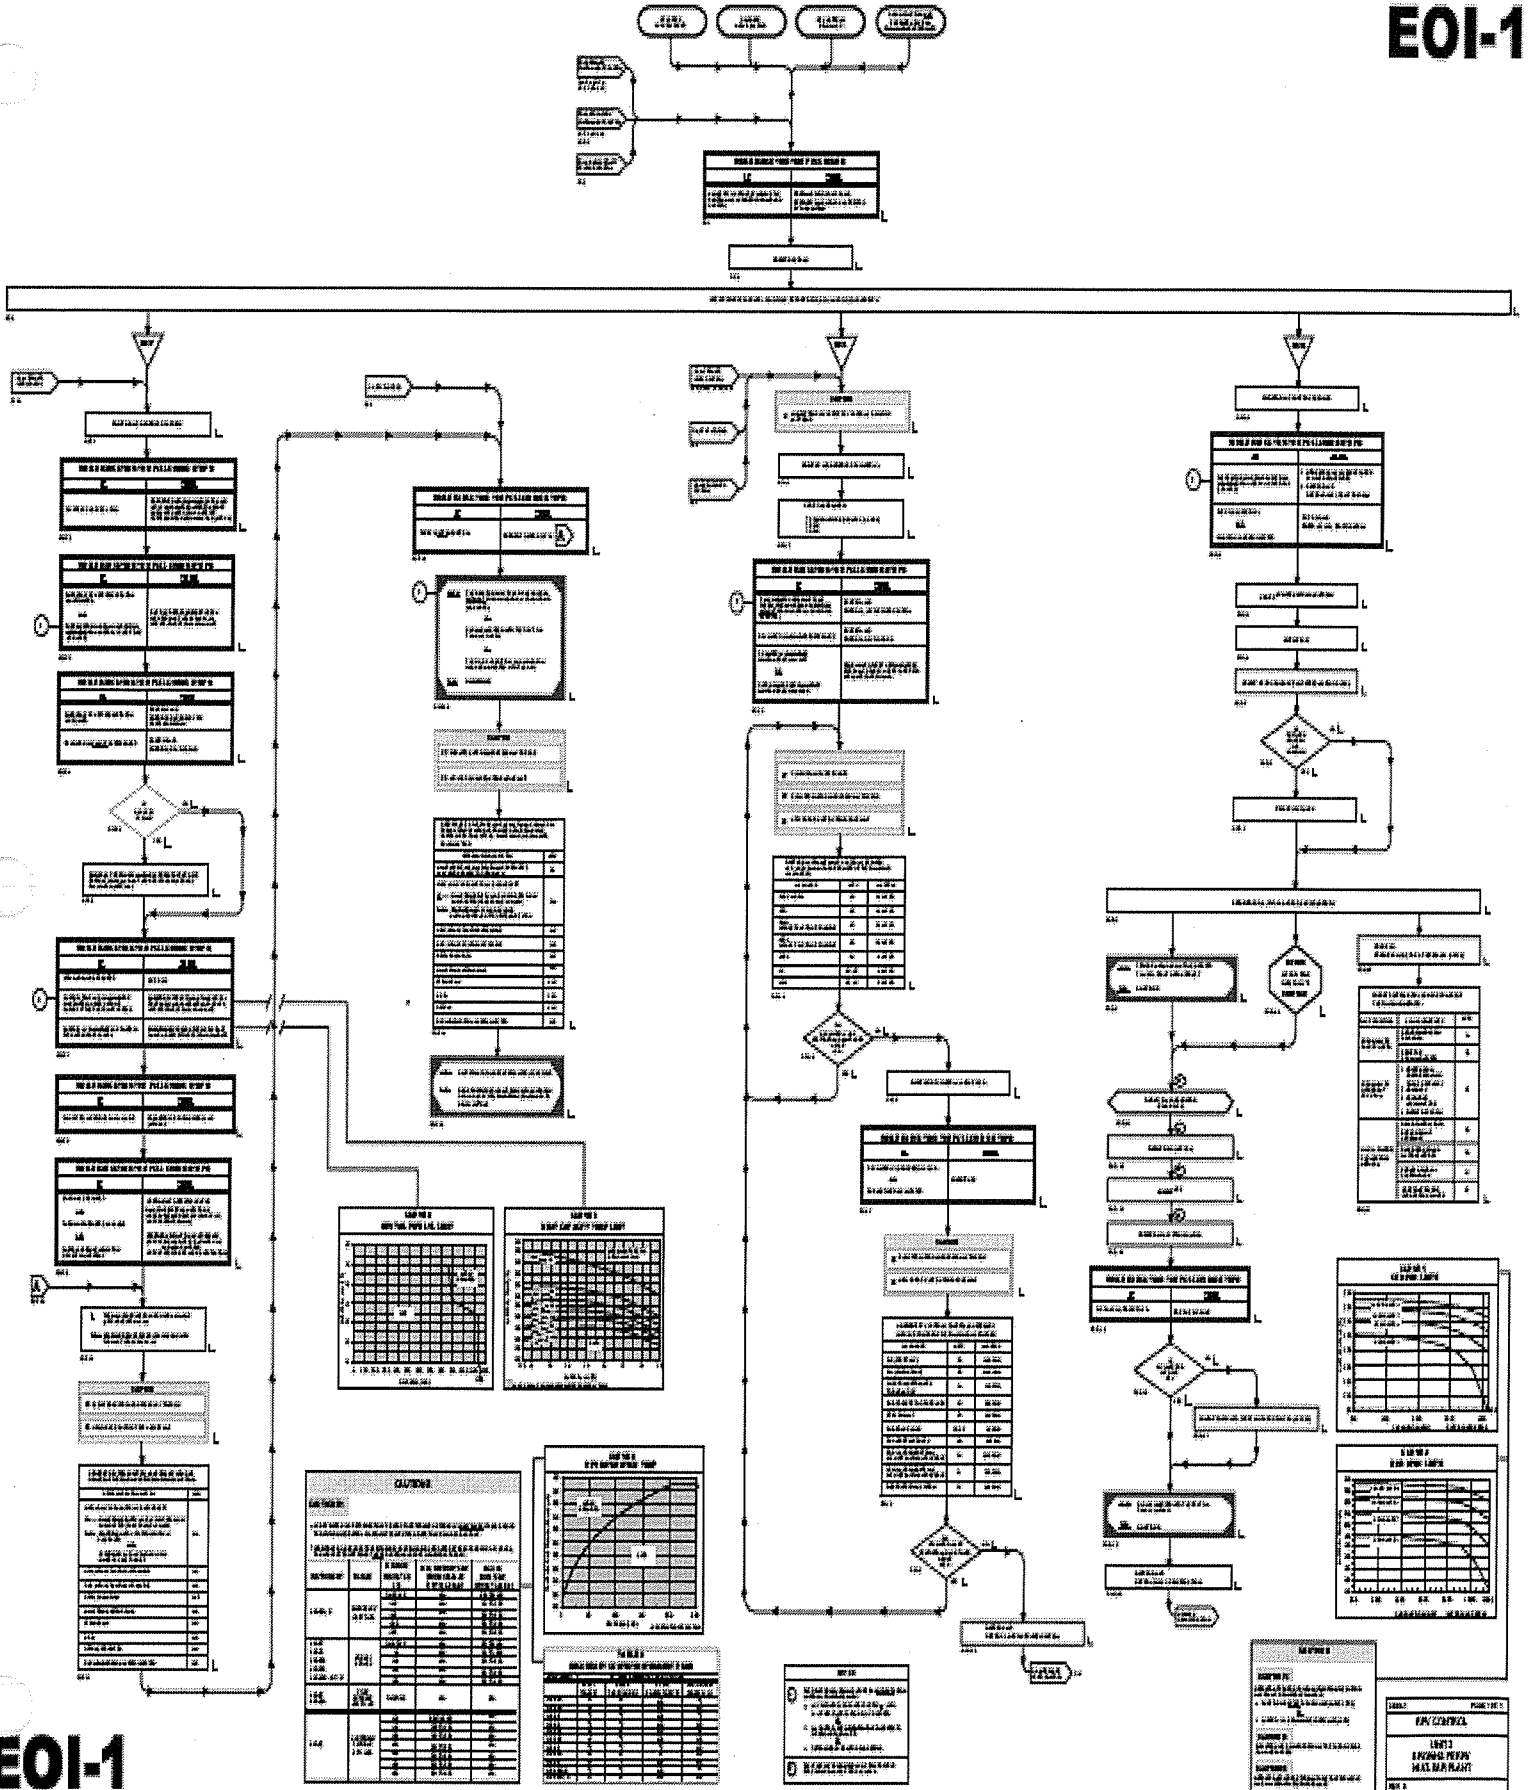

Airborne Effluents
TR 3.7.2

TR 3.7 PLANT SYSTEMS

TR 3.7.2 Airborne Effluents

LCO 3.7.2 Whenever the SJAE is in service, the concentration of hydrogen in the offgas downstream of the recombiners shall be limited to $\leq 4\%$ by volume.

APPLICABILITY: During main condenser offgas treatment system operation

-----NOTE-----

TRM LCO 3.0.3 is not applicable.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|-----------------|
| A. With the concentration of hydrogen $>4\%$ by volume. | A.1 Restore the concentration to within the limit. | 48 hours |

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

3.5.1 ECCS - Operating

LCO 3.5.1 Each ECCS injection/spray subsystem and the Automatic Depressurization System (ADS) function of six safety/relief valves shall be OPERABLE.

APPLICABILITY: MODE 1, MODES 2 and 3, except high pressure coolant injection (HPCI) and ADS valves are not required to be OPERABLE with reactor steam dome pressure \leq 150 psig.

ACTIONS

-----NOTE-----
LCO 3.0.4.b is not applicable to HPCI.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|-----------------|
| A. One low pressure ECCS injection/spray subsystem inoperable. <u>OR</u> One low pressure coolant injection (LPCI) pump in both LPCI subsystems inoperable. | A.1 Restore low pressure ECCS injection/spray subsystem(s) to OPERABLE status. | 7 days |

(continued)

ECCS - Operating
3.5.1

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--------------------------|-----------------|
| B. Required Action and associated Completion Time of Condition A not met. | B.1 Be in MODE 3. | 12 hours |
| | AND B.2 Be in MODE 4. | 36 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|----------------------------|
| C. HPCI System inoperable. | C.1 Verify by administrative means RCIC System is OPERABLE. <u>AND</u> C.2 Restore HPCI System to OPERABLE status. | Immediately 14 days |
| D. HPCI System inoperable. <u>AND</u> Condition A entered. | D.1 Restore HPCI System to OPERABLE status. <u>OR</u> D.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |
| E. One ADS valve inoperable. | E.1 Restore ADS valve to OPERABLE status. | 14 days |
| F. One ADS valve inoperable. <u>AND</u> Condition A entered. | F.1 Restore ADS valve to OPERABLE status. <u>OR</u> F.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|------------------------------------|
| <p>G. Two or more ADS valves inoperable.</p> <p><u>OR</u></p> <p>Required Action and associated Completion Time of Condition C, D, E, or F not met.</p> | <p>G.1 Be in MODE 3.</p> <p><u>AND</u></p> <p>G.2 Reduce reactor steam dome pressure to ≤ 150 psig.</p> | <p>12 hours</p> <p>36 hours</p> |
| <p>H. Two or more low pressure ECCS injection/spray subsystems inoperable for reasons other than Condition A.</p> <p><u>OR</u></p> <p>HPCI System and one or more ADS valves inoperable.</p> | <p>H.1 Enter LCO 3.0.3.</p> | <p>Immediately</p> |

| SECONDARY CONTAINMENT TEMPERATURE | | | | | |
|--|--|--------------|-----------|--|--------------------------|
| Description | | | | | |
| | | | | | UNUSUAL EVENT |
| | | | | | ALERT |
| 3.1-S | | TABLE | US | | SITE EMERGENCY |
| <p>An unisolable Primary System leak is discharging into Secondary Containment</p> <p style="text-align: center;">AND</p> <p>Any area temperature exceeds the Maximum Safe Operating Temperature limit listed in Table 3.1.</p> <p>OPERATING CONDITION: Mode 1 or 2 or 3</p> | | | | | |
| 3.1-G | | TABLE | US | | GENERAL EMERGENCY |
| <p>An unisolable Primary System leak is discharging into Secondary Containment</p> <p style="text-align: center;">AND</p> <p>Any area temperature exceeds the Maximum Safe Operating Temperature limit listed in Table 3.1</p> <p style="text-align: center;">AND</p> <p>Any indication of potential or significant fuel cladding failure exists. Refer to Table 3.1-G/3.2-G with RCS Barrier intact inside Primary Containment.</p> <p>OPERATING CONDITION Mode 1 or 2 or 3</p> | | | | | |

Facility: Browns Ferry NPP Scenario No.: B Op-Test No.: ILT 1102

FINAL

| | | | |
|------------|--|------------|-------------|
| Examiners: | | Operators: | SRO: |
| | | | ATC: |
| | | | BOP: |

Initial Conditions: IC191/ Unit 3 Reactor Power 90%. RCW Pump 3A tagged. 3-PI-3-207 Bypassed for surveillance.

Turnover: Perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 per 3-SR-3.6.1.3.5 Section 7.6 and 7.7. Raise Reactor Power to 95%.

| Event No. | Malf. No. | Event Type* | Event Description |
|-----------|-----------|-----------------|--|
| 1 | | N-BOP TS-SRO | Stroke time 2 PCIVs. The second valve will fail stroke time. |
| 2 | | R-ATC R-SRO | Raise Reactor Power with Recirc |
| 3 | th18d | C-ATC C-SRO | VFD Cooling Water Pump 3-B-1 failure |
| 4 | trg11 | C-BOP C-SRO | Steam Packing Exhauster Trip / STBY Exhauster Starts but discharge damper fails to open. |
| 5 | pc14 | TS-SRO C-BOP | Leak on RHR Loop 1 Minimum Flow Line |
| 6 | sw02a | C-ATC C-SRO | Loss of RBCCW – 3A Pump trip with Sectionalizing Valve 3-70-48 failure to close |
| 7 | th33a | M-ALL | Drywell Leak with Emergency Depressurization on Drywell Temps |
| 8 | tc02 | C | Bypass Valves Fail Closed |
| 9 | trg25 | C | RHR Loop I and II Drywell Sprays Fail |
| 10 | ad03 | C | 10 SRVs Fail Closed |

* (N)ormal, (R)eactivity, (I)nstrument, (C)omponent, (M)ajor

Critical Tasks - Two

CT#1-When Drywell Pressure cannot be maintained below the PSP limit, US determines that Emergency Depressurization is required and RO initiates Emergency Depressurization as directed by US.

1. Safety Significance:
Precludes failure of containment
2. Cues:
Procedural compliance
High Drywell Pressure
3. Measured by:
Observation - US determines (indicated by announcement or observable transition to C-2) that Emergency Depressurization is required before Drywell pressure exceeds the PSP limit.
AND
Observation - RO opens at least 6 SRV's during performance of Emergency Depressurization actions.
4. Feedback:
RPV pressure decreasing
SRV open status indications

OR

CT#1-When Drywell Temperature cannot be maintained below the Drywell Temperature limit of 280°F, US determines that Emergency Depressurization is required and RO initiates Emergency Depressurization as directed by US.

1. Safety Significance:
Precludes failure of containment
2. Cues:
Procedural compliance
High Drywell Temperature
3. Measured by:
Observation - US determines (indicated by announcement or observable transition to C-2) that Emergency Depressurization is required before Drywell Temperature exceeds the limit of 280°F.
AND
Observation - RO opens at least 6 SRV's during performance of Emergency Depressurization actions or if six SRVs cannot be opened takes additional actions to depressurize the Reactor.
4. Feedback:
RPV pressure decreasing
SRV open status indications

Critical Tasks - Two

CT#2- With a reactor scram required and the reactor not shutdown, take action to reduce power by initiating ARI to cause control rod insertion.

1. Safety Significance:

Shutting down reactor can preclude failure of containment or equipment necessary for the safe shutdown of the plant.
Correct reactivity control.

2. Cues:

Reactor power indication.
Procedural compliance.

3. Measured by:

Observation - ARI pushbuttons armed and depressed to cause control rod insertion.

4. Feedback:

Reactor power trend.
Rod status indication.

Scenario Summary:

BOP will perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 with 3-FSV-43-14 failing the stroke time test. SRO will determine Technical Specification 3.6.1.3 Condition A required.

Then, the ATC will raise power with Reactor Recirculation flow to 95%.

Once evaluators satisfied with Reactivity Manipulations, the VFD Cooling Water Pump for the B Reactor Recirc VFD will trip and the standby pump will fail to start. The ATC will start the standby VFD Cooling Water Pump to restore cooling water preventing a VFD and Reactor Recirc Pump trip.

Steam Packing Exhauster will trip and the STBY Exhauster will Start but the discharge damper will fail to open. The BOP will open the Steam Packing Exhauster discharge damper and restore Steam Packing Exhauster operation IAW with ARPs.

A leak will develop on RHR Loop 1 common minimum flow line, field reports will indicate the leak can be isolated by closing RHR A and C Pump suction valves. Once suction valves are closed SRO will determine Technical Specification 3.5.1 Condition A is required, TS 3.6.2.3 Condition B, 3.6.2.4 Condition B, and 3.6.2.5 Condition B all 7 Days.

After RHR Loop 1 is isolated an RBCCW Pump will trip and the sectionalizing valve will fail to close automatically. Operators will take actions IAW 3-AOI-70-1 and trip RWCU Pumps and close the sectionalizing valve for RBCCW.

A LOCA will occur, RPS will fail to de-energize, the crew will scram the Reactor by arming and depressing ARI, and enter EOI-1 and EOI-2. All rods will insert on ARI, level control will be on feedwater and pressure control will be on SRVs(only three SRVs are available. The bypass valves fail closed during the scram. The LOCA will cause increasing DW Pressure and Temperature; the crew will take action IAW EOI-2. When the crew attempts to spray the Drywell, the Drywell Spray valves will fail to open. Unable to spray the drywell the crew will need to establish limits for DW pressure and temperature for anticipating ED and ED.

The Emergency classification is 2.1-A

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization is complete

Reactor Level is restored and maintained.

SCENARIO REVIEW CHECKLIST

SCENARIO NUMBER: 3-B

- 9 Total Malfunctions Inserted: List (4-8)
- 4 Malfunctions that occur after EOI entry: List (1-4)
- 4 Abnormal Events: List (1-3)
- 1 Major Transients: List (1-2)
- 3 EOI's used: List (1-3)
- 1 EOI Contingencies used: List (0-3)
- 90 Validation Time (minutes)
- 2 Crew Critical Tasks: (2-5)

YES Technical Specifications Exercised (Yes/No)

Scenario Tasks

| <u>EVENT</u> | <u>TASK NUMBER</u> | <u>K/A</u> | <u>RO</u> | <u>SRO</u> |
|--------------|---|--------------|-----------|------------|
| 1 | Stroke Time Containment Isolation Valves | | | |
| | RO U-064-SU-08 SRO S-000-AD-81 | 223002A2.08 | 2.7 | 3.1 |
| 2 | Raise Power with Recirc Flow | | | |
| | RO U-068-NO-17 SRO S-000-NO-138 | 2.1.23 | 4.3 | 4.4 |
| 3 | VFD Cooling Water Pump Failure | | | |
| | RO U-068-AL-33 SRO S-068-AB-01 | 202001A2.22 | 3.1 | 3.2 |
| 4 | Steam Packing Exhauster Trip | | | |
| | RO U-47C-AL-02 SRO S-047-AB-03 | 271000A1.01 | 3.3 | 3.2 |
| 5 | RHR Loop 1 Leak | | | |
| | RO U-77A-AL-06 SRO S-000-EM-09 | 203000A4.02 | 4.1 | 4.1 |
| 6 | Loss of RBCCW | | | |
| | RO U-070-AL-03 SRO S-070-AB-01 | 206000A2.17 | 3.9 | 4.3 |
| 7 | Drywell LOCA | | | |
| | RO U-000-EM-05 SRO S-000-EM-04 SRO S-000-EM-05 SRO T-000-EM-15 | 295028EA2.01 | 4.0 | 4.1 |

Procedures Used/Referenced:

| Procedure Number | Procedure Title | Procedure Revision |
|--------------------|--|--------------------|
| 3-SR-3.6.1.3.5 | Primary Containment Isolation Valve Operability Test | Revision 24 |
| TS 3.6.1.3 | Primary Containment Isolation Valves | Amendment 212 |
| 3-GOI-100-12 | Power Maneuvering | Revision 35 |
| 3-OI-68 | Reactor Recirculation System | Revision 80 |
| 3-ARP-9-4B | Alarm Response Procedure Panel 3-9-4B | Revision 42 |
| 3-ARP-9-7A | Alarm Response Procedure Panel 3-9-7A | Revision 22 |
| 3-ARP-9-4C | Alarm Response Procedure Panel 3-9-4C | Revision 33 |
| 3-ARP-9-3B | Alarm Response Procedure Panel 3-9-3B | Revision 18 |
| TS 3.6.2.6 | Drywell-to-Suppression Chamber Differential Pressure | Amendment 212 |
| 3-EOI-3 | Secondary Containment Control Flowchart | Revision 9 |
| TS 3.5.1 | ECCS - Operating | Amendment 244 |
| TS 3.6.2.3 | Residual Heat Removal Suppression Pool Cooling | Amendment 230 |
| TS 3.6.2.4 | Residual Heat Removal Suppression Pool Spray | Amendment 212 |
| TS 3.6.2.5 | Residual Heat Removal Drywell Spray | Amendment 212 |
| 3-AOI-70-1 | Loss of Reactor Building Closed Cooling Water | Revision 16 |
| 3-EOI-1 | RPV Control Flowchart | Revision 8 |
| 3-EOI-2 | Primary Containment Control Flowchart | Revision 7 |
| 3-EOI-APPENDIX-11A | Alternate RPV Pressure Control Systems MSRVs | Revision 2 |
| 3-EOI-APPENDIX-5A | Injection Systems Lineup Condensate/Feedwater | Revision 5 |
| 3-EOI-APPENDIX-19 | H2/O2 Analyzer Operation | Revision 0 |
| 3-EOI-APPENDIX-12 | Primary Containment Venting | Revision 3 |
| 3-EOI-APPENDIX-17A | RHR System Operation Suppression Pool Cooling | Revision 5 |
| 3-EOI-APPENDIX-17C | RHR System Operation Suppression Chamber Sprays | Revision 6 |
| 3-EOI-APPENDIX-17B | RHR System Operation Drywell Sprays | Revision 5 |
| 3-EOI-3-C-2 | Emergency RPV Depressurization Flowchart | Revision 8 |

Procedures Used/Referenced Continued:

| Procedure Number | Procedure Title | Procedure Revision |
|-------------------------|--|---------------------------|
| 3-EOI-APPENDIX-6A | Injection Subsystems Lineup Condensate | Revision 2 |
| 3-EOI-APPENDIX-6D | Injection Subsystems Lineup Core Spray System I | Revision 3 |
| 3-EOI-APPENDIX-6E | Injection Subsystems Lineup Core Spray System II | Revision 3 |
| 3-EOI-APPENDIX-6C | Injection Subsystems Lineup RHR System II LPCI Mode | Revision 3 |
| EPIP-1 | Emergency Classification Procedure Event Classification Matrix | Revision 46 |
| EPIP-3 | Alert | Revision 33 |
| 3-AOI-100-1 | Reactor Scram | Revision 53 |

Console Operator Instructions

A. Scenario File Summary

1. File: batch and trigger files for scenario 3-B

Batch nrc2011b

#raw cooling water pump a clearance
ior zlohs247a[1] off

#surveillance 3.6.1.5 section 7.7
ior zlohs4314a[2] (e3 0) on
ior zlofcv4314[2] (e3 0) on
ior zloil641b6[1] (e3 0) off

#wide range pressure bypassed 3-207

#vfd cooling pump failure
ior zlohs682b2a[1] on
ior zlohs682b2a[2] off
mrf th18d trip
ior zdihs682b1a[1] (e1 0) off
trg 2 nrc2011bvfd
trg 2 = bat nrc2011b1

Trigger nrc2011bvfd
zdihs682b2a(3).eq.1

Batch nrc2011b1
mrf th18d close
dor zlohs682b2a[1]
dor zlohs682b2a[2]

#RBCCW pump trip
imf sw02a (e5 0)
ior zlohs7048a[1] off
ior zlohs7048a[2] on
trg 6 nrc20117048
trg 6 = bat nrc2011b2

Trigger nrc20117048
zdihs7048a[1].eq.1

Batch nrc2011b2
dor zlohs7048a[1]
dor zlohs7048a[2]

#Steam packing blower trip
ior ypomtrspea (e11 0) fail_control_power
ior ypovfcv6635 (e11 0) fail_power_now
ior zlohs6635a[1] on
trg 10 nrc2011spe
trg 10 = bat nrc2011spe

Trigger nrc2011spe
zdihs6635a[3].eq.1

Batch nrc2011spe
dor ypovfcv6635
dor zlohs6635a[1]

#RHR A leak
imf pc14 (e15 0) 10
ior xa554c[17] (e15 30) alarm_on
ior xa554c[24] alarm_off
ior xa554c[30] alarm_off
ior xa554c[31] alarm_off

#Major
imf th33a (e20 0) .8 15
imf tc02 (e20 0) 0
trg 25 nrc2011dwspray2
ior zdihs7475a[2] auto
imf th33b (e25 0) .5 180
imf rp07
imf ad03a
imf ad03b
imf ad03c
imf ad03d
imf ad03e
imf ad03f
ior xa553e[10] (e30 0) alarm_on
ior zdihs0123[1] close/auto
ior zdihs0130[1] close/auto
ior zdihs0131a[1] close/auto
ior zdihs0142[1] close/auto
ior zdihs0155a[2] auto
ior zdihs0156a[2] auto
ior zdihs0158a[2] auto
ior zdihs0159a[2] normal

Trigger nrc2011dwspray2
zdihs7474a(3).eq. 1

Console Operator Instructions

Scenario 3-B

| | | <u>DESCRIPTION/ACTION</u> |
|-----------------|------------|---|
| Simulator Setup | manual | Reset to IC 191 |
| Simulator Setup | Load Batch | Bat nrc2011b |
| Simulator Setup | manual | Place Green covers on Reactor Pressure indications two places. Verify 3-PI-3-207 bypassed |
| Simulator Setup | manual | Clearance out RCW Pump 3A |
| Simulator Setup | | Verify Batch file loaded, clear VFD alarms |

RCP required (90% - 95% w/Recirc flow) – Provide marked up copy of 3-GOI-100-12 and RCP for Urgent Load Reduction.

Marked up Copy of 3-SR-3.6.1.3.5, for section 7.6 and 7.7 performance.

Simulator Event Guide:

Event 1 Normal: Perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 IAW
3-SR-3.6.1.3.5 Section 7.6 and 7.7

| | | | | | | | | |
|---------------|-----------------|---|---------------|-----------------|----------------|-----------|--|-----|
| | SRO | Directs BOP to perform 3-SR-3.6.1.3.5, Section 7.6. | | | | | | |
| | BOP | Performs 3-SR-3.6.1.3.5, Section 7.6. | | | | | | |
| | | 7.6 3-FCV-43-13 Valve Stroke Timing | | | | | | |
| | | [1] RECORD the initial position of RX RECIRC SAMPLE INBD ISOLATION VLV, 3-FCV-43-13. OPEN / CLOSED (Circle one) | | | | | | |
| | | [2] On 3-LPNL-925-0009B (RB 621', near steps to Precoat Tank), PLACE REACTOR RECIRC SAMPLE INBD ISOL VLV, 3-HS-043-0013B OPEN position. | | | | | | |
| | Driver | When called 3-HS-043-0013B is in the OPEN position. | | | | | | |
| | | [3] VERIFY OPEN 3-FCV-43-13 using RX RECIRC SAMPLE INBD ISOLATION VLV, 3-HS-43-13A. | | | | | | |
| | | [4] CLOSE and TIME 3-FCV-43-13, using RX RECIRC SAMPLE INBD ISOLATION VLV, 3-HS-43-13A, and RECORD the closure time below. 3-FCV-43-13 Closure Time (Seconds) <table style="margin-left: 40px; border: none;"> <tr> <td style="padding-right: 20px;">Normal</td> <td style="padding-right: 20px;">Measured</td> <td>Maximum</td> </tr> <tr> <td>0.6 - 1.6</td> <td></td> <td>5.0</td> </tr> </table> | Normal | Measured | Maximum | 0.6 - 1.6 | | 5.0 |
| Normal | Measured | Maximum | | | | | | |
| 0.6 - 1.6 | | 5.0 | | | | | | |
| | | [5] VERIFY 3-FCV-43-13 closure time is less than or equal to the maximum closure time. | | | | | | |
| | NA | [6] IF the time recorded in step 7.6[4] is more than the maximum value listed, THEN (Otherwise N/A this section.) | | | | | | |
| | | [7] IF the stroke time measured in step 7.6[4] is less than or equal to the maximum stroke time but outside the normal range, THEN (Otherwise NA this section) | | | | | | |
| | | | | | | | | |

Simulator Event Guide:

Event 1 Normal: Perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 IAW
3-SR-3.6.1.3.5 Section 7.6 and 7.7

| | | | | | | | | |
|---------------|-----------------|---|---------------|-----------------|----------------|-----------|--|-----|
| | BOP | [8] RETURN 3-FCV-43-13, to the initial position recorded in Step 7.6[1], using RX RECIRC SAMPLE INBD ISOLATION VLV, 3-HS-43-13A. | | | | | | |
| | | [9] On 3-LPNL-925-0009B (RB 621', near steps to Precoat Tank), PLACE REACTOR RECIRC SAMPLE INBD ISOL VLV, 3-HS-043-0013B to the CLOSE position. | | | | | | |
| | Driver | When called 3-HS-043-0013B is in the CLOSE position. | | | | | | |
| | | 7.7 3-FCV-43-14 Valve Stroke Timing | | | | | | |
| | | [1] RECORD the initial position of RX RECIRC SAMPLE OUTBD ISOLATION VLV, 3-FCV-43-13. OPEN / CLOSED (Circle one) | | | | | | |
| | | [2] On 3-LPNL-925-0009B (RB 621', near steps to Precoat Tank), PLACE REACTOR RECIRC SAMPLE OUTBD ISOL VLV, 3-HS-043-0014B to the OPEN position. | | | | | | |
| | Driver | When called 3-HS-043-0014B is in the OPEN position. | | | | | | |
| | | [3] VERIFY OPEN 3-FCV-43-14 using RX RECIRC SAMPLE OUTBD ISOLATION VLV, 3-HS-43-14A. | | | | | | |
| | Driver | When Valve 3-FCV-43-14 is open insert Trigger 3 and prepare to delete the 3 overrides on trigger 3. When 3-FCV-43-14 is closed wait a minimum of 5 seconds and then delete the 3 overrides so that 43-14 exceeds the maximum stroke time. | | | | | | |
| | | [4] CLOSE and TIME 3-FCV-43-14, using RX RECIRC SAMPLE OUTBD ISOLATION VLV, 3-HS-43-14A, and RECORD the closure time below. 3-FCV-43-14 Closure Time (Seconds) <table border="0" style="margin-left: 40px;"> <tr> <td style="padding-right: 40px;">Normal</td> <td style="padding-right: 40px;">Measured</td> <td>Maximum</td> </tr> <tr> <td>0.4 - 1.4</td> <td></td> <td>5.0</td> </tr> </table> | Normal | Measured | Maximum | 0.4 - 1.4 | | 5.0 |
| Normal | Measured | Maximum | | | | | | |
| 0.4 - 1.4 | | 5.0 | | | | | | |
| | | [5] VERIFY 3-FCV-43-14 closure time is less than or equal to the maximum closure time. | | | | | | |
| | SRO | [6] IF the time recorded in step 7.7[4] is more than the maximum value listed, THEN DECLARE the valve INOPERABLE | | | | | | |
| | BOP | Report Failure of 3-FCV-43-14 to stroke close within the Maximum allowed time. | | | | | | |
| | | | | | | | | |
| | | | | | | | | |
| | | | | | | | | |

Simulator Event Guide:

Event 1 Normal: Perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 IAW
3-SR-3.6.1.3.5 Section 7.6 and 7.7

| | | |
|--|-----|---|
| | | |
| | SRO | Dispatches personnel to investigate. |
| | | Refer to Technical Specification 3.6.1.3. |
| | | <p>Condition A: NOTE Only applicable to penetration flow paths with two PCIVs. One or more penetration flow paths with one PCIV inoperable except due to MSIV leakage not within limits.</p> <p>Required Action A.1: Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p>Required Action A.2 : Verify the affected penetration flow path is isolated.</p> <p>Completion Time : 4 hours except for main steam line and Once per 31 days for isolation devices outside primary containment</p> |
| | | |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Flow

| | | |
|--|---------------|---|
| | SRO | Notifies ODS of power increase. |
| | | Direct Power increase using Recirc Flow, per 3-GOI-100-12. [21] WHEN desired to restore Reactor power to 100%, THEN PERFORM the following, as directed by Unit Supervisor and recommended by the Reactor Engineer: <ul style="list-style-type: none"> • RAISE power using control rods or core flow changes. REFER TO 3-SR-3.3.5(A) and 3-OI-68. |
| | ATC | Raise Power w/Recirc, IAW 3-OI-68, Section 6.2 |
| | | [1] IF desired to control Recirc Pumps 3A and/or 3B speed with Recirc Individual Control, THEN PERFORM the following: <ul style="list-style-type: none"> • Raise Recirc Pump 3A using, RAISE SLOW (MEDIUM), 3-HS-96-15A(15B). <p>AND/OR</p> <ul style="list-style-type: none"> • Raise Recirc Pump 3B using, RAISE SLOW (MEDIUM), 3-HS-96-16A(16B). |
| | | [2] WHEN desired to control Recirc Pumps 3A and/or 3B speed with the RECIRC MASTER CONTROL, THEN ADJUST Recirc Pump speed 3A & 3B using the following push buttons as required: <p style="text-align: center;">RAISE SLOW, 3-HS-96-31 RAISE MEDIUM, 3-HS-96-32</p> |
| | NRC | When satisfied with Reactivity Manipulation, VFD Cooling Water Pump Failure. |
| | DRIVER | When directed by lead examiner, Trigger 1 VFD Cooling Water Pump Failure. |
| | | |

Simulator Event Guide:

Event 3 Component: VFD Cooling Water Pump 3-B-1 Failure

| | | |
|--|---------------|---|
| | ATC | Reports the following annunciators 4B-12, 28 and 32 RECIRC DRIVE 3B COOLANT FLOW LOW, RECIRC DRIVE 3B DRIVE ALARM and RECIRC DRIVE 3B PROCESS ALARM. |
| | ATC | Reports the 3-B-1 VFD Cooling Water Pump for the B Recirc Pump, has tripped. |
| | ATC | Reports Standby Recirc Drive Cooling Water Pump3-B-2, failed to auto start. |
| | ATC | RECIRC DRVIE 3B COOLANT FLOW LOW STARTS RECIRC DRIVE cooling water pump and DISPATCHES personnel to the RECIRC DRIVE, to check the operation of the Recirc Drive cooling water system. |
| | SRO | Concurs with start of Standby VFD Pump. |
| | BOP | RECIRC DRIVE 3B DRIVE ALARM A. REFER TO ICS Group Display “GD @VFDBDA” and determine cause of alarm. B. IF a problem with the cooling water system is indicated, THEN VERIFY proper operation of cooling water system. C. IF the problem is conductivity in the cooling water system, THEN VERIFY demineralizer is in service. D. IF a problem with power supplies is indicated, THEN VERIFY all the low voltage supply breakers are CLOSED/ON. E. For all other alarms, or any problems encountered CONTACT system engineering. |
| | Crew | Verifies Standby pump started by pulling up ICS displays. |
| | BOP | Dispatches personnel to VFD. |
| | DRIVER | Wait 4 minutes after dispatched, THEN report tripped VFD Pump is hot to touch, internal bkr closed, 480 volt bkr tripped (480 V SD BD 3A-5D). |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 11 for Steam Packing Exhauster trip |

Simulator Event Guide:

Event 4 Component: SPE Packing Exhauster A Trip

| | | |
|--|---------------|---|
| | BOP | Responds to Alarm 7A-12, Steam Packing Exhauster Vacuum Low. |
| | | 7A-12, Steam Packing Exhauster Vacuum Low Automatic Action: Alternate SPE fan starts and discharge damper opens, and the running fans trips. |
| | | A. CHECKS the following: 1. Alternate STEAM PACKING EXHR BLOWER 3B, 3-HS-66-50A started. 2. 3B DISCHARGE VLV, 3-HS-66-34A opens. |
| | BOP | Determines that Alternate Blower started, but discharge damper fails to open. |
| | | Opens 3B DISCHARGE VLV, 3-HS-66-34A to restore SPE Vacuum. |
| | NRC | NOTE: SPE B Blower indication will have "Red and Green" lights. In order for "Red" light only indication, the crew would have to stop the A SPE. IAW 3-OI-47C |
| | DRIVER | When dispatched, wait 5 minutes and report no obvious problems at SPE or Breaker. |
| | | |
| | NRC | When ready, RHR A Leak. |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 15 for RHR A Leak. |

Simulator Event Guide:

Event 5 Component: RHR A Leak

| | |
|---------------|---|
| BOP/ATC | <p>Respond to Alarm 4C-17 RHR LOOP I PUMP ROOM FLOOD LEVEL HIGH,</p> <p>A. DISPATCH personnel to visually check the RHR pump room.</p> <p>B. IF alarm is valid, THEN PERFORM the following</p> <ul style="list-style-type: none"> • VERIFY the floor drain sump pumps running. • VERIFY the floor drains for proper drainage. • IF possible, THEN DETERMINE the source of the leak and the leak rate. • ENTER 3-EOI-3 FLOWCHART. |
| BOP/ATC | <p>Respond to Alarm 3B-26, DRYWELL TO SUPPR CHAMBER DIFF PRESS ABNORMAL</p> <p>A. CHECK alarm by checking Drywell to Suppression Chamber DP.</p> <p>B. REFER TO 1-AOI-64-1.</p> <p>C. REFER TO Tech Spec Section 3.6.2.6.</p> |
| BOP/ATC | <p>Dispatches personnel to RHR Loop 1 area.</p> |
| SRO | <p>Evaluates Tech Spec 3.6.2.6 and Enters EOI-3.</p> |
| DRIVER | <p>3 minutes after dispatched, report leak is on the common minimum flow line for RHR Pumps A and C, the leak is between the pumps and the Min Flow Valve; appears leak was caused by maintenance work in the area. When the crew closes 74-1 and 74-12 report leak has stopped and change PC14 to 0. Cannot access any manual valves due to amount of water spray. If only one of the RHR Suppression Pool Suction Valves is closed, report that leak has not slowed. In addition, report water level is about 8 inches in this quad and there is water flowing over the weir; into the suppression chamber area.</p> |
| BOP/ATC | <p>Respond to Alarm 4C-3, SUPPR CHMB RM FLOOD LEVEL HIGH</p> <p>A. DISPATCH personnel to VISUALLY CHECK the suppression chamber room.</p> <p>B. IF alarm is valid, THEN PERFORM the following:</p> <ul style="list-style-type: none"> • CHECK the floor drain sump pumps running. • CHECK the floor drains for proper drainage. • IF possible, THEN DETERMINE the source of the leak and the leak rate. • ENTER 3-EOI-3 FLOWCHART. |
| SRO | <p>When leak source is reported, directs BOP to close 74-1 and 74-12, RHR Pump 3A and 3C Suppression Pool Suction Valves.</p> |
| BOP | <p>Closes 74-1 and 74-12, RHR Pump 3A and 3C Suppression Pool Suction Valves.</p> |
| DRIVER | <p>If contacted to rack out RHR Pumps 3A and 3C, Wait 20 minutes then go to Component Overrides and insert PMP-74-5A fail now AND PMP-74-16A fail now and report back</p> |

Simulator Event Guide:

Event 5 Component: RHR A Leak

| | | |
|--|---------------|---|
| | SRO | EOI-3 (Secondary Containment Water Level) |
| | | Monitor and Control Secondary CNTMT Water Levels. |
| | | Answers Yes to: Is Any Area Water Level Above 2 inches? Answers Yes to: Is Any Floor Drain Sump Water Level Above 66 inches? |
| | | Restores and Maintains floor drain sump levels and area water levels, using all available sump pumps. |
| | | When source of leak is determined and isolated, Answers Yes to: Can all floor drain and area water levels be restored and maintained? |
| | BOP/ATC | Contacts Radwaste to determine status of sump Pumps. |
| | DRIVER | After 74-1 and 74-12 are isolated, REPORT sump pumps are operating normally, in area of alarm. DELETE override on alarm for xa554c[17] alarm on |
| | SRO | EOI-3 (Temperature) |
| | | Monitor and Control Secondary Containment Temperatures. |
| | | Operate all available ventilation. (Appendix 8F) Defeat isolation interlocks, as necessary. (Appendix 8E) |
| | | Answers NO to: Is Any Area Temperature Above Max Normal? |
| | SRO | EOI-3 (Radiation) |
| | | Monitor and Control Secondary CNTMT Radiation Levels. |
| | | Answers NO to: Is Any Area Radiation Level Above Max Normal? |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 5 for Loss of RBCCW. |

Simulator Event Guide:

Event 5 Component: RHR A Leak

| | | |
|--|---------------|---|
| | SRO | Refer to Technical Specification 3.5.1, 3.6.2.3, 3.6.2.4, 3.6.2.5, and 3.6.2.6 |
| | | <p>TS 3.5.1 Condition A: One low pressure ECCS injection/spray subsystem inoperable. Required Action A.1: Restore low pressure ECCS injection/spray subsystem to Operable status. Completion Time: 7 Days</p> |
| | | <p>TS 3.6.2.3 Condition B: Two RHR suppression pool cooling subsystems inoperable. Required Action B.1: Restore one RHR suppression pool cooling subsystem to Operable status. Completion Time: 7 Days</p> |
| | | <p>TS 3.6.2.4 Condition B: Two RHR suppression pool spray subsystems inoperable. Required Action B.1: Restore one RHR suppression pool spray subsystem to Operable status. Completion Time: 7 Days</p> |
| | | <p>TS 3.6.2.5 Condition B: Two RHR drywell spray subsystems inoperable. Required Action B.1: Restore one RHR drywell spray subsystem to Operable status. Completion Time: 7 Days</p> |
| | | TS 3.6.2.6: No Entry required |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 5 for Loss of RBCCW. |

Simulator Event Guide:

Event 6 Component: Loss of RBCCW Pump 3A

| | | |
|--|---------------|--|
| | BOP/ATC | Responds to alarm 4C-12, RBCCW PUMP DISCH. HDR PRESS LOW Report Trip of RBCCW Pump 3A. |
| | BOP/ATC | Automatic Action: Closes 3-FCV-70-48, non-essential loop, closed cooling water sectionalizing MOV. A. VERIFY 3-FCV-70-48 CLOSING/CLOSED. B. VERIFY RBCCW pumps A and B in service. C. VERIFY RBCCW surge tank low level alarm is reset. D. DISPATCH personnel to check the following: <ul style="list-style-type: none"> • RBCCW surge tank level locally. • RBCCW pumps for proper operation. E. REFER TO 3-AOI-70-1, for RBCCW System failure and 3-OI-70, for starting spare pump. |
| | SRO | Enters 3-AOI-70-1. |
| | ATC | Closes 3-FCV-70-48 and report the sectionalizing valve failed to close automatically |
| | BOP | Dispatch Personnel to investigate RBCCW Pump 3A trip |
| | DRIVER | When dispatched, report RBCCW Pump 3A breaker is tripped free. There is also a smell of burnt wiring and charring on the breaker. |
| | ATC | 3-AOI-70-1 |
| | | 4.1 Immediate Actions [1] IF RBCCW Pump(s) has tripped, THEN Perform the following <ul style="list-style-type: none"> • SECURE RWCU Pumps. • VERIFY RBCCW SECTIONALIZING VLV, 3-FCV-70-48 CLOSED. |
| | ATC | Secures RWCU Pumps and Closes 3-FCV-70-48. |
| | | |
| | | |

Simulator Event Guide:

Event 6 Component: Loss of RBCCW Pump 3A

| | | |
|--|---------------|--|
| | | <p>4.2 Subsequent Actions</p> <p>[1] IF Reactor is at power AND Drywell Cooling cannot be immediately restored, AND core flow is above 60%, THEN: (Otherwise N/A):</p> <p>[2] IF any EOI entry condition is met, THEN ENTER appropriate EOI(s) (Otherwise N/A).</p> |
| | | Step 1 and 2 are NA |
| | | <p>[3] IF RBCCW Pump(s) has tripped and it is desired to restart the tripped RBCCW pump, THEN PERFORM the following (Otherwise N/A):</p> <p>[3.1] INSPECT the tripped RBCCW pump and its associated breaker for any damage or abnormal conditions.</p> <p>[3.2] IF no damage or abnormal conditions are found, THEN ATTEMPT to restart tripped RBCCW pump(s).</p> |
| | DRIVER | When dispatched, report RBCCW Pump 3A breaker is tripped. There is also a smell of burnt wiring and charring on the breaker. |
| | SRO | [4] IF unable to restart a tripped pump, THEN PLACE Spare RBCCW Pump in service. REFER TO 3-OI-70. Direct Unit 1 to place Spare RBCCW Pump in service |
| | DRIVER | When called to place spare RBCCW Pump in service, wait 3 minutes (IRF SW02). THEN inform Unit 3 Operator that spare RBCCW Pump is in service. |
| | SRO | <p>[5] IF RBCCW flow was restored to two pump operation by placing the Spare RBCCW pump in service in the preceding step, THEN PERFORM the following:</p> <p>[5.1] REOPEN RBCCW SECTIONALIZING VLV, 3-HS-70-48A.</p> <p>[5.2] RESTORE the RWCU system to operation. (REFER TO 3-OI-69)</p> <p>Directs ATC or BOP to Open Sectionalizing Valve and Restore RWCU.</p> |
| | ATC | Opens Sectionalizing Valve, 3-FCV-70-48. |
| | NRC | When Ready, Major Main Steam Line Leak inside Containment. |
| | DRIVER | Upon Lead examiner direction, initiate Trigger 20 for Main Steam Line Leak inside Containment. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|-------------|--|
| | Crew | Recognize rising Drywell Pressure and Temperature. |
| | SRO | Directs a Reactor Scram, prior to 2.4 psig in the Drywell. |
| | ATC | Manually scrams the reactor. |
| | CT#2 | Reports RPS failed to de-energize and initiates one channel of ARI. |
| | CT#2 | Verifies all Rods In, on ARI Initiation. |
| | SRO | Enters EOI-1 and EOI-2. |
| | SRO | EOI-1 (Reactor Pressure) |
| | | Monitor and Control Reactor Pressure |
| | | IF Drywell Pressure Above 2.4 psig? – YES, but action Not Required |
| | | IF Emergency Depressurization is Anticipated and the Reactor will remain subcritical without boron under all conditions, THEN Rapidly depressurize the RPV with the Main Turbine Bypass Valves irrespective of cooldown rate? - NO |
| | | IF Emergency Depressurization is required THEN exit RC/P and enter C2 Emergency Depressurization? - NO |
| | | IF RPV water level cannot be determined? – NO |
| | | |

Simulator Event Guide:

Event 8 Component: Bypass Valves Fail Closed

| | | |
|--|---------|--|
| | ATC/BOP | Report failure of Bypass Valves to control Reactor Pressure |
| | | Is any MSRV Cycling? – YES - Direct Manually open MSRVs until RPV Pressure drops to the pressure at which all turbine bypass valves are open. (Appendix 11A) |
| | | IF Steam cooling is required? - NO |
| | | IF Suppression Pool level and temperature cannot be maintained in the safe area of Curve 3?- NO |
| | | IF Suppression Pool level cannot be maintained in the safe area of Curve 4? - NO |
| | | IF Drywell Control air becomes unavailable? - NO |
| | | IF Boron injection is required? - NO |
| | SRO | Directs a Pressure Band with SRVs, IAW Appendix 11A. Should begin to lower Reactor Pressure, not to exceed 100° cooldown. |
| | | Control Reactor Pressure in assigned band, IAW Appendix 11A. |

Simulator Event Guide:

Event 8 Component: Bypass Valves Fail Closed

| ATC/BOP | Pressure Control IAW Appendix 11A, RPV Pressure Control SRVs |
|---------|--|
| | 1. IF Drywell Control Air is NOT available, THEN EXECUTE EOI Appendix 8G, CROSSTIE CAD TO DRYWELL CONTROL AIR, CONCURRENTLY with this procedure. |
| | 2. IF Suppression Pool level is at or below 5.5 ft, THEN CLOSE MSRVs and CONTROL RPV pressure using other options. |
| | 3. OPEN MSRVs, using the following sequence, to control RPV pressure as directed by SRO: |
| | a. 3-PCV-1-179 MN STM LINE A RELIEF VALVE works |
| | b. 3-PCV-1-180 MN STM LINE D RELIEF VALVE. works |
| | c. 3-PCV-1-4 MN STM LINE A RELIEF VALVE works |
| | d. 3-PCV-1-31 MN STM LINE C RELIEF VALVE does not work |
| | e. 3-PCV-1-23 MN STM LINE B RELIEF VALVE does not work |
| | f. 3-PCV-1-42 MN STM LINE D RELIEF VALVE does not work |
| | g. 3-PCV-1-30 MN STM LINE C RELIEF VALVE does not work |
| | h. 3-PCV-1-19 MN STM LINE B RELIEF VALVE. does not work |
| | i. 3-PCV-1-5 MN STM LINE A RELIEF VALVE. does not work |
| | j. 3-PCV-1-41 MN STM LINE D RELIEF VALVE does not work |
| | k. 3-PCV-1-22 MN STM LINE B RELIEF VALVE does not work |
| | l. 3-PCV-1-18 MN STM LINE B RELIEF VALVE does not work |
| | m. 3-PCV-1-34 MN STM LINE C RELIEF VALVE does not work |
| | |
| | |

Simulator Event Guide:

Event 8 Component: Bypass Valves Fail Closed

| | | |
|--|---------|--|
| | | |
| | | |
| | | |
| | | |
| | SRO | EOI-1 RPV Pressure – Augment RPV Pressure control, as necessary; with one or more of the following depressurization systems: HPCI Appendix 11C, RCIC Appendix 11B, RFPTs on minimum flow Appendix 11F, Main Steam System Drains Appendix 11D, Steam Seals Appendix 11G, SJAEs Appendix 11G, Off Gas Preheater Appendix 11G, RWCU Appendix 11E. |
| | ATC/BOP | Augments RPV Pressure Control, if directed by SRO. |
| | | |
| | | |
| | SRO | EOI-1 (Reactor Level) |
| | | Monitor and Control Reactor Water Level. Directs Verification of PCIS isolations. |
| | ATC/BOP | Verifies PCIS isolations. |
| | SRO | Restores and Maintains RPV Water Level between (+) 2 to (+) 51 inches with one or more of the following injection sources. (Condensate and Feedwater, Appendix 5A) |
| | ATC | Maintains the prescribed level band, IAW Appendix 5A. |
| | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | ATC | Maintains the prescribed level band IAW Appendix 5A |
|--|-----|---|
| | | <ol style="list-style-type: none"> 1. IF It is desired to use a reactor feed pump that is in operation, THEN CONTINUE at step 12 to control the operating pump. 2. VERIFY Condensate system in service, supplying suction to RFPs. 3. VERIFY OPEN 3-FCV-1-125(133)(141), RFPT 3A(3B)(3C) HP STEAM SUPPLY VALVE. 4. DEPRESS 3-HS-46-8A(9A)(10A), RFPT 3A(3B)(3C) SPEED CONT RAISE/LOWER, and VERIFY amber light is illuminated. 5. VERIFY a Main Oil Pump is running for RFPT to be started. 6. VERIFY that the green light is illuminated and the red light is extinguished above the following on Panel 3-9-5 <ul style="list-style-type: none"> • 3-HS-3-208A, RX WTR LVL CH A HI RFPT/MT TRIP RESET • 3-HS-3-208B, RX WTR LVL CH B HI RFPT/MT TRIP RESET. |
| | | <ol style="list-style-type: none"> 7. VERIFY OPEN the following valves: <ul style="list-style-type: none"> • 3-FCV-3-75, HP HTR 3A1 FW OUTLET ISOL VLV • 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VLV • 3-FCV-3-77, HP HTR 3C1 FW OUTLET ISOL VLV 8. DEPRESS 3-HS-3-124A(150A)(175A), RFPT 3A(3B)(3C) TRIP RESET, and VERIFY that the turbine trip is RESET. |
| | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|-----|--|
| | ATC | Maintains the prescribed level band, IAW Appendix 5A. |
| | | 9. VERIFY OPEN 3-FSV-3-20(13)(6), RFP 3A(3B)(3C) MIN FLOW VALVE. |
| | | 10. PLACE 3-HS-46-112A(138A)(163A), RFPT 3A(3B)(3C) START/LOCAL ENABLE, in START, AND VERIFY RFPT speed increases to approximately 600 rpm. |
| | | 11. VERIFY OPEN 3-FCV-3-19(12)(5), RFP 3A(3B)(3C) DISCHARGE VALVE. |
| | | 12. SLOWLY ADJUST RFPT speed UNTIL feedwater flow to the RPV is indicated, using ANY of the following methods on Panel 3-9-5: <ul style="list-style-type: none"> • Individual 3-HS-46-8A(9A)(10A), RFPT 3A(3B)(3C) SPEED CONT RAISE/LOWER switch in MANUAL GOVERNOR, OR • Individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in MANUAL, OR • 3-LIC-46-5, REACTOR WATER LEVEL CONTROL, in MANUAL with individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in AUTO. |
| | | 13. ADJUST RFPT speed as necessary to control injection, using the methods of step 12. |
| | | 14. WHEN RPV level is approximately equal to desired level AND automatic level control is desired, THEN PLACE 3-LIC-46-5, REACTOR WATER LEVEL CONTROL, in AUTO with individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in AUTO. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|-----|---|
| | SRO | Enters EOI-2 all legs, |
| | | EOI-2 (Drywell Temperature) |
| | SRO | Monitor and Control DW Temp Below 160°F, using available DW Cooling. |
| | | Can Drywell Temp Be Maintained Below 160°F? - NO |
| | | |
| | SRO | Directs H2O2 Analyzers placed in service, IAW Appendix 19. |
| | BOP | Places H2O2 analyzers in service, IAW Appendix 19. |
| | | |
| | SRO | EOI-2 (Primary Containment Pressure) Monitor and Control PC Pressure Below 2.4 psig, Using the Vent System As Necessary. (Appendix 12) |
| | SRO | Directs venting of Primary Containment, per Appendix 12. |
| | | Can PC Pressure Be Maintained Below 2.4 psig? - NO |
| | | Vents Primary Containment, IAW Appendix 12. |
| | | |
| | | EOI-2 (Suppression Pool Temperature) |
| | | Monitor and Control Suppression Pool Temperature Below 95°F, Using Available Suppression Pool Cooling As Necessary. (Appendix 17A) |
| | | Can Suppression Pool Temperature Be Maintained Below 95°F? - NO |
| | ATC | Places Suppression Pool Cooling in service, IAW Appendix 17A. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | SRO | EOI-2 (Suppression Pool Level) |
|--|-----|---|
| | | Monitor and Control Suppression Pool Level between (-) 1 inch and (-) 6 inches. (Appendix 18) |
| | | Can Suppression Pool Level Be Maintained above (-) 6 inches? - YES |
| | | Can Suppression Pool Level Be Maintained below (-) 1 inch? - YES |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| BOP | Places H2O2 analyzers in service, IAW Appendix 19. |
|-----|--|
| | <ol style="list-style-type: none"> 1. IF A Group 6 PCIS signal exists, THEN PLACE 3-HS-76-69, H2/O2 ANALYZER ISOLATION BYPASS switch in BYPASS (Panel 3-9-54). 2. DEPRESS 3-HS-76-91, H2/O2 ANALYZER ISOLATION RESET. 3. IF H2/O2 Analyzer is to sample the Suppression Chamber, THEN ALIGN Analyzer as follows (Panel 3-9-54): <ol style="list-style-type: none"> a. PLACE 3-HS-76-110, H2/O2 ANALYZER DW/SUPPR CHBR SELECT in SUPPR CHBR position. b. VERIFY SUPPR CHBR SMPL VLVS 3-FSV-76-55/56 OPEN using 3-IL-76-49-1. c. VERIFY OPEN SMPL RTN VLVS 3-FSV-76-57/58 using 3-IL-76-49-3. 4. IF H2/O2 Analyzer is to sample the Drywell, THEN ALIGN Analyzer as follows (Panel 3-9-54): <ol style="list-style-type: none"> a. PLACE 3-HS-76-110, H2/O2 ANALYZER DW/SUPPR CHBR SELECT in DRYWELL position. b. VERIFY OPEN DRYWELL SMPL VLVS 3-FSV-76-49/50 using 3-IL-76-49-2. c. VERIFY OPEN SMPL RTN VLVS 3-FSV-76-57/58 using 3-IL-76-49-3. |
| | |
| | |
| | |
| | |
| | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| BOP | Places H2O2 analyzers in service, IAW Appendix 19. |
|-----|---|
| | <p>5. IF H2/O2 Analyzer was in service prior to sample path isolation (Panel 3-9-55), THEN RETURN H2/O2 Analyzer to service as follows:</p> <ul style="list-style-type: none"> a. TOUCH 3-MON-76-110 display screen if required to restore display. b. DEPRESS flashing FLOW / O/P RESET soft key in upper right quarter of the MAIN ("2 GAS MONITORING") screen. <p>6. IF H2/O2 Analyzer is in STANDBY at 3-MON-76-110 (Panel 3-9-55), THEN PLACE H2/O2 Analyzer in service at as follows:</p> <ul style="list-style-type: none"> a. TOUCH 3-MON-76-110 display screen. b. DEPRESS Go To Panel PROCESS VALUES soft key. c. DEPRESS Go To Panel MAINT MENU soft key. d. DEPRESS LOG ON soft key. e. ENTER password 1915 on soft keypad. f. DEPRESS ENT soft key on keypad. g. DEPRESS STANDBY MODE ON soft key to enable sample pump operation. h. VERIFY soft key reads STANDBY MODE OFF. i. DEPRESS Go To Panel PROCESS VALUES soft key. j. DEPRESS Go To Panel MAIN soft key. k. VERIFY STANDBY MODE is NOT displayed. |
| | <p>7. VERIFY H2/O2 ANALYZER SAMPLE PUMP running using 3-XI-76-110 (Panel 3-9-55).</p> <p>8. VERIFY red LOW FLOW indicating light extinguished at 3-MON-76-110, H2/O2 ANALYZER (Panel 3-9-55).</p> |
| | <p>9. WHEN H2/O2 Analyzer has been aligned and sampling for 10 minutes or greater, THEN OBTAIN H2 and O2 readings from 3-XR-76-110 H2/O2 CONCENTRATION recorder (Panel 3-9-54).</p> |
| | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|-----|--|
| | BOP | Vents Primary Containment IAW Appendix 12 |
| | | <p>1. VERIFY at least one SGTS train in service.</p> <p>2. VERIFY CLOSED the following valves (Panel 3-9-3 or Panel 3-9-54):</p> <ul style="list-style-type: none"> • 3-FCV-64-31, DRYWELL INBOARD ISOLATION VLV, • 3-FCV-64-29, DRYWELL VENT INBD ISOL VALVE, • 3-FCV-64-34, SUPPR CHBR INBOARD ISOLATION VLV, • 3-FCV-64-32, SUPPR CHBR VENT INBD ISOL VALVE. |
| | | Steps 3, 4, 5 and 6 are If / Then steps that do not apply. |
| | | <p>7. CONTINUE in this procedure at: Step 8 to vent the Suppression Chamber through 3-FCV-84-19, OR Step 9 to vent the Suppression Chamber through 3-FCV-84-20.</p> |
| | | <p>8. VENT the Suppression Chamber using 3-FIC-84-19, PATH B VENT FLOW CONT, as follows:</p> <ol style="list-style-type: none"> a. PLACE keylock switch 3-HS-84-35, DW/SUPPR CHBR VENT ISOL BYP SELECT, to SUPPR-CHBR position (Panel 3-9-54). b. VERIFY OPEN 3-FCV-64-32, SUPPR CHBR VENT INBD ISOL VALVE (Panel 3-9-54). c. PLACE 3-FIC-84-19, PATH B VENT FLOW CONT, in AUTO with setpoint at 100 scfm (Panel 3-9-55). d. PLACE keylock switch 3-HS-84-19, 3-FCV-84-19 CONTROL, in OPEN (Panel 3-9-55). e. VERIFY 3-FIC-84-19, PATH B VENT FLOW CONT, is indicating approximately 100 scfm. f. CONTINUE in this procedure at step 12. |
| | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------------|--|
| | BOP | Vents Primary Containment IAW Appendix 12 |
| | | <p>9. VENT the Suppression Chamber using 3-FIC-84-20, PATH A VENT FLOW CONT, as follows:</p> <ul style="list-style-type: none"> a. VERIFY OPEN 3-FCV-64-141, DRYWELL DP COMP BYPASS VALVE (Panel 3-9-3). b. PLACE keylock switch 3-HS-84-36, SUPPR CHBR/DW VENT ISOL BYP SELECT, to SUPPR-CHBR position (Panel 3-9-54). c. VERIFY OPEN 3-FCV-64-34, SUPPR CHBR INBOARD ISOLATION VLV (Panel 3-9-54). d. VERIFY 3-FIC-84-20, PATH A VENT FLOW CONT, in AUTO with setpoint at 100 scfm (Panel 3-9-55). e. PLACE keylock switch 3-HS-84-20, 3-FCV-84-20 ISOLATION BYPASS, in BYPASS (Panel 3-9-55). f. VERIFY 3-FIC-84-20, PATH A VENT FLOW CONT, is indicating approximately 100 scfm. g. CONTINUE in this procedure at step 12. |
| | | <p>12. ADJUST 3-FIC-84-19, PATH B VENT FLOW CONT, or 3-FIC-84-20, PATH A VENT FLOW CONT, as applicable, to maintain ALL of the following:</p> <p>Stable flow as indicated on controller, AND 3-PA-84-21, VENT PRESS TO SGT HIGH, alarm light extinguished, AND Release rates as determined below:</p> <ul style="list-style-type: none"> iii. IF Venting for ANY other reason than items i or ii above, THEN MAINTAIN release rates below Stack release rate of $1.4 \times 10^7 \mu\text{Ci/s}$ AND 0-SI-4.8.B.1.a.1 release fraction of 1. |
| | DRIVER | Acknowledges Notification. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| ATC | Place Suppression Pool Cooling in service IAW Appendix 17A |
|-----|---|
| | <p>1. IF Adequate core cooling is assured, OR Directed to cool the Suppression Pool irrespective of adequate core cooling, THEN BYPASS LPCI injection valve auto open signal as necessary; by PLACING 3-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS.</p> |
| | <p>2. PLACE RHR SYSTEM II in Suppression Pool Cooling as follows:</p> <ul style="list-style-type: none"> a. VERIFY at least one RHRSW pump supplying each EECW header. b. VERIFY RHRSW pump supplying desired RHR Heat Exchanger(s). c. THROTTLE the following in-service RHRSW outlet valves to obtain between 1350 and 4500 gpm RHRSW flow: <ul style="list-style-type: none"> • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV • 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV d. IF Directed by SRO, THEN PLACE 3-XS-74-130, RHR SYS II LPCI 2/3 CORE HEIGHT OVRD in MANUAL OVERRIDE. e. IF LPCI INITIATION Signal exists, THEN MOMENTARILY PLACE 3-XS-74-129, RHR SYS II CTMT SPRAY/CLG VLV SELECT in SELECT. |
| | <ul style="list-style-type: none"> f. IF 3-FCV-74-67, RHR SYS II LPCI INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 3-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE. g. OPEN 3-FCV-74-71, RHR SYS II SUPPR CHBR/POOL ISOL VLV. h. VERIFY desired RHR pump(s) for Suppression Pool Cooling are operating. |
| | <ul style="list-style-type: none"> i. THROTTLE 3-FCV-74-73, RHR SYS II SUPPR POOL CLG/TEST VLV, to maintain EITHER of the following as indicated on 3-FI-74-64, RHR SYS II FLOW: <ul style="list-style-type: none"> • Between 7000 and 10000 gpm for one-pump operation. <li style="text-align: center;">OR • At or below 13000 gpm for two-pump operation. j. VERIFY CLOSED 3-FCV-74-30, RHR SYSTEM II MIN FLOW VALVE. k. MONITOR RHR Pump NPSH using Attachment 1. |
| | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|-----|--|
| | SRO | Can Drywell Temp Be Maintained Below 160°F? - NO |
| | | Operate all available Drywell Cooling. |
| | | Before DW Temperature rises to 200°F, Continue |
| | | EOI-1 RPV Control and SCRAM the Reactor |
| | | Before DW Temperature rises to 280°F, Continue Stops at STOP sign. |
| | | |
| | SRO | EOI-2 Primary Containment Pressure |
| | | Before Suppression Chamber Pressure rises to 12 psig, Continue |
| | | Initiate Suppression Chamber Sprays, Using only pumps not required to assure adequate core cooling by continuous injection. (Appendix 17C) |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------|---|
| | SRO | Directs Operator to initiate Suppression Chamber Sprays, IAW Appendix 17C. |
| | ATC/BOP | Initiates Suppression Chamber Sprays, IAW Appendix 17C. |
| | ATC/BOP | <ol style="list-style-type: none"> 1. BEFORE Suppression Chamber pressure drops below 0 psig, CONTINUE in this procedure at Step 6. 2. IF Adequate core cooling is assured, OR Directed to spray the Suppression Chamber irrespective of adequate core cooling, THEN BYPASS LPCI injection valve auto open signal as necessary by PLACING 3-HS-74-155A(B), LPCI SYS I(II) OUTBD INJ VLV BYPASS SEL in BYPASS. |
| | | Step 3 and 4 are NA. |
| | | <ol style="list-style-type: none"> 5. INITIATE Suppression Chamber Sprays as follows: <ol style="list-style-type: none"> a. VERIFY at least one RHRSW pump supplying each EECW header. b. IF EITHER of the following exists: <ul style="list-style-type: none"> • LPCI Initiation signal is NOT present, OR • Directed by SRO, THEN PLACE keylock switch 3-XS-74-122(130), RHR SYS II LPCI 2/3 CORE HEIGHT OVRD, in MANUAL OVERRIDE. c. MOMENTARILY PLACE 3-XS-74-129, RHR SYS II CTMT SPRAY/CLG VLV SELECT, switch in SELECT. d. IF 3-FCV-74-67, RHR SYS II INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 3-FCV-74-66, RHR SYS II OUTBD INJECT VALVE. e. VERIFY OPERATING the desired RHR System II pump(s) for Suppression Chamber Spray. f. VERIFY OPEN 3-FCV-74-71, RHR SYS II SUPPR CHBR/POOL ISOL VLV. |

Simulator Event Guide:

Event 7: Main Steam Line Leak inside Containment

| | | |
|---------|--|---|
| ATC/BOP | | <p>g. OPEN 3-FCV-74-72, RHR SYS II SUPPR CHBR SPRAY VALVE.</p> <p>h. IF RHR System II is operating ONLY in Suppression Chamber Spray mode, THEN CONTINUE in this procedure at Step 5.k.</p> <p>i. VERIFY CLOSED 3-FCV-74-30, RHR SYSTEM II MIN FLOW VALVE.</p> <p>j. RAISE system flow by placing the second RHR System II pump in service as necessary.</p> <p>k. MONITOR RHR Pump NPSH using Attachment 2.</p> |
| | | <p>l. VERIFY RHRSW pump supplying desired RHR Heat Exchanger(s).</p> <p>m. THROTTLE the following in-service RHRSW outlet valves to obtain between 1350 and 4500 gpm flow:</p> <ul style="list-style-type: none"> • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV • 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV. |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------|--|
| | SRO | EOI-2 (Drywell Temperature) |
| | | Before DW Temperature rises to 280°F, Continue |
| | | Is Suppression Pool level below 18 feet? - YES |
| | | Are DW Temperature and Pressure within the safe area of curve 5? - YES |
| | | Direct Operators to shutdown Recirc Pumps and Drywell Blowers. |
| | ATC | Trips Reactor Recirculation Pumps. |
| | BOP | Places all Drywell Blowers in Off. |
| | SRO | Initiate DW Sprays, using only pumps not required to assure adequate core cooling; by continuous injection. (Appendix 17B) |
| | ATC/BOP | Initiate DW Sprays, IAW Appendix 17B. |
| | | |
| | SRO | EOI-2 (Primary Containment Pressure) |
| | | When Suppression Chamber Pressure exceeds 12 psig, THEN Continue |
| | | Is Suppression Pool level below 18 feet - YES |
| | | Are DW Temperature and Pressure within the safe area of curve 5 - YES |
| | | Directs Operators to shutdown Recirc Pumps and Drywell Blowers. |
| | ATC | Trips Reactor Recirculation Pumps. |
| | BOP | Places all Drywell Blowers in Off. |
| | SRO | Initiate DW Sprays; using only pumps not required to assure adequate core cooling; by continuous injection. (Appendix 17B) |
| | ATC/BOP | Initiate DW Sprays, IAW Appendix 17B. |

Simulator Event Guide:

Event 9 Component: RHR Loop I and II Drywell Sprays Fail

| | | |
|--|---------|---|
| | ATC/BOP | Initiate DW Sprays, IAW Appendix 17B. |
| | | <p>1. IF Adequate core cooling is assured OR Directed to spray the Drywell irrespective of adequate core cooling, THEN BYPASS LPCI injection valve open interlock as necessary:</p> <ul style="list-style-type: none"> • PLACE 1-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS. • PLACE 1-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS. |
| | | 2. VERIFY Recirc Pumps and Drywell Blowers shutdown. |
| | | 3. IF Directed by SRO to spray the Drywell using RHR System II, THEN CONTINUE in this procedure at Step 6 using RHR Loop II. |
| | | <p>6. INITIATE Drywell Sprays using RHR Loop I(II) as follows:</p> <ol style="list-style-type: none"> a. BEFORE drywell pressure drops below 0 psig, CONTINUE in this procedure at Step 9. b. VERIFY at least one RHRSW pump supplying each EECW header. c. IF EITHER of the following exists: <ul style="list-style-type: none"> • LPCI Initiation signal is NOT present, <p style="text-align: center;">OR</p> <ul style="list-style-type: none"> • Directed by SRO, <p>THEN PLACE keylock switch 1-XS-74-130, RHR SYS II LPCI 2/3 CORE HEIGHT OVRD, in MANUAL OVERRIDE.</p> d. MOMENTARILY PLACE 1-XS-74-29, RHR SYS II CTMT SPRAY/CLG VLV SELECT, switch in SELECT. e. IF 1-FCV-74-67, RHR SYS II LPCI INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 1-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE. f. VERIFY OPERATING the desired System I(II) RHR pump(s) for Drywell Spray. g. OPEN the following valves: <ul style="list-style-type: none"> • 1-FCV-74-74, RHR SYS II DW SPRAY OUTBD VLV. • 1-FCV-74-75, RHR SYS II DW SPRAY INBD VLV. |
| | ATC/BOP | Reports Failure of Drywell Spray Valve on RHR Loop II. |

Simulator Event Guide:

Event 9 Component: RHR Loop I and II Drywell Sprays Fail

| | | |
|--|---------|---|
| | SRO | When Loop 2 Drywell Sprays fails direct DW Sprays using Standby Coolant |
| | ATC/BOP | Initiate DW Sprays, IAW Appendix 17B. with Standby Coolant |
| | | 4. IF Directed by SRO to spray the Drywell using Standby Coolant supply, THEN CONTINUE in this procedure at Step 8. |
| | | <p>8. INITIATE Drywell Spray on RHR Loop I using Standby Coolant Supply as follows:</p> <p>a. IF EITHER of the following exists:</p> <ul style="list-style-type: none"> • LPCI Initiation signal is NOT present, <li style="text-align: center;">OR • Directed by SRO, <p>THEN PLACE keylock switch 3-XS-74-122, RHR SYS I LPCI 2/3 CORE HEIGHT OVRD, in MANUAL OVERRIDE.</p> <p>b. MOMENTARILY PLACE 3-XS-74-121, RHR SYS I CTMT SPRAY/CLG VLV SELECT, switch in SELECT. ____</p> <p>c. IF 3-FCV-74-53, RHR SYS I LPCI INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 3-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VALVE.</p> <p>d. VERIFY CLOSED the following valves:</p> <ul style="list-style-type: none"> • 3-FCV-74-61, RHR SYS I DW SPRAY INBD VLV • 3-FCV-74-60, RHR SYS I DW SPRAY OUTBD VLV • 3-FCV-74-58, RHR SYS I SUPPR CHBR SPRAY VALVE • 3-FCV-74-59, RHR SYS I SUPPR POOL CLG/TEST VLV • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV. <p>e. VERIFY RHR Pumps 3A and 3C are NOT running.</p> <p>f. PLACE 3-BKR-074-0100, RHR HTX A-C DISCH XTIE (TO U-2) VLV FCV-74-100 (M010-171) to ON (480V RMOV Board 3B, Compartment 19A).</p> |
| | Driver | Report 3-BKR-074-0100 Trips free and cannot be closed Maintenance contacted |
| | Driver | If required increase severity of Drywell Steam Leak to ensure Crew EDs |
| | ATC/BOP | Reports Failure of Drywell Sprays using Standby Coolant. |

Simulator Event Guide:

Event 10 Component: 10 SRVs Fail Closed

| | | |
|--|--------|---|
| | SRO | EOI-2 (Drywell Temperature) |
| | CT#1 | Can Drywell Temperature be Maintained below 280°F? - NO |
| | | Emergency RPV Depressurization is required. |
| | CT#1 | Enters EOI-C2. |
| | | Will the Reactor remain subcritical without Boron under all conditions? - YES |
| | | Is Drywell Pressure Above 2.4 psig? – YES |
| | | Prevent Injection from only those CS and LPCI Pumps; not required to assure adequate core cooling. (Appendix 4) |
| | | Is Suppression Pool level above 5.5 feet? - YES |
| | | Direct ATC/BOP to Open all ADS Valves. |
| | CT#1 | Open 6 ADS Valves |
| | SRO | Can 6 ADS Valves be opened - NO |
| | | Open additional MSRVs as necessary to establish 6 MSRVs open |
| | | Are at least 4 MSRVs open – NO (dependent upon whether crew opens additional MSRVs from the back-up control panel) |
| | DRIVER | If sent to the back-up control panel to open ADS MSRVs wait 2 minutes and insert trigger 30 to bring in alarm, then delete failures ad03a,c,e and f |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 10 Component: 10 SRVs Fail Closed

| | | Is RPV Press 70 PSI or more above Suppression Chamber Pressure – YES | | | | | | | | | | | | | | | | | | | | | | | | | | |
|--|---------|---|-------------------------|------|----------------|-----|--|-----|----------------|-----|-------------------|-----|--------------------------|-----|-------------|-----|------|-----|-------------------|-----|---------------|-----|----------------------|-----|------------------------------------|-----|--|-----|
| | | <p>RAPIDLY DEPRESSURIZE THE RPV TO LESS THAN 70 PSI ABOVE SUPPR CHMBR PRESS WITH ONE OR MORE OF THE FOLLOWING SYSTEMS:</p> <table border="1"> <thead> <tr> <th>DEPRESSURIZATION SYSTEM</th> <th>APPX</th> </tr> </thead> <tbody> <tr> <td>MAIN CONDENSER</td> <td>11H</td> </tr> <tr> <td>HPCI TEST MODE ONLY WHEN SUPPR PL LVL IS ABOVE 12.75 FT</td> <td>11C</td> </tr> <tr> <td>RCIC TEST MODE</td> <td>11B</td> </tr> <tr> <td>RPPTs ON MIN FLOW</td> <td>11F</td> </tr> <tr> <td>MAIN STEAM SYSTEM DRAINS</td> <td>11D</td> </tr> <tr> <td>STEAM SEALS</td> <td>11G</td> </tr> <tr> <td>SAEs</td> <td>11G</td> </tr> <tr> <td>OFF GAS PREHEATER</td> <td>11G</td> </tr> <tr> <td>RPV HEAD VENT</td> <td>11K</td> </tr> <tr> <td>HPCI AND RCIC DRAINS</td> <td>11J</td> </tr> <tr> <td>RWCU IF NO BORON HAS BEEN INJECTED</td> <td>11E</td> </tr> <tr> <td>SHUTDOWN COOLING ONLY IF: ● NO BORON HAS BEEN INJECTED OR ● THE REACTOR WILL REMAIN SUBCRITICAL WITHOUT BORON UNDER ALL CONDITIONS (SEE NOTE)</td> <td>17D</td> </tr> </tbody> </table> | DEPRESSURIZATION SYSTEM | APPX | MAIN CONDENSER | 11H | HPCI TEST MODE ONLY WHEN SUPPR PL LVL IS ABOVE 12.75 FT | 11C | RCIC TEST MODE | 11B | RPPTs ON MIN FLOW | 11F | MAIN STEAM SYSTEM DRAINS | 11D | STEAM SEALS | 11G | SAEs | 11G | OFF GAS PREHEATER | 11G | RPV HEAD VENT | 11K | HPCI AND RCIC DRAINS | 11J | RWCU IF NO BORON HAS BEEN INJECTED | 11E | SHUTDOWN COOLING ONLY IF: ● NO BORON HAS BEEN INJECTED OR ● THE REACTOR WILL REMAIN SUBCRITICAL WITHOUT BORON UNDER ALL CONDITIONS (SEE NOTE) | 17D |
| DEPRESSURIZATION SYSTEM | APPX | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| MAIN CONDENSER | 11H | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| HPCI TEST MODE ONLY WHEN SUPPR PL LVL IS ABOVE 12.75 FT | 11C | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RCIC TEST MODE | 11B | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RPPTs ON MIN FLOW | 11F | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| MAIN STEAM SYSTEM DRAINS | 11D | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| STEAM SEALS | 11G | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SAEs | 11G | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| OFF GAS PREHEATER | 11G | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RPV HEAD VENT | 11K | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| HPCI AND RCIC DRAINS | 11J | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RWCU IF NO BORON HAS BEEN INJECTED | 11E | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| SHUTDOWN COOLING ONLY IF: ● NO BORON HAS BEEN INJECTED OR ● THE REACTOR WILL REMAIN SUBCRITICAL WITHOUT BORON UNDER ALL CONDITIONS (SEE NOTE) | 17D | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | SRO | Directs additional Depressurization Methods from the chart above or directs ADS Valves be opened from Back Up Control Panel | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | SRO | EOI-1 Level | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | SRO | Restore and Maintain RPV Water Level between +2 to 51 inches with one or more of the following injection sources. Condensate Appendix 6A, Core Spray Appendix 6D or 6E, LPCI Appendix 6C | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | ATC/BOP | Restore and maintain level +2 to +51 inches IAW Appendix 6A, 6D, 6E, or 6C | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | SRO | Emergency Plan Classification 2.1-A | | | | | | | | | | | | | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------|---|
| | ATC/BOP | Restore and maintain level +2 to +51 inches IAW Appendix 6A, 6D, 6E, or 6C |
| | | Condensate Appendix 6A |
| | | 1. VERIFY CLOSED the following feedwater heater return valves: <ul style="list-style-type: none"> • 1-FCV-3-71, HP HTR 1A1 LONG CYCLE TO CNDR • 1-FCV-3-72, HP HTR 1B1 LONG CYCLE TO CNDR • 1-FCV-3-73, HP HTR 1C1 LONG CYCLE TO CNDR |
| | | 2. VERIFY CLOSED the following RFP discharge valves: <ul style="list-style-type: none"> • 1-FCV-3-19, RFP 1A DISCHARGE VALVE • 1-FCV-3-12, RFP 1B DISCHARGE VALVE • 1-FCV-3-5, RFP 1C DISCHARGE VALVE. |
| | | 3. VERIFY OPEN the following drain cooler inlet valves: <ul style="list-style-type: none"> • 1-FCV-2-72, DRAIN COOLER 1A5 CNDS INLET ISOL VLV • 1-FCV-2-84, DRAIN COOLER 1B5 CNDS INLET ISOL VLV • 1-FCV-2-96, DRAIN COOLER 1C5 CNDS INLET ISOL VLV |
| | | 4. VERIFY OPEN the following heater outlet valves: <ul style="list-style-type: none"> • 1-FCV-2-124, LP HEATER 1A3 CNDS OUTL ISOL VLV • 1-FCV-2-125, LP HEATER 1B3 CNDS OUTL ISOL VLV • 1-FCV-2-126, LP HEATER 1C3 CNDS OUTL ISOL VLV. |
| | | 5. VERIFY OPEN the following heater isolation valves: <ul style="list-style-type: none"> • 1-FCV-3-38, HP HTR 1A2 FW INLET ISOL VALVE • 1-FCV-3-31, HP HTR 1B2 FW INLET ISOL VALVE • 1-FCV-3-24, HP HTR 1C2 FW INLET ISOL VALVE • 1-FCV-3-75, HP HTR 1A1 FW OUTLET ISOL VALVE • 1-FCV-3-76, HP HTR 1B1 FW OUTLET ISOL VALVE • 1-FCV-3-77, HP HTR 1C1 FW OUTLET ISOL VALVE |
| | | 6. VERIFY OPEN the following RFP suction valves: <ul style="list-style-type: none"> • 1-FCV-2-83, RFP 1A SUCTION VALVE • 1-FCV-2-95, RFP 1B SUCTION VALVE • 1-FCV-2-108, RFP 1C SUCTION VALVE. |
| | | 7. VERIFY at least one condensate pump running. |
| | | 8. VERIFY at least one condensate booster pump running. |
| | | 9. ADJUST 1-LIC-3-53, RFW START-UP LEVEL CONTROL, to control injection (Panel 1-9-5). |
| | | 10. VERIFY RFW flow to RPV. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------|--|
| | ATC/BOP | Restore and maintain level +2 to +51 inches IAW Appendix 6A, 6D, 6E, or 6C |
| | | Core Spray System I Appendix 6D |
| | | 1. VERIFY OPEN the following valves: <ul style="list-style-type: none"> • 1-FCV-75-2, CORE SPRAY PUMP 1A SUPPR POOL SUCT VLV • 1-FCV-75-11, CORE SPRAY PUMP 1C SUPPR POOL SUCT VLV • 1-FCV-75-23, CORE SPRAY SYS I OUTBD INJECT VALVE. |
| | | 2. VERIFY CLOSED 1-FCV-75-22, CORE SPRAY SYS I TEST VALVE. |
| | | 3. VERIFY CS Pump 1A and/or 1C running. |
| | | 4. WHEN RPV pressure is below 450 psig, THEN THROTTLE 1-FCV-75-25, CORE SPRAY SYS I INBD INJECT VALVE, as necessary to control injection at or below 4000 gpm per pump. |
| | | 5. MONITOR Core Spray Pump NPSH using Attachment 1. |
| | | Core Spray System II Appendix 6E |
| | | 1. VERIFY OPEN the following valves: <ul style="list-style-type: none"> • 1-FCV-75-30, CORE SPRAY PUMP 1B SUPPR POOL SUCT VLV • 1-FCV-75-39, CORE SPRAY PUMP 1D SUPPR POOL SUCT VLV • 1-FCV-75-51, CORE SPRAY SYS II OUTBD INJECT VALVE. |
| | | 2. VERIFY CLOSED 1-FCV-75-50, CORE SPRAY SYS II TEST VALVE |
| | | 3. VERIFY CS Pump 1B and/or 1D running. |
| | | 4. WHEN RPV pressure is below 450 psig, THEN THROTTLE 1-FCV-75-53, CORE SPRAY SYS II INBD INJECT VALVE, as necessary to control injection at or below 4000 gpm per pump. |
| | | 5. MONITOR Core Spray Pump NPSH using Attachment 1. |

Simulator Event Guide:

Event 7 Major: Main Steam Line Leak inside Containment

| | | |
|--|---------|--|
| | ATC/BOP | Restore and maintain level +2 to +51 inches IAW Appendix 6A, 6D, 6E, or 6C |
| | | LPCI Appendix 6C |
| | | 1. IF Adequate core cooling is assured AND It becomes necessary to bypass LPCI Injection Valve auto open signal to control injection, THEN PLACE 1-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS . |
| | | 2. VERIFY OPEN the following valves: <ul style="list-style-type: none"> • 1-FCV-74-24, RHR PUMP 1B SUPPR POOL SUCT VLV. • 1-FCV-74-35, RHR PUMP 1D SUPPR POOL SUCT VLV. |
| | | 3. VERIFY CLOSED the following valves: <ul style="list-style-type: none"> • 1-FCV-74-75, RHR SYS II DW SPRAY INBD VLV • 1-FCV-74-74, RHR SYS II DW SPRAY OUTBD VLV • 1-FCV-74-71, RHR SYS II SUPPR CHBR/POOL ISOL VLV • 1-FCV-74-72, RHR SYS II SUPPR CHBR SPRAY VALVE • 1-FCV-74-73, RHR SYS II SUPPR POOL CLG/TEST VLV. |
| | | 4. VERIFY RHR Pump 1B and/or 1D running. |
| | | 5. WHEN RPV pressure is below 450 psig, THEN VERIFY OPEN 1-FCV-74-67, RHR SYS II LPCI INBD INJECT VALVE. |
| | | 6. IF RPV pressure is below 230 psig, THEN VERIFY CLOSED 1-FCV-68-3, RECIRC PUMP 1A DISCHARGE VALVE. |
| | | 7. THROTTLE 1-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE, as necessary to control injection. |
| | | 8. MONITOR RHR Pump NPSH using Attachment 1. |
| | | 9. PLACE RHRSW pumps in service as soon as possible on ANY RHR Heat Exchangers discharging to the RPV. |
| | | 10. THROTTLE the following in-service RHRSW outlet valves to maintain flow between 1350 and 4500 gpm: <ul style="list-style-type: none"> • 1-FCV-23-46, RHR HX 1B RHRSW OUTLET VLV • 1-FCV-23-52, RHR HX 1D RHRSW OUTLET VLV. |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted.

Emergency Depressurization is complete

Reactor Level is restored and maintained

SHIFT TURNOVER SHEET

Equipment Out of Service/LCO's:

RCW Pump 3A is out of service and tagged out.

3-PI-3-207 Bypassed for surveillance.

Operations/Maintenance for the Shift:

Perform Stroke Time Test on 3-FCV-43-13 and 3-FCV-43-14 per 3-SR-3.6.1.3.5 Section 7.6 and 7.7.

Once completed raise power with flow to 95% IAW 3-GOI-100-12 section 5.0 step 21 and the Reactivity Control Plan.

Units 1 is in a forced outage and Unit 2 is at 100% power.

Unusual Conditions/Problem Areas:

None

E01-3 UNIT 3

E01-3



**TABLE 3
SPECIFICATIONS OF THE PUMP**


| NO. | ITEM | UNIT | VALUE |
|-----|---------------------------|--------------------|-------------|
| 1 | TYPE | | VERTICAL |
| 2 | DRIVE | | ELECTRIC |
| 3 | DISCHARGE | MM | 150 |
| 4 | HEAD | M | 100 |
| 5 | FLOW | M ³ /HR | 1000 |
| 6 | EFFICIENCY | % | 70 |
| 7 | NET POSITIVE SUCTION HEAD | M | 1.5 |
| 8 | MAXIMUM SPEED | REV/MIN | 3000 |
| 9 | STARTING CURRENT | A | 100 |
| 10 | INSULATION CLASS | | F |
| 11 | WEIGHT | KG | 500 |
| 12 | HEIGHT | M | 2.0 |
| 13 | WIDTH | M | 0.8 |
| 14 | DEPTH | M | 0.8 |
| 15 | INSTALLATION | | INDOOR |
| 16 | MAINTENANCE | | EASY |
| 17 | NOISE LEVEL | DB(A) | 85 |
| 18 | ENVIRONMENTAL | | INDOOR |
| 19 | SEISMIC | | AS PER CODE |
| 20 | WARRANTY | | 1 YEAR |

**TABLE 4
SPECIFICATIONS OF THE MOTOR**

| NO. | ITEM | UNIT | VALUE |
|-----|---------------------------|--------------------|-------------|
| 1 | TYPE | | INDUSTRIAL |
| 2 | DRIVE | | ELECTRIC |
| 3 | DISCHARGE | MM | 150 |
| 4 | HEAD | M | 100 |
| 5 | FLOW | M ³ /HR | 1000 |
| 6 | EFFICIENCY | % | 70 |
| 7 | NET POSITIVE SUCTION HEAD | M | 1.5 |
| 8 | MAXIMUM SPEED | REV/MIN | 3000 |
| 9 | STARTING CURRENT | A | 100 |
| 10 | INSULATION CLASS | | F |
| 11 | WEIGHT | KG | 500 |
| 12 | HEIGHT | M | 2.0 |
| 13 | WIDTH | M | 0.8 |
| 14 | DEPTH | M | 0.8 |
| 15 | INSTALLATION | | INDOOR |
| 16 | MAINTENANCE | | EASY |
| 17 | NOISE LEVEL | DB(A) | 85 |
| 18 | ENVIRONMENTAL | | INDOOR |
| 19 | SEISMIC | | AS PER CODE |
| 20 | WARRANTY | | 1 YEAR |


**TABLE 5
SPECIFICATIONS OF THE MOTOR**

| NO. | ITEM | UNIT | VALUE |
|-----|---------------------------|--------------------|-------------|
| 1 | TYPE | | INDUSTRIAL |
| 2 | DRIVE | | ELECTRIC |
| 3 | DISCHARGE | MM | 150 |
| 4 | HEAD | M | 100 |
| 5 | FLOW | M ³ /HR | 1000 |
| 6 | EFFICIENCY | % | 70 |
| 7 | NET POSITIVE SUCTION HEAD | M | 1.5 |
| 8 | MAXIMUM SPEED | REV/MIN | 3000 |
| 9 | STARTING CURRENT | A | 100 |
| 10 | INSULATION CLASS | | F |
| 11 | WEIGHT | KG | 500 |
| 12 | HEIGHT | M | 2.0 |
| 13 | WIDTH | M | 0.8 |
| 14 | DEPTH | M | 0.8 |
| 15 | INSTALLATION | | INDOOR |
| 16 | MAINTENANCE | | EASY |
| 17 | NOISE LEVEL | DB(A) | 85 |
| 18 | ENVIRONMENTAL | | INDOOR |
| 19 | SEISMIC | | AS PER CODE |
| 20 | WARRANTY | | 1 YEAR |

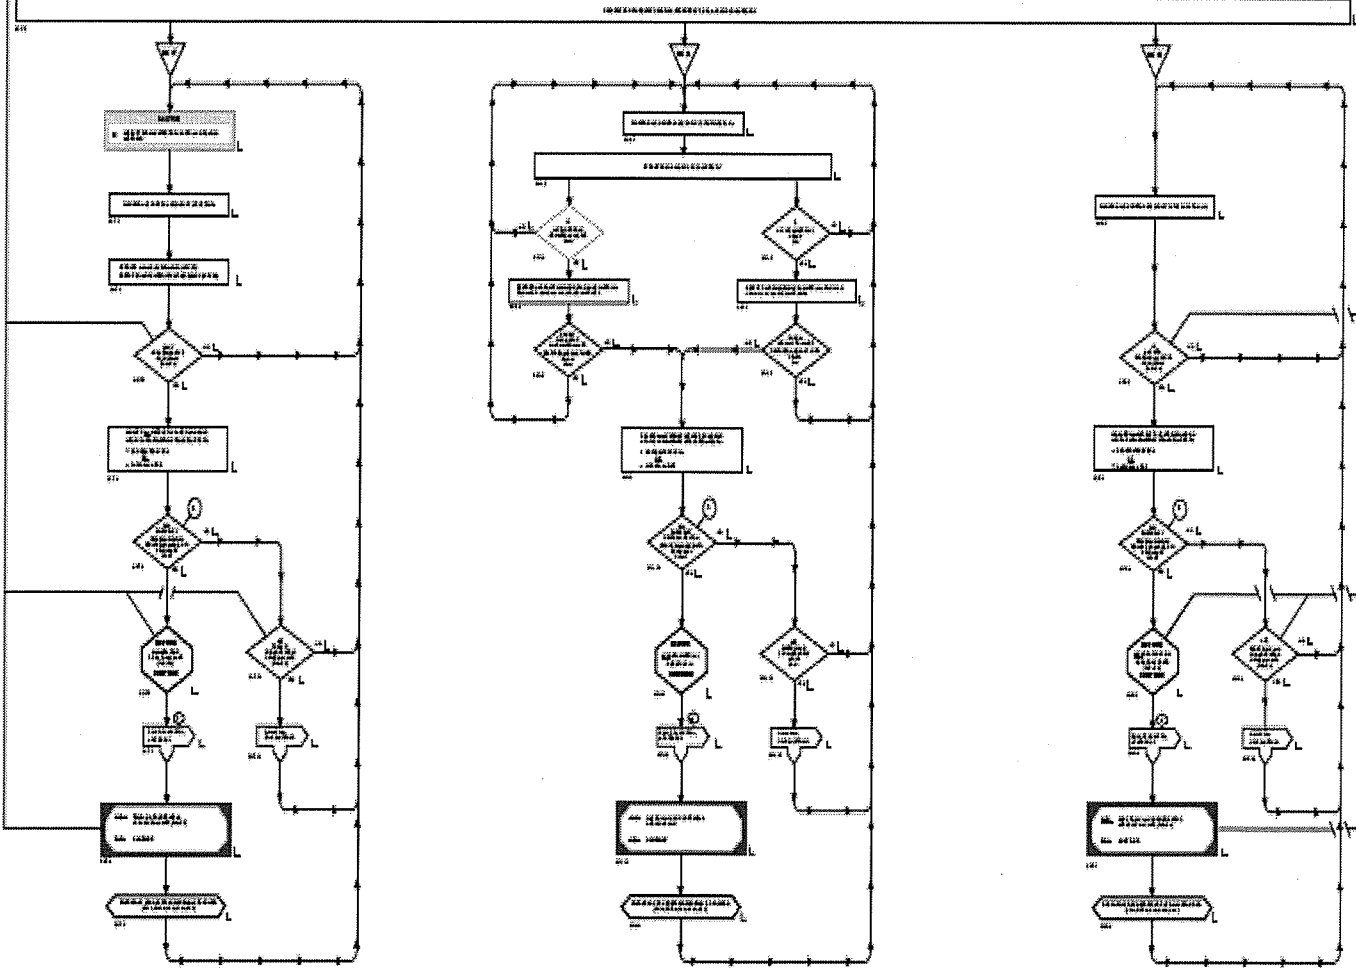

**TABLE 6
SPECIFICATIONS OF THE MOTOR**

| NO. | ITEM | UNIT | VALUE |
|-----|---------------------------|--------------------|-------------|
| 1 | TYPE | | INDUSTRIAL |
| 2 | DRIVE | | ELECTRIC |
| 3 | DISCHARGE | MM | 150 |
| 4 | HEAD | M | 100 |
| 5 | FLOW | M ³ /HR | 1000 |
| 6 | EFFICIENCY | % | 70 |
| 7 | NET POSITIVE SUCTION HEAD | M | 1.5 |
| 8 | MAXIMUM SPEED | REV/MIN | 3000 |
| 9 | STARTING CURRENT | A | 100 |
| 10 | INSULATION CLASS | | F |
| 11 | WEIGHT | KG | 500 |
| 12 | HEIGHT | M | 2.0 |
| 13 | WIDTH | M | 0.8 |
| 14 | DEPTH | M | 0.8 |
| 15 | INSTALLATION | | INDOOR |
| 16 | MAINTENANCE | | EASY |
| 17 | NOISE LEVEL | DB(A) | 85 |
| 18 | ENVIRONMENTAL | | INDOOR |
| 19 | SEISMIC | | AS PER CODE |
| 20 | WARRANTY | | 1 YEAR |



**TABLE 7
SPECIFICATIONS OF THE MOTOR**

| NO. | ITEM | UNIT | VALUE |
|-----|---------------------------|--------------------|-------------|
| 1 | TYPE | | INDUSTRIAL |
| 2 | DRIVE | | ELECTRIC |
| 3 | DISCHARGE | MM | 150 |
| 4 | HEAD | M | 100 |
| 5 | FLOW | M ³ /HR | 1000 |
| 6 | EFFICIENCY | % | 70 |
| 7 | NET POSITIVE SUCTION HEAD | M | 1.5 |
| 8 | MAXIMUM SPEED | REV/MIN | 3000 |
| 9 | STARTING CURRENT | A | 100 |
| 10 | INSULATION CLASS | | F |
| 11 | WEIGHT | KG | 500 |
| 12 | HEIGHT | M | 2.0 |
| 13 | WIDTH | M | 0.8 |
| 14 | DEPTH | M | 0.8 |
| 15 | INSTALLATION | | INDOOR |
| 16 | MAINTENANCE | | EASY |
| 17 | NOISE LEVEL | DB(A) | 85 |
| 18 | ENVIRONMENTAL | | INDOOR |
| 19 | SEISMIC | | AS PER CODE |
| 20 | WARRANTY | | 1 YEAR |

E01-3

0010
© 1995 by the American Nuclear Society
 All rights reserved. No part of this publication
 may be reproduced without the written permission
 of the American Nuclear Society.

0010
 SECONDARY SYSTEM INTERFACES
 UNIT 3
 WORK BOOK
 HANNA PLANT
 001

E01-2
UNIT 3






E01-2



| UNIT NO. | UNIT NAME | UNIT TYPE |
|----------|-----------------|-----------|
| 301 | CONDENSATE UNIT | CONDENSER |

| UNIT NO. | UNIT NAME | UNIT TYPE |
|----------|------------------|-----------|
| 302 | EXHAUST GAS UNIT | EXHAUST |

UNIT 3 - CONDENSATE UNIT

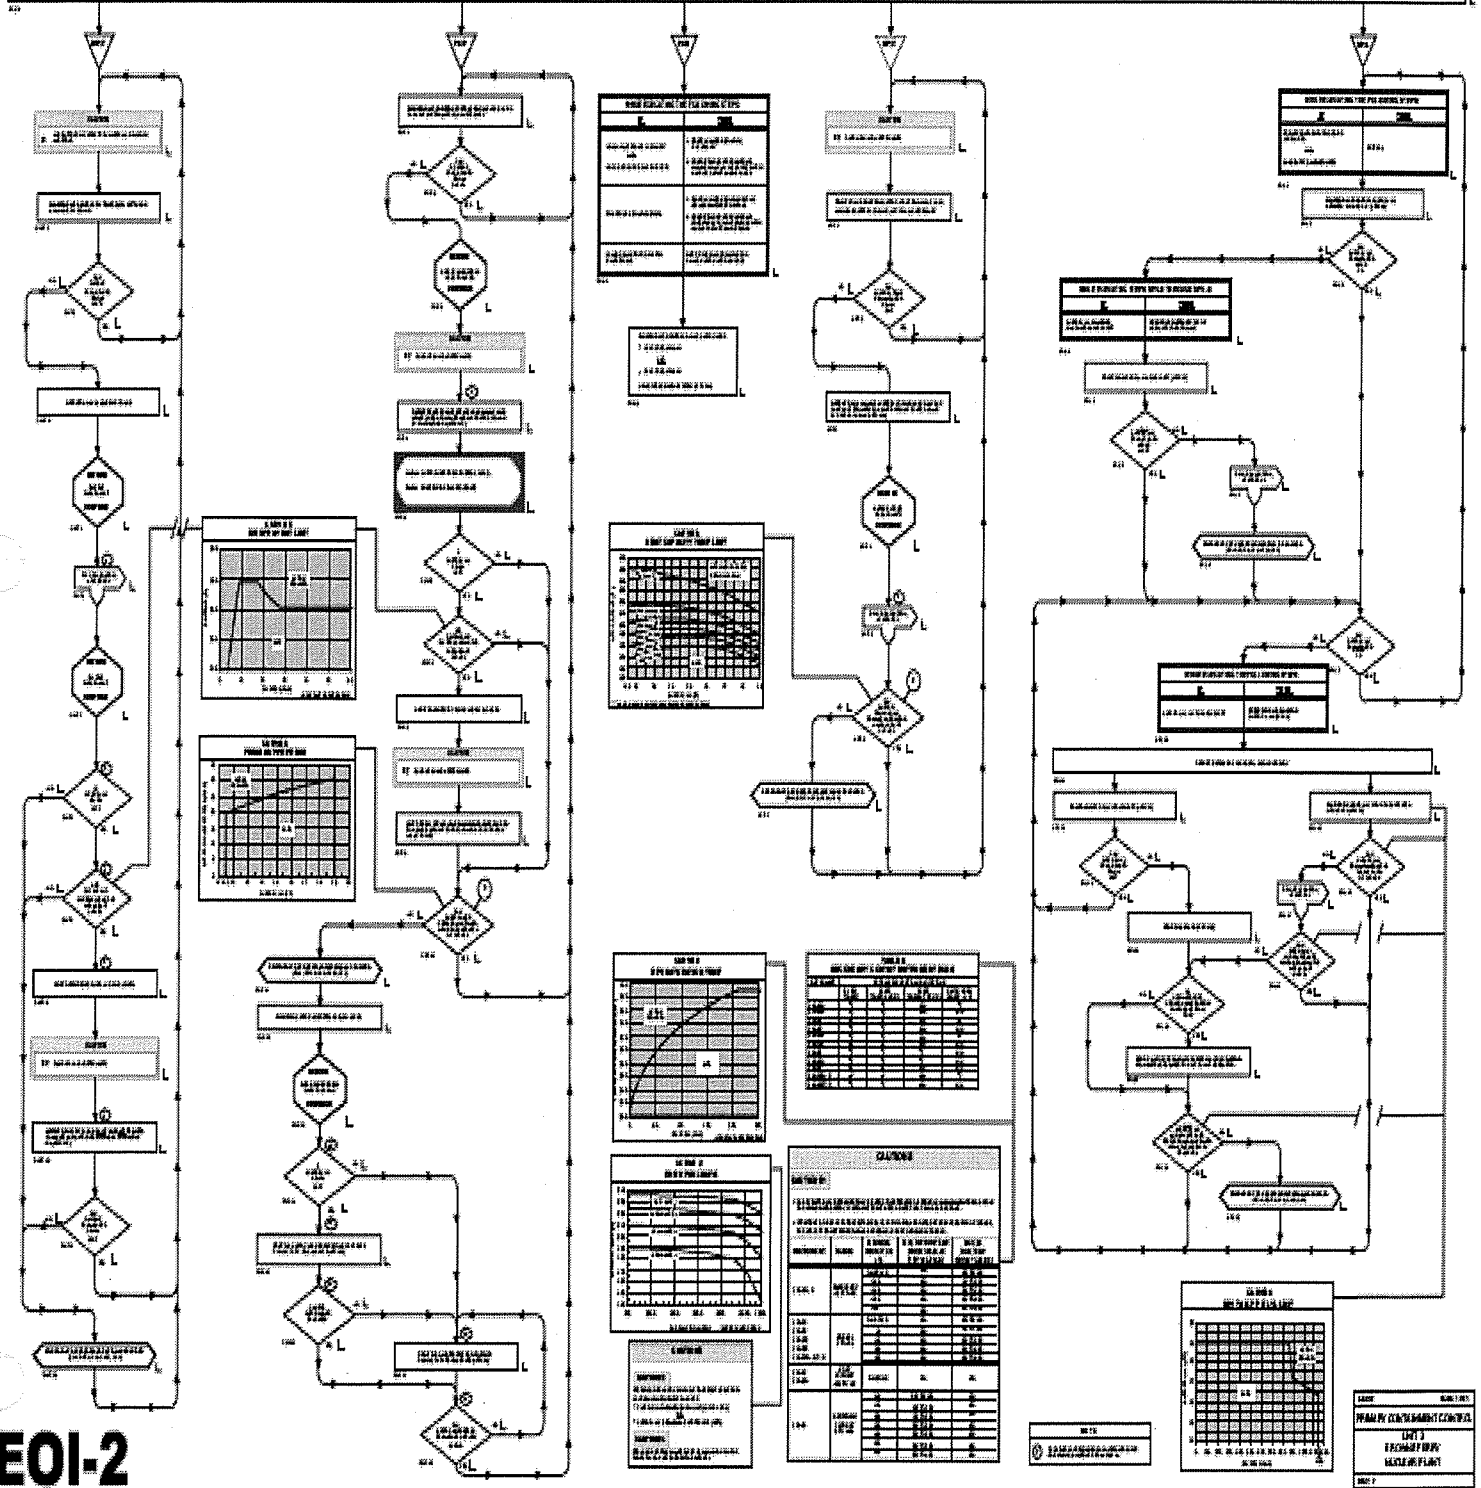

| UNIT NO. | UNIT NAME | UNIT TYPE |
|----------|-----------------|-----------|
| 301 | CONDENSATE UNIT | CONDENSER |

| UNIT NO. | UNIT NAME | UNIT TYPE |
|----------|------------------|-----------|
| 302 | EXHAUST GAS UNIT | EXHAUST |


| UNIT NO. | UNIT NAME | UNIT TYPE |
|----------|-----------------|-----------|
| 301 | CONDENSATE UNIT | CONDENSER |


UNIT 3
CONDENSATE UNIT
EXHAUST GAS UNIT

E01-2

3-C-2

EMERGENCY RPV DEPRESSURIZATION

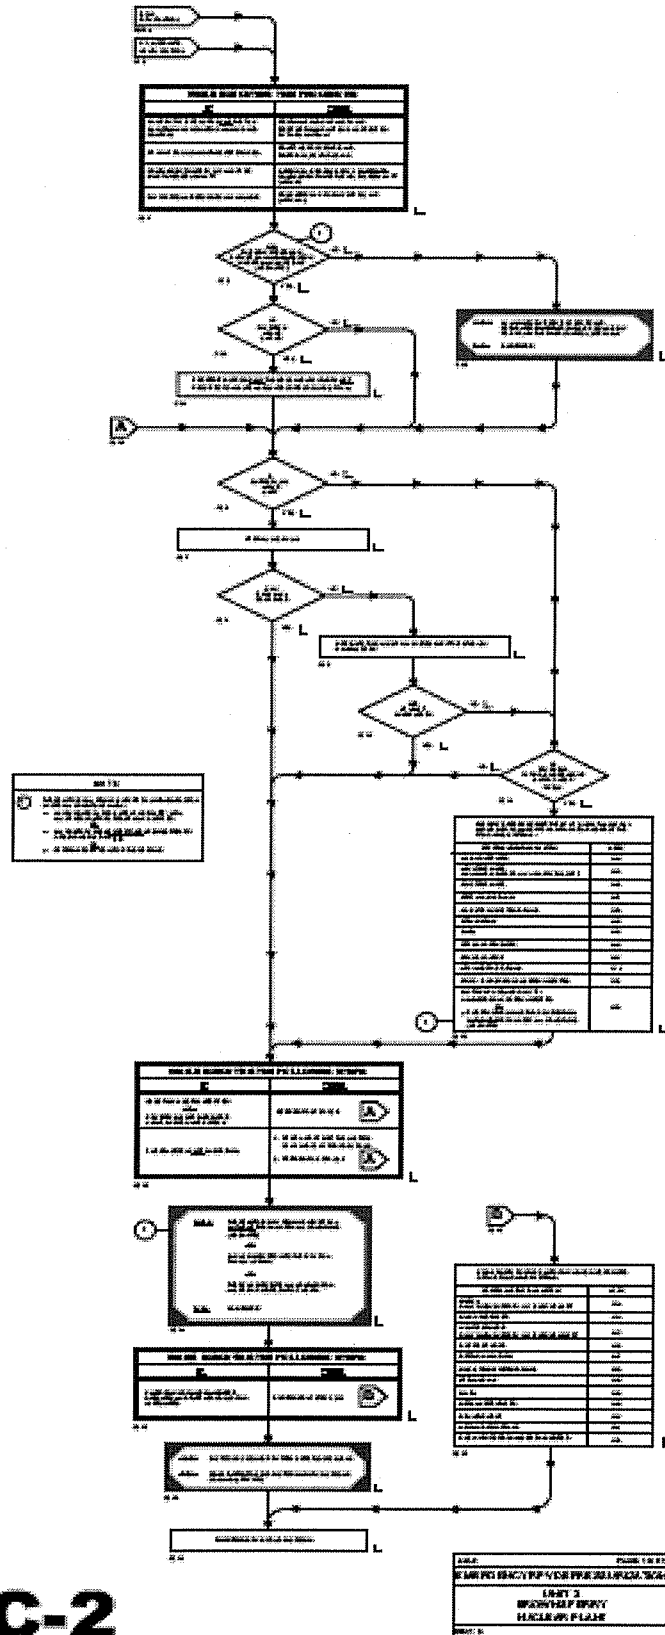

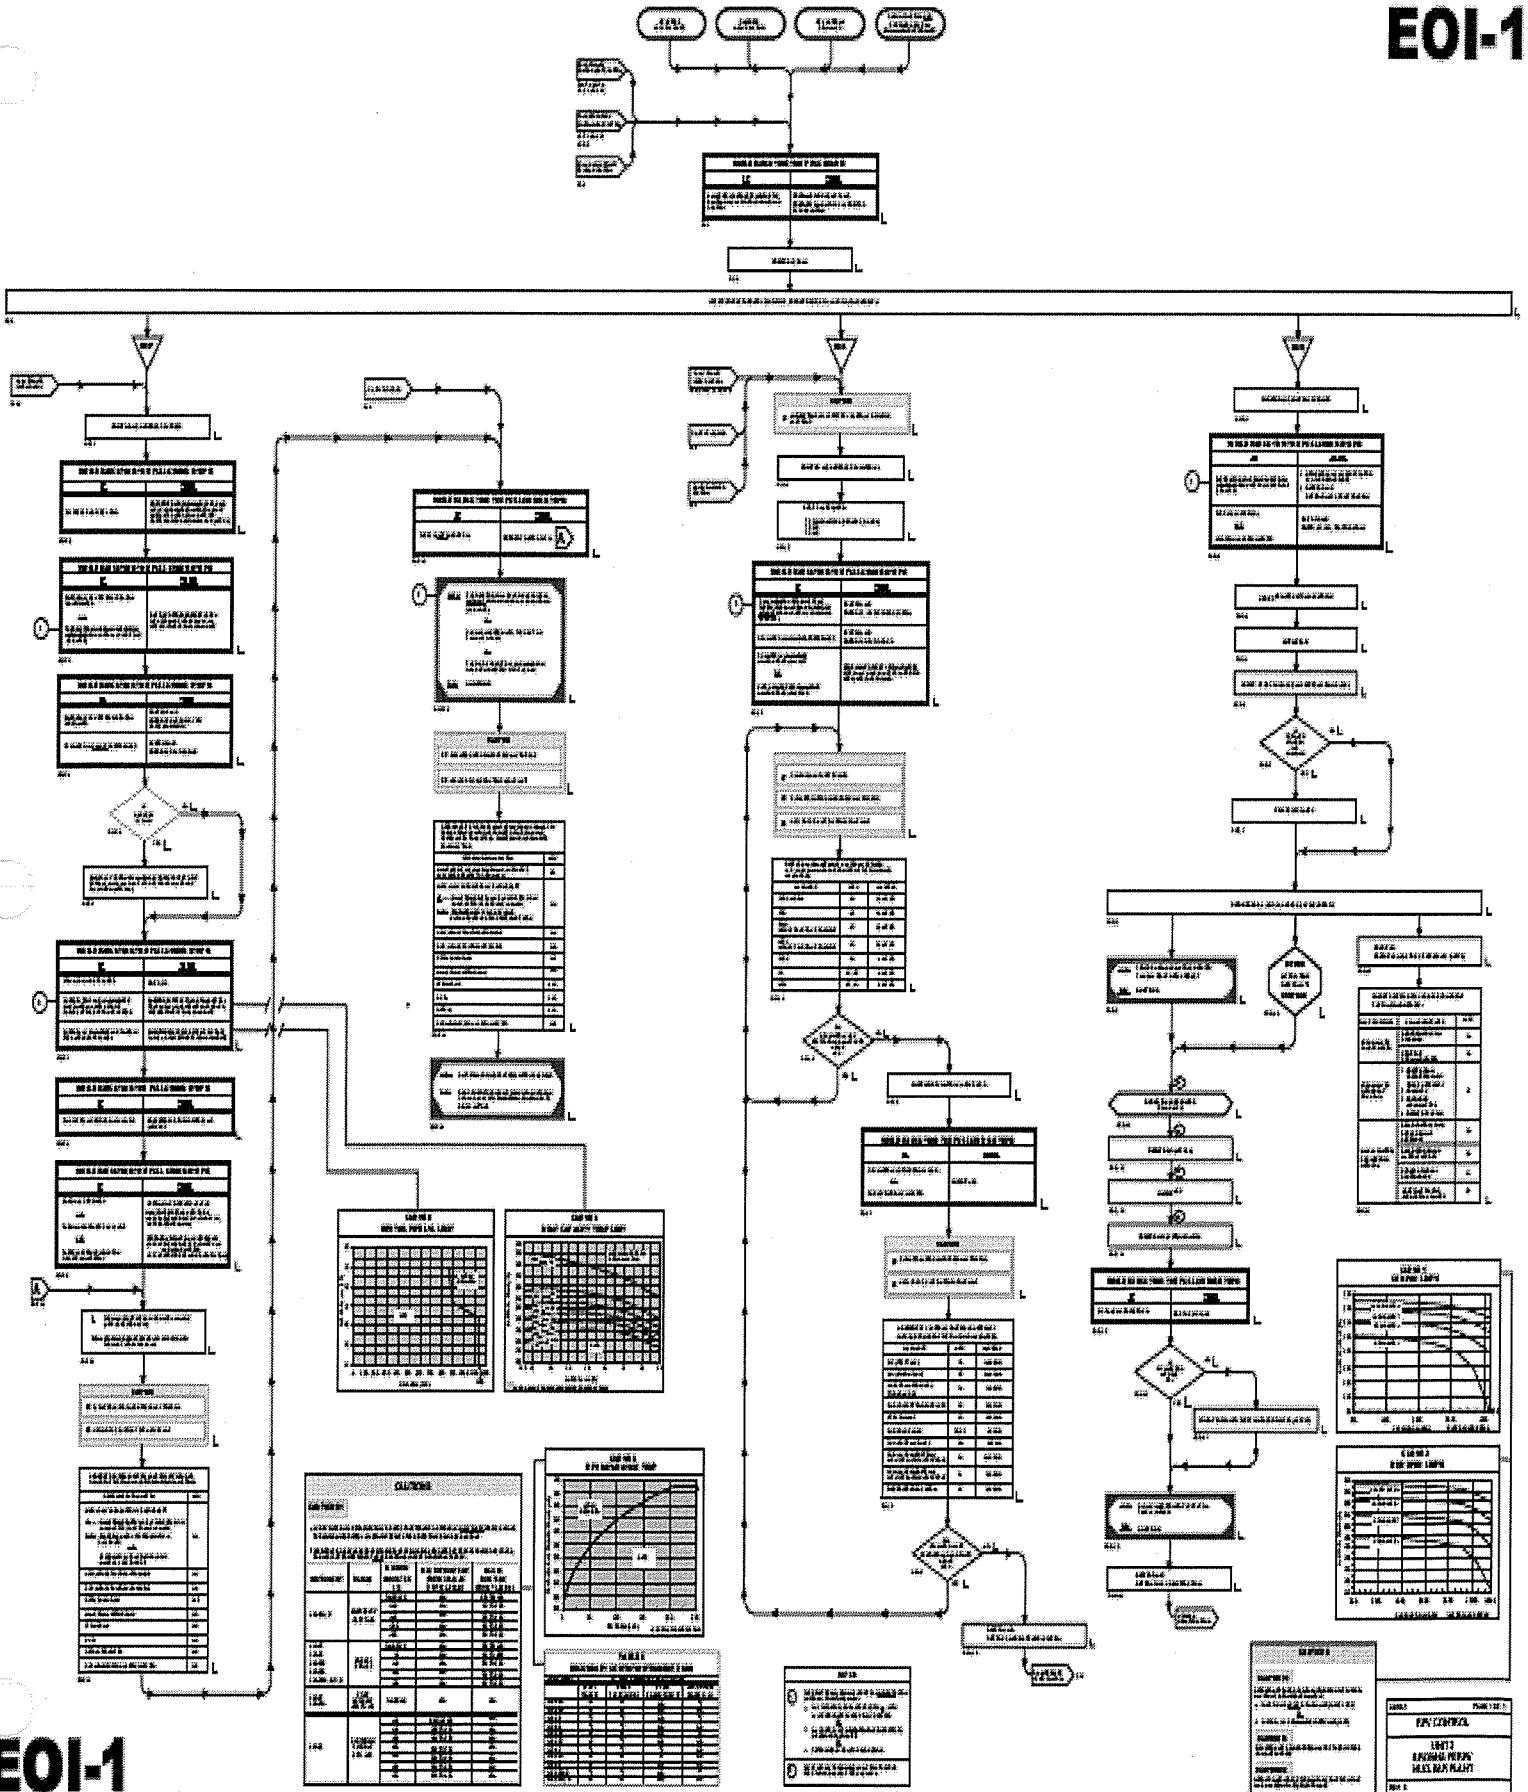

3.6 CONTAINMENT SYSTEMS

3.6.1.3 Primary Containment Isolation Valves (PCIVs)

LCO 3.6.1.3 Each PCIV, except reactor building-to-suppression chamber vacuum breakers, shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3,
When associated instrumentation is required to be OPERABLE per LCO 3.3.6.1, "Primary Containment Isolation Instrumentation."

ACTIONS

NOTES

1. Penetration flow paths except for 18 and 20 inch purge valve penetration flow paths may be unisolated intermittently under administrative controls.
 2. Separate Condition entry is allowed for each penetration flow path.
 3. Enter applicable Conditions and Required Actions for systems made inoperable by PCIVs.
 4. Enter applicable Conditions and Required Actions of LCO 3.6.1.1, "Primary Containment," when PCIV leakage results in exceeding overall containment leakage rate acceptance criteria in MODES 1, 2, and 3.
-

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|---|
| <p>A. -----NOTE----- Only applicable to penetration flow paths with two PCIVs. -----</p> <p>One or more penetration flow paths with one PCIV inoperable except due to MSIV leakage not within limits.</p> | <p>A.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p><u>AND</u></p> | <p>4 hours except for main steam line</p> <p><u>AND</u></p> <p>8 hours for main steam line</p> <p>(continued)</p> |

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|----------------|---|---|
| A. (continued) | <p>A.2 -----NOTE----- Isolation devices in high radiation areas may be verified by use of administrative means. -----</p> <p>Verify the affected penetration flow path is isolated.</p> | <p>Once per 31 days for isolation devices outside primary containment</p> <p><u>AND</u></p> <p>Prior to entering MODE 2 or 3 from MODE 4, if primary containment was de-inerted while in MODE 4, if not performed within the previous 92 days, for isolation devices inside primary containment</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|--|
| <p>B. -----NOTE----- Only applicable to penetration flow paths with two PCIVs. -----</p> <p>One or more penetration flow paths with two PCIVs inoperable except due to MSIV leakage not within limits.</p> | <p>B.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> | <p>1 hour</p> |
| <p>C. -----NOTE----- Only applicable to penetration flow paths with only one PCIV. -----</p> <p>One or more penetration flow paths with one PCIV inoperable.</p> | <p>C.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> <p><u>AND</u></p> <p>C.2 -----NOTE----- Isolation devices in high radiation areas may be verified by use of administrative means. -----</p> <p>Verify the affected penetration flow path is isolated.</p> | <p>4 hours except for excess flow check valves (EFCVs)</p> <p><u>AND</u></p> <p>12 hours for EFCVs</p> <p>Once per 31 days</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|-----------------|
| D. One or more penetration flow paths with MSIV leakage not within limits. | D.1 Restore leakage rate to within limit. | 4 hours |
| E. Required Action and associated Completion Time of Condition A, B, C, or D not met in MODE 1, 2, or 3. | E.1 Be in MODE 3. | 12 hours |
| | <u>AND</u> E.2 Be in MODE 4. | 36 hours |
| F. Required Action and associated Completion Time of Condition A, B, C, or D not met for PCIV(s) required to be OPERABLE during MODE 4 or 5. | F.1 Initiate action to suspend operations with a potential for draining the reactor vessel (OPDRVs). | Immediately |
| | <u>OR</u> F.2 -----NOTE----- Only applicable for inoperable RHR Shutdown Cooling Valves. ----- Initiate action to restore valve(s) to OPERABLE status. | Immediately |

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

3.5.1 ECCS - Operating

LCO 3.5.1 Each ECCS injection/spray subsystem and the Automatic Depressurization System (ADS) function of six safety/relief valves shall be OPERABLE.

APPLICABILITY: MODE 1, MODES 2 and 3, except high pressure coolant injection (HPCI) and ADS valves are not required to be OPERABLE with reactor steam dome pressure \leq 150 psig.

ACTIONS

-----NOTE-----

LCO 3.0.4.b is not applicable to HPCI.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|-----------------|
| <p>A. One low pressure ECCS injection/spray subsystem inoperable.</p> <p><u>OR</u></p> <p>One low pressure coolant injection (LPCI) pump in both LPCI subsystems inoperable.</p> | <p>A.1 Restore low pressure ECCS injection/spray subsystem(s) to OPERABLE status.</p> | <p>7 days</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--------------------------|-----------------|
| B. Required Action and associated Completion Time of Condition A not met. | B.1 Be in MODE 3. | 12 hours |
| | AND B.2 Be in MODE 4. | 36 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|----------------------------|
| C. HPCI System inoperable. | C.1 Verify by administrative means RCIC System is OPERABLE. <u>AND</u> C.2 Restore HPCI System to OPERABLE status. | Immediately 14 days |
| D. HPCI System inoperable. <u>AND</u> Condition A entered. | D.1 Restore HPCI System to OPERABLE status. <u>OR</u> D.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |
| E. One ADS valve inoperable. | E.1 Restore ADS valve to OPERABLE status. | 14 days |
| F. One ADS valve inoperable. <u>AND</u> Condition A entered. | F.1 Restore ADS valve to OPERABLE status. <u>OR</u> F.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|------------------------------------|
| <p>G. Two or more ADS valves inoperable.</p> <p><u>OR</u></p> <p>Required Action and associated Completion Time of Condition C, D, E, or F not met.</p> | <p>G.1 Be in MODE 3.</p> <p><u>AND</u></p> <p>G.2 Reduce reactor steam dome pressure to ≤ 150 psig.</p> | <p>12 hours</p> <p>36 hours</p> |
| <p>H. Two or more low pressure ECCS injection/spray subsystems inoperable for reasons other than Condition A.</p> <p><u>OR</u></p> <p>HPCI System and one or more ADS valves inoperable.</p> | <p>H.1 Enter LCO 3.0.3.</p> | <p>Immediately</p> |

3.6 CONTAINMENT SYSTEMS

3.6.2.3 Residual Heat Removal (RHR) Suppression Pool Cooling

LCO 3.6.2.3 Four RHR suppression pool cooling subsystems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|-----------------|
| A. One RHR suppression pool cooling subsystem inoperable. | A.1 Restore the RHR suppression pool cooling subsystem to OPERABLE status. | 30 days |
| B. Two RHR suppression pool cooling subsystems inoperable. | B.1 Restore one RHR suppression pool cooling subsystem to OPERABLE status. | 7 days |
| C. Three or more RHR suppression pool cooling subsystems inoperable. | C.1 Restore required RHR suppression pool cooling subsystems to OPERABLE status. | 8 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---------------------------------|-----------------|
| D. Required Action and associated Completion Time not met. | D.1 Be in MODE 3. | 12 hours |
| | <u>AND</u> D.2 Be in MODE 4. | 36 hours |

RHR Suppression Pool Spray
3.6.2.4

3.6 CONTAINMENT SYSTEMS

3.6.2.4 Residual Heat Removal (RHR) Suppression Pool Spray

LCO 3.6.2.4 Four RHR suppression pool spray subsystems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|-----------------|
| A. One RHR suppression pool spray subsystem inoperable. | A.1 Restore the RHR suppression pool spray subsystem to OPERABLE status. | 30 days |
| B. Two RHR suppression pool spray subsystems inoperable. | B.1 Restore one RHR suppression pool spray subsystem to OPERABLE status. | 7 days |
| C. Three or more RHR suppression pool spray subsystems inoperable. | C.1 Restore required RHR suppression pool spray subsystems to OPERABLE status. | 8 hours |
| D. Required Action and associated Completion Time not met | D.1 Be in MODE 3. AND | 12 hours |

3.6 CONTAINMENT SYSTEMS

3.6.2.5 Residual Heat Removal (RHR) Drywell Spray

LCO 3.6.2.5 Four RHR drywell spray subsystems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|-----------------|
| A. One RHR drywell spray subsystem inoperable. | A.1 Restore the RHR drywell spray subsystem to OPERABLE status. | 30 days |
| B. Two RHR drywell spray subsystems inoperable. | B.1 Restore one RHR drywell spray subsystem to OPERABLE status. | 7 days |
| C. Three or more RHR drywell spray subsystems inoperable. | C.1 Restore required RHR drywell spray subsystems to OPERABLE status. | 8 hours |
| D. Required Action and associated Completion Time not met. | D.1 Be in MODE 3. | 12 hours |
| | <u>AND</u> D.2 Be in MODE 4. | 36 hours |

3.6 CONTAINMENT SYSTEMS

3.6.2.6 Drywell-to-Suppression Chamber Differential Pressure

LCO 3.6.2.6 The drywell pressure shall be maintained ≥ 1.1 psid above the pressure of the suppression chamber.

-----NOTE-----

This differential may be decreased to < 1.1 psid for a maximum of 4 hours during required operability testing of the HPCI system, the RCIC system or the suppression chamber-to-drywell vacuum breakers.

APPLICABILITY: MODE 1 during the time period:

- a. From 24 hours after THERMAL POWER is $> 15\%$ RTP following startup, to
- b. 24 hours prior to reducing THERMAL POWER to $< 15\%$ RTP prior to the next scheduled reactor shutdown.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|-----------------|
| A. Drywell-to-suppression chamber differential pressure not within limit. | A.1 Restore differential pressure to within limit. | 8 hours |
| B. Required Action and associated Completion Time not met. | B.1 Reduce THERMAL POWER to $\leq 15\%$ RTP. | 12 hours |

| PRIMARY CONTAINMENT PRESSURE | | | | | PRIMARY CONTAINMENT HYDROGEN | | | | | |
|---|--------------|--|--------------|--|--|--|--|--|--|-------------------|
| Description | | | | | Description | | | | | |
| | | | | | | | | | | UNUSUAL EVENT |
| 2.1-A | | | TABLE | | | | | | | ALERT |
| Drywell pressure at or above 2.45 psig AND Indication of Primary System leakage into Primary Containment. Refer to Table 2.1-A. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | | | | | | |
| 2.1-S | CURVE | | | | 2.2-S | | | | | SITE EMERGENCY |
| Suppression Chamber pressure can NOT be maintained in the safe area of Curve 2.1-S. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | Drywell or Suppression Chamber hydrogen concentration at or above 4% AND Drywell or Suppression Chamber oxygen concentration at or above 5%. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | |
| 2.1-G | | | | | 2.2-G | | | | | GENERAL EMERGENCY |
| Suppression Chamber pressure can NOT be maintained below 55 psig. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | Drywell or Suppression Chamber hydrogen concentration at or above 6% AND Drywell or Suppression Chamber oxygen concentration at or above 5%. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | |

Facility: Browns Ferry NPP Scenario No.: C Op-Test No.: ILT 1102

FINAL

| | |
|------------|--|
| Examiners: | |
| | |
| | |

| | |
|------------|------|
| Operators: | SRO: |
| | ATC: |
| | BOP: |

Initial Conditions: IC192/ Unit 3 Reactor Power 86% / HPCI tagged out for PMs. Stator Water Cooling Pump 3B tagged out.

Turnover: BOP Operator - Perform 3-OI-3 Section 8.13 Automatic Start Test of RFPT 3A EBOP 3A3 Oil Pump. Perform Control Rod Pattern adjust IAW RCP.

| Event No. | Malf. No. | Event Type* | Event Description |
|-----------|-----------|-----------------|--|
| 1 | | N-BOP N-SRO | 8.13 Automatic Start Test of RFPT 3A Oil Pumps, 3-OI-3 |
| 2 | | R-ATC R-SRO | Perform Control Rod Pattern adjust IAW RCP |
| 3 | rd04r3823 | C-ATC TS-SRO | Final(4 th) Control Rod (38-23) manipulated continues to move 3 notches beyond intended position |
| 4 | rc09 | C-BOP TS-SRO | RCIC Room high temp / Fail to Isolate |
| 5 | fw05b | C-ALL | Loss of FW Heating 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate |
| 6 | fw18 | M-ALL | Feedwater Line Break in Turbine Bldg / Drywell leak Div 1 ECCS fails to initiate |
| 7 | ed12b | C | 480V RMOV Board 3B Supply Breaker Trip |
| 8 | cs04a | I | Loop I Core Spray Logic Power Failure |

* (N)ormal, (R)eactivity, (I)nstrument, (C)omponent, (M)ajor

Critical Tasks - Four

CT#1-With an injection system(s) operating and the reactor shutdown and at pressure, after RPV water level drops to -162 inches, initiate Emergency Depressurization before RPV level lowers to -180 inches.

1. Safety Significance:

Maintain adequate core cooling, prevent degradation of fission product barrier.

2. Cues:

Procedural compliance.

Water level trend.

3. Measured by:

Observation - At least 6 SRV's must be opened before RPV level lowers to -180 inches.

4. Feedback:

RPV pressure trend.

SRV status indications.

CT#2-With RPV pressure below the Shutoff Head of the available Low Pressure system(s), operate available Low Pressure system(s) to restore RPV water level above T.A.F. (-162 inches).

1. Safety Significance:

Maintaining adequate core cooling.

2. Cues:

Procedural compliance.

Pressure below low pressure ECCS system(s) shutoff head.

3. Measured by:

Operator manually starts or initiates at least one low pressure ECCS system and injects into the RPV to restore water level above -162 inches.

4. Feedback:

Reactor water level trend.

Reactor pressure trend.

Critical Tasks - Four

CT#3-With a primary system discharging into the secondary containment, take action to manually isolate the break.

1. Safety Significance:

Isolating high energy sources can preclude failure of secondary containment and subsequent radiation release to the public.

2. Cues:

Procedural compliance.
Area temperature indication.

3. Measured by:

With the reactor at pressure and a primary system discharging into the secondary containment, operator takes action to manually isolate the break.

4. Feedback:

Valve position indication

CT#4-To prevent an uncontrolled RPV depressurization when Reactor level cannot be restored and maintained above -162 inches, inhibit ADS .

1. Safety Significance:

Maintain adequate core cooling, prevent degradation of fission product barrier.

2. Cues:

Procedural compliance.

3. Measured by:

ADS logic inhibited prior to an automatic initiation.

4. Feedback:

RPV pressure trend.

RPV level trend.

ADS "ADS LOGIC BUS A/B INHIBITED" annunciator status.

Scenario Summary:

The Plant is operating at 86% Reactor Power.

The BOP Operator will perform Automatic Start Test of RFPT 3A EBOP 3A3 Oil Pump, 3-OI-3 Section 8.13

The ATC will adjust the Control Rod Pattern IAW RCP. When the 4th control rod is withdrawn, it will continue to move 3 notches beyond its intended positions. The ATC will completely insert the Control Rod IAW 3-AOI-85-6 or 3-AOI-85-7. Accumulator must be declared Inop if charging water is isolated. The SRO may declare the Control Rod Inoperable Technical Specification 3.1.3 condition C.

A RCIC Steam Line Break will result in high Room temperature with a failure of RCIC to Isolate. The BOP will isolate RCIC. The SRO will determine RCIC Isolation Valves inoperable and RCIC System inoperable. With HPCI already Inoperable, plant shutdown is required. Technical Specification 3.5.3 Condition B and 3.6.1.3 Condition A.

A tube leak on High Pressure Feedwater Heater B2 results in isolation of Extraction Steam to the heater. The crew will respond in accordance with 3-AOI-6-1A or 1C. The ATC will lower reactor power by 5%. The Operators refer to 3-AOI-6-1A or 1C and determine that all automatic actions failed to occur and the Operators isolate the Heater B2.

A Feedwater line break will occur in the Turbine Building. The Loss of Feedwater Flow 3-AOI-3-1 should be entered and a manual Scram inserted. EOI-1 will be entered on Reactor Level.

EOI-2 will be entered on High Drywell Pressure / Temperature. Actions of EOI-2 will be directed.

SRO will enter C-1 on lowering Reactor Level. CRD should be maximized and SLC should be initiated as Reactor Level continues to lower.

Reactor level will decrease to TAF and an Emergency Depressurization will be initiated per C-2.

Div 1 ECCS will fail to auto initiate and will have to be manually initiated.

Level will be restored with Low Pressure ECCS.

The Emergency Classification is 1.1-S1

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted

Emergency Depressurization complete

Reactor Level is restored and maintained

SCENARIO REVIEW CHECKLIST

SCENARIO NUMBER: 3-C

- 7 Total Malfunctions Inserted: List (4-8)
- 3 Malfunctions that occur after EOI entry: List (1-4)
- 3 Abnormal Events: List (1-3)
- 1 Major Transients: List (1-2)
- 3 EOI's used: List (1-3)
- 2 EOI Contingencies used: List (0-3)
- 70 Validation Time (minutes)
- 3 Crew Critical Tasks: (2-5)

YES Technical Specifications Exercised (Yes/No)

Scenario Tasks

| <u>EVENT</u> | <u>TASK NUMBER</u> | <u>K/A</u> | <u>RO</u> | <u>SRO</u> |
|--------------|---|--------------|-----------|------------|
| 1 | Automatic Start Test of RFPT 3A Oil Pumps | | | |
| | RO U-003-NO-30 | 259001K4.06 | 2.5 | 2.6 |
| 2 | Control Rod Pattern Adjustment | | | |
| | RO U-085-NO-07 | | | |
| | SRO S-000-AD-31 | 2.2.2 | 4.6 | 4.1 |
| 3 | Control Rod Mispositioned or Drift | | | |
| | RO U-085-AB-07 | 295014AA1.03 | 3.5 | 3.5 |
| | SRO S-085-AB-07 | | | |
| 4 | RCIC Steam Leak | | | |
| | RO U-071-AL-19 | 295032EA1.05 | 3.7 | 3.9 |
| | SRO S-000-EM-12 | | | |
| 5 | Loss of Feedwater Heating | | | |
| | RO U-006-AB-01 | 2.1.43 | 4.1 | 4.3 |
| | SRO S-006-AB-01 | | | |
| 6 | Feedwater Line Break | | | |
| | RO U-000-EM-18 | 295031EA2.04 | 4.6 | 4.8 |
| | SRO S-000-EM-19 | | | |
| | SRO T-000-EM-15 | | | |

Procedures Used/Referenced:

| Procedure Number | Procedure Title | Procedure Revision |
|-------------------|---|--------------------|
| 3-OI-3 | Reactor Feedwater System | Revision 82 |
| 3-GOI-100-12 | Power Maneuvering | Revision 35 |
| 3-OI-85 | Control Rod Drive System | Revision 70 |
| 3-ARP-9-5A | Alarm Response Procedure Panel 3-9-5A | Revision 41 |
| 3-AOI-85-6 | Rod Drift Out | Revision 9 |
| 3-AOI-85-7 | Mispositioned Control Rod | Revision 5 |
| TS 3.1.3 | Control Rod Operability | Amendment 212 |
| 3-ARP-9-3A | Alarm Response Procedure Panel 3-9-3A | Revision 43 |
| 3-ARP-9-3D | Alarm Response Procedure Panel 3-9-3D | Revision 28 |
| 3-EOI-3 | Secondary Containment Control Flowchart | Revision 9 |
| 3-EOI-APPENDIX-8F | Restoring Refuel Zone and Reactor Zone Ventilation Fans Following Group 6 Isolation | Revision 2 |
| TS 3.5.3 | RCIC System | Amendment 244 |
| TS 3.6.1.3 | Primary Containment Isolation Valves | Amendment 212 |
| 3-ARP-9-6A | Alarm Response Procedure Panel 3-9-6A | Revision 20 |
| 3-AOI-6-1A | High Pressure Feedwater Heater String/Extraction Steam Isolation | Revision 18 |
| 3-AOI-6-1C | High and Low Pressure Feedwater Heater String/Extraction Steam Isolation | Revision 15 |
| 3-OI-6 | Feedwater Heating and Misc Drains System | Revision 67 |
| 3-ARP-9-5A | Alarm Response Procedure Panel 3-9-5A | Revision 41 |
| 3-ARP-9-6C | Alarm Response Procedure Panel 3-9-6C | Revision 21 |
| 3-EOI-1 | RPV Control Flowchart | Revision 8 |
| 3-EOI-APPENDIX-5B | Injection System Lineup CRD | Revision 1 |
| 3-EOI-APPENDIX-7B | Alternate RPV Injection System Lineup SLC System | Revision 2 |
| 3-EOI-3-C-1 | Alternate Level Control Flowchart | Revision 9 |
| 3-EOI-3-C-2 | Emergency RPV Depressurization Flowchart | Revision 8 |
| 3-EOI-APPENDIX-6B | Injection Subsystems Lineup RHR System I LPCI Mode | Revision 3 |

Procedures Used/Referenced Continued:

| Procedure Number | Procedure Title | Procedure Revision |
|-------------------------|--|---------------------------|
| 3-EOI-APPENDIX-6D | Injection Subsystems Lineup Core Spray System I | Revision 3 |
| 3-EOI-2 | Primary Containment Control Flowchart | Revision 7 |
| EPIP-1 | Emergency Classification Procedure Event Classification Matrix | Revision 46 |
| EPIP-4 | Site Area Emergency | Revision 32 |
| 3-AOI-100-1 | Reactor Scram | Revision 53 |

Console Operator Instructions

Scenario File Summary

File: batch and trigger files for scenario 3-C

Batch nrc2011c

#hpci tagout
bat nrc2011hpcito

Batch nrc2011hpcito

ior zdihs732 close
ior zdihs733a close
ior zdihs7381a close
ior zlohs7347a[1] off
ior ypovfcv732 (none 30) fail_now
ior ypovfcv733 (none 30) fail_now
ior ypovfcv7381 (none 30) fail_now

#stator water pump b tagout
ior zlohs3536a[1] off
ior zlohs3536a[2] off

#CR Drift
imf rd04r3823 (e1 0)

#RCIC leak fail to isolate
imf rc09 (e5 0) 100 120
imf rc10

#Loss of Feedwater Heating
imf fw05b (e10 0) 100 300 75
ior ypovfcv0521 fail_power_now
ior zlohs0521a[2] on
trg 11 nrc20110521
trg 11 = bat nrc2011c1

Trigger nrc20110521
zdihs0521a[1].eq.1

Batch nrc2011c1
dor ypovfcv0521
dor zlohs0521a[2]

#Major

imf fw18 (e20 0) 50 300

imf th21 (e25 30) .1 360

imf cs04a

imf ed12b (e20 300)

ior xa553c[27] alarm_off

ior xa553c[14] alarm_off

ior zloil7561a[1] off

ior zloil7561b[1] off

trg 21 nrc20117525

trg 21 = bat nrc2011c2

Trigger nrc20117525

zdihs7525a[3] .eq. 1

Batch nrc2011c2

dmf cs04a

Console Operator Instructions

Scenario 3-C

| | | <u>DESCRIPTION/ACTION</u> |
|-----------------|-------------------|--|
| Simulator Setup | manual | Reset to IC192 |
| Simulator Setup | Load Batch | Bat nrc2011c |
| Simulator Setup | manual | Clearance out HPCI |
| Simulator Setup | manual | Clearance out Stator Water Cooling Pump 3B |
| Simulator Setup | | Verify batch file loaded |

RCP required (86% Power with Control Rod Pattern Adjust) – Provide marked up copy of 3-GOI-100-12 and RCP for Urgent Load Reduction.

Simulator Event Guide:

Event 1 Normal: Automatic Start Test of RFPT 3A EBOP 3A3 Oil Pump
per 3-OI-3 Section 8.13

| | |
|-----|---|
| SRO | Direct BOP to perform Automatic Start Test of RFPT 3A EBOP 3A3 Oil Pump per 3-OI-3 Section 8.13 |
| BOP | <p>8.13 Automatic Start Test of RFPT 3A Oil Pumps</p> <p>[1] OBTAIN Unit Supervisor approval to perform this test.</p> <p>[2] VERIFY the following switches in Normal after START or STOP:</p> <ul style="list-style-type: none"> • RFPT 3A 3A1 MAIN OIL PUMP, 3-HS-3-103A • RFPT 3A 3A2 MAIN OIL PUMP, 3-HS-3-250A <p>[3] VERIFY RFPT 3A EBOP 3A3, 3-HS-3-102A, in AUTO.</p> <p>[4] TEST EBOP 3A3 as follows:</p> <p>[4.1] DEPRESS and HOLD 3A3 EBOP TEST push-button, 3-HS-3-105A.</p> <p>[4.2] VERIFY the following:</p> <ul style="list-style-type: none"> • Red (running) light and amber (auto start) light at push-button illuminated. • RFPT OIL PUMP AUTO START annunciation, 3-XA-55-6B Window 29, in alarm. <p>[4.3] RELEASE 3A3 EBOP TEST push-button, 3-HS-3-105A.</p> <p>[4.4] PLACE RFPT 3A EBOP 3A3 switch, 3-HS-3-102A, in START (return to AUTO).</p> <p>[4.4.1] VERIFY the following:</p> <ul style="list-style-type: none"> • Amber (auto start) light extinguished at 3A3 EBOP TEST push-button, 3-HS-3-105A. • RFPT OIL PUMP AUTO START annunciation, 3-XA-55-6B Window 29, will reset. <p>[4.5] PLACE RFPT 3A EBOP 3A3, 3-HS-3-102A, in STOP (return to AUTO).</p> <ul style="list-style-type: none"> • CHECK Red light extinguished at 3A3 EBOP TEST push-button. |
| BOP | Perform 3-OI-3 section 8.13 steps 1-4 to Test Automatic Start of RFPT 3A EBOP 3A3 Oil Pump |

Simulator Event Guide:

Event 2 Reactivity: Raise Reactor Power after Completion of Control Rod Pattern Adjustment per 3-GOI-100-12 and in accordance with the RCP

| | | |
|--|-----|---|
| | SRO | Notify ODS of Power Increase |
| | | <p>Direct Power Increase after Control Rod Pattern Adjustment per 3-GOI-100-12 section 5.0 step 21</p> <p>5.0 INSTRUCTION STEPS</p> <p>[21] WHEN desired to restore Reactor power to 100%, THEN</p> <p>PERFORM the following as directed by Unit Supervisor and recommended by the Reactor Engineer:</p> <ul style="list-style-type: none"> • RAISE power using control rods or core flow changes. REFER TO 3-SR-3.3.5(A) and 3-OI-68. • MONITOR Core thermal limits using Illustration 1, ICS, and/or 0-TI-248 |
| | ATC | <p>Raise Power with Control Rods per 3-OI-85, section 6.6. Control Rods to be withdrawn: 22-23, 22-39, 38-39 and 38-23 start at 00 and go to 10.</p> |
| | ATC | <p>6.6.1 Initial Conditions Prior to Withdrawing Control Rods</p> <p>[2] VERIFY the following prior to control rod movement:</p> <ul style="list-style-type: none"> • CRD POWER, 3-HS-85-46 in ON. • Rod Worth Minimizer is operable and LATCHED into the correct ROD GROUP when Rod Worth Minimizer is enforcing (not required with no fuel in RPV). <p>6.6.2 Actions Required During and Following Control Rod Withdrawal</p> <p>[4] OBSERVE the following during control rod repositioning:</p> <ul style="list-style-type: none"> • Control rod reed switch position indicators (four rod display) agree with the indication on the Full Core Display. • Nuclear Instrumentation responds as control rods move through the core (This ensures control rod is following drive during Control Rod movement.) <p>[5] ATTEMPT to minimize automatic RBM Rod Block as follows:</p> <ul style="list-style-type: none"> • STOP Control Rod withdrawal (if possible) prior to reaching any RBM Rod Block using the RBM displays on Panel 3-9-5 and PERFORM Step 6.6.2[6]. |

Simulator Event Guide:

Event 2 Reactivity: Raise Reactor Power after Completion of Control Rod Pattern Adjustment per 3-GOI-100-12 and in accordance with the RCP

| | |
|-----|---|
| ATC | <p>6.6.2 Actions Required During and Following Control Rod Withdrawal (contd)</p> <p>[6] IF Control Rod movement was stopped to keep from exceeding a RBM setpoint or was caused by a RBM Rod Block, THEN</p> <p>PERFORM the following at the Unit Supervisor's discretion to "REINITIALIZE" the RBM:</p> <p>[6.1] PLACE CRD POWER, 3-HS-85-46 in the OFF position to deselect the Control Rod.</p> <p>[6.2] PLACE CRD POWER, 3-HS-85-46, in the ON position.</p> <p>6.6.3 Control Rod Notch Withdrawal</p> <p>[1] SELECT the desired control rod by depressing the appropriate CRD ROD SELECT pushbutton, 3-XS-85-40.</p> <p>[2] OBSERVE the following for the selected control rod:</p> <ul style="list-style-type: none">• CRD ROD SELECT pushbutton is brightly ILLUMINATED• White light on the Full Core Display ILLUMINATED• Rod Out Permit light ILLUMINATED <p>[4] PLACE CRD CONTROL SWITCH, 3-HS-85-48, in ROD OUT NOTCH, and RELEASE.</p> <p>[5] OBSERVE the control rod settles into the desired position and the ROD SETTLE light extinguishes.</p> |
|-----|---|

Simulator Event Guide:

Event 2 Reactivity: Raise Reactor Power after Completion of Control Rod Pattern Adjustment per 3-GOI-100-12 and in accordance with the RCP

| | | |
|--|--------|--|
| | ATC | <p>6.6.5 Return to Normal After Completion of Control Rod Withdrawal [1] WHEN control rod movement is no longer desired AND deselecting control rods is desired, THEN:</p> <p>[1.1] PLACE CRD POWER, 3-HS-85-46, in OFF.</p> <p>[1.2] PLACE CRD POWER, 3-HS-85-46, in ON.</p> |
| | DRIVER | <p>When ATC withdraws the Final (4th) rod (38-23) Insert trigger 1, Rod will continue to move 3 Notches beyond intended position. After Control Rod 38-23 reaches position 14 delete malfunction rd04r3823 from the malfunction menu. Want rod to go at least 3 notches past intended position of 10, eg position 16.</p> |

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | |
|--------|--|
| DRIVER | When ATC withdraws the Final (4 th) rod (38-23) Insert trigger 1, Rod will continue to move 3 Notches beyond intended position. After Control Rod 38-23 reaches position 14 delete malfunction rd04r3823 from the malfunction menu. Want rod to go at least 3 notches past intended position of 10, eg position 16. |
| ATC | Reports CONTROL ROD DRIFT alarm and Control Rod 38-23 has drifted out 3 notches from intended position |
| SRO | Directs ATC to respond per ARP and 3-AOI-85-6 and/or 3-AOI-85-7 |
| ATC | <p>3-ARP-9-5A window 28 CONTROL ROD DRIFT</p> <p>A. DETERMINE which rod is drifting from Full Core Display.</p> <p>B. IF no control rod motion is observed, THEN RESET rod drift as follows: 1. PLACE ROD DRIFT ALARM TEST switch, 3-HS-85-3A-S7, in RESET and RELEASE. 2. RESET the annunciator.</p> <p>C. IF rod drifting in, THEN REFER TO 3-AOI-85-5 and 3-AOI-85-7</p> <p>D. IF rod drifting out, THEN REFER TO 3-AOI-85-6 and 3-AOI-85-7.</p> <p>E. REFER TO Tech Spec Section 3.1.3, 3.10.8.</p> |
| ATC | <p>Resets the CONTROL ROD DRIFT alarm when rod motion has stopped by placing the ROD DRIFT ALARM TEST switch, 3-HS-85-3A-S7, in RESET and RELEASE. Then resets the annunciator</p> <p>Responds per 3-AOI-85-6 and/or 3-AOI-85-7</p> <p>Monitors Full Core Display for a second Control Rod Drift as per Immediate Actions of 3-AOI-85-6</p> |
| NRC | NOTE: If crew identifies Control Rod 38-23 as a drift this is the correct AOI. If the crew identifies Control Rod 38-23 as Mispositioned then refer to Page 19 |
| ATC | <p>3-AOI-85-6 Control Rod Drift 4.1 Immediate Actions</p> <p>[1] IF multiple control rod drifts are identified, THEN</p> <p>MANUALLY SCRAM the reactor and enter 3-AOI-100-1.</p> |

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | |
|-----|--|
| ATC | <p>3-AOI-85-6 Control Rod Drift (continued)</p> <p>4.2 Subsequent Actions</p> <p>[1] IF a Control Rod is moving from its intended position without operator actions, THEN</p> <p>SELECT the drifting control rod and INSERT to the FULL IN (00) position.</p> <p>[2] IF control rod drive does NOT respond to INSERT signal, THEN</p> <p>[3] NOTIFY the Reactor Engineer to Evaluate Core Thermal Limits and Preconditioning Limits for the current Control Rod pattern.</p> <p>[4] IF another Control Rod Drift occurs before Reactor Engineering completes the evaluation, THEN</p> <p>MANUALLY SCRAM Reactor and enter 3-AOI-100-1.</p> <p>[5] IF the control rod will not latch into position "00" and continues to demonstrate occurrences of inadvertent withdrawal, THEN</p> <p>[6] IF the control rod is latched into position "00", THEN REMOVE associated HCU from service per 3-OI-85.</p> <p>[7] EVALUATE Tech Spec 3.1.3.</p> <p>[8] INITIATE Service Request/Work Order.</p> |
|-----|--|

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | |
|-----|--|
| ATC | <p>3-AOI-85-6 Control Rod Drift (continued) 4.2 Subsequent Actions(continued) [9] NOTIFY Reactor Engineer to perform the following for current condition:</p> <ul style="list-style-type: none"> • EVALUATE condition of core to assure no resultant fuel damage has occurred. • EVALUATION of impact on thermal limits and PCIOMOR restraints. (N/A if scram was initiated.) • DETERMINE if other control rods need to be repositioned in order to safely restore core symmetry to prevent local fuel damage. (N/A if scram was initiated.) <p>[10] NOTIFY System Engineering to PERFORM 0-TI-20, Control Rod Drive System Testing and Troubleshooting to determine problem with faulty control rod.</p> <p>[11] IF a manual scram was not inserted and Reactor Startup or Shutdown is not in progress, THEN</p> <p>[12] WHEN control rod fault has been corrected, THEN</p> <p>[13] NOTIFY Reactor Engineer to EVALUATE impact on preconditioning envelope, prior to returning to normal power operation.</p> |
| ATC | <p>Selects Control Rod 38-23 and inserts to position 00</p> <p>Notifies the Reactor Engineer to Evaluate Core Thermal Limits and Preconditioning Limits for the current Control Rod pattern.</p> <p>Removes the associated HCU from service per 3-OI-85</p> |

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | | |
|--|---------------|--|
| | DRIVER | As Reactor Engineer inform that Core Thermal Limits and Preconditioning Limits for the current Control Rod pattern will be evaluated. |
| | SRO | <p>Evaluates Tech Spec 3.1.3 Condition C</p> <p>Initiates Work Order/Service Request</p> <p>Notifies Reactor Engineer to perform the following for current condition:</p> <ul style="list-style-type: none"> • Evaluation of condition of core to assure no resultant fuel damage has occurred. • Evaluation of impact on thermal limits and PCIOMOR restraints. • Determination if other control rods need to be repositioned in order to safely restore core symmetry to prevent local fuel damage. <p>Notifies System Engineering to perform 0-TI-20, Control Rod Drive System Testing and Troubleshooting to determine problem with faulty control rod.</p> <p>Enters 3-GOI-100-12, Power Maneuvering, for the power change that occurred.</p> <p>Directs associated HCU removed from service per 3-OI-85</p> |
| | DRIVER | <p>If contacted, as Reactor Engineer inform that all conditions listed above will be evaluated.</p> <p>If contacted, as Work Control inform that you will get working on a Work Order/SR.</p> <p>If contacted, as System Engineering inform that you will perform 0-TI-20.</p> |
| | SRO | The SRO may direct entry into 3-AOI-85-7, Mispositioned Control Rod, if so the following procedure will be used. |
| | ATC | <p>3-AOI-85-7 Mispositioned Control Rod</p> <p>4.1 Immediate Actions</p> <p>None</p> <p>4.2 Subsequent Actions</p> <p>[1] STOP all intentional control rod movement.</p> <p>[2] IF Control Rod is determined to be mispositioned, THEN</p> <p>NOTIFY the following:</p> <ul style="list-style-type: none"> • Reactor Engineer (RE), • Shift Technical Advisor (STA), • Unit Supervisor • Shift Manager (SM) • Operations Superintendent. [INPO SOER 84-002] |

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | |
|------------|--|
| <p>ATC</p> | <p>4.2 Subsequent Actions (continued)</p> <p>[3] IF the Control Rod is > 2 notches from the intended position, THEN</p> <p>PERFORM the following: (Otherwise N/A)</p> <p>[3.1] INSERT the mispositioned rod to "00".</p> <p>[3.2] IF a Reactor Startup or Shutdown is not in progress, THEN (Otherwise N/A)</p> <p>[4] IF the Control Rod is less than or equal to 2 notches from the intended position, THEN (Otherwise N/A)</p> <p>[5] CHECK the following radiation recorders for a rise in activity to determine if any fuel damage occurred:</p> <ul style="list-style-type: none"> • MAIN STEAM LINE RADIATION, 3-RR-90-135 (Panel 3-9-2) • OFFGAS RADIATION, 3-RR-90-266, on Panel 3-9-2. • OFFGAS RADIATION, 3-RR-90-160 (Panel 3-9-2) • OFFGAS PRETREATMENT RADIATION, 3-RR-90-157 (Panel 3-9-2) <p>[6] IF there is any evidence of fuel damage, THEN</p> <p>[7] INTIATE a Service Request/PER for Control Rod error or mispositioned Control Rod.</p> <p>[8] IF possible, THEN DETERMINE how long the rod has been mispositioned</p> <p>[9] NOTIFY Reactor Engineer to perform the following when time permits:</p> <ul style="list-style-type: none"> • EVALUATE the possible consequences • DOCUMENT in Reactor Engineer log. |
|------------|--|

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | |
|--------|--|
| SRO | <p>Directs ATC to stop all intentional Control Rod Movement</p> <p>Informs all positions listed in step 2 of Subsequent Actions of Mispositioned Control Rod</p> <p>Directs ATC to Insert Mispositioned Control Rod to 00</p> <p>Enters 3-GOI-100-12, Power Maneuvering</p> <p>Initiates Service Request and Notifies Reactor Engineer to evaluate the possible consequences and document in the Reactor Engineering Log</p> |
| DRIVER | <p>The SRO will direct the associated HCU removed from service if 3-AOI-85-6 is entered. Acknowledge order to remove HCU from service, verify what steps in 3-OI-85 will be used to isolate the HCU. Wait 20 minutes, then insert malfunction rd08 to bring in accumulator low pressure alarm and report HCU removed from service</p> |
| DRIVER | <p>When directed by NRC insert Trigger 5 for RCIC steam leak with failure to auto isolate.</p> |
| SRO | <p>Evaluate Tech Spec 3.1.3</p> |
| | <p>Condition C One or more control rods inoperable for reasons other than Condition A or B</p> <p>Required Action C.1 Fully Insert inoperable control rod</p> <p>Completion Time 3 Hours</p> <p style="text-align: center;">AND</p> <p>Required Action C.2 Disarm the associated CRD</p> <p>Completion Time 4 Hours</p> |

Simulator Event Guide:

Event 3 Component: Final(4th) Control Rod manipulated continues to move 3 notches beyond intended position

| | | |
|--|--------|--|
| | ATC | <p>Stops all intentional control rod movement</p> <p>When directed inserts Control Rod to Position 00</p> <p>Evaluates Radiation Recorders to determine if Fuel Damage Exists and determines how long rod has been mispositioned.</p> |
| | DRIVER | <p>Acknowledge all positions informed in step 2 of Subsequent Actions.</p> <p>If, contacted, as Work Control inform that you will get working on a Work Order/Service Request.</p> <p>If contacted, as Reactor Engineer inform that you will evaluate all conditions listed above.</p> |
| | DRIVER | <p>When directed by NRC insert Trigger 5 for RCIC steam leak with failure to auto isolate.</p> |

Simulator Event Guide:

Event 4 Component: RCIC Room high temp / Fail to Isolate (Leak downstream of Isolation valves)

| | | |
|--|---------------|--|
| | DRIVER | When directed by NRC insert Trigger 5 for RCIC steam leak with failure to auto isolate. |
| | BOP | <p>Respond to Annunciator RX BLDG AREA RADIATION HIGH</p> <p>A. DETERMINE area with high radiation level on Panel 3-9-11. (Alarm on Panel 3-9-11 will automatically reset if radiation level lowers below setpoint.)</p> <p>C. NOTIFY RADCON.</p> <p>D. IF the TSC is NOT manned and a "VALID" radiological condition exists., THEN USE public address system to evacuate area where high airborne conditions exist.</p> |
| | BOP | Determine RCIC Area Radiation Monitor is in Alarm and report, Evacuate affected area and notify radiation protection. |
| | BOP | <p>Respond to annunciator RCIC STEAM LINE LEAK DETECTION TEMP HIGH</p> <p>If temperature continues to rise it will cause isolation of the following valves at steam line space temperature of 165°F Torus Area or 165°F RCIC Pump Room.</p> <ul style="list-style-type: none"> • RCIC STEAM LINE INBD ISOLATION VLV, 3-FCV-71-2 • RCIC STEAM LINE OUTBD ISOLATION VLV, 3-FCV-71-3 <p>A. CHECK RCIC temperature switches on LEAK DETECTION SYSTEM TEMPERATURE indicator, 3-TI-69-29 on Panel 3-9-21.</p> <p>B. IF RCIC is NOT in service AND 3-FI-71-1A(B), RCIC STEAM FLOW indicates flow, THEN ISOLATE RCIC and VERIFY temperatures lowering.</p> <p>C. IF high temperature is confirmed, THEN ENTER 3-EOI-3 Flowchart.</p> <p>D. CHECK CS/RCIC ROOM EI 519 RX BLDG radiation indicator, 3-RI-90-26A on Panel 3-9-11 and NOTIFY RADCON if rising radiation levels are observed.</p> <p>E. DISPATCH personnel to investigate.</p> |

Simulator Event Guide:

Event 4 Component: RCIC Room high temp / Fail to Isolate (Leak downstream of Isolation valves)

| | | |
|--|---------|---|
| | BOP | Reports rising temperature in RCIC, reports RCIC failed to isolate and isolates RCIC Steam Line |
| | SRO | Enter EOI-3 on Secondary Containment Area Radiation |
| | DRIVER | If dispatched to RCIC area report after 5 minutes that cannot access area at this time. |
| | SRO | If Reactor Zone or Refuel Zone Exhaust Radiation Level is above 72 mr/hr. Then verify isolation of Reactor Zone or Refuel Zone and verify SGTS initiates |
| | | If above 72 mr/hr direct Operator to verify isolation of ventilation system and SGTS initiated |
| | ATC/BOP | Verifies Reactor Zone and Refuel Zone Ventilation Systems isolated and SGTS initiated |
| | SRO | If Reactor Zone or Refuel Zone Exhaust Ventilation isolated and ventilation radiation levels are below 72 mr/hr Then Restart Reactor Zone and Refuel Zone Ventilation per Appendix 8F |
| | | If ventilation isolated and below 72 mr/hr directs Operator to perform Appendix 8F |
| | SRO | <p>Enters EOI-3 on High Secondary Containment Temperature</p> <p>Secondary Containment Temperature</p> <p>Monitor and Control Secondary Containment Temperature</p> <p>Operate available ventilation per Appendix 8F</p> <p>Is Any Area Temp Above Max Normal - YES</p> <p>Isolate all systems that are discharging into the area except systems required to:</p> <ul style="list-style-type: none"> • Be operated by EOIs <p style="text-align: center;">OR</p> <ul style="list-style-type: none"> • Suppress a Fire |
| | CT#3 | Isolates RCIC Steam Lines and reports Temperatures and Radiation Levels lowering |
| | SRO | <p>Evaluates Technical Specification 3.6.1.3 Condition B</p> <p>Condition B One or more penetration flow paths with two PCIVs inoperable except due to MSIV leakage not within limits.</p> <p>Required Action B.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> <p>Completion Time 1 Hour</p> |

Simulator Event Guide:

Event 4 Component: RCIC Room high temp / Fail to Isolate (Leak downstream of Isolation valves)

| | |
|-----|---|
| SRO | <p>Evaluates Technical Specification 3.5.3 Condition A</p> <p>Condition A RCIC System Operable</p> <p>Required Action A.1 Verify by administrative means that HPCI is operable</p> <p>Completion Time Immediately</p> <p style="text-align: center;">AND</p> <p>Required Action A.2 Restore RCIC system to operable status</p> <p>Completion Time 14 Days</p> |
| | <p>Evaluate Technical Specification 3.5.3 Condition B</p> <p>Condition B Required Action and associated completion time not met</p> <p>Required Action B.1 Be in Mode 3</p> <p>Completion Time 12 Hours</p> <p style="text-align: center;">AND</p> <p>Required Action B.2 Reduce Reactor Steam Dome Pressure to < or equal to 150 PSIG</p> <p>Completion Time 36 Hours</p> |
| SRO | <p>Enters EOI-3 on High Secondary Containment Temperature (continued)</p> <p>Secondary Containment Radiation</p> <p>Monitor and Control Secondary Containment Radiation Levels</p> <p>Is Any Area Radiation Level Max Normal - NO</p> <p>Isolate all systems that are discharging into the area except systems required to:</p> <ul style="list-style-type: none"> • Be operated by EOIs <p style="text-align: center;"><u>OR</u></p> <ul style="list-style-type: none"> • Suppress a Fire |
| | <p>Ensures no systems are still discharging to Secondary Containment, remains in EOI-3 until entry conditions are cleared.</p> |
| SRO | <p>Enters EOI-3 on High Secondary Containment Temperature (continued)</p> <p>Secondary Containment Level</p> <p>Monitor and Control Secondary Containment Water Levels</p> <p>Is Any Floor Drain Sump Above 66 inches - NO</p> <p style="text-align: center;"><u>AND</u></p> <p>Is Any Area Water Level Above 2 inches - NO</p> |
| | |

Simulator Event Guide:

Event 4 Component: RCIC Room high temp / Fail to Isolate (Leak downstream of Isolation valves)

| | | |
|--|----------------------|---|
| | <p>ATC/BOP</p> | <p>3-EOI Appendix 8F</p> <ol style="list-style-type: none"> 1. VERIFY PCIS Reset. 2. PLACE Refuel Zone Ventilation in service as follows (Panel 3-9-25): <ol style="list-style-type: none"> a. VERIFY 3-HS-64-3A, REFUEL ZONE FANS AND DAMPERS, control switch is in OFF. b. PLACE 3-HS-64-3A, REFUEL ZONE FANS AND DAMPERS, control switch to SLOW A (SLOW B). c. CHECK two SPLY/EXH A(B) green lights above 3-HS-64-3A, REFUEL ZONE FANS AND DAMPERS, control switch extinguish and two SPLY/EXH A(B) red lights illuminate. d. VERIFY OPEN the following dampers: <ul style="list-style-type: none"> • 3-FCO-64-5, REFUEL ZONE SPLY OUTBD ISOL DMPR • 3-FCO-64-6, REFUEL ZONE SPLY INBD ISOL DMPR • 3-FCO-64-9, REFUEL ZONE EXH OUTBD ISOL DMPR • 3-FCO-64-10, REFUEL ZONE EXH INBD ISOL DMPR. 3. PLACE Reactor Zone Ventilation in service as follows (Panel 3-9-25): <ol style="list-style-type: none"> a. VERIFY 3-HS-64-11A, REACTOR ZONE FANS AND DAMPERS, control switch is in OFF. b. PLACE 3-HS-64-11A, REACTOR ZONE FANS AND DAMPERS, control switch in SLOW A (SLOW B). c. CHECK two SPLY/EXH A(B) green lights above 3-HS-64-11A, REACTOR ZONE FANS AND DAMPERS, control switch extinguish and two SPLY/EXH A(B) red lights illuminate. d. VERIFY OPEN the following dampers: <ul style="list-style-type: none"> • 3-FCO-64-13, REACTOR ZONE SPLY OUTBD ISOL DMPR • 3-FCO-64-14, REACTOR ZONE SPLY INBD ISOL DMPR • 3-FCO-64-42, REACTOR ZONE EXH INBD ISOL DMPR • 3-FCO-64-43, REACTOR ZONE EXH OUTBD ISOL DMPR. |
| | <p>DRIVER</p> | <p>When directed by NRC insert Trigger 10 for Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate</p> |

Simulator Event Guide:

Event 5 Component: Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate

| | |
|---------|--|
| DRIVER | When directed by NRC insert Trigger 10 for Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate. |
| ATC/BOP | <p>Announces "BYPASS VALVE TO CONDENSER NOT CLOSED" and refers to 3-ARP-9-6A, window 18.</p> <p>A. CHECK heater high or low level or moisture separator high or low level alarm window illuminated on Panel 3-9-6 or 3-9-7 to identify which bypass valve is opening.</p> <p>B. CHECK ICS to determine which bypass valve is open.</p> <p>C. DISPATCH personnel to check which valve's light is extinguished on junction box 34-21, Col T-13 J-LINE, elevation 565'.</p> |
| DRIVER | Acknowledge dispatch, wait 1-2 minutes and report 3-LCV-6-22B light is out on junction box 34-21. |
| ATC/BOP | <p>Announces "HEATER B2 LEVEL HIGH" and refers to 3-ARP-9-6A window 9.</p> <p>A. CHECK the following indications:</p> <ul style="list-style-type: none"> • Condensate flow recorder 2-29, Panel 3-9-6. Rising flow is a possible indication of a tube leak. • Heater B2 shell pressure, 3-PI-5-22 and drain cooler B5 flow, 3-FI-6-34, Panel 3-9-6. High or rising shell pressure or drain cooler flow is possible indication of a tube leak. <p>B. CHECK drain valve 3-FCV-6-95 open.</p> <p>C. CHECK level on ICS screen, FEEDWATER HEATER LEVEL (FWHL).</p> <ul style="list-style-type: none"> • IF the 3B2 heater indicates HIGH (Yellow), THEN VERIFY proper operation of the Drain and Dump Valves. • DISPATCH personnel to local Panel 3-LPNL-925-562C to VERIFY and MANUALLY control the level. <p>D. IF a valid HIGH HIGH level is received, THEN GO TO 3-AOI-6-1A or 3-AOI-6-1C.</p> |
| ATC/BOP | <p>Checks condensate flow recorder, Heater B2 shell pressure and Drain Cooler B5 flow for indications of a tube leak</p> <p>Checks drain valve 3-FCV-6-95 open</p> <p>Checks 3B2 Heater level on ICS and dispatches personnel to verify and manually control level</p> |
| DRIVER | Acknowledge order to verify and manually control level on B2 Heater. Wait 6 minutes and report unable to take manual control of B2 Heater. |

Simulator Event Guide:

Event 5 Component: Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate

| | | |
|--|---------|---|
| | ATC/BOP | Announces B1 and B2 High Pressure Heater Extraction Isolation |
| | SRO | Directs crew to enter 3-AOI-6-1A or 3-AOI-6-1C |
| | ATC/BOP | <p>3-AOI-6-1A High Pressure Feedwater Heater String/Extraction Steam Isolation</p> <p>4.1 Immediate Actions</p> <p>[1] REDUCE Core Thermal Power to $\geq 5\%$ below initial power level to maintain thermal margin.</p> <p>4.2 Subsequent Actions</p> <p>[1] REFER TO 3-OI-6 for turbine/heater load restrictions.</p> <p>[2] REQUEST Reactor Engineer EVALUATE and ADJUST thermal limits, as required.</p> <p>[3] ADJUST reactor power and flow as directed by Reactor Engineer/Unit Supervisor to stay within required thermal and feedwater temperature limits. REFER TO 3-GOI-100-12 or 3-GOI-100-12A for the power reduction.</p> <p>[4] ISOLATE heater drain flow from the feedwater heater string that isolated by closing the appropriate FEEDWATER HEATER A-2(B-2) or (C-2) DRAIN TO HTR A-3(B-3) or (C-3), 3-FCV-6-94(95) or (96).</p> <p>[5] IF a tube leak is indicated, THEN</p> <p>PERFORM manual actions of Attachment 1 for affected heaters.</p> <p>[6] VERIFY automatic actions occur. REFER TO Attachment 1.</p> <p>[7] MONITOR TURB THRUST BEARING TEMPERATURE, 3-TR-47-23, for rises in metal temperature and possible active/passive plate reversal.</p> <p>[8] DETERMINE cause which required heater isolation and PERFORM necessary corrective action.</p> |

Simulator Event Guide:

Event 5 Component: Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate

| | | | | | | | |
|----------------------|--|---------------|---------------|---------------|---------------|----------------------|---------------|
| ATC/BOP | <p>3-AOI-6-1A High Pressure Feedwater Heater String/Extraction Steam Isolation (continued)</p> <p>4.2 Subsequent Actions (continued)</p> <p>[9] WHEN the condition which required heater isolation is no longer required, THEN</p> <p>RESTORE affected heater. REFER TO 3-OI-6.</p> | | | | | | |
| ATC BOP | <p>Lower Reactor Power greater than 5% below initial power level using Recirc Pump flow adjustments</p> <p>Refers to 3-OI-6 for turbine/heater load restrictions</p> <p>Contacts Reactor Engineer to evaluate and adjust Thermal Limits, if needed</p> <p>Isolates heater drain flow B2 Heater Drain to B3 Heater by shutting 3-FCV-6-95</p> | | | | | | |
| SRO | <p>Directs isolating FW to B HP heater string based on indications of tube leak by performing manual actions of Attachment 1 and verifying automatic actions occur</p> <p>3-AOI-6-1A Attachment 1</p> <p>B1 or B2 The following valves must be manually closed: 3-FCV-3-31, HP HTR 3B2 FW INLET ISOL VALVE 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VALVE</p> <p> The following valves AUTO Isolate 3-FCV-5-9, HP HEATER 3B1 EXTR ISOL VLV 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV 3-FCV-6-74, MOISTURE SEP LC RES B1 ISOL VLV 3-FCV-6-172, MOISTURE SEP LC RES B2 ISOL VLV</p> <p>Directs power reduction to 920 MWe (79%) power (Power Reduction with RCP flow or Control Rods) per 3-OI-6, Illustration 1</p> <p>3-OI-6 Illustration 1 HEATERS OUT (Tube and Shell Side) **</p> <table border="0" style="margin-left: 40px;"> <tr> <td>One HP string</td> <td>920 MWe (79%)</td> </tr> <tr> <td>One LP string</td> <td>920 MWe (79%)</td> </tr> <tr> <td>One HP and LP string</td> <td>920 MWe (79%)</td> </tr> </table> <p>Enters 3-GOI-100-12, Power Maneuvering</p> <p>Notifies Rx Eng. And ODS of Feedwater Heater isolation and power reduction</p> | One HP string | 920 MWe (79%) | One LP string | 920 MWe (79%) | One HP and LP string | 920 MWe (79%) |
| One HP string | 920 MWe (79%) | | | | | | |
| One LP string | 920 MWe (79%) | | | | | | |
| One HP and LP string | 920 MWe (79%) | | | | | | |

Simulator Event Guide:

Event 5 Component: Loss of Feedwater Heating and 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV Fail to isolate

| | |
|--------|--|
| BOP | <p>3-AOI-6-1A Attachment 1</p> <p>Closes the following Feedwater Valves Manually 3-FCV-3-31, HP HTR 3B2 FW INLET ISOL VALVE 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VALVE</p> <p>Verifies the following valves close automatically 3-FCV-5-9, HP HEATER 3B1 EXTR ISOL VLV 3-FCV-5-21, HP HEATER 3B2 EXTR ISOL VLV 3-FCV-6-74, MOISTURE SEP LC RES B1 ISOL VLV 3-FCV-6-172, MOISTURE SEP LC RES B2 ISOL VLV</p> <p>Takes action to manually shut 3-FCV-5-21 upon determining the valve did not automatically close and reports to SRO</p> <p>Recognizes HTR level lowers as a result of isolating the Condensate side of 3B HP HTR string (i.e. tube leak) and reports to crew</p> |
| DRIVER | <p>After HS for 3-FCV-5-21 taken to closed, verify Trigger 11 goes active.</p> <p>As Reactor Engineer , when contacted direct crew to follow the guidance of urgent load reduction and 3-OI-6</p> |
| ATC | <p>Lower Reactor Power to <920 MWe/<79% power by lowering recirc flow.</p> |
| SRO | <p>Direct ATC to insert the first group of control rods on the Emergency Shove Sheet per Reactor Engineer recommendation.</p> |
| ATC | <p>Inserts the first group of rods on the Emergency Shove Sheet using a peer check as directed by Rx Engineer & Unit Supervisor</p> |
| DRIVER | <p>When directed by NRC Insert Trigger 20 Feedwater Line Break in Turbine Bldg</p> <p>When Reactor Water Level reaches -110 to -120 inches insert Trigger 25 Drywell leak</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | | |
|--|---------------|--|
| | DRIVER | <p>When directed by NRC Insert Trigger 20 Feedwater Line Break in Turbine Bldg</p> <p>When Reactor Water Level reaches -110 to -120 inches insert Trigger 25 Drywell leak</p> |
| | ATC | <p>Responds to alarms "RECTOR FEED PUMPS A, B, AND C ABNORMAL", "RFWCS ABNORMAL" and "REACTOR WATER LEVEL ABNORMAL"</p> |
| | ATC | <p>3-ARP-9-5A Reactor Water Level Abnormal</p> <p>A. VERIFY Reactor water level hi/low using multiple indications including Average Narrow Range Level on 3-XR-3-53 recorder, 3-LI-3-53, 3-LI-3-60, 3-LI-3-206, and 3-LI-3-253 on Panel 3-9-5.</p> <p>B. IF alarm is valid, THEN REFER TO 3-AOI-3-1 or 3-OI-3.</p> <p>C. IF 3-LI-3-53, 3-LI-3-60, 3-LI-3-206, and 3-LI-3-253 has failed or is invalid, THEN with SRO permission, BYPASS the affected level instrument. REFER TO 3-OI-3, Section 8.2.</p> |
| | ATC | <p>Monitors Reactor Water Level and Reports trend, recommends Manual Reactor Scram</p> <p>Determines Feedwater Leak in the Turbine Building due to both Feedwater Line Flows lowering to 0 and Reactor Feed Pump Flows Increasing with a Lowering Reactor Water Level</p> |
| | SRO | <p>Directs a Manual Reactor Scram inserted</p> <p>Directs Reactor Feed Pumps to be tripped, Reactor Feed Pump Discharge Valves shut, and Condensate Booster Pumps then Condensate Pumps secured (Isolate and stop leak)</p> |
| | ATC | <p>Inserts Manual Reactor Scram</p> <p>Trips Reactor Feed Pumps and shuts Reactor Feed Pump Discharge Valves</p> <p>Secures Condensate Booster Pumps then Condensate Pumps</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | | |
|--|---------------|--|
| | DRIVER | When Reactor Water Level reaches -110 to -120 inches insert Trigger 25 Drywell leak |
| | SRO | <p>Enters EOI-1 on Low Reactor Water Level</p> <p>RC/Q Monitor and Control Reactor Power</p> <p>Directs Exit of EOI-1 RC/Q Leg after ATC reports All Rods In on Scram Report</p> <p>RC/P Monitor and Control RPV Pressure</p> <p>Answers No to is any MSRVCycling</p> <p>Directs BOP to maintain RPV Pressure 800-1000 psig using Bypass Valves</p> <p>RC/L Monitor and Control RPV Water Level</p> <p>Verify as Required</p> <ul style="list-style-type: none"> • PCIS Isolations (Groups 1, 2 and 3) • ECCS • RCIC <p>Recognizes loss of all High Pressure Injection sources with exception of CRD and SLC. Directs maximizing CRD flow to the Vessel per Appendix 5B</p> <p>Answers No to can water level be Restored and Maintained above +2 inches</p> <p>Maintain RPV Water Level above -162 inches</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | | |
|--|---------------|---|
| | DRIVER | When Reactor Water Level reaches -110 to -120 inches insert Trigger 25 Drywell leak |
| | CT#4 | <p>Enters EOI-1 on Low Reactor Water Level (cont)</p> <p>Directs ADS inhibited when RPV Water Level drops below -120 inches</p> <p>Augments RPV Water Level Control with SLC per Appendix 7B</p> <p>Answers No to can RPV Water Level be maintained above -162 inches</p> <p>Exits RC/L and enters C-1, Alternate Level Control</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | |
|-----|---|
| ATC | <p>Appendix 5B</p> <ol style="list-style-type: none">1. IF Maximum injection flow is NOT required, THEN VERIFY CRD aligned as follows:<ol style="list-style-type: none">a. VERIFY at least one CRD pump in service and aligned to Unit 3 CRD system.b. ADJUST 3-FIC-85-11, CRD SYSTEM FLOW CONTROL, as necessary to obtain flow rate of 65 to 85 gpm.c. THROTTLE 3-PCV-85-23, CRD DRIVE WATER PRESS CONTROL VLV, to maintain 250 to 350 psid drive water header pressure differential.d. EXIT this procedure.2. IF BOTH of the following exist: CRD is NOT required for rod insertion, AND Maximum injection flow is required, THEN LINE UP ALL available CRD pumps to the RPV as follows:<ol style="list-style-type: none">a. IF CRD Pump 3A is available, THEN VERIFY RUNNING CRD Pump 3A or 3B.b. IF CRD Pump 3B is available, THEN VERIFY RUNNING CRD Pump 3A or 3B.c. OPEN the following valves to increase CRD flow to the RPV:<ul style="list-style-type: none">• 3-PCV-85-23, CRD DRIVE WATER PRESS CONTROL VLV• 3-PCV-85-27, CRD CLG WATER PRESS CONTROL VLV• 3-FCV-85-50, CRD EXH RTN LINE SHUTOFF VALVE.d. ADJUST 3-FIC-85-11, CRD SYSTEM FLOW CONTROL, on Panel 9-5 to control injection WHILE maintaining 3-PI-85-13A, CRD ACCUM CHG WTR HDR PRESS, above 1450 psig, if possible. |
|-----|---|

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | | |
|--|---------------|--|
| | DRIVER | When Reactor Water Level reaches -110 to -120 inches insert Trigger 25 Drywell leak |
| | ATC | <p>Appendix 7B</p> <p>2. IF RPV injection is needed immediately ONLY to prevent or mitigate fuel damage, THEN CONTINUE at Step 10 to inject SLC Boron Tank to RPV.</p> <p>10. UNLOCK and PLACE 3-HS-63-6A, SLC PUMP 3A/3B, control switch in START PUMP 3A or START PUMP 3B (Panel 3-9-5).</p> <p>11. CHECK SLC injection by observing the following: Selected pump starts, as indicated by red light illuminated above pump control switch.</p> <ul style="list-style-type: none"> • Squib valves fire, as indicated by SQUIB VALVE A and B CONTINUITY blue lights extinguished, • SLC SQUIB VALVE CONTINUITY LOST Annunciator in alarm (3-XA-55-5B, Window 20). • 3-PI-63-7A, SLC PUMP DISCH PRESS, indicates above RPV pressure. • System flow, as indicated by 3-IL-63-11, SLC FLOW, red light illuminated, • SLC INJECTION FLOW TO REACTOR Annunciator in alarm (3-XA-55-5B, Window 14). <p>12. IF Proper system operation CANNOT be verified, THEN RETURN TO Step 10 and START other SLC pump.</p> <p>13. IF SLC tank level drops to 0%, THEN STOP SLC pumps.</p> <p>15. MONITOR and CONTROL SLC System as necessary to maintain injection.</p> |

Simulator Event Guide:

Event 7 Component: 480V RMOV Board 3B Supply Breaker Trip

| | | |
|--|-----------------|--|
| | | When Trigger 25, Drywell Leak, is inserted Drywell Pressure will begin to rise and Reactor Water Level will begin to lower at a faster rate. |
| | BOP | Approximately 5 minutes after Feedwater Leak inserted recognizes loss of 480v RMOV Board B. Announces loss of Division II ECCS systems |
| | NRC | Loop II LPCI will still inject due to outboard injection valve open (with no power) and inboard injection valve still having power. Will be unable to throttle flow; when Loop II LPCI is no longer required, pumps must be secured. Loop II Core Spray is not functional. |
| | SRO CT#4 | <p>Enters C-1, Alternate Level Control Verifies ADS Inhibited</p> <p>Directs lineup of Injection Systems Irrespective of Pump NPSH and Vortex limits (LPCI and CS) per Appendix 6B and 6D</p> <p>Answers Yes to can 2 or more CNDS, LPCI or CS Injection Subsystems be aligned with pumps running</p> <p>When RPV Water Level drops to -162 inches, Then continues</p> <p>Answers Yes to is any CNDS, LPCI or CS Injection Subsystem aligned with at least one pump running</p> <p>Before RPV Water Level drops to -180 inches continue</p> |
| | CT#1 | <p>Answers Yes to are pumps running that can restore and maintain RPV Water Level above -180 inches after Emergency Depressurization</p> <p>Emergency RPV Depressurization is Required</p> <p>Enters C-2</p> |
| | CT#2 | <p>Directs maximizing RPV Injection from all available sources irrespective of pump NPSH and Vortex Limits</p> <p>Answers Yes to can RPV Water Level be restored and maintained above -180 inches</p> <p>Exits C-1 and enters EOI-1, RPV Control at step RC/L-1</p> |
| | BOP/ATC CT#4 | Inhibits ADS |
| | CT#2 | <p>Lines up LPCI and CS Loop I pumps for Injection per Appendix 6B and 6D</p> <p>After Emergency Depressurization commenced, verifies RPV Injection is maximized from all available sources irrespective of pump NPSH and Vortex Limits</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | |
|---------|--|
| BOP/ATC | <p>Appendix 6B, Loop I LPCI</p> <ol style="list-style-type: none"> 1. IF Adequate core cooling is assured, AND It becomes necessary to bypass the LPCI injection valve auto open signal to control injection, THEN PLACE 3-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS. 2. VERIFY OPEN 3-FCV-74-1, RHR PUMP 3A SUPPR POOL SUCT VLV. 3. VERIFY OPEN 3-FCV-74-12, RHR PUMP 3C SUPPR POOL SUCT VLV. 4. VERIFY CLOSED the following valves: <ul style="list-style-type: none"> • 3-FCV-74-61, RHR SYS I DW SPRAY INBD VLV • 3-FCV-74-60, RHR SYS I DW SPRAY OUTBD VLV • 3-FCV-74-57, RHR SYS I SUPPR CHBR/POOL ISOL VLV • 3-FCV-74-58, RHR SYS I SUPPR CHBR SPRAY VALVE • 3-FCV-74-59, RHR SYS I SUPPR POOL CLG/TEST VLV 5. VERIFY RHR Pump 3A and/or 3C running. 6. WHEN RPV pressure is below 450 psig, THEN VERIFY OPEN 3-FCV-74-53, RHR SYS I LPCI INBD INJECT VALVE. 7. IF RPV pressure is below 230 psig, THEN VERIFY CLOSED 3-FCV-68-79, RECIRC PUMP 3B DISCHARGE VALVE. 8. THROTTLE 3-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VALVE, as necessary to control injection. 10. PLACE RHRSW pumps in service as soon as possible on ANY RHR Heat Exchangers discharging to the RPV. 11. THROTTLE the following in-service RHRSW outlet valves to maintain flow between 1350 and 4500 gpm: <ul style="list-style-type: none"> • 3-FCV-23-34, RHR HX 3A RHRSW OUTLET VLV • 3-FCV-23-40, RHR HX 3C RHRSW OUTLET VLV |
|---------|--|

Simulator Event Guide:

Event 8 Component: Loop I Core Spray Logic Power Failure

| | | |
|--|---------|--|
| | BOP/ATC | <p>Appendix 6D, Loop I Core Spray</p> <ol style="list-style-type: none">1. VERIFY OPEN the following valves:<ul style="list-style-type: none">• 3-FCV-75-2, CORE SPRAY PUMP 3A SUPPR POOL SUCT VLV• 3-FCV-75-11, CORE SPRAY PUMP 3C SUPPR POOL SUCT VLV• 3-FCV-75-23, CORE SPRAY SYS I OUTBD INJECT VALVE.2. VERIFY CLOSED 3-FCV-75-22, CORE SPRAY SYS I TEST VALVE.3. VERIFY CS Pump 3A and/or 3C RUNNING.4. WHEN RPV pressure is below 450 psig, THEN THROTTLE 3-FCV-75-25, CORE SPRAY SYS I INBD INJECT VALVE, as necessary to control injection at or below 4000 gpm per pump. |
|--|---------|--|

Simulator Event Guide:

Event 8 Component: Loop I Core Spray Logic Power Failure

| | |
|--|---|
| <p>SRO</p> <p>CT#1</p> | <p>Enters C-2, Emergency RPV Depressurization</p> <p>Answers Yes to will the Reactor remain subcritical without Boron under all conditions</p> <p>Answers Yes to is Drywell Pressure above 2.4 psig</p> <p>Does not prevent Injection from any Core Spray or LPCI pumps because they are all needed to assure adequate core cooling</p> <p>Answers Yes to is Suppression Pool Level above 5.5 feet</p> <p>Directs opening of all ADS Valves</p> <p>Answers Yes to can 6 ADS Valves be opened</p> <p>Maintains 6 ADS Valves open until RPV cold shutdown Interlocks are clear</p> |
| <p>BOP/ATC</p> <p>CT#1</p> <p>CT#2</p> | <p>Reports Suppression Pool Level in Feet when directed by SRO</p> <p>Opens 6 ADS valves and verifies open when directed</p> <p>When RPV Pressure is low enough for Injection of LPCI and Core Spray, operator should verify available systems are injecting. At this time operator should notice Core Spray Loop I Injection Valve not open and take action to manually open the valve.</p> <p>When adequate core cooling is assured begins to throttle flow to prevent overfilling RPV. Must secure pumps on Loop II LPCI to stop injection.</p> |
| <p>NRC</p> | <p>Loop II LPCI will still inject due to outboard injection valve open (with no power) and inboard injection valve still having power. Will be unable to throttle flow, when Loop II LPCI is no longer required pumps must be secured. Loop II Core Spray is not functional.</p> |

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | | |
|--|-----|---|
| | SRO | <p>Enters EOI-2 on High Drywell Pressure</p> <p>DW/T Monitor and control Drywell temperature below 160F using available Drywell cooling</p> <p>Answers No to can Drywell Temperature be maintained below 160F</p> <p>Operate all available drywell cooling</p> <p>Before Drywell Temperature rises to 200F enter EOI-1 and Scram Reactor (this will already be complete at this time)</p> <p>Before Drywell Temperature rises to 280F continue</p> <p>Answers Yes to is Suppression Pool Level below 18 Feet</p> <p>Answers Yes to are Drywell Temperatures and Pressures within the safe area of curve 5</p> <p>Directs Shutdown of Recirc Pumps and Drywell Blowers (should leave Drywell Blowers running due to being unable to spray because adequate core cooling is not assured)</p> <p>Does not initiate Drywell Sprays Because Adequate Core Cooling is not assured at this time</p> |
|--|-----|---|

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | |
|-----|--|
| SRO | <p>Enters EOI-2 on High Drywell Pressure (cont)</p> <p>PC/P Monitor and control Primary Containment pressure below 2.4 psig</p> <p>Answers No to can Primary Containment Pressure be maintained below 2.4 psig</p> <p>Before Suppression Chamber Pressure rises to 12 psig Initiate Suppression Chamber Sprays using only those pumps not required for Adequate Core Cooling</p> <p>(Does not initiate Suppression Chamber Sprays because Adequate Core Cooling is not assured at this time)</p> <p>PC/H Monitor and Control Drywell and Suppression Chamber Hydrogen at or below 2.4% and Oxygen at or below 3.3% using the Nitrogen Makeup System</p> <p>SP/T Monitor and Control Suppression Pool Temperature below 95F using available Suppression Pool Cooling</p> <p>Answers Yes to can Suppression Pool Temperature be maintained below 95F</p> <p>(Once Emergency Depressurization has commenced Suppression Pool Temperature will exceed 95F, this step should be re-addressed once Adequate Core Cooling is assured)</p> |
|-----|--|

Simulator Event Guide:

Event 6 Major: Feedwater Line Break in Turbine Bldg / Drywell leak/
Div 1 ECCS fails to initiate

| | |
|-----|--|
| SRO | <p>SP/L Monitor and Control Suppression Pool Level between -1 and -6 inches Answers Yes to can Suppression Pool Level be maintained above -6 inches Answers Yes to can Suppression Pool Level be maintained below -1 inches</p> |
| SRO | <p>Enters EOI-3 on High Secondary Containment Temperature</p> <p>Secondary Containment Temperature Monitor and Control Secondary Containment Temperature Operate available ventilation per Appendix 8F Answers Yes to Is Any Area Temp Above Max Normal Isolate all systems that are discharging into the area except systems required to:</p> <ul style="list-style-type: none"> • Be operated by EOIs <p style="text-align: center;"><u>OR</u></p> <ul style="list-style-type: none"> • Suppress a Fire <p>Secondary Containment Radiation Monitor and Control Secondary Containment Radiation Levels Answers No to Is Any Area Radiation Level Max Normal</p> <p>Secondary Containment Level Monitor and Control Secondary Containment Water Levels Answers No to Is Any Floor Drain Sump Above 66 inches</p> <p style="text-align: center;"><u>AND</u></p> <p>Answers No to Is Any Area Water Level Above 2 inches</p> |
| | <p>Secondary Water Level Conditions may change if the leak is not isolated in a timely manner.</p> |
| SRO | <p>The Emergency Classification is 1.1-S1</p> |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

All Control Rods are inserted

Emergency Depressurization complete

Reactor Level is restored and maintained

SHIFT TURNOVER SHEET

Equipment Out of Service/LCO's:

HPCI is tagged out for Preventive Maintenance.

Stator Water Cooling Pump 3B is tagged out.

Operations/Maintenance for the Shift:

BOP Operator perform 3-OI-3 Section 8.13 Automatic Start Test of RFPT 3A EBOP 3A3 Oil Pump

Once completed perform Control Rod Pattern adjustment in accordance with the Reactivity Control Plan


Units 1 and 2 are at 100% power.

Unusual Conditions/Problem Areas:

None

C-1
UNIT 3

C-1

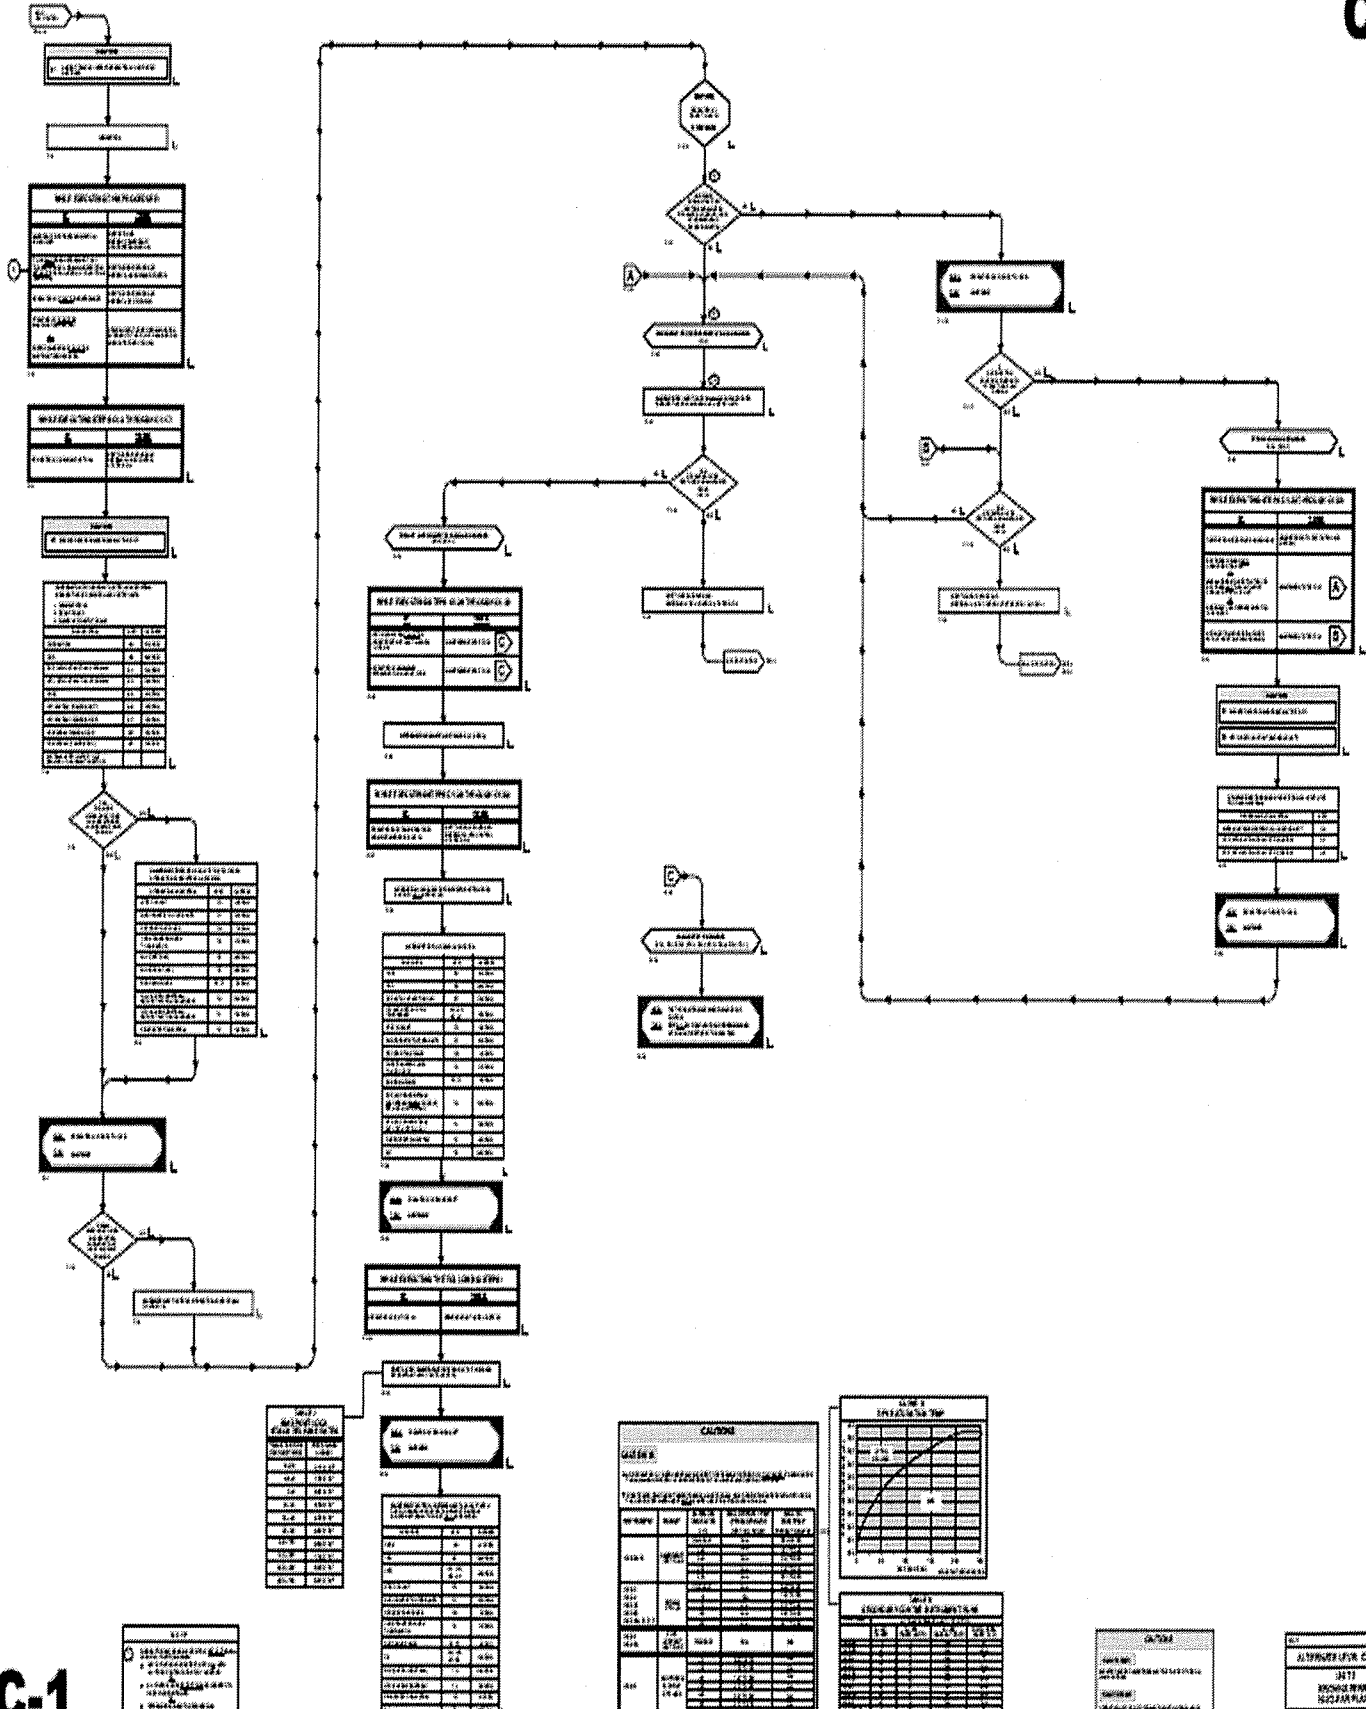

C-1



TABLE DATA (UNIT 3) FOR PUMP 301

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |

TABLE DATA (UNIT 3) FOR PUMP 302

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |

UNIT 3 CONTROL LOGIC (UNIT 3) FOR PUMP 301



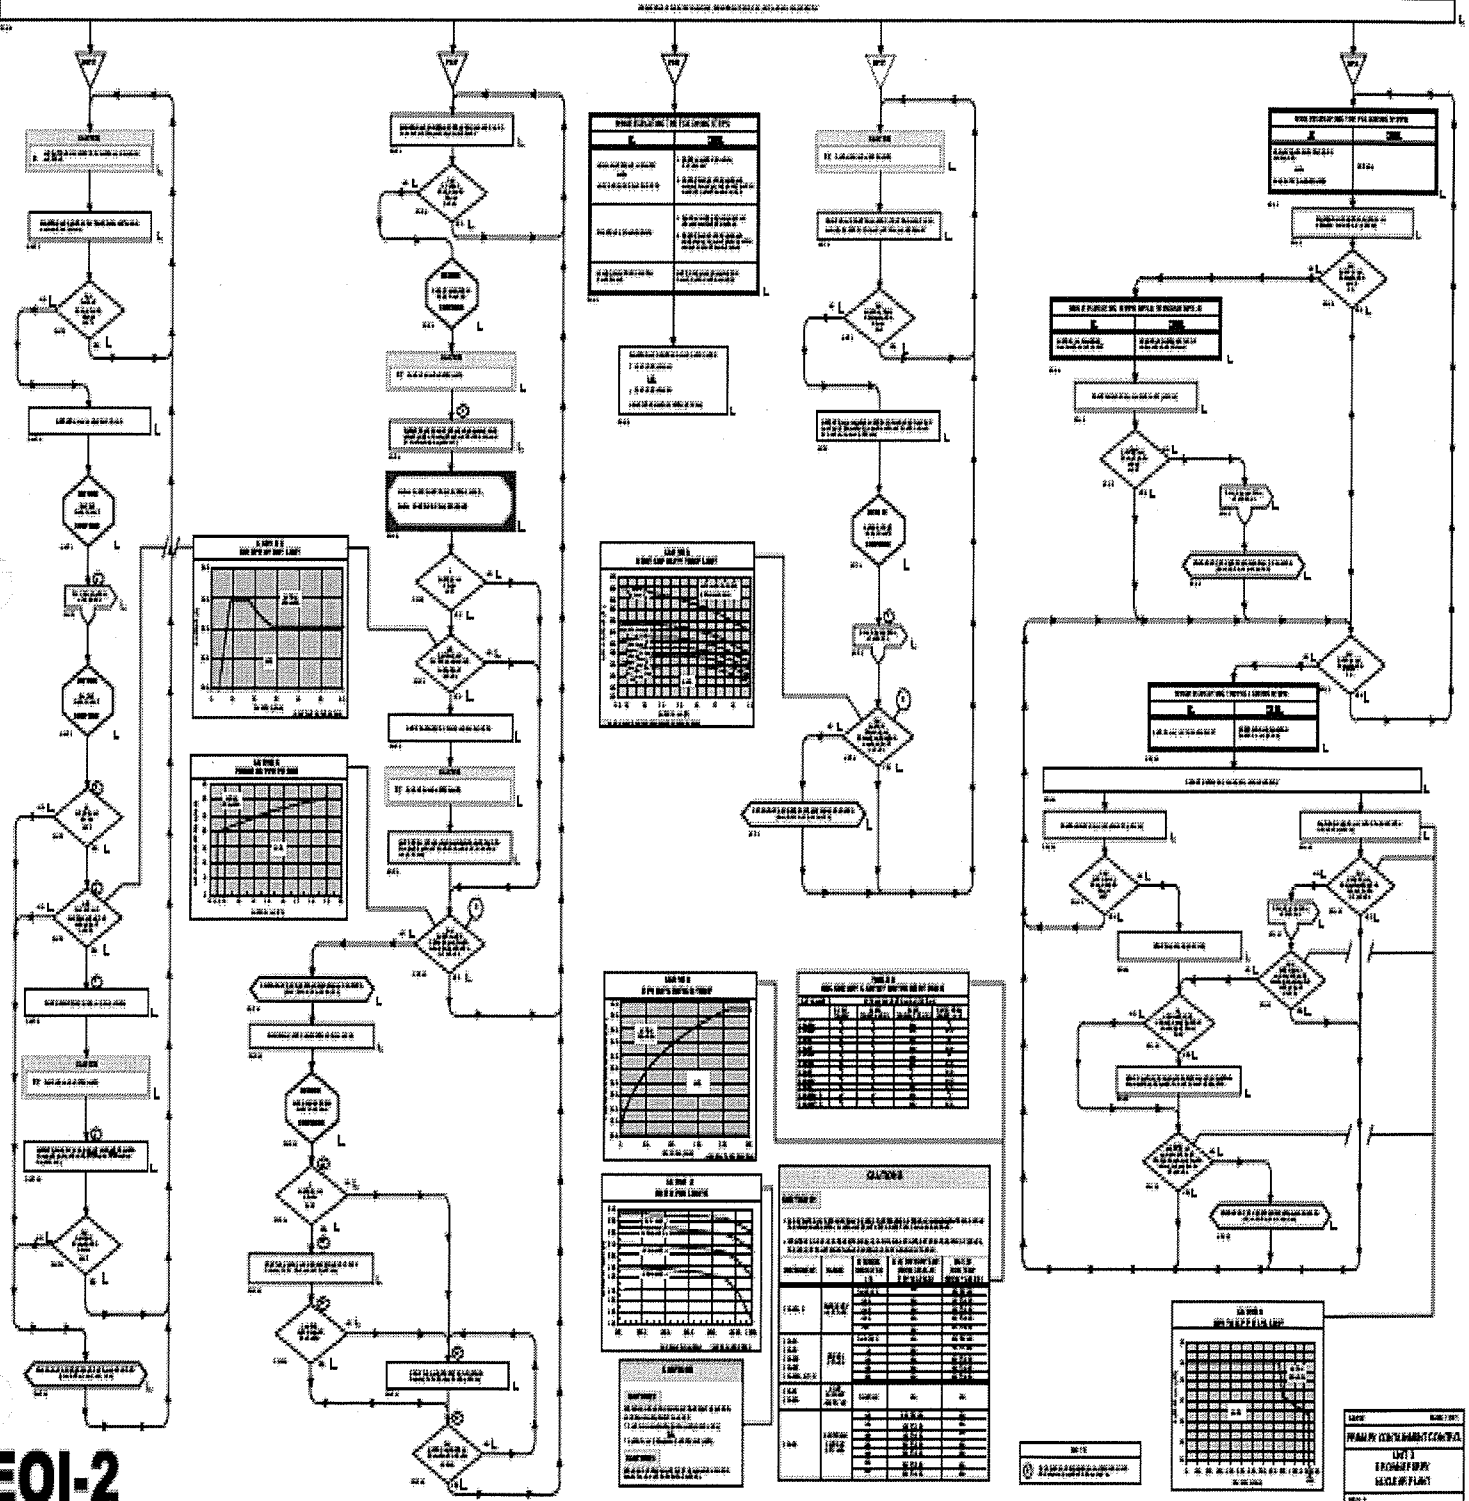


TABLE DATA (UNIT 3) FOR PUMP 303

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |

TABLE 3
PUMP 303





TABLE 6
PUMP 306

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |

TABLE 7
PUMP 307

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |


TABLE 8
PUMP 308

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |


TABLE 9
PUMP 309

| NO. | DESCRIPTION | UNIT |
|-----|-------------|------|
| 1 | ... | ... |
| 2 | ... | ... |

UNIT 3 CONTROL LOGIC (UNIT 3) FOR PUMP 301

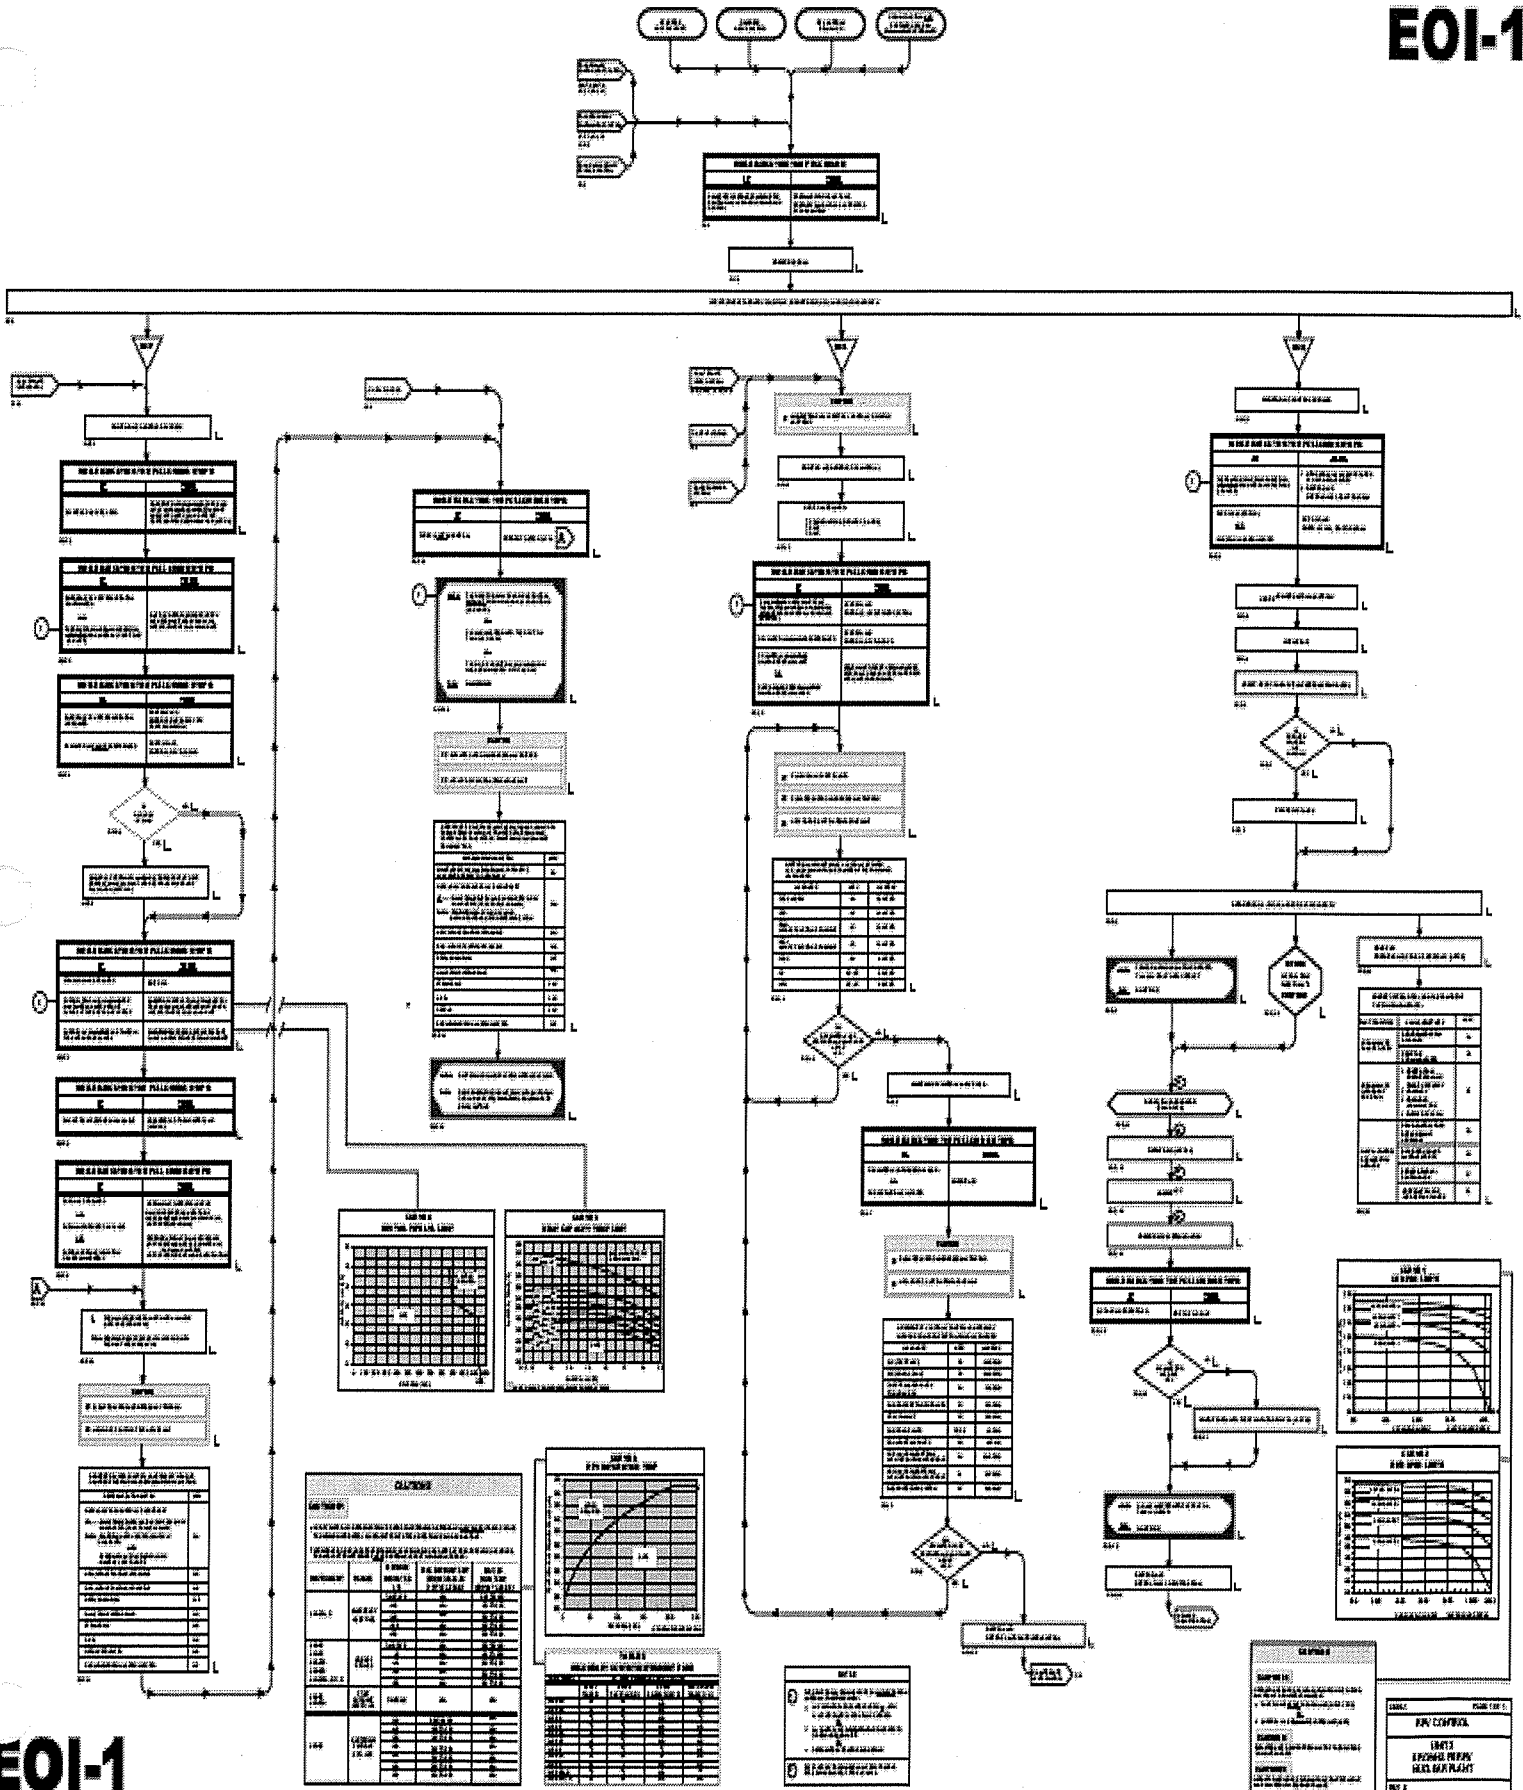

3-E01-3 SECONDARY CONTAINMENT CONTROL 3-E01-3

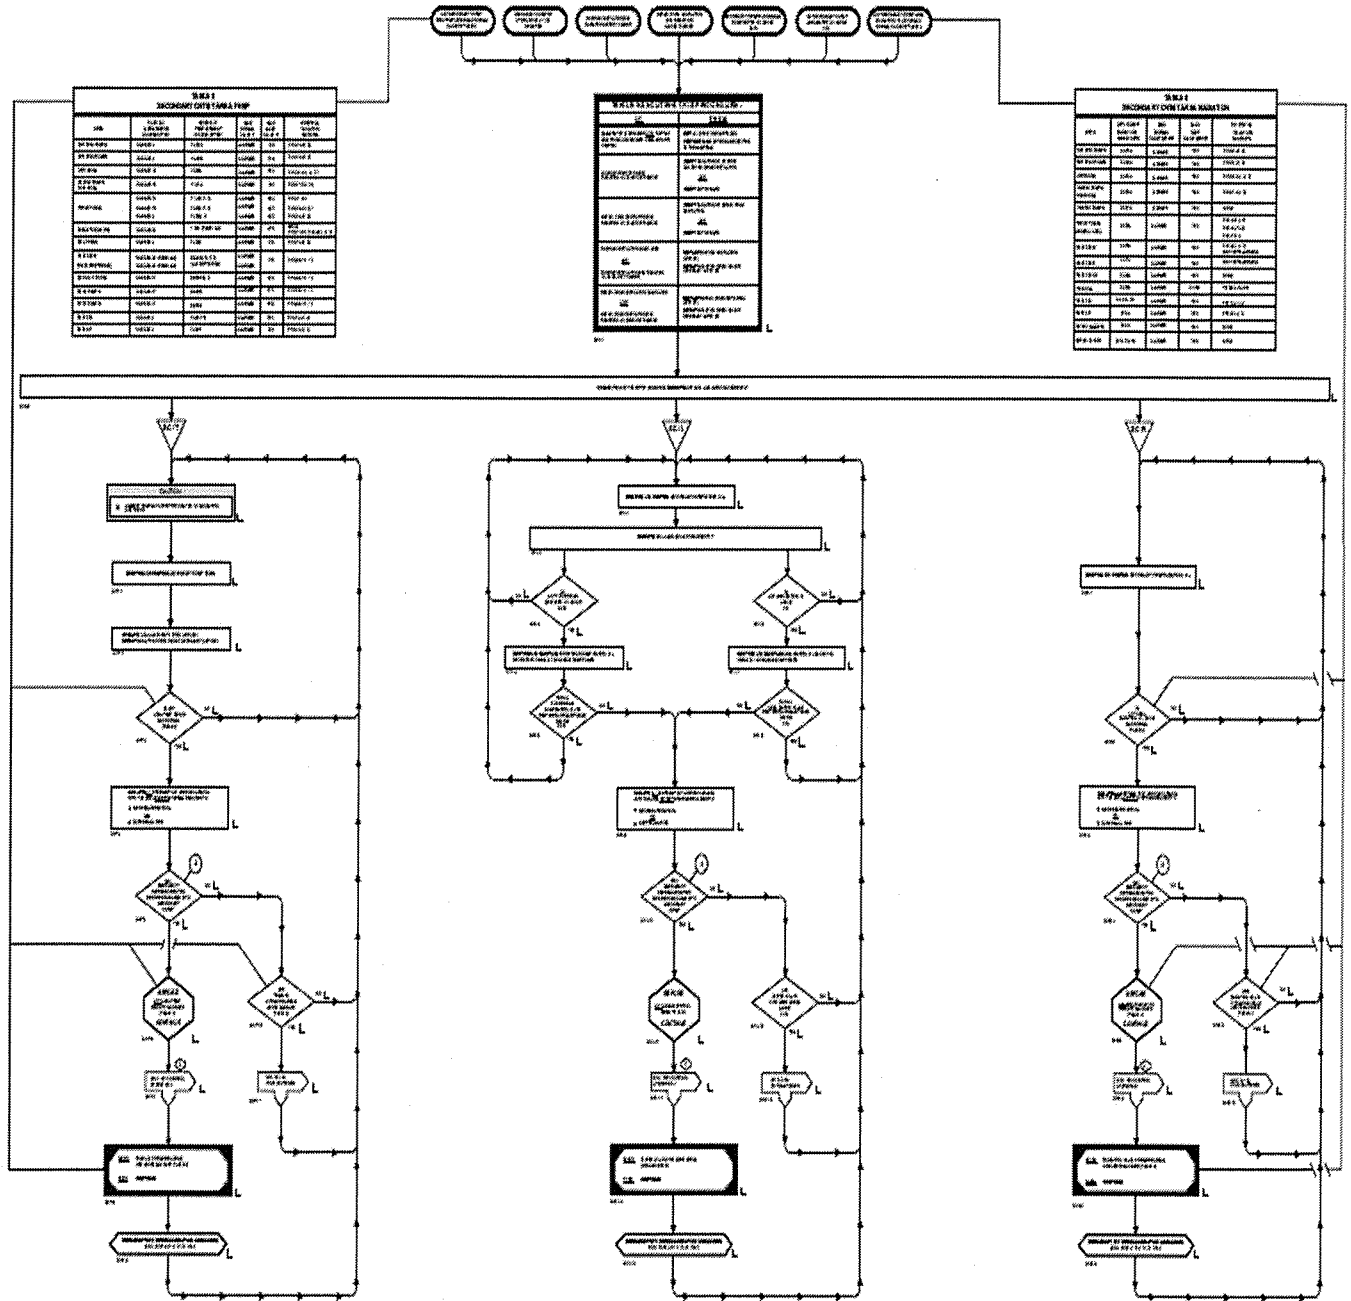

**TABLE 1
SECONDARY CONTAINMENT PUMP**

| NO. | DESCRIPTION | UNIT | STATUS | LOCATION | REMARKS |
|-----|-------------|------|--------|----------|---------|
| 1 | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... |

**TABLE 2
SECONDARY CONTAINMENT CONTROL**

| NO. | DESCRIPTION | UNIT | STATUS | LOCATION | REMARKS |
|-----|-------------|------|--------|----------|---------|
| 1 | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... |


**TABLE 3
SECONDARY CONTAINMENT CONTROL**

| NO. | DESCRIPTION | UNIT | STATUS | LOCATION | REMARKS |
|-----|-------------|------|--------|----------|---------|
| 1 | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... |

CAUTIONS

1. When the secondary containment pump is started, the operator should monitor the pump current and the pump pressure. If the pump current or pressure is abnormal, the operator should stop the pump immediately and report to the supervisor.

| NO. | DESCRIPTION | UNIT | STATUS | LOCATION | REMARKS |
|-----|-------------|------|--------|----------|---------|
| 1 | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... |



**TABLE 5
SECONDARY CONTAINMENT PUMP**

| NO. | DESCRIPTION | UNIT | STATUS | LOCATION | REMARKS |
|-----|-------------|------|--------|----------|---------|
| 1 | ... | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... | ... |

3.6 CONTAINMENT SYSTEMS

3.6.1.3 Primary Containment Isolation Valves (PCIVs)

LCO 3.6.1.3 Each PCIV, except reactor building-to-suppression chamber vacuum breakers, shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3,
When associated instrumentation is required to be OPERABLE per LCO 3.3.6.1, "Primary Containment Isolation Instrumentation."

ACTIONS

NOTES

1. Penetration flow paths except for 18 and 20 inch purge valve penetration flow paths may be unisolated intermittently under administrative controls.
 2. Separate Condition entry is allowed for each penetration flow path.
 3. Enter applicable Conditions and Required Actions for systems made inoperable by PCIVs.
 4. Enter applicable Conditions and Required Actions of LCO 3.6.1.1, "Primary Containment," when PCIV leakage results in exceeding overall containment leakage rate acceptance criteria in MODES 1, 2, and 3.
-

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|---|
| <p>A. -----NOTE----- Only applicable to penetration flow paths with two PCIVs. ----- One or more penetration flow paths with one PCIV inoperable except due to MSIV leakage not within limits.</p> | <p>A.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p><u>AND</u></p> | <p>4 hours except for main steam line <u>AND</u> 8 hours for main steam line</p> <p>(continued)</p> |

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|----------------|---|---|
| A. (continued) | <p>A.2 -----NOTE----- Isolation devices in high radiation areas may be verified by use of administrative means. -----</p> <p>Verify the affected penetration flow path is isolated.</p> | <p>Once per 31 days for isolation devices outside primary containment</p> <p><u>AND</u></p> <p>Prior to entering MODE 2 or 3 from MODE 4, if primary containment was de-inerted while in MODE 4, if not performed within the previous 92 days, for isolation devices inside primary containment</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|--|
| <p>B. -----NOTE----- Only applicable to penetration flow paths with two PCIVs. ----- One or more penetration flow paths with two PCIVs inoperable except due to MSIV leakage not within limits.</p> | <p>B.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> | <p>1 hour</p> |
| <p>C. -----NOTE----- Only applicable to penetration flow paths with only one PCIV. ----- One or more penetration flow paths with one PCIV inoperable.</p> | <p>C.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> <p><u>AND</u></p> <p>C.2 -----NOTE----- Isolation devices in high radiation areas may be verified by use of administrative means. ----- Verify the affected penetration flow path is isolated.</p> | <p>4 hours except for excess flow check valves (EFCVs) <u>AND</u> 12 hours for EFCVs</p> <p>Once per 31 days</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|-----------------|
| D. One or more penetration flow paths with MSIV leakage not within limits. | D.1 Restore leakage rate to within limit. | 4 hours |
| E. Required Action and associated Completion Time of Condition A, B, C, or D not met in MODE 1, 2, or 3. | E.1 Be in MODE 3. | 12 hours |
| | <u>AND</u> E.2 Be in MODE 4. | 36 hours |
| F. Required Action and associated Completion Time of Condition A, B, C, or D not met for PCIV(s) required to be OPERABLE during MODE 4 or 5. | F.1 Initiate action to suspend operations with a potential for draining the reactor vessel (OPDRVs). | Immediately |
| | <u>OR</u> F.2 -----NOTE----- Only applicable for inoperable RHR Shutdown Cooling Valves. ----- Initiate action to restore valve(s) to OPERABLE status. | Immediately |

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

3.5.3 RCIC System

LCO 3.5.3 The RCIC System shall be OPERABLE.

APPLICABILITY: MODE 1,
MODES 2 and 3 with reactor steam dome pressure > 150 psig.

ACTIONS

-----NOTE-----
LCO 3.0.4.b is not applicable to RCIC.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|-----------------|
| A. RCIC System inoperable. | A.1 Verify by administrative means High Pressure Coolant Injection System is OPERABLE. | Immediately |
| | <u>AND</u> A.2 Restore RCIC System to OPERABLE status. | 14 days |
| B. Required Action and associated Completion Time not met. | B.1 Be in MODE 3. | 12 hours |
| | <u>AND</u> B.2 Reduce reactor steam dome pressure to ≤ 150 psig. | 36 hours |

3.1 REACTIVITY CONTROL SYSTEMS

3.1.3 Control Rod OPERABILITY

LCO 3.1.3 Each control rod shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each control rod.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|--|
| <p>A. One withdrawn control rod stuck.</p> | <p>-----NOTE----- Rod worth minimizer (RWM) may be bypassed as allowed by LCO 3.3.2.1, "Control Rod Block Instrumentation," if required, to allow continued operation. -----</p> | <p>Immediately</p> <p>2 hours</p> <p>(continued)</p> |
| | <p>A.1 Verify stuck control rod separation criteria are met.</p> <p><u>AND</u></p> <p>A.2 Disarm the associated control rod drive (CRD).</p> <p><u>AND</u></p> | |

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|--|
| A. (continued) | A.3 Perform SR 3.1.3.2 and SR 3.1.3.3 for each withdrawn OPERABLE control rod. | 24 hours from discovery of Condition A concurrent with THERMAL POWER greater than the low power setpoint (LPSP) of the RWM |
| | <u>AND</u> A.4 Perform SR 3.1.1.1. | 72 hours |
| B. Two or more withdrawn control rods stuck. | B.1 Be in MODE 3. | 12 hours |
| C. One or more control rods inoperable for reasons other than Condition A or B. | C.1 -----NOTE----- RWM may be bypassed as allowed by LCO 3.3.2.1, if required, to allow insertion of inoperable control rod and continued operation. ----- | |
| | Fully insert inoperable control rod. <u>AND</u> C.2 Disarm the associated CRD. | 3 hours 4 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|--|
| <p>D. -----NOTE----- Not applicable when THERMAL POWER > 10% RTP. -----</p> <p>Two or more inoperable control rods not in compliance with banked position withdrawal sequence (BPWS) and not separated by two or more OPERABLE control rods.</p> | <p>D.1 Restore compliance with BPWS.</p> <p><u>OR</u></p> <p>D.2 Restore control rod to OPERABLE status.</p> | <p>4 hours</p> <p>4 hours</p> |
| <p>E. Required Action and associated Completion Time of Condition A, C, or D not met.</p> <p><u>OR</u></p> <p>Nine or more control rods inoperable.</p> | <p>E.1 Be in MODE 3.</p> | <p>12 hours</p> |

| | | |
|---------------------|---|---------------|
| BROWNS FERRY | EMERGENCY CLASSIFICATION PROCEDURE EVENT CLASSIFICATION MATRIX | EPIP-1 |
|---------------------|---|---------------|

| WATER LEVEL | | | | | | | | | | |
|--|--|-------------|--|--|---|-------------|--------------|-----------|--|--------------------------|
| Description | | | | | Description | | | | | |
| 1.1-U1 | | NOTE | | | 1.1-U2 | | | | | |
| Uncontrolled water level decrease in Reactor Cavity with irradiated fuel assemblies expected to remain covered by water. OPERATING CONDITION: Mode 5 | | | | | Uncontrolled water level decrease in Spent Fuel Pool with irradiated fuel assemblies expected to remain covered by water. OPERATING CONDITION ALL | | | | | |
| 1.1-A1 | | NOTE | | | 1.1-A2 | | | | | ALERT |
| Uncontrolled water level decrease in Reactor Cavity expected to result in irradiated fuel assemblies being uncovered. OPERATING CONDITION: Mode 5 | | | | | Uncontrolled water level decrease in Spent Fuel Storage Pool expected to result in irradiated fuel assemblies being uncovered. OPERATING CONDITION: ALL | | | | | |
| 1.1-S1 | | NOTE | | | 1.1-S2 | | | | | SITE EMERGENCY |
| Reactor water level can NOT be maintained above -162 inches. (TAF) OPERATING CONDITION: ALL | | | | | Reactor water level can NOT be determined. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | |
| 1.1-G1 | | | | | 1.1-G2 | NOTE | TABLE | US | | GENERAL EMERGENCY |
| Reactor water level can NOT be restored and maintained above -180 inches. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | Reactor water level can NOT be determined AND Either of the following exists: <ul style="list-style-type: none"> • The reactor will remain subcritical without boron under all conditions, and <ul style="list-style-type: none"> ➢ Less than 4 MSRVs can be opened, or ➢ Reactor pressure can NOT be restored and maintained above Suppression Chamber pressure by at least <ul style="list-style-type: none"> ❖ UNIT 1 – 90 psi ❖ UNIT 2 – 80 psi ❖ UNIT 3 – 70 psi • It has NOT been determined that the reactor will remain subcritical without boron under all conditions and unable to restore and maintain MARFP in Table 1.1-G2. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | | |

Facility: Browns Ferry NPP Scenario No.: D Op-Test No.: ILT 1102

FINAL

| | | | |
|------------|--|------------|-------------|
| Examiners: | | Operators: | SRO: |
| | | | ATC: |
| | | | BOP: |

Initial Conditions: IC193 / Unit 3 Reactor Power 4% / Condensate Pump 3A tagged

Turnover: Aligning Charcoal Filters for Parallel Flow IAW 3-OI-66 Section 5.11. Raise Power with Control Rods for Mode Change

| Event No. | Malf. No. | Event Type* | Event Description |
|-----------|-----------|-----------------|--|
| 1 | | N-BOP N-SRO | Aligning Charcoal Filters for Parallel Flow 5.11 |
| 2 | | R-ATC R-SRO | Raise Power with Control Rods for Mode Change |
| 3 | th03b | C-ATC TS-SRO | Reactor Recirc Pump 3B Trip |
| 4 | trg 5 | TS-SRO C-BOP | CS Pump 3A inadvertent initiation with loss of minimum flow protection |
| 5 | ms01 | C-BOP C-SRO | Steam Seal Regulator failure |
| 6 | fw30c | C-ATC C-SRO | Feedwater Pump 3C Governor drifts up |
| 7 | pc14 | M-ALL | Torus Leak / ATWS |
| 8 | trg 20 | C | 3-FCV-73-30 Fails to Open |
| 9 | | C | 3-FCV-74-57 fails to open (If repair team called for, open valve after ED started) |

* (N)ormal, (R)eactivity, (I)nstrument, (C)omponent, (M)ajor

Critical Tasks - Five

CT#1-During an ATWS, when conditions with Emergency Depressurization required, Terminate and Prevent RPV injection from ECCS and Feedwater until reactor pressure is below the MARFP as directed by US.

1. Safety Significance:
Prevention of fuel damage due to uncontrolled feeding.
2. Cues:
Procedural compliance.
3. Measured by:
Observation - No ECCS injection prior to being less than the MARFP.
AND
Observation - Feedwater terminated and prevented until less than the MARFP.
4. Feedback:
Reactor power trend, power spikes, reactor short period alarms.
Injection system flow rates into RPV.

CT#2-When Suppression Pool level cannot be maintained above 11.5 feet the US determines that Emergency Depressurization is required, RO initiates Emergency Depressurization as directed by US.

1. Safety Significance:
Precludes failure of Containment.
2. Cues:
Procedural compliance.
Suppression Pool level trend.
3. Measured by:
Observation - US determines (indicated by announcement or observable transition to C-2) that Emergency Depressurization is required before Suppression Pool level drops below 11.5 feet.
AND
Observation - RO opens at least 6 SRV's during performance of Emergency Depressurization actions.
4. Feedback:
RPV pressure trend.
Suppression Pool temperature trend.
SRV status indication.

Critical Tasks - Five

CT#3-With RPV pressure <MARFP, slowly increase and control injection into RPV to restore and maintain RPV level above TAF as directed by US.

1. Safety Significance:

Maintaining adequate core cooling and preclude possibility of large power excursions.

2. Cues:

Procedural compliance.

RPV pressure indication.

3. Measured by:

Observation - Injection not commenced until less than MARFP, and injection controlled such that power spikes are minimized, level restored and maintained greater than TAF.

4. Feedback:

RPV level trend.

RPV pressure trend.

Injection system flow rate into RPV.

CT#4-With a reactor scram required and the reactor not shutdown, initiate action to reduce power by injecting boron (If still critical with challenge to BIIT) and inserting control rods.

1. Safety Significance:

Shutting down reactor can preclude failure of containment or equipment necessary for the safe shutdown of the plant.

2. Cues:

Procedural compliance.

Suppression Pool temperature.

3. Measured by:

Observation - If operating IAW EOI-1 and C-5, US determines that SLC is required (indicated by verbal direction or EOI placekeeping action) before exceeding 110 degrees in the Suppression Pool.

AND

RO places SLC A / B Pump control switch in ON, when directed by US.

AND

Control Rod insertion commenced in accordance EOI Appendixes.

4. Feedback:

Reactor Power trend.

Control Rod indications.

SLC tank level.

Critical Tasks - Five

CT#5-When Suppression Pool Level cannot be maintained above 12.75 feet HPCI secured to prevent damage.

1. Safety Significance:

Prevent failure of Primary Containment from pressurization of the Suppression Chamber.

2. Cues:

Procedural compliance.

Suppression Pool Level indication

3. Measured by:

Observation – HPCI Auxiliary Pump placed in Pull to Lock

4. Feedback:

HPCI does not Auto initiate

No RPM indication on HPCI

Scenario Summary:

The Plant is operating at 4% Reactor Power.

The BOP Operator will Aligning Charcoal Filters for Parallel Flow IAW 3-OI-66 section 5.11.

The ATC will withdraw control rods in order to raise power to 8% for a mode change from 2 to 1.

Once the NRC is satisfied with the reactivity manipulation, Reactor Recirculation Pump B will trip. The SRO will direct entry to 3-AOI-68-1A, the ATC will close RR Pump B discharge valve. The SRO will evaluate Technical Specification 3.4.1 Condition A is required.

Core Spray Pump 3A inadvertently initiates with loss of minimum flow protection. BOP Operator verifies initiation is inadvertent and with SRO concurrence stop Core Spray Pump 3A IAW with ARPs. The SRO will evaluate Technical Specification 3.5.1 Condition A is required.

The Steam Seal regulator will fail, the BOP Operator will take action IAW with the ARPs and restore steam seal pressure with the bypass valve.

The operating feedwater pump controller will fail, level will slowly rise until the ATC or Crew notices the Reactor Level change. The controller will fail to respond until the ATC takes manual control with handswitch. The Operator will be able to maintain Reactor Level control in manual. SRO should direct entry into 3-AOI-3-1.

An unisolable Torus leak will commence. Suppression Pool level will start to lower and continue to lower. The SRO will enter EOI-3 on flood alarms and eventually EOI-2 on Suppression Pool Level. The SRO will determine that Suppression Pool level cannot be maintained above 11.5 feet and enter EOI-1 to scram the reactor and then to Emergency Depressurize.

An ATWS will exist on the scram, the crew will work through EOI-1 and C-5 to insert control rods, maintain reactor level and pressure. The SRO will transition to C-2 to Emergency Depressurize.

Attempts to add water to the suppression pool will be unsuccessful with the failure of 3-FCV-73-30 and 3-FCV-74-57.

The Emergency Classification is 1.2-S

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner:

All but six Control Rods are inserted

Emergency Depressurization complete

Reactor Level is restored and maintained

SCENARIO REVIEW CHECKLIST

SCENARIO NUMBER: 3-D

- 7 Total Malfunctions Inserted: List (4-8)
- 2 Malfunctions that occur after EOI entry: List (1-4)
- 4 Abnormal Events: List (1-3)
- 1 Major Transients: List (1-2)
- 4 EOI's used: List (1-3)
- 2 EOI Contingencies used: List (0-3)
- 90 Validation Time (minutes)
- 5 Crew Critical Tasks: (2-5)

YES Technical Specifications Exercised (Yes/No)

Scenario Tasks

| <u>EVENT</u> | <u>TASK NUMBER</u> | <u>K/A</u> | <u>RO</u> | <u>SRO</u> |
|--------------|--|--------------|-----------|------------|
| 1 | Align Charcoal Filters | | | |
| | RO U-066-NO-22 | 271000A4.09 | 3.3 | 3.2 |
| 2 | Raise Power with Control Rods | | | |
| | RO U-085-NO-06 | | | |
| | SRO S-000-AD-31 | 2.2.2 | 4.6 | 4.1 |
| 3 | Reactor Recirc Pump Trip | | | |
| | RO U-068-AB-01 | 202001A2.03 | 3.6 | 3.7 |
| | SRO S-068-AB-01 | | | |
| 4 | Core Spray Inadvertent Initiation | | | |
| | RO U-075-NO-01 | 209001A3.02 | 3.8 | 3.7 |
| 5 | Steam Seal Regulator Failure | | | |
| | RO U-001-AL-01 | 245000K6.01 | 2.8 | 2.9 |
| | SRO S-047-AB-03 | | | |
| 6 | Reactor Feed Pump Turbine Governor Failure | | | |
| | RO U-003-AL-09 | 259002A4.01 | 3.8 | 3.6 |
| | SRO S-003-AB-01 | | | |
| 7 | Torus Leak/ATWS | | | |
| | RO U-000-EM-14 | 295030EA2.01 | 4.1 | 4.2 |
| | RO U-000-EM-17 | | | |
| | RO U-000-EM-83 | | | |
| | SRO S-000-EM-07 | | | |
| | SRO S-000-EM-15 | | | |
| | SRO S-000-EM-18 | | | |

Procedures Used/Referenced:

| Procedure Number | Procedure Title | Procedure Revision |
|-------------------|---|--------------------|
| 3-OI-66 | Off Gas System | Revision 59 |
| 3-GOI-100-1A | Unit Startup | Revision 91 |
| 3-OI-85 | Control Rod Drive System | Revision 70 |
| 3-AOI-68-1A | Recirc Pump Trip/Core Flow Decrease OPRMs Operable | Revision 6 |
| TS 3.4.1 | Recirculation Loops Operating | Amendment 221 |
| 3-ARP-9-3C | Alarm Response Procedure Panel 3-9-3C | Revision 26 |
| TS 3.5.1 | ECCS - Operating | Amendment 244 |
| 3-ARP-9-6B | Alarm Response Procedure Panel 3-9-6B | Revision 11 |
| 3-ARP-9-7A | Alarm Response Procedure Panel 3-9-7A | Revision 22 |
| 3-AOI-47-3 | Loss of Condenser Vacuum | Revision 11 |
| 3-AOI-3-1 | Loss of Reactor Feedwater or Reactor Water Level High/Low | Revision 9 |
| 3-ARP-9-3B | Alarm Response Procedure Panel 3-9-3B | Revision 18 |
| 3-ARP-9-4C | Alarm Response Procedure Panel 3-9-4C | Revision 30 |
| TS 3.6.2.2 | Suppression Pool Water Level | Amendment 212 |
| 3-EOI-2 | Primary Containment Control Flowchart | Revision 7 |
| 3-EOI-APPENDIX-18 | Suppression Pool Water Inventory Removal and Makeup | Revision 2 |
| 3-EOI-3 | Secondary Containment Control Flowchart | Revision 9 |
| 3-EOI-1 | RPV Control Flowchart | Revision 8 |
| 3-EOI-APPENDIX-3A | SLC Injection | Revision 1 |
| 3-EOI-3-C-5 | Level-Power Control Flowchart | Revision 9 |
| 3-EOI-APPENDIX-4 | Prevention of Injection | Revision 5 |
| 3-EOI-3-C-2 | Emergency RPV Depressurization Flowchart | Revision 8 |
| 3-EOI-APPENDIX-6A | Injection Subsystems Lineup Condensate | Revision 2 |
| 3-EOI-APPENDIX-6B | Injection Subsystems Lineup RHR System I LPCI Mode | Revision 3 |
| 3-EOI-APPENDIX-6C | Injection Subsystems Lineup RHR System II LPCI Mode | Revision 3 |

Procedures Used/Referenced Continued:

| Procedure Number | Procedure Title | Procedure Revision |
|--------------------|--|--------------------|
| 3-EOI-APPENDIX-1F | Manual Scram | Revision 2 |
| 3-EOI-APPENDIX-1D | Insert Control Rods Using Reactor Manual Control System | Revision 2 |
| 3-EOI-APPENDIX-2 | Defeating ARI Logic Trips | Revision 4 |
| 3-EOI-APPENDIX-8A | Bypassing Group 1 RPV Low Low Low Level Isolation Interlocks | Revision 1 |
| 3-EOI-APPENDIX-8E | Bypassing Group 6 Low RPV Level and High Drywell Pressure Isolation Interlocks | Revision 1 |
| 3-AOI-100-1 | Reactor Scram | Revision 53 |
| 3-EOI-APPENDIX-17A | RHR System Operation Suppression Pool Cooling | Revision 5 |
| EPIP-1 | Emergency Classification Procedure Event Classification Matrix | Revision 46 |
| EPIP-4 | Site Area Emergency | Revision 32 |

Console Operator Instructions

Scenario File Summary

File: batch and trigger files for scenario 3-D

Batch nrc2011dR1

#cp pump 3a clearance
ior ypobkrcndpa fail_power

#Recirc Pump B trip
imf th03b (e1 0)

#cs Initiation
ior zdihs755a[4] (e5 0) start
ior zdihs759a[2] (e5 0) close

#steam seal failure
imf ms01 (e10 0)
imf mc04 (e10 0) 100

#FWLC fail
imf fw30c (e15 0) 100 3000 54
trg 7 nrc2011fptc
trg 7 = dmf fw30c

Trigger nrc2011fptc
zdihs4610a[4] .ne. 1

#SP LEAK ATWS/major
bat atws75
imf pc14 (e20 0) 100 300 75
ior ypovfcv7330 (e20 0) fail_now
trg 21 = bat atws-1
trg 22 = bat app01f
trg 23 = bat app02
ior zdihs7457a[2] auto
bat nrcstick20
trg 24 = bat nrcunstick14
trg 25 = bat sdv

Batch nrcstick20

imf rd06r3015
imf rd06r3023
imf rd06r3031
imf rd06r1851
imf rd06r1439
imf rd06r1431
imf rd06r3415
imf rd06r3815
imf rd06r4215
imf rd06r4631
imf rd06r5439
imf rd06r3027
imf rd06r2631
imf rd06r2615
imf rd06r2239
imf rd06r3839
imf rd06r1415
imf rd06r3015
imf rd06r4615
imf rd06r2223

Batch nrcunstick14

dmf rd06r3435
dmf rd06r3423
dmf rd06r2631
dmf rd06r3431
dmf rd06r2639
dmf rd06r3439
dmf rd06r3027
dmf rd06r3427
dmf rd06r2243
dmf rd06r2643
dmf rd06r3043
dmf rd06r3443
dmf rd06r1843
dmf rd06r1819

Console Operator Instructions

Scenario 3-D

| | | <u>DESCRIPTION/ACTION</u> |
|-----------------|-------------------|----------------------------------|
| Simulator Setup | manual | Reset to IC 193 |
| Simulator Setup | Load Batch | Bat nrc2011dR1 |
| Simulator Setup | manual | Clearance out Condensate pump 3A |
| Simulator Setup | | Verify Batch file loaded |

RCP required (Raise Power from 4% to 8% with Control Rods for Mode Change) – Provide marked up copy of 3-GOI-100-1A and RCP

Simulator Event Guide:

Event 1 Normal: Aligning Charcoal Filters for Parallel Flow IAW 3-OI-66 Section 5.11

| | | |
|--|----------------------------|---|
| | SRO | Direct BOP to align Charcoal Filters for parallel flow. |
| | BOP | Align Charcoal Filters for Parallel Flow IAW 3-OI-66 section 5.11. |
| | <p>Typographical error</p> | <p>5.11 Aligning Charcoal Filters for Parallel Flow:</p> <p>[1] PLACE the OFFGAS TREATMENT SELECT handswitch, 3-XS-66-113, in TREAT.</p> <p>[2] OPEN the CHARCOAL ADSORBER TRAIN 2 INLET VALVE, using 3-HS-66-117.</p> <p>[3] OPEN the CHARCOAL ADSORBER TRAIN 1 DISCH VALVE, using 3-HS-66-118.</p> <p>[4] CLOSE the CHARCOAL ADSORBER TRAINS SERIES VLV, using 3-ES-66-116.</p> <p>[5] CHECK dewpoint temperature on OFFGAS MOIST SEP REHEATER TEMPERATURE recorder, 3-TRS-66-108, indicates 45°F or less (Red Pen).</p> <p>[6] IF the Off-Gas System is intended to be operated with charcoal beds in parallel with the charcoal beds on another (shut down) unit, THEN</p> |
| | <p>NPG-SPP 1.2</p> | <p style="text-align: center;">NOTE</p> <p>Typographical errors do not require stopping procedure performance. These errors should be noted, and corrected following performance of the procedure. This does not apply to changes in component identifiers, numerical units, values, limits, work sequence or where the potential exists for improper operation of plant equipment.</p> |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|-----|--|
| | SRO | Notify ODS of power increase |
| | | <p>Direct Power increase using Control Rods per 3-GOI-100-1A , section 5.4</p> <p>5.4 Withdrawal of Control Rods while in Mode 2</p> <p>[67] CONTINUE to withdraw control rods to raise Reactor power to approximately 8%. (REFER TO 3-OI-85 and 3-SR-3.1.3.5(A))</p> |
| | ATC | <p>Raise Power with Control Rods per 3-OI-85, section 6.6. The following are the first 10 rods to be withdrawn: 02-35, 26-59, 34-59, 58-35, 58-27, 34-03, 26-03, 02-27, 06-47 and 14-55 all rods start at 12 and go to 48</p> |
| | | <p>6.6.1 Initial Conditions Prior to Withdrawing Control Rods</p> <p>[2] VERIFY the following prior to control rod movement:</p> <ul style="list-style-type: none"> • CRD POWER, 3-HS-85-46 in ON. • Rod Worth Minimizer is operable and LATCHED into the correct ROD GROUP when Rod Worth Minimizer is enforcing (not required with no fuel in RPV). <p>6.6.2 Actions Required During and Following Control Rod Withdrawal</p> <p>[4] OBSERVE the following during control rod repositioning:</p> <ul style="list-style-type: none"> • Control rod reed switch position indicators (four rod display) agree with the indication on the Full Core Display. • Nuclear Instrumentation responds as control rods move through the core (This ensures control rod is following drive during Control Rod movement.) <p>[5] ATTEMPT to minimize automatic RBM Rod Block as follows:</p> <ul style="list-style-type: none"> • STOP Control Rod withdrawal (if possible) prior to reaching any RBM Rod Block using the RBM displays on Panel 3-9-5 and PERFORM Step 6.6.2[6]. <p>[6] IF Control Rod movement was stopped to keep from exceeding a RBM setpoint or was caused by a RBM Rod Block, THEN PERFORM the following at the Unit Supervisor's discretion to "REINITIALIZE" the RBM:</p> <p>[6.1] PLACE CRD POWER, 3-HS-85-46 in the OFF position to deselect the Control Rod.</p> <p>[6.2] PLACE CRD POWER, 3-HS-85-46, in the ON position.</p> |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | |
|-----|--|
| ATC | <p>6.6.4 Continuous Rod Withdrawal</p> <p>[1] SELECT desired Control Rod by depressing appropriate CRD ROD SELECT, 3-XS-85-40.</p> <p>[2] OBSERVE the following for the selected control rod:</p> <ul style="list-style-type: none">• CRD ROD SELECT pushbutton is brightly ILLUMINATED• White light on the Full Core Display ILLUMINATED• Rod Out Permit light ILLUMINATED <p>[3] VERIFY Rod Worth Minimizer operable and LATCHED into correct ROD GROUP when the Rod Worth Minimizer is enforcing.</p> <p>[4] VERIFY Control Rod is being withdrawn to a position greater than three notches.</p> |
|-----|--|

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | |
|-----|--|
| ATC | <p>6.6.4 Continuous Rod Withdrawal (Continued)</p> <p>[6] IF continuously withdrawing the control rod to position 48 and performing the control rod coupling integrity check in conjunction with withdrawal, THEN</p> <p>PERFORM the following: (Otherwise N/A)</p> <p>[6.1] PLACE and HOLD CRD NOTCH OVERRIDE, 3-HS-85-47, in NOTCH OVERRIDE.</p> <p>[6.2] PLACE and HOLD CRD CONTROL SWITCH, 3-HS-85-48, in ROD OUT NOTCH.</p> <p>[6.3] MAINTAIN the CRD Notch Override Switch in the Override position and the CRD Control Switch in the Rod Out Notch position with the control rod at position 48.</p> <p>[6.4] CHECK control rod coupled by observing the following:</p> <ul style="list-style-type: none">• Four rod display digital readout and the full core display digital readout and background light remain illuminated.• CONTROL ROD OVERTRAVEL annunciator, 3-XA-55-5A, Window 14, does not alarm. <p>[6.5] RELEASE both CRD NOTCH OVERRIDE, 3-HS-85-47, and CRD CONTROL SWITCH, 3-HS-85-48.</p> |
|-----|--|

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|-----|--|
| | ATC | <p>6.6.4 Continuous Rod Withdrawal (Continued)</p> <p>[6.6] CHECK control rod settles into position 48 and ROD SETTLE light extinguishes.</p> <p>[6.7] IF control rod coupling integrity check fails, THEN REFER TO 3-AOI-85-2</p> <p>[7] IF continuously withdrawing the control rod to position 48 and the control rod coupling integrity check will be performed after the CRD NOTCH OVERRIDE, 3-HS-85-47, and CRD CONTROL SWITCH, 3-HS-85-48 are to be released, THEN</p> <p>PERFORM control rod coupling integrity check as follows (otherwise N/A):</p> <p>[7.1] PLACE AND HOLD CRD NOTCH OVERRIDE, 3-HS-85-47, in NOTCH OVERRRRIDE.</p> <p>[7.2] PLACE AND HOLD CRD CONTROL SWITCH, 3-HS-85-48, in ROD OUT NOTCH.</p> <p>[7.3] WHEN position 48 is reached, THEN</p> <p>RELEASE CRD NOTCH OVERRIDE, 3-HS-85-47, and CRD CONTROL SWITCH, 3-HS-85-48.</p> <p>[7.4] VERIFY control rod settles into position 48.</p> <p>[7.5] PLACE CRD CONTROL SWITCH, 3-HS-85-48, in ROD OUT NOTCH and RELEASE.</p> <p>[7.6] CHECK control rod coupled by observing the following:</p> <ul style="list-style-type: none">• Four rod display digital readout AND full core display digital readout AND background light will remain illuminated.• CONTROL ROD OVERTRAVEL annunciator (3-XA-55-5A, Window 14) does NOT alarm. |
|--|-----|--|

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|--------|--|
| | ATC | <p>6.6.4 Continuous Rod Withdrawal (Continued)</p> <p>[7.7] CHECK control rod settles into position 48 and ROD SETTLE light extinguishes.</p> <p>[7.8] IF control rod coupling integrity check fails, THEN REFER TO 3-AOI-85-2.</p> <p>6.6.5 Return to Normal After Completion of Control Rod Withdrawal</p> <p>[1] WHEN control rod movement is no longer desired AND deselecting control rods is desired, THEN:</p> <p>[1.1] PLACE CRD POWER, 3-HS-85-46, in OFF.</p> <p>[1.2] PLACE CRD POWER, 3-HS-85-46, in ON.</p> |
| | DRIVER | When NRC directs, insert Trigger 1 for Reactor Recirc Pump 3B trip. |

Simulator Event Guide:

Event 3: Reactor Recirc Pump 3B Trip

| | | |
|--|---------------|--|
| | DRIVER | When NRC directs, insert Trigger 1 for Reactor Recirc Pump 3B trip. |
| | ATC | Respond to numerous alarms and Report Trip of Reactor Recirc Pump 3B |
| | SRO | Enter 3-AOI-68-1A Recirc Pump Trip/Core Flow Decrease OPRMs Operable |
| | ATC | <p>4.2 Subsequent Actions</p> <p>[1] IF both Recirc Pumps are tripped in modes 1 or 2, THEN (Otherwise N/A),</p> <p>[1.1] SCRAM the Reactor.</p> <p>[2] IF a single Recirc Pump tripped, THEN CLOSE tripped Recirc Pump discharge valve.</p> |
| | | Closes 3B Recirc Pump Discharge Valve |
| | ATC | [3] IF Region I or II of the Power to Flow Map is entered, THEN |
| | | Steps 3 through 8 are N/A |
| | SRO | <p>[9] NOTIFY Reactor Engineer to PERFORM the following:</p> <ul style="list-style-type: none"> • Tech Specs 3.4.1 • 3-SR-3.4.1(SLO), Reactor Recirculation System Single Loop Operation • 0-TI-248, Core Flow Determination in Single Loop Operation |

Simulator Event Guide:

Event 3: Reactor Recirc Pump 3B Trip

| | | |
|--|---------------|---|
| | SRO | Evaluate Tech Spec for Single Loop Operation TS 3.4.1 Condition A |
| | | <p>Condition A Requirements of the LCO not met.</p> <p>Required Action A.1 Satisfy the requirements of the LCO</p> <p>Completion Time 24 hours</p> <p>MODE Change not permitted until setpoint changes complete.</p> |
| | ATC | <p>[10] [NER/C] WHEN the Recirc Pump discharge valve has been closed for at least five minutes (to prevent reverse rotation of the pump) [GE SIL-517], THEN (N/A if Recirc Pump was isolated in Step 4.2[8])</p> <p>OPEN Recirc Pump discharge valve as necessary to maintain Recirc Loop in thermal equilibrium.</p> |
| | | Opens Recirc Pump 3B discharge valve |
| | BOP | <p>[11] REFER TO the following ICS screens to help determine the cause of recirc pump trip/core flow lowering. VFDMPB and VFDBAL</p> <p>[12] CHECK parameters associated with Recirc Drive and Recirc Pump/Motor 3B on ICS and 3-TR-68-71 to determine cause of trip.</p> <p>Dispatch personnel [13] PERFORM visual inspection of tripped Reactor Recirc Drive.</p> <p>Dispatch personnel [14] PERFORM visual inspection of Reactor Recirc Pump Drive relay boards for relay targets.</p> |
| | DRIVER | As Reactor Engineer acknowledge request of procedure steps. If crew asks RE for directions on completion of rod withdrawal, direct to complete the rod that was in progress of being withdrawn and STOP. Any field investigation for pump trip, report no obvious causes. Pump Breaker: 4KV Recirc BD 3B |
| | DRIVER | When NRC directs, insert Trigger 5 for Core Spray Pump 3A inadvertent start. |

Simulator Event Guide:

Event 4: Core Spray Pump 3A Inadvertent Initiation

| | | |
|--|---------------|---|
| | DRIVER | When NRC directs, insert Trigger 5 for Core Spray Pump 3A inadvertent start. Delete Pump Start override immediately after pump starts to allow operator to secure pump. |
| | BOP | Report inadvertent start of Core Spray Pump 3A and alarm CORE SPRAY SYS I PUMP A START |
| | BOP | <p>A. VERIFY auto start signals by multiple indications.</p> <p>B. VERIFY Pump 3A operation by motor amps, discharge pressure, and flow on Panel 3-9-3.</p> <p>B. IF pump is NOT needed, THEN</p> <p style="padding-left: 40px;">STOP Pump before 5 min time limit at minimum flow expires.</p> <p>D. WHEN the auto start signal is reset and Core Spray is NOT required for Core Cooling, THEN</p> <p>E. RETURN system to standby readiness.</p> |
| | BOP | Report drywell pressure and reactor level normal and stops Core Spray Pump 3A |
| | BOP | Dispatches personnel to investigate pump start |
| | DRIVER | If dispatched report unable to determine why pump started and electrical maintenance will be contacted. |
| | SRO | Evaluate Technical Specification 3.5.1 |
| | | <p>Condition A One low pressure ECCS injection/spray subsystem inoperable.</p> <p>Required Action A.1 Restore low pressure ECCS injection/spray subsystem(s) to Operable status.</p> <p>Completion Time 7 Days</p> |
| | DRIVER | When NRC directs, insert Trigger 10 for Steam Seal Regulator Failure. |

Simulator Event Guide:

Event 5: Steam Seal Regulator Failure

| | |
|--------|--|
| DRIVER | When NRC directs, insert Trigger 10 for Steam Seal Regulator Failure. |
| BOP | Respond to Annunciator STEAM TO STEAM SEAL REG PRESS LOW A. CHECK steam seal header pressure, 3-PI-1-148, Panel 3-9-7. B. VERIFY proper valve alignment on Panel 3-9-7. C. IF pressure is low, THEN OPEN steam seal bypass valve 3-FCV-1-145. D. DISPATCH personnel to check 3-PIC-1-147 (El 617' Turb Bldg). E. CHECK condenser vacuum on 3-P/TR-2-2 (Panel 3-9-6) and turbine vibration on 3-XR-47-15 (Panel 3-9-7) normal. |
| BOP | Responds to Annunciators STEAM PACKING EXHAUSTER VACUUM LOW OG HOLDUP LINE INLET FLOW HIGH |
| BOP | Recommends opening steam seal bypass valve 3-FCV-1-145 to restore steam pressure |
| SRO | Concurs with actions to restore steam seal pressure |
| BOP | Dispatches personnel and checks condenser vacuum |
| DRIVER | Reports Condenser Vacuum stable or slowly degrading. |
| DRIVER | If personnel dispatched report 3-PIC-1-147 has failed low, no air pressure indication, once steam seal pressure is restored delete malfunction mc04 condenser air in leakage |
| SRO | Evaluate entry to 3-AOI-47-3 Loss of Condenser Vacuum |
| BOP | Once steam seal pressure is restored resets annunciators and verifies condenser vacuum is improving. |
| DRIVER | If I&C is dispatched acknowledge communication |
| DRIVER | When NRC directs, insert Trigger 15 for Feedwater Pump Governor Failure. |

Simulator Event Guide:

Event 6: Feedwater Pump 3C Governor Drifts Up

| | |
|--------|---|
| DRIVER | When NRC directs, insert Trigger 15 for Feedwater Pump Governor Failure. When operator takes the RFPT Governor to manual the malfunction is automatically deleted, therefore, IF the operator pulls the Governor control knob back out, the malfunction must be manually reinserted and deleted when the operator returns the Governor control knob back down to force the operator to control level manually. |
| ATC | Report Rising Reactor Water Level and RFPT is not responding. |
| SRO | Direct manual control of operating RFPT and Enter 3-AOI-3-1. |
| | <p>4.2 Subsequent Actions</p> <p>[1] VERIFY applicable automatic actions.</p> <p>[16] IF Feedwater Control System has failed, THEN PERFORM the following:</p> <p style="padding-left: 40px;">[16.1] PLACE individual RFPT Speed Control Raise/Lower switches in MANUAL GOVERNOR (depressed position with amber light illuminated).</p> <p style="padding-left: 40px;">[16.2] ADJUST RFP Discharge flows with RFPT Speed Control Raise/Lower switches as necessary to maintain level.</p> <p>[20] IF level continues to rise, THEN TRIP a RFP, as necessary.</p> <p>[22] IF RFPs are in manual control, THEN LOWER speed of operating RFPs.</p> <p>[23] EXPECT a possible Reactor power rise due to a rise in moderation.</p> <p>[24] IF unit remains on-line, THEN PERFORM the following:</p> <ul style="list-style-type: none"> • RETURN Reactor water level to normal operating level of 33" (normal range). • REQUEST Nuclear Engineer check core limits. |
| ATC | Take MANUAL GOVERNOR control of RFPT and maintain Reactor Water Level Manually in the Normal Level Band. Operator may attempt to control RFPT with PDS. PDS will not respond. |
| DRIVER | If a scram is inserted or at NRC direction initiate trigger 20 for the Suppression Pool Leak |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|--|------------------------|---|
| | DRIVER | If a scram is inserted or at NRC direction initiate trigger 20 for the Suppression Pool Leak |
| | ATC/BOP | Respond to alarm multiple Pump Room Flood Level alarms and SUPPR CHAMBER WATER LEVEL ABNORMAL |
| | ATC/BOP | Report lowering suppression pool water level |
| | | <p>A. CHECK level using multiple indications.</p> <p>B. IF level is low, THEN DISPATCH personnel to check for leaks.</p> <p>C. IF level is high, THEN</p> <p>D. REFER TO 3-OI-74, Sections 8.2, 8.3, and 8.4.</p> <p>E. REFER TO Tech Spec Section 3.6.2.2.</p> <p>F. IF level is above -1" or below -6.25", THEN ENTER 3-EOI-2 Flowchart.</p> |
| | DRIVER | When dispatched wait 6 minutes and report water level is 4 inches and rising in the Southeast Quad. Water is flowing in from the Torus Area. Cannot determine source of the leak. |
| | SRO | <p>Enter EOI-2 on Low Suppression Pool Level</p> <p>Monitor and Control Suppression Pool Level Between -1 inch and -6 inches (Appendix 18)</p> <p>Answers No to Can Suppression Pool Level Be Maintained Above -6 inches</p> <p>Answers Yes to Can Suppression Pool Level Be Maintained Below -1 inches</p> |
| | SRO CT#5 | Sets a Value for HPCI to place in Pull to Lock prior to 12.75 feet |
| | ATC/BOP CT#5 | Places HPCI in Pull to Lock before Suppression Level lowers to 12.75 feet |

Simulator Event Guide:

Event 8 Component: 3-FCV-73-30, HPCI PUMP MIN FLOW VALVE, fails to open

| | | |
|--|--------------------|---|
| | SRO | Directs Appendix 18 |
| | BOP | <p>Appendix 18</p> <p>6. IF Directed by SRO to add water to suppression pool, THEN MAKEUP water to Suppression Pool as follows:</p> <ol style="list-style-type: none"> a. VERIFY OPEN 3-FCV-73-40, HPCI CST SUCTION VALVE. b. OPEN 3-FCV-73-30, HPCI PUMP MIN FLOW VALVE c. IF HPCI is NOT available for Suppression Pool makeup, THEN MAKEUP water to Suppression Pool using RCIC as follows: <ol style="list-style-type: none"> 1) VERIFY OPEN 3-FCV-71-19, RCIC CST SUCTION VALVE. 2) OPEN 3-FCV-71-34, RCIC PUMP MIN FLOW VALVE. |
| | BOP | Attempts to makeup water to the Suppression Pool using HPCI; 3-FCV-73-30 has lost power. Utilizes RCIC to makeup water to the Suppression Pool and dispatches personnel to investigate 3-FCV-73-30. |
| | DRIVER | 3-FCV-73-30 power fails when the Torus leak is inserted, crew will dispatch personnel to investigate. Acknowledge investigation and provide no further information. |
| | SRO CT#2 | Determines a trigger value for inserting a Reactor Scram on lowering Suppression Pool Water Level and enters EOI-1, Scrams Reactor before Suppression Pool level reaches 11.5 feet. |
| | SRO | Determines that Emergency Makeup to the Suppression Pool using Standby Coolant is required and directs BOP to line up Standby Coolant to the Suppression Pool per Appendix 18. |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-----|--|
| BOP | <p>Appendix 18</p> <p>5. IF Directed by SRO to Emergency Makeup to the Suppression Pool from Standby Coolant, THEN CONTINUE in this procedure at Step 9.</p> <p>9. IF Directed by SRO to Emergency Makeup to the Suppression Pool using Standby Coolant Supply, THEN MAKEUP water to the Suppression Pool as follows:</p> <p>a. VERIFY CLOSED the following valves:</p> <ul style="list-style-type: none">• 3-FCV-74-61, RHR SYS I DW SPRAY INBD VALVE• 3-FCV-74-60, RHR SYS I DW SPRAY OUTBD VALVE• 3-FCV-74-58, RHR SYS I SUPPR CHBR SPRAY VALVE• 3-FCV-74-59, RHR SYS I SUPPR POOL CLG/TEST VALVE• 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VALVE <p>b. VERIFY RHR Pumps 3A and 3C are NOT running.</p> <p>c. PLACE 3-BKR-074-0100, RHR HTX A-C DISCH XTIE (TO U-2) VLV FCV-74-100 (M010-171) to ON (480V RMOV Board 3B, Compartment 19A).</p> <p>d. START RHRSW Pumps B1 and B2.</p> <p>e. NOTIFY Unit 1 Operator to VERIFY CLOSED 1-FCV-23-46, RHR HEAT EXCHANGER B COOL WATER OUTLET VLV</p> |
|-----|--|

Simulator Event Guide:

Event 9 Component: 3-FCV-74-57, RHR SYS I SUPPR CHMBR/POOL ISOL VLV, fails to open

| | | |
|--|--------|---|
| | DRIVER | When personnel dispatched to close 3-BKR-074-0100, wait 1 minutes then close breaker and report, delete override for breaker control power. When requested 1-FCV-23-46 is closed. When requested to open 2-FCV-23-57 insert remote function sw09 open |
| | BOP | <p>Appendix 18 (continued)</p> <p>f. NOTIFY Unit 2 Operator to perform the following</p> <ol style="list-style-type: none"> 1) VERIFY CLOSED 2-FCV-23-46, RHR HX 2B RHRSW OUTLET VLV 2) OPEN 2-FCV-23-57, STANDBY COOLANT VLV FROM RHRSW. <p>g. INJECT Standby Coolant into the Suppression Pool as follows:</p> <ol style="list-style-type: none"> 1) CLOSE 3-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VLV. 2) OPEN 3-FCV-74-100, RHR SYS I U-2 DISCH XTIE. 3) OPEN 3-FCV-74-57, RHR SYS I SUPPR CHMBR/POOL ISOL VLV. 4) THROTTLE OPEN 3-FCV-74-59, RHR SYS I SUPPR POOL CLG/TEST VLV to control injection. |
| | BOP | Determines 3-FCV-74-57 will not open and is unable to Emergency Makeup to the Suppression Pool, dispatches personnel to determine cause of valve failure. |
| | DRIVER | Acknowledges dispatch and provides no further information until crew has opened all ADS valves. Once all ADS valves are opened delete override zdihs7457a[2] auto and inform crew that the valve would not open due to dirty contacts and the problem has been fixed. |
| | SRO | Enters EOI-3 on Flood Alarms |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|--------|--|---|
| SRO | | <p>Enters EOI-3 on Flood Alarms</p> <p>EOI-3 Secondary Containment Temp Monitor and Control Secondary CNTMT Temp</p> <p>Answers No to Is Any Area Temp Above Max Normal</p> <p>EOI-3 Secondary Containment Radiation Monitor and Control Secondary CNTMT Radiation Levels</p> <p>Answers No to Is Any Area Radiation Level Above Max Normal</p> <p>EOI-3 Secondary Containment Level Monitor and Control Secondary CNTMT Water Level</p> <p>Answers Yes to Is Any Floor Drain Sump Above 66 inches Answers Yes to Is Any Area Water Level Above 2 inches</p> <p>Restore and Maintain Water Levels using all available sump pumps</p> <p>Answers No to Can All Water Levels be Restore and Maintained Below</p> <p>Isolate all systems that are discharging into the area except systems required to:</p> <ul style="list-style-type: none"> • Be operated by EOIs <u>OR</u> • Suppress a Fire <p>Answers No to Will Emergency Depressurization Reduce Discharge Into Secondary Containment.</p> |
| SRO | | Enters EOI-1 at pre-determined trigger value and directs Reactor Scram based on EOI-2 step SP/L-7. |
| Driver | | After the first channel of ARI, initiate Trigger 25 for Bat SDV, further ATWS action are on page 41. |
| ATC | | Inserts Reactor Scram, Initiates One Channel of ARI and reports "rods out" |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-----|---|
| SRO | <p>Enters EOI-1 from EOI-2 step SP/L-7 Verify Reactor Scram</p> <p>EOI-1 RC/P Monitor and Control RPV pressure</p> <p>Exits RC/P and enters C-2, Emergency RPV Depressurization, based on Override step RC/P-4.</p> <p>EOI-1 RC/L Monitor and Control RPV Water Level</p> <p>Verify as Required:</p> <ul style="list-style-type: none">• PCIS Isolations (Groups 1,2 and 3)• ECCS• RCIC <p>Exits RC/L and enters C-5, Level/Power Control, based on override RC/L-3</p> <p>EOI-1 RC/Q Monitor and Control Reactor Power</p> <ul style="list-style-type: none">• Crew may determine Reactor Subcritical and exit RC/Q, as long as <u>NO</u> Boron has been injected, at any point during execution. If this is done Crew would enter AOI-100-1, Reactor Scram, based on override RC/Q-2. <p>(The following steps will be executed through AOI-100-1 if RC/Q exited)</p> <p>Verify Reactor Mode Switch is in Shutdown</p> <p>Initiate second channel of ARI</p> <p>Verify Recirc Pump Runback (Pump speed 480rpm or less)</p> <p>Answers No to is Reactor Power above 5% or Unknown</p> <p>(The Following steps N/A if RC/Q exited)</p> <p>Before Suppression Pool Temperature rises to 110F, determines Boron Injection is Required.</p> <p>Initiates SLC per Appendix 3A</p> |
|-----|---|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|---------|---|
| SRO | <p>EOI-1 RC/Q (cont) Inhibit ADS</p> <p>Verify RWCU System Isolation</p> <p>Answers Yes to is SLC injecting into the RPV</p> <p>Stops at step RC/Q-18 until SLC has injected into the RPV to a tank level of 43%, then exits RC/Q and enters AOI-100-1</p> <p>Trips the SLC pump when SLC tank level drops to 0%</p> |
| ATC | <p>Initiates Second Channel of ARI and reports "no rod movement."</p> <p>Verifies Recirc Pump at 480 rpm or less.</p> <p>Reports Reactor Power less than 5% during Scram Report</p> <p>Should insert IRM's to determine if Reactor is subcritical</p> |
| BOP/ATC | <p>Verify and Report PCIS Isolations, ECCS and RCIC</p> <p>If directed, Initiate SLC per Appendix 3A, Inhibit ADS, and Verify RWCU System Isolation (These steps N/A if RC/Q exited and AOI-100-1 entered)</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|--|--------------------------------|--|
| | <p>BOP/ATC CT#4</p> | <p>Appendix 3A</p> <ol style="list-style-type: none"> 1. UNLOCK and PLACE 3-HS-63-6A, SLC PUMP 3A/3B, control switch in START PUMP 3A or START PUMP 3B position. 2. CHECK SLC System for injection by observing the following: <ul style="list-style-type: none"> • Selected pump starts, as indicated by red light illuminated above pump control switch. • Squib valves fire, as indicated by SQUIB VALVE A and B CONTINUITY blue lights extinguished, • SLC SQUIB VALVE CONTINUITY LOST Annunciator in alarm on Panel 3-9-5 (3-XA-55-5B, Window 20). • 3-PI-63-7A, SLC PUMP DISCH PRESS, indicates above RPV pressure. • System flow, as indicated by 3-IL-63-11, SLC FLOW, red light illuminated on Panel 3-9-5, • SLC INJECTION FLOW TO REACTOR Annunciator in alarm on Panel 3-9-5 (3-XA-55-5B, Window 14). 3. IF Proper system operation CANNOT be verified, THEN RETURN to Step 1 and START other SLC pump. 4. VERIFY RWCU isolation by observing the following: <ul style="list-style-type: none"> • RWCU Pumps 3A and 3B tripped • 3-FCV-69-1, RWCU INBD SUCT ISOLATION VALVE closed • 3-FCV-69-2, RWCU OUTBD SUCT ISOLATION VALVE closed. • 3-FCV-69-12, RWCU RETURN ISOLATION VALVE closed. 5. VERIFY ADS inhibited. 6. MONITOR reactor power for downward trend. 7. MONITOR 3-LI-63-1A, SLC STORAGE TANK LEVEL, and CHECK that level is dropping approximately 1% per minute. |
|--|--------------------------------|--|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|---------|--------|--|
| SRO | | <p>Enters C-5 from EOI-1 step RC/L-3</p> <p>Override Step C5-1, states that IF Emergency Depressurization is required, THEN continue at step C5-19, however, if the SRO has not determined that ED is required at this time then he will continue at step C5-2 (below)</p> <p>Inhibit ADS</p> <p>Answers Yes to is any Main Steam Line Open</p> <p>Bypass the following Isolation Interlocks:</p> <ul style="list-style-type: none"> • MSIV Low Low Low RPV Water Level (APPX (8A)) • RB Ventilation Low RPV Water Level (APPX 8E) <p>Crosstie CAD to DW Control Air, if necessary (APPX 8G) (Step N/A)</p> |
| DRIVER | | <p>When requested for appendix 8A and 8E wait 4 minutes and insert bat app08ae and report complete</p> |
| SRO | CT#1/2 | <p>Answers No to is Reactor Power Above 5% or Unknown</p> <p>Establishes Reactor Water Level Band between -180 and +51 inches utilizing available injection sources listed on step C5-15.</p> <p>Upon determination that Emergency Depressurization is required continues at step C5-19 and enters C-2 by direction of EOI-2 step SP/L-6 and from EOI-1 step RC/P-4 and directs Crew to Stop and Prevent all Injection Sources to the RPV <u>Except</u> from RCIC, CRD and SLC per step C5-20, in accordance with Appendix 4.</p> |
| BOP/ATC | | <p>Inhibits ADS (if not already done per Appendix 3A)</p> <p>If directed, dispatches personnel to perform Appendices 8A and 8E.</p> <p>Maintains Reactor Water Level until directed to Stop and Prevent per Appendix 4.</p> <p>When directed performs Appendix 4 to Stop and Prevent all Injection Sources to the RPV <u>Except</u> from RCIC, CRD and SLC</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

BOP/ATC
CT#1

Appendix 4

1. **PREVENT** injection from HPCI by performing the following:
 - a. IF HPCI Turbine is NOT at zero speed, THEN **PRESS** and **HOLD** 3-HS-73-18A, HPCI TURBINE TRIP push-button.
 - b. WHEN HPCI Turbine is at zero speed, THEN **PLACE** 3-HS-73-47A, HPCI AUXILIARY OIL PUMP control switch in PULL TO LOCK and **RELEASE** 3-HS-73-18A, HPCI TURBINE TRIP push-button.
3. **PREVENT** injection from CORE SPRAY following an initiation signal by **PLACING** ALL Core Spray pump control switches in STOP.

4. PREVENT injection from LPCI SYSTEM I by performing the following:

NOTE

Injection may be prevented by performing EITHER step 4.a or step 4.b.

- a. Following automatic pump start, PLACE RHR SYSTEM I pump control switches in STOP.
OR
- b. BEFORE RPV pressure drops below 450 psig,
 - 1) PLACE 3-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS.
AND
 - 2) VERIFY CLOSED 3-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VALVE.

5. PREVENT injection from LPCI SYSTEM II by performing the following:

NOTE

Injection may be prevented by performing EITHER step 5.a or step 5.b.

- a. Following automatic pump start, PLACE RHR SYSTEM II pump control switches in STOP.

OR

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-------------------------|---|
| <p>BOP/ATC CT#1</p> | <p>Appendix 4 (continued)</p> <p>b. BEFORE RPV pressure drops below 450 psig,</p> <ol style="list-style-type: none"> 1) PLACE 3-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS. AND 2) VERIFY CLOSED 3-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE. <p>6. PREVENT injection from CONDENSATE and FEEDWATER by performing the following:</p> <ol style="list-style-type: none"> a. IF Immediate injection termination from a reactor feedwater pump is required, THEN PERFORM step 6.d for the desired pump. b. LOWER RFPT 3A(3B)(3C) speed to minimum setting (approximately 600 rpm) using ANY of the following methods on Panel 3-9-5: <ul style="list-style-type: none"> • Using 3-LIC-46-5, REACTOR WATER LEVEL CONTROL, in MANUAL AND individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in AUTO, OR • Using individual 3-SIC-46-8(9)(10), RFPT 3A(3B)(3C) SPEED CONTROL in MANUAL, OR • Using individual 3-HS-46-8A(9A)(10A), RFPT 3A(3B)(3C) SPEED CONT RAISE/LOWER switch in MANUAL GOVERNOR. c. CLOSE the following valves BEFORE RPV pressure drops below 450 psig: <ul style="list-style-type: none"> • 3-FCV-3-19, RFP 3A DISCHARGE VALVE • 3-FCV-3-12, RFP 3B DISCHARGE VALVE • 3-FCV-3-5, RFP 3C DISCHARGE VALVE • 3-LCV-3-53, RFW START-UP LEVEL CONTROL d. TRIP RFPTs as necessary to prevent injection by DEPRESSING the following push-buttons: <ul style="list-style-type: none"> • 3-HS-3-125A, RFPT 3A TRIP • 3-HS-3-151A, RFPT 3B TRIP • 3-HS-3-176A, RFPT 3C TRIP. |
|-------------------------|---|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|---|--|
| <p>CT#2 SRO</p> | <p>Determines Emergency Depressurization is required and enters C-2 Answers No to will the reactor remain subcritical under all conditions. Waits until he receives the report that Appendix 4 is complete.</p> <p>Answers Yes to is Suppression Pool Level above 5.5 ft</p> <p>Directs All ADS Valves opened</p> <p>Answers Yes to can Six ADS Valves be opened</p> <p>Stops execution of C-2 until:</p> <ul style="list-style-type: none"> • The Reactor will remain Subcritical without Boron under all conditions <p style="text-align: center;">OR</p> <ul style="list-style-type: none"> • SLC has injected into the RPV to a tank level of 43% <p style="text-align: center;">OR</p> <ul style="list-style-type: none"> • The Reactor is Subcritical and No Boron has been injected into the RPV <p>Stops execution of execution of C-2 until Shutdown Cooling RPV Pressure Interlocks are clear</p> <p>Maintain RPV in Cold Shutdown per Appendix 17D</p> |
| <p>BOP/ATC</p> | <p>Reports when Appendix 4 is complete</p> <p>Reports Suppression Pool Level in Feet when Directed</p> |
| <p>CT#2 SRO CT#3</p> | <p>Opens and Verifies Open ALL ADS Valves when directed</p> <p>Upon commencement of Emergency Depressurization Continues in C-5 at step C5-21 Answers Yes to are at least 2 MSRV's open per C-2, Emergency RPV Depressurization</p> <p>Stops until RPV Pressure is below MAREP (190psig with 6 MSRV's open) Then continues</p> <p>Directs crew to Start and Slowly raise RPV Injection to Restore and Maintain RPV Water Level above -180 inches irrespective of pump NPSH limits and Suppression Pool level per Appendix 6A or per Appendix 6B, 6C</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|------------------------|--|
| CT#3 BOP/ATC | Appendix 6A <ol style="list-style-type: none">1. VERIFY CLOSED the following Feedwater heater return valves:<ul style="list-style-type: none">• 3-FCV-3-71, HP HTR 3A1 LONG CYCLE TO CNDR• 3-FCV-3-72, HP HTR 3B1 LONG CYCLE TO CNDR• 3-FCV-3-73, HP HTR 3C1 LONG CYCLE TO CNDR2. VERIFY CLOSED the following RFP discharge valves:<ul style="list-style-type: none">• 3-FCV-3-19, RFP 3A DISCHARGE VALVE• 3-FCV-3-12, RFP 3B DISCHARGE VALVE• 3-FCV-3-5, RFP 3C DISCHARGE VALVE3. VERIFY OPEN the following drain cooler inlet valves:<ul style="list-style-type: none">• 3-FCV-2-72, DRAIN COOLER 3A5 CNDS INLET ISOL VLV• 3-FCV-2-84, DRAIN COOLER 3B5 CNDS INLET ISOL VLV• 3-FCV-2-96, DRAIN COOLER 3C5 CNDS INLET ISOL VLV4. VERIFY OPEN the following heater outlet valves:<ul style="list-style-type: none">• 3-FCV-2-124, LP HEATER 3A3 CNDS OUTL ISOL VLV• 3-FCV-2-125, LP HEATER 3B3 CNDS OUTL ISOL VLV• 3-FCV-2-126, LP HEATER 3C3 CNDS OUTL ISOL VLV5. VERIFY OPEN the following heater isolation valves:<ul style="list-style-type: none">• 3-FCV-3-38, HP HTR 3A2 FW INLET ISOL VLV• 3-FCV-3-31, HP HTR 3B2 FW INLET ISOL VLV• 3-FCV-3-24, HP HTR 3C2 FW INLET ISOL VLV• 3-FCV-3-75, HP HTR 3A1 FW OUTLET ISOL VLV• 3-FCV-3-76, HP HTR 3B1 FW OUTLET ISOL VLV• 3-FCV-3-77, HP HTR 3C1 FW OUTLET ISOL VLV6. VERIFY OPEN the following RFP suction valves:<ul style="list-style-type: none">• 3-FCV-2-83, RFP 3A SUCTION VALVE• 3-FCV-2-95, RFP 3B SUCTION VALVE• 3-FCV-2-108, RFP 3C SUCTION VALVE7. VERIFY at least one condensate pump running.8. VERIFY at least one condensate booster pump running.9. ADJUST 3-LIC-3-53, RFW START-UP LEVEL CONTROL, to control injection (Panel 3-9-5).10. VERIFY RFW flow to RPV. |
|------------------------|--|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-------------|--|
| CT#3 | Appendix 6B |
| BOP/ATC | <ol style="list-style-type: none"> 1. IF Adequate core cooling is assured, AND It becomes necessary to bypass the LPCI injection valve auto open signal to control injection, THEN PLACE 3-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS. 2. VERIFY OPEN 3-FCV-74-1, RHR PUMP 3A SUPPR POOL SUCT VLV 3. VERIFY OPEN 3-FCV-74-12, RHR PUMP 3C SUPPR POOL SUCT VLV 4. VERIFY CLOSED the following valves: <ul style="list-style-type: none"> • 3-FCV-74-61, RHR SYS I DW SPRAY INBD VLV • 3-FCV-74-60, RHR SYS I DW SPRAY OUTBD VLV • 3-FCV-74-57, RHR SYS I SUPPR CHBR/POOL ISOL VLV • 3-FCV-74-58, RHR SYS I SUPPR CHBR SPRAY VALVE • 3-FCV-74-59, RHR SYS I SUPPR POOL CLG/TEST VLV 5. VERIFY RHR Pump 3A and/or 3C running. 6. WHEN RPV pressure is below 450 psig, THEN VERIFY OPEN 3-FCV-74-53, RHR SYS I LPCI INBD INJECT VALVE. 7. IF RPV pressure is below 230 psig, THEN VERIFY CLOSED 3-FCV-68-79, RECIRC PUMP 3B DISCHARGE VALVE. 8. THROTTLE 3-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VALVE, as necessary to control injection. 10. PLACE RHRSW pumps in service as soon as possible on ANY RHR Heat Exchangers discharging to the RPV. 11. THROTTLE the following in-service RHRSW outlet valves to maintain flow between 1350 and 4500 gpm: <ul style="list-style-type: none"> • 3-FCV-23-34, RHR HX 3A RHRSW OUTLET VLV • 3-FCV-23-40, RHR HX 3C RHRSW OUTLET VLV |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|--|---------|--|
| | BOP/ATC | <p>Appendix 6C</p> <ol style="list-style-type: none"> 1. IF Adequate core cooling is assured, AND It becomes necessary to bypass the LPCI injection valve auto open signal to control injection, THEN PLACE 3-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS. 2. VERIFY OPEN 3-FCV-74-24, RHR PUMP 3B SUPPR POOL SUCT VLV 3. VERIFY OPEN 3-FCV-74-35, RHR PUMP 3D SUPPR POOL SUCT VLV 4. VERIFY CLOSED the following valves: <ul style="list-style-type: none"> • 3-FCV-74-75, RHR SYS II DW SPRAY INBD VLV • 3-FCV-74-74, RHR SYS II DW SPRAY OUTBD VLV • 3-FCV-74-71, RHR SYS II SUPPR CHBR/POOL ISOL VLV • 3-FCV-74-72, RHR SYS II SUPPR CHBR SPRAY VALVE • 3-FCV-74-73, RHR SYS II SUPPR POOL CLG/TEST VLV 5. VERIFY RHR Pump 3B and/or 3D running. 6. WHEN RPV pressure is below 450 psig, THEN VERIFY OPEN 3-FCV-74-67, RHR SYS II LPCI INBD INJECT VALVE. 7. IF RPV pressure is below 230 psig, THEN VERIFY CLOSED 3-FCV-68-3, RECIRC PUMP 3A DISCHARGE VALVE. 8. THROTTLE 3-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE, as necessary to control injection. 10. PLACE RHRSW pumps in service as soon as possible on ANY RHR Heat Exchangers discharging to the RPV. 11. THROTTLE the following in-service RHRSW outlet valves to maintain flow between 1350 and 4500 gpm: <ul style="list-style-type: none"> • 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV • 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV |
|--|---------|--|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | | |
|--|------------------------|---|
| | BOP/ATC | Starts and Slowly raises RPV Injection to Restore and Maintain RPV Water Level above -180 inches irrespective of pump NPSH limits and Suppression Pool level per Appendix 6A or per Appendix 6B, 6C |
| | SRO CT#4 | EOI-1 RC/Q steps RC/Q-20 and RC/Q-21 Reset ARI Defeat ARI Logic Trips if necessary (APPX 2) (This step is N/A, however, crew may choose to perform this step) Insert Control Rods by performing Appendix 1F and 1D Appendix 1F: Scram Valves Opened but SDV is Full <ol style="list-style-type: none">1) Reset Scram Defeat RPS Logic Trips if necessary2) Drain SDV3) Recharge Accumulators4) Initiate Reactor Scram Appendix 1D: Manual Control Rod Insertion Method <ol style="list-style-type: none">1) Drive Control Rods. Bypass RWM if necessary |
| | BOP/ATC | Dispatch personnel to perform Appendix 2(N/A) and outside portions of Appendix 1F. Dispatch personnel to close 3-FCV-85-586 (while awaiting completion of Appendix 1F) Drive Rods per Appendix 1D while waiting for completion of Appendix 1F |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|----------------------------|---|
| <p>CT#4 ATC</p> | <p>Appendix 1F</p> <ol style="list-style-type: none"> 2. WHEN RPS Logic has been defeated, THEN RESET Reactor Scram. 3. VERIFY OPEN Scram Discharge Volume vent and drain valves. 4. DRAIN SDV UNTIL the following annunciators clear: <ul style="list-style-type: none"> • WEST CRD DISCH VOL WTR LVL HIGH HALF SCRAM (Panel 3-9-4, 3-XA-55-4A, Window 1) • EAST CRD DISCH VOL WTR LVL HIGH HALF SCRAM (Panel 3-9-4, 3-XA-55-4A, Window 29). 5. DISPATCH personnel to VERIFY OPEN 3-SHV-085-0586, CHARGING WATER ISOL. 6. WHEN CRD Accumulators are recharged, THEN INITIATE manual Reactor Scram and ARI. 7. CONTINUE to perform Steps 1 through 6 UNTIL ANY of the following exists: <ul style="list-style-type: none"> • ALL control rods are fully inserted, <li style="text-align: center;">OR • NO inward movement of control rods is observed, <li style="text-align: center;">OR • SRO directs otherwise. |
| <p>DRIVER</p> | <p>When directed to perform Appendix 2 and outside portions of Appendix 1F wait 3 minutes. Insert Triggers 21, 22, 23, and 24 then report completion.</p> <p>If directed to close 3-FCV-85-586 wait 3 minutes then insert mrf rd06 close. Then report completion.</p> <p>If/When directed to re-open 3-FCV-85-586 wait 3 minutes then insert mrf rd06 open. Then report completion.</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|----------------------------|---|
| <p>CT#4 ATC</p> | <p>Appendix 1D</p> <ol style="list-style-type: none"> 1. VERIFY at least one CRD pump in service. 2. IF Reactor Scram or ARI CANNOT be reset, THEN DISPATCH personnel to CLOSE 3-SHV-085-0586, CHARGING WATER SOV 3. VERIFY REACTOR MODE SWITCH in SHUTDOWN. 4. BYPASS Rod Worth Minimizer. 5. REFER to Attachment 2 and INSERT control rods in the area of highest power as follows: <ol style="list-style-type: none"> a. SELECT control rod. b. PLACE CRD NOTCH OVERRIDE switch in EMERG ROD IN position UNTIL control rod is NOT moving inward. c. REPEAT Steps 5.a and 5.b for each control rod to be inserted. 6. WHEN NO further control rod movement is possible or desired, THEN DISPATCH personnel to VERIFY OPEN 3-SHV-085-0586, CHARGING WATER SOV (RB NE, EI 565 ft). |
| <p>ATC</p> | <p>Continue performance of Appendix 1F and 1D until all rods inserted OR Until EOI-1 RC/Q is exited due to Reactor determined to be Subcritical at which point continue to insert rods per 3-AOI-100-1 and 3-OI-85</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-----|---|
| SRO | <p>Executes all legs of EOI-2 concurrently (SP/L leg has been previously addressed)</p> <p>EOI-2 DW/T Monitor and control Drywell Temperature below 160F using available Drywell Cooling</p> <p>Answers Yes to can Drywell Temperature be maintained below 160F</p> <p>EOI-2 PC/P Monitor and control Primary Containment pressure below 2.4 psig using the vent system (APPX 12) as necessary</p> <p>Answers Yes to can Primary Containment pressure be maintained below 2.4 psig</p> <p>EOI-2 PC/H Monitor and control Drywell and Suppression Chamber</p> <ul style="list-style-type: none"> • Hydrogen at or below 2.4% <li style="text-align: center;">AND • Oxygen at or below 3.3% <p>Using the Nitrogen Makeup System (APPX 14A)</p> <p>EOI-2 SP/T Monitor and control Suppression Pool temperature below 95F using available Suppression Pool Cooling (APPX 17A) as necessary</p> <p>Answers No to can Suppression Pool temperature be maintained below 95F (This is assuming Emergency Depressurization is complete and Reactor Water Level has been restored, if Emergency Depressurization has not been conducted yet, the answer will be Yes. If Reactor Water Level has not been restored yet, after Emergency Depressurization, this is not a priority.)</p> <p>Directs Line up of all available Suppression Pool Cooling using only RHR pumps not required to assure adequate core cooling by continuous injection (APPX 17A) (After Emergency Depressurization complete and Reactor Water level restored)</p> |
| BOP | <p>Performs Appendix 17A to place Suppression Pool cooling in service after Emergency Depressurization and restoration of Reactor Water level.</p> |

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-----|--|
| BOP | <p>Appendix 17A</p> <p>1. If Adequate core cooling is assured, OR Directed to cool the Suppression Pool irrespective of adequate core cooling,</p> <p>Then BYPASS LPCI injection valve auto open signal as necessary by PLACING 3-HS-74-155A(B), LPCI SYS I(II) OUTBD INJ VLV BYPASS SEL in BYPASS.</p> <p>2. PLACE RHR SYSTEM I(II) in Suppression Pool Cooling as follows:</p> <p>a. VERIFY at least one RHRSW pump supplying each EECW header.</p> <p>b. VERIFY RHRSW pump supplying desired RHR Heat Exchanger(s).</p> <p>c. THROTTLE the following in-service RHRSW outlet valves to obtain between 1350 and 4500 gpm RHRSW flow:</p> <ul style="list-style-type: none">• 3-FCV-23-34, RHR HX 3A RHRSW OUTLET VLV• 3-FCV-23-46, RHR HX 3B RHRSW OUTLET VLV• 3-FCV-23-40, RHR HX 3C RHRSW OUTLET VLV• 3-FCV-23-52, RHR HX 3D RHRSW OUTLET VLV <p>d. If Directed by SRO, Then PLACE 3-XS-74-122(130), RHR SYS I(II) LPCI 2/3 CORE HEIGHT OVRD in MANUAL OVERRIDE.</p> <p>e. If LPCI INITIATION Signal exists, Then MOMENTARILY PLACE 3-XS-74-121(129), RHR SYS I(II) CTMT SPRAY/CLG VLV SELECT in SELECT.</p> <p>f. If 3-FCV-74-53(67), RHR SYS I(II) LPCI INBD INJECT VALVE, is OPEN, Then VERIFY CLOSED 3-FCV-74-52(66), RHR SYS I(II) LPCI OUTBD INJECT VALVE.</p> <p>g. OPEN 3-FCV-74-57(71), RHR SYS I(II) SUPPR CHBR/POOL ISOL VLV.</p> |
|-----|--|

Simulator Event Guide:

Event 7 Major: Torus Leak/ATWS

| | |
|-----|---|
| BOP | <p>Appendix 17A (cont)</p> <p>h. VERIFY desired RHR pump(s) for Suppression Pool Cooling are operating.</p> <p>i. THROTTLE 3-FCV-74-59(73), RHR SYS I(II) SUPPR POOL CLG/TEST VLV, to maintain EITHER of the following as indicated on 3-FI-74-50(64), RHR SYS I(II) FLOW:</p> <ul style="list-style-type: none">• Between 7000 and 10000 gpm for one-pump operation.<li style="text-align: center;">OR• At or below 13000 gpm for two-pump operation. <p>j. VERIFY CLOSED 3-FCV-74-7(30), RHR SYSTEM I(II) MIN FLOW VALVE.</p> <p>k. MONITOR RHR Pump NPSH using Attachment 1.</p> <p>l. NOTIFY Chemistry that RHRSW is aligned to in-service RHR Heat Exchangers.</p> <p>m. If Additional Suppression Pool Cooling flow is necessary, Then PLACE additional RHR and RHRSW pumps in service using Steps 2.b through 2.l.</p> |
|-----|---|

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner:

All but six Control Rods are inserted

Emergency Depressurization complete

Reactor Level is restored and maintained

SHIFT TURNOVER SHEET

Equipment Out of Service/LCO's:

Condensate Pump 3A tagged Out of Service.

Operations/Maintenance for the Shift:

Align Charcoal Filters for Parallel Flow IAW 3-OI-66 Section 5.11.

Once completed Raise Power with Control Rods for Mode Change IAW 3-GOI-100-1A, section 5.4 step [67] and the Reactivity Control Plan

Units 1 and 2 are at 100% power.

Unusual Conditions/Problem Areas:

None

E01-3

UNIT 3


E01-3




| NO. | ITEM | UNIT | QTY | REMARKS |
|-----|------|------|-----|---------|
| 1 | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... |

| NO. | ITEM | UNIT | QTY | REMARKS |
|-----|------|------|-----|---------|
| 1 | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... |

| NO. | ITEM | UNIT | QTY | REMARKS |
|-----|------|------|-----|---------|
| 1 | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... |

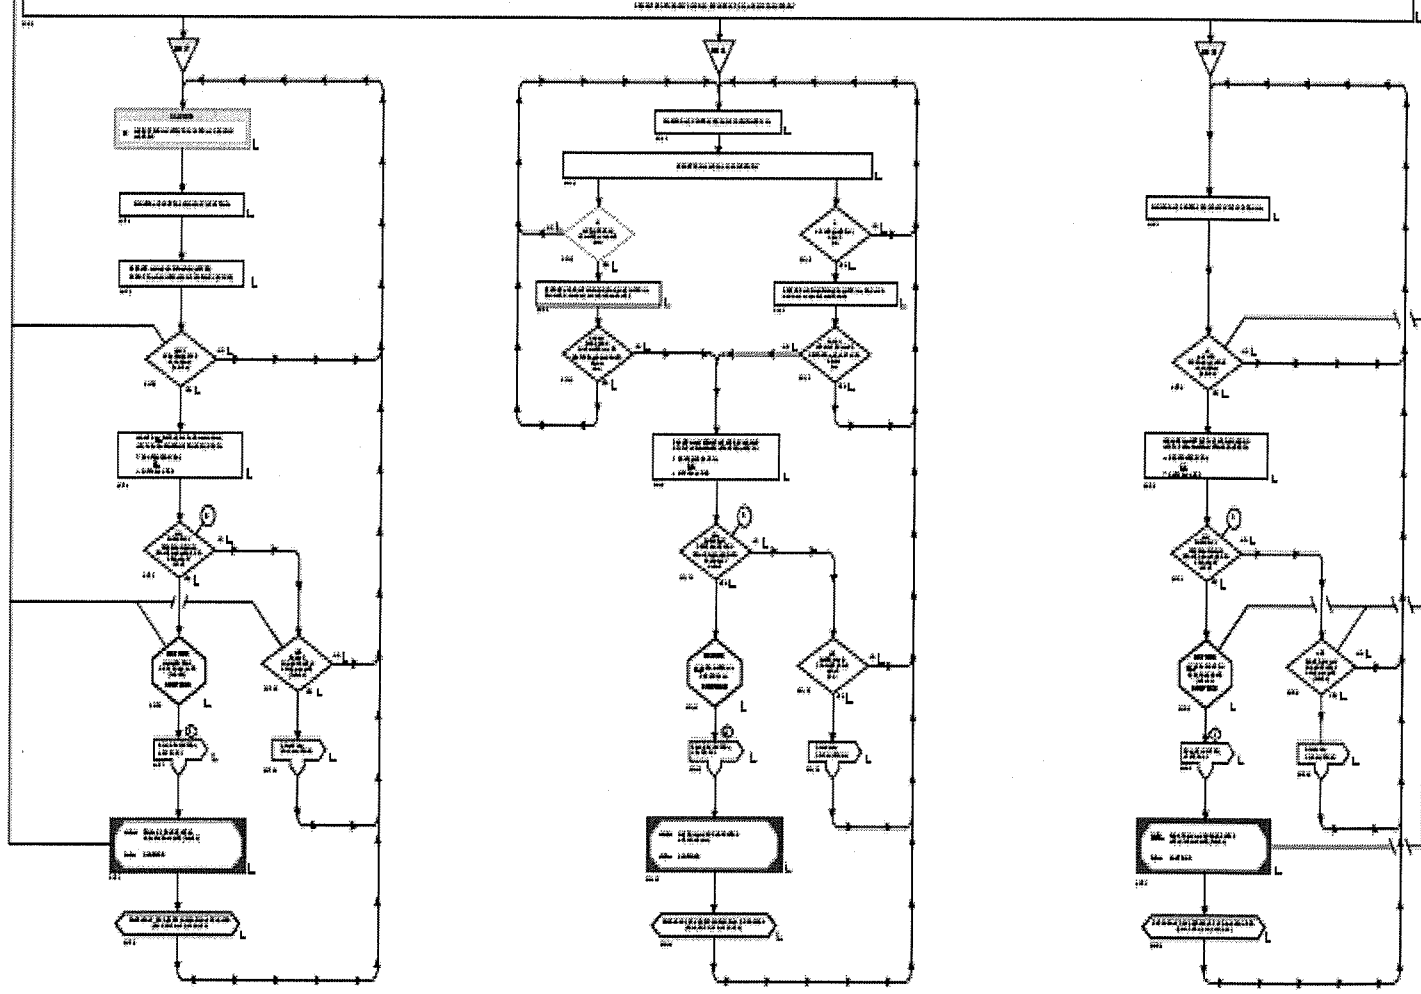

| NO. | ITEM | UNIT | QTY | REMARKS |
|-----|------|------|-----|---------|
| 1 | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... |







| NO. | ITEM | UNIT | QTY | REMARKS |
|-----|------|------|-----|---------|
| 1 | ... | ... | ... | ... |
| 2 | ... | ... | ... | ... |
| 3 | ... | ... | ... | ... |
| 4 | ... | ... | ... | ... |
| 5 | ... | ... | ... | ... |
| 6 | ... | ... | ... | ... |
| 7 | ... | ... | ... | ... |
| 8 | ... | ... | ... | ... |
| 9 | ... | ... | ... | ... |
| 10 | ... | ... | ... | ... |
| 11 | ... | ... | ... | ... |
| 12 | ... | ... | ... | ... |
| 13 | ... | ... | ... | ... |
| 14 | ... | ... | ... | ... |
| 15 | ... | ... | ... | ... |
| 16 | ... | ... | ... | ... |
| 17 | ... | ... | ... | ... |
| 18 | ... | ... | ... | ... |
| 19 | ... | ... | ... | ... |
| 20 | ... | ... | ... | ... |

E01-3

UNIT 3
SPECIFICATIONS FOR UNIT 3


UNIT 3
SPECIFICATIONS FOR UNIT 3

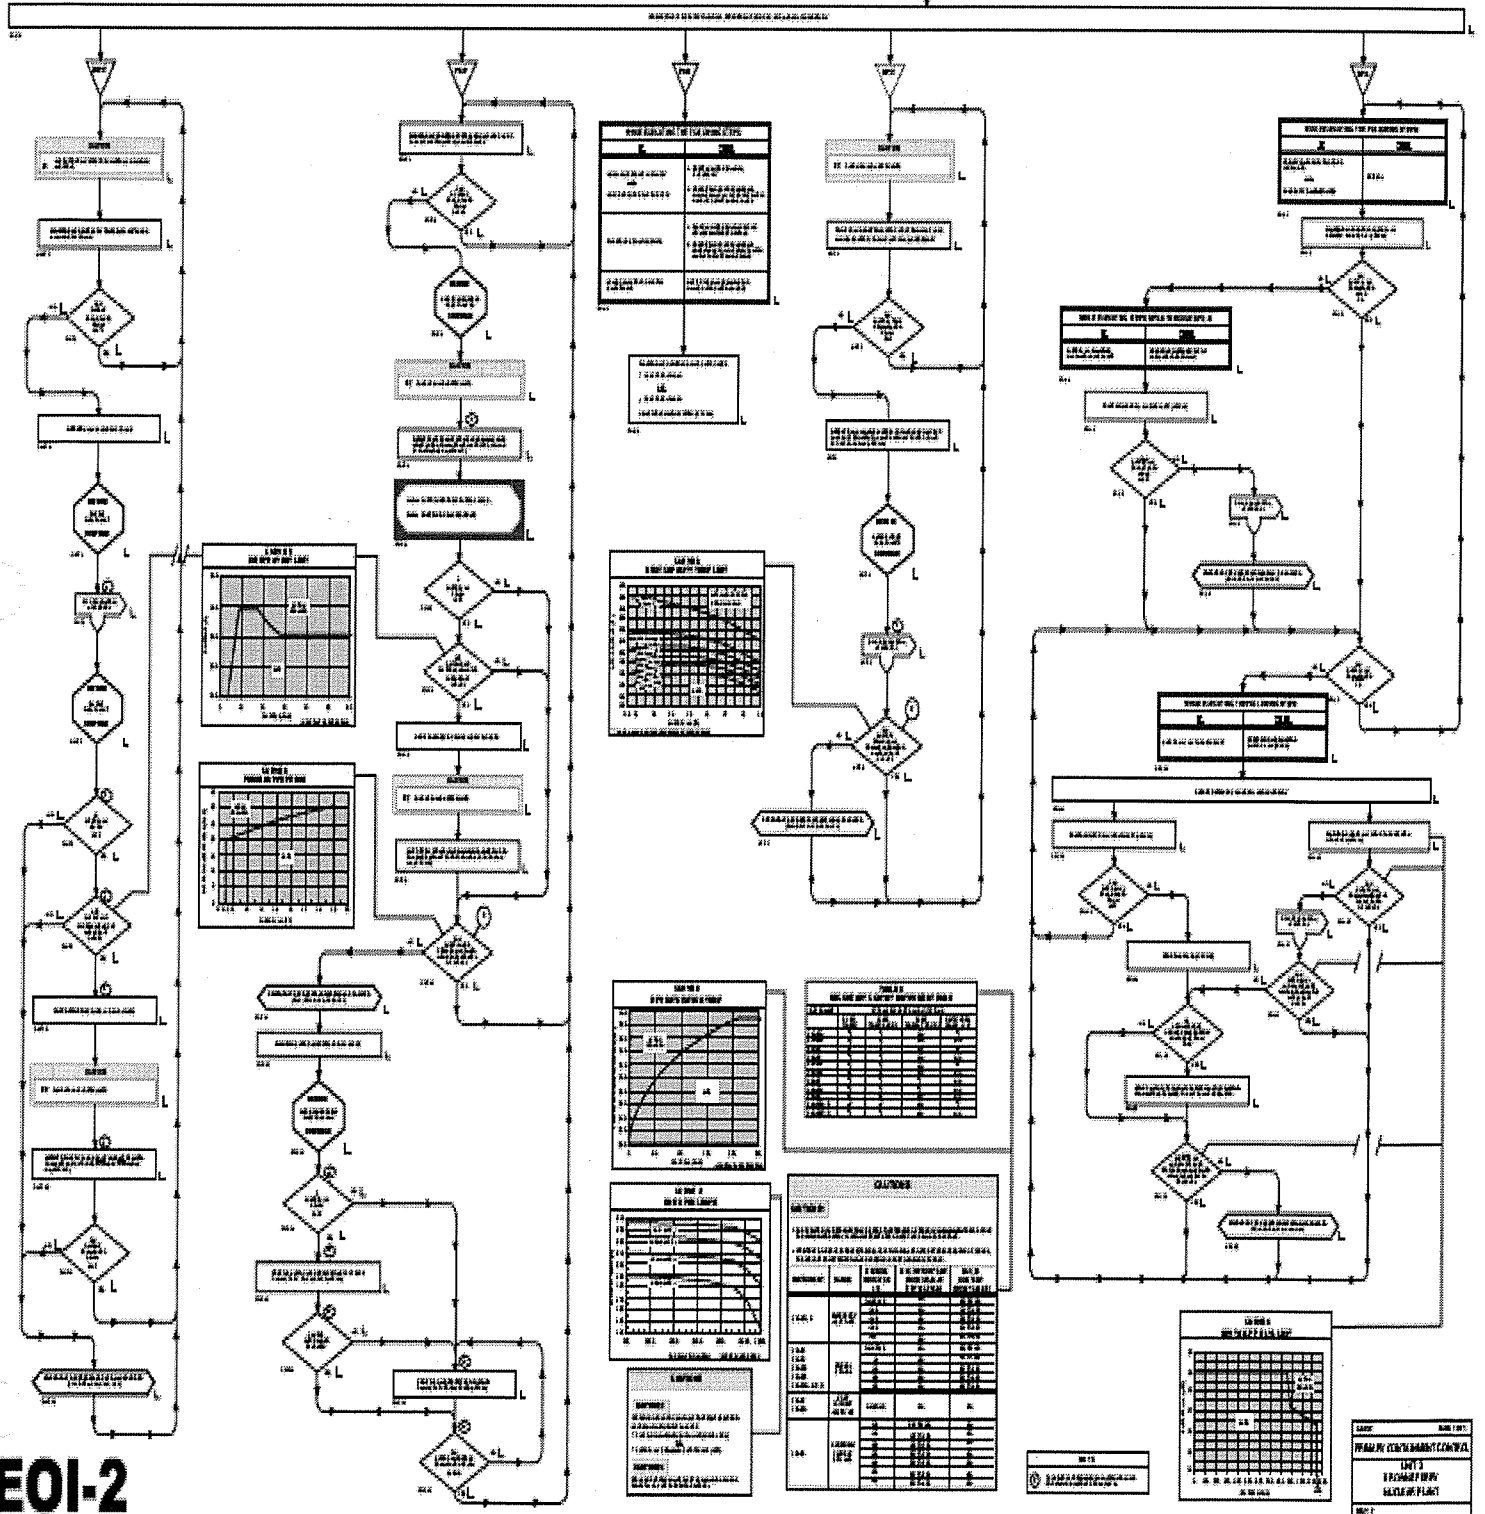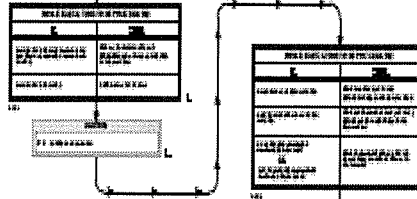

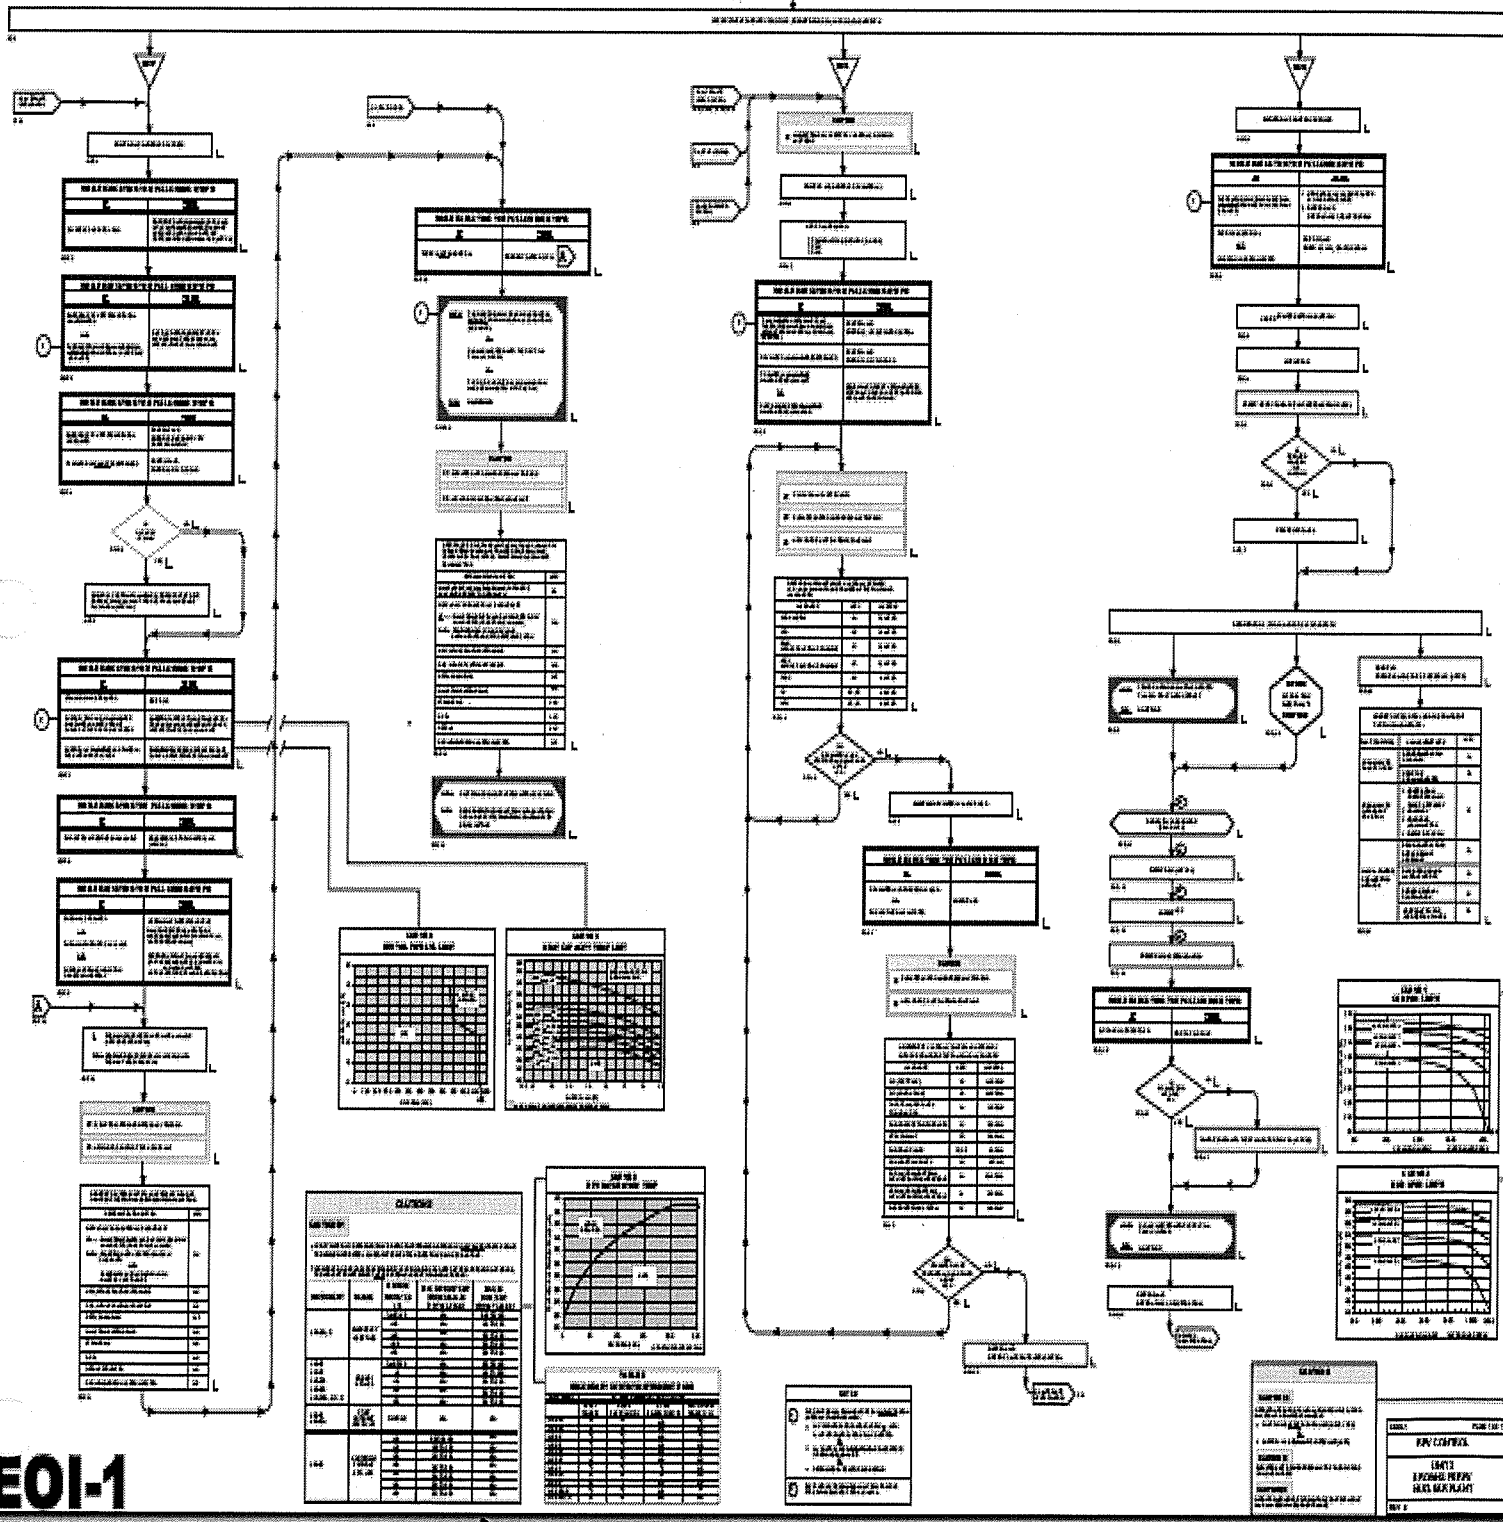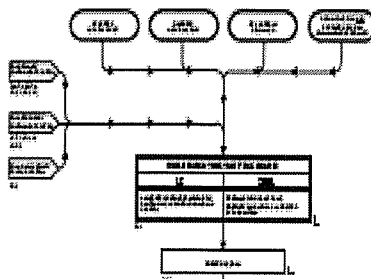

C-5
UNIT 3

C-5

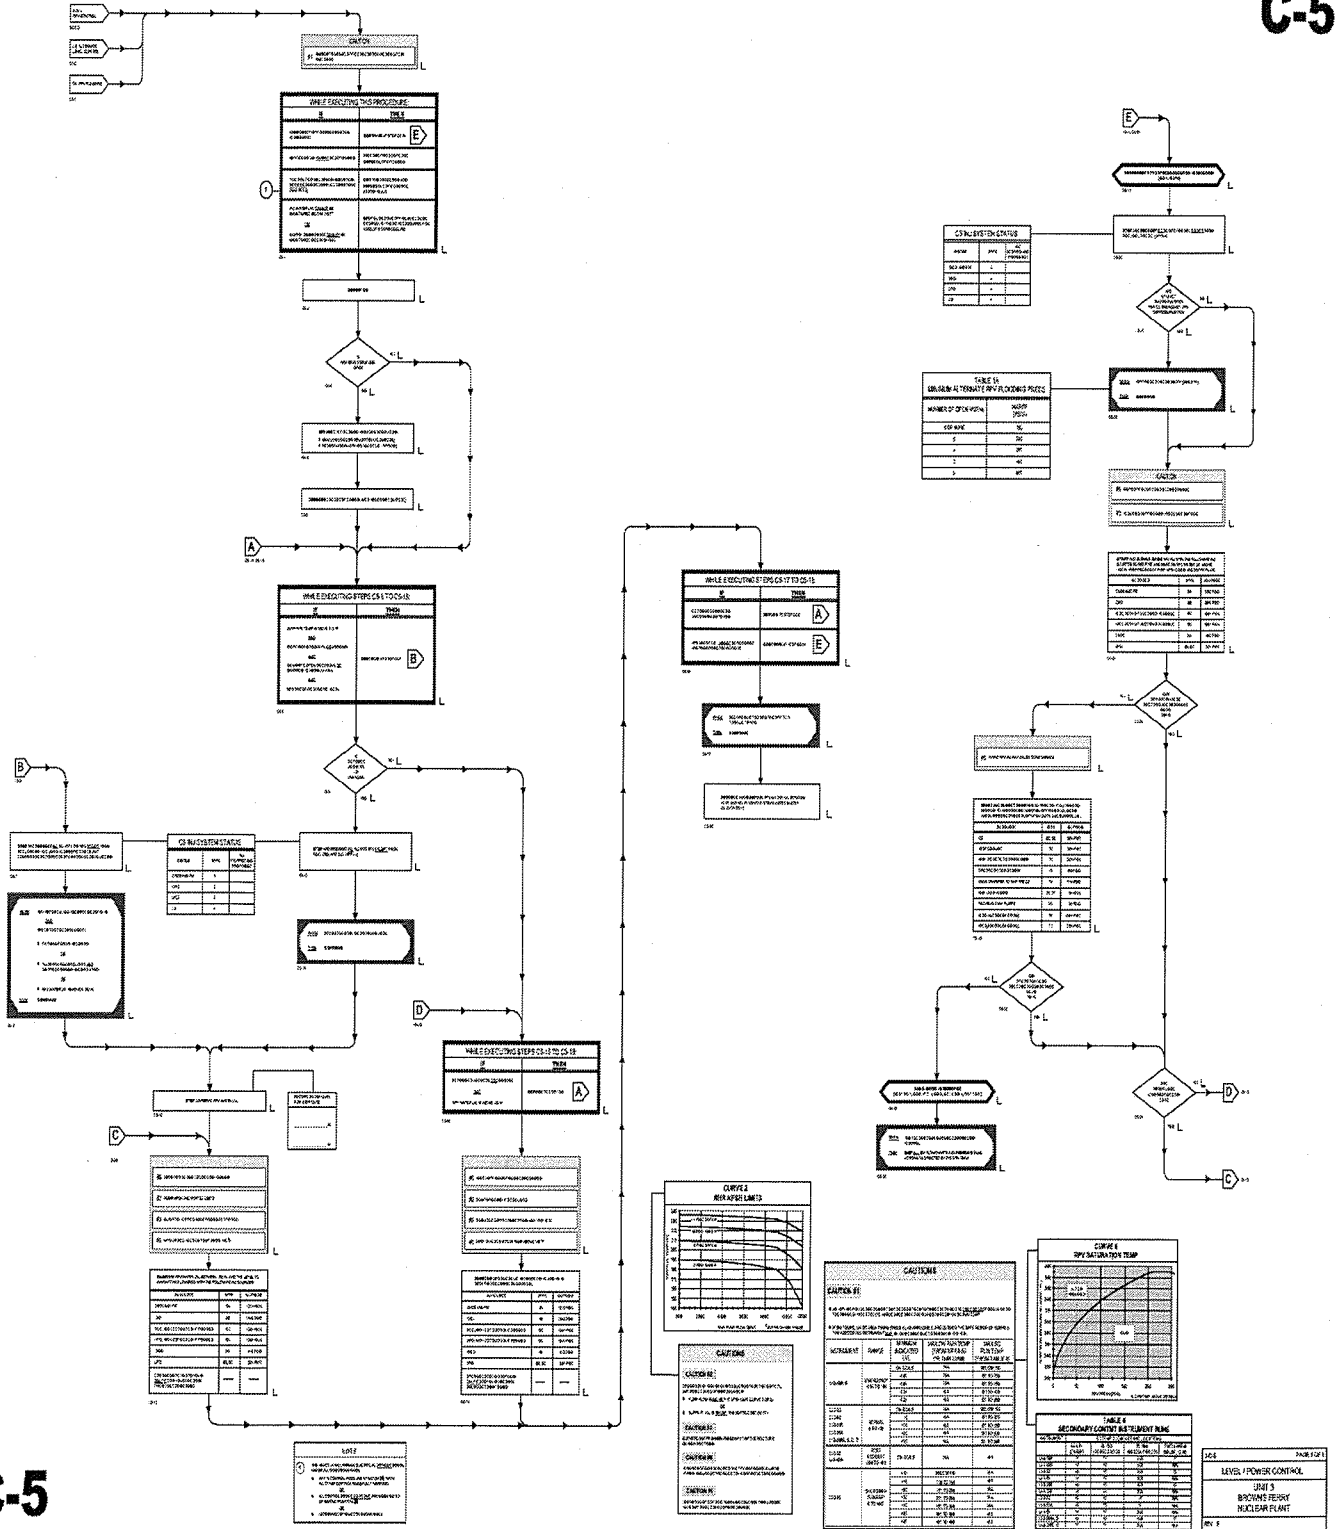

C-5

LEVEL/POWER CONTROL
UNIT 3
BROWNS FERRY
NUCLEAR PLANT
PAGE 50 OF 56

3.4 REACTOR COOLANT SYSTEM (RCS)

3.4.1 Recirculation Loops Operating

LCO 3.4.1 Two recirculation loops with matched flows shall be in operation.

OR

One recirculation loop may be in operation provided the following limits are applied when the associated LCO is applicable:

- a. LCO 3.2.1, "AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)," single loop operation limits specified in the COLR;
- b. LCO 3.2.2, "MINIMUM CRITICAL POWER RATIO (MCPR)," single loop operation limits specified in the COLR;
- c. LCO 3.3.1.1, "Reactor Protection System (RPS) Instrumentation," Function 2.b (Average Power Range Monitors Flow Biased Simulated Thermal Power - High), Allowable Value of Table 3.3.1.1-1 is reset for single loop operation.

APPLICABILITY: MODES 1 and 2.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|-----------------|
| A. Requirements of the LCO not met. | A.1 Satisfy the requirements of the LCO. | 24 hours |
| B. Required Action and associated Completion Time of Condition A not met. | B.1 Be in MODE 3. | 12 hours |
| <u>OR</u> No recirculation loops in operation. | | |

3.5 EMERGENCY CORE COOLING SYSTEMS (ECCS) AND REACTOR CORE ISOLATION COOLING (RCIC) SYSTEM

3.5.1 ECCS - Operating

LCO 3.5.1 Each ECCS injection/spray subsystem and the Automatic Depressurization System (ADS) function of six safety/relief valves shall be OPERABLE.

APPLICABILITY: MODE 1, MODES 2 and 3, except high pressure coolant injection (HPCI) and ADS valves are not required to be OPERABLE with reactor steam dome pressure \leq 150 psig.

ACTIONS

-----NOTE-----

LCO 3.0.4.b is not applicable to HPCI.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|-----------------|
| <p>A. One low pressure ECCS injection/spray subsystem inoperable.</p> <p><u>OR</u></p> <p>One low pressure coolant injection (LPCI) pump in both LPCI subsystems inoperable.</p> | <p>A.1 Restore low pressure ECCS injection/spray subsystem(s) to OPERABLE status.</p> | <p>7 days</p> |

(continued)

ECCS - Operating
3.5.1

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|---------------------------------|-----------------|
| B. Required Action and associated Completion Time of Condition A not met. | B.1 Be in MODE 3. <u>AND</u> | 12 hours |
| | B.2 Be in MODE 4. | 36 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|------------------------------------|
| C. HPCI System inoperable. | C.1 Verify by administrative means RCIC System is OPERABLE. <u>AND</u> C.2 Restore HPCI System to OPERABLE status. | Immediately 14 days |
| D. HPCI System inoperable. <u>AND</u> Condition A entered. | D.1 Restore HPCI System to OPERABLE status. <u>OR</u> D.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |
| E. One ADS valve inoperable. | E.1 Restore ADS valve to OPERABLE status. | 14 days |
| F. One ADS valve inoperable. <u>AND</u> Condition A entered. | F.1 Restore ADS valve to OPERABLE status. <u>OR</u> F.2 Restore low pressure ECCS injection/spray subsystem to OPERABLE status. | 72 hours 72 hours |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|---------------------------------|
| <p>G. Two or more ADS valves inoperable.</p> <p><u>OR</u></p> <p>Required Action and associated Completion Time of Condition C, D, E, or F not met.</p> | <p>G.1 Be in MODE 3.</p> <p><u>AND</u></p> <p>G.2 Reduce reactor steam dome pressure to ≤ 150 psig.</p> | <p>12 hours</p> <p>36 hours</p> |
| <p>H. Two or more low pressure ECCS injection/spray subsystems inoperable for reasons other than Condition A.</p> <p><u>OR</u></p> <p>HPCI System and one or more ADS valves inoperable.</p> | <p>H.1 Enter LCO 3.0.3.</p> | <p>Immediately</p> |

| SCRAM FAILURE | | | | REACTOR COOLANT ACTIVITY | | | | |
|--|-------|------|----|---|--|--|--|-------------------|
| Description | | | | Description | | | | |
| | | | | 1.3-U | | | | |
| | | | | Reactor coolant activity exceeds 28 $\mu\text{Ci/gm}$ dose equivalent I-131 (Technical Specification Limits) as determined by chemistry sample. OPERATING CONDITION ALL | | | | UNUSUAL EVENT |
| 1.2-A | | NOTE | | 1.3-A | | | | |
| Failure of RPS automatic scram functions to bring the reactor subcritical AND Manual scram or ARI (automatic or manual) was successful. OPERATING CONDITION: Mode 1 or 2 | | | | Reactor coolant activity exceeds 300 $\mu\text{Ci/gm}$ dose equivalent Iodine-131 as determined by chemistry sample. OPERATING CONDITION: Mode 1 or 2 or 3 | | | | ALERT |
| 1.2-S | | NOTE | | | | | | |
| Failure of automatic scram, manual scram, and ARI to bring the reactor subcritical. OPERATING CONDITION: Mode 1 | | | | | | | | SITE EMERGENCY |
| 1.2-G | CURVE | | US | | | | | |
| Failure of automatic scram, manual scram, and ARI. Reactor power is above 3% AND Either of the following conditions exists: <ul style="list-style-type: none"> • Suppression Pool temp exceeds HCTL. Refer to Curve 1.2-G. • Reactor water level can NOT be restored and maintained at or above -180 inches. OPERATING CONDITION: Mode 1 or 2 | | | | | | | | GENERAL EMERGENCY |

Facility: Browns Ferry NPP Scenario No.: F Op-Test No.: ILT 1102

FINAL

| | | | |
|------------|--|------------|------|
| Examiners: | | Operators: | SRO: |
| | | | ATC: |
| | | | BOP: |

Initial Conditions: IC104/ Unit 2 Reactor Power 70%/ EECW A3 Pump tagged Out/ RFPT B Out of Service

Turnover: Remove LPRM 8-49B from bypass IAW 2-OI-92B section 6.4, then raise power with Control Rods as directed by the RCP.

| Event No. | Malf. No. | Event Type* | Event Description |
|-----------|-------------------|-----------------|---|
| 1 | | N-BOP N-SRO | Remove an LPRM from Bypass 8-49B |
| 2 | | R-ATC R-SRO | Raise Power with Control Rods |
| 3 | rd25 rd07r1435 | C-ATC TS-SRO | RPIS Position Failure rod 14-35, will drift in when inserted to position 46 |
| 4 | sw03m | C-BOP TS-SRO | D3 EECW Pump Trip |
| 5 | ms05h | C-BOP TS-SRO | Outboard MSIV D Partial Closure |
| 6 | fw26a/b | I-ATC I-SRO | Feedwater Flow Transmitters fail |
| 7 | mc04 | M-ALL | Degrading Vacuum, ATWS with out MSIVs |
| 8 | ia02 | C | Loss of Drywell Control Air |
| 9 | rd01 | C | 2A CRD Pump Trip |

* (N)ormal, (R)eactivity, (I)nstrument, (C)omponent, (M)ajor

Critical Tasks - Three

CT#1-With a reactor scram required and the reactor not shutdown, initiate action to reduce power by injecting boron (If still critical with challenge to BIIT) and inserting control rods.

1. Safety Significance:

Shutting down reactor can preclude failure of containment or equipment necessary for the safe shutdown of the plant.

2. Cues:

Procedural compliance.
Suppression Pool temperature.

3. Measured by:

Observation - If operating per EOI-1 and C-5, US determines that SLC is required (indicated by verbal direction or EOI placekeeping) before exceeding 110° F in the Suppression Pool.

AND

RO places SLC A / B Pump control switch in ON, when directed by US.

AND

Control Rod insertion commenced in accordance with EOI Appendixes.

4. Feedback:

Reactor Power trend.
Control Rod indications.
SLC tank level.

CT#2-During an ATWS, when conditions are met to deliberately lower RPV level, Terminate and Prevent injection into the RPV from ECCS and Feedwater until conditions are met to reestablish injection.

1. Safety Significance:

Precludes loss of primary containment integrity and uncontrolled release of radioactivity into the environment.

2. Cues:

Procedural compliance.

3. Measured by:

Observation - With Emergency Depressurization not required and >5% power, injection systems are terminated and prevented until:

- <5% power or < -162" with Suppression Pool Temp > 110° F
- OR
- Level < (-) 50 inches with Suppression Pool Temp < 110° F

4. Feedback:

Injection system flow rates into RPV
Reactor Power lowering

Critical Tasks - Three

CT#3-With reactor scram required and the reactor not shutdown, to prevent an uncontrolled RPV depressurization and subsequent power excursion, inhibit ADS.

1. Safety Significance:

Precludes core damage due to an uncontrolled reactivity addition.

2. Cues:

Procedural compliance.

3. Measured by:

ADS logic inhibited prior to an automatic initiation unless all required injection systems are Terminated and Prevented.

4. Feedback:

RPV pressure trend.

RPV level trend.

ADS "ADS LOGIC BUS A/B INHIBITED" annunciator status.

Scenario Summary:

BOP will remove LPRM 8-49B from bypass IAW 2-OI-92B section 6.4.

ATC will raise Reactor Power with control rods as directed by the Reactivity Control Plan.

During power ascension Control Rod 14-35 will experience an RPIS position failure. The crew will respond IAW ARPs and 2-AOI-85-4. The ATC will insert Control Rod 14-35 one notch to establish position indication. After Control Rod 14-35 is inserted it will begin to drift in, the ATC will respond IAW 2-AOI-85-5 and insert the control rod to position 00.

EECW D3 Pump will trip and the standby EECW Pump B3 will fail to auto start, the BOP will respond IAW ARPs and start EECW Pump B3 to EECW flow to the north header. The SRO will evaluate Technical Specification 3.7.2 and Condition A is entered.

Outboard MSIV D will drift closed, the crew will respond IAW 2-AOI-1-3. The ATC will lower Reactor Power to less than 66% and the BOP will fully close Outboard MSIV D. The SRO will evaluate Technical Specification 3.6.1.3 and Condition A is entered.

Feedwater Flow Transmitters will fail the crew will respond IAW ARPs and 2-AOI-3-1, the ATC will report that Feedwater Level Control transferred to single element and will transfer to single element. Reactor Level will stabilize after the initial transient.

Vacuum will begin to degrade and the crew will respond IAW 2-AOI-47-3, the crew will insert a manual Reactor scram prior to the Main Turbine trip. An ATWS will exist and the crew will enter EOI-1 and C-5.

After the scram and airline break will occur in the drywell causing MSIV closure and transition to SRVs for pressure control and RCIC for level control. Until the crew performs Appendix 8G, SRV operation will degrade due to the loss of air.

CRD Pump 2A will trip and the ATC will start CRD Pump 1B in order to insert control rods.

The crew will maintain directed level and pressure bands, insert all control rods and enter EOI-2 and place RHR in Suppression Pool Cooling.

The Emergency Classification is 1.2-S

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

Controls Rods are being inserted

Reactor Level is being maintained in directed level band

SCENARIO REVIEW CHECKLIST

SCENARIO NUMBER: 2-F

- 6 Total Malfunctions Inserted: List (4-8)

- 2 Malfunctions that occur after EOI entry: List (1-4)

- 4 Abnormal Events: List (1-3)

- 1 Major Transients: List (1-2)

- 2 EOI's used: List (1-3)

- 1 EOI Contingencies used: List (0-3)

- 60 Validation Time (minutes)

- 3 Crew Critical Tasks: (2-5)

YES Technical Specifications Exercised (Yes/No)

Scenario Tasks

| <u>EVENT</u> | <u>TASK NUMBER</u> | <u>K/A</u> | <u>RO</u> | <u>SRO</u> |
|--------------|------------------------------------|--------------|-----------|------------|
| 1 | Remove an LPRM from Bypass | | | |
| | RO U-92B-NO-05 | 215005A4.04 | 3.2 | 3.2 |
| 2 | Raise Power with Control Rods | | | |
| | RO U-085-NO-07 | | | |
| | SRO S-000-AD-31 | 2.2.2 | 4.6 | 4.1 |
| 3 | RPIS Position Failure | | | |
| | RO U-085-AL-14 | 214000A2.01 | 3.1 | 3.3 |
| | SRO S-085-AB-04 | | | |
| 4 | EECW Pump Trip | | | |
| | RO U-067-NO-12 | 400000A2.01 | 3.3 | 3.4 |
| 5 | MSIV Partial Closure | | | |
| | RO U-001-AB-02 | 239001A2.03 | 4.0 | 4.2 |
| | SRO S-001-AB-02 | | | |
| 6 | Feedwater Flow Transmitter Failure | | | |
| | RO U-003-NO-12 | 259002A2.02 | 3.3 | 3.4 |
| | SRO S-003-AB-01 | | | |
| 7 | Vacuum Loss/ATWS | | | |
| | RO U-000-EM-17 | 295037EA2.06 | 4.0 | 4.1 |
| | SRO S-000-EM-06 | | | |
| | SRO S-000-EM-18 | | | |
| | SRO S-032-AB-02 | | | |

Procedures Used/Referenced:

| Procedure Number | Procedure Title | Procedure Revision |
|--------------------|---|--------------------|
| 2-OI-92B | Average Power Range Monitor | Revision 38 |
| 2-GOI-100-12 | Power Maneuvering | Revision 40 |
| 2-OI-85 | Control Rod Drive System | Revision 125 |
| 2-ARP-9-5A | Alarm Response Procedure Panel 2-9-5A | Revision 46 |
| 2-AOI-85-4 | Loss of RPIS | Revision 20 |
| TRM 3.3.5 | Surveillance Instrumentation | Revision 0 |
| 2-AOI-85-5 | Rod Drift In | Revision 19 |
| 2-ARP-9-20A | Alarm Response Procedure Panel 2-9-20A | Revision 24 |
| 2-ARP-9-23D | Alarm Response Procedure Panel 2-9-23D | Revision 12 |
| 0-OI-67 | Emergency Equipment Cooling Water System | Revision 91 |
| TS 3.7.2 | Emergency Equipment Cooling Water System and Ultimate Heat Sink | Amendment 254 |
| 2-ARP-9-5B | Alarm Response Procedure Panel 2-9-5B | Revision 25 |
| 2-AOI-1-3 | Main Steam Isolation Valve Closure at Power | Revision 22 |
| TS 3.6.1.3 | Primary Containment Isolation Valves | Amendment 253 |
| 2-ARP-9-6C | Alarm Response Procedure Panel 2-9-6C | Revision 19 |
| 2-AOI-3-1 | Loss of Reactor Feedwater or Reactor Water Level High/Low | Revision 20 |
| 2-ARP-9-53 | Alarm Response Procedure Panel 2-9-53 | Revision 35 |
| 2-AOI-47-3 | Loss of Condenser Vacuum | Revision 18 |
| 2-EOI-1 | RPV Control Flowchart | Revision 12 |
| 2-EOI-APPENDIX-8G | Crosstie CAD to Drywell Control Air | Revision 4 |
| 2-EOI-APPENDIX-11A | Alternate RPV Pressure Control Systems MSRVs | Revision 4 |
| 2-EOI-2-C-5 | Level-Power Control Flowchart | Revision 11 |
| 2-EOI-APPENDIX-4 | Prevention of Injection | Revision 10 |
| 2-EOI-APPENDIX-5C | Injection System Lineup RCIC | Revision 4 |
| 2-EOI-APPENDIX-5D | Injection System Lineup HPCI | Revision 6 |

Procedures Used/Referenced Continued:

| Procedure Number | Procedure Title | Procedure Revision |
|-------------------------|--|---------------------------|
| 2-EOI-APPENDIX-3A | SLC Injection | Revision 5 |
| 2-EOI-APPENDIX-2 | Defeating ARI Logic Trips | Revision 4 |
| 2-EOI-APPENDIX-1F | Manual Scram | Revision 5 |
| 2-EOI-APPENDIX-1D | Insert Control Rods Using Reactor Manual Control System | Revision 6 |
| 2-AOI-85-3 | CRD System Failure | Revision 23 |
| 2-EOI-2 | Primary Containment Control Flowchart | Revision 10 |
| 2-EOI-APPENDIX-17A | RHR System Operation Suppression Pool Cooling | Revision 12 |
| 2-EOI-APPENDIX-12 | Primary Containment Venting | Revision 3 |
| EPIP-1 | Emergency Classification Procedure Event Classification Matrix | Revision 46 |
| EPIP-4 | Site Area Emergency | Revision 32 |

Console Operator Instructions

A. Scenario File Summary

1. File: batch and trigger files for scenario 2-F

Batch NRC/110202

Imf sw07b

Bat atws70

Imf rd01a (e2 120)

Trge1 NRC/msivd = zdihs0152a[1].eq.1

Trge1 = bat NRC/110202-3

Ior xa555b23 alarm_off

Trge3 NRC/singleelement = zdihs466a.eq.1

Trge3 = bat NRC/110202-4

Imf ia02a (e2 15) 100 10 0

Imf ia02b (e2 60) 100 30 0

Batch NRC/1102-1

Ior zlohs466a off

Ior zlohs466b on

Imf fw26a (none 0) 0

Imf fw26b (none 60) 100 30 0

Batch NRC/1102-2

Imf th27e

Ior zlohs0152a[2] on

Imf ms05h

Ior za0fi464 1.6

Batch NRC/1102-3

Dor zlohs0152a[2]

Dor zaofi464

Batch NRC/1102-4

Dor zlohs466a

Dor zlohs466b

Pref file

F3 imf rd25

F4 imf rd07r1435

F5dmf rd071435

F6 imf sw03m

F7 bat NRC/110202

F8 bat NRC/1102-1

F9 bat NRC/1102-2

F10 dmf th27e

F11

F12 trg e2 modesw

Shift f1 imf mc04 100

Shift f4 mrf rd06 open

Shift f5 bat app01f

Shift f6 bat app02

Shift f7 mrf rd06 close

Shift f8 bat sdv

Console Operator Instructions

Scenario 2-F

| | | <u>DESCRIPTION/ACTION</u> |
|-----------------|------------|---------------------------|
| Simulator Setup | manual | Reset to IC 104 |
| Simulator Setup | Load Batch | RestorePref NRC/110202 |
| Simulator Setup | manual | Tag Out EECW Pump A3 |
| Simulator Setup | manual | F7 and F12 |
| Simulator Setup | | Verify file loaded |

**RCP required (70% - 85% with control rods and flow) and RCP for Urgent Load Reduction
Provide marked up copy of 3-GOI-100-12**

Simulator Event Guide:

Event 1 Normal: Remove LPRM 8-49B from bypass IAW 2-OI-92B section 6.4

| | |
|---------------|---|
| SRO | Directs LPRM 8-49B un-bypassed. |
| BOP | Removes LPRM 8-49B from bypass IAW 2-OI-92B section 6.4. |
| | <p>6.4 Returning an LPRM to Operate From a Bypassed Condition</p> <p>[1] REVIEW all precautions and limitations. REFER TO Section 3.0.</p> <p>[2] REFERENCE Illustration 4 to find the APRM/LPRM Channel associated with the desired LPRM to be returned to normal.</p> <p>[3] At Panel 2-9-14, DEPRESS any softkey to illuminate the display on the desired APRM/LPRM channel chassis.</p> <p>[4] DEPRESS the "ETC" softkey until "BYPASS SELECTIONS" illuminates on the bottom row of the display.</p> <p>[5] DEPRESS "BYPASS SELECTIONS" softkey, enter the password, and DEPRESS "ENT".</p> <p>[6] SELECT the desired LPRM to be returned to service by using the left or right arrows on the softkey board until the inverse video illuminates the correct LPRM.</p> <p>[7] DEPRESS the "OPERATE" softkey.</p> <p>[8] CHECK the "BYP/HV OFF" is replaced by "OPERATE" below the selected LPRM.</p> <p>[9] DEPRESS "EXIT" softkey to return display to the desired bargraph.</p> <p>[10] VERIFY, as a result of returning this LPRM to operate, that any alarms received on Panel 2-9-5 or on the APRM/LPRM channel are reset.</p> |
| Driver | If RE called for password 1234 |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|-----|---|
| | SRO | Notify ODS of power increase. |
| | | <p>Direct Power increase using Recirc Flow per 2-GOI-100-12.</p> <p>[20] IF desired to raise power with only two (2) Reactor feedpumps in service, THEN RAISE Reactor power, as desired, maintaining each Reactor feedpump less than 5850 RPM.</p> |
| | ATC | <p>Raise Power with Control Rods per 2-OI-85, section 6.6. Control Rods 22-31, 30-39, 38-31 and 30-23 from 00 to 16, 30-31 from 00 to 48.</p> |
| | | <p>6.6.1 Initial Conditions Prior to Withdrawing Control Rods</p> <p>[2] VERIFY the following prior to control rod movement:</p> <ul style="list-style-type: none"> • CRD POWER, 2-HS-85-46 in ON. • Rod Worth Minimizer is operable and LATCHED into the correct ROD GROUP when Rod Worth Minimizer is enforcing (not required with no fuel in RPV). <p>6.6.2 Actions Required During and Following Control Rod Withdrawal</p> <p>[4] OBSERVE the following during control rod repositioning:</p> <ul style="list-style-type: none"> • Control rod reed switch position indicators (four rod display) agree with the indication on the Full Core Display. • Nuclear Instrumentation responds as control rods move through the core. (This ensures control rod is following drive during Control Rod movement.) <p>[5] ATTEMPT to minimize automatic RBM Rod Block as follows:</p> <ul style="list-style-type: none"> • STOP Control Rod withdrawal (if possible) prior to reaching any RBM Rod Block using the RBM displays on Panel 2-9-5 and PERFORM Step 6.6.2[6]. <p>[6] IF Control Rod movement was stopped to keep from exceeding a RBM setpoint or was caused by a RBM Rod Block, THEN</p> <p>PERFORM the following at the Unit Supervisor's discretion to "REINITIALIZE" the RBM:</p> <p>[6.1] PLACE CRD POWER, 2-HS-85-46 in the OFF position to deselect the Control Rod.</p> <p>[6.2] PLACE CRD POWER, 2-HS-85-46, in the ON position.</p> |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|-----|---|
| | ATC | <p>6.6.3 Control Rod Notch Withdrawal</p> <p>[1] SELECT the desired control rod by depressing the appropriate CRD ROD SELECT pushbutton, 2-XS-85-40.</p> <p>[2] OBSERVE the following for the selected control rod:</p> <ul style="list-style-type: none">• CRD ROD SELECT pushbutton is brightly ILLUMINATED.• White light on the Full Core Display ILLUMINATED.• Rod Out Permit light ILLUMINATED. <p>[3] VERIFY Rod Worth Minimizer is operable and LATCHED into the correct ROD GROUP when the Rod Worth Minimizer is enforcing.</p> <p>[4] PLACE CRD CONTROL SWITCH, 2-HS-85-48, in ROD OUT NOTCH, and RELEASE.</p> <p>[5] OBSERVE the control rod settles into the desired position and the ROD SETTLE light extinguishes.</p> |
|--|-----|---|

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | |
|-----|---|
| ATC | <p>6.6.4 Continuous Rod Withdrawal</p> <p>[1] SELECT desired Control Rod by depressing appropriate CRD ROD SELECT, 2-XS-85-40.</p> <p>[2] OBSERVE the following for the selected control rod:</p> <ul style="list-style-type: none">• CRD ROD SELECT pushbutton is brightly ILLUMINATED.• White light on the Full Core Display ILLUMINATED.• Rod Out Permit light ILLUMINATED. <p>[3] VERIFY Rod Worth Minimizer operable and LATCHED into correct ROD GROUP when the Rod Worth Minimizer is enforcing.</p> <p>[4] VERIFY Control Rod is being withdrawn to a position greater than three notches.</p> <p>[5] IF withdrawing the control rod to a position other than "48", THEN</p> <p>PERFORM the following: (Otherwise N/A)</p> <p>[5.1] PLACE AND HOLD CRD NOTCH OVERRIDE, 2-HS-85-47, in NOTCH OVERRRIDE.</p> <p>[5.2] PLACE AND HOLD CRD CONTROL SWITCH, 2-HS-85-48, in ROD OUT NOTCH.</p> <p>[5.3] WHEN control rod reaches two notches prior to the intended notch, THEN</p> <p>RELEASE CRD NOTCH OVERRIDE, 2-HS-85-47 and CRD CONTROL SWITCH, 2-HS-85-48.</p> <p>[5.4] IF control rod settles at notch before intended notch, THEN</p> <p>PLACE CRD CONTROL SWITCH, 2-HS-85-48, in ROD OUT NOTCH and RELEASE.</p> |
|-----|---|

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | |
|---------------|--|
| ATC | <p>6.6.4 Continuous Rod Withdrawal (Continued)</p> <p>[5.5] WHEN control rod settles into the intended notch, THEN CHECK the following.</p> <ul style="list-style-type: none"> • Four rod display digital readout and the full core display digital readout and background light remain illuminated. • CONTROL ROD OVERTRAVEL annunciator, 2-XA-55-5A, Window 14, does NOT alarm. <p>[5.6] CHECK the control rod settles at intended position and ROD SETTLE light extinguishes.</p> <p>[6] IF continuously withdrawing the control rod to position 48 and performing the control rod coupling integrity check in conjunction with withdrawal, THEN</p> <p>PERFORM the following: (Otherwise N/A)</p> <p>[6.1] PLACE and HOLD CRD NOTCH OVERRIDE, 2-HS-85-47, in NOTCH OVERRRRIDE.</p> <p>[6.2] PLACE and HOLD CRD CONTROL SWITCH, 2-HS-85-48, in ROD OUT NOTCH.</p> <p>[6.3] MAINTAIN the CRD Notch Override Switch in the Override position and the CRD Control Switch in the Rod Out Notch position, with the control rod at position 48.</p> <p>[6.4] CHECK control rod coupled by observing the following:</p> <ul style="list-style-type: none"> • Four rod display digital readout and the full core display digital readout and background light remain illuminated. • CONTROL ROD OVERTRAVEL annunciator, 2-XA-55-5A, Window 14, does not alarm. <p>[6.5] RELEASE both CRD NOTCH OVERRIDE, 2-HS-85-47, and CRD CONTROL SWITCH, 2-HS-85-48.</p> |
| DRIVER | Insert imf rd25r14-35 RPIS Position Failure when rod 30-31 is being withdrawn to 48 |

Simulator Event Guide:

Event 2 Reactivity: Raise Power with Control Rods

| | | |
|--|---------------|--|
| | ATC | <p>[6.6] CHECK control rod settles into position 48 and ROD SETTLE light extinguishes.</p> <p>[6.7] IF control rod coupling integrity check fails, THEN REFER TO 2-AOI-85-2.</p> |
| | ATC | <p>6.6.5 Return to Normal After Completion of Control Rod Withdrawal</p> <p>[1] WHEN control rod movement is no longer desired AND deselecting control rods is desired, THEN:</p> <p>[1.1] PLACE CRD POWER, 2-HS-85-46, in OFF.</p> <p>[1.2] PLACE CRD POWER, 2-HS-85-46, in ON.</p> |
| | | |
| | DRIVER | Insert imf rd25r14-35 RPIS Position Failure when rod 30-31 is being withdrawn to 48 |

Simulator Event Guide:

Event 3 Instrument: RPIS Position Failure Control Rod 14-35

| | | |
|--|---------------|--|
| | ATC | Report Control Rod Drift Alarm 5A-28, reports no control rods drifting. |
| | | Reports loss of position indication on Control Rod 14-35. |
| | SRO | Enter 2-AOI-85-4 Loss of RPIS. |
| | ATC | 4.1 Immediate Actions [1] STOP all control rod movement. |
| | SRO | 4.2 Subsequent Actions NOTE Reference TRM 3.3.5, RPIS Indicated Channel Operability, for applicable 7 or 30 day LCO relating to an inoperable RPIS indication. [1] IF control rod movement is required with a Total loss of RPIS, THEN MANUALLY SCRAM reactor. [2] NOTIFY the Operations Superintendent and Reactor Engineer for actions to be taken in a timely manner. |
| | SRO | [9] IF unable to restore position indication for an individual control rod or rods, THEN NOTIFY Reactor Engineer and DETERMINE additional corrective action. Control Rods may be moved to an Operable Position Indication as a means of position verification (REFER TO Tech Spec Bases SR 3.1.3.1). As a minimum, rod position will be verified, preferably with an independent position indication or other method. |
| | DRIVER | Acknowledge notifications, if asked for recommendation; ask caller to recommend action. RE provide to complete movement of control rod 30-31 to 48. |
| | SRO | Direct ATC to insert Control Rod 14-35 one notch to attempt to establish position indication. |
| | ATC | Insert Control Rod 14-35 to position 46. |
| | SRO | Evaluate Technical Requirements Manual 3.3.5. Information LCO Condition A and Condition C from table 3.3.5-1 |
| | DRIVER | When control rod 14-35 is inserted to position 46; initiate F4 imf rd07r1435, when the control rod is near position 08; delete the drift in malfunction F5 dmf rd07r1435. |
| | NRC | When ready EECW Pump D3 Trip. |
| | DRIVER | When directed by the NRC F6 imf sw03m. |

Simulator Event Guide:

Event 3 Instrument: RPIS Position Failure Control Rod 14-35

| | | |
|--|---------------|---|
| | ATC | Report Control Rod Drift Alarm 5A-28, reports Control Rod 14-35 drifting in. |
| | SRO | Enter 2-AOI-85-5 Rod Drift In. |
| | ATC | 4.1 Immediate Actions [1] IF multiple rods are drifting into core, THEN MANUALLY SCRAM Reactor. Refer to 2-AOI-100-1. |
| | SRO | 4.2 Subsequent Actions [1] IF a Control Rod is moving from its intended position without operator actions, THEN INSERT the Control Rod to position 00 using CONTINUOUS IN. [2] NOTIFY the Reactor Engineer to Evaluate Core Thermal Limits and Preconditioning Limits for the current Control Rod pattern. [3] IF another Control Rod Drift occurs before Reactor Engineering completes the evaluation, THEN MANUALLY SCRAM Reactor and enter 2-AOI-100-1. |
| | ATC | Inserts Control Rod 14-35 to position 00. |
| | | [4] CHECK Thermal Limits on ICS (RUN OFFICIAL 3D). |
| | | [5] ADJUST control rod pattern as directed by Reactor Engineer and CHECK Thermal Limits on ICS (RUN OFFICIAL 3D). |
| | | |
| | | |
| | Crew | Dispatch AUO to check scram valves. |
| | DRIVER | As Reactor engineer when called have crew stop control rod pattern adjustment. As AUO after dispatched report scram valves are normal. |
| | SRO | Evaluate Tech Spec 3.1.3 |
| | | Condition C One or more control rods inoperable for reasons other than Condition A or B Required Action C.1 Fully Insert inoperable control rod Completion Time 3 Hours AND Required Action C.2 Disarm the associated CRD Completion Time 4 Hours |
| | NRC | When ready EECW Pump D3 Trip. |
| | DRIVER | When directed by the NRC F6 imf sw03m. |

Simulator Event Guide:

Event 4 Component: EECW Pump D3 Trip

| | | |
|--|---------------|---|
| | BOP | Respond to alarms 20A-21 and 23D-26. |
| | | 23D-26 4160V SD BD D MOTOR OL or TRIP Overload or trip out, on any one of the following: CS pump 1D, 2D, RHR pump 1D, 2D, RHRSW pump D2, D3 A. CHECK control room for white light illuminated on effected equipment. B. DISPATCH personnel to check: 1. Relays at associated electrical bd. 2. Equipment for abnormal conditions, relay targets, smell, burned paint, breaker. |
| | | 20A EECW SOUTH HDR DG SECTION PRESS LOW B. CHECK Panel 2-9-3 for status of South header pump(s) breaker lights and pump motor amps normal. C. NOTIFY UNIT SUPERVISOR, Unit 1 and Unit 3. D. START standby pump for affected header. REFER TO 0-OI-67. |
| | | 8.11 Recovering from an EECW Pump Trip [1] VERIFY < 25 minutes has elapsed since the EECW pump trip and header pressure > 0 psig. [3] IF the south header pump has tripped, THEN : [3.1] START desired RHRSW Pump using one of the following: • RHRSW PUMP D3(B3) EECW SOUTH HDR, 0-HS-23-94A/2(88A/2) on Unit 2. |
| | | [4] For the EECW(RHRSW) pump(s) started, PERFORM the following: • VERIFY running current is less than 53 amps. • VERIFY locally, Pump breaker charging spring recharged by observing amber breaker spring charged light is on and closing spring target indicates charged. • VERIFY Pump upper and lower motor bearing oil level is in the normal operating range. • NOTIFY Chemistry of running RHRSW (EECW) pump(s). |
| | BOP | Start EECW Pump B3. |
| | SRO | Evaluate Technical Specification 3.7.2. |
| | DRIVER | When dispatched report EECW Pump D3 nothing abnormal at pump, breaker indicates instantaneous over current 4kv SD BD D compt 10. |

Simulator Event Guide:

Event 4 Component: EECW Pump D3 Trip

| | | |
|--|---------------|---|
| | SRO | Evaluate Technical Specification 3.7.2. |
| | | Condition A: One required EECW pump inoperable. Required Action A.1: Restore the required EECW pump to OPERABLE status. Completion Time: 7 days |
| | | |
| | | |
| | | |
| | | |
| | NRC | When ready, MSIV Partial closure. |
| | DRIVER | When directed F9 bat NRC/110202-2, when alarm 5B-18 alarms F10 dmft h27e. |

Simulator Event Guide:

Event 5 Component: Outboard MSIV D Partial Closure

| | | |
|--|---------|--|
| | ATC | Respond to alarm 5B-18 MAIN STEAM LINE CH A FLOW HIGH. |
| | | <p>5B-18 MAIN STEAM LINE CH A FLOW HIGH</p> <p>A. VERIFY alarm by checking main steam flow indicators.</p> <p>B. IF alarm is valid on any steam line, THEN MANUALLY SCRAM Reactor and PLACE Rx Mode Sw. in Shutdown and CLOSE MSIVs. (This alarm is not valid)</p> <p>C. IF any flow indicators are low, THEN CHECK all MSIVs open.</p> <p>D. REFER TO 2-AOI-1-3.</p> <p>E. REFER TO Tech Spec Table 3.3.6.1-1.</p> |
| | ATC | Report Steam flow in D line is lower than A, B and C lines. |
| | ATC/BOP | Report Outboard MSIV D 1-52 indicates partially closed. |
| | SRO | Enter 2-AOI-1-3, MSIV Closure at Power. |
| | | <p>4.1 Immediate Action</p> <p>None</p> <p>4.2 Subsequent Action</p> <p>[1] IF any EOI entry condition is met, THEN (Otherwise N/A):</p> |
| | ATC | [2] LOWER reactor power with recirc flow and insert control rods as necessary, when directed by the Reactor Engineer/Unit Supervisor, to ensure that rated steam line flow (3.54 x 106 lbm/hr) is NOT exceeded; as indicated on Main Steam Line Flow Indicators. |
| | ATC/BOP | [3] IF an MSIV is partially closed, THEN : [3.1] LOWER reactor power to ≤ 66%. [3.2] PLACE the associated MSIV control switch to CLOSE . |
| | ATC | Lower Power to ≤ 66%. |
| | BOP | PLACE the Outboard MSIV D 1-52 control switch to CLOSE . |

Simulator Event Guide:

Event 5 Component: MSIV Partial Closure

| | | |
|--|--------|---|
| | SRO | Evaluate Technical Specification 3.6.1.3. |
| | | <p>Condition A: NOTE Only applicable to penetration flow paths with two PCIVs. One or more penetration flow paths with one PCIV inoperable except due to MSIV leakage not within limits</p> <p>Required Action A.1: Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p>Completion Time: 8 hours for main steam lines</p> <p>Required Action A.2: NOTE Isolation devices in high radiation areas may be verified by use of administrative means. Verify the affected penetration flow path is isolated.</p> <p>Completion Time: Once per 31 days for isolation devices outside primary containment</p> |
| | | |
| | | |
| | | |
| | NRC | When ready, Feedwater Flow Transmitter Failure. |
| | DRIVER | When directed F8 bat NRC/110202-1. |

Simulator Event Guide:

Event 6 Instrument: Feedwater Flow Transmitter Failures

| | | |
|--|--------|--|
| | ATC | <p>Respond to alarm 6C-14 RFWCS INPUT FAILURE.</p> <p>A. VERIFY RFWCS continues to maintain Reactor Water level.</p> <p>B. IDENTIFY bad/invalid signal by checking Control Room instrumentation and/or ICS. REFER TO ATTACHMENT 1, on next page, for list of RFWCS instrumentation. REFER TO ICS RX FW LVL CONTROL SYS display (FWLCS).</p> <p>C. REQUEST assistance from Site Engineering.</p> <p>D. BYPASS the bad/invalid signal with Unit Supervisor approval.</p> |
| | ATC | Report Feedwater Flow signal has failed LOW for FW Line A. |
| | ATC | Report FW Line B Feedwater Flow signal failing HIGH . |
| | SRO | Enter 2-AOI-3-1, "Loss of Feedwater or Reactor Water Level High/Low". |
| | | <p>4.1 Immediate Actions None</p> <p>4.2 Subsequent Actions</p> <p>[2] IF Feedwater Flow signal fails (FI-3-78A, FI-3-78B), THEN PERFORM the following:</p> <p>A. With SRO's permission, REFER TO 2-OI-3 and BYPASS failed Feedwater Flow Instrument in Unit 1&2 Computer Room; or Unit 2 Aux Instrument Room.</p> <p>[2.1] IF both Feedwater Flow Instruments fail, THEN VERIFY level control transfers to SINGLE ELEMENT.</p> |
| | ATC | Verifies Reactor Level control in single element, level control failed to transfer to single element; Operator depresses single element pushbutton to transfer. |
| | | <p>[6] IF Reactor Water Level continues to rise, THEN TRIP RFP, as necessary.</p> <p>[7] IF RFPs in automatic control, THEN VERIFY 2-LIC-46-5 lowers flow of operating RFPs.</p> |
| | ATC | Verifies RFPTs maintain water level. |
| | NRC | When ready for Major Vacuum Leak. |
| | DRIVER | Upon Lead examiner direction <shift F1> imf mc04 100. |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|---------------|--|
| | BOP | Respond to alarm 53-14 OG HOLDUP LINE INLET FLOW HIGH. |
| | ATC | Report degrading condenser Vacuum. |
| | SRO | Enter 2-AOI-47-3, "Loss of Condenser Vacuum". |
| | | 4.1 Immediate Actions None |
| | | 4.2 Subsequent Actions |
| | | [1] IF ANY EOI entry condition is met? THEN: |
| | | [2] IF unable to maintain hotwell pressure below -25 inches Hg, as indicated on 2-XR-2-2, with Reactor power less than 30%, THEN TRIP the main turbine. |
| | | [4] REDUCE reactor power in an attempt to maintain condenser vacuum. |
| | SRO | Determines a trigger value for Reactor Scram prior to Turbine Trip; at 25 inches. |
| | ATC | Insert Reactor Scram when directed; and place mode switch in shutdown. Report ATWS and initiate first channel of ARI. |
| | DRIVER | Right after the scram enter <shift F8> Bat SDV. |
| | SRO | Enter 2-EOI-1, "RPV Control". |
| | SRO | EOI-1 (Reactor Pressure) |
| | | Monitor and Control Reactor Pressure |
| | | IF Drywell Pressure Above 2.4 psig? - NO |
| | | IF Emergency Depressurization is Anticipated and the Reactor will remain subcritical without boron under all conditions THEN Rapidly depressurize the RPV with the Main Turbine Bypass Valves irrespective of cooldown rate ?- NO |
| | | IF Emergency Depressurization is required THEN exit RC/P and enter C2 Emergency Depressurization? - NO |
| | | IF RPV water level cannot be determined? - NO |
| | | Is any MSRVCycling? - YES |
| | | IF Steam cooling is required? - NO |
| | | IF Suppression Pool level and temperature cannot be maintained in the safe area of Curve 3? - NO |

Simulator Event Guide:

Event 8 Component: ATWS without MSIVs

| | | |
|--|---------------|--|
| | SRO | 2-EOI-1 (Reactor Pressure) |
| | | IF Suppression Pool level cannot be maintained in the safe area of Curve 4? - NO |
| | | IF Drywell Control air becomes unavailable? – YES. THEN crosstie CAD to Drywell Control Air, Appendix 8G. |
| | | IF Boron injection is required? - NO |
| | SRO | Direct a Pressure Band of 800 to 1000 psig, Appendix 11A. |
| | ATC/BOP | Maintain directed pressure band, IAW Appendix 11A. |
| | BOP | Crosstie CAD to Drywell control air, IAW Appendix 8G. |
| | SRO | IF Main Steam Relief Valve Air Accumulator Low annunciator, (XA-55-3D-18) is in alarm, THEN: place each MSR/V Control Switch in Close/Auto AND Place MSR/V Auto Actuation Logic Inhibit XS-1-202 to Inhibit. |
| | ATC/BOP | Places XS-1-202 to inhibit. |
| | SRO | EOI-1 RPV Pressure – Augment RPV Pressure control as necessary with one or more of the following depressurization systems: HPCI Appendix 11C, RCIC Appendix 11B, RFPTs on minimum flow Appendix 11F, Main Steam System Drains Appendix 11D, Steam Seals Appendix 11G, SJAEs Appendix 11G, Off Gas Preheater Appendix 11G, RWCU Appendix 11E. |
| | DRIVER | If Appendix 8G is performed, THEN delete Instrument Air Leaks ia02a and ia02b. |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| ATC/BOP | Pressure Control IAW Appendix 11A, RPV Pressure Control SRVs |
|---------|--|
| | 1. IF Drywell Control Air is NOT available, THEN: EXECUTE EOI Appendix 8G, CROSSTIE CAD TO DRYWELL CONTROL AIR, CONCURRENTLY with this procedure. |
| | 2. IF Suppression Pool level is at or below 5.5 ft, THEN: CLOSE MSRVs and CONTROL RPV pressure using other options. |
| | 3. OPEN MSRVs; using the following sequence to control RPV pressure, as directed by SRO: |
| | a. 2-PCV-1-179 MN STM LINE A RELIEF VALVE |
| | b. 2-PCV-1-180 MN STM LINE D RELIEF VALVE. |
| | c. 2-PCV-1-4 MN STM LINE A RELIEF VALVE |
| | d. 2-PCV-1-31 MN STM LINE C RELIEF VALVE |
| | e. 2-PCV-1-23 MN STM LINE B RELIEF VALVE |
| | f. 2-PCV-1-42 MN STM LINE D RELIEF VALVE |
| | g. 2-PCV-1-30 MN STM LINE C RELIEF VALVE |
| | h. 2-PCV-1-19 MN STM LINE B RELIEF VALVE. |
| | i. 2-PCV-1-5 MN STM LINE A RELIEF VALVE. |
| | j. 2-PCV-1-41 MN STM LINE D RELIEF VALVE |
| | k. 2-PCV-1-22 MN STM LINE B RELIEF VALVE |
| | l. 2-PCV-1-18 MN STM LINE B RELIEF VALVE |
| | m. 2-PCV-1-34 MN STM LINE C RELIEF VALVE |
| | |
| | |
| | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|---------------|--|
| | ATC/BOP | Pressure Control IAW Appendix 11A, RPV Pressure Control SRVs |
| | | 3. IF Drywell Control Air header, supplied from CAD System A; shows indications of being depressurized, as determined by Appendix 8G, THEN: OPEN MSRVs supplied by CAD System B, using the following sequence to control RPV pressure, as directed by SRO: |
| | | 4. IF Drywell Control Air header, supplied from CAD System B; shows indications of being depressurized, as determined by Appendix 8G, THEN: OPEN MSRVs supplied by CAD System A, using the following sequence to control RPV pressure, as directed by SRO: |
| | | 6. IF BOTH Drywell Control Air headers are depressurized, THEN PERFORM the following as directed by EOI-1, RPV Control, RC/P Section: <ul style="list-style-type: none"> • PLACE each MSRV control switch in CLOSE/AUTO, and PLACE 2-XS-1-202, MSRV AUTO ACTUATION LOGIC INHIBIT, to INHIBIT. AND <ul style="list-style-type: none"> • MINIMIZE MSRV cycling by using sustained openings for RPV depressurization. |
| | SRO | EOI-1 RPV Pressure – Augment RPV Pressure control as necessary with one or more of the following depressurization systems: HPCI Appendix 11C, RCIC Appendix 11B, RFPTs on minimum flow Appendix 11F, Main Steam System Drains Appendix 11D, Steam Seals Appendix 11G, SJAEs Appendix 11G, Off Gas Preheater Appendix 11G, RWCU Appendix 11E. |
| | ATC/BOP | Augment RPV Pressure Control, if directed by SRO. |
| | | |
| | | |
| | | |
| | DRIVER | If Appendix 8G is performed, THEN delete Instrument Air Leaks ia02a and ia02b. |
| | | |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 8 Component: Loss of Drywell Control Air

| | | |
|--|---------------|--|
| | BOP | Crosstie CAD to Drywell control air, IAW Appendix 8G. |
| | | 1. OPEN the following valves: <ul style="list-style-type: none"> • 0-FCV-84-5, CAD SYSTEM A N2 SHUTOFF VALVE (Panel 9-54) • 0-FCV-84-16, CAD SYSTEM B N2 SHUTOFF VALVE (Panel 9-55). |
| | | 2. VERIFY 0-PI-84-6, N2 VAPORIZER A OUTLET PRESSURE, and 0-PI-84-17, N2 VAPORIZER B OUTLET PRESSURE, indicate approximately 100 psig (Unit 1, Panel 9-54 and 9-55). |
| | | 3. PLACE keylock switch 2-HS-84-48, CAD A CROSS TIE TO DW CONTROL AIR, in OPEN (Unit 2, Panel 9-54). |
| | | 4. CHECK OPEN 2-FSV-84-48, CAD A CROSS TIE TO DW CONTROL AIR, (Unit 2, Panel 9-54). |
| | | 5. PLACE keylock switch 2-HS-84-49, CAD B CROSS TIE TO DW CONTROL AIR, in OPEN (Unit 2, Panel 9-55). |
| | | 6. CHECK OPEN 2-FSV-84-49, CAD B CROSS TIE TO DW CONTROL AIR (Unit 2, Panel 9-55). |
| | | 7. CHECK MAIN STEAM RELIEF VLV AIR ACCUM PRESS LOW, 2-PA-32-31, alarm cleared (2-XA-55-3D, Window 18). |
| | | 8. IF MAIN STEAM RELIEF VLV AIR ACCUM PRESS LOW, 2-PA-32-31, annunciator is or remains in alarm (2-XA-55-3D, Window 18), THEN DETERMINE which Drywell Control Air header is depressurized as follows: a. DISPATCH personnel to Unit 2, RB, El 565 ft, to MONITOR the following indications for low pressure: b. MONITOR 0-FI-84-7(18), CAD LINE A(B) N2 FLOW, on Unit 1, Panel 1-9-54(55) for high flow. c. MONITOR inboard MSIV indication status for valves drifting closed. |
| | | 9. IF Drywell Control Air header supplied from CAD System A shows indications of being depressurized, THEN CLOSE the following valves: <ul style="list-style-type: none"> • 0-FCV-84-5, CAD SYSTEM A N2 SHUTOFF VALVE (Panel 9-54) • 2-FSV-84-48, CAD A CROSS TIE TO DW CONTROL AIR (Panel 9-54). 10. IF Drywell Control Air header supplied from CAD B shows indications of being depressurized, THEN CLOSE the following valves: <ul style="list-style-type: none"> • 0-FCV-84-16, CAD SYSTEM B N2 SHUTOFF VALVE (Panel 9-55) • 2-FSV-84-49, CAD B CROSS TIE TO DW CONTROL AIR (Panel 9-55). |
| | DRIVER | If Appendix 8G is performed, THEN delete Instrument Air Leaks ia02a and ia02b. |
| | DRIVER | If dispatched CAD N2 PRESSURE TO DWCA for CAD A pressure is 105 psig. DW CONT AIR N2 SUPPLY PRESS for CAD B pressure is 110 psig. |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|-------------|--|
| | SRO | C5 Level / Power Control |
| | | Crosstie CAD to DW Control Air, if necessary (Appendix 8G). |
| | | IF Suppression Pool Temperature is above 110°F AND Reactor Power is above 5% AND a MSR/V is open or cycling OR drywell pressure is above 2.4 psig AND RPV water level is above -162 inches? – NO |
| | | Is Reactor Power above 5% ?- YES |
| | | Stop and Prevent all injection into the RPV except from RCIC, CRD, and SLC (Appendix 4). WHEN RPV Level drops below -50 inches; THEN Continue: |
| | CT#2 | Direct Terminate and Prevent IAW Appendix 4. |
| | | IF Suppression Pool Temperature is above 110°F AND Reactor Power is above 5% AND a MSR/V is open or cycling OR drywell pressure is above 2.4 psig AND RPV water level is above -162 inches – IF YES? |
| | | Stop and Prevent all injection into the RPV except from RCIC, CRD, and SLC; irrespective of any consequent reactor power or reactor water level oscillations. |
| | | WHEN RPV Level drops below -50 inches and any of the following exist: <ul style="list-style-type: none"> • Power drops below 5% OR • All MSR/Vs remain closed and DW pressure remains below 2.4 psig OR • Water level reaches -162 inches THEN Continue: |
| | CT#2 | Direct Terminate and Prevent, IAW Appendix 4. |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|--------------------------------|---|
| | ATC/BOP | Terminate and Prevent IAW Appendix 4 |
| | <p>CT#2 BOP/ATC</p> | <p>Appendix 4</p> <ol style="list-style-type: none"> 1. PREVENT injection from HPCI by performing the following: <ol style="list-style-type: none"> a. IF HPCI Turbine is NOT at zero speed, THEN PRESS and HOLD 2-HS-73-18A, HPCI TURBINE TRIP push-button. b. WHEN HPCI Turbine is at zero speed, THEN PLACE 2-HS-73-47A, HPCI AUXILIARY OIL PUMP control switch in PULL TO LOCK and RELEASE 2-HS-73-18A, HPCI TURBINE TRIP push-button. 3. PREVENT injection from CORE SPRAY following an initiation signal by PLACING ALL Core Spray pump control switches in STOP. 4. PREVENT injection from LPCI SYSTEM I by performing the following: <p style="text-align: center;">NOTE</p> <p>Injection may be prevented by performing EITHER step 4.a or step 4.b.</p> <ol style="list-style-type: none"> a. Following automatic pump start, PLACE RHR SYSTEM I pump control switches in STOP. <li style="text-align: center;">OR b. BEFORE RPV pressure drops below 450 psig, <ol style="list-style-type: none"> 1) PLACE 2-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS. <li style="text-align: center;">AND 2) VERIFY CLOSED 2-FCV-74-52, RHR SYS I LPCI OUTBD INJECT VALVE. 5. PREVENT injection from LPCI SYSTEM II by performing the following: <p style="text-align: center;">NOTE</p> <p>Injection may be prevented by performing EITHER step 5.a or step 5.b.</p> <ol style="list-style-type: none"> a. Following automatic pump start, PLACE RHR SYSTEM II pump control switches in STOP. <li style="text-align: center;">OR b. BEFORE RPV pressure drops below 450 psig, <ol style="list-style-type: none"> 1) PLACE 2-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS. <li style="text-align: center;">AND 2) VERIFY CLOSED 2-FCV-74-66, RHR SYS II LPCI OUTBD INJECT VALVE. 6. PREVENT injection from CONDENSATE and FEEDWATER by performing the following: <ol style="list-style-type: none"> a. IF Immediate injection termination from a reactor feedwater pump is required, THEN PERFORM step 6.d for the desired pump. |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|--------------------------------|--|
| | <p>BOP/ATC CT#2</p> | <p>Terminate and Prevent IAW Appendix 4</p> |
| | | <p>Appendix 4 (continued)</p> <p>c. CLOSE the following valves BEFORE RPV pressure drops below 500 psig:</p> <ul style="list-style-type: none"> • 2-FCV-3-19, RFP 2A DISCHARGE VALVE • 2-FCV-3-12, RFP 2B DISCHARGE VALVE • 2-FCV-3-5, RFP 2C DISCHARGE VALVE • 2-LCV-3-53, RFW START-UP LEVEL CONTROL |
| | | <p>d. TRIP RFPTs as necessary to prevent injection by DEPRESSING the following push-buttons:</p> <ul style="list-style-type: none"> • 2-HS-3-125A, RFPT 3A TRIP • 2-HS-3-151A, RFPT 3B TRIP • 2-HS-3-176A, RFPT 3C TRIP. |
| | <p>SRO</p> | <p>WHEN RPV Level drops below -50 inches THEN Continue: OR WHEN RPV Level has dropped below -50 inches AND Power is below 5% OR Reactor Level reaches -162 inches, THEN Continue: Directs a Level Band with RCIC and HPCI.</p> |
| | <p>ATC/BOP</p> | <p>Maintain Directed Level Band with RCIC, Appendix 5C and HPCI, Appendix 5D.</p> |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | ATC/BOP | Maintain Directed Level Band with RCIC, Appendix 5C |
|--|---------|--|
| | | 3. VERIFY RESET and OPEN 2-FCV-71-9, RCIC TURB TRIP/THROT VALVE RESET. |
| | | 4. VERIFY 2-FIC-71-36A, RCIC SYSTEM FLOW/CONTROL, controller in AUTO with setpoint at 600 gpm. |
| | | 5. OPEN the following valves: <ul style="list-style-type: none"> • 2-FCV-71-39, RCIC PUMP INJECTION VALVE • 2-FCV-71-34, RCIC PUMP MIN FLOW VALVE • 2-FCV-71-25, RCIC LUBE OIL COOLING WTR VLV. |
| | | 6. PLACE 2-HS-71-31A, RCIC VACUUM PUMP, handswitch in START. |
| | | 7. OPEN 2-FCV-71-8, RCIC TURBINE STEAM SUPPLY VLV, to start RCIC Turbine. |
| | | 8. CHECK proper RCIC operation by observing the following: <ol style="list-style-type: none"> a. RCIC Turbine speed accelerates above 2100 rpm. b. RCIC flow to RPV stabilizes and is controlled automatically at 600 gpm. c. 2-FCV-71-40, RCIC Testable Check Vlv, opens by observing 2-ZI-71-40A, DISC POSITION, red light illuminated. d. 2-FCV-71-34, RCIC PUMP MIN FLOW VALVE, closes as flow rises above 120 gpm. |
| | | 9. IF BOTH of the following exist? - NO |
| | | 10. ADJUST 2-FIC-71-36A, RCIC SYSTEM FLOW/CONTROL, controller as necessary to control injection. |
| | | |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | ATC/BOP | Maintain Directed Level Band with HPCI, Appendix 5D |
|--|---------|--|
| | | 4. VERIFY 2-IL-73-18B, HPCI TURBINE TRIP RX LVL HIGH, amber light extinguished. |
| | | 5. VERIFY at least one SGTS train in operation. |
| | | 6. VERIFY 2-FIC-73-33, HPCI SYSTEM FLOW/CONTROL, controller in AUTO and set for 5,000 gpm. |
| | | 7. PLACE 2-HS-73-47A, HPCI AUXILIARY OIL PUMP, handswitch in START. |
| | | 8. PLACE 2-HS-73-10A, HPCI STEAM PACKING EXHAUSTER, handswitch in START. |
| | | 9. OPEN the following valves: <ul style="list-style-type: none"> • 2-FCV-73-30, HPCI PUMP MIN FLOW VALVE • 2-FCV-73-44, HPCI PUMP INJECTION VALVE. |
| | | 10. OPEN 2-FCV-73-16, HPCI TURBINE STEAM SUPPLY VLV, to start HPCI Turbine. |
| | | 11. CHECK proper HPCI operation by observing the following: <ul style="list-style-type: none"> a. HPCI Turbine speed accelerates above 2400 rpm. b. 2-FCV-73-45, HPCI Testable Check Vlv, opens by observing 2-ZI-73-45A, DISC POSITION, red light illuminated. c. HPCI flow to RPV stabilizes and is controlled automatically at 5000 gpm. d. 2-FCV-73-30, HPCI PUMP MIN FLOW VALVE, closes as flow exceeds 1200 gpm. |
| | | 12. VERIFY HPCI Auxiliary Oil Pump stops and the shaft driven oil pump operates properly. |
| | | 13. WHEN HPCI Auxiliary Oil Pump stops, THEN PLACE 2-HS-73-47A, HPCI AUXILIARY OIL PUMP, handswitch in AUTO. |
| | | 14. ADJUST 2-FIC-73-33, HPCI SYSTEM FLOW/CONTROL, controller as necessary to control injection. |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|-----------------|---|
| | SRO | EOI-1 (Power Control) |
| | | Monitor and Control Reactor Power. |
| | | Will the reactor will remain sub subcritical without boron under all conditions? - NO |
| | | Is the reactor subcritical and No boron has been injected?- NO |
| | | Verify Reactor Mode Switch in Shutdown. |
| | | Initiate ARI. |
| | ATC | Initiates ARI. |
| | SRO | Verify Recirc Runback (pump speed 480 rpm). |
| | ATC | Verifies Recirc Runback. |
| | SRO | Is Power above 5%? - YES |
| | | Directs tripping Recirc Pumps. |
| | ATC | Trips Recirc Pumps. |
| | SRO CT#1 | Before Suppression Pool temperature rises to 110°F, continue. |
| | CT#1 | Boron injection is required. |
| | ATC/BOP CT#1 | Initiate SLC, IAW Appendix 3A. |
| | SRO | Directs ARI Reset Appendix 2. |
| | CT#1 | Insert Control Rods Using one or more of the following methods: <ul style="list-style-type: none"> • Appendix 1F • Appendix 1D |
| | DRIVER | WHEN directed to perform Appendix 1F and Appendix 2, wait 4 minutes and report appendix 2 complete and field action for appendix 1F complete. <Shift>F5 bat app01f AND <Shift>F6 bat app02 and BAT atws-1 |
| | ATC CT#1 | Inserts Control Rods, IAW Appendix 1D and 1F. |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | ATC CT#1 | Insert Control Rods, LAW Appendix 1F. |
|--|---------------|---|
| | | <p>2. WHEN RPS Logic has been defeated, THEN RESET Reactor Scram.</p> <p>3. VERIFY OPEN Scram Discharge Volume vent and drain valves.</p> <p>4. DRAIN SDV UNTIL the following annunciators clear:</p> <ul style="list-style-type: none"> • WEST CRD DISCH VOL WTR LVL HIGH HALF SCRAM (Panel 2-9-4, 2-XA-55-4A, Window 1) • EAST CRD DISCH VOL WTR LVL HIGH HALF SCRAM (Panel 2-9-4, 2-XA-55-4A, Window 29). <p>5. DISPATCH personnel to VERIFY OPEN 2-SHV-085-0586, CHARGING WATER SHUTOFF.</p> <p>6. WHEN CRD Accumulators are recharged, THEN INITIATE manual Reactor Scram and ARI.</p> <p>7. CONTINUE to perform Steps 1 through 6, UNTIL ANY of the following exists:</p> <ul style="list-style-type: none"> • ALL control rods are fully inserted, <li style="text-align: center;">OR • NO inward movement of control rods is observed, <li style="text-align: center;">OR • SRO directs otherwise. |
| | DRIVER | <p>WHEN dispatched to close Charging Water Shutoff, wait 2 minutes and report 2-SHV-085-0586 closed. (<Shift>F7 mrf rd06 close)</p> <p>WHEN asked to open Charging Water Shutoff, wait 2 minutes and report 2-SHV-085-0586 open. (<Shift>F4 mrf rd06 open).</p> |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |

Simulator Event Guide:

Event 9 Component: 2A CRD Pump Trip

| | | |
|--|--|---|
| | | Reports Trip of CRD Pump 2A and Starts CRD Pump 1B, IAW 2-AOI-85-3 |
| | | <p>[1] IF operating CRD pump has failed AND standby CRD pump is available, THEN PERFORM the following at Panel 2-9-5:</p> <p>[1.1] PLACE CRD SYSTEM FLOW CONTROL, 2-FIC-85-11, in MAN at minimum setting.</p> <p>[1.2] START associated standby CRD Pump using one of the following:</p> <ul style="list-style-type: none"> • CRD PUMP 1B, using 2-HS-85-2A. <p>[1.3] IF CRD Pump 1B was started, THEN OPEN CRD PUMP 1B DISCH TO U2, using 2-HS-85-8A</p> <p>[1.4] ADJUST CRD SYSTEM FLOW CONTROL, 2-FIC-85-11, to establish the following conditions:</p> <ul style="list-style-type: none"> • CRD CLG WTR HDR DP, 2-PDI-85-18A, approximately 20 psid. • CRD SYSTEM FLOW CONTROL, 2-FIC-85-11, between 40 and 65 gpm. <p>[1.5] BALANCE CRD SYSTEM FLOW CONTROL, 2-FIC-85-11, AND PLACE in AUTO or BALANCE.</p> |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|----------------------------|---|
| | <p>ATC CT#1</p> | <p>Insert Control Rods IAW Appendix 1D</p> |
| | | <ol style="list-style-type: none"> 1. VERIFY at least one CRD pump in service. 2. IF Reactor Scram or ARI CANNOT be reset, THEN DISPATCH personnel to CLOSE 2-SHV-085-0586, CHARGING WATER SHUTOFF (RB NE, El 565). 3. VERIFY REACTOR MODE SWITCH in SHUTDOWN. 4. BYPASS Rod Worth Minimizer. 5. REFER to Attachment 2 and INSERT control rods in the area of highest power as follows: <ol style="list-style-type: none"> a. SELECT control rod. b. PLACE CRD NOTCH OVERRIDE switch in EMERG ROD IN position UNTIL control rod is NOT moving inward. c. REPEAT Steps 5.a and 5.b for each control rod to be inserted. 6. WHEN NO further control rod movement is possible or desired, THEN DISPATCH personnel to VERIFY OPEN 2-SHV-085-0586, CHARGING WATER SHUTOFF (RB NE, El 565 ft). |
| | <p>DRIVER</p> | <p>WHEN dispatched to close Charging Water Shutoff, wait 2 minutes and report 2-SHV-085-0586 closed. (<Shift>F7 mrf rd06 close) WHEN asked to open Charging Water Shutoff, wait 2 minutes and report 2-SHV-085-0586 open. (<Shift>F4 mrf rd06 open).</p> |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | BOP/ATC CT#1 | Initiate SLC IAW Appendix 3A |
|--|-----------------|--|
| | | <ol style="list-style-type: none"> 1. UNLOCK and PLACE 2-HS-63-6A, SLC PUMP 2A/2B, control switch in START-A or START-B position. 2. CHECK SLC System for injection by observing the following: <ul style="list-style-type: none"> • Selected pump starts, as indicated by red light illuminated above pump control switch. • Squib valves fire, as indicated by SQUIB VALVE A and B CONTINUITY blue lights extinguished. • SLC SQUIB VALVE CONTINUITY LOST Annunciator in alarm on Panel 2-9-5 (2-XA-55-5B, Window 20). • 2-PI-63-7A, SLC PUMP DISCH PRESS, indicates above RPV pressure. • System flow, as indicated by 2-IL-63-11, SLC FLOW, red light illuminated on Panel 2-9-5. • SLC INJECTION FLOW TO REACTOR Annunciator in alarm on Panel 2-9-5 (2-XA-55-5B, Window 14). |
| | | <ol style="list-style-type: none"> 3. IF Proper system operation CANNOT be verified, THEN RETURN to Step 1 and START other SLC pump. 4. VERIFY RWCU isolation by observing the following: <ul style="list-style-type: none"> • RWCU Pumps 2A and 2B tripped. • 2-FCV-69-1, RWCU INBD SUCT ISOLATION VALVE closed. • 2-FCV-69-2, RWCU OUTBD SUCT ISOLATION VALVE closed. • 2-FCV-69-12, RWCU RETURN ISOLATION VALVE closed. 5. VERIFY ADS inhibited. 6. MONITOR reactor power for downward trend. 7. MONITOR 2-LI-63-1A, SLC STORAGE TANK LEVEL, and CHECK that level is dropping approximately 1% per minute. |
| | | |
| | | |

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|---------|---|
| | SRO | ENTER 2-EOI-2, "Primary Containment Control" |
| | | EOI-2 (Drywell Temperature) |
| | SRO | Monitor and Control DW Temp Below 160°F using available DW Cooling. |
| | | Can Drywell Temp Be Maintained Below 160°F? - YES |
| | | |
| | SRO | EOI-2 (Primary Containment Hydrogen) |
| | | If PCIS Group 6 isolation exists? – YES THEN DIRECTS: <ol style="list-style-type: none"> 1. Place analyzer isolation bypass keylock switches to bypass. 2. Select Drywell or suppression chamber and momentarily pull out select switch handle to start sample pumps. |
| | BOP | <ol style="list-style-type: none"> 1. Place analyzer isolation bypass keylock switches to bypass. 2. Select Drywell or suppression chamber and momentarily pull out select switch handle to start sample pumps. |
| | | |
| | SRO | EOI-2 (Suppression Pool Temperature) |
| | | Monitor and Control Suppression Pool Temperature Below 95°F, Using Available Suppression Pool Cooling As Necessary (Appendix 17A) |
| | | Can Suppression Pool Temperature Be Maintained Below 95°F? – NO |
| | | Operate all available Suppression pool cooling, using only RHR Pumps not required to assure adequate core cooling by continuous injection, Appendix 17A. |
| | ATC/BOP | Place an RHR System in Pool Cooling, when directed IAW Appendix 17A. |
| | SRO | Before Suppression Pool Temperature rises to 110°F Continue in EOI-1 RPV Control |
| | | Can Suppression Pool temperature and level be maintained within a safe area of curve 3? - YES |
| | | |
| | SRO | The Emergency Classification is 1.2-S. |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

Controls Rods are being inserted

Reactor Level is being maintained in directed level band

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| | | |
|--|-----|---|
| | SRO | EOI-2 (Suppression Pool Level) |
| | | Monitor and Control Suppression Pool Level between -1 inch and -6 inches, (Appendix 18). |
| | | Can Suppression Pool Level be maintained above -6 inches? – YES |
| | | Can Suppression Pool Level be maintained below -1 inch? – YES |
| | | |
| | SRO | EOI-2 (Primary Containment Pressure) |
| | | Monitor and Control PC Pressure Below 2.4 psig, Using the Vent System As Necessary, (Appendix 12) |
| | SRO | Can Primary Containment pressure be maintained below 2.4 psig? – YES |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | | |
| | SRO | The Emergency Classification is 1.2-S. |

Terminate the scenario when the following conditions are satisfied or upon request of Lead Examiner.

Controls Rods are being inserted

Reactor Level is being maintained in directed level band

Simulator Event Guide:

Event 7 Major: ATWS without MSIVs

| ATC | Place Suppression Pool Cooling in service, IAW Appendix 17A. |
|-----|---|
| | <p>1. IF Adequate core cooling is assured, OR Directed to cool the Suppression Pool irrespective of adequate core cooling, THEN BYPASS LPCI injection valve open interlock AS NECESSARY:</p> <ul style="list-style-type: none"> • PLACE 2-HS-74-155A, LPCI SYS I OUTBD INJ VLV BYPASS SEL in BYPASS. • PLACE 2-HS-74-155B, LPCI SYS II OUTBD INJ VLV BYPASS SEL in BYPASS. |
| | <p>2. PLACE RHR SYSTEM I(II) in Suppression Pool Cooling as follows:</p> <p>a. VERIFY at least one RHRSW pump supplying each EECW header.</p> <p>b. VERIFY RHRSW pump supplying desired RHR Heat Exchanger(s).</p> <p>c. THROTTLE the following in-service RHRSW outlet valves to obtain between 1350 and 4500 gpm RHRSW flow:</p> <ul style="list-style-type: none"> • 2-FCV-23-34, RHR HX 2A RHRSW OUTLET VLV • 2-FCV-23-46, RHR HX 2B RHRSW OUTLET VLV • 2-FCV-23-40, RHR HX 2C RHRSW OUTLET VLV • 2-FCV-23-52, RHR HX 2D RHRSW OUTLET VLV. <p>d. IF Directed by SRO, THEN PLACE 2-XS-74-122(130), RHR SYS I(II) LPCI 2/3 CORE HEIGHT OVRD in MANUAL OVERRIDE.</p> <p>e. IF LPCI INITIATION Signal exists, THEN MOMENTARILY PLACE 3-XS-74-121(129), RHR SYS I(II) CTMT SPRAY/CLG VLV SELECT in SELECT.</p> |
| | <p>f. IF 2-FCV-74-53(67), RHR SYS I(II) LPCI INBD INJECT VALVE, is OPEN, THEN VERIFY CLOSED 2-FCV-74-52(66), RHR SYS I(II) LPCI OUTBD INJECT VALVE.</p> <p>g. OPEN 2-FCV-74-57(71), RHR SYS I(II) SUPPR CHBR/POOL ISOL VLV.</p> <p>h. VERIFY desired RHR pump(s) for Suppression Pool Cooling are operating.</p> |
| | <p>i. THROTTLE 2-FCV-74-59(73), RHR SYS I(II) SUPPR POOL CLG/TEST VLV, to maintain EITHER of the following as indicated on 2-FI-74-50(64), RHR SYS I(II) FLOW:</p> <ul style="list-style-type: none"> • Between 7000 and 10000 gpm for one-pump operation. <p>OR</p> <ul style="list-style-type: none"> • At or below 13000 gpm for two-pump operation. <p>j. VERIFY CLOSED 2-FCV-74-7(30), RHR SYSTEM I(II) MIN FLOW VALVE.</p> <p>k. MONITOR RHR Pump NPSH using Attachment 1.</p> |
| | |

SHIFT TURNOVER SHEET

Equipment Out of Service/LCO's:

EECW Pump A3 is out of service and tagged out.

RFPT B Out of Service

Operations/Maintenance for the Shift:

Remove LPRM 8-49B from bypass IAW 2-OI-92B section 6.4.

Once completed adjust load line IAW RCP and 2-GOI-100-12 section 5.0 step 20 and continue power ascension as directed by the RCP.

Units 1 and 3 are at 100% power.


Unusual Conditions/Problem Areas:

None

2-EOI-1


RPV CONTROL

2-EOI-1

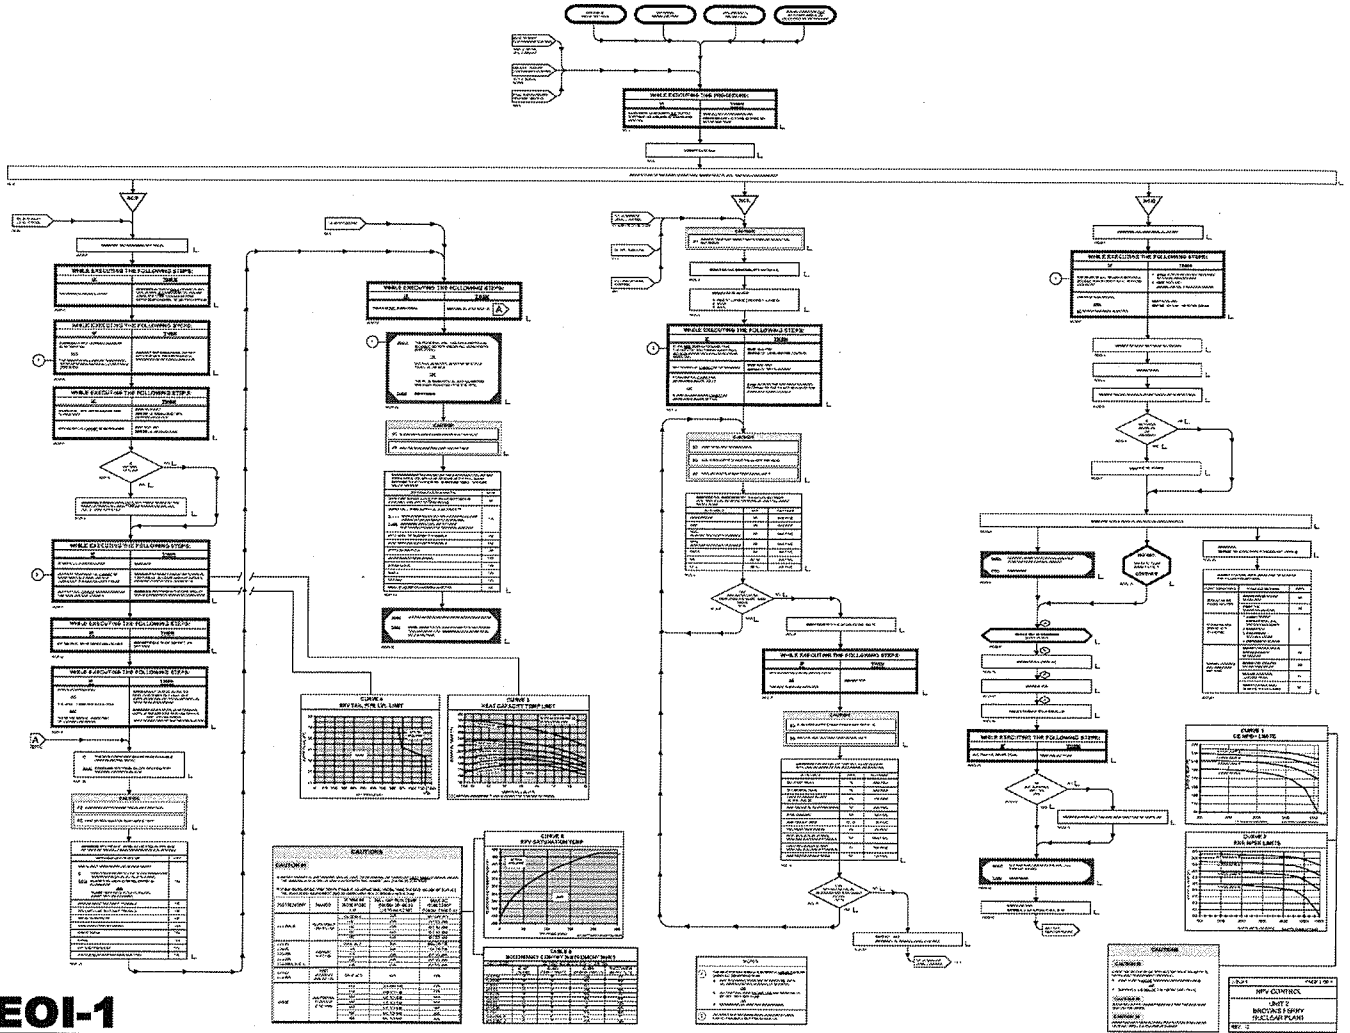

EOI-1


2-EOI-2 PRIMARY CONTAINMENT CONTROL 2-EOI-2

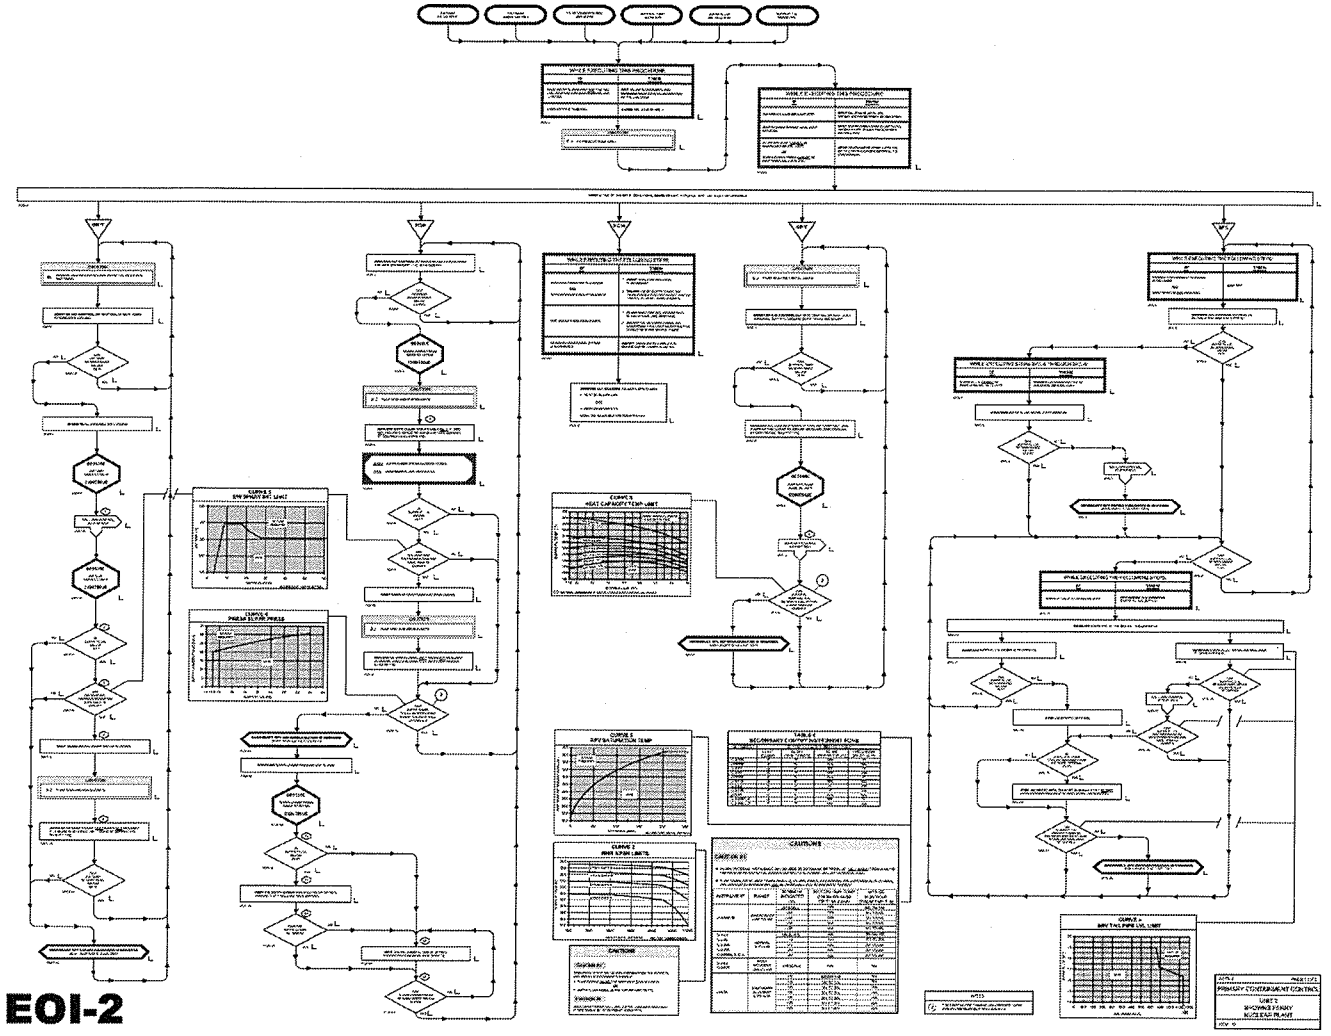

2-C-5

LEVEL / POWER CONTROL

2-C-5

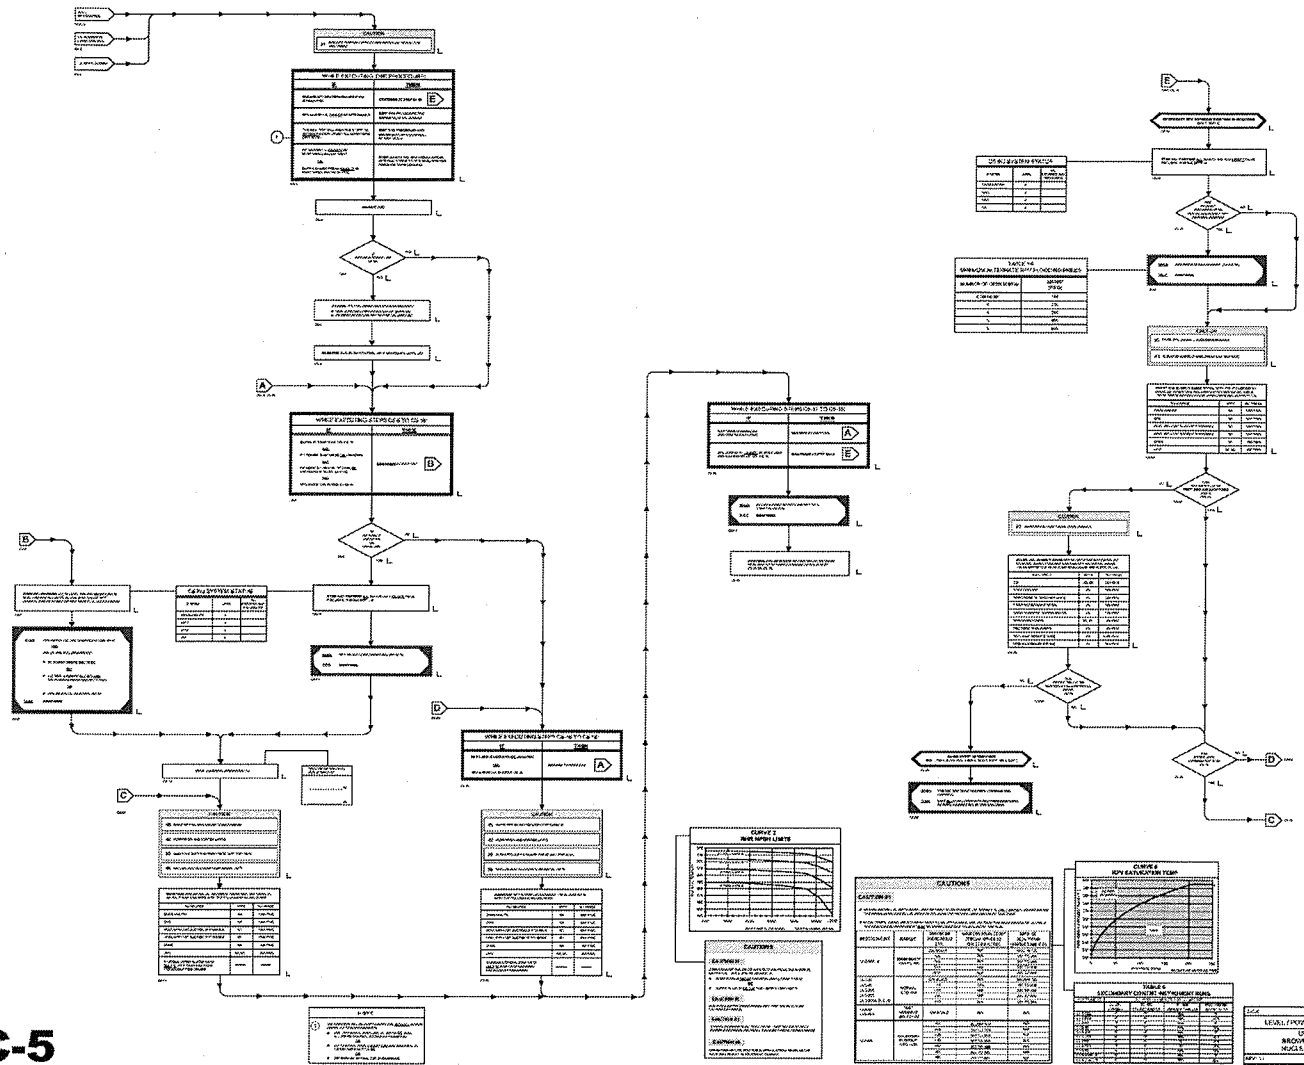

C-5

LEVEL POWER CONTROL
UNIT 2
MIDWAY PENNY
NUCLEAR PLANT

TR 3.3 INSTRUMENTATION

TR 3.3.5 Surveillance Instrumentation

LCO 3.3.5 The surveillance instrumentation for each parameter in Table 3.3.5-1 shall be OPERABLE .

APPLICABILITY: According to Table 3.3.5-1

NOTE

TRM LCO 3.0.4 is not applicable.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|---|
| A. One or more required channels inoperable. | A.1 Enter the Condition referenced in Table 3.3.5-1 for the channel. | Immediately |
| B. As required by Required Action A.1 and referenced in Table 3.3.5-1. | B.1 Restore required control room indication channel to OPERABLE status. | 7 days |
| C. As required by Required Action A.1 and referenced in Table 3.3.5-1. | C.1 Restore one of the required control room indication channels for each associated parameter to OPERABLE status. | 7 days from discovery of both redundant channels for one or more associated parameters not indicating in the control room |
| | <u>AND</u> C.2 Restore required control room indication channels to OPERABLE status. | 30 days |

(continued)

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|-------------------|
| D. As required by Required Action A.1 and referenced in Table 3.3.5-1. | D.1 Monitor torus temperature to observe any unexplained temperature increase which might be indicative of an open relief valve. | Once per 12 hours |
| | <p style="text-align: center;"><u>AND</u></p> D.2 Restore control room indication by either the Tailpipe Thermocouple Temperature or Acoustic Monitor to OPERABLE status for each relief valve. | 30 days |
| | <p style="text-align: center;"><u>AND</u></p> D.3 When inoperable for more than 30 days, initiate a Problem Evaluation Report (PER). | 24 hours |

(continued)

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|---|-----------------|
| <p>E. As required by Required Action A.1 and referenced in Table 3.3.5-1.</p> | <p align="center"><u>NOTE</u></p> <p>Required Actions E.1.1 and E.1.2 are not applicable when in MODES 4 and 5.</p> | |
| | <p>E.1.1 Restore required control room indication channel to OPERABLE status.</p> <p align="center"><u>OR</u></p> | 72 hours |
| | <p>E.1.2 Initiate the preplanned alternate method of monitoring the parameter.</p> <p align="center"><u>AND</u></p> | 72 hours |
| | <p>E.2 When inoperable for more than seven days, initiate a Problem Evaluation Report (PER).</p> | 24 hours |

(continued)

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|---|-----------------|
| <p>F. Required Action and associated Completion Time of Condition B or D not met.</p> <p><u>OR</u></p> <p>Required Action and associated Completion Time of Condition C not met for Instruments 3.a or 3.b.</p> | <p>F.1 Be in MODE 4.</p> | <p>24 hours</p> |
| <p>G. Required Action and associated Completion Time of Condition C not met for Instruments 2.a, 2.b, 4.a, or 4.b.</p> | <p>G.1 Be in MODE 3.</p> | <p>12 hours</p> |
| <p>H. Required Action and associated Completion Time of Condition C not met for Instrument 5 channels.</p> | <p>H.1 Reduce THERMAL POWER to \leq 15% RTP.</p> | <p>12 hours</p> |

TABLE 3.3.5-1 (page 1 of 2)
Surveillance Instrumentation

| PARAMETER AND INSTRUMENTS | APPLICABLE MODES OR OTHER SPECIFIED CONDITIONS | REQUIRED CHANNELS | CONDITIONS REFERENCED FROM REQUIRED ACTION A.1 | TECHNICAL SURVEILLANCE REQUIREMENTS | TYPE INDICATION AND RANGE |
|--|--|-------------------|--|---|---|
| 1. Suppression Chamber Air Temperature (XR-84-52) | 1,2,3 | 1 | B | TSR 3.3.5.1 TSR 3.3.5.6 | Recorder 0-400°F |
| 2. Control Rod Motion | | | | | |
| a. Control Rod Position (a) | 1,2 | 1(b) | C | TSR 3.3.5.2 | Indicators 00-48 |
| b. Neutron Monitoring (a) | 1,2 | 1(c) | C | TSR 3.3.5.3 TSR 3.3.5.4 TSR 3.3.5.7 TSR 3.3.5.8 TSR 3.3.5.9 | SRM Indicators 0.1-10 ⁶ cps IRM Indicators 0-125 LPRM Indicators 0-125 |
| 3. Drywell Pressure/ Temperature Alarm | | | | | |
| a. Drywell Pressure (PS-84-67B) (d) | 1,2,3 | 1 | C | TSR 3.3.5.14 | Alarm at 35 psig |
| b. Drywell Temperature and Pressure and Timer (TS-84-52A and PIS-84-58A and IS-84-67A) (d) | 1,2,3 | 1 | C | TSR 3.3.5.10 TSR 3.3.5.13 | Alarm if temp. > 281°F and pressure > 2.5 psig after 30 minute delay |

(continued)

- (a) The channel of Control Rod Position instruments and the channel of Neutron Monitoring instruments are considered redundant to each other for the parameter of Control Rod Motion.
- (b) The Control Rod Position channel consists of full core display position indicators or four-rod display position indicators capable of determining position of all OPERABLE control rods. Position indicators are considered to be capable of determining rod position when they display the rod position or the rod can be moved to a position where rod position is displayed.
- (c) The Neutron Monitoring channel contains the following:
 1. In MODE 2 with IRMs on Range 2 or below a minimum of 3 OPERABLE channels of SRMs.
 2. In MODE 2 a minimum of 6 OPERABLE channels of IRMs.
 3. In MODES 1 and 2, 43 LPRM detector assemblies, each containing four fission chambers. Individual failed chambers can be bypassed to the extent that APRMs remain OPERABLE.
- (d) The channel of Drywell Pressure and the channel of Drywell Temperature and Pressure and Timer instruments are considered redundant to each other for the parameter of Drywell Pressure/Temperature Alarm.

3.1 REACTIVITY CONTROL SYSTEMS

3.1.3 Control Rod OPERABILITY

LCO 3.1.3 Each control rod shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTIONS

-----NOTE-----
Separate Condition entry is allowed for each control rod.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|--|
| <p>A. One withdrawn control rod stuck.</p> | <p>-----NOTE----- Rod worth minimizer (RWM) may be bypassed as allowed by LCO 3.3.2.1, "Control Rod Block Instrumentation," if required, to allow continued operation. -----</p> <p>A.1 Verify stuck control rod separation criteria are met.</p> <p><u>AND</u></p> <p>A.2 Disarm the associated control rod drive (CRD).</p> <p><u>AND</u></p> | <p>Immediately</p> <p>2 hours</p> <p>(continued)</p> |

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|---|---|
| A. (continued) | <p>A.3 Perform SR 3.1.3.2 and SR 3.1.3.3 for each withdrawn OPERABLE control rod.</p> <p><u>AND</u></p> <p>A.4 Perform SR 3.1.1.1.</p> | <p>24 hours from discovery of Condition A concurrent with THERMAL POWER greater than the low power setpoint (LPSP) of the RWM</p> <p>72 hours</p> |
| B. Two or more withdrawn control rods stuck. | B.1 Be in MODE 3. | 12 hours |
| C. One or more control rods inoperable for reasons other than Condition A or B. | <p>C.1 -----NOTE----- RWM may be bypassed as allowed by LCO 3.3.2.1, if required, to allow insertion of inoperable control rod and continued operation. -----</p> <p>Fully insert inoperable control rod.</p> <p><u>AND</u></p> <p>C.2 Disarm the associated CRD.</p> | <p>3 hours</p> <p>4 hours</p> |

(continued)

3.7 PLANT SYSTEMS

3.7.2 Emergency Equipment Cooling Water (EECW) System and Ultimate Heat Sink (UHS)

LCO 3.7.2 The EECW System with three pumps and UHS shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|--|
| A. One required EECW pump inoperable. | A.1 Restore the required EECW pump to OPERABLE status. | 7 days |
| B. Required Action and associated Completion Time of Condition A not met. <u>OR</u> Two or more required EECW pumps inoperable. <u>OR</u> UHS inoperable. | B.1 Be in MODE 3. <u>AND</u> B.2 Be in MODE 4. | 12 hours 36 hours |

3.6 CONTAINMENT SYSTEMS

3.6.1.3 Primary Containment Isolation Valves (PCIVs)

LCO 3.6.1.3 Each PCIV, except reactor building-to-suppression chamber vacuum breakers, shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3,
When associated instrumentation is required to be OPERABLE per LCO 3.3.6.1, "Primary Containment Isolation Instrumentation."

ACTIONS

NOTES

1. Penetration flow paths except for 18 and 20 inch purge valve penetration flow paths may be unisolated intermittently under administrative controls.
2. Separate Condition entry is allowed for each penetration flow path.
3. Enter applicable Conditions and Required Actions for systems made inoperable by PCIVs.
4. Enter applicable Conditions and Required Actions of LCO 3.6.1.1, "Primary Containment," when PCIV leakage results in exceeding overall containment leakage rate acceptance criteria in MODES 1, 2, and 3.

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|--|---|
| <p>A. NOTE Only applicable to penetration flow paths with two PCIVs.</p> <hr/> <p>One or more penetration flow paths with one PCIV inoperable except due to MSIV leakage not within limits.</p> | <p>A.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, blind flange, or check valve with flow through the valve secured.</p> <p><u>AND</u></p> | <p>4 hours except for main steam line</p> <p><u>AND</u></p> <p>8 hours for main steam line</p> <p>(continued)</p> |

ACTIONS

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|----------------|---|---|
| A. (continued) | <p>A.2 NOTE</p> <p>Isolation devices in high radiation areas may be verified by use of administrative means.</p> <hr/> <p>Verify the affected penetration flow path is isolated.</p> | <p>Once per 31 days for isolation devices outside primary containment</p> <p><u>AND</u></p> <p>Prior to entering MODE 2 or 3 from MODE 4, if primary containment was de-inerted while in MODE 4, if not performed within the previous 92 days, for isolation devices inside primary containment</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|---|--|---|
| <p>B. NOTE Only applicable to penetration flow paths with two PCIVs.</p> <hr/> <p>One or more penetration flow paths with two PCIVs inoperable except due to MSIV leakage not within limits.</p> | <p>B.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> | <p>1 hour</p> |
| <p>C. NOTE Only applicable to penetration flow paths with only one PCIV.</p> <hr/> <p>One or more penetration flow paths with one PCIV inoperable.</p> | <p>C.1 Isolate the affected penetration flow path by use of at least one closed and de-activated automatic valve, closed manual valve, or blind flange.</p> <p><u>AND</u></p> <p>C.2 NOTE Isolation devices in high radiation areas may be verified by use of administrative means.</p> <hr/> <p>Verify the affected penetration flow path is isolated.</p> | <p>4 hours except for excess flow check valves (EFCVs)</p> <p><u>AND</u></p> <p>12 hours for EFCVs</p> <p>Once per 31 days</p> |

(continued)

ACTIONS (continued)

| CONDITION | REQUIRED ACTION | COMPLETION TIME |
|--|---|-----------------|
| D. One or more penetration flow paths with MSIV leakage not within limits. | D.1 Restore leakage rate to within limit. | 4 hours |
| E. Required Action and associated Completion Time of Condition A, B, C, or D not met in MODE 1, 2, or 3. | E.1 Be in MODE 3. <u>AND</u> | 12 hours |
| | E.2 Be in MODE 4. | 36 hours |
| F. Required Action and associated Completion Time of Condition A, B, C, or D not met for PCIV(s) required to be OPERABLE during MODE 4 or 5. | F.1 Initiate action to suspend operations with a potential for draining the reactor vessel (OPDRVs). <u>OR</u> | Immediately |
| | F.2 <u>NOTE</u> Only applicable for inoperable RHR Shutdown Cooling Valves. Initiate action to restore valve(s) to OPERABLE status. | |

| SCRAM FAILURE | | | | REACTOR COOLANT ACTIVITY | | | | |
|--|-------|------|----|---|--|--|--|-------------------|
| Description | | | | Description | | | | |
| | | | | 1.3-U | | | | UNUSUAL EVENT |
| | | | | Reactor coolant activity exceeds 26 $\mu\text{Ci/gm}$ dose equivalent I-131 (Technical Specification Limits) as determined by chemistry sample. | | | | |
| | | | | OPERATING CONDITION ALL | | | | |
| 1.2-A | | NOTE | | 1.3-A | | | | ALERT |
| Failure of RPS automatic scram functions to bring the reactor subcritical AND Manual scram or ARI (automatic or manual) was successful. | | | | Reactor coolant activity exceeds 300 $\mu\text{Ci/gm}$ dose equivalent Iodine-131 as determined by chemistry sample. | | | | |
| OPERATING CONDITION: Mode 1 or 2 | | | | OPERATING CONDITION: Mode 1 or 2 or 3 | | | | |
| 1.2-S | | NOTE | | | | | | SITE EMERGENCY |
| Failure of automatic scram, manual scram, and ARI to bring the reactor subcritical. | | | | | | | | |
| OPERATING CONDITION: Mode 1 | | | | | | | | |
| 1.2-G | CURVE | | US | | | | | GENERAL EMERGENCY |
| Failure of automatic scram, manual scram, and ARI. Reactor power is above 3% AND Either of the following conditions exists: <ul style="list-style-type: none"> • Suppression Pool temp exceeds HCTL. Refer to Curve 1.2-G. • Reactor water level can NOT be restored and maintained at or above -180 inches. | | | | | | | | |
| OPERATING CONDITION: Mode 1 or 2 | | | | | | | | |