
Occupational Radiation Exposure at Commercial Nuclear Power Reactors And Other Facilities 1984

Seventeenth Annual Report

**U.S. Nuclear Regulatory
Commission**

Office of Nuclear Regulatory Research

B. G. Brooks



REPRINTED NOVEMBER 1986

NOTICE

Availability of Reference Materials Cited in NRC Publications

Most documents cited in NRC publications will be available from one of the following sources:

1. The NRC Public Document Room, 1717 H Street, N.W.
Washington, DC 20555
2. The Superintendent of Documents, U.S. Government Printing Office, Post Office Box 37082,
Washington, DC 20013-7082
3. The National Technical Information Service, Springfield, VA 22161

Although the listing that follows represents the majority of documents cited in NRC publications, it is not intended to be exhaustive.

Referenced documents available for inspection and copying for a fee from the NRC Public Document Room include NRC correspondence and internal NRC memoranda; NRC Office of Inspection and Enforcement bulletins, circulars, information notices, inspection and investigation notices; Licensee Event Reports; vendor reports and correspondence; Commission papers; and applicant and licensee documents and correspondence.

The following documents in the NUREG series are available for purchase from the GPO Sales Program: formal NRC staff and contractor reports, NRC-sponsored conference proceedings, and NRC booklets and brochures. Also available are Regulatory Guides, NRC regulations in the *Code of Federal Regulations*, and *Nuclear Regulatory Commission Issuances*.

Documents available from the National Technical Information Service include NUREG series reports and technical reports prepared by other federal agencies and reports prepared by the Atomic Energy Commission, forerunner agency to the Nuclear Regulatory Commission.

Documents available from public and special technical libraries include all open literature items, such as books, journal and periodical articles, and transactions. *Federal Register* notices, federal and state legislation, and congressional reports can usually be obtained from these libraries.

Documents such as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings are available for purchase from the organization sponsoring the publication cited.

Single copies of NRC draft reports are available free, to the extent of supply, upon written request to the Division of Technical Information and Document Control, U.S. Nuclear Regulatory Commission, Washington, DC 20555.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at the NRC Library, 7920 Norfolk Avenue, Bethesda, Maryland, and are available there for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from the American National Standards Institute, 1430 Broadway, New York, NY 10018.

Occupational Radiation Exposure at Commercial Nuclear Power Reactors And Other Facilities 1984

Seventeenth Annual Report

Manuscript Completed: June 1986
Date Published: October 1986

B. G. Brooks

**Division of Regulatory Applications
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, DC 20555**




PREVIOUS REPORTS IN SERIES

- WASH-1311 A Compilation of Occupational Radiation Exposure from Light Water Cooled Nuclear Power Plants, 1969-1973, U.S. Atomic Energy Commission, May 1974.
- NUREG-75/032 Occupational Radiation Exposure at Light Water Cooled Power Reactors, 1969-1974, U.S. Nuclear Regulatory Commission, June 1975.
- NUREG-0109 Occupational Radiation Exposure at Light Water Cooled Power Reactors, 1969-1975, U.S. Nuclear Regulatory Commission, August 1976.
- NUREG-0323 Occupational Radiation Exposure at Light Water Cooled Power Reactors, 1969-1976, U.S. Nuclear Regulatory Commission, March 1978.
- NUREG-0482 Occupational Radiation Exposure at Light Water Cooled Power Reactors, 1977, U.S. Nuclear Regulatory Commission, May 1979.
- NUREG-0594 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1978, U.S. Nuclear Regulatory Commission, November 1979.
- NUREG-0713 Vol. 1 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1979, U.S. Nuclear Regulatory Commission, March 1981.
- NUREG-0713 Vol. 2 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1980, U.S. Nuclear Regulatory Commission, December 1981.
- NUREG-0713 Vol. 3 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1981, U.S. Nuclear Regulatory Commission, November 1982.
- NUREG-0713 Vol. 4 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1982, U.S. Nuclear Regulatory Commission, December 1983.
- NUREG-0713 Vol. 5 Occupational Radiation Exposure at Commercial Nuclear Power Reactors, 1983, U.S. Nuclear Regulatory Commission, March 1985.
- Previous reports in the NUREG-0714 series, which will now be combined with NUREG-0713 are as follows:
- WASH-1350-R1 through WASH-1350-R6
- First through Sixth Annual Reports of the Operation of the U.S. AEC's Centralized Ionizing Radiation Exposure Records and Reports System, U.S. Atomic Energy Commission.
- NUREG-75/108 Seventh Annual Occupational Radiation Exposure Report for Certain NRC Licensees - 1974, U.S. Nuclear Regulatory Commission, October 1975.
- NUREG-0119 Eighth Annual Occupational Radiation Exposure Report for 1975, U.S. Nuclear Regulatory Commission, October 1976.
- NUREG-0322 Ninth Annual Occupational Radiation Exposure Report for 1976, U.S. Nuclear Regulatory Commission, October 1977.
- NUREG-0463 Tenth Annual Occupational Radiation Exposure Report for 1977, U.S. Nuclear Regulatory Commission, October 1978.
- NUREG-0593 Eleventh Annual Occupational Radiation Exposure Report for 1978, U.S. Nuclear Regulatory Commission, January 1981.
- NUREG-0714 Vol. 1 Twelfth Annual Occupational Radiation Exposure Report for 1979, U.S. Nuclear Regulatory Commission, August 1982.
- NUREG-0714 Vols. 2 and 3 Occupational Radiation Exposure, Thirteenth and Fourteenth Annual Reports, 1980 and 1981, U.S. Nuclear Regulatory Commission, October 1983.
- NUREG-0714 Vols. 4 and 5 Occupational Radiation Exposure, Fifteenth and Sixteenth Annual Reports, 1982 and 1983, U.S. Nuclear Regulatory Commission, October 1985.

EDITOR'S NOTE

For the past 10 years, the NRC has published two annual reports that summarized occupational radiation exposure data reported by certain types of NRC licensees. Each report has kept its same report number since 1979. NUREG-0713, Vols. 1 through 5, contained data reported by commercial nuclear power facilities only. NUREG-0714, Vols. 1 through 5, contained exposure information reported by several different types of NRC licensees. As a cost-reduction measure, these two reports are now being combined into one document, NUREG-0713, Vol. 6. From this time forward, the data that would have been presented in NUREG-0714 will be contained in subsequent volumes of NUREG-0713; additional volumes of NUREG-0714 will not be published. It is hoped that this change will not cause any confusion.



ABSTRACT

This report summarizes the occupational exposure data that are maintained in the U.S. Nuclear Regulatory Commission's Radiation Exposure Information and Reports System (REIRS). The bulk of the information contained in the report was extracted from the 1984 annual statistical reports submitted by seven categories* of NRC licensees subject to the reporting requirements of 10 CFR §20.407. These seven categories of licensees also submit personal identification and exposure information for terminating employees pursuant to 10 CFR §20.408, and some analysis of these "termination" data are also presented in this report.

Annual reports for 1984 were received from a total of 504 NRC licensees, 88 of whom were licensed nuclear power reactors. Compilations of these reports indicated that some 193,200 individuals were monitored, 108,500 of whom received a measurable dose. The collective dose incurred by these individuals was calculated to be 59,400 person-rem (person-cSv)** which represents a slight (4%) increase over the 1983 value. Since the number of workers receiving a measurable dose increased by 13%, the average measurable dose decreased to 0.55 rem (cSv).

About 20% of the monitored individuals were found to have received doses greater than 0.50 rem (cSv) as had been the case in the previous three years. However, the number of individuals receiving doses greater than five rems (cSv) continued to decrease.

Some 230,000 termination reports were submitted to the NRC which contained personal identification and exposure information for about 67,500 individuals who had completed their work assignment or employment with a covered category of NRC licensees during 1984. This is about the same as the number of persons terminating during each of the previous two years. The total number of monitored individuals for whom personal identification and exposure information has been incorporated into REIRS during the 16 years that it has been operating is now about 350,000, some 300,000 of whom terminated from nuclear power facilities.

Analyses of these data indicate that about 6,000 individuals completed work assignments at two or more nuclear reactor facilities during calendar year 1984 and received an average dose of 0.91 rem (cSv). Approximately 2,000 of these individuals worked at two or more reactor facilities during one calendar quarter and received an average dose of 0.40 rem (cSv). Both averages declined somewhat from those found for 1983. However, these figures may have to be revised because the termination data for about 15% of the individuals terminating during 1984 or 1983 were not computerized by the date of this publication.

*Commercial nuclear power reactors; industrial radiographers; fuel processors, fabricators, and reprocessors; manufacturers and distributors of byproduct material; independent spent fuel storage installations; facilities for land disposal of low-level waste; and geologic repositories for high-level waste.

**In the International System of Units the sievert (Sv) is the name given to the units for dose equivalent. One centisievert (cSv) equals one rem; therefore, person-rem becomes person-cSv.

10

PREFACE

A number of NRC Licensees have inquired how occupational radiation exposure data (from reports required by the NRC) are used by the NRC staff. This is a very appropriate inquiry that may be of importance to many affected licensees. In combination with other sources of information, the principal uses of the data are to provide facts regarding routine occupational exposures to radiation and radioactive material that occur in connection with certain NRC-licensed activities, including individual and collective radiation doses from external sources as well as pertinent information on the inhalation of radioactive material (nuclides involved, bioassay results, exposure magnitude, etc.). These facts are used by the NRC staff as indicated below:

1. The data permit evaluation, from the viewpoint of trends, of the effectiveness of the overall NRC/licensee radiation protection and ALARA efforts by certain licensees. They also provide for the identification (and subsequent correction) of unfavorable trends.
2. The external-dose data permit evaluation of the radiological risk associated with certain categories of NRC-licensed activities, including the size of the workforce and the collective dose.
3. The data provide for governmental monitoring of the potential transient-worker problem.
4. The data are used in the establishment of priorities for the utilization of NRC health physics resources: research, standards development, and regulatory program development.
5. The data are considered in reviews of inspection frequencies that are programmed for various categories of licensees.
6. The data may influence licensing action decisions.
7. The data are used for comparative analyses of radiation protection performance: US/foreign, BWRs/PWRs, civilian/military, plant/plant, nuclear industry/other industries, etc.
8. The data are used for justification of the expenditure of resources in the annual budget process.
9. The data help provide facts for evaluating the adequacy of the current risk-limitation system (e.g., are individual lifetime dose limits, worker population collective dose limits, and requirements for optimization needed?).
10. The data permit comparisons of occupational radiation risks with potential public risks when action for additional protection of the public involves worker exposures.
11. The data help in the evaluation of the effectiveness of dose-reduction measures (e.g., methods for reducing individuals' doses that may increase the collective dose).

12. The data provide facts for answering Congressional and Administration inquiries and for responding to questions raised by public interest groups, special interest groups, labor unions, etc.
13. The data provide information that can be used in the planning of epidemiological studies.

With regard to routine workplace conditions, the annual statistical summary reports required by § 20.407, the termination reports required by § 20.408, and the annual dose data reported by work function in accordance with Subsection 6.9.1.5 of the standard technical specifications for nuclear power plants provide the only centralized data base available to assist the staff in the performance of its duties as listed above. It is to everyone's advantage if these duties are performed by a well-informed staff in the light of factual information.



Robert E. Alexander, Chief
Safety Research Applications Branch

TABLE OF CONTENTS

	<u>Page</u>
ABSTRACT.....	iii ✓
PREFACE.....	v ✓
1 INTRODUCTION.....	1 ✓
2 LIMITATIONS OF THE DATA.....	3 ✓
3 ANNUAL PERSONNEL MONITORING REPORTS - 10 CFR § 20.407.....	5 ✓
3.1 Definitions of Terms and Sources of Data.....	5 ✓
3.1.1 Statistical Summary Reports.....	5 ✓
3.1.2 Number of Monitored Individuals.....	5 ✓
3.1.3 Number of Workers with Measurable Doses.....	5 ✓
3.1.4 Collective Dose.....	5 ✓
3.1.5 Average Individual Dose.....	6 ✓
3.1.6 Average Measurable Dose.....	6 ✓
3.1.7 Number of Licensees Reporting.....	6 ✓
3.1.8 CR.....	6 ✓
3.2 Annual Whole Body Dose Distributions.....	8 ✓
3.3 Summary of Occupational Exposure Data By License Category....	8 ✓
3.3.1 Industrial Radiography Licenses, Single and Multiple Locations.....	8 ✓
3.3.2 Manufacturer and Distributor Licenses, Broad and Other.....	13 ✓
3.3.3 Low-Level Waste Disposal Licenses.....	14 ✓
3.3.4 Independent Spent Fuel Storage Installation Licenses..	16 ✓
3.3.5 Fuel Fabrication and Reprocessing Licenses.....	16 ✓
3.3.6 Water-Cooled Power Reactor Licenses.....	20 ✓
3.3.7 High-Temperature Gas-Cooled Power Reactor Licenses....	22 ✓
4 COMMERCIAL LIGHT WATER REACTORS - FURTHER ANALYSIS.....	23 ✓
4.1 Introduction.....	23 ✓
4.2 Definitions of Terms and Sources of Data.....	23 ✓
4.2.1 Number of Reactors.....	23 ✓
4.2.2 Electric Energy Generated.....	23 ✓
4.2.3 Collective Dose per Megawatt-Year.....	23 ✓
4.2.4 Average Rated Capacity.....	23 ✓
4.3 Annual Whole Body Dose Distributions.....	27 ✓
4.4 Average Annual Whole Body Doses.....	27 ✓
4.5 Plant Rankings by Collective Dose per Reactor.....	33 ✓

TABLE OF CONTENTS (Continued)

	<u>Page</u>
4.6 Collective Dose by Work Function and Employee Type.....	37
4.7 Health Implications of Average Annual Doses.....	42
5 TERMINATION DATA SUBMITTED PURSUANT TO 10 CFR § 20.408.....	44
5.1 Termination Reports, 1969-1984.....	44
5.2 Limitations of Termination Data.....	44
5.3 Transient Workers per Calendar Quarter.....	45
5.4 Transient Workers per Calendar Year.....	46
5.5 Temporary Workers per Calendar Year.....	52
5.6 Dose Distributions by Sex.....	53
5.7 Age Distribution.....	56
6 PERSONNEL OVEREXPOSURES - 10 CFR § 20.403 and 10 CFR § 20.405.....	57
6.1 Control Levels.....	57
6.2 Summary of Overexposures.....	57
REFERENCES.....	61
APPENDIX A - ALPHABETICAL LISTING OF ANNUAL EXPOSURE DATA COMPILED FOR LICENSEES.....	63
APPENDIX B - DISTRIBUTION OF WHOLE BODY DOSES AT LICENSED NUCLEAR POWER FACILITIES, 1984.....	75
APPENDIX C - PERSONNEL, DOSE, AND POWER GENERATION SUMMARY, 1969-1984.....	81
APPENDIX D - NUMBER OF PERSONNEL AND COLLECTIVE DOSE BY WORK AND JOB FUNCTION, 1984.....	105
APPENDIX E - SUMMARY OF ANNUAL WHOLE BODY DOSE BY YEAR AND REACTOR TYPE.....	163

LIST OF TABLES

Table

Table 3.1 Annual Exposure Data for Certain Categories of Licensees, 1973-1984.....	7
Table 3.2 Distribution of Annual Whole Body Doses by License Category, 1984.....	9
Table 3.3 Summary of Annual Dose Distributions for Certain NRC Licensees, 1968-1984.....	10

TABLE OF CONTENTS (Continued)

<u>Table</u>	<u>Page</u>
Table 3.4 Annual Exposure Information for Industrial Radiographers, 1982-1984.....	11
Table 3.5 Annual Exposure Information for Manufacturers and Distributors, 1982-1984.....	14
Table 3.6 Annual Exposure Information for Fuel Fabricators, 1982-1984.	18
Table 3.7 Annual Exposure Information for Fort St. Vrain, 1974-1984...	22
Table 4.1 Summary of Annual Information Reported by Commercial Boiling Water Reactors, 1973-1984.....	24
Table 4.2 Summary of Annual Information Reported by Commercial Pressurized Water Reactors, 1973-1984.....	25
Table 4.3 Summary of Annual Information Reported by Commercial Light Water Cooled Reactors, 1973-1984.....	26
Table 4.4 Summary Distribution of Annual Whole Body Doses at Commercial Light Water Reactors, 1973-1984.....	28
Table 4.5 Boiling Water Reactors Listed in Ascending Order of Collective Dose per Reactor, 1980-1984.....	34
Table 4.6 Pressurized Water Reactors Listed in Ascending Order of Collective Dose per Reactor, 1980-1984.....	35
Table 4.7a Five-year Totals and Averages Listed in Ascending Order of Collective Dose per BWR, 1980-1984.....	36
Table 4.7b Five-year Totals and Averages Listed in Ascending Order of Collective Dose per PWR, 1980-1984.....	36
Table 4.8 Annual Collective Doses by Work Function and Personnel Type, 1984.....	38
Table 4.9 Percentages of Annual Collective Dose at LWRs by Work Function, 1975-1984.....	39
Table 4.10 Annual Collective Dose by Occupation and Personnel Type, 1984.....	40
Table 5.1 Termination Reports Submitted to the NRC, 1969-1984.....	45
Table 5.2 Transient Workers per Calendar Quarter, 1973-1984.....	47
Table 5.3 Transient Workers per Calendar Year at Nuclear Power Facilities, 1977-1984.....	48

TABLE OF CONTENTS (Continued)

<u>Table</u>	<u>Page</u>
Table 5.4a Actual and Compiled Dose Distributions of Transient Workers per Calendar Year at Power Reactors.....	50
Table 5.4b Effects of Transient Workers on Annual Statistical Compilations.....	51
Table 5.5 Annual Whole Body Doses Exceeding Five Rems.....	52
Table 5.6 Temporary Workers per Calendar Year.....	53
Table 5.7 Sex vs Dose Profiles of Terminated Individuals.....	54
Table 5.8 Age Distribution of Terminated Reactor Workers as of 1985...	56
Table 6.1 Personnel Overexposures to External Radiation 1977-1984.....	58


LIST OF FIGURES

Figures

Figure 3.1 Annual Dose Distributions of Workers at Industrial Radiography Facilities, 1982-1984.....	12
Figure 3.2 Annual Dose Distributions of Workers at Manufacturing and Distribution Facilities, 1982-1984.....	15
Figure 3.3 Annual Dose Distributions of Workers at Low-Level Waste Disposal Facilities and at an Independent Fuel Storage Facility, 1982-1984.....	17
Figure 3.4 Annual Dose Distributions of Workers at Fuel Fabricators and Processors, 1982-1984.....	19
Figure 3.5 Annual Dose Distributions of Workers at Light Water Reactor Facilities, 1983 and 1984.....	21
Figure 4.1 Average Collective Dose and Number of Workers per Reactor, 1973-1984.....	29
Figure 4.2 Annual Values at BWRs and PWRs, 1973-1984.....	30
Figure 4.3 Average Annual Values at LWRs, 1973-1984.....	31
Figure 4.4 Average, Median and Extreme Values of the Collective Dose per Reactor, 1973-1984.....	32

TABLE OF CONTENTS (Continued)

<u>Figure</u>		<u>Page</u>
Figure 4.5	Collective Dose by Work Function and Personnel Type at BWRs and PWRs, 1979-1984.....	41
Figure 5.1	Dose Distribution of Males and Females Terminating from LWRs, 1983.....	55



Occupational Radiation Exposure
at Commercial Nuclear Power Reactors and Other Facilities
Seventeenth Annual Report, 1984

1 INTRODUCTION

One of the basic purposes of the Atomic Energy Act and the implementing regulations in Title 10, Code of Federal Regulations, Chapter I, Part 20, is to protect the health and safety of the public, including the employees of the licensees conducting operations under those regulations. Among the regulations designed to ensure that the standards for protection against radiation set out in 10 CFR Part 20 are met, is a requirement that licensees provide individuals likely to be exposed to radiation with devices to monitor their exposure. Each licensee is also required to maintain indefinitely records of the results of such monitoring. However, there was no initial provision that these records or any summary of them be transmitted to a central location where the data could be retrieved and analyzed.

On November 4, 1968, the U.S. Atomic Energy Commission (AEC) published an amendment to Part 20 requiring the reporting of certain occupational radiation exposure information to a central repository at AEC Headquarters. This information was required of the four categories* of AEC licensees that were considered to involve the greatest potential for significant occupational doses and of AEC facilities and contractors exempt from licensing. A procedure was established whereby the appropriate occupational exposure data were extracted from these reports and entered into the Commission's Radiation Exposure Information Reporting System (REIRS), a computer system maintained at the Oak Ridge National Laboratory Computer Technology Center in Oak Ridge, Tennessee. The computerization of these data ensured that they would be kept indefinitely and facilitated their retrieval and analysis. The data maintained in REIRS have been summarized and published in a report every year since 1969. Annual reports for each of the years 1969 through 1973 presented the data reported by both AEC licensees and contractors and were published in six documents designated as WASH-1350-R1 through WASH-1350-R6.

In January 1975, with the separation of the AEC into the Energy Research and Development Administration (ERDA) and the U.S. Nuclear Regulatory Commission (NRC), each agency assumed responsibility for collecting and maintaining occupational radiation exposure information reported by the facilities under its jurisdiction. The annual reports published by the NRC on occupational exposure for calendar year 1974 and subsequent years do not contain information pertaining to ERDA facilities or contractors. Comparable information for facilities and contractors under ERDA, now the Department of Energy (DOE), is collected and published by DOE's Division of Operational and Environmental Safety at Germantown, Maryland.

*Commercial nuclear power reactors; industrial radiographers; fuel processors, fabricators, and reprocessors; and manufacturers and distributors of specified quantities of byproduct material.

In 1982 and 1983, paragraph 20.408(a) was amended to require three additional categories of NRC licensees to submit annual statistical exposure reports and individual termination exposure reports. The new categories are (1) geologic repositories for high-level radioactive waste, (2) independent spent fuel storage installations, and (3) facilities for the land disposal of low-level radioactive waste. Therefore, this document presents the exposure information that was reported by NRC licensees representing two of these new categories. (There are no geologic repositories for high-level waste currently licensed.)

This report and each of its predecessors summarizes information reported during previous years. However, more licensee-specific data, such as the annual reports submitted by each commercial power reactor pursuant to 10 CFR § 20.407 and their technical specifications, may be found in those documents listed on the inside of the front cover of this report. Additional operating data and statistics for each power reactor for the years 1973 through 1982 may be found in a series of reports, "Nuclear Power Plant Operating Experience" [Refs. 1-9]. These documents are available for viewing at all NRC public document rooms, or they may be purchased from the National Technical Information Service, as shown in the Reference section.

2 LIMITATIONS OF THE DATA

All of the figures compiled in this report relating to exposures and doses are based on the results and interpretations of the readings of various types of personnel monitoring devices employed by each licensee. This information obtained from routine personnel monitoring programs is sufficient to characterize the radiation environment in which individuals work and is used in evaluating the radiation protection program.

Monitoring requirements are based, in general, on 10 CFR § 20.202, which requires licensees to monitor individuals who receive or are likely to receive a dose in any calendar quarter in excess of 25% of the applicable quarterly limits. For most adults the quarterly limit for the whole body is 1.25 rems (cSv), so 0.312 rem (cSv) per quarter is the level above which monitoring is required. Depending on the administrative policy of each licensee, persons such as visitors and clerical workers may also be provided with monitoring devices for identification or convenience, although the probability of their being exposed to measurable levels of radiation is extremely small. Licensees are given the option of reporting the dose distribution of only those individuals for whom monitoring is required, or the dose distribution of all those for whom monitoring is provided. Many licensees elect to report the latter; however, this may increase the number of individuals that one could consider to be radiation workers. In an effort to account for this, the number of individuals reported as having "no measurable exposure" has been subtracted from the total number of individuals monitored in order to calculate an average dose per individual receiving a measurable dose, as well as the average dose per monitored individual.

One source of error that is present in the calculation of the annual collective dose (i.e., the summation of each monitored person's whole body dose) incurred by workers is the assumption that the midpoint of the dose range is the mean dose of the individuals reported in each dose range. This allows the collective dose to be calculated without knowing each person's actual annual dose. Past experience has shown that the actual mean dose of the individuals reported in each range is less than the midpoint. Thus, the collective doses presented in this report may be 10% higher than the sum of the actual individual doses.

The average dose per individual, as well as the dose distributions shown for groups of licensees, also could have been affected by the multiple reporting of individuals who were monitored by two or more licensees during the year. Since individuals are not identified in the annual reports, an individual who was monitored by five different licensees would have been counted once on each report. Therefore, when the data were summed to determine the total number of individuals monitored by a group of licensees, this person would be counted as five individuals rather than as one. This could also affect the distribution of doses because the individual has been counted five times in the lower dose ranges rather than one time in the higher range in which his actual accumulated dose (the sum of his doses incurred at each facility) would have placed him. This source of error has the greatest potential impact on the data reported by power reactor facilities since they employ many short-term workers. Further discussion of this is provided in Section 5.

Another fact that should be kept in mind before drawing any conclusions from the annual statistical data is that all of the personnel included in the reports may not have been monitored throughout the entire year. Many licensees such as radiography firms and nuclear power facilities may monitor numerous individuals for periods much less than a year. The average doses calculated from these data, therefore, are less than the average dose that an individual would receive if he were involved in that activity for the full year.

3 ANNUAL PERSONNEL MONITORING REPORTS - 10 CFR § 20.407

3.1 Definition of Terms and Sources of Data

3.1.1 Statistical Summary Reports

On February 4, 1974, 10 CFR § 20.407 was amended to require certain categories of licensees to submit an annual statistical report indicating the distribution of the whole body doses incurred by individuals whom they monitored for exposure to radiation. Table 3.2 shows the eighteen dose ranges specified by 10 CFR § 20.407(b) among which the doses are to be distributed. In prior years, the annual report was formatted differently and was not very useful as a basis for estimating the collective dose.

3.1.2 Number of Monitored Individuals

This is the total number of individuals that the NRC licensees covered by 10 CFR § 20.407 reported as being monitored for exposure to external radiation during the year. This number must include all individuals for whom monitoring is required, and may include visitors, service representatives, contract workers, clerical workers and any other individuals for whom the licensee feels that monitoring devices should be provided.

3.1.3 Number of Workers with Measurable Doses

The number of workers with measurable doses is obtained from the annual dose distribution reports submitted by NRC licensees pursuant to 10 CFR § 20.407 by subtracting the number of individuals having less than measurable doses from the total number of monitored individuals. This figure is used to calculate an individual's average measurable dose because it deletes those individuals who received exposures too small to be detected by personnel monitoring devices, many of whom probably did not routinely work in radiation areas (and were monitored for convenience or for identification purposes).

3.1.4 Collective Dose

The collective dose is used in this report to mean the summation of the whole body external dose received by each monitored individual and has the units person-rem (person-cSv).† The collective dose is not usually provided in the annual dose distribution reports submitted pursuant to 10 CFR § 20.407, but NRC staff

†In the International Systems of Units, the sievert (Sv) is the name given to the units for dose equivalent. One centisievert (cSv) equals one rem; therefore person-rem become person-cSv.

*Commercial nuclear power reactors; industrial radiographers; fuel processors, fabricators and reprocessors; manufacturers and distributors of byproduct material; independent spent fuel storage installations; and facilities for land disposal of low-level radioactive waste.

calculated it from the reports by summing the products obtained by multiplying the number of individuals reported in each of the dose ranges (shown in Table 1) by the midpoint of the corresponding range. This assumes that the midpoint of the range is equal to the arithmetic mean of the individual doses in the range. Past experience has shown that the actual mean dose of individuals reported in each dose range is less than the midpoint of the range, and the collective doses shown in this report for these may be about 10% too high. In 1981, a few power reactor licensees began reporting the actual collective dose (as determined from official personnel dosimetry results) on their § 20.407 annual reports, and the NRC staff used these doses, when provided, instead of the above-described calculations. The staff would prefer to use the actual collective dose and encourages more licensees to make it available.

3.1.5 Average Individual Dose

The average individual dose is obtained by dividing the collective dose by the total number of individuals reported as being monitored. This figure is usually less than the average measurable dose because it includes the number of those individuals who received zero or less than measurable doses.

3.1.6 Average Measurable Dose

The average measurable dose is obtained by dividing the collective dose by the number of workers that received a measurable dose. This is the average most commonly used in this and others' reports when examining trends and comparing doses received by workers in various segments of the nuclear industry because it reflects the deletion of those individuals receiving zero or minimal doses, many of whom were monitored for convenience.

3.1.7 Number of Licensees Reporting

This is the number of NRC licenses issued to companies to use radioactive material for certain activities that would place them in one of the six categories that are required to report pursuant to 10 CFR § 20.407. The third column in Table 3.1 shows the number of licensees that have filed such reports during the last several years. State licensees do not submit such reports to the NRC.

3.1.8 CR

One of the parameters that the United Nations Scientific Committee on the Effects of Atomic Radiation (UNSCEAR) recommends be calculated for occupational dose distributions to aid in the comparison of exposure data is a ratio "CR." CR is defined to be the ratio of the annual collective dose incurred by individuals whose annual doses exceed 1.5 rems to the total annual collective dose. One UNSCEAR report [Ref. 10] states that normal values of CR should be between 0.05 and 0.50. This means that, usually, no more than 50% of the collective dose should be due to individual doses that exceed 1.5 rems. The last column in Table 3.1 shows the values of CR for the different types of licenses; one can see that CR is close to 0.50 for three of the categories and is much less than 0.50 for the remaining three categories for 1984.

Table 3.1
ANNUAL EXPOSURE DATA FOR CERTAIN CATEGORIES OF LICENSEES
1973 - 1984

License Category	Calendar Year	Number of Licensees Reporting	Number of Monitored Individuals	Number of Workers with Measurable Doses	Collective Dose (person-rems or person-cSv)	Average Individual Dose (rems or cSv)	Average Measurable Dose per Worker (rems or cSv)	CR+
Industrial Radiography	1984	361	8,458	5,446	2,490	0.30	0.46	0.46
	1983	340	8,624	5,131	2,384	0.28	0.46	0.45
	1982	353	9,235	6,160	2,998	0.32	0.49	0.46
	1981	266	9,938	5,489	2,652	0.27	0.48	0.48
	1980	292	11,102	6,556	2,979	0.27	0.45	0.57
	1979	341	11,969	6,904	3,461	0.29	0.50	0.47
	1978	337	13,093	6,685	2,950	0.23	0.44	0.43
	1977	339	10,569	6,197	3,159	0.30	0.51	0.45
	1976	321	11,245	6,222	3,629	0.32	0.58	0.51
	1975	291	9,178	4,693	2,796	0.30	0.60	0.53
	1974	319	8,792	4,943	2,938	0.33	0.59	0.51
	1973	341	8,206	5,328	3,354	0.41	0.63	
	Manufacturing and Distribution	1984	38	5,009	1,932	642	0.13	0.33
1983		33	5,051	2,003	824	0.16	0.41	0.54
1982		34	5,453	2,199	890	0.16	0.40	0.51
1981		29	4,846	2,395	904	0.19	0.38	0.52
1980		29	5,119	2,460	1,033	0.20	0.42	0.61
1979		28	3,937	2,219	888	0.23	0.40	0.55
1978		27	3,973	1,886	851	0.21	0.45	0.61
1977		30	4,243	2,459	1,329	0.31	0.54	0.63
1976		24	3,501	1,976	1,226	0.35	0.62	0.67
1975		19	3,367	1,859	1,188	0.35	0.64	0.64
1974		24	3,340	1,827	1,050	0.31	0.57	0.63
1973		34	4,251	1,925	1,177	0.28	0.61	
Low-Level Waste Disposal		1984	2	925	297	72	0.08	0.24
	1983	1	612	358	71	0.12	0.20	0.14
	1982	1	680	251	53	0.08	0.21	0.20
Independent Fuel Storage	1984	1	32	32	13	0.41	0.41	0.06
	1983	1	33	27	8	0.24	0.30	0.00
	1982	1	35	32	9	0.26	0.28	0.00
Fuel Fabrication and Processing	1984	14	9,488	5,772	818	0.09	0.14	0.04
	1983	15	9,023	5,013	835	0.09	0.17	0.19
	1982	16	9,808	5,433	831	0.08	0.15	0.20
	1981	18	10,552	5,942	940	0.09	0.16	0.09
	1980	18	10,204	5,900	1,111	0.11	0.19	0.12
	1979	21	9,946	5,365	1,268	0.13	0.24	0.16
	1978	20	11,305	6,100	1,525	0.13	0.25	0.24
	1977	21	11,496	7,004	1,725	0.15	0.25	0.34
	1976	24	11,227	5,285	1,830	0.16	0.35	0.41
	1975	24	11,614	5,602	3,175	0.27	0.57	0.54
	1974	26	11,064	4,728	2,836	0.26	0.60	0.61
	1973	27	10,610	5,056	2,400	0.23	0.47	
	**Commercial Light Water Reactors	1984	88	169,242*	94,996*	55,353	0.32	0.58
1983		80	139,895*	83,546*	56,758	0.41	0.68	0.60
1982		79	127,904*	80,871*	52,227	0.41	0.65	0.57
1981		73	123,978*	80,664*	54,271	0.44	0.67	0.58
1980		70	124,250*	77,903*	53,810	0.43	0.69	0.59
1979		69	99,463*	62,316*	39,759	0.40	0.64	0.57
1978		68	72,448*	45,474*	31,910	0.44	0.70	0.61
1977		65	67,130*	42,867*	32,731	0.49	0.76	0.64
1976		62	66,800	36,715	26,555	0.40	0.72	0.62
1975		54	54,763	28,034	21,270	0.39	0.76	0.64
1974		53	62,044	21,904	14,083	0.23	0.64	0.62
1973		41	44,795	16,558	14,337	0.32	0.87	
Grand Totals and Averages		1984	504	193,154*	108,475*	59,392	0.30	0.55
	1983	470	163,238*	96,878*	60,880	0.37	0.63	0.59
	1982	482	153,118*	94,946*	57,008	0.37	0.60	0.56
	1981	385	149,314*	94,490*	58,767	0.39	0.62	0.56
	1980	410	150,675*	92,819*	58,933	0.39	0.63	0.57
	1979	459	125,316*	76,804*	45,376	0.36	0.59	0.55
	1978	453	100,819*	60,145*	37,236	0.37	0.62	0.59
	1977	455	93,438*	58,527*	38,944	0.42	0.67	0.62
	1976	428	92,773	50,198	33,240	0.36	0.66	0.60
	1975	388	78,922	40,188	28,429	0.36	0.71	0.62
	1974	422	85,240	33,402	20,907	0.25	0.63	0.60
	1973	443	67,862	28,867	21,268	0.31	0.74	

+CR is the ratio of the annual collective dose delivered at annual doses exceeding 1.5 rems to the total annual collective dose. (See Section 3.1).

*These figures are adjusted to account for the multiple counting of transient reactor workers (see Section 5).

**Includes all LWRs that reported, although all of them may not have been in commercial operation for a full year, but excludes the gas-cooled reactor.

3.2 Annual Whole Body Dose Distributions

Table 3.2 is a compilation of the statistical summary reports submitted by six categories of licensees. One can see that in nearly every category some 40%-70% of the doses are less than measurable. About 90% of the reported individuals were monitored by nuclear power facilities where they received about 90% of the total collective dose in 1984.

The "Adjusted Total" shown in Table 3.2 for the dose distribution of individuals monitored by commercial power reactors in 1984 reflects corrections that were made to the compilation of the annual reports to account for the counting of transient workers more than one time. This adjusted total was also used in the calculation of the "Grand Total" at the bottom of the table. Further discussion of the data and methodology used in making these corrections is given in Section 5.

It should be pointed out that annual exposures that exceed five rems (cSv) are not necessarily classified as personnel overexposures. Although 1.25 rems (cSv) is the quarterly limit set forth in paragraph (a) of 10 CFR § 20.101, paragraph (b) permits licensees, under certain conditions, to allow a worker to receive a whole body dose of three rems (cSv) per calendar quarter (up to 12 rems (cSv)) annually. The conditions are that the licensee must have determined and recorded the worker's prior accumulated occupational dose to the whole body and that the worker's whole body dose when added to his accumulated occupational dose does not exceed $5(N - 18)$ rems (cSv), where N equals the individual's age in years. Although there is no annual limit, annual exposures that exceed 12 rems (cSv) indicate that an overexposure has occurred. Any quarterly exposure in excess of the applicable quarterly limits must be reported. A discussion of various types of occurrences in which the limits have been exceeded is given in Section 6.

A summary of the annual whole body exposures reported to the Commission by certain categories of NRC licensees required to submit reports pursuant to 10 CFR § 20.407 during the past 16 years is presented in Table 3.3. About 95% of the exposures have consistently remained less than two rems (cSv), and the number of individuals receiving an annual exposure in excess of five rems (cSv) has declined to remain at about one-tenth of one percent of the total number of individuals monitored each year for the last three years.

3.3 Summary of Occupational Exposure Data by License Category

3.3.1 Industrial Radiography Licenses, Single and Multiple Locations

These licenses are issued to allow the use of sealed radioactive materials, usually in exposure devices or "cameras," that primarily emit gamma rays for nondestructive testing of pipeline weld joints, steel structures, boilers, aircraft and ship parts, and other high-stress alloy parts. Some firms are licensed to conduct such activities in one location, usually in a plant, and others perform radiography at multiple sites in the field. As shown in Table 3.1, annual reports were received for 361 radiography licenses in 1984, which is about the same number as reported in 1982 and 1983.

Table 3.2
DISTRIBUTION OF ANNUAL WHOLE BODY DOSES BY LICENSE CATEGORY
 1984

LICENSE CATEGORY	Number of Individuals with Whole Body Doses in the Following Ranges (Rms or cSv)																Total Number Monitored	Number with Measurable Dose	Total Collective Dose (person-cSv)	
	No Measurable Exposure	Measurable but <0.10	0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.0	1.0-2.0	2.0-3.0	3.0-4.0	4.0-5.0	5.0-6.0	6.0-7.0	7.0-8.0	8.0-9.0	9.0-10.0	10.0-11.0				11.0-12.0
			>12.0	Total	Total	Total	Total	Total	Total	Total	Total	Total	Total	Total	Total	Total				Total
INDUSTRIAL RADIOGRAPHY																				
Single Location	1,077	432	118	68	19	11	31	18	3	1								1,778		
Multiple Locations	1,935	2,160	713	596	345	263	443	125	64	23	8	2	0	1	2	0	0	6,680		
Total	3,012	2,592	831	664	364	274	474	143	67	24	8	2	0	0	1	2	0	8,458		
MANUFACTURING & DISTRIB.																				
Broad	2,909	1,093	192	122	77	51	111	45	24	1								4,625		
Other	168	110	60	25	9	4	6	2										384		
Total	3,077	1,203	252	147	86	55	117	47	24	1								5,009		
LOW-LEVEL WASTE DISPOSAL																				
Total	628	174	49	31	15	13	15											925		
INDEP. SPENT FUEL STORAGE																				
Total	0	6	11	4	4	6	1											32		
FUEL FABRICATION																				
Uranium Fuel Process.	3,632	4,121	823	399	262	98	44											9,379		
Decommis. of U and Pu	84	15	8	2														109		
Fuel Facilities	3,716	4,136	831	401	262	98	44											9,488		
**COMMERCIAL POWER REACT.																				
Boiling Water Reactors	30,316	15,698	6,267	4,953	3,040	2,399	5,679	2,714	994	218								72,278		
Press. Water Reactors	47,985	26,091	8,612	6,589	4,133	2,998	6,774	2,253	681	77								106,193		
High Temp. Gas Reactors	1,616	62	8															1,686		
Total	79,917	41,851	14,887	11,542	7,173	5,397	12,453	4,967	1,675	295								180,157		
Adjusted Total	75,862	39,404	13,964	10,693	6,631	4,998	11,806	5,182	1,997	380	9	2						170,928		
1 GRAND TOTALS	86,295	47,515	15,938	11,940	7,362	5,444	12,457	5,372	2,088	405	17	4	0	1	2	0	0	194,840		

*Dose values exactly equal to the values separating ranges are reported in the next higher range.

**Includes all reactors that reported although all of them may not have been in commercial operation for a full year.

†These values are adjusted to account for the multiple counting of transient reactor workers, but the adjustment may not be complete because all of the 1984 termination data have not been computerized.

Table 3.3

SUMMARY OF ANNUAL DOSE DISTRIBUTIONS
FOR CERTAIN NRC LICENSEES

1968-1984

Year	Total Number of Monitored Persons Compiled Number	(Adjusted* Number)	Percent of Individuals With Doses <2 rems	Percent of Individuals With Doses >5 rems	Number of Individuals With Doses >12 rems
1968	36,836		97.2%	0.5%	3
1969	31,176		96.5%	0.5%	7
1970	36,164		96.1%	0.6%	0
1971	36,311		95.3%	0.7%	1
1972	44,690		95.7%	0.5%	8
1973	67,862		95.0%	0.5%	1
1974	85,097		96.4%	0.3%	1
1975	78,713		94.8%	0.5%	1
1976	92,773		95.0%	0.4%	3
1977	98,212	(93,438)	93.8%*	0.4%*	1
1978	105,893	(100,818)	94.6%*	0.2%*	3
1979	131,027	(125,316)	95.2%*	0.2%*	1
1980	159,177	(150,675)	94.6%*	0.3%*	0
1981	157,874	(149,314)	94.6%*	0.2%*	1
1982	162,456	(154,117)	94.9%*	0.1%*	0
1983	172,927	(164,239)**	94.6%*	0.1%*	0
1984	204,069	(194,840)**	95.91*	0.1%*	0

*Based on the distribution of individual doses after adjusting for the multiple counting of transient reactor workers (see Section 5).

**The termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR System.

Table 3.4 summarizes the reported data for the two types of radiography licenses for 1984 and for the previous two years for comparison purposes. The table shows that both the number of workers (701) receiving measurable doses and the collective dose (196) of workers at the single-location facilities decreased by about 9%. This resulted in the average measurable dose remaining at 0.28 rem (cSv). The number of workers at firms having multiple-location licenses increased by about 8% while the collective dose increased only about 6%. This resulted in the average measurable dose decreasing slightly to 0.48 rem (cSv). Overall, one finds that the average measurable dose for radiography workers continues to remain at about 0.50 rem (cSv), as it has for the last eight years, and that the average dose for workers performing radiography at a single location is usually about half this amount. This is probably due to the fact that it is more difficult for workers to avoid exposure to radiation in the field, where conditions are not the best and may change every day. In order to see the contribution that each radiography licensee made to the total collective dose, a summary of the information reported by each of these licensees in 1984 is presented in alphabetical order in Appendix A.

Table 3.4


ANNUAL EXPOSURE INFORMATION FOR INDUSTRIAL RADIOGRAPHERS
1982-1984

Type of License	Year	No. of Licenses	Number of Monitored Individuals	Workers with Measurable Doses	Collective Dose (person-rem or person-cSv)	Average Measurable Dose (rem or cSv)
Single location		129	1,778	701	196	0.28
Multiple locations	1984	232	6,680	4,745	2,294	0.48
Total		361	8,458	5,446	2,490	0.46
Single location		128	1,714	773	213	0.28
Multiple locations	1983	210	6,910	4,358	2,171	0.50
Total		338	8,624	5,131	2,384	0.46
Single location		126	1,977	942	187	0.20
Multiple locations	1982	227	7,258	5,218	2,811	0.54
Total		353	9,235	6,160	2,998	0.49

Since personnel monitoring data has frequently been found to have log-normal distributions [Ref. 11], trends in the data reported by radiography licensees may be observed from log probability plots* of the data. Figure 3.1 displays such plots of the doses incurred by workers monitored by the two types of radiography licensees for each of the years 1982, 1983, and 1984. The plots of the dose distributions of workers at single-location radiography facilities, where the workers receive doses that are lower than those usually received by workers at multiple-location facilities, form fairly straight lines and usually lie above those of the multiple-location facilities. One feature of these types of graphs is that several comparisons of various dose distributions can be quickly made. For example, one can easily see that in 1984 about 85% of the workers monitored by firms licensed for radiography at multiple locations received doses that were less than one rem (cSv), while some 92% of the workers monitored at single location radiography facilities received such doses. Also, the relative positions and curvature of the graphs are indicative of certain characteristics of the dose distributions. For example, the position of the 1983 and 1984 plot of the dose distribution of workers at single-location facilities below that of the 1982 plot indicates an increase in the average dose and in CR (as shown at the bottom of the graph). This is due to the fact that there were more workers with doses that exceeded three rems (cSv) in 1983 and 1984. The 1984 plot of the multiple-location licensees is quite close to those for 1982 and 1983, and one finds similar average doses and values of CR each year.

*If the data have a log normal distribution, the data points will form a straight line when plotted on log probability paper on which cumulative probabilities are laid off on the vertical axis at distances proportional to the corresponding number of standard deviations above or below the median and the dose is plotted on the horizontal axis on a logarithmic scale.

Figure 3.1
**ANNUAL DOSE DISTRIBUTION OF WORKERS
 AT INDUSTRIAL RADIOGRAPHY FACILITIES
 1982-1984**

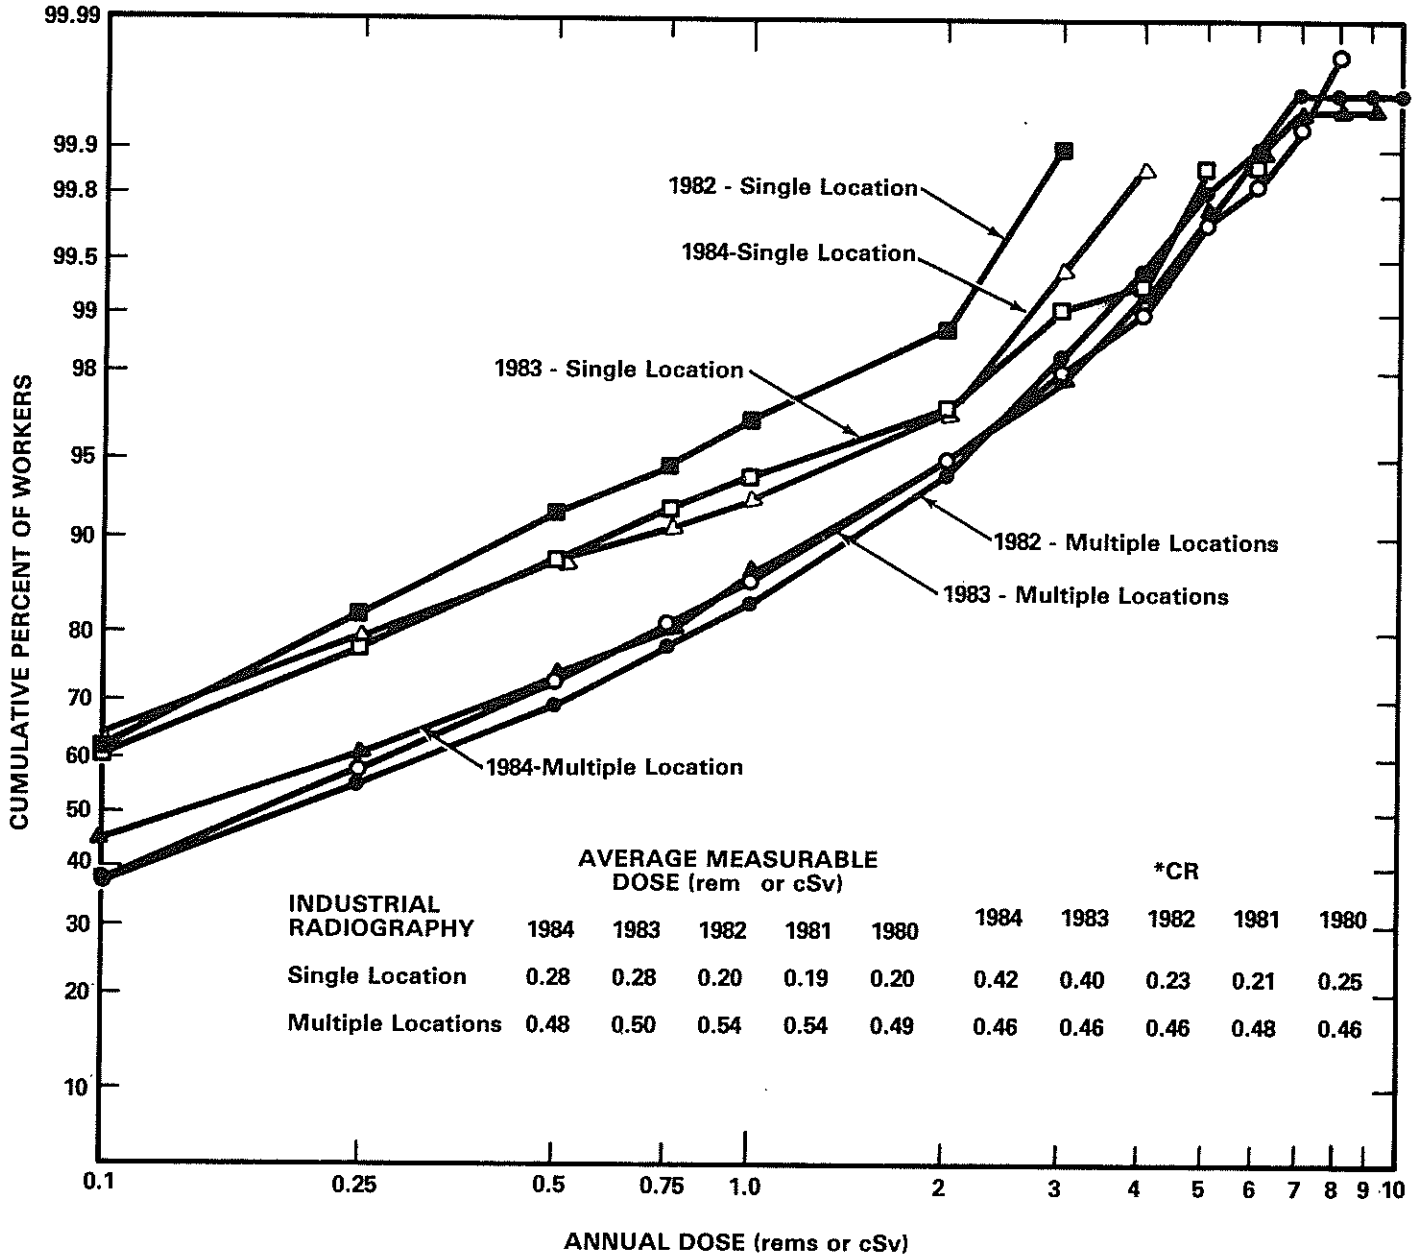

*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems to the total annual collective dose.

Note: Each point on the curves represents the cumulative percentage of workers with measurable doses who received doses less than the indicated annual dose.

The tendency of the plots to curve upward for doses greater than one rem (cSv) is typical of distributions having several workers with doses in the higher dose ranges [Refs. 10, 11], and indicates that the entire distribution is not a log-normal one. Another theoretical analysis of occupational dose distributions [Ref. 12] has found that these data may be fitted by a hybrid log-normal distribution. At low doses, this distribution is log normal, but at higher doses, where radiation control programs very closely monitor each worker's total dose so that the frequency of doses approaching the dose limits is reduced, the distribution is normal.

3.3.2 Manufacturer and Distributor Licenses, Broad and Other

These licenses are issued to allow the manufacture and distribution of radionuclides in various forms for a number of diverse purposes. Broad licenses are issued to large facilities having a comprehensive radiological protection program, and the other licenses are usually issued to smaller firms requiring a more restrictive license. Some firms are medical suppliers that process, package, or distribute such products as diagnostic test kits, radioactive surgical implants, and tagged radiochemicals for use in medical research, diagnosis, and therapy. Other firms are suppliers of industrial radionuclides and are involved in the processing, encapsulation, packaging, and distribution of the radionuclides that they have purchased in bulk quantities from production reactors and cyclotrons. Major products include gamma radiography sources, cobalt irradiation sources, well-logging sources, sealed sources for gauges and smoke detectors, and radiochemicals for nonmedical research. However, only those NRC licensees (about 35) that possess or use at any one time specified quantities of the nuclides listed in paragraph 20.408(a)(6) are required to submit annual (10 CFR § 20.407) and termination (10 CFR § 20.408) reports.

Table 3.5 presents the annual data that were reported by the two types of licensees for 1984 and the previous two years. The total number of workers receiving measurable doses as reported by these types of licensees continued to decline somewhat to 1,932 workers in 1984. The collective dose decreased by about 22% or 200 person-rems (person-cSv), and the average dose declined to 0.33 rem (cSv). This reduction was primarily due to the fact that one fairly large broad-scope licensee ceased its manufacturing and distribution activities. Looking at the information shown separately for the broad and other licensees, one can see that the values of all of the parameters remain higher for the broad licensees, probably because this type of license allows the possession of larger quantities of radioactive materials than do the other licenses. In order to see the contribution that each of these licensees made toward the total values of the number of persons monitored, number of workers, and collective dose, Appendix A lists the values of these parameters for each licensee in alphabetical order by licensee name for 1984.

Table 3.5
ANNUAL EXPOSURE INFORMATION FOR MANUFACTURERS AND DISTRIBUTORS
1982-1984

Type of License	Year	No. of Licenses	Number of Monitored Individuals	Workers with Measurable Doses	Collective Dose (person-rem or person-cSv)	Average Measurable Dose (rem or cSv)
M & D-Broad	1984	13	4,625	1,716	594	0.35
M & D-Other		25	384	216	48	0.22
Total		38	5,009	1,932	642	0.33
M & D-Broad	1983	16	4,332	1,744	767	0.44
M & D-Other		17	719	259	57	0.22
Total		33	5,051	2,003	824	0.41
M & D-Broad	1982	18	4,610	1,892	821	0.43
M & D-Other		16	843	307	69	0.22
Total		34	5,453	2,199	890	0.40


Figure 3.2 displays log probability plots of the doses incurred by workers under the two types of manufacturing and distribution licenses for the years 1982 through 1984. The position of the curves plotted for the other licenses above those plotted for the broad licenses indicates that a larger portion of the workers reported by the other licensees have lower doses than those reported by the broad licensees. For example, the graphs show that about 86% of workers monitored by the broad licensees received doses that were less than one rem (cSv), while about 95% of the workers monitored by the other licensees received such doses in 1984.

3.3.3 Low-Level Waste Disposal Licenses

These licenses are issued to allow the receipt, possession, and disposal of low-level radioactive wastes at a land disposal facility. The licensee has the appropriate equipment to pick up wastes from such places as hospitals and laboratories, and transport them to a proper facility for storage and burial.

The requirement for this category of NRC licensee to file annual reports became effective in January 1983. Two licensees in this category submitted annual reports in 1984, while in 1982 and 1983 there was only one licensee in this category. Table 3.1 summarizes the data reported for 1982 through 1984. In 1984, the total number of monitored individuals increased because a second licensee

Figure 3.2
 ANNUAL DOSE DISTRIBUTION OF WORKERS
 AT MANUFACTURING & DISTRIBUTION FACILITIES
 1982-1984

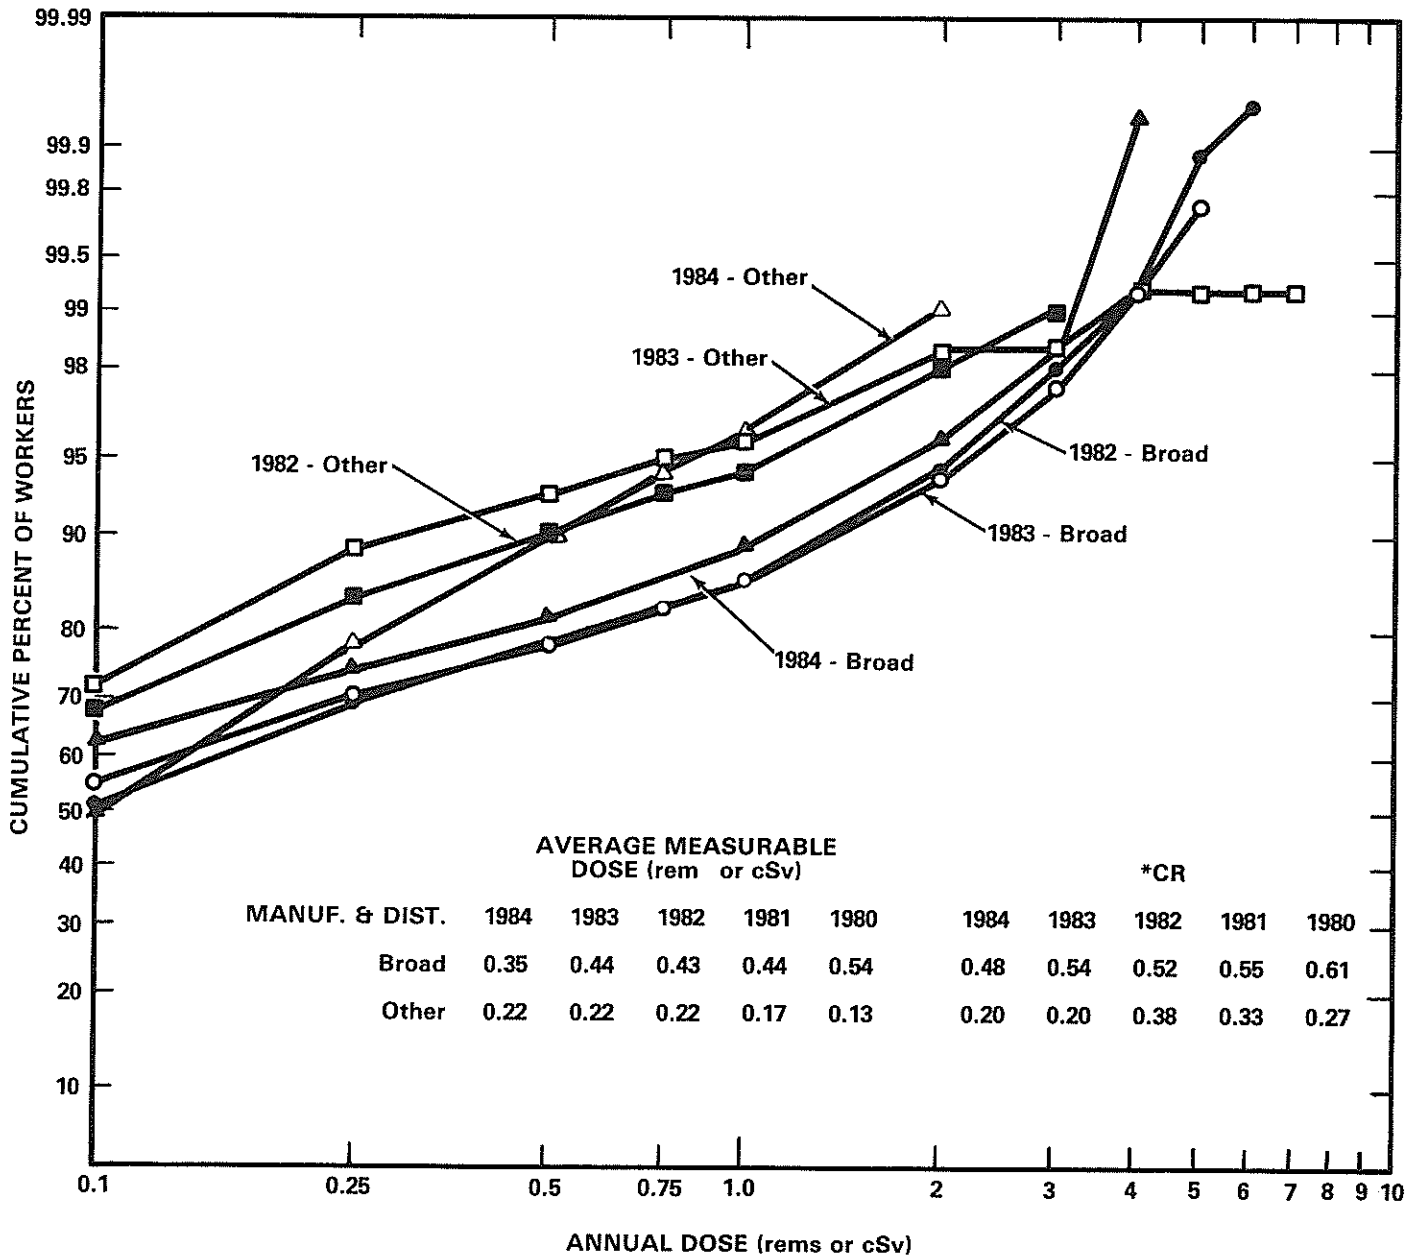

*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems to the total annual collective dose.

Note: Each point on the curves represents the cumulative percentage of workers with measurable doses who received doses less than the indicated annual dose.

was included in this category. However, the collective dose, 72 person-rem (person-cSv), remained about the same as that found for 1983 because the collective dose calculated for the one licensee that reported in 1983 declined by about the same amount as that calculated for the licensee included for the first time in 1984. The number of workers receiving measurable doses also decreased slightly so that the average measurable dose rose somewhat to 0.24 rem (cSv).

Figure 3.3 displays log probability plots of the doses incurred by workers at the low-level waste disposal facilities from 1982 through 1984. One can quickly see that the distributions are quite similar, with all of the doses being less than two rem (cSv) and about 90% of the doses being less than 0.75 rem (cSv) each year. However, the position of the plot for 1984 below that for 1983 is indicative of the slight increase in the average dose and CR. Appendix A summarizes the exposure information reported by these licensees in 1984.

3.3.4 Independent Spent Fuel Storage Installation Licenses

These licenses are issued to allow the possession of power reactor spent fuel and other associated radioactive materials for the purpose of storage of such fuel in an independent spent fuel storage installation (ISFSI). Here, the spent fuel, which has undergone at least one year of decay since being used as a source of energy in a power reactor, is provided interim storage, protection, and safeguarding for a limited time pending its ultimate disposal.

Table 3.1 summarizes the data submitted for 1982 through 1984 by the only licensed ISFSI. Only about 35 individuals have been monitored at the facility each year. However, in 1984 the collective dose increased by about 50% to a value of 13 person-rem (person-cSv). The average measurable dose also increased from 0.30 rem (cSv) to 0.41 rem (cSv). These increases were primarily due to a significant increase in the amount of incoming spent fuel in 1984.


Figure 3.3 displays log probability plots of the doses incurred by workers at the ISFSI for the years 1982 through 1984. The plots are quite similar for 1982 and 1983 when all doses were less than 0.75 rem so the value of CR was zero each year. The plot of the 1984 data lies below that of the previous two years, which indicates that there were doses in higher ranges than before, but all doses were less than 2 rem (cSv) as reflected in the low value (0.06) of CR.

3.3.5 Fuel Fabrication and Reprocessing Licenses

The fuel fabrication licenses are issued to allow the processing and fabrication of reactor fuels. In most uranium facilities where light water reactor fuels are processed, uranium hexafluoride enriched in the isotope U-235 is converted to solid uranium dioxide pellets and inserted into zirconium tubes. The tubes are fabricated into fuel assemblies, which are shipped to nuclear power plants. Some facilities also perform chemical operations to recover the uranium from scrap and other off-specification materials. On a much smaller scale, fuel assemblies containing plutonium oxide pellets can be similarly fabricated and used in reactors for experimental purposes. However, there are no NRC licensees engaged in this activity at this time.

The number of facilities licensed by the NRC to fabricate fuel, especially plutonium fuel, has been decreasing for the last several years (Table 3.1). Therefore, a number of licensees are primarily engaged in decommissioning activities,

Figure 3.3
ANNUAL DOSE DISTRIBUTION OF WORKERS AT LOW-LEVEL WASTE
DISPOSAL FACILITIES AND AT AN INDEPENDENT SPENT FUEL STORAGE FACILITY
1982-1984

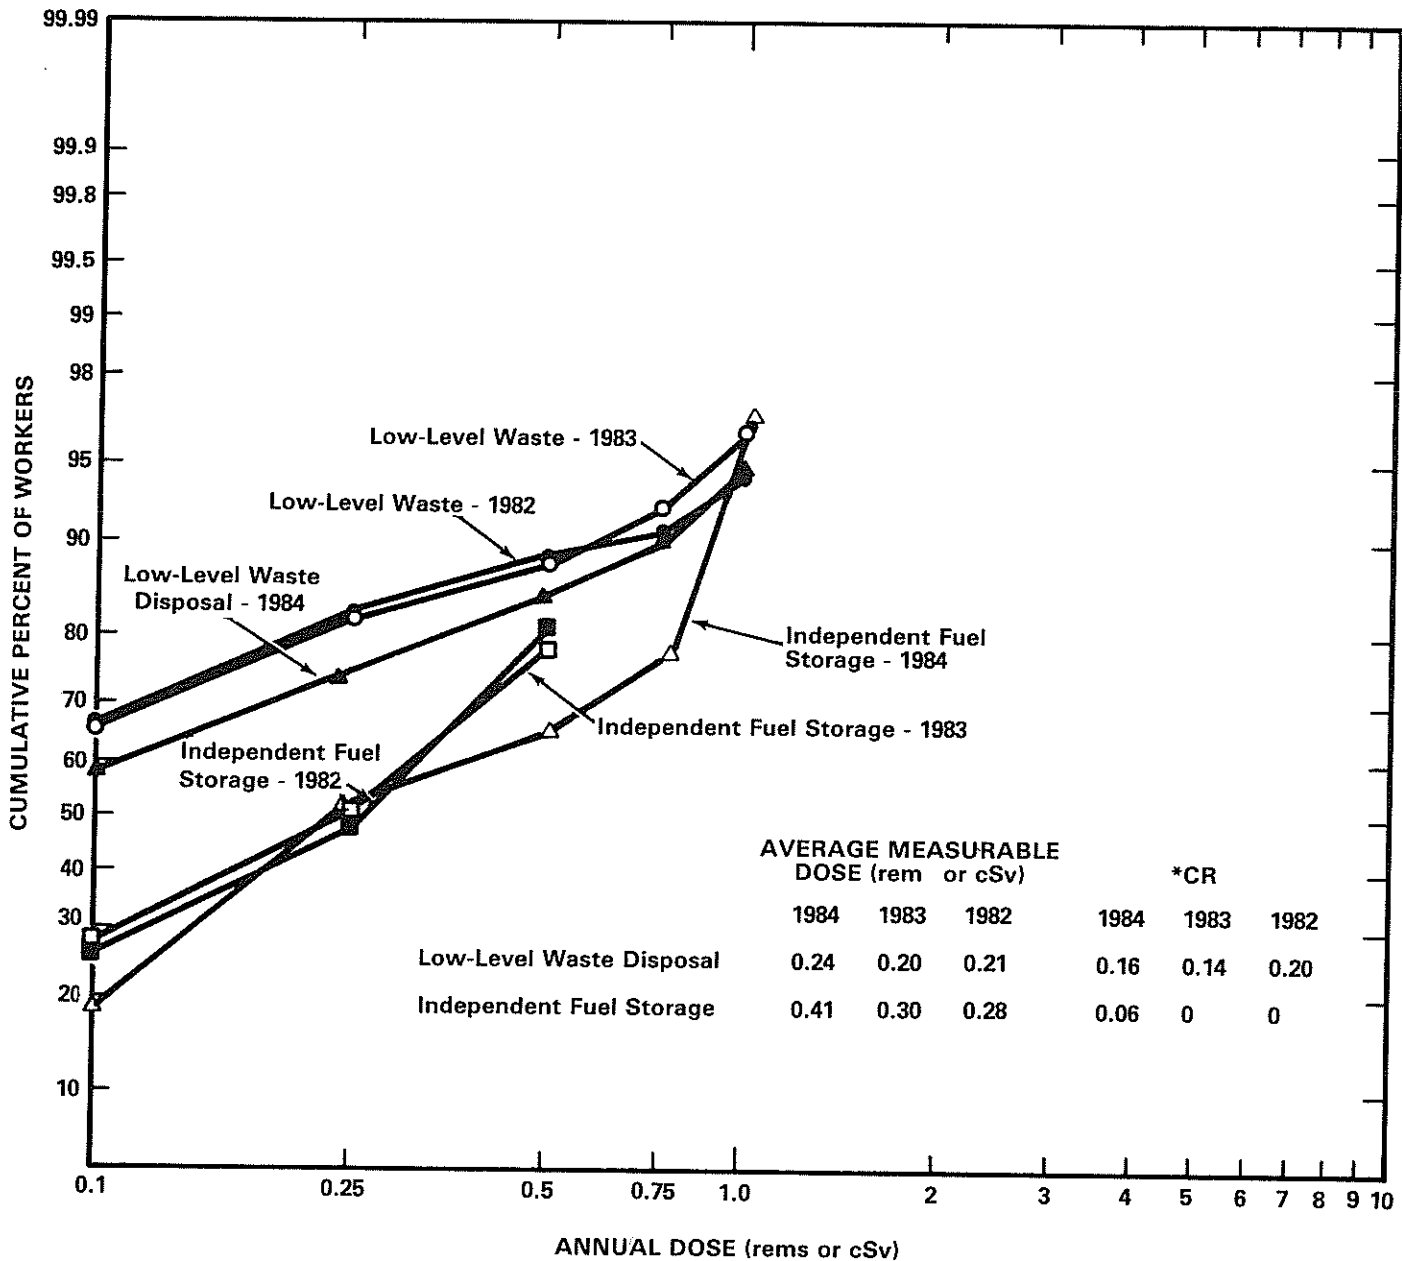

*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems to the total annual collective dose.

Note: Each point on the curves represents the cumulative percentage of workers with measurable doses who received doses less than the indicated annual dose.

and the information that they provided for these years is shown as "Pu Decommissioning" in Table 3.6.


Table 3.6
ANNUAL EXPOSURE INFORMATION FOR FUEL FABRICATORS
1982-1984

Type of License	Year	No. of Licenses	Number of Monitored Individuals	Workers with Measurable Doses	Collective Dose (person-rems or person-cSv)	Average Measurable Dose (rems or cSv)
Uranium Fuel Fab		11	9,379	5,947	815	0.14
Pu Decommissioning	1984	3	109	25	3	0.12
Total		14	9,488	5,772	818	0.14
Uranium Fuel Fab		11	8,440	4,746	748	0.16
Pu Decommissioning	1983	4	583	267	87	0.33
Total		15	9,023	5,013	835	0.17
Uranium Fuel Fab		11	8,652	5,117	724	0.14
Pu Decommissioning	1982	5	1,156	316	107	0.34
Total		16	9,808	5,433	831	0.15

Table 3.6 shows that the number of workers involved in decommissioning activities decreased sharply in 1984, as did the collective dose. The major reason for this is that there was one licensee involved in both decommissioning activities and the analysis of post-irradiated fuel in 1982 and 1983. The decommissioning is now complete and the licensee is no longer included in the fuel fabrication category. However, it should be pointed out that three of the eleven licensees primarily engaged in uranium fuel fabrication in 1982 and 1983 were also involved in the decommissioning of plutonium facilities, and the report submitted by each one covered both activities. Therefore, for comparison with data submitted for previous years, the data in the "Total" row should be used because decommissioning activities were also being conducted during previous years and were not shown separately. Appendix A lists the number of persons monitored, the number of workers receiving measurable doses, and the collective dose for each of these licensees in alphabetical order by licensee name for 1984.

Figure 3.4 consists of the log probability plots of the dose distributions of workers at fuel fabrication facilities for the years 1982 through 1984. The plots for 1982 and 1983 are quite similar, with all doses being less than five rems (cSv) and about 99.3% of the doses being less than two rems (cSv) each year. The average dose and the value of CR were therefore about the same for each year. However, in 1984, there were no doses greater than two rems (cSv) so that the value of CR fell to 0.04.

Figure 3.4
 ANNUAL DOSE DISTRIBUTION OF WORKERS
 AT FUEL FABRICATORS AND PROCESSORS
 1982-1984

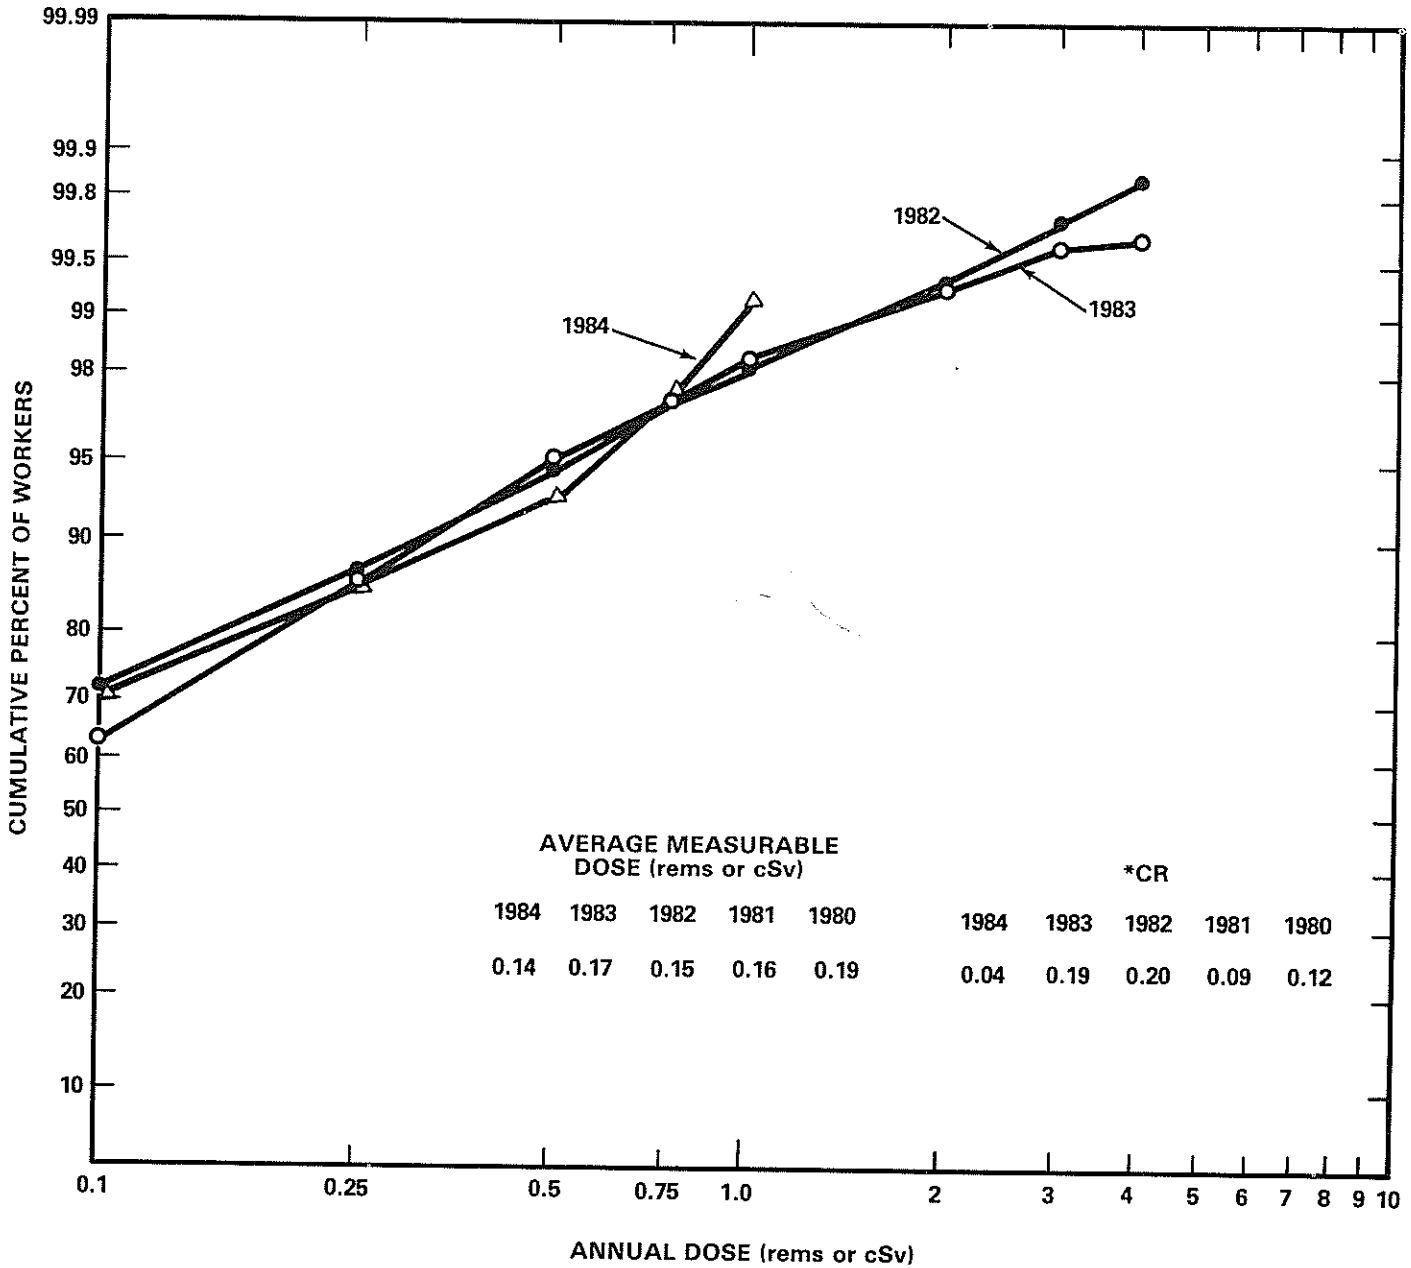

*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems to the total annual collective dose.

Note: Each point on the curves represents the cumulative percentage of workers with measurable doses who received doses less than the indicated annual dose.

Fuel reprocessing licenses are issued to allow the separation of usable uranium and plutonium from spent nuclear fuel. There was only one commercial facility that was ever licensed to reprocess fuel, and it has been shut down since 1972. However, the licensee did some decontamination work and stored radioactive waste at the facility for several years, and the annual report that was submitted each year was usually grouped with those of the fuel fabricators. In February 1982, the Department of Energy assumed possession and control of the reprocessing facility to conduct waste solidification activities necessary for final decommissioning. During this period, the NRC license will, in effect, be suspended, and no reports will be filed with the NRC.

3.3.6 Water-Cooled Power Reactor Licenses


These licenses are issued to utilities to allow them to use special nuclear material in a reactor to produce heat to generate electricity to be sold to consumers. There are two major types of commercial reactors in the United States - pressurized water reactors (PWRs) and boiling water reactors (BWRs) - each of which uses water as the primary coolant.

As shown in Table 3.1, annual reports were received from nuclear power facilities for 88 licensed reactors where 169,242 individuals were monitored for exposure to radiation in 1984. Of this number 94,996 workers received a measurable dose and incurred a collective dose of 55,353 person-rem (person-cSv). It appears that the collective dose is beginning to level off or decrease somewhat, while the number of workers continues to increase. This has resulted in the average measurable dose decreasing to 0.58 rem (cSv). The dose distributions of workers monitored at each plant site is presented in alphabetical order by site name in Appendix B.

Figure 3.5 presents the log-normal plot of the distribution of the whole body doses received by radiation workers at nuclear power facilities in 1983 and 1984. One can quickly see that about 73% of the workers receiving measurable doses at BWRs received doses that were less than one rem (cSv) while about 82% of such workers at PWRs received doses of less than one rem (cSv). The position of the BWR plots below those of the PWRs each year indicates that higher average doses were received at BWRs. Also, departures from a straight line for doses that exceed one rem are again seen, and, according to the hybrid log-normal method [Ref. 12] of analyzing these dose distributions, the sharpness of the departure indicates that a strong feedback mechanism operates when workers begin to incur larger doses and may reflect efforts to keep doses as low as reasonably achievable [Ref. 13].

Listed at the bottom of the figure are the values of CR for the last five years. These show that a larger portion of the collective dose (about 60%) at BWRs continues to be due to workers receiving doses greater than 1.5 rems (cSv) than at PWRs, where CR is usually about 0.50. More detailed presentations and analyses of the annual exposure information reported by nuclear power facilities can be found in Section 4.

Figure 3.5
ANNUAL DOSE DISTRIBUTION OF WORKERS AT
LIGHT WATER REACTOR FACILITIES
1983 & 1984

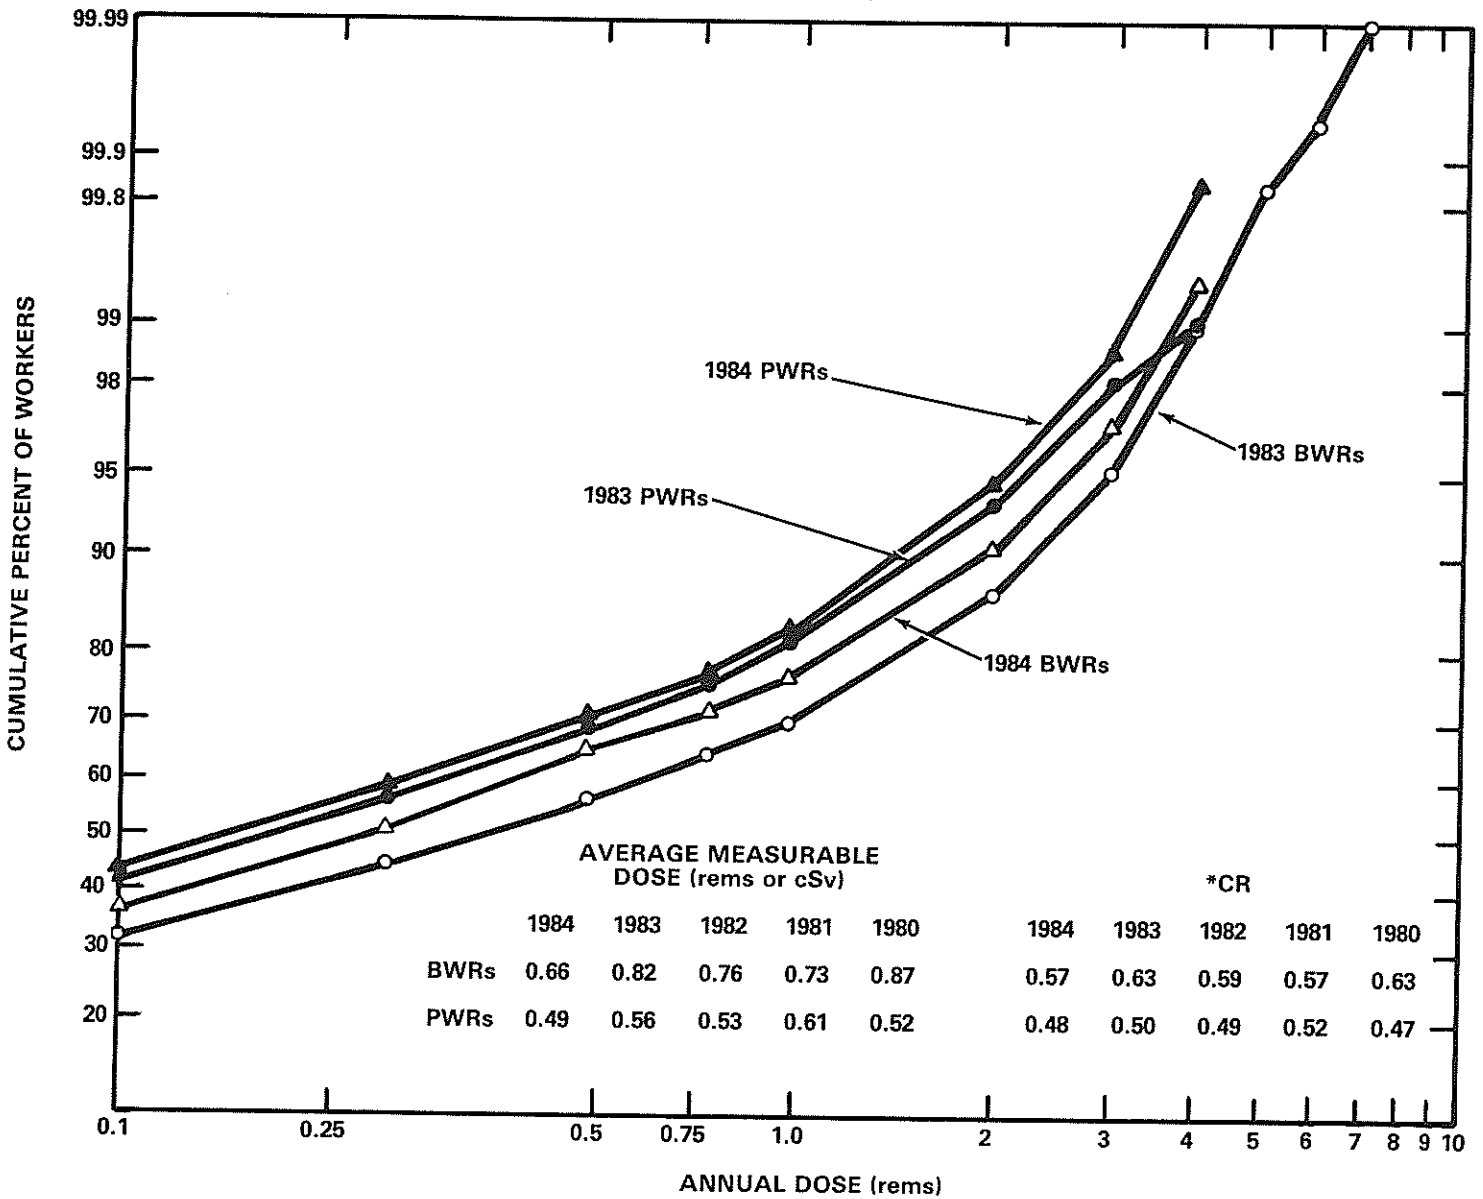

*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems to the total annual collective dose.

Note: Each point on the curves represents the cumulative percentage of workers with measurable doses who received doses less than the indicated annual dose.

3.3.7 High-Temperature Gas-Cooled Power Reactor Licenses

A license to operate a power reactor is issued to utilities to allow them to use special nuclear material in a reactor to produce heat to generate electricity to be sold to consumers. In this type of a reactor, a gas, usually helium, is used as the primary coolant. Fort St. Vrain near Greeley, Colorado, is the only such reactor in operation in the U.S. As shown in Table 3.7, annual whole body doses incurred by workers at the plant have been minimal. No one has ever exceeded an annual dose of 0.25 rem (cSv), and the average dose per worker is usually less than 0.05 rem (cSv).

Table 3.7

ANNUAL EXPOSURE INFORMATION FOR FORT ST. VRAIN
1974-1984

Year	No. of Individuals with Annual Doses in Ranges (rems or cSv)			Total No. of Individuals Monitored	Annual Collective Dose (person-rems or person-cSv)	Gross Electricity Generated (MW-yr)	Average Measurable Dose per Worker (rems or cSv)
	No Measurable Dose	Measurable Dose <0.10	0.10-0.25				
1974	1,597	63	1	1,661	3.3	0.0	0.05
1975	1,263	0	0	1,263	0.0	0.0	0.00
1976	1,362	25	0	1,387	1.3	2.8	0.05
1977	946	55	1	1,002	2.9	29.8	0.05
1978	896	34	0	930	1.7	75.7	0.05
1979	1,149	120	2	1,271	6.4	28.6	0.05
1980	902	57	1	960	3.0	83.2	0.05
1981	1,096	31	0	1,127	1.0	93.6	0.03
1982	978	22	0	1,000	0.4	72.6	0.02
1983	965	48	0	1,013	1.0	94.4	0.02
1984	1,616	62	8	1,686	3.0	10.9	0.04

4 COMMERCIAL LIGHT WATER REACTORS - FURTHER ANALYSIS

4.1 Introduction

Since general trends in occupational radiation exposures at nuclear power reactors are best evaluated within the context of other pertinent information, some of the tables and appendices that summarize exposure data also show the type, capacity, and age of the reactor; the amount of electricity generated; the type of workers being exposed; and the sort of tasks being performed.

4.2 Definitions of Terms and Sources of Data

4.2.1 Number of Reactors

The number of reactors shown in Tables 4.1, 4.2, and 4.3 is the number of BWRs, PWRs, and total light-water-cooled reactors (LWRs), respectively, that had been in commercial operation for at least one full year as of December 31 of each of the indicated years. This is the number of reactors on which the average number of workers and average collective dose per reactor is based. Excluded are those reactors that may have been in commercial operation for only a few months during the first year, and conservative values are yielded for the averages. The date that each reactor was declared to be in commercial operation was found in Reference 14.

4.2.2 Electric Energy Generated

The electric energy generated in gross megawatt-years (MW-yr) each year by each facility is shown in Appendix C. This number was obtained by dividing the gross megawatt-hours of electricity annually produced by each facility by 8,760, the number of hours in the year, except for leap years when the number is 8,784 hours. The gross megawatt-years of generated electricity that are presented in Tables 4.1, 4.2, and 4.3 are the sums of that produced by the number of reactors included each year. These sums are divided by the number of those reactors included in each year to yield the average amount of electric energy generated (MW-yr) per reactor, which is also shown in Tables 4.1, 4.2, and 4.3. The number of gross megawatt-hours of electricity produced each year was also found in Reference 14.

4.2.3 Collective Dose per Megawatt-Year

The number of megawatt-years of electricity generated was used in determining the ratio of the average value of the annual collective dose to the number of megawatt-years of electricity generated. The ratio was calculated by dividing the total collective dose by the total gross megawatt-years generated and is a figure that is a measure of the dose incurred by workers at power plants in relation to the gross electric energy produced. This ratio was also calculated for each reactor site and is presented in Tables 4.1, 4.2, and 4.3 and Appendix C.

4.2.4 Average Rated Capacity

The average rated capacity, shown in Tables 4.1, 4.2, and 4.3 was found by dividing the sum of the net maximum dependable capacities (net MWe) of the reactors by the number of reactors included each year. The net maximum dependable capacity is defined to be the gross electrical output as measured at the

Table 4.1

SUMMARY OF ANNUAL INFORMATION REPORTED BY
COMMERCIAL BOILING WATER REACTORS

1973-1984

Year	Number Of Reactors Included	Annual Collective Doses (person-rem or person-cSv)	No. of Workers With Measurable Doses	Gross Electricity Generated (MW-yr)	Average Dose Per Worker (rem or cSv)	Average Collective Dose Per Reactor (person-rem or person-cSv)	Average No. Personnel With Measurable Doses Per Reactor	Average Collective Dose per MW-yr	Average Electricity Generated Per Reactor (MW-yr)	Average Rated Capacity Net (MWe)
1973	12	4,564	5,340	3,394	0.85	380	445	1.3	283	459
1974	14	7,095	8,769	4,059	0.81	507	626	1.7	290	513
1975	18	12,611	14,607	5,786	0.86	701	812	2.2	321	611
1976	23	12,626	17,859	8,586	0.71	549	776	1.5	373	647
1977	23*	19,042	21,388	9,098	0.89	828	930	2.1	396	645
1978	25*	15,096	20,278	11,774	0.74	604	811	1.3	471	668
1979	25*	18,322	25,245	11,671	0.73	733	1,010	1.6	467	669
1980	26*	29,530	34,094	10,868	0.87	1,136	1,311	2.7	418	664
1981	26*	25,471	34,832	10,899	0.73	980	1,340	2.3	419	674
1982	26*	24,437	32,235	10,655	0.76	940	1,240	2.3	410	674
1983	26*	27,455	33,473	9,730	0.82	1,056	1,287	2.8	374	675
1984	27†	27,074	41,105	9,963	0.66	1,003	1,522	2.7	369	722

*Two plants have been shut down continuously for a number of years but have been included in the count of reactors used to compute various averages per reactor in this report. One may wish to calculate these averages without counting these reactors each year: Dresden 1 - shut down since 10/78; Humboldt Bay - shut down since 7/76. (See Appendix B)

†In 1984 it was decided that Humboldt Bay would not be put in commercial operation again, and it is not included in this count of reactors.

Table 4.2

SUMMARY OF ANNUAL INFORMATION REPORTED BY
COMMERCIAL PRESSURIZED WATER REACTORS

1973-1984

Year	Number Of Reactors Included	Annual Collective Doses (person-rem or person-cSv)	No. of Workers With Measurable Doses	Gross Electricity Generated (MW-yr)	Average Dose Per Worker (rems or cSv)	Average Collective Dose Per Reactor (person-rem or person-cSv)	Average No. Personnel With Measurable Doses Per Reactor	Average Collective Dose per MW-yr	Average Electricity Generated Per Reactor (MW-yr)	Average Rated Capacity Net (MWe)
1973	12	9,399	9,440	3,770	1.00	783	787	2.5	314	533
1974	20	6,627	9,697	6,824	0.68	331	485	1.0	341	619
1975	26	8,268	10,884	11,983	0.76	318	419	0.7	461	643
1976	30	13,807	17,588	13,325	0.79	460	586	1.0	444	675
1977	34	13,469	20,878	17,346	0.65	396	614	0.8	510	699
1978	39	16,713	25,720	19,840	0.65	429	659	0.8	509	723
1979	42*	21,659	38,877	18,249	0.56	516	924	1.2	434	729
1980	42*	24,266	46,237	18,287	0.52	578	1,101	1.3	435	721
1981	44*	28,671	47,351	20,552	0.61	652	1,076	1.4	467	745
1982	48*	27,753	52,147	22,141	0.53	578	1,086	1.3	461	773
1983	49*	29,016	52,173	23,196	0.56	592	1,065	1.3	473	778
1984	51†	28,140	56,987	26,478	0.49	552	1,117	1.1	519	805

*Three plants have been shut down continuously for a number of years but have been included in the count of reactors used to compute various averages per reactor in this report. One may wish to calculate these averages without counting these reactors each year: Indian Point 1 - shut down since 10/78; Three Mile Island 1 and 2 - shut down since 3/79. (See Appendix B)

†In 1984, it was decided that Indian Point 1 would not be put in commercial operation again, and it is not included in this count of reactors.

Table 4.3
SUMMARY OF ANNUAL INFORMATION REPORTED BY
COMMERCIAL LIGHT WATER COOLED REACTORS*
1973-1984

Year	Number Of Reactors Included	Annual Collective Doses (person-rem) or person-cSv	No. of Workers With Measurable Doses	Gross Electricity Generated (MW-yr)	Average Dose Per Worker (rem) or cSv	Average Collective Dose Per Reactor (person-rem) or person-cSv	Average No. Personnel With Measurable Doses Per Reactor	Average Collective Dose per MW-yr	Average MW-Yrs Electricity Generated Per Reactor (MW-yr)	Average Rated Capacity Net (MWe)
1973	24	13,963	14,780	7,164	0.94	582	616	1.9	299	496
1974	34	13,722	18,466	10,883	0.74	404	543	1.3	320	575
1975	44	20,879	25,489	17,769	0.82	475	579	1.2	404	630
1976	53	26,433	35,447	21,911	0.75	499	669	1.2	413	663
1977	57**	32,511	42,266	26,444	0.77	570	742	1.2	462	677
1978	64**	31,809	45,998	31,614	0.69	497	719	1.0	494	702
1979	67**	39,981	64,122	29,920	0.62	597	956	1.3	447	705
1980	68**	53,796	80,331	29,155	0.67	791	1,181	1.8	429	699
1981	70**	54,142	82,183	31,451	0.66	773	1,174	1.7	449	719
1982	74**	52,190	84,382	32,795	0.62	705	1,139	1.6	443	738
1983	75**	56,471	85,646	32,926	0.66	753	1,142	1.7	439	742
1984	78†	55,214	98,092	36,441	0.56	708	1,258	1.5	467	776

*Includes only those reactors that had been in commercial operation for at least one full year as of December 31 of each of the indicated years, and all figures are uncorrected for multiple reporting of transient individuals.

**Five plants have been shut down continuously for a number of years but the data they reported has been used in the compilation of various totals and averages shown in this report. One may wish to calculate these figures without including these reactors each year: Dresden 1 - shut down since 10/78; Humboldt Bay - shut down since 7/76; Indian Point 1 - shut down since 10/78; Three Mile Island 1 and 2 - shut down since 3/79. (See Appendix B)

†In 1984, it was decided that Humboldt Bay and Indian Point 1 would not be put in commercial operation again, and they are not included in compilations in this report.

output terminals of the turbine generator during the most restrictive seasonal conditions, less the normal station service loads. This "capacity" of each plant was found in Reference 14, and it is shown for each site in Appendix C.

4.3 Annual Whole Body Dose Distributions

Table 4.4 summarizes the distribution of the annual whole body doses received by workers at commercial LWRs during each of the years 1973 through 1984. This distribution is the sum of the annual dose distributions reported by each licensed LWR each year. As previously mentioned, the distribution reported by each LWR site for 1984 is shown in Appendix B. The table shows that the number of monitored individuals continues to increase while the collective dose appears to be leveling off. However, the values of CR* show that the percentage of the collective dose due to individual doses greater than 1.5 rems (cSv), has shown a general decrease from its 1973 value of 72% to about 55% in 1984. The distributions shown in Table 4.4 have been adjusted for the number of individuals that may have been reported by more than one site (see Section 5 for a discussion of the methodology). Appendix D provides unadjusted dose distributions for BWRs and PWRs separately for the years 1980 through 1984.

4.4 Average Annual Whole Body Doses

Some of the data presented in Tables 4.1, 4.2, and 4.3 are graphically displayed in Figure 4.1, where it can be seen that the average collective dose and average number of workers per BWR have been higher than those for PWRs since 1974 and that the values of both parameters, in general, continued to rise at both types of facilities until 1982. At that time, the average collective dose per reactor appeared to begin leveling off or decreasing slightly, as did the number of workers. However, in 1984 the average number of workers per reactor reached an all-time high at both BWRs and PWRs, which resulted in lower average doses at both types of facilities.

Figures 4.2 and 4.3 are plots of much of the information that is given in Tables 4.1, 4.2, and 4.3. The values of all of the parameters plotted, except the number of workers and electricity generated, decreased somewhat from last year's values. In looking at these figures and the fluctuations in the parameters for the years following the incident at the Three Mile Island Plant in 1979, one suspects that they reflect some of the impact that this incident had on the nuclear power industry.

To further assist in the identification of any trends that might exist, Figure 4.4 displays the average and median** values of the collective dose per reactor for BWRs and for PWRs for the years 1973 through 1984. The ranges of the values reported each year are shown by the vertical lines with a small bar at each end marking the two extreme values. The rectangles indicate the range of values of the collective dose exhibited by those plants ranked in the twenty-fifth through the seventy-fifth percentiles. Since the median values usually are not as greatly affected by the extreme values of the collective doses, they do not normally fluctuate as much from year to year as do the average values. The median collective dose for PWRs continues to range between 400 and 500

*See definition in Section 3.1.8.

**The value at which 50% of the reactors reported greater collective doses and the other 50% reported smaller collective doses.

Table 4.4
SUMMARY DISTRIBUTION OF
ANNUAL WHOLE BODY DOSES AT COMMERCIAL LIGHT WATER REACTORS
1973 - 1984

YEAR	Number of Individuals with Whole Body Doses in the Ranges (rems or cSv)																			Total Number Monitored	Number with Measurable Exposure	**Total Collective Dose (person-rems or person-cSv)	CR ***
	No Meas'ble Exposure	Meas'ble <0.10	0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.0	1.0-2.0	2.0-3.0	3.0-4.0	4.0-5.0	5.0-6.0	6.0-7.0	7.0-8.0	8.0-9.0	9.0-10.0	10.0-12.0	>12.0						
			5,494	1,698	1,214	740	652	2,468	1,584	422	251	125	71	38	16	7							
1973	19,043	5,494	1,698	1,214	740	652	2,468	1,584	422	251	125	71	38	16	7			33,823	14,780	13,963	0.72		
1974	20,472	6,735	2,887	2,056	1,182	906	2,503	1,378	471	226	86	30	6					36,938	18,466	13,722	0.63		
1975	18,854	8,841	3,674	2,750	1,685	1,339	3,948	1,872	691	423	169	60	24	12	0	1		44,343	25,489	20,879	0.65		
1976	25,704	12,821	5,130	4,135	2,520	2,030	4,860	2,354	789	487	188	70	26	11	5	1		61,151	35,447	26,433	0.62		
1977	23,502	12,395	6,030	4,518	2,890	2,220	5,649	2,856	1,288	661	186	89	47	23	6			62,360	38,858	32,511	0.64		
1978	28,372	15,101	6,342	4,998	3,088	2,247	5,995	3,034	1,197	514	109	37	9	0	1	0	2	71,046	42,674	31,804	0.61		
1979	39,434	22,711	9,020	7,400	4,755	3,206	7,536	3,403	1,404	545	117	42	17	3	0	1		99,594	60,160	39,981	0.61		
1980	44,703	26,903	10,676	8,904	5,570	4,134	10,671	4,607	1,816	831	235	119	29	7	1			119,206	74,503	53,796	0.59		
1981	39,245	26,836	11,226	9,330	6,042	4,497	11,170	4,811	1,999	585	122	96	11	3	1	0	1	115,975	76,730	54,142	0.58		
1982	41,713	29,226	11,713	9,903	6,229	4,420	10,220	4,716	2,066	596	97	31	5	0	1	1		120,937	79,224	52,190	0.57		
1983	47,537	29,552	11,341	9,487	5,949	4,344	11,442	5,292	2,237	697	114	37	8	2				128,041	80,804	56,471	0.60		
1984	55,561	37,437	13,841	10,643	6,624	4,997	11,806	5,182	1,997	380	9	2						148,479	92,918	55,214	0.55		

* Summary of reports submitted in accordance with 10 CFR 20.407 by plants that had been in commercial operation for at least one full year as of December 31 of each of the indicated years. Figures shown for the years 1977 - 1984 have been adjusted for the multiple reporting of transient individuals (see Section 5).

** The collective dose and CR were not reported by the facilities but were calculated by the IRC staff using methods described in this document.

*** CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems (cSv) to the total annual collective dose.

Figure 4.1
AVERAGE COLLECTIVE DOSE AND NUMBER OF WORKERS PER REACTOR
1973 - 1984

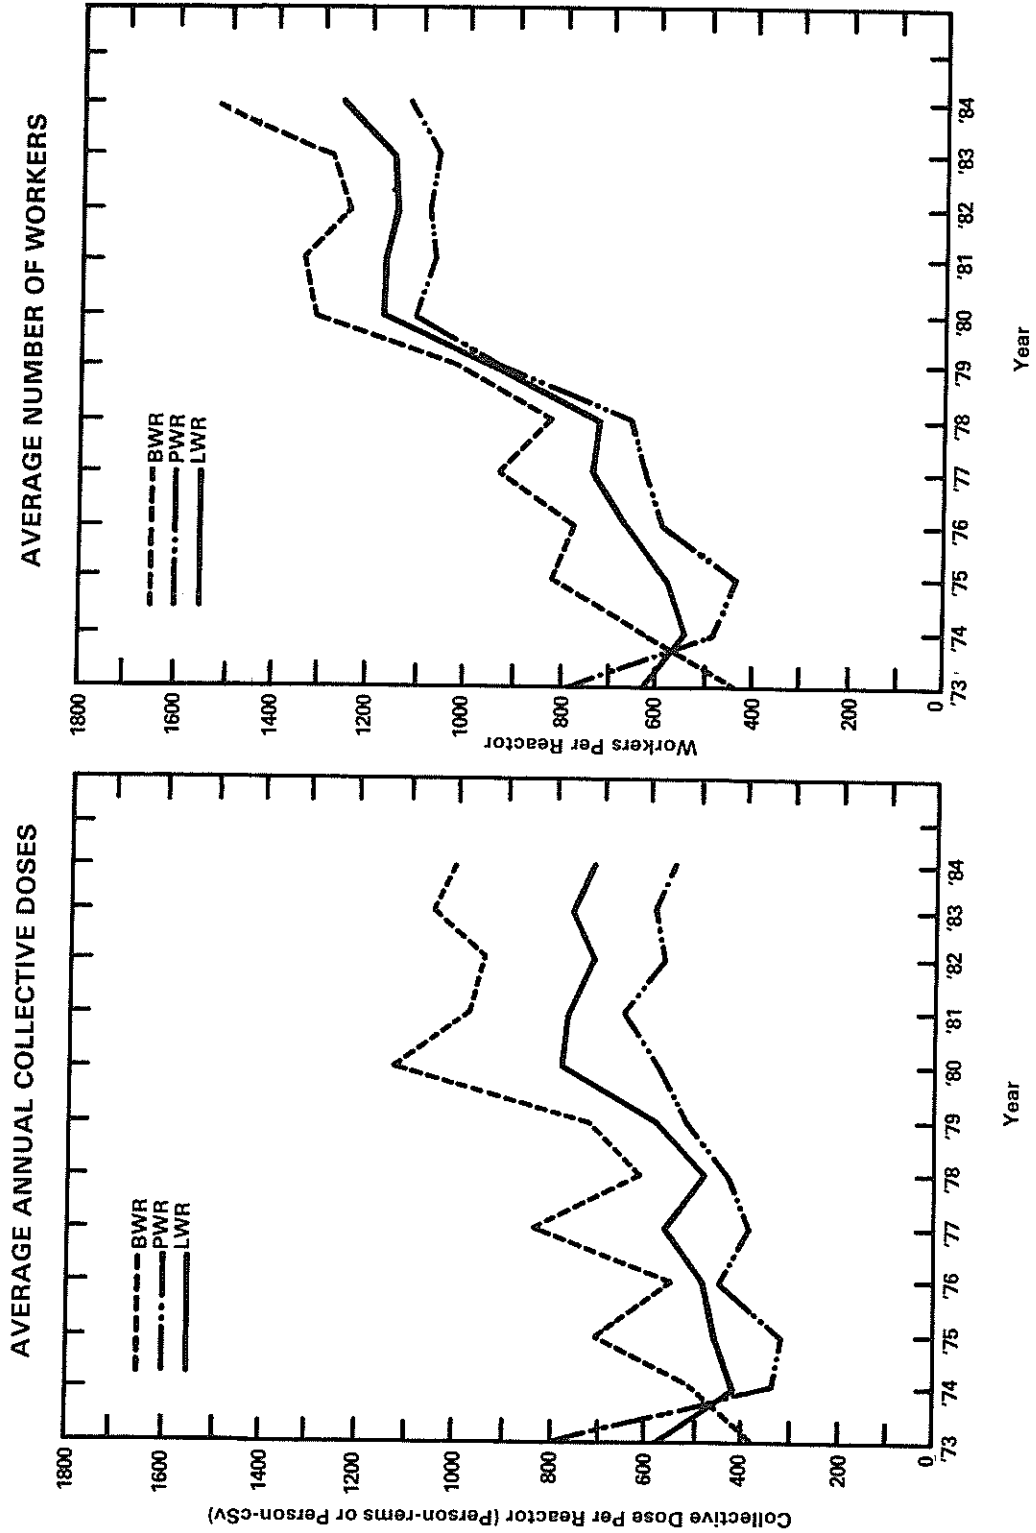


Figure 4.2
ANNUAL VALUES AT BWRs AND PWRs
 1973 - 1984

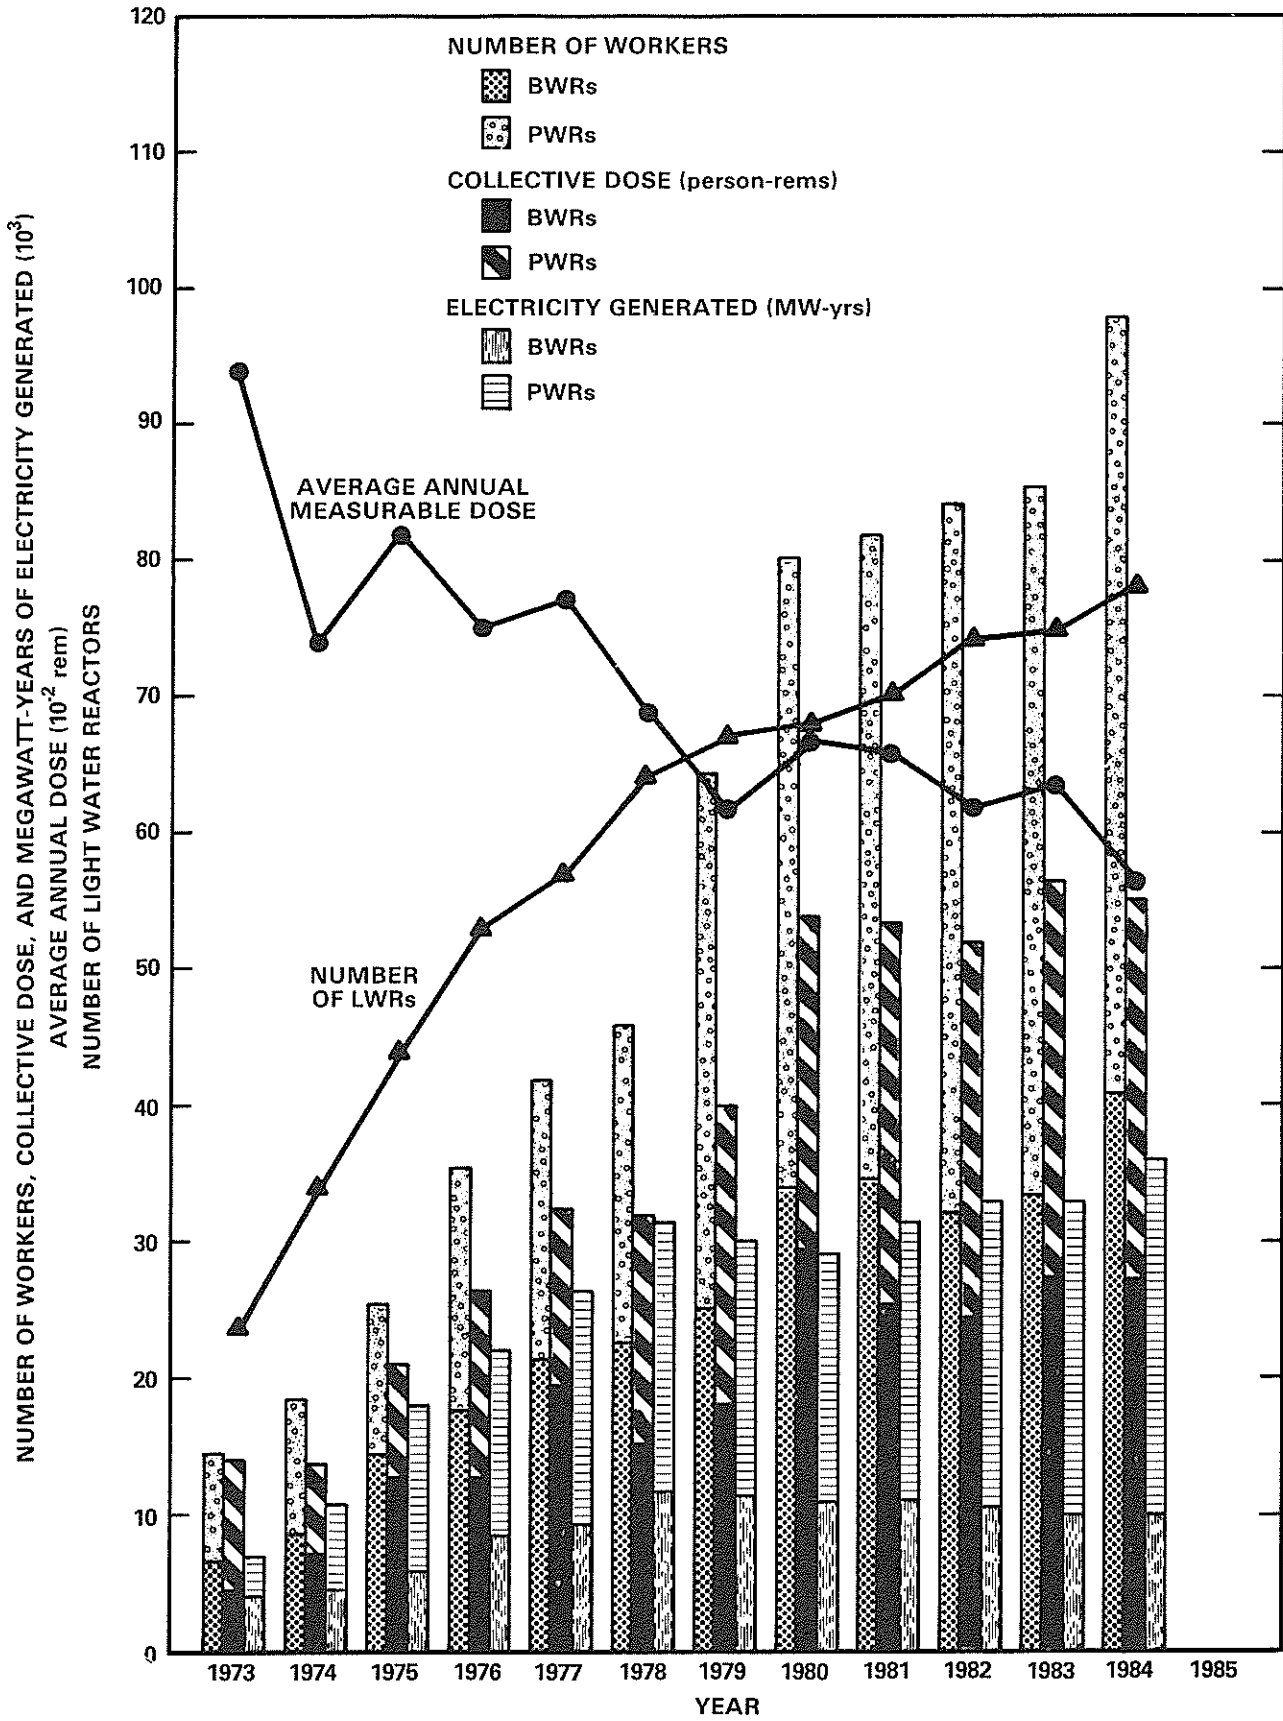


Figure 4.3
AVERAGE ANNUAL VALUES AT LWRs
 1973 - 1984


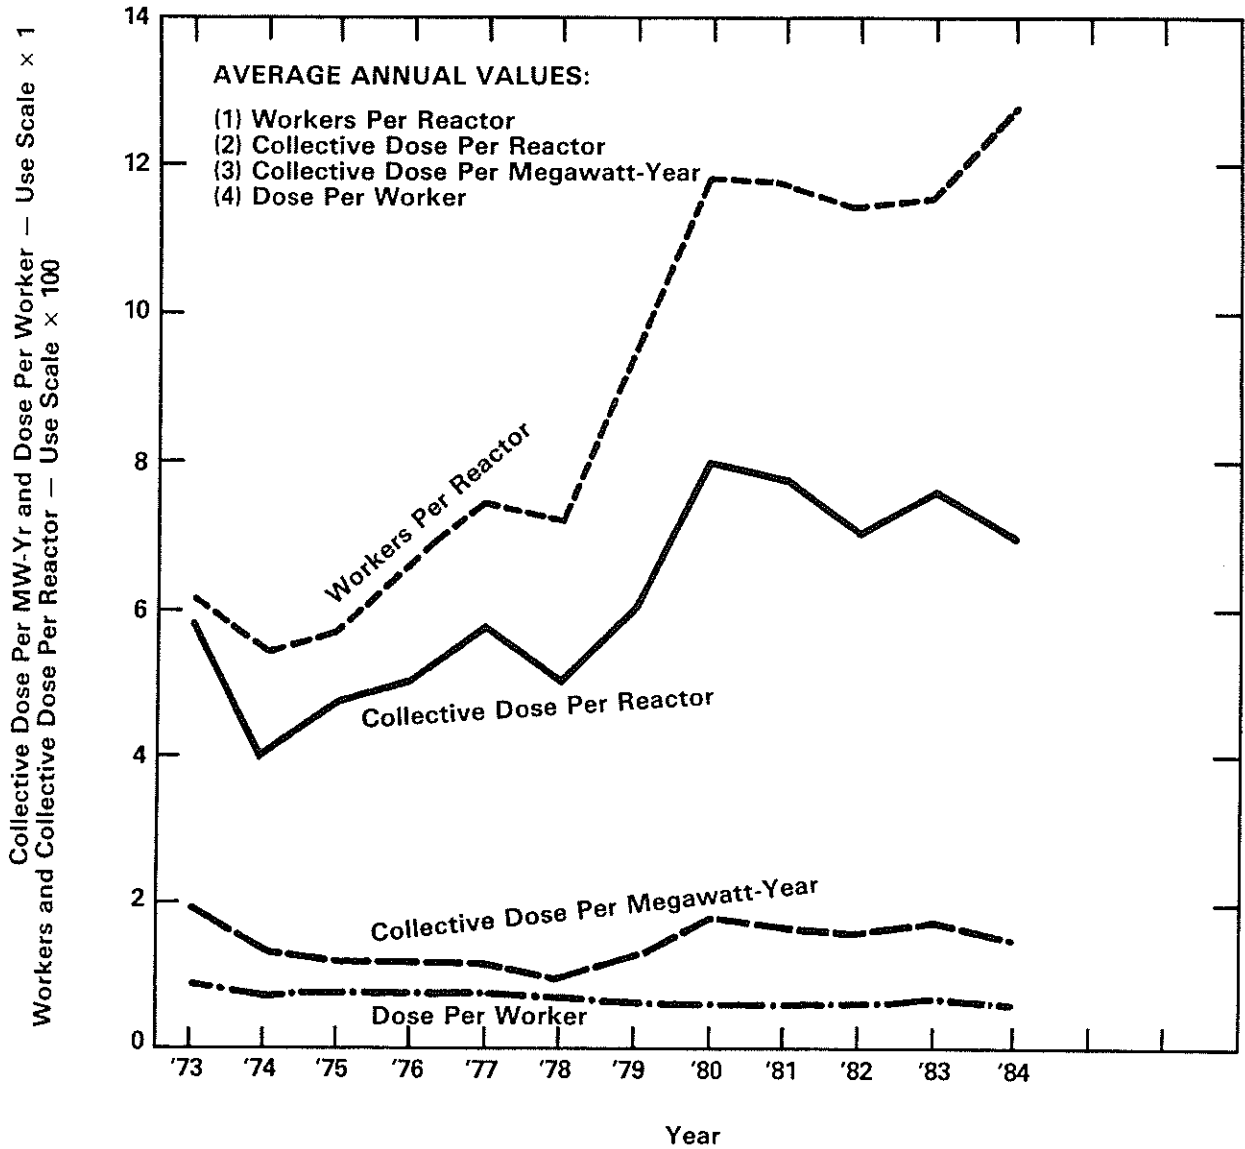


Figure 4.4
**AVERAGE, MEDIAN AND EXTREME VALUES OF
 THE COLLECTIVE DOSE PER REACTOR
 1973 - 1984**

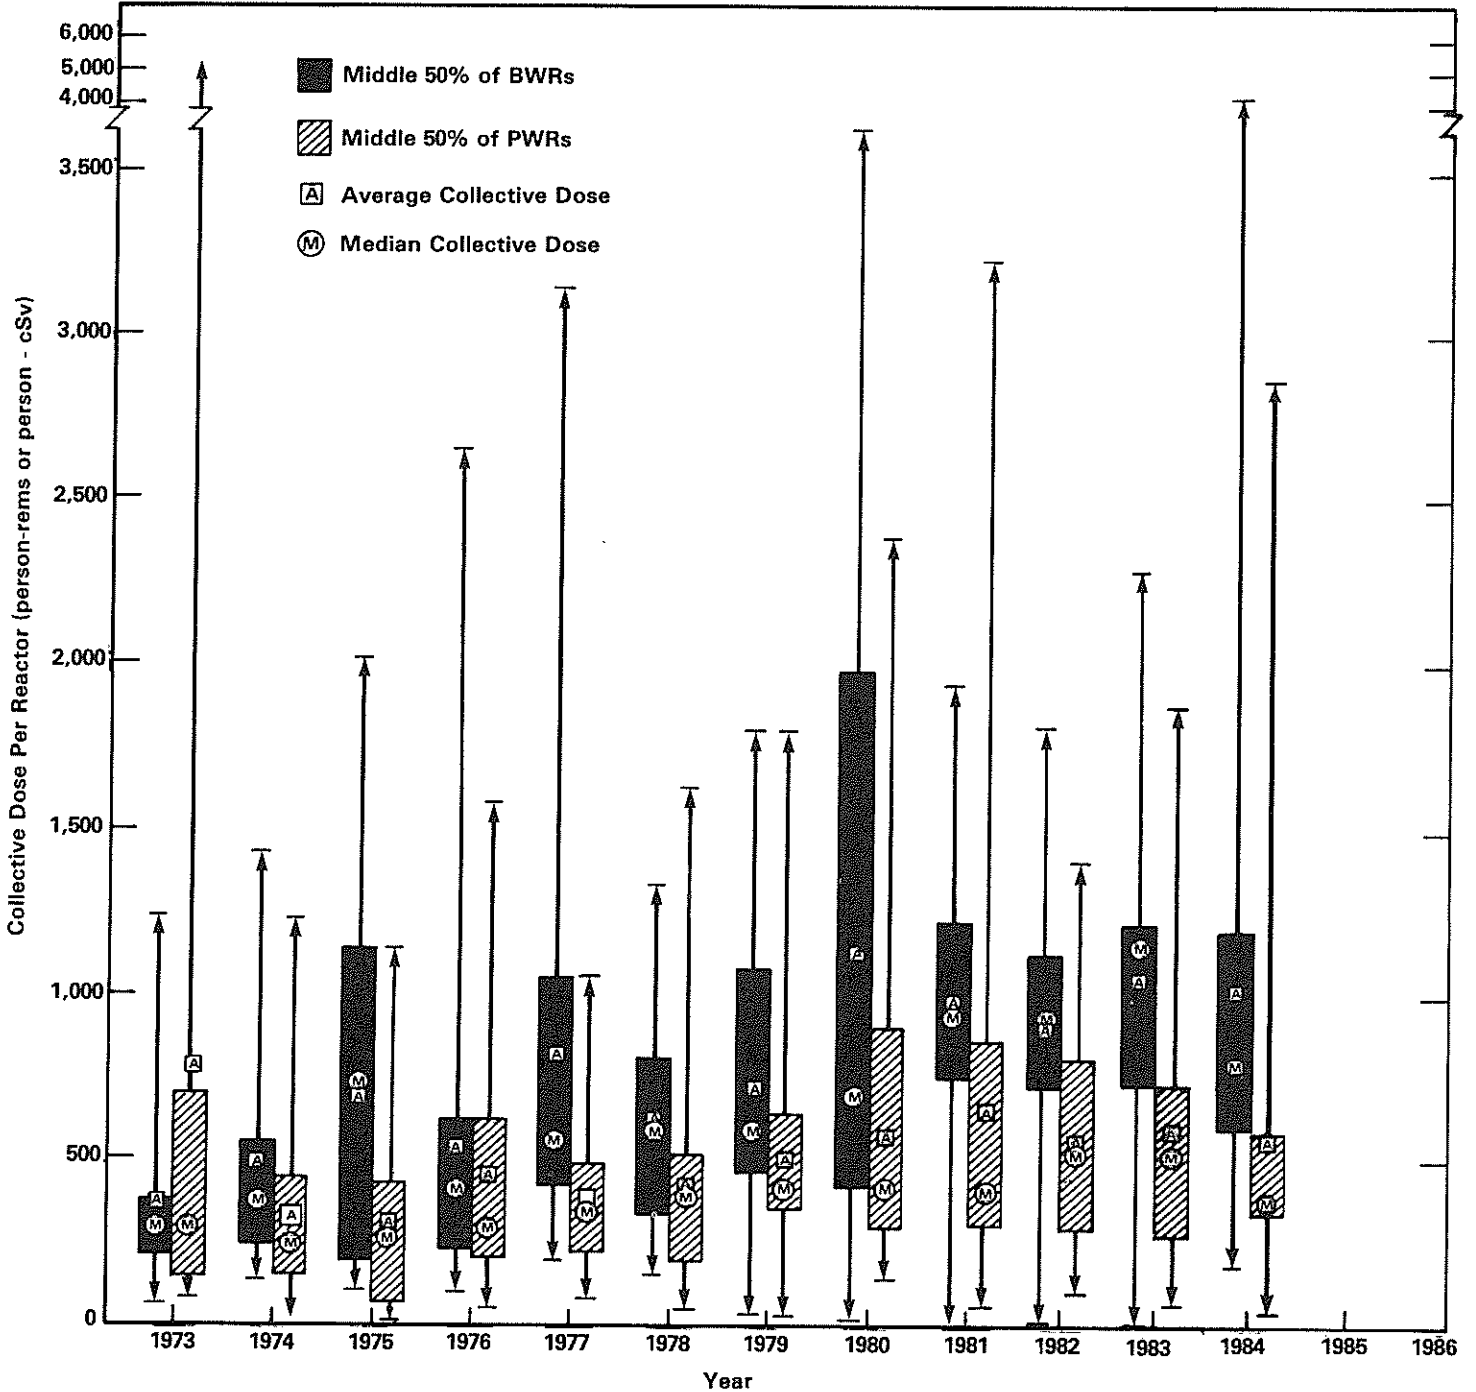

person-rem (person-cSv). At BWRs the median fluctuates more from year to year, and in 1984 the median decreased to 790 person-rem (person-cSv), which was still nearly twice that found for PWRs (395 person-rem (person-cSv)). Figure 4.4 also shows that in 1984 fifty percent of the PWRs reported collective doses between 340 and 570 person-rem (person-cSv) while fifty percent of the BWRs reported collective doses between 590 and 1,170 person-rem (person-cSv). Nearly every year, the median collective dose is less than the average, which indicates that the collective dose for most plants is less than the average collective dose per reactor (the value that is widely quoted).

4.5 Plant Rankings by Collective Dose per Reactor

The number of reactors from which data have been collected is still rather small, and the information reported by a few reactors where unusual conditions or problems may have occurred could have a large impact on some of the statistics presented in this report. In an effort to identify those plants, Tables 4.5 and 4.6 list the BWRs and PWRs in ascending order of person-rem (person-cSv) per reactor for each of the five years from 1980 through 1984. Two other parameters, dose per worker and collective dose per megawatt-year, are also given for each plant and could have been used in listing the plants as well. Also shown is a parameter "CR" which is defined to be the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rem (cSv) to the total annual collective dose. In 1984 the value of CR for about 65% of the U.S. plants fell within the range 0.05 to 0.50 which is recommended by the UNSCEAR [Ref. 10]. Most of the reactors having values of CR greater than 0.50 were BWRs, the highest value being 0.87.

Table 4.7 lists the plants that had been in commercial operation for at least five years as of December 31, 1984, and shows the values of several parameters for each of the sites. It also gives a number of averages for the two types of reactors. Based on the 125 reactor-years of operation accumulated by the 25 BWR sites listed, the average annual collective dose per reactor was found to be 1,067 person-rem (person-cSv), the average measurable dose was 0.80 rem (cSv), and the average collective dose per megawatt-year was 2.7. Based on the 170 reactor-years of operation by the 34 PWR sites listed, these averages were found to be 569 person-rem (person-cSv), 0.59 rem and 1.3, respectively.

In 1984, there were five BWR units where collective doses that exceeded 1,500 person-rem (person-cSv) were accumulated. Although these five units represented only 18.5% of the 27 BWRs operating in 1984, they contributed nearly 44% of the total collective dose incurred at BWRs in 1984. Most of the collective dose accumulated at the BWR site with the highest collective dose (4,082 person-rem (person-cSv)) was attributed to the replacement of all the recirculation system piping.

At PWRs, there were five units where the collective dose exceeded 1,100 person-rem (person-cSv). Although representing less than 10% of the 51 PWRs operating in 1984, they contributed nearly 32% of the total collective dose at PWRs in 1984. The plant with the highest collective dose (2,880 person-rem (person-cSv)) in 1984 accumulated most of the dose during the replacement of steam generators.

Table 4.6
PRESSURIZED WATER REACTORS LISTED IN ASCENDING ORDER OF COLLECTIVE DOSE PER REACTOR
1980-1984

1980			1981			1982			1983			1984		
Site names	Coll. Dose per Site	Dose per Worker (rems or cSv) Hr-yr	Site names	Coll. Dose per Site	Dose per Worker (rems or cSv) Hr-yr	Site names	Coll. Dose per Site	Dose per Worker (rems or cSv) Hr-yr	Site names	Coll. Dose per Site	Dose per Worker (rems or cSv) Hr-yr	Site names	Coll. Dose per Site	Dose per Worker (rems or cSv) Hr-yr
Davis Besse	154	0.12	Davis Besse	58	0.10	Keosauqua	101	0.29	Yankee Rowe	68	0.17	Yankee Rowe	49	0.09
Keosauqua	165	0.41	Keosauqua	141	0.37	Prairie Island 1,2	229	0.36	Davis Besse	80	0.11	Prairie Island 1,2	147	0.27
Prairie Island 1,2	363	0.36	Prairie Island 1,2	329	0.39	Haddam Neck	176	0.23	Prairie Island 1,2	233	0.36	Mt. Sterling Point 2	120	0.42
Three Mile Island 1,2	394	0.17	Three Mile Island 1,2	376	0.18	Davis Besse	164	0.12	San Onofre 1	155	0.09	Keosauqua	113	0.29
Yankee Rowe	213	0.42	Beaver Valley	229	0.39	McGuire	169	0.11	Maine Yankee	184	0.28	Davis Besse	177	0.16
North Anna 1	218	0.10	Salton 1	254	0.15	Crystal River	177	0.23	Keosauqua	185	0.37	Rancho Seco	222	0.28
Cook 1,2	493	0.37	Point Beach 1,2	302	0.77	Fort Calhoun	217	0.36	Indian Point 1,2	485	0.46	Indian Point 3	230	0.35
Point Beach 1,2	598	1.07	Yankee Rowe	302	0.59	Farley 1,2	484	0.33	Sequoyah 1,2	491	0.28	Calvert Cliffs 1,2	479	0.35
Indian Point 3	308	0.32	Point Beach 1,2	607	0.39	St. Lucie	272	0.26	Salton 1,2	581	0.24	Summer	295	0.26
Calvert Cliffs 1,2	677	0.45	Calvert Cliffs 1,2	655	0.49	Point Beach 1,2	609	0.29	Trojan	307	0.32	Three Mile Island 1,2	688	0.64
Arkansas 1	342	0.28	North Anna 1,2	680	0.28	Palisades	330	0.21	Cook 1,2	658	0.46	Yankee Rowe	348	0.53
Oncolee 1,2,3	1,055	0.50	Indian Point 3	364	0.54	Rancho Seco	317	0.44	North Anna 1,2	665	0.30	Oncolee 1,2,3	1,106	0.53
Rancho Seco	412	0.46	Rancho Seco	402	0.52	Arkansas 1,2	803	0.50	Calvert Cliffs 1,2	668	0.35	Cook 1,2	762	0.49
Trojan	424	0.35	Oncolee 1,2,3	1,211	0.50	Arkansas 1,2	803	0.50	Oncolee 1,2,3	1,207	0.53	Zion 1,2	786	0.71
Crystal River	424	0.32	Crystal River 3	488	0.36	Trojan	419	0.42	Fort Calhoun	433	0.50	Point Beach 1,2	789	0.56
Farley	425	0.33	Maine Yankee	424	0.49	Yankee Rowe	474	0.59	Farley 1,2	1,021	0.53	Ginna	395	0.55
Salton 1	449	0.25	Fort Calhoun	458	0.56	Three Mile Island 1,2	1,004	0.47	McGuire 1	521	0.30	Arkansas 1,2	504	0.36
Zion 1,2	920	0.68	Farley	511	0.38	Calvert Cliffs 1,2	1,057	0.59	Crystal River	552	0.32	Trojan	507	0.30
Maine Yankee	462	0.63	Millstone Point 2	531	0.60	Oncolee 1,2,3	1,792	0.73	Three Mile Island 1,2	1,359	0.73	Sequoyah 1,2	507	0.30
Indian Point 1*,2	971	0.62	Arkansas 1,2	1,102	0.50	Sequoyah	570	0.29	Indian Point 3	607	0.65	Fort Calhoun	563	0.62
St. Lucie	532	0.50	Trojan	508	0.46	Salton 1,2	1,203	0.37	Zion 1,2	607	0.65	Palisades	573	0.43
Beaver Valley	553	0.30	Ginna	655	0.71	Main Yankee	619	0.48	Arkansas 1,2	1,311	1.02	Turkey Point 3,4	1,255	0.62
Crystal River	625	0.59	Robinson 2	733	0.50	Beaver Valley	599	0.34	San Onofre 1,2	1,397	0.65	St. Lucie 1,2	1,263	0.60
Millstone Point 2	636	0.71	Zion 1,2	1,720	0.99	Beaver Valley	1,490	0.79	Point Beach 1,2	1,403	0.82	North Anna 1,2	694	0.70
Fort Calhoun	668	0.75	Palisades	902	0.42	Surry 1,2	1,635	0.76	Beaver Valley	1,403	0.82	Surry 1,2	2,247	0.70
Ginna	708	0.66	St. Lucie	529	0.63	Indian Point 1*,2	1,635	0.76	Rancho Seco	772	0.52	Haddam Neck	1,216	0.85
Turkey Point 3,4	1,651	0.92	Haddam Neck	2,036	0.67	North Anna 1,2	832	0.27	Ginna	707	0.59	Indian Point 2	2,644	0.91
Haddam Neck	1,353	0.73	Turkey Point 3,4	2,251	0.77	Zion 1,2	1,915	0.57	Palisades	855	0.88	Robinson 2	2,680	0.70
Robinson 2	1,852	0.92	Indian Point 1*,2	2,731	1.05	Oncolee 1,2,3	2,103	1.34	Robinson	923	0.41	Averages per reactor	552	0.49
Surry 1,2	3,836	0.72	Surry 1,2	4,244	1.13	Turkey Point 3,4	2,119	0.72	Palisades	977	0.45	Averages per reactor	552	0.49
San Onofre 1	2,387	0.78	San Onofre	3,223	1.11	Ginna	1,140	0.83	St. Lucie	1,204	0.54	Averages per reactor	552	0.49
Averages per reactor:	578	0.52	Averages per reactor:	652	0.61	Indian Point 3	1,226	0.71	Turkey Point 1,2	2,681	0.92	Averages per reactor	552	0.49
						Millstone Point 2	1,413	0.58	Surry 1,2	3,220	1.17	Averages per reactor	552	0.49
						Millstone Point 2	1,426	0.71	Millstone Point 2	1,881	0.79	Averages per reactor	552	0.49
						Averages per reactor:	578	0.53	Averages per reactor	592	0.56	Averages per reactor:	552	0.49

For sites with more than one operating reactor, the collective dose indicated is obtained by dividing the collective dose for the site by the number of reactors.
*CR is the ratio of the annual collective dose delivered at individual doses exceeding 1.5 rems (cSv) to the total collective dose.

Table 4.7a
 FIVE-YEAR TOTALS AND AVERAGES LISTED IN ASCENDING
 ORDER OF COLLECTIVE DOSE PER BWR
 1980-1984

BWRs **Site name	*Total Collective Dose per Site	Workers with Measurable Doses	Average Dose per Worker (rem or cSv)	Total Mega- watt- years	Average Collective Dose per MW-yr
La Crosse	1,111	907	1.22	136.5	8.1
Big Rock Point	1,260	2,389	0.53	242.0	5.2
Duane Arnold	3,014	4,997	0.60	1,507.7	2.0
Hatch 1,2	6,763	15,785	0.43	3,231.5	2.1
Browns Ferry 1,2,3	11,728	15,632	0.75	9,413.3	1.2
Cooper	4,072	5,444	0.13	2,336.2	1.7
Dresden 1,2,3	13,186	12,812	1.02	4,898.0	2.7
Vermont Yankee	4,404	5,758	0.76	2,032.1	2.2
Monticello	5,111	6,155	0.83	1,620.5	3.2
Nine Mile Point	5,197	7,490	0.69	1,809.2	2.9
Millstone Point 1	5,663	3,749	1.51	2,356.5	2.4
Peach Bottom 2,3	12,198	14,785	0.83	6,109.8	2.0
Fitzpatrick	6,716	10,193	0.66	2,788.4	2.4
Oyster Creek	7,826	9,597	0.82	855.4	9.1
Quad Cities 1,2	15,811	11,129	1.42	5,125.6	3.1
Brunswick 1,2	17,035	23,247	0.73	3,550.7	4.8
Pilgrim (125 reactor-years)	12,245	16,065	0.76	1,719.0	7.1
Grand Totals and Averages	133,340	166,000	0.80	49,722.7	2.7
Averages per Reactor-year	1,067	1,328		397.8	

Table 4.7b
 FIVE-YEAR TOTALS AND AVERAGES LISTED IN ASCENDING
 ORDER OF COLLECTIVE DOSE PER PWR
 1980-1984

PWRs **Site name	*Total Collective Dose per Site	Workers with Measurable Doses	Average Dose per Worker (rem or cSv)	Total Mega- watt- years	Average Collective Dose per MW-yr
Davis Besse	633	5,017	0.13	2,289.2	0.3
Prairie Island 1,2	1,291	3,648	0.35	4,484.0	0.3
Kewaunee	711	2,064	0.34	2,243.0	0.3
Yankee Rowe	1,405	2,880	0.49	541.5	2.6
Cook 1,2	3,267	7,190	0.45	7,553.8	0.4
Calvert Cliffs 1,2	3,488	8,140	0.43	5,404.6	0.7
Maine Yankee	1,753	4,752	0.37	2,976.5	0.6
Three Mile Island 1,2	3,621	9,225	0.39	0.0	-
Crystal River	1,811	5,222	0.35	2,708.6	1.9
Point Beach 1,2	3,995	5,175	0.77	3,682.0	1.1
Oconee 1,2,3	6,371	11,001	0.58	9,042.7	0.7
Rancho Seco	2,160	4,568	0.47	2,069.5	1.0
Trojan	2,189	5,458	0.40	3,143.8	1.4
Fort Calhoun	2,339	4,090	0.57	1,530.8	1.5
Beaver Valley	2,657	7,687	0.35	2,077.8	1.3
Indian Point 3	2,735	4,730	0.58	1,626.8	1.7
Palisades	3,206	8,523	0.38	1,663.9	1.9
Zion 1,2	6,840	7,087	0.97	6,576.7	1.0
Ginna	3,752	4,797	0.78	1,801.6	2.1
Millstone Point 2	4,581	6,533	0.70	2,974.3	1.5
Turkey Point 3,4	9,957	11,639	0.86	4,385.4	2.3
Haddam Neck	5,115	7,048	0.73	2,315.9	2.2
Surry 1,2	15,037	16,900	0.89	4,742.0	3.2
Robinson 2 (170 reactor-years)	7,814	11,853	0.66	1,529.2	5.1
Grand Totals and Averages	96,728	165,227	0.59	77,363.6	1.3
Averages per Reactor-year	569	972		455.1	

*For sites with more than one operating reactor, the collective dose per reactor is obtained by dividing the collective dose for the site by the number of reactors.

**Sites where not all reactors had completed five full years of commercial operation as of 12/31/84 are not included.

In general, particularly for BWRs, the plants having the lower values of most of the parameters shown are usually the newer plants. Some of the older, smaller plants also appear near the top of the listings since they report small collective doses; however, the ratio of their collective dose to the number of megawatt-years of electricity generated will be higher because of their limited power generation capacity. In the case of PWRs, this generalization does not always apply. For example, Prairie Island and Susquehanna, three reactors that have been operating for 10 or 11 years, have experienced lower collective doses than many newer reactors for years.

Usually, the combination of a large annual collective dose and a large collective dose to megawatt-year ratio for a plant indicates that extensive maintenance or modifications were undertaken during the year. For example, maintenance jobs that were large contributors to BWR doses in 1984 included replacement of recirculation system piping, inspection for intergranular stress corrosion cracking (IGSCC), IGSCC repair, Mark I torus modifications, and reactor vessel component inservice inspection. The PWR facilities reporting high values for these two parameters during the last few years generally have been involved in extensive tube inspection, sleeving, and plugging related to the repair of steam generators. It should be noted that the differences in nuclear plant designs and the ages of plants [Ref. 15], even between plants of a given type, affect the nature of these parameters as well, and one should be careful when attempting to draw conclusions from these data.

4.6 Collective Dose by Work Function and Employee Type

A second type of annual statistical report that is required by each plant's technical specifications provides the collective dose of workers monitored at each plant site by employee type (plant, utility, or contractor) and by work and job functions. The report submitted for each reactor site, after undergoing any necessary standardization, is provided in Appendix D. Summaries of the collective doses shown in these reports are given in Tables 4.8, 4.9, and 4.10. The collective doses obtained from these reports are not used in any other tables in this document for the following reasons: the technical specifications of each plant requires only 80% of the plant's collective dose be accounted for, and some plants do not use the official dosimeter results in compiling the data.

Table 4.8 provides a detailed summary of the distribution of collective dose by work function and personnel types for BWRs, PWRs, and all LWRs. It shows that contract workers performing special maintenance at LWRs continue to incur the largest portion (35%) of the collective dose. Table 4.9 presents a more general summary of these data for the last ten years, and one can see that the collective dose incurred during routine and special maintenance activities has ranged between 67% and 77% during these years. Figure 4.5 graphically shows the trends in the collective dose by work function and type of personnel for the years 1979 through 1984 for BWRs and PWRs separately. Contractor personnel incur most of the collective dose during special maintenance while it is nearly equally divided between contractor and plant and utility personnel during routine maintenance and waste processing and that the figures are fairly stable from year to year. Because of this stability and the fact that a number of these reports are not submitted in a standard format, summaries of these data will not be presented in future reports of these NUREG series.

Table 4.8

ANNUAL COLLECTIVE DOSE
BY WORK FUNCTION AND PERSONNEL TYPE

1984

WORK FUNCTION	STATION EMPLOYEES PERSON-REM % OF TOTAL	UTILITY EMPLOYEES PERSON-REM % OF TOTAL	CONTRACT WORKERS & OTHERS PERSON-REM % OF TOTAL	TOTAL PER FUNCTION PERSON-REM % OF TOTAL
<u>BOILING WATER REACTORS</u>				
<u>REACTOR OPERATIONS & SURVEILLANCE</u>	1494.190	188.650	1139.668	2822.508
ROUTINE MAINTENANCE	2350.776	1028.623	4997.430	8376.829
INSERVICE INSPECTION	217.526	114.967	1158.467	1490.960
SPECIAL MAINTENANCE	1244.152	1537.676	9190.503	11972.331
WASTE PROCESSING	455.392	30.866	441.481	927.739
REFUELING	352.897	65.153	274.714	692.764
TOTALS	6114.933	2965.935	17202.263	26283.131
<u>* PRESSURIZED WATER REACTORS</u>				
<u>REACTOR OPERATIONS & SURVEILLANCE</u>	1647.331	149.729	1486.936	3283.996
ROUTINE MAINTENANCE	2355.534	472.006	3226.830	6054.370
INSERVICE INSPECTION	319.122	286.057	1295.760	1900.939
SPECIAL MAINTENANCE	1658.680	1283.824	9446.879	12389.383
WASTE PROCESSING	437.662	34.341	520.618	992.621
REFUELING	1013.627	343.006	1400.592	2757.225
TOTALS	7431.956	2568.963	17377.615	27378.534
<u>* ALL LIGHT WATER REACTORS</u>				
<u>REACTOR OPERATIONS & SURVEILLANCE</u>	3141.521	338.379	2626.604	6106.504
ROUTINE MAINTENANCE	4706.310	1500.629	8224.260	14431.199
INSERVICE INSPECTION	536.648	401.024	2454.227	3391.899
SPECIAL MAINTENANCE	2902.832	2821.500	18637.382	24361.714
WASTE PROCESSING	893.054	65.207	962.099	1920.360
REFUELING	1366.524	408.159	1675.306	3449.989
TOTALS	13546.889	5534.898	34579.878	53661.665

* Table does not include results from the PMRs at Point Beach 1,2 (737 man-rem) because of formatting problems.

** These values are higher than usual because the dose incurred during various maintenance activities while Salem 1 was refueling was attributed to the refueling work function.

Table 4.9

PERCENTAGES OF ANNUAL COLLECTIVE
DOSE AT LWRS BY WORK FUNCTION

Work Function	Percent of Collective Dose Each Year									
	1975	1976	1977	1978	1979	1980	1981	1982	1983	1984
Reactor operations and surveillance	10.8%	10.2%	10.5%	13.3%	12.2%	9.5%	8.9%	9.4%	10.1%	11.4%
Routine maintenance	52.6%	31.0%	28.1%	31.5%	29.2%	35.5%	36.1%	27.9%	29.7%	26.9%
Inservice inspection	3.0%	6.0%	6.4%	7.7%	9.0%	5.5%	5.3%	6.5%	7.6%	6.3%
Special maintenance	19.0%	40.0%	42.5%	35.9%	39.4%	40.6%	40.5%	46.8%	43.9%	45.4%
Waste processing	6.9%	5.0%	5.8%	5.0%	3.6%	3.0%	4.2%	5.0%	4.6%	3.6%
Refueling	7.7%	7.9%	6.7%	6.6%	6.6%	6.1%	5.0%	4.4%	4.1%	6.4%
<i>GW R</i>	<i>12,611</i>	<i>12,626</i>	<i>19,042</i>	<i>15,096</i>	<i>18,322</i>	<i>29,530</i>	<i>25,471</i>	<i>24,437</i>	<i>27,455</i>	<i>27,074</i>
<i>PWR</i>	<i>8,268</i>				<i>21,659</i>	<i>24,266</i>	<i>28,671</i>	<i>27,753</i>	<i>29,012</i>	<i>28,140</i>

Table 4.10
ANNUAL COLLECTIVE DOSE
BY OCCUPATION AND PERSONNEL TYPE

1984



OCCUPATION	STATION EMPLOYEES PERSON-REM % OF TOTAL	UTILITY EMPLOYEES PERSON-REM % OF TOTAL	CONTRACT WORKERS & OTHERS PERSON-REM % OF TOTAL	TOTAL PER. FUNCTION PERSON-REM % OF TOTAL
<u>BOILING WATER REACTORS</u>				
MAINTENANCE	3218.862	2641.490	13536.407	19396.759
OPERATIONS	1504.276	10.630	368.562	1883.468
HEALTH PHYSICS	714.376	11.882	1387.125	2113.383
SUPERVISORY	373.535	135.557	867.998	1377.090
ENGINEERING	303.884	166.376	1042.171	1512.431
TOTALS	6114.933	2965.935	17202.263	26283.131
<u>* PRESSURIZED WATER REACTORS</u>				
MAINTENANCE	3809.596	2200.794	12475.201	18485.591
OPERATIONS	1552.086	15.535	182.413	1750.034
HEALTH PHYSICS	1135.637	26.570	2654.018	3816.225
SUPERVISORY	459.872	80.809	291.019	831.700
ENGINEERING	474.765	245.255	1774.964	2494.984
TOTALS	7431.956	2568.963	17377.615	27378.534
<u>* ALL LIGHT WATER REACTORS</u>				
MAINTENANCE	7028.458	4842.284	26011.608	37882.350
OPERATIONS	3056.362	26.165	550.975	3633.502
HEALTH PHYSICS	1850.013	38.452	4041.143	5929.608
SUPERVISORY	833.407	216.366	1159.017	2208.790
ENGINEERING	778.649	411.631	2817.135	4007.415
TOTALS	13546.889	5534.898	34579.878	53661.665

* Table does not include results from the PMRs at Point Beach (737 person-rem) because of formatting problems.

493 7626

Figure 4.5

COLLECTIVE DOSE BY WORK FUNCTION AND PERSONNEL TYPE
AT BWRs and PWRs, 1979-1984

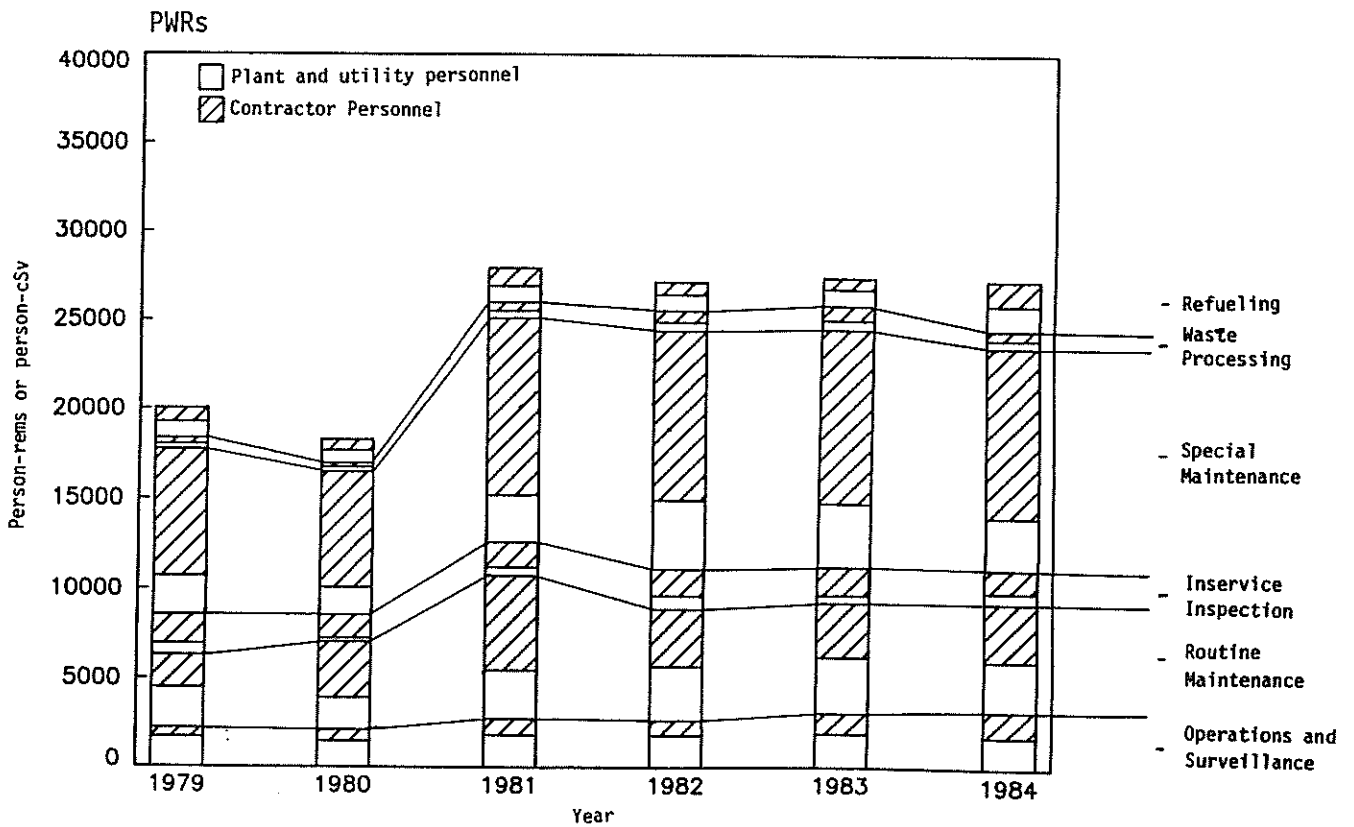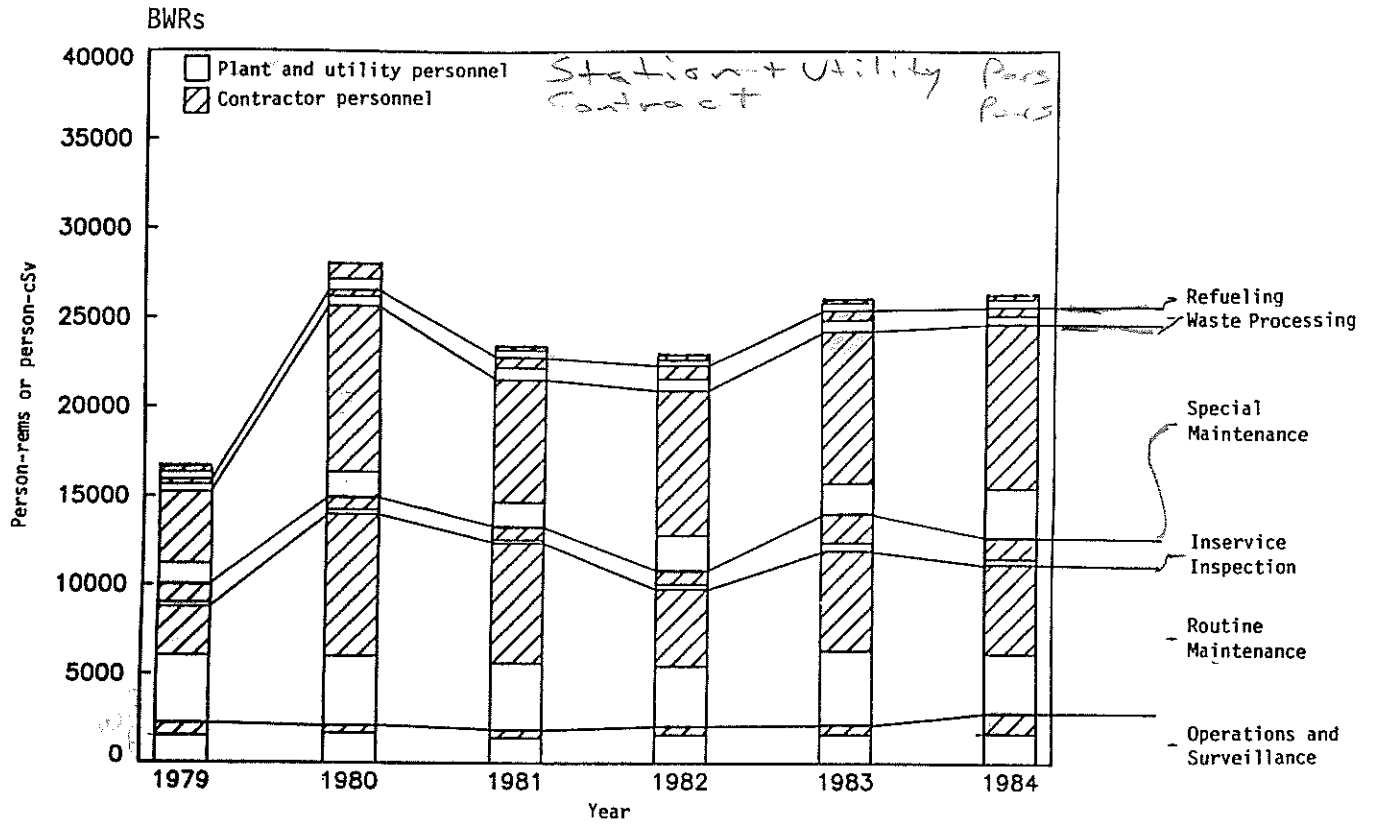

66.36%
100

Table 4.10 presents the distribution of the collective dose for 1984 at all LWRs among five occupations. As expected, maintenance personnel incurred the majority (70.6%) of the collective dose with contractor maintenance personnel receiving about twice as much as the station and utility maintenance employees combined. This is about the same as that reported for 1983. Supervisory personnel received 4.1% of the dose, compared to 2.7% in 1983, while workers in the remaining three occupations--operations, health physics, and engineering--received 6.8%, 11.0%, and 7.5%, respectively, of the collective dose. None of these values changed very much from those found for 1983, either. The collective doses shown in Tables 4.8 and 4.10 do not equal those shown in other tables in the report because they are the sum of the doses taken from the type of annual reports shown in Appendix D rather than the collective dose that was obtained or calculated from the § 20.407 annual reports.

Another use made of the reports given in Appendix D is in proportioning the collective dose obtained from the § 20.407 annual reports into the work functions and personnel types shown in Appendix C. This was done in the following way:

- (1) The collective dose incurred by workers in the work function "Reactor Operations and Surveillance" on each plant's annual report submitted pursuant to their technical specifications (the first number in the last column in Appendix D) was determined.
- (2) The ratio of this dose to the total collective dose (the last number in the last column in Appendix D) was calculated and multiplied by the total collective dose that had been estimated or obtained from the § 20.407 annual report. This product is the collective dose shown in the column headed "Operations" in Appendix C.
- (3) The collective dose shown in the column headed "Maintenance and Others" in Appendix C was determined by first summing the collective doses incurred by workers in the five remaining functions given in Appendix D and then calculating the fraction that this dose is of the total collective dose. This fraction was multiplied by the total collective dose estimated from the § 20.407 annual reports to yield the collective dose shown in this column of Appendix C.
- (4) A similar procedure was followed in determining the collective dose for the columns headed "Contractor" and "Station & Utility" in Appendix C.

4.7 Health Implications of Average Annual Doses

If any damage to health is caused by exposure to radiation in the workplace, it would likely manifest itself as certain types of cancer in the exposed worker or, less likely, as inherited genetic damage in the first few generations of the workers' offspring. However, the likelihood of cancer or genetic damage occurring as a result of radiation exposure experienced by workers in the nuclear industry is small. A vast amount of scientific information is available from which estimates of these risks can be made. Much of this information, however, has been obtained from epidemiologic studies of human populations at levels of exposure considerably higher than those normally experienced in the workplace. Complementary to this, information obtained from many animal and cell biology

studies have greatly enhanced our knowledge and understanding of the biological effects of ionizing radiation. Although using this information to estimate risks in the workplace introduces uncertainties, these uncertainties can be dealt with in such a manner that the risk is not likely to be underestimated. Thus, the discussion below is likely to overstate the health implications rather than understate them.

474
500
Cancer induction as a result of radiation exposure has been examined by many organizations having scientific and medical expertise in the subject. One of these, the National Academy of Sciences (NAS), published a comprehensive review of the biological effects of ionizing radiation in 1980 [Ref. 16]. Based on this report, a large working population receiving one million person-rem (person-cSv) might suffer an estimated 100 to 200 additional cancer deaths over the remaining years of their lives. This risk estimate can be applied to the 59,400 person-rem (person-cSv) (Table 3.1) and the 108,500 workers who received measurable exposures in 1984.5. The result is that for these workers the expected number of additional cancer deaths that might result from radiation dose received that year would be about twelve. These deaths would occur many years following the exposure and would be in addition to the approximately 20,000 cancer deaths that occur normally in a population of 108,500 workers without exposure to this amount of radiation. Perhaps more meaningful to the individual workers are the health implications to the workers receiving the average dose of 0.55 rem (cSv) or the maximum dose of eight or nine rem (cSv) during 1984.5. The estimated increased cancer death risk is about one chance in 10,000 for the average dose and about one chance in 1,000 for the maximum dose. Should a worker receive 0.55 rem (cSv) per year continuously during his entire working career (working from age 20 until age 65) his risk of dying from cancer could increase by less than 2% over the normal risk of dying of cancer. These risks can be compared to the American Cancer Society's estimates of one chance in four of developing cancer and one chance in five of dying of cancer.

no change
350,000
474
475
The potential genetic effects from a worker population receiving about 59,400 person-rem (person-cSv) is very small compared to genetic damages that normally occur spontaneously in a population of this size. Approximately 100,000 serious genetic defects occur normally in one million live births, i.e., an average of about one serious defect in every ten live births. Theoretically, the total genetic damage in the first generation children of the 108,500 exposed* workers would, according to the 1980 NAS report, be an increase of four or less cases (less than 0.05%) compared to the expected 10,000 cases that occur normally. No significant increase in the number of genetic defects has been observed in the children of individuals exposed to ionizing radiation at Hiroshima and Nagasaki, Japan.

*Assuming that, on the average, each exposed person will have one child in the future, i.e., 108,500 children born to this worker population.
110,703

5 TERMINATION DATA SUBMITTED PURSUANT TO 10 CFR § 20.408

5.1 Termination Reports, 1969-1984

In 1969, the Atomic Energy Commission (predecessor of the NRC) began requiring certain categories of licensees* to submit personal identification and exposure information upon the termination of each monitored person's employment or work assignment in the licensee's facility. The appropriate information on each report has been manually coded and entered into the Commission's computerized Radiation Exposure Information Reporting System (REIRS) for permanent retention. The data are retrievable by several criteria - social security number, name, facility, etc. - which allows statistical analysis of the data as well as the tracing of individual dose histories. During the years that this information has been collected, some 1,500,000 termination records have been received for approximately 350,000 individuals who have been reported as having terminated their employment at facilities in one or more of the categories of covered licensees. The figures given for the number of reports and the number of individuals are different because numerous individuals have been terminated more than once over the years and because some individuals may have had external doses reported for more than one part of the body, as well as estimates of internal depositions of radioactive material, each of which is counted as one record. Table 5.1 provides a breakdown of this information for individuals terminating during each of 16 years and, since the majority of termination reports are now submitted by nuclear power facilities, the number of records and individuals that they reported are displayed separately. One can see that the number of records continues to increase each year, primarily because of the growing need for workers at power reactors.

5.2 Limitations of Termination Data

When examining or using the statistics that are based on the termination data, one should keep in mind that these data have various limitations: (1) some licensees submit a termination report for each monitored contractor employee at the end of each monitoring period rather than waiting until the individual actually completes his work assignment at the facility, (2) the period(s) of exposure that are reported for terminating individuals may indicate the monitoring period during which he may have been exposed to radiation rather than the actual dates of exposure, (3) some licensees report cumulative periods of exposure and doses rather than the actual periods and dose incurred during each period, and (4) licensees having more than one licensed facility sometimes include in the termination report submitted when the individual leaves the second facility the dose that he incurred at the first facility, which may already have been reported. Although attempts have been made to correct for some of these problems, they are still a small additional source of error in any statistics developed from the termination data.

*Commercial nuclear power reactors; industrial radiographers; fuel processors, fabricators, and reprocessors; and manufacturers and distributors of specified quantities of byproduct material. Three other types of NRC licensees are now required to submit reports pursuant to 10 CFR §§ 20.407 and 20.408: geologic repositories for high-level radioactive waste; receivers of radioactive waste from other persons for land disposal; and independent installations for the storage of spent fuel.

Table 5.1

TERMINATION REPORTS SUBMITTED TO THE NRC

1969-1984**

YEAR	All Covered Categories*		Power Reactor Licensees	
	Number of Termination Records	Number of Terminating Individuals	Number of Termination Records	Number of Terminating Individuals
1969	5,009	3,992	790	727
1970	8,606	6,069	2,126	1,908
1971	12,955	8,874	2,246	2,197
1972	15,685	10,353	4,997	3,888
1973	19,985	15,588	11,525	9,071
1974	30,389	21,499	16,946	11,603
1975	44,676	27,415	38,376	22,627
1976	70,230	40,079	63,593	35,294
1977	88,295	42,183	81,074	36,864
1978	96,010	44,541	85,308	37,359
1979	133,470	58,913	118,218	48,305
1980	175,408	73,662	162,515	65,092
1981	189,762	72,603	181,327	67,482
1982	177,610	65,347	171,836	62,101
1983**	196,731	69,647	190,957	67,098
1984**	231,317	67,408	228,983	66,360

*Commercial nuclear power reactors; industrial radiographers; fuel processors, fabricators, and reprocessors; manufacturers and distributors of specified quantities of byproduct materials; low-level waste disposal facilities; independent spent fuel storage installations; and geologic high-level waste repositories.

**The termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR System.

5.3 Transient Workers per Calendar Quarter

One use of the information contained in the termination reports is the examination of the doses being received by short-term workers. Since nearly half of the termination reports indicated periods of exposure that were less than 90 days, it is possible that several thousand individuals could have been employed by two or more licensees during the same calendar quarter. Thus, in this report, a "quarterly transient" worker is defined to be an individual who began and terminated employment at two or more different licensed facilities within one calendar quarter. This allows one to examine the doses of those workers most likely to approach the quarterly limits without their employer's knowledge since they move so rapidly among facilities.

Table 5.2 displays some of the information gathered from these termination reports that were submitted by all covered licensees and by licensed nuclear power facilities, separately. One can quickly see that the vast majority of these individuals are monitored by nuclear power facilities. The number of these individuals increased about twentyfold during the five years 1972 through 1976, but has remained between 2,350 and 2,550 since 1981. The top part of Table 5.2 also shows that the average individual dose (which is close to being a quarterly dose for these workers) continues to decrease, dropping to an average dose of 0.26 rem (cSv) in 1984.

The bottom half of the table separates the information shown for power reactor licensees into that for reactor workers employed by two, three, and four or more different reactor ~~licensees~~. The table shows that most of these transients were reported by two different licensees during a quarter. The smaller number of workers terminated by three or more licensees received higher average doses than those terminated by two employers every year until 1982. From that year onward, the average dose of workers terminated from three or more facilities has been about the same or less than the average dose of the workers terminating from two nuclear power licensees.

Examination of these records also revealed that some individuals have worked for as many as six different NRC licensees during one calendar quarter. However, on the average, less than two instances per year have been found in which a worker exceeded his quarterly limit of three rems (cSv) as a result of his working at two or more different licensed facilities within one calendar quarter. In a few of these instances, the doses that the workers had received while employed by the first utility were revised upward later in the year. The underestimates resulted in quarterly doses that slightly exceeded three rems (cSv). A very few quarterly exposures exceeding three rems (cSv) may have gone undetected because a worker's dose was received over a period spanning a calendar quarter and was reported for the entire period. When this happens, it is not possible to determine the portion of the dose received during each quarter.

5.4 Transient Workers per Calendar Year

Since the number of transient workers per calendar quarter comprise only a small percentage of the total number of individuals terminating each year, it was decided to change the criteria so that the records of more workers would be examined. This was done by selecting the records of all individuals who began and terminated two or more periods of employment with at least two different reactor facilities within one calendar year and summing each worker's whole body doses. An examination of these data would allow one to determine the number and average dose for these "annual transients." Since more than 95% of these transients are reported by nuclear power facilities, only the termination records of these individuals were examined in detail. Table 5.3 summarizes the number and doses of the transients found among the individuals terminating during the eight years from 1977 through 1984. The number of these workers increased from about 3,200 workers in 1977 to about 6,000 in 1984. However, after reaching a high of about 6,000 person-rems (person-cSv) in 1980, the collective dose incurred by these workers decreased to about 5,500 person-rems (person-cSv) in 1984. The average dose also decreased somewhat in 1984 to a value of 0.91 rem (cSv).

Table 5.2

TRANSIENT WORKERS PER CALENDAR QUARTER
1973-1984

All Covered Licensees				Power Reactor Facilities			
Year	No. of Persons Terminated by Two or more Licensees Within One Quarter	Collective Dose (person-rems or person-cSv)	Average Individual Dose (rem or cSv)	Year	No. of Persons Terminated by Two or more Licensees Within One Quarter	Collective Dose (person-rems or person-cSv)	Average Individual Dose (rem or cSv)
1973	157	138	0.88	1973	146	123	0.84
1974	332	170	0.51	1974	285	158	0.55
1975	709	508	0.72	1975	684	493	0.72
1976	1,299	904	0.70	1976	1,257	889	0.71
1977	1,481	870	0.59	1977	1,437	851	0.59
1978	1,570	720	0.46	1978	1,500	680	0.45
1979	1,809	836	0.46	1979	1,754	802	0.46
1980	2,355	1,063	0.45	1980	2,218	1,033	0.47
1981	2,344	955	0.41	1981	2,335	952	0.41
1982	2,325	900	0.39	1982	2,294	879	0.38
1983*	2,437	776	0.32	1983*	2,401	755	0.31
1984*	2,544	674	0.26	1984*	2,519	654	0.26

Power Reactor Facilities				Power Reactor Facilities			
Year	No. of Workers Terminated by Two Licensees	Collective Dose	Average Dose	No. of Workers Terminated by Three Licensees	Collective Dose	Average Dose	No. of Workers Terminated by >Three Licensees
1973	133	108	0.81	11	13	1.18	2
1974	255	132	0.52	28	24	0.86	2
1975	609	427	0.70	70	62	0.89	5
1976	1,095	720	0.66	145	146	1.01	17
1977	1,271	718	0.56	147	115	0.78	17
1978	1,303	590	0.45	165	75	0.45	32
1979	1,527	647	0.43	178	130	0.73	49
1980	1,896	856	0.45	259	140	0.54	63
1981	1,967	780	0.40	308	145	0.47	60
1982	1,960	761	0.39	276	106	0.38	58
1983*	2,032	663	0.32	290	76	0.26	79
1984*	2,136	542	0.25	286	79	0.27	97

*Figures for these years may be incomplete because the termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR System.

Table 5.3
TRANSIENT WORKERS PER CALENDAR YEAR AT NUCLEAR POWER FACILITIES
1977-1984

Year	No. of Commercial Reactors	No. of Workers Terminated by Two or More Licensees	Collective Dose		Average Dose (rems or cSv)
			(person-rems or person-cSv)	Average Dose	
1977	57	3,161	3,776	1.19	
1978	64	3,202	3,231	1.01	
1979	68	3,938	3,891	0.99	
1980	69	5,463	6,028	1.10	
1981	71	5,425	5,381	0.99	
1982	75	5,303	5,610	1.06	
1983*	76	5,672	5,935	1.05	
1984*	79	6,024	5,489	0.91	

Year	No. of Workers Terminated by Two Licensees	Collective Dose	Average Dose	No. of Workers Terminated by Three Licensees	Collective Dose		Average Dose	
					(person-rems or person-cSv)	Average Dose		
1977	2,166	1,987	0.92	572	842	1.47	423	2.24
1978	2,119	1,490	0.70	621	792	1.28	462	2.05
1979	2,761	2,097	0.76	688	805	1.17	489	2.02
1980	3,772	3,444	0.91	959	1,245	1.30	732	1.83
1981	3,745	3,033	0.81	924	1,172	1.27	756	1.56
1982	3,645	3,349	0.92	913	1,131	1.24	745	1.52
1983*	3,882	3,350	0.86	1,092	1,522	1.39	698	1.52
1984*	4,219	3,350	0.81	1,066	1,236	1.16	739	1.16

*Figures for these years may be incomplete because the termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR system.

The lower portion of Table 5.3 shows the number and doses of workers who were terminated by two, three, and four or more different licensees during each calendar year. In 1984 there were sharp decreases in the collective and average doses of workers terminated by more than two facilities. This is probably due to the utilities' increased efforts to keep the annual doses of all workers less than five rems (cSv). This is further borne out by the fact that, as shown in Table 5.4a, the distribution of the doses of these transient workers was such that there were only 11 workers with doses greater than five rems (cSv) in 1984. Table 5.4a shows that in prior years, there were usually between 50 and 100 transient workers with annual doses greater than five rems (cSv).

Another way in which the distribution of the doses received by transient workers can be useful is in the determination of the impact that the inclusion of these individuals in each of two or more licensee's annual reports had on the annual summary (Table 4.4) for all nuclear power facilities (one of the problems mentioned in Section 2). Table 5.4a shows the actual distribution of these transient workers' doses as determined from the above-described termination reports and compares it with the distribution of the doses of these workers as they would have appeared in a compilation of the annual statistical reports submitted by each of the nuclear power facilities. During each of the years shown, each of the transient workers was counted an average of 2.6 times. This was not surprising because some individuals were reported by as many as nine different facilities.

Table 5.4b illustrates the impact that the multiple reporting of these transient workers had on the staff's compilations of the annual statistical reports for the years 1978 through 1984. Since each nuclear power facility reports the distribution of the doses received by workers while monitored by the particular facility during the year, one would expect that a summation of these reports would result in individuals being counted several times in dose ranges lower than the range in which their total accumulated dose (the sum of the personnel monitoring results incurred at each facility during the year) would actually place them. Thus, while the total collective dose would remain the same, the number of workers, their dose distribution, and average dose would be affected by this multiple reporting. This was found to be true because too few workers were reported in the higher dose ranges. For example, in 1983 the compiled annual reports indicated that 85,694 workers received a measurable dose, 85 of whom received doses greater than five rems (cSv). After accounting for those individuals that were reported more than once, the adjusted distribution indicated that there were only 80,552 workers that received a measurable dose and that 163 of them received doses greater than five rems (cSv). This resulted in an average measurable dose of 0.70 rem (cSv) rather than the 0.66 rem (cSv) obtained from the compiled reports.

Since the number of transient workers receiving measurable doses is only about 5% of the total number of workers receiving measurable doses during the year, their impact on most of the statistics derived from compilations of the annual summary reports is not very great. However, when examining the number of annual doses exceeding five rems, one finds that the adjusted statistical distribution indicates that the number of workers who received doses greater than five rems (cSv) was between 50 and 80 more than the number found in the compiled statistical distribution each year until 1984. This is more clearly shown in Table 5.5, where it can also be seen that in 1984 the number of workers receiving doses greater than five rems (cSv) was found to be 11 workers. Most of this reduction

Table 5.4 a

ACTUAL AND COMPILED DOSE DISTRIBUTIONS OF TRANSIENT WORKERS PER CALENDAR YEAR AT POWER REACTORS

Type of Distribution and Year	Less than Measurable	Meas'ble <0.10	Number of Individuals with Whole Body Doses in the Ranges (rems or cSv)																Total Individuals	Collective Dose (Person-rems or cSv)	Avg. Dose (rem or cSv)	Avg. Measurable Dose (rem or cSv)
			0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.00	1.00-2.00	2.00-3.00	3.00-4.00	4.00-5.00	5.00-6.00	6.00-7.00	7.00-8.00	8.00-9.00	9.00-10.00	>10						
			0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.00	1.00-2.00	2.00-3.00	3.00-4.00	4.00-5.00	5.00-6.00	6.00-7.00	7.00-8.00	8.00-9.00	9.00-10.00	>10						
Actual Distribution of Transients - 1978	308	885	317	282	177	131	463	307	168	107	42	13	1	0	1				3,202	b ₃ ,231	1.01	1.12
Compiled Distribution of Transients - 1978	2,079	2,423	918	788	488	382	873	262	51	11	0	2							8,277	b ₃ ,231	0.39	0.52
Actual Distribution of Transients - 1979	373	883	398	358	281	240	678	410	195	71	32	14	4	1					3,938	b ₃ ,888	0.99	1.09
Compiled Distribution of Transients - 1979	2,130	2,676	1,259	1,048	673	460	1,040	313	46	13	1								9,649	b ₃ ,888	0.40	0.52
Actual Distribution of Transients - 1980	533	1,175	565	482	388	277	829	595	353	174	47	25	15	4	1				5,463	b ₆ ,028	1.10	1.22
Compiled Distribution of Transients - 1980	3,207	3,910	1,639	1,398	900	661	1,632	503	74	29	4	4	4						13,955	b ₆ ,028	0.43	0.56
Actual Distribution of Transients - 1981	562	1,271	482	422	380	310	954	614	275	107	30	17	0	1					5,425	b ₅ ,381	0.99	1.08
Compiled Distribution of Transients - 1981	3,640	3,767	1,473	1,418	963	716	1,550	349	69	8	1	1							13,955	b ₅ ,381	0.39	0.52
Actual Distribution of Transients - 1982	623	1,226	452	397	332	286	867	536	339	184	42	18	1	0	0	1			5,303	b ₅ ,610	1.06	1.20
Compiled Distribution of Transients - 1982	3,803	3,480	1,432	1,308	842	661	1,502	506	87	20	1								13,642	b ₅ ,610	0.41	0.57
Actual Distribution of Transients - 1983	838	1,306	441	410	318	298	864	565	381	166	56	23	4	2					5,672	b ₅ ,935	1.05	1.16
Compiled Distribution of Transients - 1983	4,372	3,654	1,311	1,219	839	662	1,593	584	94	13	5	2							14,348	b ₅ ,935	0.41	0.59
Actual Distribution of Transients - 1984	998	1,462	444	419	341	297	928	662	380	92	9	2							6,024	b ₅ ,489	0.91	1.09
Compiled Distribution of Transients - 1984	5,043	3,909	1,367	1,268	883	696	1,575	447	58	7	0								15,253	b ₅ ,489	0.36	0.54

^aIncludes data from Fort St. Vrain.

^bCollective dose found by summing the actual doses reported for those workers on their termination reports.

^cDistribution found by subtracting the actual from the compiled distribution shown in Table 5.4a and then subtracting this difference from the compiled statistical distribution shown in Table 5.4t

Table 5.4b
EFFECTS OF TRANSIENT WORKERS ON ANNUAL STATISTICAL COMPILATIONS

Type of Distribution and Year	Number of Individuals with Whole Body Doses in the Ranges (rems or cSv)																	Total Individuals	Collective Dose (person-rems or cSv)	Avg. Dose (rem or cSv)	Avg. Measurable Dose (rem or cSv)
	Less than Measurable	Meas'ble <0.10	0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.00	1.00-2.00	2.00-3.00	3.00-4.00	4.00-5.00	5.00-6.00	6.00-7.00	7.00-8.00	8.00-9.00	9.00-10.00	>10					
^a Compiled Statistical Distribution - 1978	31,039	16,673	6,943	5,504	3,399	2,498	6,405	2,989	1,080	418	67	26	8	0	0	2	77,051	31,806	0.41	0.69	
^c Adjusted Statistical Distribution - 1978	29,268	15,135	6,342	4,998	3,088	2,247	5,995	3,034	1,197	514	109	37	9	0	1	2	71,976	31,668	0.45	0.74	
^a Compiled Statistical Distribution - 1979	42,340	24,632	9,883	8,090	5,147	3,426	7,898	3,306	1,255	477	86	28	13	2	0	1	106,584	39,987	0.38	0.62	
^c Adjusted Statistical Distribution - 1979	40,583	22,831	9,022	7,400	4,755	3,206	7,536	3,403	1,404	545	117	42	17	3	0	1	100,865	39,525	0.39	0.66	
^a Compiled Statistical Distribution - 1980	47,377	29,695	11,751	9,820	6,082	4,518	11,474	4,515	1,537	686	192	98	18	3			128,668	53,799	0.42	0.67	
^c Adjusted Statistical Distribution - 1980	44,703	26,960	10,677	8,904	5,570	4,134	10,671	4,607	1,816	831	235	119	29	7	1		120,166	53,626	0.45	0.72	
^a Compiled Statistical Distribution - 1981	42,323	29,332	12,217	10,326	6,625	4,903	11,766	4,546	1,763	486	93	81	11	2	1	1	124,506	54,152	0.43	0.66	
^c Adjusted Statistical Distribution - 1981	39,245	25,836	11,226	9,330	6,042	4,497	11,170	4,811	1,969	585	122	91	11	3	1	1	115,946	54,142	0.47	0.71	
^a Compiled Statistical Distribution - 1982	45,871	31,502	12,693	10,814	6,739	4,795	10,855	4,686	1,814	432	56	13	4	0	1		130,275	52,191	0.40	0.62	
^c Adjusted Statistical Distribution - 1982	42,691	29,248	11,713	9,903	6,229	4,420	10,220	4,716	2,066	596	97	31	5	0	1	1	121,937	52,191	0.43	0.66	
^a Compiled Statistical Distribution - 1983	52,036	31,948	12,211	10,296	6,470	4,708	12,171	5,311	1,950	544	65	16	4				137,730	56,472	0.41	0.66	
^c Adjusted Statistical Distribution - 1983	48,502	29,600	11,341	9,487	5,949	4,344	11,442	5,292	2,237	697	116	37	8	2			129,054	56,472	0.44	0.70	
^a Compiled Statistical Distribution - 1984	59,616	39,884	14,764	11,492	7,166	5,396	12,453	4,976	1,675	295							157,708	55,214	0.35	0.56	
^c Adjusted Statistical Distribution - 1984	55,561	37,437	13,841	10,643	6,624	4,997	11,806	5,182	1,997	380	9	2					148,479	55,214	0.37	0.59	

^aIncludes data from Fort St. Vrain.

^bCollective dose found by summing the actual doses reported for those workers on their termination reports.

^cDistribution found by subtracting the actual from the compiled distribution shown in Table 5.4a and then subtracting this difference from the compiled statistical distribution shown in Table 5.4b.

is probably due to the fact, as stated in the footnote, that not all of the 1984 termination reports had yet been processed. After discussions with several firms that provided contract personnel to work at nuclear power facilities during 1984, it was determined that 110 would be a more realistic estimate of the number of workers with annual doses greater than five rems.

Table 5.5

ANNUAL WHOLE BODY DOSES EXCEEDING FIVE REMS (cSv)

Year	Compiled Number >5 Rems (cSv)	Adjusted Number >5 Rems (cSv)	Percent of Workers
1977	270	351	0.9
1978	103	158	0.4
1979	130	180	0.3
1980	311	391	0.5
1981	189	235	0.3
1982	74	135	0.2
1983*	85	163	0.2
1984*	0	11(110)**	<0.1(0.1)**

*Figures for these years may be incomplete because the termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR system.

**Estimate based on discussions with firms providing contract personnel.

5.5 Temporary Workers per Calendar Year

To complete the examination of the doses received by the short-term workers employed at nuclear power facilities, Table 5.6 summarizes the data compiled on "temporary workers". For purposes of this report, temporary workers were defined to be those individuals who began and ended their employment at only one nuclear power facility during the calendar year. Table 5.6 shows that the number of these temporary individuals has increased by some 64% between 1977 and 1984 while the number of reactors has increased by about 40% during this time. The number of temporary workers receiving a measurable dose, however, has increased by only 27%. The average dose per monitored individual remains at about 0.30 rem (cSv) and, since about half of them received less than measurable doses, the average measurable dose remains at about 0.60 rem (cSv). Comparison of these figures with those in Table 5.4b reveals that these workers comprised 28% of the total number of workers (92,918) receiving a measurable dose in 1984, while their collective dose was only 26% of the total collective dose. Their average measurable dose was also slightly less than the overall average of 0.59 rem (cSv).

Table 5.6

TEMPORARY WORKERS PER CALENDAR YEAR
(Individuals Terminated by Only One Employer)

Year	No. of Reactors	Number of Temps. Monitored	Number with Measurable Doses	Collective Dose (person-rem or person-cSv)	Average Dose (rem or cSv)	Average Measurable Dose (rem or cSv)
1977	57	29,090	19,094	11,373	0.39	0.60
1978	64	28,864	17,110	9,821	0.34	0.57
1979	68	38,347	21,491	9,488	0.25	0.44
1980	69	48,383	28,305	16,168	0.33	0.57
1981	71	48,265	28,675	16,755	0.35	0.58
1982	75	44,503	25,646	14,266	0.32	0.56
1983*	76	47,428	24,144	14,902	0.31	0.62
1984*	79	47,622	26,188	14,653	0.31	0.56

*Figures for these years may be incomplete because the termination data for about 15% of the individuals terminating during 1983 or 1984 have not been entered into the REIR System.

no do not add to text
5.6 Dose Distribution by Sex

In 1980 the sex of terminating individuals was first entered into the REIR System, along with the usual identification and dose data that have always been entered. Since the sex of the individual is not normally indicated on the termination reports, the sex was determined by examining the first name or salutation of each individual for whom either one was shown. The REIR System now contains the sex of about 65% of the individuals terminating since 1980.


Table 5.7 summarizes the results of several analyses of the termination data submitted for individuals for whom the sex had been entered in the REIR System. Females comprise between 5% and 8% of the total number of the annual transients (individuals beginning and ending one or more periods of employment during the year). Table 5.7 also shows that the collective dose incurred by these females is only about 1.3% of the total collective dose incurred by the total number of annual transients. Consequently, the average measurable dose for female workers was found to be 0.26 rem (cSv) while it was 0.73 rem (cSv) for the male workers terminating in 1983. Figure 5.1 shows the distribution of doses of these workers, and one can quickly see that some 90% of the females received doses that were less than 0.10 rem (cSv); only 65% of the males received such doses. There were no females in this population that received a dose greater than five rems (cSv), but there were about 100 male workers that received doses between five and nine rems (cSv) in 1983, the last year for which this analysis was done.

Table 5.7

SEX VS DOSE PROFILES OF TERMINATED INDIVIDUALS

	1980		1981		1982		1983	
	Females	Males	Females	Males	Females	Males	Females	Males
Number of individuals monitored	3,901	42,844	2,930	40,462	2,281	39,065	3,207	42,106
Percentage of total monitored	8.3%	91.7%	6.6%	93.4%	5.5%	94.5%	7.1%	92.9%
Percentage of workers with measurable doses	3.6%	96.4%	3.8%	96.2%	2.2%	97.8%	3.6%	96.4%
Percentage of total collective dose	1.0%	99.0%	1.1%	98.9%	1.2%	98.8%	1.3%	98.7%
Average individual dose (rems or cSv)	0.05	0.46	0.07	0.46	0.08	0.41	0.07	0.42
Average measurable dose (rems or cSv)	0.19	0.70	0.20	0.69	0.21	0.67	0.26	0.73
Highest annual dose (rems or cSv)	4-5	8-9	3-4	8-9	2-3	6-7	4-5	8-9

Figure 5.1
 Dose Distribution of Males and Females Terminating from LWRs
 1983

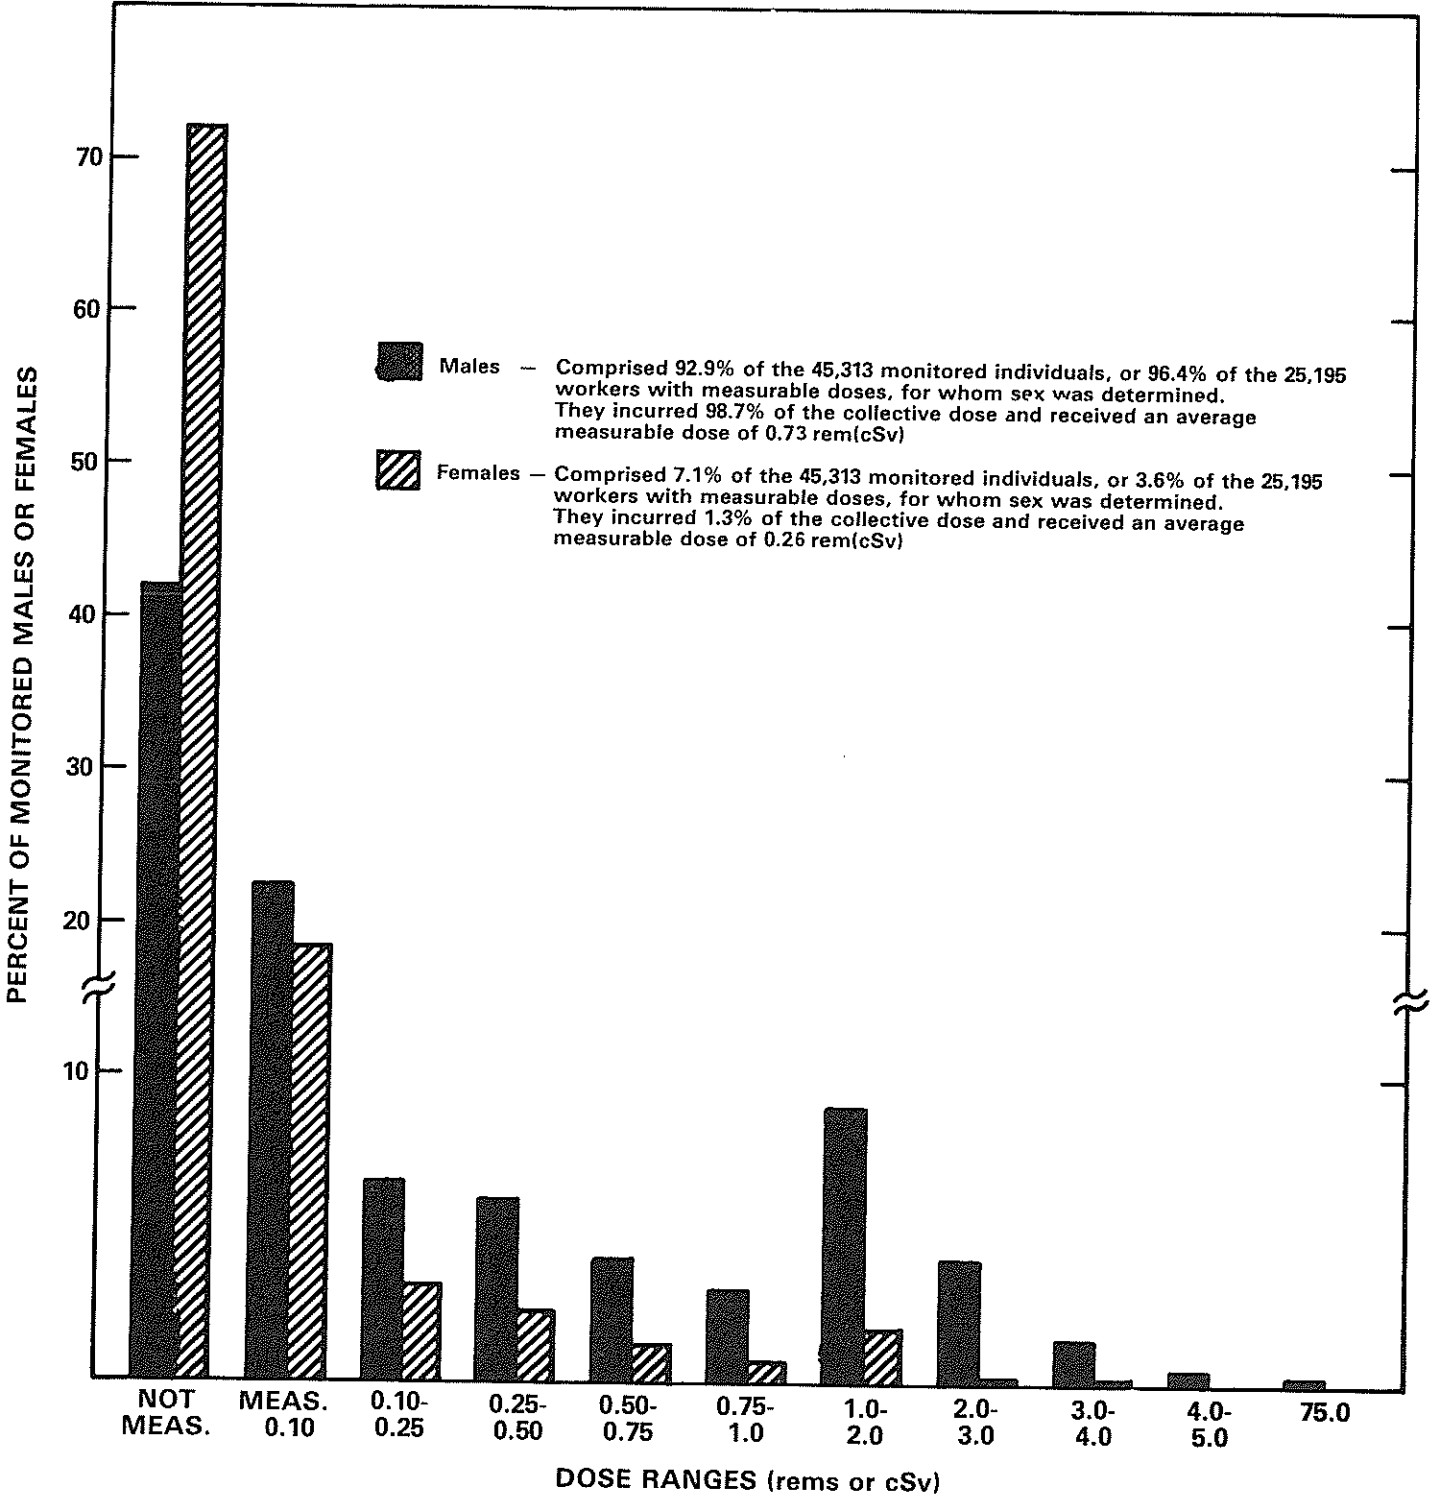

me add

5.7 Age Distribution

Since the REIR System contains birth dates for about 60% of the approximately 300,000 individuals that have terminated from nuclear power facilities since 1969, it is possible to examine the age distribution of these terminated workers. Table 5.8 shows the percentage of these individuals in each of twelve age groups, ranging from 20 years old to 79 years old as of the year 1985. There is a small portion of the workers less than 25 or older than 65 with the vast majority (63.8%) being between 25 and 45 years of age.

Table 5.8

AGE DISTRIBUTION OF TERMINATED REACTOR WORKERS
AS OF 1985

Age Range (Years)	Percent in Range
20-24	2.0
25-29	12.4
30-34	18.1
35-39	19.1
40-44	14.1
45-49	10.0
50-54	7.8
55-59	6.7
60-64	5.3
65-69	3.1
70-74	1.2
75-79	0.2
≥ 80	0.1

all ready added to report

6 PERSONNEL OVEREXPOSURES - 10 CFR § 20.403 and 10 CFR § 20.405

6.1 Control Levels

One requirement of the above-referenced sections of Part 20, Title 10, Chapter I, Code of Federal Regulations, is that all persons licensed by the NRC must submit reports of all occurrences involving personnel radiation exposures that exceed certain control levels, thus providing for investigations and corrective actions as necessary. The term "overexposure" is not necessarily intended to indicate that a worker has been subjected to an unacceptable biological risk. Based on the magnitude of the exposure, the occurrence may be placed into one of three categories:

4 (1) Category A

10 CFR § 20.403(1) - Exposure of the whole body of any individual to 25 rems (cSv) or more; exposure to the skin of the whole body of any individual to 150 rems (cSv) or more; or exposure of the extremities (feet, ankles, hands or forearms) of any individual to 375 rems (cSv) or more. The Commission must be notified immediately of these events.

(2) Category B

10 CFR § 20.403(b) - Exposure of the whole body of any individual to 5 rems (cSv) or more; exposure of the skin of the whole body of any individual to 30 rems (cSv) or more; or exposure of the extremities to 75 rems (cSv) or more. The Commission must be notified within 24 hours of these events.

(3) Category C

10 CFR § 20.405 - Exposure of an individual to radiation or concentrations of radioactive material that exceeds any applicable quarterly limit in Part 20 or in the licensee's license but is less than the values given above. This includes reports of whole body exposures that exceed 1.25 rems (cSv), or that exceed 3 rems (cSv), as discussed in Section 3.2. Reports of skin exposures that exceed 7.5 rems (cSv) and extremity exposures that exceed 18.75 rems (cSv) are included, and reports of exposures of individuals to concentrations in excess of the levels given in 10 CFR § 20.103 and Appendix B usually fall into this category as well. These reports must be submitted to the Commission within 30 days of the occurrence.

6.2 Summary of Overexposures

Table 6.1 summarizes all the occupational overexposures to external sources of radiation as reported by Commission licensees pursuant to § 20.403 and § 20.405 during the years 1977 through 1984. For 1982, 1983, and 1984, it shows the number of individuals that exceeded various limits while employed by one of several types of licensees. For the years 1977 through 1981, only the overexposures reported by licensed industrial radiography firms are shown separately. Most of the occurrences included in the "Others" category come from research

Table 6.1
PERSONNEL OVEREXPOSURES TO EXTERNAL RADIATION
1977-1984

Year	License Category	Persons and Doses (rems or cSv)	Types of Overexposures and Doses								
			Whole Body (rems or cSv)			Skin (rems or cSv)			Extremity (rems or cSv)		
			<5.00	≥5 <25	≥25	>7.5<30	≥30<150	≥150	>18.75<75	≥75<375	>375
1984	Industrial Radiography	No. of Persons Sum of Doses	3 12.5	1 8.2					3 127.9		
	Power Reactors	No. of Persons Sum of Doses	3 7.6								
	Medical Facilities	No. of Persons Sum of Doses	2 5.7	1 5.2					1 18.8		
	Marketing & Manufact.	No. of Persons Sum of Doses							1 21.8		
	Others	No. of Persons Sum of Doses	1 1.7						3 70.1		
1983	Industrial Radiography	No. of Persons Sum of Doses	1 4.7								1 650
	Power Reactors	No. of Persons Sum of Doses	8 14.9								
	Medical Facilities	No. of Persons Sum of Doses	3 5.2								
	Marketing & Manufact.	No. of Persons Sum of Doses		1 ^a 25					2 49.5		
	Others	No. of Persons Sum of Doses							25 837	2 228	
1982	Industrial Radiography	No. of Persons Sum of Doses	6 16.1	3 20.7							
	Power Reactors	No. of Persons Sum of Doses	1 5.0	1 9.4							
	Medical Facilities	No. of Persons Sum of Doses	2 1.9								
	Marketing & Manufact.	No. of Persons Sum of Doses	1 ^b 1.3								
	Others	No. of Persons Sum of Doses	1 4.3						15 569	2 206	
1981	Industrial Radiography	No. of Persons Sum of Doses	7 12.2	1 7.1							
	All Others	No. of Persons Sum of Doses	10 24.1	2 ^c 30.9		1 8.1			4 102.9		
1980	Industrial Radiography	No. of Persons Sum of Doses	4 23.6	1 7.7					1 56.0		
	All Others	No. of Persons Sum of Doses	84 285.4						3 73.5		3 33,000
1979	Industrial Radiography	No. of Persons Sum of Doses	8 ^d 25.9	3 34.6							
	All Others	No. of Persons Sum of Doses	30 65.0	3 ^e 39.0		7 125.7	1 40.0	2 ^f 327	15 468.1	1 ^g 147	
1978	Industrial Radiography	No. of Persons Sum of Doses	4 15.3	1 21.6						1 150	
	All Others	No. of Persons Sum of Doses	12 36.0	4 51.9	1 27.3	2 18.2			2 49.2		
1977	Industrial Radiography	No. of Persons Sum of Doses	7 23.7	2 ^h 23.2							1 630
	All Others	No. of Persons Sum of Doses	38 75.0		1 220	3 ⁱ 40.0			10 224		

^aThis person simultaneously received an extremity overexposure of 61 rems (cSv) that is not shown.

^bThis person simultaneously received a skin overexposure of 15.2 rems (cSv) that is not shown.

^cOne of these persons simultaneously received an extremity overexposure of 21 rems (cSv) that is not shown.

^dOne of these persons simultaneously received an extremity overexposure of 46 rems (cSv) that is not shown.

^eOne of these persons simultaneously received an extremity overexposure of 45 rems (cSv) that is not shown.

^fThese two persons simultaneously received extremity overexposures of 82 and 38 rems (cSv) that are not shown.

^gThis person simultaneously received a skin overexposure of 13 rems (cSv) that is not shown.

^hThis person simultaneously received an extremity overexposure of 18 rems (cSv) that is not shown.

ⁱThis person simultaneously received an extremity overexposure of 26.9 rems (cSv) that is not shown.


facilities, universities, and measuring and well-logging activities. In 1980 the total number of individuals reported as being overexposed was 96, a considerable increase over the numbers reported for other years. This increase was due to the overexposure of some 67 individuals at one nuclear power facility during steam generator repair work. They received doses between three and five rems. In 1984, the total number of overexposed individuals was 19, which is the lowest number reported during the years shown. The highest whole body dose in 1984 was 8.2 rems (cSv). In each of the years from 1977 through 1983, the highest whole body doses were 220, 27.3, 17.0, 7.7, 9.4, and 25 rems (cSv), respectively.

There were two incidents in 1984 in which external exposures of the magnitude described in Category A or B were received. In one incident, a radiographer received a whole body dose of 8.2 rems (cSv) while performing radiography in a field site in Utah. The radiographer failed to perform adequate radiation surveys after making radiographic exposures and did not realize that the radiographic source had not returned to the fully retracted and shielded position.

In the second incident, the dosimeter worn by a nuclear medicine student indicated a whole body dose of 5.2 rems (cSv) for the month of December. Investigation failed to find the cause of exposure, and it was assumed that the student incurred the dose. Although both of these doses are all in excess of NRC limits, they are below the level where observable medical effects would be expected.

There were ^{no} two instances in 1984 in which the estimated intake of radioactive material exceeded the quarterly intake limit, equivalent to exposure for 520 hours at the maximum permissible concentrations (MPC-hours). Both incidents involved thyroid uptakes of iodine-125 in which one individual received an estimated thyroid dose of 2,000 rems (cSv) or less and the other received a thyroid dose of 300 rems (cSv) or less. Both individuals were involved in research activities, and their excessive thyroid burdens were discovered during routine bioassays. It is doubtful that either was the result of excessive airborne concentrations of iodine-125, but exactly how the uptakes actually occurred was never discovered. No change in thyroid function was observed in either individual.

There was ^{one} report of personnel exposure to airborne concentrations of soluble uranium in excess of the applicable limit equivalent to exposure for 40 hours at the maximum permissible concentration in 1984. The report indicated that an uptake equal to 90 MPC-hours may have been incurred by an employee while working in a ventilation dust collection unit.



296-03-001-00

REFERENCES

1. U.S. Atomic Energy Commission, "Nuclear Power Plant Operating Experience During 1973," USAEC Report OOE-ES-004, December 1974.*
2. U.S. Nuclear Regulatory Commission, "Nuclear Power Plant Operating Experience 1974-1975," USNRC Report NUREG-0227, April 1977.*
3. U.S. Nuclear Regulatory Commission, "Nuclear Power Plant Operating Experience 1976," USNRC Report NUREG-0366, December 1977.*
4. M. R. Beebe, "Nuclear Power Plant Operating Experience 1977," USNRC Report NUREG-0483, February 1979.*
5. "Nuclear Power Plant Operating Experience 1978," USNRC Report NUREG-0618, December 1979.*
6. "Nuclear Power Plant Operating Experience - 1979," USNRC Report NUREG/CR-1496, May 1981.*
7. "Nuclear Power Plant Operating Experience - 1980," USNRC Report NUREG/CR-2378, ORNL/NSIC-191, October, 1982.*
8. "Nuclear Power Plant Operating Experience - 1981," USNRC Report NUREG/CR-3430, ORNL/NSIC-215, Vol. 1, December, 1983.*
9. "Nuclear Power Plant Operating Experience -1982," USNRC Report NUREG/CR-3430, ORNL/NSIC-215, Vol. 2, January, 1985.*
10. United Nations, "Report of the Scientific Committee on the Effects of Atomic Radiation," Annex H, General Assembly of Official Records, United Nations, New York, 1982.
11. A. Brodsky, R. Specht, B. Brooks, et al., "Log-Normal Distributions of Occupational Exposure in Medicine and Industry." Presented at the 9th Midyear Topical Symposium of the Health Physics Society, 1976.
12. S. Kumazawa, and T. Namakunai, "A New Theoretical Analysis of Occupational Dose Distributions Indicating the Effect of Dose Limits," Health Physics, Vol. 41, No. 3, 1981.
13. S. Kumazawa, and T. Namakunai, "A Method for Implementation of ALARA for Occupational Exposure Using the Hybrid Lognormal Model." Presented at the 27th Annual Meeting of the Health Physics Society, July 1, 1982.

*Report is available for purchase from the National Technical Information Service, Springfield, Virginia 22161, and/or the NRC/GPO Sales Program, Division of Technical Information and Document Control, U.S. Nuclear Regulatory Commission, Washington, DC 20555.

14. "Licensed Operating Reactors, Status Summary Report," USNRC Report NUREG-0020, Vol. 9, No. 1, January, 1985.*
15. L. A. Cross and A. P. Cross, "Trends in Nuclear Power Plant Man-Rem Per Megawatt-Year," presented to American Nuclear Society-European Nuclear Society International Conference, Washington, DC, November 17-20, 1980.
16. National Academy of Sciences, "The Effects on Populations of Exposure to Low Levels of Ionizing Radiation: 1980," Committee on the Biological Effects of Ionizing Radiations, July 1980. Available from the National Academy Press, 2101 Constitution Avenue NW., Washington, DC 20418.

*Report is available for purchase from the National Technical Information Service, Springfield, Virginia 22161, and/or the NRC/GPO Sales Program, Division of Technical Information and Document Control, U.S. Nuclear Regulatory Commission, Washington, DC 20555.

APPENDIX A

Alphabetical Listing of Annual Exposure Data
Compiled for Certain NRC Licensees

1984

03310

APPENDIX A
INDUSTRIAL RADIOGRAPHERS

Single Location 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
ADEX CORPORATION	29-01208-02	6	0	0	0.00
ADEX CORPORATION - RPG	29-01208-03	0	0	0	0.00
AIR PRODUCTS AND CHEMICALS	37-05105-05	15	12	1	0.12
ALLOY CRAFTS COMPANY	13-17511-01	4	2	0	0.11
ALONSO & CARUS IRON WORKS	52-21350-01	2	2	0	0.18
AMOCO OIL COMPANY	12-06708-01	4	0	0	0.00
AMHUR/DARLING VALVE COMPANY	37-15476-01	6	5	0	0.08
ARMY, DEPARTMENT OF THE	13-18235-01	39	11	1	0.05
ARMY, DEPARTMENT OF THE	29-00047-06	170	23	1	0.05
ARROW TANK & ENGINEERING CO.	22-13253-01	5	0	0	0.00
ASSOCIATED PIPING & ENGINEERING	43-15119-01	9	8	1	0.12
ATLANTIC RESEARCH CORPORATION	45-02808-04	15	15	4	0.27
BABCOCK & WILCOX COMPANY	34-02160-03	46	32	2	0.05
BELDIT CORPORATION	48-02412-02	2	0	0	0.00
BORG-WARNER CORPORATION	37-16828-01	10	0	0	0.00
BRAND EXAMINATION SERVICES	06-17156-01	36	32	48	1.51
BRIGHTON CORP.	34-21480-01	3	3	4	1.29
BULKEYE INTERNATIONAL	34-06627-01	4	2	0	0.05
BUYRUS-ERIE CO.	48-06390-01	0	0	0	0.00
CALUMET TESTING SERVICES INC.	13-16347-01	33	23	21	0.92
CAPITOL STEEL CORPORATION	35-16365-01	3	2	1	0.28
CARIBE SHELL & TUBE, INC.	52-19438-01	6	5	1	0.10
CATERPILLAR TRACTOR COMPANY	12-18023-01	6	2	0	0.05
CHICAGO BRIDGE AND IRON CO.	12-05639-01	7	5	0	0.05
CHICAGO BRIDGE AND IRON CO.	43-05337-02	15	6	1	0.17
COLT INDUSTRIES OPERATING CORP.	48-02387-03	5	0	0	0.00
COMBUSTION ENGINEERING	35-02325-02	12	10	1	0.13
CONSECO INC.	48-16774-01	0	0	0	0.00
CONSOLIDATED FOUNDRIES & MFG.	34-04657-02	0	0	0	0.00
CONSOLIDATED X-RAY SERVICE	29-21452-01	88	88	85	0.97
CONSTRUCTION ENGINEERING CO.	37-18456-01	28	7	1	0.13
COPEL-VULCAN	37-19530-01	1	1	1	0.63
COUNTER & CO.	29-21308-01	0	0	0	0.00
CRANE COMPANY - INDIAN ORCHARD	20-00518-02	4	0	0	0.00
DAY AND ZIMMERMANN INC.	42-15051-02	3	3	0	0.05
DEPT. OF ARMY	35-19189-02	39	1	0	0.18
DEPT. OF NAVY, USS	04-18082-01	20	3	0	0.05
DEPT. OF THE NAVY, NONDESTRUCT	04-06145-03	9	0	0	0.00
CONNECTICUT, STATE OF	06-06472-03	37	2	0	0.05
DODGE FOUNDRY AND MACHINE CO.	37-15324-01	4	3	0	0.13
DRAVO CORPORATION	34-00850-02	5	3	0	0.13
DUNCAN FOUNDRY & MACHINE WORKS	12-09687-01	0	0	0	0.00
DURALOY COMPANY (THE)	37-02279-02	10	5	2	0.39

APPENDIX A (cont.)
INDUSTRIAL RADIOGRAPHERS

Single Location -1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
DURIRON COMPANY INCORPORATED	34-06398-01	5	5	2	0.31
E. I. DU PONT DE NEMOURS & CO.	07-00455-30	5	1	0	0.05
EMPIRE STEEL CASTINGS, INC.	37-02448-01	3	1	0	0.38
EXXON COMPANY U. S. A.	25-03375-02	6	0	0	0.00
GENERAL ELECTRIC COMPANY	20-00815-05	12	6	0	0.05
GENERAL ELECTRIC COMPANY	34-00499-10	3	1	0	0.05
GENERAL MOTORS CORP.	21-08678-04	4	0	0	0.00
GENERAL MOTORS CORPORATION	12-02251-01	4	4	0	0.05
GENERAL MOTORS CORPORATION	21-02392-01	3	0	0	0.00
GENERAL MOTORS CORPORATION	34-15315-02	24	0	0	0.00
GLOBE X-RAY SERVICES INC.	35-15194-01	33	33	29	0.89
GREDE FOUNDRIES INCORPORATED	48-02844-01	3	1	0	0.05
HARRISON STEEL CASTINGS CO.	13-02141-01	6	4	1	0.16
HUSS OIL VIRGIN ISLAND CORP.	55-15533-02	11	3	0	0.13
HUGH STEEL STRUCTURES INC.	37-17534-01	9	3	0	0.05
INGERSOLL-RAND COMPANY	29-02015-02	2	2	1	0.40
INTERIOR, DEPARTMENT OF THE	24-02619-02	7	3	0	0.05
INTERIOR, DEPARTMENT OF THE	36-01142-03	6	1	0	0.05
JOHN DEERE FOUNDRY	12-09111-01	3	3	0	0.05
KAST METALS CORPORATION	14-07206-01	6	2	0	0.05
KELSEY-HAYES COMPANY INC.	12-02360-02	4	0	0	0.00
KUMUKU TUBE CO.	13-21248-01	0	0	0	0.00
LABARGE INC.	35-15514-01	2	2	0	0.21
LUKENS STEEL COMPANY	37-02827-01	9	0	0	0.00
LYNCHBURG FOUNDRY COMPANY	45-17464-01	9	2	0	0.18
MAGNAFLUX CORPORATION	12-00622-07	435	334	288	0.86
MARATHON OIL COMPANY	34-01541-02	46	9	1	0.05
MASON & HANGER-SILAS MASON CO.	16-17692-01	92	2	0	0.05
MASSILLON STEEL CASTING CO.	34-02605-01	0	0	0	0.00
MAYNARD ELECTRIC STEEL CASTING	46-07080-01	4	4	2	0.46
MOMANUS INSPECTION SERVICE	48-14158-01	3	3	1	0.18
MINNEAPOLIS ELECTRIC STEEL CAS	22-05572-02	2	0	0	0.00
MISSOURI STEEL CASTINGS CO.	25-15152-01	4	0	0	0.00
NATIONAL AERONAUTICS AND SPACE	34-00507-04	49	12	1	0.05
NATIONAL AERONAUTICS AND SPACE	45-03886-02	6	6	0	0.05
NAVY, DEPARTMENT OF USS H.	31-17677-01	10	9	2	0.25
NAVY, DEPARTMENT OF THE	04-06145-01	45	11	1	0.05
NAVY, DEPARTMENT OF THE	04-09369-01	109	3	0	0.05
NAVY, DEPARTMENT OF THE	28-01012-02	52	50	5	0.10
NAVY, DEPARTMENT OF THE	37-00314-06	67	16	2	0.12
NAVY, DEPARTMENT OF THE	39-06126-01	57	49	6	0.11
NAVY, DEPARTMENT OF THE	29-19047-01	8	0	0	0.00

APPENDIX A (cont.)
INDUSTRIAL RADIOGRAPHERS
Single Location - 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
NAVY, DEPARTMENT OF THE	46-09611-01	3	0	0	0.00
NAVY, DEPARTMENT OF THE	46-19259-01	24	24	1	0.05
NAVY, DEPARTMENT OF THE	53-00007-01	24	23	2	0.08
NAVY, DEPT OF THE	29-14031-02	0	0	0	0.00
NAVY, DLPT. OF, USS FRANK C.	21-19283-01	9	9	1	0.11
NILLS STEEL TANK COMPANY	21-04741-01	4	1	0	0.05
NORTHWEST AIRLINES INC.	22-12980-01	27	3	0	0.05
OKLAHOMA STEEL CASTINGS CO.	35-21159-01	5	3	0	0.13
OSARK AIR LINES, INC.	24-13591-01	24	1	1	0.63
P. X. ENGINEERING COMPANY INC.	20-15102-01	2	2	0	0.05
PELTON CASTEL INC.	48-02669-02	3	3	0	0.05
PENNSYLVANIA SHIPBUILDING CO.	37-21067-01	3	5	0	0.05
PITTSBURGH-DES MOINES CORP.	43-19915-01	2	2	0	0.05
PROFESSIONAL SERVICES INDUS.	12-21501-01	7	3	0	0.05
QUAKER ALLOY CASTING COMPANY	37-03671-01	22	17	3	0.18
REFINERY PRODUCTS CORPORATION	48-03665-02	3	1	1	0.63
RICHMOND ENGINEERING COMPANY	45-02884-01	16	3	1	0.20
SAWYER RESEARCH PRODUCT INC.	34-02044-01	7	1	0	0.05
STAFFER VALVE CO.	34-21198-01	4	0	0	0.00
SIVYER STEEL CASTING COMPANY	14-02407-01	4	1	0	0.18
SOUTHWESTERN ENGINEERING CO.	24-19500-01	3	3	1	0.24
ST. LOUIS STEEL CASTING, INC.	24-01587-01	2	3	0	0.05
STROTHERS WELLS CORPORATION	37-11152-01	7	4	0	0.05
TAYLOR AND HERR COMPANY	06-02024-01	3	0	0	0.00
TELEDYNE UNIDCAST	34-00412-03	0	0	0	0.00
THIUKOL CHEMICAL CORPORATION	01-00856-02	7	0	0	0.00
THIUKOL CHEMICAL CORPORATION—	43-03227-01	16	8	0	0.05
THIUKOL CORPORATION	17-16380-01	54	24	2	0.08
TRANS WORLD AIRLINES INC.	24-05151-05	23	5	2	0.35
U.S.A. WORTHINGTON PUMP CORP	29-02210-02	4	0	0	0.00
UNITED STATES PIPE AND FOUNDRY	29-07262-01	3	0	0	0.00
VALLRATH COMPANY (THE)	48-05395-01	6	2	0	0.05
WAUKESHA FOUNDRY COMPANY INC.	46-13776-01	5	4	0	0.05
WEATHERLY FOUNDRY AND MANUFAC.	37-09859-01	2	0	0	0.00
WEHR STEEL COMPANY	48-02005-02	4	3	1	0.20
WESTERN ZIRCONIUM	43-18296-01	11	1	0	0.05
WESTINGHOUSE ELECTRIC CORP.	37-03632-01	16	7	1	0.07
WESTINGHOUSE ELECTRIC CORP.	37-05609-02	5	3	3	0.87
WHITING CORPORATION	12-04921-01	6	0	0	0.00
WILLIAM POWELL COMPANY (THE)	34-02963-01	6	5	0	0.05
WISCONSIN CENTRIFUGAL INCORP.	48-11641-01	4	4	2	0.37
WISCONSIN INDUSTRIAL TESTING	48-17480-01	30	25	16	0.66
WURD INDUSTRIES PIPE FABRICAT.	35-15458-01	5	4	5	1.36
YUBA HEAT TRANSFER CORPORATION	35-13735-01	3	3	2	0.61

03320

APPENDIX A
INDUSTRIAL RADIOGRAPHERS
Multiple Locations-1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rem) ¹	Average Meas'ble Dose (rems or cSv)
A-I INSPECTION, INC.	49-21496-01	4	4	5	1.20
ABC TESTING	20-19778-01	10	10	3	0.29
ADVEX CORPORATION	45-16452-01	15	12	12	1.03
AIR FORCE, DEPARTMENT OF THE	09-15149-01	6	6	0	0.05
ALASKA INDUSTRIAL X-RAY	50-16084-01	7	6	4	0.62
ALASKA WELDING CENTER	50-19202-01	59	56	52	0.93
ALLEGHENY LABS.	37-20734-01	3	2	0	0.11
ALLIED INSPECTION SERVICES INC.	21-18428-01	11	9	7	0.72
ALLIS-CHALMERS CORPORATION	37-16260-03	20	1	0	0.05
AMERICAN AIRLINES INC.	35-13964-01	76	29	5	0.16
AMERICAN OIL COMPANY (THE)	13-03155-10	21	16	1	0.05
AMERICAN TESTING & INSPECTION	12-21101-01	7	7	2	0.23
AMOCO OIL COMPANY	45-01378-02	13	2	0	0.05
ARMY, DEPARTMENT OF THE	36-02405-05	7	6	0	0.05
ARNOLD GREENE TESTING LAB.	20-01074-02	39	30	5	0.18
ASTRITECH INC	37-09928-01	15	9	4	0.46
BABCOCK & WILCOX CO. (THE)	34-02160-04	133	44	8	0.18
BAKER TESTING SERVICES INC.	20-19067-01	4	4	0	0.05
BASIN INDUSTRIAL X-RAY, INC.	42-19906-01	0	0	0	0.00
BATH IRON WORKS CORPORATION	18-06828-04	17	3	0	0.05
BENJAMIN F. SHAW COMPANY	39-13318-01	2	2	0	0.18
BILL MILLER INC.	35-19048-01	18	13	10	0.77
BRANCH RADIOGRAPHIC LAB	29-03405-02	49	49	6	0.11
BRAUN ENGINEERING TESTING, INC.	22-16537-02	0	0	0	0.00
BRIGGS ENGINEERING & TESTING	20-16401-01	5	5	3	0.64
BRISTOL STEEL AND IRON WORKS	45-16947-01	0	5	1	0.21
BOGHE-TWINING, INC.	04-19522-01	88	82	81	0.99
C & R LABORATORIES	53-19179-01	4	4	0	0.05
CAPITAL X-RAY SERVICE	35-11114-01	25	25	66	2.65
CARRULL ENGINEERS	20-13042-01	5	1	0	0.18
CATALYTIC INC.	37-12931-02	0	0	0	0.00
CATERPILLAR TRACTOR COMPANY	12-06013-02	16	2	0	0.18
CERTIFIED TESTING LABORATORIES	29-14150-01	6	6	0	0.05
CHEWE CONTRACTING CORPORATION	22-18342-01	15	13	5	0.34
CHICAGO BRIDGE AND IRON CO.	42-13553-02	115	112	59	0.52
CLEVELAND X-RAY INSPECTION INC	35-15205-01	51	51	48	0.94
CILBY AND THIELMEIER TESTING	24-13737-01	5	5	5	0.94
COLONIAL GAS CO.	29-15003-01	5	0	0	0.00
COLUMBIA GAS TRANSMISSION CORP.	47-16060-01	6	4	1	0.14
COMBUSTION ENGINEERING INC.	06-04154-01	18	11	1	0.13
CONSOLIDATED TESTING LABS	31-01545-03	5	5	4	0.81
CONSOLIDATED X-RAY SERVICE CO.	42-06456-02	92	91	64	0.70
CONSUMERS POWER COMPANY	21-06606-03	23	18	5	0.28

INDUSTRIAL RADIOGRAPHERS
Multiple Locations-1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
CORPORACION GEOTEC	52-21486-01	0	0	0	0.00
CRANE COMPANY	24-00563-02	9	9	5	0.53
CIL ENGINEERING INC.	34-08331-01	2	2	1	0.50
D & S TESTING, INC.	34-21458-01	14	12	12	0.95
DANIEL INTERNATIONAL CORP	39-01261-02	44	31	19	0.61
DAYTON X-RAY COMPANY	34-06943-01	12	10	4	0.35
DEPT. OF NAVY, MARC ISLAND NAV.	04-00364-06	52	45	3	0.07
DEPT. OF NAVY, NAVAL EXPLOSIVE	19-00318-03	25	0	0	0.00
DEPT. OF NAVY, USS A.	04-11872-01	20	0	0	0.00
DEPT. OF NAVY, USS D.	04-17976-01	16	15	1	0.05
DEPT. OF NAVY, USS H.	04-18130-01	23	0	0	0.00
DEPT. OF NAVY, USS J.	04-17765-01	11	0	0	0.00
DEPT. OF NAVY, USS K.	04-16013-01	10	0	0	0.00
DEPT. OF NAVY, USS P.	04-18041-01	19	19	2	0.09
DEPT. OF THE NAVY	09-21465-01	13	8	1	0.10
DEPT. OF THE NAVY	31-17825-02	13	4	0	0.05
DEPT. OF THE NAVY.	04-04484-03	8	8	1	0.10
DEPT. OF THE NAVY.	38-05314-05	7	0	0	0.00
DEPT. OF THE NAVY, USS S.	09-19770-01	16	1	0	0.05
DUQUESNE LIGHT COMPANY	37-17507-01	14	12	2	0.13
E. L. CONWELL & COMPANY	37-17637-01	2	0	0	0.00
EASTERN TESTING AND INSPECTION	29-09814-01	27	24	20	0.83
EBASCO SERVICES INC.	29-07056-03	51	31	10	0.33
EG & G FLORIDA, INC.	09-21233-01	25	22	3	0.14
ELPASO NATURAL GAS COMPANY	42-03201-02	4	4	1	0.29
EQUITABLE GAS COMPANY	37-17491-01	7	0	0	0.00
EAM COMPANY	35-16191-01	429	429	56	0.13
FACTORY MUTUAL RESEARCH CORPOR	20-04007-02	6	2	0	0.05
FINLAY TESTING LABORATORIES	53-17854-01	7	5	4	0.84
FOSTER WHEELER ENERGY CORP.	31-01776-05	32	14	5	0.36
FRANKLIN RESEARCH CENTER	37-00637-11	16	1	0	0.05
FROEHLING & ROBERTSON INC.	45-06890-01	10	8	3	0.39
GAMMA FIELD RADIOGRAPHIC FACIL,	12-13858-01	25	20	15	0.73
GAMMA SCAN COMPANY	07-19528-01	0	0	0	0.00
GENERAL DYNAMICS CORPORATION	06-01781-08	106	94	23	0.24
GENERAL DYNAMICS CORPORATION	20-11915-01	21	9	1	0.10
GEO CONSTRUCTION TESTING	04-00616-04	241	186	50	0.31
GLADSTONE LABS. INC. (THE)	34-01764-02	5	3	0	0.13
GREAT LAKES TESTING CORP.	13-21306-01	0	0	0	0.00
GRINNELL COMPANY, INC.	38-02839-01	30	12	3	0.26
H. C. NUTTING CO.	34-14924-01	4	4	0	0.08
H. R. INSPECTION SERVICE INC.	15-06209-01	8	8	6	0.73
H&H X-RAY SERVICES INC.	17-19236-01	6	6	7	1.10

APPENDIX A (cont.)
INDUSTRIAL RADIOGRAPHERS
Multiple Locations 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
HARDY ASSOCIATES LTD.	50-19946-01	6	3	1	0.31
HARRON TESTING LABORATORY INC.	34-00681-03	8	8	1	0.14
HOUSTON INSPECTION SERVICE	42-23150-01	20	20	62	3.10
HUTCHINSON AREA VO-TECH INSTIT.	22-15554-01	270	31	2	0.05
INDEPENDENT INSPECTION	42-19441-01	3	2	3	1.69
INDEPENDENT TESTING LAB.	03-15981-02	57	49	25	0.51
INDUSTRIAL GAMMA INSPECTION	24-19850-01	1	0	0	0.00
INDUSTRIAL INSPECTION	34-14071-01	47	43	30	0.69
INDUSTRIAL LABORATORIES INC.	41-04226-02	6	6	5	0.79
INDUSTRIAL NDT COMPANY	45-19494-01	11	9	4	0.43
INDUSTRIAL NDT SERVICES	13-06147-04	7	6	2	0.30
INDUSTRIAL TESTING LABORATORY	37-16406-01	13	1	0	0.05
INSPECTION & TESTING COMPANY	11-19921-01	23	23	26	1.11
INSPECTION SERVICE CORP OF PEN.	37-11636-31	8	5	7	1.32
INSPECTION SERVICE, INC.	41-21154-01	34	25	13	0.53
INTERMOUNTAIN TESTING COMPANY	05-07872-01	25	25	31	1.22
INTERNATIONAL TESTING LABS.	29-14027-01	8	2	0	0.11
J.T. CULLEN COMPANY INC.	12-15025-01	6	4	3	0.73
JACKSONVILLE SHIPYARDS INC.	09-13611-01	10	7	1	0.20
JAN X-RAY SERVICES INC.	21-16560-01	16	15	13	0.88
JUNES, OTHO	35-21425-01	34	30	15	0.51
LAKELAND TESTING LABORATORY	22-14897-01	6	2	1	0.40
LATY INSPECTION SERVICE	37-21473-01	2	0	0	0.00
LAW ENGINEERING TESTING CO.	10-00346-03	243	196	22	0.11
LHIGH TESTING LABORATORIES	07-01173-03	8	8	5	0.56
LUCKHEAD SHIPBUILDING & CONSTR.	46-06926-02	11	4	0	0.05
MAGNA CHEM. INC.	21-19111-01	27	15	4	0.24
MASSACHUSETTS MATERIALS RES.	20-19130-01	7	4	0	0.08
MATERIALS TESTING LABORATORY	45-17151-01	9	9	10	1.16
MATTINGLY & OIRLILLY SERVICE	25-21479-01	0	0	0	0.00
MET LAB INC.	45-09963-01	7	7	2	0.23
MET-CHEM ENGINEERING LAB.	43-19662-01	37	36	22	0.62
MET-CHEM ENGINEERING LAB.	43-11213-02	11	9	9	1.03
METALOGIC, INC.	02-19728-01	94	81	39	0.48
METALSALLES INC.	43-17142-01	6	4	3	0.64
METILS INC.	42-16534-01	26	9	5	0.53
MID-CEN INSPECTION	49-16670-01	93	93	44	0.48
MIDLAND-ROSS CORPORATION	34-01115-02	0	0	0	0.00
MIDWEST INSPECTION SERVICE LTD.	48-16296-01	15	9	8	0.83
MINNUTE MANUFACTURING CORP.	37-11460-01	1	0	0	0.00
MONROE X-RAY CO.	17-12201-02	4	4	3	0.69
MONTANA X-RAY INC.	25-21134-01	1	1	3	2.50
MORRISON-ANDERSON COMPANY INC.	11-15946-01	14	13	3	0.26

APPENDIX A (cont.)
INDUSTRIAL RADIOGRAPHERS
Multiple Locations - 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
NATIONAL INSPECTION & CONSULT.	09-21289-01	0	0	0	0.00
NAVY DEPT, NAVAL SUB BASE	53-10226-01	27	1	0	0.05
NAVY DEPT, USS ACADIA	64-19846-01	22	22	1	0.05
NAVY, DEPARTMENT OF USS F	31-18014-01	9	9	1	0.05
NAVY, DEPARTMENT OF USS L	31-17970-01	14	14	2	0.11
NAVY, DEPARTMENT OF USS O	31-18096-01	13	0	0	0.00
NAVY, DEPARTMENT OF USS P	31-17928-01	26	2	0	0.05
NAVY, DEPARTMENT OF USS Y	31-17802-01	7	0	0	0.00
NAVY, DEPARTMENT OF THE	04-03141-01	24	1	0	0.05
NAVY, DEPARTMENT OF THE	04-13252-01	18	0	0	0.00
NAVY, DEPARTMENT OF THE	06-07150-01	18	17	2	0.11
NAVY, DEPARTMENT OF THE	45-04052-03	80	72	6	0.09
NAVY, DEPARTMENT OF THE	45-15650-02	14	0	0	0.00
NAVY, DEPARTMENT OF THE	46-03078-01	82	79	12	0.15
NAVY, DEPT. OF THE, (USS C,	09-19932-01	11	11	1	0.05
NAVY, DEPT. OF THE, USS M.	04-19966-01	17	17	1	0.05
NAVY, DEPT. OF THE, USS U,	64-21246-01	16	7	0	0.05
NDE SERVICE, INC.	05-19821-01	15	15	11	0.72
NDE CORROSION & CONTROL SERV	42-21135-01	0	0	0	0.00
NEW YORK TESTING LABORATORIES	31-02933-01	7	5	2	0.37
NEWPORT NEWS INDUSTRIAL CORP.	34-16805-01	4	3	0	0.05
NEWPORT NEWS INDUSTRIAL CORP	45-11589-01	0	0	0	0.00
NEWPORT NEWS SHIPBUILDING	45-09428-02	95	89	34	0.38
NIC TESTING SERVICE	37-18348-02	13	3	1	0.20
NONDESTRUCTIVE INSPECTION SERV.	47-11883-01	11	11	8	0.68
NONDESTRUCTIVE TESTING CORP.	29-19742-01	24	24	5	0.21
NUOTER CORPORATION	24-03783-01	18	13	1	0.06
NORFOLK SHIPBUILDING AND DRYDO	45-12042-01	17	11	1	0.07
NORTH AMERICAN INSPECTION, INC.	37-25370-01	24	21	14	0.66
NORTHEASTERN RESEARCH & TEST	29-18006-01	0	0	0	0.00
NUCLEAR ENERGY SERVICE INC.	42-16559-01	128	88	61	0.69
NUCLEAR INSTALLATION SERV. CO.	09-23042-01	6	2	0	0.05
NWI INTERNATIONAL	12-17506-01	5	3	0	0.05
OKLAHOMA TESTING LABORATORIES	35-10577-01	14	7	1	0.13
OLD DOMINION IRON & STEEL CORP.	45-15581-01	3	3	0	0.13
PANHANDLE EASTERN PIPE LINE CO	15-17729-01	9	9	1	0.09
PARKER INDUSTRIAL X-RAY LAB.	06-01337-03	13	8	3	0.35
PATZIG TESTING LABS INC.	14-18897-02	15	6	1	0.19
PDM LATIN AMERICA, LTD.	10-19980-01	0	0	0	0.00
PENN INSPECTION CO.	35-21144-01	9	9	7	0.74
PERINI CORP.	20-21490-01	0	0	0	0.00
PHOTON FIELD INSPECTION, INC.	21-21010-01	3	1	0	0.05
PITTSBURGH DESIGN STEEL CO.	14-01837-04	10	4	1	0.11

APPENDIX A (cont.)
INDUSTRIAL RADIOGRAPHERS
Multiple Locations -1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
PITTSBURGH DES MOINES STEEL CO	37-02607-02	13	7	2	0.27
PITTSBURGH TESTING LABORATORY PLANT INSPECTION CO.	37-00276-25 04-21032-01	526 9	323 0	176 0	0.55 0.00
PORTABLE ATOMIC X-RAY COMPANY	35-07488-03	2	1	1	0.63
POWER INSPECTION, I.C.	37-21428-01	0	0	0	0.00
POWER PIPING COMPANY	37-09945-01	4	4	1	0.31
PRECISION COMPONENTS CORP.	37-16280-01	53	25	2	0.07
PROGRESS SERVICES, INC.	34-19592-01	11	8	2	0.21
PROGRESSIVE FABRICATORS	24-21200-01	0	0	0	0.00
PULLMAN POWER PRODUCTS	37-08042-01	94	50	16	0.32
Q.C. LABORATORIES INC.	09-11579-03	27	25	9	0.34
QUAD CITY TESTING LABORATORY	14-17989-01	6	6	4	0.58
QUALITY ASSURANCE LABORATORIES RADIOGRAPHY INSPECTION, INC.	18-19078-01 15-21451-01	7 26	4 24	2 12	0.61 0.49
REACTOR CONTROLS INC.	04-15365-01	14	6	1	0.13
RELIANCE TESTING LABORATORIES	19-17176-01	18	10	3	0.31
RICHARD KRUGEL, DBA GENERAL T.	34-09037-01	5	5	8	1.58
ROCKWELL INTERNATIONAL	04-17624-03	0	0	0	0.00
S & S INSPECTION COMPANY	12-19780-01	19	13	7	0.54
SMITH-EMERY COMPANY	04-19467-01	13	11	2	0.17
SOUTHWEST X-RAY CORP.	03-21354-01	36	36	40	1.12
SPACE SCIENCE SERVICES INC.	09-07550-01	41	28	20	0.72
SPECTRUM LABORATORIES INC.	29-07266-01	4	3	0	0.05
SSW INSPECTION SERVICES	14-19899-01	0	0	0	0.00
ST. LOUIS TESTING LABORATORIES	24-00188-02	15	14	19	1.35
STONE & WEBSTER ENGINEERING CO.	20-05600-02	90	42	10	0.23
SUN RAY TESTING INTERNATIONAL	04-19810-01	0	0	0	0.00
SUPERIOR INDUSTRIAL X-RAY CO.	12-02370-01	12	6	1	0.09
TENNECO INC.	42-09073-02	25	24	6	0.26
TENNESSEE VALLEY AUTHORITY	41-06832-06	35	21	3	0.13
TERLX CORPORATION	34-19607-01	5	0	0	0.00
TESTING INSTITUTE OF ALASKA	50-17446-01	5	4	2	0.37
TOWNSEND AND BOTTOM INC.	21-17095-01	0	0	0	0.00
TRANS-EASTERN INSPECTION SERV	37-14855-01	85	74	61	0.82
TRANS-WORLD TESTING LABS., INC.	04-23360-01	11	11	4	0.34
TRI-STATE INSPECTION & CONSULT.	37-19640-01	0	0	0	0.00
TRUTOM LTD.	06-20755-01	20	13	9	0.69
TULSA GAMMA RAY INC.	35-17178-01	15	14	19	1.33

APPENDIX A (cont.)

INDUSTRIAL RADIOGRAPHERS
Multiple Locations - 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
TULSA INSPECTION SERVICE, INC.	35-23362-01	43	40	22	0.54
TWIN CITY TESTING AND FIG.	22-01376-02	40	28	18	0.64
TWIN PORTS TESTING, INC.	48-23476-01	11	8	10	1.22
U.S. TESTING CO., INC.	29-02477-09	0	0	0	0.00
ULTRA TECHNOLOGY, INC.	50-23363-01	0	0	0	0.00
UNION BOILER COMPANY	47-16182-01	21	20	12	0.61
UNITED INSPECTION, INC.	35-23436-01	16	14	6	0.41
UNITED STATES TESTING COMPANY	37-15445-02	82	41	11	0.26
UNITED TECHNOLOGIES CORP	06-07522-05	0	0	0	0.00
UNIVERSAL TECHNICAL TESTING LAB	37-00453-03	18	12	8	0.65
UNIVERSAL TESTING LABORATORIES	29-16397-01	27	6	1	0.15
VENEGAS INDUSTRIAL TESTING LAB	28-14847-02	5	3	2	0.56
VIRGINIA DEPARTMENT OF HIGHWAY	45-13380-02	2	0	0	0.00
W.M. KELLOGG CONSTRUCTORS, INC	42-16573-01	3	0	0	0.00
WESTERN INDUSTRIAL X-RAY	04-21386-01	49	39	37	0.94
WESTERN STRESS, INC.	49-23490-01	13	11	1	0.06
WESTERN X-RAY COMPANY	35-19993-01	13	9	5	0.51
X-R-1 TESTING OF MICHIGAN	21-05472-01	52	23	5	0.23
X-RAY, INC.	46-03414-03	28	28	14	0.51
X-RAY INSPECTION COMPANY	35-19507-01	5	5	6	1.16
ARMY, DEPARTMENT OF THE	29-00047-08	0	0	0	0.00
MELLOY LABORATORIES INC.	45-13733-04	0	0	0	0.00
WASHINGTON UNIVERSITY	24-00167-12	0	0	0	0.00

APPENDIX A (cont.)

MANUFACTURERS AND DISTRIBUTORS

1984

Licensee Name	License Number	Program Type	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
ABBOTT LABORATORIES	12-00621-03	BROAD	1310	175	12	0.07
ACCURAY CORPORATION	34-00255-03	BROAD	387	223	17	0.08
AMERSHAM CORPORATION	12-12836-01	BROAD	229	75	22	0.29
E. R. SQUIBB AND SONS INC.	29-00139-02	BROAD	406	234	41	0.18
HALLIDORTON COMPANY	35-00502-03	BROAD	57	57	10	0.17
MALLINCKRODT/NUCLEAR	24-04266-01	BROAD	356	326	184	0.56
NEW ENGLAND NUCLEAR CORP.	20-00320-09	BROAD	99	50	9	0.17
NEW ENGLAND NUCLEAR CORP.	20-11868-01	BROAD	626	227	123	0.54
NEW ENGLAND NUCLEAR CORP.	20-00320-13	BROAD	455	201	146	0.72
PITTSWAY CORPORATION	12-15023-01	BROAD	36	0	0	0.00
RAMSEY ENGINEERING CO.	42-01485-04	BROAD	92	60	18	0.30
TECHNICAL OPERATIONS INC.	20-00277-03	BROAD	64	28	10	0.36
UPJOHN COMPANY	21-00182-03	BROAD	508	60	3	0.05
AIRCO INCORPORATED	29-02085-01	OTHER	27	1	0	0.18
ATOMIC ENERGY OF CANADA LIM.	54-00300-04	OTHER	0	0	0	0.00
ATOMIC ENERGY OF CANADA LIM.	54-00300-09	OTHER	28	25	6	0.25
ATOMIC ENERGY OF CANADA LIM.	54-00300-12	OTHER	0	0	0	0.00
CAMBRIDGE NUCLEAR CORP.	20-06799-02	OTHER	24	12	2	0.15
ELFRETH ALLEY APOTHECARY	37-18461-01	OTHER	28	21	4	0.18
GAMMA DIAGNOSTIC LABORATORIES	20-19215-01	OTHER	19	15	17	1.11
KAY-RAY INC.	12-11184-02	OTHER	0	0	0	0.00
MALLINCKRODT, INC.	24-04266-07	*OTHER	0	0	0	0.00
MALLINCKRODT, INC.	37-21345-01	*OTHER	0	0	0	0.00
MALLINCKRODT, INC.	37-23326-01	*OTHER	0	0	0	0.00
NEW ENGLAND NUCLEAR CORP.	20-00320-19	OTHER	4	4	0	0.05
NUCLEAR PHARMACY, INC.	37-21322-01	*OTHER	6	6	1	0.19
NUCLEAR PHARMACY	37-19566-01	*OTHER	18	6	1	0.13
NUCLEAR RESEARCH CORP.	37-02401-04	OTHER	0	0	0	0.00
PHARMATOPES INC.	21-19219-01	*OTHER	14	4	0	0.08
PHARMATOPES INC.	34-16654-01	*OTHER	20	19	4	0.21
PHARMATOPES INC.	34-19007-01	*OTHER	12	3	0	0.09
PHARMATOPES INC.	34-19008-01	*OTHER	10	5	0	0.08
PHARMATOPES & CO.	13-19451-01	*OTHER	6	0	0	0.00
SYNCOB CORP.	12-19333-01	*OTHER	40	35	4	0.12
SYNCOB CORP.	24-19360-01	*OTHER	19	17	3	0.17
SYNCOB CORP.	34-18467-01	*OTHER	14	3	0	0.05
SYNCOB CORP.	34-13484-01	*OTHER	12	5	2	0.31
SYNCOB CORP.	35-19583-01	*OTHER	9	6	0	0.07
SYNCOB CORP.	37-21092-01	*OTHER	15	4	1	0.18

Activity includes distribution of radiopharmaceuticals

APPENDIX A (cont.)
 FUEL FABRICATORS AND PROCESSORS
 1984

Licensee Name	License Number	Total Individuals Monitored	Workers with Measurable Dose	Collective Dose (man-rems)	Average Meas'ble Dose (rems or cSv)
ATOMICS INTERNATIONAL	SNM-0021	1124	477	61	0.13
BABCOCK & WILCOX CO.	* SNM-0414	109	25	3	0.12
BABCOCK AND WILCOX	SNM-1168	179	121	46	0.38
BABCOCK AND WILCOX INC	SNM-0042	2431	1859	127	0.07
COMBUSTION ENGINEERING INC.	SNM-1067	212	96	29	0.29
COMBUSTION ENGINEERING, INC.	SNM-0033	69	36	3	0.09
EXXON NUCLEAR COMPANY INC,	SNM-1227	873	621	75	0.12
GENERAL ATOMIC COMPANY	SNM-0696	1500	412	42	0.10
GENERAL ELECTRIC CO.	SNM-1097	1225	787	109	0.14
NUCLEAR FUEL SERVICES INC.	SNM-0124	904	626	37	0.06
UNITED NUCLEAR CORP.	* SNM-0777	0	0	0	0.00
UNITED NUCLEAR CORPORATION	SNM-0368	126	64	4	0.06
WESTINGHOUSE ELECTRIC CORP	SNM-1107	738	646	283	0.44
WESTINGHOUSE ELECTRIC CORP	SNM-1120	0	0	0	0.00
LOW-LEVEL WASTE DISPOSAL FAC.					
CHEM-NUCLEAR SYSTEMS, INC.	46-19524-02	546	262	57	0.22
NUCLEAR ENGINEERING COMPANY	16-19204-01	379	35	16	0.44
INDEPENDENT SPENT FUEL STORAGE INSTALLATION					
GENERAL ELECTRIC COMPANY	SNM-2500	32	32	13	0.41

* Engaged primarily in decommissioning activities.

Noted

APPENDIX B
Annual Whole Body Doses at Licensed Nuclear Power Facilities
1984

Appendix B
**ANNUAL WHOLE BODY DOSES AT LICENSED NUCLEAR POWER FACILITIES
 CY 1984**

PLANT NAME AND TYPE	Number of Individuals with Whole Body Doses in the Following Range (rems or cSv)														Total Number Monitored	Number with Measurable Exposure	Collective Dose		
	No Measurable Exposure	<0.10	0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.0	1.0-2.0	2.0-3.0	3.0-4.0	4.0-5.0	5.0-6.0	6.0-7.0	7.0-8.0	8.0-9.0				9.0-10.0	10.0-12.0
Arkansas 1, 2 PWR	956	671	311	268	147	94	195	46	9	1							2,698	1,742	806
Beaver Valley PWR	1,166	588	281	187	110	85	110	32									2,559	1,393	504**
Big Rock Point BWR	110	147	35	27	21	12	35	15	5								407	297	155
Browns Ferry 1,2,3 BWR	3,538	739	481	531	284	231	462	186	41	7							6,500	2,962	1,940**
Brunswick 1,2 BWR	1,288	2,273	467	433	300	268	766	428	111								6,334	5,046	3,260**
Calvert Cliffs 1,2 PWR	433	741	205	138	76	45	145	17	2								1,802	1,369	479
Cook 1,2 PWR	2,031	534	293	216	163	106	215	26	6								3,590	1,559	762
Cooper Station BWR	1,840	833	142	139	98	82	193	109	2								3,438	1,598	799**
Crystal River 3 PWR	1,142	385	128	26	9	1											1,691	549	49**
Davis Besse PWR	899	657	203	127	62	22	17										1,987	1,088	177**
Dresden 1,2,3 BWR	1,011	617	330	240	173	203	459	217	20	2							3,272	2,261	1,774
Duane Arnold BWR	964	309	102	77	40	43	37	2	1								1,575	611	189
Farley 1,2 PWR	288	742	467	252	147	124	255	56	3								2,334	2,046	902*
Fitpatrick BWR	684	664	208	199	88	91	232	72	54	2							2,294	1,610	971**
Fort Calhoun PWR	60	351	89	110	97	65	145	44	10	2							973	913	563
Ginna PWR	594	239	114	102	76	53	102	18	8	1							1,307	713	394

Appendix B
**ANNUAL WHOLE BODY DOSES AT LICENSED NUCLEAR POWER FACILITIES
 CY 1984**

PLANT NAME AND TYPE	Number of Individuals with Whole Body Doses in the Following Range (rems or cSv)														Total Number Monitored	Number With Measurable Exposure	Collective Dose		
	No Measurable Exposure	Measurable <0.10	0.10-0.25	0.25-0.50	0.50-0.75	0.75-1.0	1.0-2.0	2.0-3.0	3.0-4.0	4.0-5.0	5.0-6.0	6.0-7.0	7.0-8.0	8.0-9.0				9.0-10.0	10.0-12.0
Haddam Neck PWR	453	403	208	137	93	96	284	151	46	12							1,883	1,430	1,216**
Hatch 1,2 BWR	1,034	1,412	750	642	357	232	497	169	48	3							5,144	4,110	2,218
Indian Point 2 PWR	378	731	351	296	231	193	732	279	103	3							3,297	2,919	2,644**
Indian Point 3 PWR	671	269	147	92	59	33	55	2	1								1,329	658	230
Kewanee PWR	332	194	95	75	65	34	16	2	1								814	482	139**
La Crosse BWR	138	188	16	5	1	4	20	11	17	26							426	288	252
La Salle 1 BWR	1,141	690	256	168	80	27	24										2,386	1,245	252
Maine Yankee PWR	228	425	141	120	99	111	289	69	8								1,490	1,262	884
McGuire 1 PWR	1,284	769	291	279	111	73	124	16									2,947	1,663	507
Millstone 1 BWR	831	779	310	288	210	148	220	32	5								2,823	1,992	836**
Millstone 2 PWR	119	112	43	41	30	21	32	5	1								404	285	120*
Monticello BWR	1,025	432	217	162	135	113	281	230	197	105							2,897	1,872	2,462
Nine Mile Point BWR	780	627	214	175	103	86	225	72	28								2,310	1,530	890
North Anna 1,2 PWR	958	1,474	260	257	208	154	432	177	76	24							4,020	3,062	1,945
Oconee 1,2,3 PWR	806	634	354	324	205	170	325	63	10								2,891	2,085	1,106**
Oyster Creek BWR	1,559	564	325	327	243	162	428	211	107	2							3,928	2,369	2,054

Appendix B
**ANNUAL WHOLE BODY DOSES AT LICENSED NUCLEAR POWER FACILITIES
 CY 1984**

PLANT NAME AND TYPE	Number of Individuals with Whole Body Doses in the Following Range (rems or cSv)														Total Number Monitored	Number with Measurable Exposure	Collective Dose			
	No Measurable Exposure	Measurable < 0.10	0.10 - 0.25	0.25 - 0.50	0.50 - 0.75	0.75 - 1.0	1.0 - 2.0	2.0 - 3.0	3.0 - 4.0	4.0 - 5.0	5.0 - 6.0	6.0 - 7.0	7.0 - 8.0	8.0 - 9.0				9.0 - 10.0	10.0 - 12.0	> 12.0
Palisades PWR	373	671	188	145	88	61	143	40	7	1							1,717	1,344	573	
Peach Bottom 2,3 BWR	2,303	872	619	504	304	217	428	224	125	20							5,616	3,313	2,450	
Pilgrim BWR	0	1,170	813	459	322	269	800	457	204	48							4,452	4,542	4,082	
Point Beach 1,2 PWR	390	588	173	128	117	99	169	76	21	1							1,762	1,372	789	
Prairie Island 1,2 PWR	377	244	126	80	39	28	28	1									916	539	147	
Quad Cities 1,2 BWR	1,043	444	180	168	117	110	388	241	27	3							2,721	1,678	1,579	
Rancho Seco 1 PWR	501	437	137	99	48	31	43	7									1,303	802	222	
Robinson 2 PWR	1,183	1,939	379	295	201	189	579	341	204								5,310	4,127	2,880**	
Salem 1,2 PWR	1,194	472	283	239	113	77	153	53	4	1							2,589	1,395	681	
San Onofre 1 PWR	8,171	3,345	468	259	135	78	88	1									12,545	4,374	513*	
San Onofre 2 PWR	3,484	2,124	486	266	133	57	68	6									6,624	3,140	473**	
Sequoyah 1,2 PWR	1,496	723	436	418	242	188	311	51	4								3,869	2,373	1,117**	
St. Lucie 1,2 PWR	1,440	682	368	295	183	116	290	143	13								3,530	2,090	1,263	
Summer 1 PWR	854	498	225	185	104	67	40	1									1,974	1,120	295**	
Surry 1,2 PWR	224	1,223	482	313	182	139	508	260	73	18							3,422	3,198	2,247	
Susquehanna BWR	1,721	2,061	528	187	28	17	5	1									4,548	2,827	308	
Three Mile Island 1,2 PWR	1,604	327	173	142	108	86	180	45	18								2,683	1,079	688	

Appendix B
**ANNUAL WHOLE BODY DOSES AT LICENSED NUCLEAR POWER FACILITIES
 CY 1984**

PLANT NAME AND TYPE	No Measurable Exposure	Number of Individuals with Whole Body Doses in the Following Range (rems or cSv)														Total Number Monitored	Number with Measurable Exposure	Collective Dose		
		Measurable Exposure < 0.10	0.10 - 0.25	0.25 - 0.50	0.50 - 0.75	0.75 - 1.0	1.0 - 2.0	2.0 - 3.0	3.0 - 4.0	4.0 - 5.0	5.0 - 6.0	6.0 - 7.0	7.0 - 8.0	8.0 - 9.0	9.0 - 10.0				10.0 - 12.0	> 12.0
Trojan PWR	326	401	174	168	101	61	111	25	1									1,368	1,042	433**
Turkey Point 3,4 PWR	1,042	714	306	294	156	101	273	128	31	7								3,052	2,010	1,255
Vermont Yankee BWR	731	176	172	176	129	83	179	37	2									1,685	954	603
Yankee Rowe PWR	1,512	272	65	64	57	52	119	25										2,166	654	348**
Zion 1,2 PWR	906	308	149	148	138	88	205	47	21	6								2,016	1,110	786
Totals - BWRs	21,741	14,997	6,165	4,907	3,033	2,398	5,679	2,714	994	218								62,846	41,105	27,074
Totals - PWRs	37,875	24,887	8,599	6,585	4,133	2,998	6,774	2,253	681	77								94,862	56,987	28,140
Grand Totals - LWRs	59,616	39,884	14,764	11,492	7,166	5,396	12,453	4,967	1,675	295								157,708	98,092	55,214
Fort St. Vrain HTGR	1,616	62	8															1,686	70	3**

APPENDIX C
Personnel, Dose and Power Generation Summary
1969 - 1984

*A discussion of the methods used to collect and calculate the information contained in this appendix is given in Section 2.1.

Appendix C
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Meas'ble Dose (rem or cSv)	Person-rem (-cSv)/MW-Yr	
ARKANSAS 1, 2 Docket 50-313; DPR-51, NPF-6 1st commercial operation 12/74,- Type - PWRs Capacity - 836, 858 MWe	1975	588.0	76.5	147	21			0.14	0.0	
	1976	464.6	56.6	476	289	27	100	0.61	0.6	
	1977	610.3	76.8	601	256	28	111	0.43	0.4	
	1978	627.2	77.5	722	189	32	109	0.26	0.3	
	1979	397.0	55.3	1321	369	54	252	0.28	0.9	
	1980	452.8	63.7	1233	342	81	213	0.28	0.8	
	1981	1104.7	68.3	2225	1102	130	843	0.50	1.0	
	1982	905.4	58.6	1608	803	97	505	0.50	0.9	
	1983	915.0	54.6	2109	1397	97	1145	0.66	1.5	
	1984	1289.1	77.4	1742	806	89	533	0.46	0.6	
	BEAVER VALLEY 1 Docket 50-334; DPR-66 1st commercial operation 10/76 Type - PWR Capacity - 810 MWe	1977	355.6	57.0	331	87	8	58	0.26	0.2
		1978	304.2	40.8	646	190	11	152	0.29	0.6
		1979	221.0	40.0	704	132	22	67	0.19	0.6
		1980	39.8	6.8	1817	553	76	477	0.30	13.9
1981		573.4	73.6	1237	229	38	142	0.19	.4	
1982		326.7	41.6	1755	599	126	481	0.34	1.8	
1983		561.2	68.2	1485	772	158	615	0.52	1.4	
1984		576.7	71.8	1393	504	125	302	0.36	0.9	
BIG ROCK POINT Docket 50-155, DPR-6 1st commercial operation 3/63 Type - BWR Capacity - 70 MWe		1969	48.1		165	136			0.82	2.8
		1970	43.5		290	194			0.67	4.5
	1971	44.4		260	184			0.71	4.1	
	1972	43.5		195	181			0.93	4.2	
	1973	50.9		241	285		119	1.18	5.6	
	1974	40.7	70.3	281	276	54	42	0.98	6.8	
	1975	35.1	59.8	300	180	58	20	0.60	5.1	
	1976	29.5	50.1	488	289	82	105	0.59	9.8	
	1977	43.6	73.4	465	334	94	60	0.72	7.7	
	1978	48.5	77.9	285	175	93	9	0.61	3.6	
1979	13.0	23.5	623	455	89	102	0.73	35.0		

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/MW-Yr	
BIG ROCK POINT (Continued)	1980	48.9	79.0	599	354	16	91	0.59	7.2	
	1981	56.9	90.6	479	160	58	38	0.33	2.8	
	1982	43.6	70.8	521	328	129	68	0.63	7.5	
	1983	42.3	71.0	493	263	32	55	0.53	6.9	
1984	50.3	78.6	297	155	37	20	0.52	3.1		
BROWNS FERRY 1, 2, 3 Docket 50-259, 50-260, 50-296; DPR-33, -52, -68 1st commercial operation 8/74, 3/75, 3/77 Type - BWRs Capacity - 1065, 1065, 1065 MWe	1975	161.7	17.8	2380	325	60	249	0.14	2.0	
	1976	337.6	26.9	2207	234	0	259	0.11	0.7	
	1977	1327.5	73.0	1858	863	4	289	0.46	0.6	
	1978	1992.1	73.5	2376	1792	0	289	0.75	0.9	
	1979	2393.0	79.1	2689	1667	0	289	0.62	0.7	
	1980	2182.1	73.6	2712	1825	4	49	0.67	0.8	
	1981	2132.9	69.5	3379	2380	100	404	0.70	1.1	
	1982	2025.4	67.6	3277	2220	181	317	0.68	1.1	
	1983	1641.0	54.3	3302	3363	276	908	1.02	2.0	
	1984	1431.9	54.2	2962	1940	229	541	0.66	1.4	
	BRUNSWICK 2, 1 Docket 50-324, 50-325; DPR-62, -71 1st commercial operation 11/75, 3/77 Type - BWR Capacity - 790, 790 MWe	1976	297.2	56.0	1265	326	15	222	0.26	1.1
		1977	291.1	55.7	1512	1119	48	782	0.74	3.8
1978		1173.1	83.7	1458	1004	99	695	0.69	0.8	
1979		810.0	60.1	2891	2602	97	2074	0.90	3.2	
1980		687.2	52.2	3788	3870	111	3098	1.02	5.6	
1981		925.2	56.9	3854	2638	159	1890	0.68	2.9	
1982		540.3	50.3	4957	3792	162	2841	0.76	6.5	
1983		636.7	40.6	5602	3475	152	2428	0.62	5.5	
1984	761.3	51.5	5046	3260	143	2363	0.66	4.3		

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Function Operations & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Meas'ble Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr
CALVERT CLIFFS 1, 2 Docket 50-317, 50-318; DPR-53, -69 1st commercial operation 5/75, 4/77 Type - PWRs Capacity 825, 825 MWe	1976	753.4	95.2	507	74	28	8	0.15	0.1
	1977	583.0	72.1	2265	547	36	224	0.24	0.9
	1978	1188.5	75.8	1391	500	13	143	0.36	0.4
	1979	1161.0	74.0	1428	805	33	423	0.56	0.7
	1980	1309.9	84.1	1496	677	15	402	0.45	0.5
	1981	1379.7	83.1	1555	607	29	378	0.45	0.4
	1982	1238.3	73.7	1805	1057	84	402	0.59	0.8
	1983	1397.2	81.6	1915	668	5	143	0.35	0.5
	1984	1389.4	79.2	1369	479	61	78	0.35	0.3
	COOK 1, 2 Docket 50-315; DPR-58, -74 1st commercial operation 8/75, 7/78 Type - PWRs Capacity - 1020 MWe, 1060 MWe	1976	807.4	83.1	395	116	13	71	0.29
1977		573.0	76.1	802	299	21	138	0.37	0.5
1978		744.8	73.6	778	336	49	139	0.43	0.4
1979		1373.0	65.3	1445	718	45	454	0.50	0.5
1980		1552.4	74.1	1345	493	46	323	0.37	0.3
1981		1557.3	73.4	1341	655	48	442	0.49	0.4
1982		1461.6	69.8	1527	699	67	472	0.46	0.5
1983		1456.5	71.2	1418	658	50	467	0.46	0.5
1984		1526.0	75.3	1559	762	42	597	0.49	0.5
COOPER STATION Docket 50-298; DPR-46 1st commercial operation 7/74 Type - BWR Capacity - 764 MWe		1975	456.4	83.6	579	117	30	19	0.20
	1976	433.3	75.5	763	350	39	210	0.46	0.8
	1977	538.2	86.2	315	197	50	66	0.63	0.4
	1978	576.0	91.0	297	158	40	58	0.53	0.3
	1979	591.0	87.6	426	221	50	89	0.52	0.4
	1980	448.3	71.2	785	859	70	644	1.09	1.9
	1981	457.1	71.2	935	579	63	382	0.62	1.3
	1982	622.3	84.6	743	542	66	361	0.73	0.9
	1983	396.6	63.3	1363	1293	57	1081	0.93	3.3
	1984	411.9	67.2	1598	799	46	635	0.50	1.9

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Personnel Type Contractor Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/MW-Yr
CRYSTAL RIVER 3 Docket 50-302; DPR-72 1st commercial operation 3/77 Type - PWR Capacity - 821 MWe	1978	311.5	41.4	643	321	8	244	0.50	1.0
	1979	453.0	58.9	1150	495	29	346	0.43	1.1
	1980	402.1	53.2	1053	625	24	382	0.59	1.6
	1981	490.4	62.2	1120	408	18	236	0.36	0.8
	1982	589.8	76.0	780	177	9	116	0.23	0.3
	1983	452.1	58.8	1720	552	71	353	0.32	1.2
	1984	774.2	94.5	549	49	10	22	0.09	0.1
	DAVIS-BESSE 1 Docket 50-346; NPF-3 1st commercial operation 11/77 Type - PWR Capacity - 874 MWe	1978	326.4	48.7	421	48	13	14	0.11
1979	381.0	67.0	304	30	8	5	0.10	0.1	
1980	256.4	36.2	1283	154	4	121	0.12	0.6	
1981	531.4	67.4	578	58	1	32	0.10	0.1	
1982	390.8	51.5	1350	164	12	139	0.12	0.4	
1983	592.1	73.0	718	80	6	46	0.11	0.1	
1984	518.5	62.5	1088	177	10	122	0.16	0.3	
DRESDEN 1, * 2, 3 Docket 50-010, 50-237, 50-249; DPR-2, -19, -25 1st commercial operation 7/60, 7/70, 11/71 Type - BWRs Capacity - 197, 772, 773 MWe	1969	99.7			286				2.9
	1970	163.1			143				0.9
	1971	394.5			715				1.8
	1972	1243.7			728				0.6
	1973	1112.2		1341	939	143	344	0.70	0.8
	1974	842.5	54.9	1594	1662		57	1.04	2.0
	1975	708.1	54.6	2310	3423	271	2252	1.48	4.8
	1976	1127.2	80.8	1746	1680	228	749	0.96	1.5
	1977	1132.9	77.0	1862	1693	316	693	0.91	1.5
	1978	1242.2	79.5	1946	1529	204	619	0.79	1.2
	1979	1013.0	74.7	2407	1800	191	641	0.75	1.8
	1980	1074.4	55.0	2717	2105	236	1093	0.77	2.0
	1981	1035.7	51.5	2408	2802	120	1850	1.16	2.7
	1982	1085.3	77.9	2572	2923	136	1731	1.14	2.7
	1983	913.6	65.6	2854	3582	176	2127	1.26	3.9
	1984	789.8	55.3	2261	1774	153	814	0.78	2.2

*Dresden 1 is shutdown, but it is still included in the count of commercial reactors shown elsewhere in the report.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Meas'ble Dose (rem or-cSv)	Person-rem (-cSv)/ MW-Yr	
DUANE ARNOLD Docket 50-331; DPR-49 1st commercial operation 2/75 Type - BWR Capacity - 515 MWe	1976	305.2	78.0	350	105	14	62	0.30	0.3	
	1977	353.6	78.9	538	299	36	220	0.56	0.8	
	1978	149.2	33.2	1112	974	59	932	0.88	6.5	
	1979	352.0	78.0	757	275	35	219	0.36	0.8	
	1980	339.1	73.3	1108	671	32	570	0.61	2.0	
	1981	277.7	69.8	1286	790	56	598	0.61	2.8	
	1982	278.5	74.7	524	229	18	175	0.44	0.8	
	1983	283.0	62.9	1468	1135	42	1016	0.77	4.0	
	1984	329.4	72.9	611	189	27	117	0.31	0.6	
	FARLEY 1, 2 Docket 50-348, 50-364; NPF-2, -8 1st commercial operation 12/77, 7/81 Type - PWR Capacity - 797, 809 MWe	1978	713.8	86.5	527	108	39	34	0.20	0.1
1979		211.0	28.6	1227	643	108	460	0.52	3.0	
1980		557.3	69.3	1330	435	106	185	0.33	0.8	
1981		310.2	41.4	1331	511	96	270	0.38	1.6	
1982		1271.5	79.2	1453	484	155	196	0.33	0.4	
1983		1356.5	82.9	1938	1021	241	479	0.53	0.8	
1984		1447.0	86.6	2046	902	177	504	0.44	0.6	
FITZPATRICK Docket 50-333; DPR-59 1st commercial operation 7/75 Type - BWR Capacity - 810 MWe		1976	489.0	71.6	600	202	14	937	0.34	0.4
		1977	460.5	68.4	1380	1080	166	597	0.78	2.3
		1978	497.0	72.1	904	909	169	538	1.00	1.8
	1979	349.0	50.8	850	859	118	1808	1.01	2.5	
	1980	509.5	70.3	2056	2040	187	1072	0.99	4.0	
	1981	562.9	74.7	2490	1425	136	862	0.57	2.5	
	1982	583.6	75.0	2322	1190	158	667	0.51	2.0	
	1983	546.2	70.6	1715	1090	82	423	0.64	2.0	
	1984	576.2	76.8	1610	971	889	467	0.60	1.7	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Contractor Personnel Type Station & Utility	Average Measurable Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr	
FORT CALHOUN Docket 50-285; DPR-40 1st commercial operation 9/73 Type - PWR Capacity - 478 MWe	1974	294.0	83.5	327	71		24	0.22	0.2	
	1975	252.3	67.4	469	294		92	0.63	1.2	
	1976	265.9	69.5	516	313	285	38	0.61	1.2	
	1977	351.8	79.4	535	297	264	72	0.56	0.8	
	1978	342.3	75.1	596	410	351	151	0.69	1.2	
	1979	440.0	95.7	451	126	107	47	0.28	0.3	
	1980	242.3	60.4	891	668	630	426	0.75	2.8	
	1981	260.9	72.3	822	458	397	254	0.56	1.8	
	1982	418.0	89.7	604	217	173	99	0.36	0.5	
	1983	330.4	73.1	860	433	367	205	0.50	1.3	
	1984	279.2	59.9	913	563	472	313	0.62	2.0	
	GINNA Docket 50-244; DPR-18 1st commercial operation 7/70 Type - PWR Capacity - 470 MWe	1971	327.8		340	430	361	108	1.26	1.3
		1972	293.6		677	1032	961	278	1.52	3.5
		1973	409.5		319	224	169	84	0.70	0.5
1974		253.7	62.4	884	1225			1.39	4.8	
1975		365.2	76.7	685	538			0.78	1.5	
1976		248.8	58.2	758	636	607	210	0.84	2.5	
1977		365.6	85.5	530	401	386	120	0.76	1.1	
1978		386.5	80.6	657	450	430	98	0.68	1.2	
1979		355.0	72.8	878	592	524	207	0.67	1.7	
1980		370.5	76.0	1073	708	644	302	0.66	1.9	
1981		399.0	82.1	925	655	606	251	0.71	1.6	
1982		289.0	58.8	1117	1140	1060	546	1.02	3.9	
1983		365.0	74.6	969	855	813	378	0.88	2.3	
1984		378.1	77.2	713	394	337	195	0.55	1.0	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rems or-cSv)	Person-rems (-cSv) per Work Function Operations & Maint. & Others	Person-rems (-cSv) per Contractor	Person-rems (-cSv) per Station & Utility	Average Measurable Dose (rems or cSv)	Person-rems (-cSv)/ MW-Yr	
HADDAM NECK (CONN. YANKEE) Docket 50-213; DPR-61 1st commercial operation 1/68 Type - PWR Capacity - 569 MWe	1969	438.5		138	106		27	79	0.77	0.2	
	1970	424.7		734	689		463	226	0.94	1.6	
	1971	502.2		289	342		166	176	1.18	0.7	
	1972	515.6		355	325		181	144	0.91	0.6	
	1973	293.1		951	697		544	153	0.73	2.4	
	1974	521.4	91.2	550	201				0.36	0.4	
	1975	494.3	89.9	795	703	20	253	196	0.88	1.4	
	1976	482.9	82.5	644	449	5	440	201	0.70	0.9	
	1977	480.7	83.9	894	641	59	440	201	0.72	1.3	
	1978	563.4	98.6	216	117	25	18	99	0.54	0.2	
	1979	493.0	87.5	1226	1161	73	783	378	0.95	2.4	
	1980	426.8	75.0	1860	1353	175	1076	277	0.73	3.2	
	1981	487.5	84.3	1554	1036	174	809	227	0.67	2.1	
	1982	543.9	93.4	559	126	46	22	104	0.23	0.2	
	1983	453.7	77.8	1645	1384	106	1017	367	0.84	3.1	
	1984	404.0	71.7	1430	1216	154	803	413	0.85	3.0	
	HATCH 1, 2 Docket 50-321, 50-366; DPR-57; NPF-05 1st commercial operation 12/75, 9/79 Type - BWR Capacity - 752, 748 MWe	1976	496.3	83.8	630	134	79	4	130	0.21	0.3
		1977	446.8	66.3	1303	465	96	220	245	0.36	1.0
		1978	513.0	72.8	1304	248	88	52	196	0.19	0.5
1979		401.0	54.6	2131	582	85	382	200	0.27	1.5	
1980		1008.7	70.9	1930	449	143	163	286	0.23	0.4	
1981		870.9	64.3	2899	1337	200	792	545	0.46	1.5	
1982		768.0	56.6	3418	1460	218	1064	396	0.43	1.9	
1983		934.7	68.6	3428	1299	253	851	448	0.38	1.4	
1984		658.6	117.3	4110	2218	311	1861	357	0.54	3.4	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (cSv) per Work Function Operations & Others	Person-rem (cSv) per Contractor Station & Utility	Average Measurable Dose (rem or-cSv)	Person-rem (cSv)/MW-Yr	
HUMBOLDT BAY ^a Docket 50-133; DPR-7 1st commercial operation 8/63 Type - BWR Capacity - 63 MWe	1969	44.6		125	164	69	12	1.31	3.7	
	1970	49.3		115	209	130	37	1.82	4.2	
	1971	39.6		140	292	114	65	2.09	7.4	
	1972	43.1		127	253	81	57	1.99	5.9	
	1973	50.1		210	266	60		1.27	5.3	
	1974	43.4	83.8	296	318	103		1.07	7.3	
	1975	45.3	83.9	265	339	131	112	1.28	7.5	
	1976	23.5	46.4	523	683	37	50	1.31	29.1	
	1977	0	0	1063	1904	24	973	1.79	-	
	1978	0	0	320	335	13	145	1.05	-	
	1979	0	0	135	31	11	2	0.23	-	
	1980	0	0	142	22	10	3	0.15	-	
	1981	0	0	75	9			0.12	-	
	1982	0	0	71	19	5	0	0.27	-	
	1983	0	0	84	17	4	0	0.20	-	
	INDIAN POINT 1,* 2, 3** Docket 50-3, 50-247, 50-286; DPR-5, -26, -64 1st commercial operation 10/62, 8/73, 8/76 Type - PWR	1969	206.2			298				1.4
		1970	43.3			1639				37.8
		1971	154.0			768				5.0
1972		142.3			967				6.8	
1973		0		2998	5262	709	2847	1.75	-	
1974		556.1	59.4	1019	910			0.89	1.6	
1975		584.4	74.8	891	705	166	47	0.79	1.2	
1976		273.9	34.8	1590	1950	154	172	1.23	7.1	
1977		1278.3	75.3	1391	1070	189	383	0.77	0.8	
1978		1172.3	67.8	1909	2006	260	759	1.05	1.7	

^aHumboldt Bay has been shutdown since 1976 and in 1984, it was decided that it would not be placed in operation again. Therefore, it is no longer included in the count of commercial reactors.

*Indian Point 1 was defueled in 1975 and in 1984, it was decided that it would not be put in operation again. Therefore, it is no longer included in the count of commercial reactors.

**Indian Point 3 was purchased by a different utility and now reports separately.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Function Operations & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr
INDIAN POINT 1,* 2 Docket 50-3, 50-247, DPR-5, -26 1st commercial operation 10/62, 8/73 Type - PWR Capacity - 864 MWe	1979	574.0	71.4	1349	1279	209	612	0.95	2.2
	1980	510.8	64.8	1577	971	181	398	0.62	1.9
	1981	367.5	46.0	2595	2731	237	1595	1.05	7.4
	1982	532.4	65.4	2144	1635	343	883	0.76	3.1
	1983	702.6	84.0	1057	486	200	217	0.46	0.7
	1984	416.7	51.9	2919	2644	650	1863	0.91	6.3
INDIAN POINT 3** Docket 50-286; DPR-64 1st commercial operation 8/76 Type - PWR Capacity - 965 MWe	1979	568.0	66.5	808	636	63	482	0.79	1.1
	1980	367.3	53.2	977	308	47	210	0.32	0.8
	1981	365.8	59.8	677	364	46	255	0.54	1.0
	1982	171.5	22.5	1477	1226	42	1094	0.83	7.1
	1983	7.8	2.6	941	607	38	494	0.65	77.8
	1984	714.4	76.3	658	230	48	127	0.35	0.3
KEMAUNEE Docket 50-305; DPR-43 1st commercial operation 6/74 Type - PWR Capacity - 503 MWe	1975	401.9	88.2	104	28	1	12	0.27	0.1
	1976	405.9	78.9	381	270	16	193	0.71	0.7
	1977	425.0	79.9	312	139	8	76	0.44	0.3
	1978	466.6	89.5	335	154	11	89	0.46	0.3
	1979	412.0	79.0	343	127	6	79	0.37	0.3
	1980	433.8	82.1	401	165	7	103	0.41	0.4
	1981	451.8	86.7	383	141	7	94	0.37	0.3
	1982	458.4	87.6	353	101	5	51	0.29	0.2
1983	444.1	83.7	445	165	10	119	0.37	0.4	
1984	455.3	85.7	482	139	7	90	0.29	0.3	

*INDIAN POINT 1 was defueled in 1975 and in 1984 it was decided that it would not be placed in operation again. Therefore, it is no longer included in the count of commercial reactors.

**INDIAN POINT 3 was purchased by a different utility and now reports separately.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Personnel Type Contractor Station & Utility	Average Measurable Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr	
LACROSSE Docket 50-409; DPR-45 1st commercial operation 11/69 Type - BWR Capacity - 48 MWe	1970	15.3		218	111		40	0.72	7.2	
	1971	33.1		151	158		71	1.14	4.8	
	1972	29.2		157	172			1.41	5.9	
	1973	24.4		115	221			1.21	9.1	
	1974	37.9	81.0	165	139	50	6	1.42	3.7	
	1975	32.0	69.6	118	234		6	0.94	7.3	
	1976	21.2	47.6	141	111	71	8	1.59	5.2	
	1977	11.3	33.7	182	224	164	6	0.90	7.6	
	1978	21.6	62.0	153	186	95	21	1.22	19.8	
	1979	24.0	71.8	124	218	121	11	1.76	7.7	
	1980	26.4	68.5	187	123	61	3	0.66	4.2	
	1981	29.6	76.0	148	205	140	16	1.39	11.9	
	1982	17.2	44.6	288	313	210	31	1.96	12.6	
	1983	24.8	59.7		252	141	5	0.87	6.5	
	1984	38.5	80.5							
	LASALLE 1 * Docket 50-373; NPF-11 1st commercial operation 1/84 Type - BWR Capacity - 1036 MWe	1984	677.8	68.9	1245	252	30	86	0.20	0.4
MAINE YANKEE Docket 50-309; DPR-36 1st commercial operation 12/72 Type - PWR Capacity - 810 MWe	1973	408.7		782	117		59	0.15	0.3	
	1974	432.6	68.7	619	420	64	188	0.68	1.0	
	1975	542.9	79.9	440	319	15	181	0.72	0.6	
	1976	712.2	95.0	244	85	17	26	0.35	0.1	
	1977	617.6	82.2	508	245	5	112	0.48	0.4	
	1978	642.7	84.1	638	420	54	262	0.66	0.6	
	1979	537.0	68.4	393	154	70	26	0.39	0.3	
	1980	527.0	72.2	735	462	117	277	0.63	0.9	
	1981	624.2	78.2	968	424	11	308	0.49	0.7	
	1982	542.5	69.1	1352	619	33	462	0.48	1.1	

*LASALLE 1 was counted for the first time in 1984.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Function Operations & Maint. & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/MW-Yr	
MAINE YANKEE (Continued)	1983	677.1	83.6	592	164	40	72	0.28	0.2	
	1984	605.7	74.4	1262	884	9	702	0.70	1.5	
MCGUIRE 1 Docket 50-369; NPF-9 1st commercial operation 12/81 Type - PWR Capacity - 1180 MWe	1982	524.9	80.4	1560	169	26	29	0.11	0.3	
	1983	558.3	55.4	1751	521	35	123	0.30	0.9	
	1984	764.1	68.5	1663	507	40	110	0.30	0.7	
MILLSTONE POINT 1 Docket 50-245; DPR-21 1st commercial operation 3/71 Type - BWR Capacity - 654 MWe	1972	377.6		612	596	50	340	0.97	1.6	
	1973	225.1		1184	663	125	422	0.56	2.9	
	1974	430.3	79.1	2477	1430			0.58	3.3	
	1975	465.4	75.6	2587	2022			0.78	4.3	
	1976	449.8	76.1	1377	1194	54	955	0.87	2.6	
	1977	575.7	89.6	1075	392	118	159	0.36	0.7	
	1978	556.6	87.6	1391	1239	140	907	0.89	2.2	
	1979	505.0	77.3	1769	1793	198	1326	1.01	3.6	
	1980	405.8	69.0	3024	2158	100	1864	0.71	5.3	
	1981	304.3	51.6	2506	1496	96	1201	0.60	4.9	
	1982	490.2	79.9	1370	929	78	587	0.68	1.9	
	1983	640.1	95.6	309	244	63	74	0.79	0.4	
	1984	516.1	78.8	1992	836	80	532	0.42	1.6	
	MILLSTONE POINT 2 Docket 50-336; DPR-65 1st commercial operation 12/75 Type-PWR Capacity - 833 MWe	1976	545.7	78.7	620	168	26	73	0.27	0.3
		1977	518.7	65.7	667	242	38	153	0.36	0.5
		1978	536.6	67.3	1420	1621	72	1534	1.14	3.0
1979		520.0	62.8	757	472	81	305	0.62	0.9	
1980		579.3	69.2	892	636	76	514	0.71	1.1	
1981		722.4	82.6	890	531	44	393	0.60	0.7	
1982		595.9	70.6	2083	1413	27	1219	0.68	2.4	
1983		294.0	34.2	2383	1881	170	1548	0.79	6.4	
1984		782.7	93.5	285	120	11	63	0.42	0.2	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions & Others	Person-rem (-cSv) per Contract-Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/MW-Yr	
MONTICELLO Docket 50-263; DPR-22 1st commercial operation 6/71 Type - BWR Capacity - 525 MWe	1972	424.4		99	61	40	1	0.62	0.1	
	1973	389.5		401	176	48	67	0.44	0.4	
	1974	349.3	74.9	842	349		91	0.41	1.0	
	1975	344.8	72.2	1353	1353			1.00	3.9	
	1976	476.4	91.5	325	263	59	51	0.81	0.5	
	1977	425.6	79.9	860	1000	135	661	1.16	2.3	
	1978	459.4	87.2	679	375	62	165	0.55	0.8	
	1979	522.0	97.6	372	157	62	51	0.42	0.3	
	1980	411.8	78.2	1114	531	82	248	0.48	1.3	
	1981	389.3	72.6	1446	1004	101	756	0.69	2.6	
	1982	291.1	63.3	1307	993	130	760	0.76	3.4	
	1983	494.6	96.3	416	121	57	23	0.29	0.2	
	1984	33.7	9.2	1872	2462	208	927	1.32	73.1	
	NINE MILE POINT 1 Docket 50-220; DPR-63 1st commercial operation 12/69 Type - BWR Capacity - 610 MWe	1970	227.0		821	44	12	17	0.05	0.2
		1971	346.5		1006	195	43	63	0.19	0.6
		1972	381.8		735	285	59	28	0.39	0.7
1973		411.0		550	567	139	118	1.03	1.4	
1974		385.9	70.5	740	824	42	279	1.11	2.1	
1975		359.0	72.1	649	681	68	203	1.05	1.9	
1976		484.6	88.2	392	428	52	229	1.09	0.9	
1977		347.4	59.2	1093	1383	41	883	1.26	4.0	
1978		527.7	95.1	561	314	59	26	0.56	0.6	
1979		354.0	66.1	1326	1497	106	940	1.13	4.2	
1980		533.9	92.3	1174	591	75	251	0.50	1.1	
1981		385.2	66.0	2029	1592	144	1064	0.78	4.1	
1982		133.5	21.4	1352	1264	63	944	0.93	9.5	
1983		329.8	56.2	1405	860	50	576	0.61	2.6	
1984	426.8	71.9	1530	890	163	372	0.58	2.1		

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rems or-cSv)	Person-rems (-cSv) per Work Function Operations & Maint.	Person-rems (-cSv) per Contractor Station & Utility	Average Meas'ble Dose (µmSv or cSv)	Person-rems (-cSv)/ MW-Yr
NORTH ANNA 1, 2 Docket 50-338; NPF-04, - 09 1st commercial operation 6/78, 12/80 Type - PWRs Capacity - 890, 890 MWe	1979	507.0	61.7	2025	449	78	190	0.22	0.9
	1980	681.8	86.5	2086	218	128	85	0.10	0.3
	1981	1241.9	71.5	2416	680	188	343	0.28	0.5
	1982	777.7	45.8	2872	1915	78	1207	0.67	2.5
	1983	1338.4	76.1	2228	665	129	296	0.30	0.5
	1984	1021.3	58.8	3062	1945	154	1416	0.54	1.9
OCONEE 1, 2, 3 Docket 50-269, 50-270, 50-287; DPR-38, -47, -55 1st commercial operation 7/73 9/74, 12/74 Type - PWRs Capacity - 860, 860, 860 MWe	1974	650.6	60.1	844	517	18	144	0.61	0.8
	1975	1838.3	75.5	829	497	72	90	0.60	0.3
	1976	1561.4	63.0	1215	1026	65	219	0.84	0.6
	1977	1566.4	65.9	1595	1328	244	294	0.83	0.8
	1978	1909.0	75.8	1636	1393	179	340	0.85	0.7
	1979	1708.0	67.7	2100	1001	123	181	0.48	0.6
	1980	1703.7	70.1	2124	1055	117	162	0.50	0.6
	1981	1661.5	66.8	2445	1211	113	275	0.50	0.7
	1982	1293.1	52.5	2445	1792	97	364	0.73	1.4
	1983	2141.5	82.2	1902	1207	88	316	0.63	0.6
	1984	2242.9	85.7	2085	1106	63	260	0.53	0.5
	OYSTER CREEK Docket 50-219; DPR-16 1st commercial operation 12/69 Type - BWR Capacity - 620 MWe	1970	413.6		95	63	21	11	0.66
1971		448.9		249	240	50	92	0.96	0.5
1972		515.0		339	582	150	167	1.72	1.1
1973		424.6		782	1236	195	683	1.58	2.9
1974		434.5	70.4	935	984	166	162	1.05	2.3
1975		373.6	73.3	1210	1140	169	271	0.94	3.0
1976		456.5	79.3	1582	1078	70	587	0.68	2.4
1977		385.7	70.1	1673	1614	76	1048	0.96	4.2
1978		431.8	74.3	1411	1279	134	696	0.91	3.0
1979		541.0	85.9	842	467	95	332	0.55	0.9
1980	232.9	41.4	1966	1733	97	1182	0.88	7.4	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rems or cSv)	Person-rems (-cSv) per Work Function Operations & Others	Person-rems (-cSv) per Contract Station & Utility	Average Measurable Dose (rems or cSv)	Person-rems (-cSv)/MW-Yr
OYSTER CREEK (Continued)	1981	314.8	59.8	1689	917	48	479	0.54	2.9
	1982	242.7	62.5	1270	865	33	491	0.68	3.6
	1983	27.9	11.5	2303	2257	65	1863	0.98	80.9
	1984	37.1	9.6	2369	2054	134	1538	0.87	55.4
PALISADES Docket 50-255; DPR-20 1st commercial operation 12/71 Type - PWR Capacity - 635 MWe	1972	216.8		975	78	16	661	1.16	0.4
	1973	286.8		774	1133			0.81	3.9
	1974	10.7	5.5	495	627			0.62	58.6
	1975	302.0	64.5	742	306	23	109	0.94	1.0
	1976	346.9	55.2	332	696	13	23	0.30	2.0
	1977	616.6	91.4	849	100	52	173	0.90	0.2
	1978	320.2	49.7	1599	764	99	360	0.53	2.1
	1979	415.0	59.9	1307	854	191	312	0.32	1.5
	1980	288.3	42.9	2151	424	167	737	0.42	2.2
	1981	418.2	57.2	1554	902	73	203	0.21	0.8
	1982	404.3	54.7	2167	330	145	494	0.45	2.2
	1983	454.4	60.3	1344	977	79	339	0.43	5.8
	1984	98.7	15.2		573				
	PEACH BOTTOM 2, 3 Docket 50-277, 50-278; DPR-44, -56 1st commercial operation 7/74, 12/74 Type - BWR Capacity - 1051, 1035 MWe	1975	1234.3	80.9	971	228	180	434	0.23
1976		1379.2	73.0	2136	840	223	1374	0.39	0.6
1977		1052.4	58.7	2827	2036	162	709	0.72	1.9
1978		1636.3	84.0	2244	1317	245	717	0.59	0.8
1979		1740.0	84.5	2276	1388	311	1596	0.61	0.8
1980		1374.2	66.3	2774	2302	273	1880	0.83	1.7
1981		1161.8	58.0	2857	2506	313	1347	0.88	2.2
1982		1583.3	76.9	2734	1977	331	2422	0.72	1.2
1983		824.7	40.5	3107	2963	225	2045	0.95	3.6
1984		1165.8	57.4	3313	2450			0.74	2.1

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rems or-csv)	Person-rems (-cSv) per Work Function Operations & Others	Person-rems (-cSv) per Contractor Station & Utility	Average Measurable Dose (rems or cSv)	Person-rems (-cSv)/MW-Yr	
PILGRIM 1 Docket 50-293; DPR-35 1st commercial operation 12/72 Type - BWR Capacity - 663 MWe	1973	484.0		230	126	49	77	0.55	0.3	
	1974	234.1	39.2	454	415			0.91	1.8	
	1975	308.1	71.3	473	798	142	656	1.69	2.6	
	1976	287.8	60.7	1317	2648	66	2582	2.01	9.2	
	1977	316.6	61.4	1875	3142	146	2996	1.68	9.9	
	1978	519.5	83.1	1667	1327	157	1170	0.80	2.5	
	1979	574.0	89.4	2458	1015	131	884	0.41	1.8	
	1980	360.3	56.2	3549	3626	207	3419	1.02	10.1	
	1981	408.9	65.9	2803	1836	70	1766	0.66	4.5	
	1982	389.9	63.9	2854	1539	314	1225	0.54	3.9	
	1983	559.5	87.2	2326	1162	296	886	0.50	2.1	
	1984	1.4	0.4	4542	4082	647	3435	0.90	-	
	POINT BEACH 1, 2 Docket 50-266, 50-301; DPR-24, -27 1st commercial operation 12/70, 10/72 Type - PWRs Capacity - 485, 485 MWe	1971	393.4			164				0.4
		1972	378.3			580				1.5
1973		693.7		501	588	72	516	1.17	0.8	
1974		760.2	81.3	400	295	70	225	0.74	0.4	
1975		801.2	82.9	339	459			1.35	0.6	
1976		857.3	86.7	313	370	58	312	1.18	0.4	
1977		873.9	87.3	417	429	63	366	1.03	0.5	
1978		914.4	90.9	336	320	71	249	0.99	0.3	
1979		808.0	80.8	610	644	65	579	1.06	0.8	
1980		727.2	82.5	561	598	60	538	1.07	0.8	
1981		760.4	83.6	773	596	83	513	0.77	0.8	
1982		757.2	84.3	767	609	72	537	0.79	0.8	
1983		648.2	72.7	1702	1403	81	1322	0.82	2.2	
1984		788.9	78.6	1372	789	121	668	0.56	1.0	
PRAIRIE ISLAND 1, 2 Docket 50-282, 50-306; DPR-42, -60 1st commercial operation 12/73, 12/74	1974	181.9	43.9	150	18			0.12	0.1	
	1975	836.0	83.3	477	123			0.26	0.1	
	1976	725.2	76.6	818	447	68	379	0.55	0.6	
1977	922.9	87.2	718	300	73	227	0.42	0.3		

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rems or-cSv)	Person-rems (-cSv) per Work Function Operations & Others	Person-rems (-cSv) per Contractor Station & Utility	Average Measurable Dose (rems or cSv)	Person-rems (-cSv)/MW-Yr
PRAIRIE ISLAND 1, 2 (Continued) Type - PWRs Capacity - 503, 500 MWe	1978	941.1	92.2	546	221	43	48	0.40	0.2
	1979	865.0	86.0	594	180	29	49	0.30	0.2
	1980	800.7	79.9	983	353	40	141	0.36	0.4
	1981	844.9	80.5	836	329	153	128	0.39	0.4
	1982	944.9	90.4	645	229	30	68	0.36	0.2
	1983	921.1	86.8	654	233	14	73	0.36	0.3
	1984	972.4	91.7	539	147	18	52	0.27	0.2
	1974	958.1	72.3	678	482	114	36	0.71	0.5
	1975	833.6	68.4	1083	1618	269	692	1.49	1.9
	1976	951.2	73.1	1225	1651	108	648	1.35	1.7
QUAD CITIES 1, 2 Docket 50-254, 50-265; DPR-29, -30 1st commercial operation 2/73, 3/73 Type - BWRs Capacity - 769, 769 MWe	1977	970.1	84.0	907	1031	108	373	1.14	1.1
	1978	1124.5	88.6	1207	1618	156	722	1.34	1.4
	1979	1075.0	84.6	1688	2158	215	1250	1.28	2.0
	1980	866.9	64.4	3089	4838	291	3657	1.57	5.6
	1981	1156.9	81.1	2246	3146	100	2623	1.40	2.7
	1982	1018.7	76.0	2314	3757	177	2653	1.62	3.7
	1983	1088.5	79.2	1802	2491	166	1937	1.38	2.3
	1984	994.6	65.7	1678	1579	122	1078	0.94	1.6
	1976	268.1	30.4	297	58	6	17	0.19	0.2
	RANCHO SECO Docket 50-312; DPR-54 1st commercial operation 4/75 Type - PWR Capacity - 873 MWe	1977	706.4	77.1	515	390	61	248	0.76
1978		607.7	80.5	508	323	76	176	0.64	0.5
1979		687.0	91.1	287	126	27	64	0.44	0.2
1980		530.9	60.4	890	412	110	281	0.46	0.8
1981		321.2	40.2	772	402	83	266	0.52	1.3
1982		409.5	53.3	766	337	49	217	0.44	0.8
1983		347.9	46.8	1338	787	158	604	0.59	2.3
1984		460.0	58.3	802	222	73	115	0.28	0.5

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (cSv) per Work Function Operations & Others	Person-rem (cSv) per Contractor Station & Utility	Average Meas'ble Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr
ROBINSON 2 Docket 50-261; DPR-23 1st commercial operation 3/71 Type - PWR Capacity - 665 MWe	1972	580.0		245	215	42	173	0.88	0.4
	1973	455.1		831	695	185	487	0.84	1.5
	1974	578.1	83.3	853	672			0.79	1.2
	1975	501.8	72.7	849	1142			1.34	2.3
	1976	585.5	84.7	597	715	30	685	1.20	1.2
	1977	511.5	85.2	634	455	52	403	0.72	0.9
	1978	480.5	72.0	943	963	63	900	1.02	2.0
	1979	482.0	70.8	1454	1188	60	1128	0.82	2.5
	1980	387.3	62.2	2009	1852	79	1773	0.92	4.8
	1981	426.6	73.0	1462	733	45	688	0.50	1.7
	1982	277.5	48.9	2011	1426	128	1298	0.71	5.1
	1983	409.8	75.5	2244	923	96	827	0.41	2.3
	1984	28.0	7.0	4127	2880	196	2684	0.70	-
	SALEM 1, 2 Docket 50-272, -311; DPR-70, -75 1st commercial operation 6/77, 10/81 Type - PWRs Capacity - 1079, 1106 MWe	1978	546.4	55.6	574	122	28	94	0.21
1979		250.0	25.5	1488	584	100	484	0.39	2.3
1980		680.6	69.2	1704	449	55	394	0.26	0.7
1981		743.0	78.1	1652	254	4	250	0.15	0.3
1982		1440.4	72.6	3228	1203	66	1137	0.37	0.8
1983		742.0	35.4	2383	581	10	571	0.24	0.8
1984		650.1	31.8	1395	681	10	671	0.70	1.0
SAN ONOFRE 1 Docket 50-206; DPR-13 1st commercial operation 1/68 Type - PWR Capacity - 436 MWe	1969	314.1		123	42	10	32	0.34	0.1
	1970	365.9		251	155	13	142	0.62	0.4
	1971	362.1		121	50	12	38	0.41	0.1
	1972	338.5		326	256	29	227	0.78	0.8
	1973	273.7		570	353	40	313	0.62	1.3
	1974	377.8	86.1	219	71			0.32	0.2
1975	389.0	87.4	424	292			0.69	0.7	

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem per Work Function Operations & Maint. & Others	Person-rem per Contract Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/ MW-Yr
SAN ONOFRE 1 (Continued)	1976	297.9	70.2	1330	880	147	629	0.66	2.9
	1977	281.2	63.7	985	847	77	451	0.86	3.0
	1978	323.2	80.2	764	401	25	234	0.52	1.2
	1979	401.0	90.2	521	139	23	65	0.27	0.3
	1980	97.3	22.3	3063	2387	219	2018	0.78	24.5
	1981	95.9	26.7	2902	3223	100	3104	1.11	33.6
	1982	61.6	15.7	3055	832	81	729	0.27	13.5
	1983	0.0	0.0	1701	155	31	113	0.09	-
	1984	34.7	9.4	4374	513	67	432	0.12	14.7
	1984	635.7	58.9	3140	473	38	398	0.15	0.7
SAN ONOFRE 2 * Docket 50-361; NPF-10 1st commercial operation 3/83 Type - PWR Capacity - 1070 MWe	1982	583.5	52.8	1965	570	67	57	0.29	1.0
1983	1663.7	75.0	1772	491	74	46	0.28	0.3	
1984	1481.9	69.0	2373	1117	153	111	0.47	0.8	
SEQUOYAH 1, 2 Docket 50-327, -328; DPR-77, -79 1st commercial operation 7/81, 6/82 Type - PWR Capacity - 1148, 1148 MWe	1977	649.1	84.7	445	152	26	92	0.34	0.2
1978	606.4	76.5	797	337	15	140	0.42	0.6	
1979	592.0	74.0	907	438	25	209	0.48	0.7	
1980	627.9	77.5	1074	532	82	195	0.50	0.8	
1981	599.1	72.7	1473	929	20	556	0.63	1.6	
1982	816.8	94.0	1045	272	17	105	0.26	0.3	

*San Onofre 2 and St. Lucie 2 were counted for the first time in 1984.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/ MW-Yr
ST. LUCIE 1, 2 (Continued)	1983	290.3	15.4	2211	1204	5	924	0.54	4.2
	1984	1183.0	69.6	2090	1263	41	808	0.60	1.1
SUMMER 1 * Docket 50-395; NPF-12 1st commercial operation 1/84 Type - PWR Capacity - 885 MWe	1984	504.6	61.1	1120	295	29	202	0.26	0.6
	1973	420.6		936	152			0.16	0.4
	1974	717.4	49.8	1715	884	72		0.51	1.2
	1975	1079.0	70.8	1948	1649	27		0.85	1.5
	1976	930.7	60.4	2753	3165	444	1065	1.15	3.4
	1977	1139.0	72.2	1860	2307	348	1873	1.24	2.0
	1978	1210.6	77.2	2203	1837	726	1380	0.83	1.5
	1979	343.0	42.3	5065	3584	173	1029	0.71	10.4
	1980	568.2	40.3	5317	3836	353	2975	0.72	6.6
	1981	907.6	59.3	3753	4244	428	3117	1.13	4.7
	1982	1323.3	88.5	1878	1490	399	3040	0.79	1.1
	1983	916.2	61.3	2754	3220	571	1786	1.17	3.5
	1984	1026.7	71.0	3198	2247	536	1575	0.70	2.2
SUSQUEHANNA 1 * Docket 50-387; NPF-14 1st commercial operation 6/83 Type - BWR Capacity - 1032 MWe	1984	719.9	72.6	2827	308	71	128	0.11	0.4

* Susquehanna 1 was counted for the first time in 1984.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (rem-cSv)	Person-rem (-cSv) per Operations & Others	Person-rem (-cSv) per Work Function Maintenance & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem-cSv)	Person-rem (-cSv)/MW-Yr	
*THREE MILE ISLAND 1, 2 Docket 50-289; DPR-50, -73 1st commercial operation-9/74, Type - PWRs Capacity - 776, 880 MWe	1975	675.9	82.2	131	73	23	263	18	0.56	0.1	
	1976	530.0	65.4	819	286	15	344	69	0.35	0.5	
	1977	664.5	80.9	1122	359	23	481	128	0.32	0.5	
	1978	690.0	85.1	1929	504	197	1195	235	0.26	0.7	
	1979	266.0	21.9	4024	1392	29	365	907	0.35	5.2	
	1980	0.0	0.0	2328	394	50	326	234	0.17	-	
	1981	0.0	0.0	2103	376	62	942	190	0.18	-	
	1982	0.0	0.0	2123	1004	79	1080	433	0.47	-	
	1983	0.0	0.0	1592	1159	49	639	637	0.73	-	
	1984	0.0	0.0	1079	688			330	0.64	-	
	TROJAN Docket 50-344; NPF-1 1st commercial operation 5/76 Type - PWR Capacity - 1080 MWe	1977	792.0	92.6	591	174	30	144	105	0.29	0.2
		1978	205.5	20.6	711	319	81	238	124	0.45	1.5
		1979	631.0	58.1	736	257	74	183	113	0.35	0.4
		1980	727.5	72.5	1159	421	77	344	305	0.36	0.6
1981		775.6	74.1	1311	609	113	496	363	0.46	0.8	
1982		579.5	60.8	977	419	76	343	168	0.42	0.7	
1983		494.2	62.4	969	307	35	272	129	0.32	0.6	
1984		567.0	54.4	1042	433	40	393	230	0.42	0.8	
1973		401.9		444	78	88	366	202	0.18	0.2	
1974		953.6		794	454	270	606	559	0.57	0.5	
TURKEY POINT 3, 4 Docket 50-250, 50-251; DPR-31, -41 1st commercial operation 12/72, 9/73 Type - PWRs Capacity - 666, 666 MWe	1975	1003.7	74.9	1176	876	89	1095	868	0.74	0.9	
	1976	974.2	71.2	1647	1184	94	942	522	0.72	1.2	
	1977	979.5	72.1	1319	1036	90	942	546	0.78	1.1	
	1978	1000.2	78.8	1336	1032	299	1381	997	0.77	1.0	
	1979	811.0	62.4	2002	1680	232	1419	1218	0.84	2.1	
	1980	990.6	73.6	1803	1651	274	1977	1854	0.92	1.7	
	1981	654.0	46.8	2932	2251	197	1922	1656	0.77	3.4	
	1982	915.7	65.2	2956	2119	272	2409	2119	0.72	2.3	
	1983	878.4	62.8	2930	2681	217	1038	876	0.92	3.1	
	1984	946.7	68.5	1010	1255	217	1038	876	0.62	1.3	


*Three Mile Island 1 and 2 are shutdown. They are still included in the count of commercial reactors.

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Functions Operations & Others	Person-rem (-cSv) per Contractor Station & Utility	Average Measurable Dose (rem or cSv)	Person-rem (-cSv)/ MW-Yr	
VERMONT YANKEE Docket 50-271; DPR-28 1st commercial operation 11/72 Type - BWR Capacity - 504 MWe	1973	222.1		244	85			0.35	0.4	
	1974	303.5		357	216	24	103	0.60	0.7	
	1975	429.0	87.8	282	153	70	63	0.54	0.4	
	1976	389.6	77.1	815	411	36	246	0.50	1.0	
	1977	423.5	85.1	641	258	83	90	0.40	0.6	
	1978	387.5	75.9	934	339	78	158	0.36	0.9	
	1979	414.0	82.1	1220	1170	546	642	0.96	2.8	
	1980	357.8	71.5	1443	1338	141	926	0.93	3.7	
	1981	429.1	84.6	1264	731	121	408	0.58	1.7	
	1982	501.0	96.0	481	205	60	80	0.43	0.4	
	1983	346.1	69.3	1316	1527	215	787	1.16	4.4	
	1984	398.1	79.0	954	603	80	307	0.63	1.5	
	YANKEE ROWE Docket 50-29; DPR-3 1st commercial operation 7/61 Type - PWR Capacity - 167 MWe	1969	138.3		193	215	83	78	1.11	1.5
		1970	146.1		355	255	90	158	0.72	1.7
1971		173.5		155	90	46	19	0.58	0.5	
1972		78.7		282	255	63	146	0.90	3.2	
1973		127.1		133	99		47	0.74	0.8	
1974		111.3		243	205		99	0.84	1.8	
1975		145.1	82.4	249	116	52	66	0.47	0.8	
1976		152.2	89.8	152	59	17	4	0.39	0.4	
1977		124.6	73.9	725	356	28	174	0.49	2.9	
1978		145.0	81.0	565	282	26	95	0.50	1.9	
1979		149.0	81.6	441	127	16	52	0.29	0.9	
1980		35.6	22.0	502	213	6	90	0.42	6.0	
1981		109.0	74.4	515	302	8	136	0.59	2.8	
1982		108.6	73.4	814	474	6	215	0.54	4.4	
1983	163.5	91.4	395	68	19	4	0.17	0.4		
1984	124.8	71.4	654	348	15	141	0.53	2.8		

Appendix C (Continued)
Personnel, Dose and Power Generation Summary

Reporting Organization	Year	Mega-watt-Years (MW-Yr)	Unit Availability Factor	Total Personnel With Measurable Doses	Collective Dose (person-rem or-cSv)	Person-rem (-cSv) per Work Function Operations & Maint. & Others	Person-rem (-cSv) per Contract-Station & Utility	Average Measurable Dose (rem or-cSv)	Person-rem (-cSv)/MW-Yr
ZION 1, 2 Docket 50-295, 50-304; DPR-39, -48 1st commercial operation 12/73, 9/74 Type - PWRs Capacity - 1040, 1040 MWe	1974	425.3	71.1	306	56		13	0.18	0.1
	1975	1181.5	74.9	436	127	110	49	0.29	0.1
	1976	1134.9	61.9	774	571	507	257	0.74	0.5
	1977	1358.6	75.0	784	1003	960	561	1.28	0.7
	1978	1613.5	80.2	1104	1017	867	418	0.92	0.6
	1979	1238.0	67.6	1472	1274	1106	747	0.87	1.0
	1980	1411.2	74.1	1363	920	823	560	0.67	0.7
	1981	1366.9	72.3	1754	1720	1670	1155	0.98	1.3
	1982	1186.4	64.3	1575	2103	2061	1688	1.34	1.8
	1983	1222.3	66.8	1285	1311	1193	905	1.02	1.1
	1984	1389.9	69.5	1110	786	763	556	0.71	0.6



APPENDIX D
Number of Personnel and Collective Dose by Work and Job Function
1984

Note: A 't' preceding a plant name indicates that the licensee's input was recategorized by NRC staff.

Appendix D

NUMBER OF PERSONNEL AND PERSON-REM BY WORK AND JOB FUNCTION

PLANT: * ARKANSAS 1,2 (PMR)

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSON-REMS		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSON-REMS & OTHERS	TOTAL PERSON-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	PERSONS	PERSON-REMS					
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	25	0	48	0.000	5,782	0.000	11,401	0.000	11,401
OPERATING PERSONNEL	62	0	0	0.000	25,863	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	44	0	62	0.000	14,642	0.000	17,892	0.000	17,892
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	2	1	9	0.249	0.249	0.109	1,707	0.109	1,707
TOTAL	133	1	119	0.253	46,536	0.109	31,000	0.109	77,645
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	113	7	77	1.792	48,926	1.792	24,844	0.000	24,844
OPERATING PERSONNEL	2	0	0	0.254	0.254	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	31	0	19	7.364	7,364	0.000	3,431	0.000	3,431
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	1	2	0.101	0.000	0.101	1,506	0.101	1,506
TOTAL	146	8	98	2.52	56,544	1.893	29,781	0.000	88,218
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	1	0	49	0.133	0.133	0.000	23,822	0.000	23,822
OPERATING PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	5	1.405	1,405	0.000	0.622	0.000	0.622
SUPERVISORY PERSONNEL	0	0	1	0.000	0.000	0.000	0.182	0.000	0.182
ENGINEERING PERSONNEL	1	0	5	0.347	0.347	0.000	0.777	0.000	0.777
TOTAL	6	0	60	1.885	1,885	0.000	25,403	0.000	27,288
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	98	6	474	1.594	43,684	1.594	288,310	0.000	288,310
OPERATING PERSONNEL	9	0	0	0.000	4,695	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	34	0	52	13.126	13,126	0.000	20,378	0.000	20,378
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	1	3	30	0.224	0.224	0.375	21,585	0.375	21,585
TOTAL	142	9	556	7.07	61,729	1.969	330,273	0.750	393,971
WASTE PROCESSING									
MAINTENANCE PERSONNEL	4	0	29	0.000	2,918	0.000	18,788	0.000	18,788
OPERATING PERSONNEL	3	0	0	0.502	0.502	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	22	0	5	14.703	14,703	0.000	0.866	0.000	0.866
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	29	0	34	18.123	18,123	0.000	19,654	0.000	37,777
REFUELING									
MAINTENANCE PERSONNEL	55	3	36	1.077	38,073	1.077	14,662	0.000	14,662
OPERATING PERSONNEL	14	0	0	4.995	4,995	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	0	42	0.646	0.646	0.000	10,151	0.000	10,151
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	4	4	1.717	1,618	0.000	2,820	0.000	2,820
TOTAL	75	6	82	2.794	45,332	2.794	27,633	0.000	75,759
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	296	16	713	1025	139,516	4,463	381,827	525,806	525,806
OPERATING PERSONNEL	90	0	90	323	36,309	0.000	0.000	36,309	36,309
HEALTH PHYSICS PERSONNEL	138	0	185	51,886	51,886	0.000	53,340	105,226	105,226
SUPERVISORY PERSONNEL	0	0	1	1	0.000	0.000	0.182	0.182	0.182
ENGINEERING PERSONNEL	7	8	50	65	2,438	2,302	28,395	33,135	33,135
GRAND TOTAL	531	24	949	1504	230,149	6,765	463,744	700,658	700,658

*Workers may be counted in more than one category.

Appendix D(cont.)

PLANT: BEAVER VALLEY (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSON-REMS		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSON-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS				
REACTOR OPERATIONS & SURV.								
MAINTENANCE PERSONNEL	5	0	6	0.000	2,730	0.000	1,870	0.000
OPERATING PERSONNEL	61	0	0	0.000	21,325	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	45	0	59	0.000	29,783	0.000	43,135	0.000
SUPERVISORY PERSONNEL	14	0	1	0.000	4,880	0.000	0.135	0.000
ENGINEERING PERSONNEL	22	0	17	0.000	9,022	0.000	6,740	0.000
TOTAL	147	0	83	0.000	67,740	0.000	51,880	119,620
ROUTINE MAINTENANCE								
MAINTENANCE PERSONNEL	103	0	200	0.000	77,633	0.000	120,877	0.000
OPERATING PERSONNEL	4	0	0	0.000	1,300	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	12	0	2	0.000	6,219	0.000	1,832	0.000
SUPERVISORY PERSONNEL	9	0	3	0.000	5,316	0.000	1,685	0.000
ENGINEERING PERSONNEL	11	0	13	0.000	6,190	0.000	10,630	0.000
TOTAL	139	0	218	0.000	96,658	0.000	135,024	231,682
IN-SERVICE INSPECTION								
MAINTENANCE PERSONNEL	0	0	36	0.000	0.050	0.000	43,690	0.000
OPERATING PERSONNEL	1	0	0	0.000	0.230	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.010	0.000	0.130	0.000
SUPERVISORY PERSONNEL	1	0	0	0.000	0.175	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	0	4	0.000	1,510	0.000	5,580	0.000
TOTAL	5	0	40	0.000	1,975	0.000	49,400	51,375
SPECIAL MAINTENANCE								
MAINTENANCE PERSONNEL	6	0	72	0.000	7,705	0.000	23,485	0.000
OPERATING PERSONNEL	0	0	0	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.110	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0.000	0.175	0.000	0.000	0.000
ENGINEERING PERSONNEL	1	0	5	0.000	0.360	0.000	1,960	0.000
TOTAL	7	0	77	0.000	8,350	0.000	25,445	33,795
WASTE PROCESSING								
MAINTENANCE PERSONNEL	1	0	4	0.000	0.410	0.000	1,675	0.000
OPERATING PERSONNEL	2	0	0	0.000	1,165	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.050	0.000	0.225	0.000
SUPERVISORY PERSONNEL	2	0	0	0.000	0.735	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0.000	0.010	0.000	0.020	0.000
TOTAL	5	0	4	0.000	2,370	0.000	1,920	4,290
REFUELING								
MAINTENANCE PERSONNEL	11	0	23	0.000	11,975	0.000	18,655	0.000
OPERATING PERSONNEL	1	0	0	0.000	0.580	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.010	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	0	3	0.000	0.860	0.000	2,335	0.000
ENGINEERING PERSONNEL	4	0	4	0.000	3,720	0.000	6,555	0.000
TOTAL	18	0	30	0.000	17,145	0.000	27,545	44,690
TOTAL BY JOB FUNCTION								
MAINTENANCE PERSONNEL	126	0	341	0.000	100,503	0.000	210,252	310,755
OPERATING PERSONNEL	69	0	0	0.000	24,600	0.000	0.000	24,600
HEALTH PHYSICS PERSONNEL	57	0	61	0.000	36,182	0.000	45,322	81,504
SUPERVISORY PERSONNEL	28	0	35	0.000	12,141	0.000	4,155	16,296
ENGINEERING PERSONNEL	41	0	43	0.000	20,812	0.000	31,485	52,297
GRAND TOTAL	321	0	452	0.000	194,238	0.000	291,214	485,452

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

* † PLANT: BIG ROCK POINT (BWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		STATION EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		TOTAL PERSONS		TOTAL PERSON-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	PERSONS	EMPLOYEES	PERSONS	EMPLOYEES	PERSONS	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSON-REMS
REACTOR OPERATIONS & SURV.	0	2	0	0.207	0	0.207	0.557	0.000	0.000	0.557	0.000	0.557
MAINTENANCE PERSONNEL	30	1	0	20.644	0	20.644	0.145	0.007	0.000	0.145	0.007	0.152
OPERATING PERSONNEL	12	0	0	5.233	0	5.233	0.102	0.102	0.000	0.102	0.000	0.204
HEALTH PHYSICS PERSONNEL	3	0	0	0.775	0	0.775	0.075	0.023	0.000	0.075	0.023	0.100
SUPERVISORY PERSONNEL	1	3	0	0.401	0	0.401	0.929	0.003	0.000	0.929	0.003	0.932
ENGINEERING PERSONNEL	46	6	0	27.260	52	27.260	1.731	0.135	0.000	1.731	0.135	1.866
TOTAL	92	12	0	52	52	52	6.292	0.265	0.000	6.292	0.265	6.557
ROUTINE MAINTENANCE	18	22	3	5.941	3	5.941	5.830	1.075	0.000	5.830	1.075	6.905
MAINTENANCE PERSONNEL	3	1	0	0.859	0	0.859	0.246	0.000	0.000	0.246	0.000	0.246
OPERATING PERSONNEL	11	0	5	2.639	0	2.639	0.133	1.574	0.000	0.133	1.574	1.707
HEALTH PHYSICS PERSONNEL	6	0	0	5.732	0	5.732	0.083	0.013	0.000	0.083	0.013	0.096
SUPERVISORY PERSONNEL	0	0	0	0.005	0	0.005	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	38	23	8	15.176	69	15.176	6.292	2.462	0.000	6.292	2.462	8.754
TOTAL	33	45	13	23	23	23	1.155	1.317	0.000	1.155	1.317	2.472
IN-SERVICE INSPECTION	0	4	3	0.039	3	0.039	0.079	0.005	0.000	0.079	0.005	0.084
MAINTENANCE PERSONNEL	1	0	0	0.287	0	0.287	0.005	0.355	0.000	0.005	0.355	0.360
OPERATING PERSONNEL	3	0	2	0.572	0	0.572	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.050	0	0.050	0.335	0.007	0.000	0.335	0.007	0.342
SUPERVISORY PERSONNEL	1	1	0	0.182	1	0.182	1.574	1.684	0.000	1.574	1.684	3.258
ENGINEERING PERSONNEL	5	5	5	1.130	15	1.130	6.887	3.561	0.000	6.887	3.561	10.448
TOTAL	15	17	10	15.598	17	15.598	0.524	0.000	0.000	0.524	0.000	0.524
SPECIAL MAINTENANCE	2	2	0	0.604	0	0.604	0.030	1.596	0.000	0.030	1.596	1.626
MAINTENANCE PERSONNEL	13	0	5	6.163	0	6.163	0.051	0.000	0.000	0.051	0.000	0.051
OPERATING PERSONNEL	7	0	0	1.761	0	1.761	0.188	0.853	0.000	0.188	0.853	1.041
HEALTH PHYSICS PERSONNEL	1	1	2	0.359	2	0.359	7.680	6.010	0.000	7.680	6.010	13.690
SUPERVISORY PERSONNEL	1	1	0	0.359	1	0.359	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	38	20	17	24.485	75	24.485	0.132	0.057	0.000	0.132	0.057	0.189
TOTAL	15	20	17	24.485	75	24.485	0.132	0.057	0.000	0.132	0.057	0.189
WASTE PROCESSING	7	0	0	1.644	0	1.644	0.000	0.000	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	8	0	0	1.645	0	1.645	0.011	0.004	0.000	0.011	0.004	0.015
OPERATING PERSONNEL	2	0	0	0.874	0	0.874	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0.280	0	0.280	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0.000	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	17	0	0	6.443	17	6.443	3.283	6.075	0.000	3.283	6.075	9.358
TOTAL	17	0	0	6.443	17	6.443	3.283	6.075	0.000	3.283	6.075	9.358
REFUELING	11	1	0	3.204	0	3.204	0.157	0.000	0.000	0.157	0.000	0.157
MAINTENANCE PERSONNEL	22	0	0	7.135	0	7.135	0.013	0.075	0.000	0.013	0.075	0.088
OPERATING PERSONNEL	4	0	0	0.910	0	0.910	0.000	0.447	0.000	0.000	0.447	0.447
HEALTH PHYSICS PERSONNEL	0	0	1	0.062	1	0.062	3.113	5.202	0.000	3.113	5.202	8.315
SUPERVISORY PERSONNEL	0	6	7	0.002	7	0.002	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	37	7	8	11.313	52	11.313	6.075	20.671	0.000	6.075	20.671	26.746
TOTAL	37	7	8	11.313	52	11.313	6.075	20.671	0.000	6.075	20.671	26.746
TOTAL BY JOB FUNCTION	51	46	16	26.633	113	26.633	14.707	5.953	0.000	14.707	5.953	20.660
MAINTENANCE PERSONNEL	66	4	0	31.174	70	31.174	0.994	0.363	0.000	0.994	0.363	1.357
OPERATING PERSONNEL	45	0	12	16.391	57	16.391	0.217	3.506	0.000	0.217	3.506	3.723
HEALTH PHYSICS PERSONNEL	16	0	17	8.660	17	8.660	0.209	0.483	0.000	0.209	0.483	0.692
SUPERVISORY PERSONNEL	3	11	9	0.949	23	0.949	4.565	6.118	0.000	4.565	6.118	10.683
ENGINEERING PERSONNEL	181	61	38	83.807	280	83.807	20.692	16.423	0.000	20.692	16.423	37.115
GRAND TOTAL	293	293	293	120.922	293	120.922	120.922	120.922	0.000	120.922	120.922	241.844

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: BROWNS FERRY 1,2,3 (BWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSON-REMS		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSON-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSONS								
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	45	43	0	0	8,200	12,400	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	121	0	0	0	30,300	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	62	3	95	0	29,000	0.500	60.500	0.000	0.000	0.000	0.000	60.500
SUPERVISORY PERSONNEL	1	56	16	0	0.100	17,900	0.000	0.000	0.000	0.000	0.000	4.000
ENGINEERING PERSONNEL	0	24	0	0	0.000	6,700	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	229	126	111	0	67,600	35,500	64,500	466	67,600	35,500	64,500	167,600
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	452	557	0	0	252,000	317,400	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	95	0	0	0	24,300	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	49	2	96	0	14,300	0.300	53.900	0.000	0.300	0.000	0.000	53.900
SUPERVISORY PERSONNEL	0	13	47	0	0.000	4,200	0.000	0.000	0.000	0.000	0.000	26.100
ENGINEERING PERSONNEL	0	28	0	0	0.000	11,200	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	596	600	143	0	290,600	333,100	80,000	1339	290,600	333,100	80,000	703,700
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	7	0	0	0	0.806	0.000	0.000	0.000	0.806	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	14	0	0	0.000	2.800	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	7	14	0	0	0.806	2.800	0.000	21	0.806	2.800	0.000	3.606
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	39	385	1	0	16,600	160,800	0.200	0.000	0.000	0.000	0.200	0.200
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	13	0	41	0	4,600	0.000	29.300	0.000	0.000	0.000	0.000	29.300
SUPERVISORY PERSONNEL	1	61	177	0	0.100	79,200	216.300	0.000	0.100	0.000	0.000	216.300
ENGINEERING PERSONNEL	0	13	0	0	0.000	4,300	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	53	459	219	0	21,300	244,300	245.800	731	21,300	244,300	245.800	511.400
WASTE PROCESSING												
MAINTENANCE PERSONNEL	23	0	0	0	7,300	0.000	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	11	0	0	0	5,400	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	3	0	1,300	0.000	3.500	0.000	0.000	0.000	0.000	3.500
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	38	0	3	0	14,000	0.000	3.500	41	14,000	0.000	3.500	17.500
REFUELING												
MAINTENANCE PERSONNEL	2	31	0	0	1,200	6,200	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	15	0	0	0	4,200	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	7	0	0.000	0.000	1.500	0.000	0.000	0.000	0.000	1.500
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	1	0	0	0.000	0.100	0.000	0.000	0.000	0.100	0.000	0.000
TOTAL	17	32	7	0	5,400	6,300	1.500	56	5,400	6,300	1.500	13.200
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	568	1016	1	1	286,106	496,800	0.200	1585	286,106	496,800	0.200	783,106
OPERATING PERSONNEL	242	0	0	0	64,200	0.000	0.000	242	64,200	0.000	0.000	64,200
HEALTH PHYSICS PERSONNEL	128	5	242	0	49,200	0.800	148.700	375	49,200	0.800	148.700	198.700
SUPERVISORY PERSONNEL	2	144	240	0	0.200	104,100	246.400	386	0.200	104,100	246.400	350.700
ENGINEERING PERSONNEL	0	66	0	0	0.000	20,300	0.000	66	0.000	20,300	0.000	20,300
GRAND TOTAL	940	1231	483	0	399,706	622,000	395,300	2654	399,706	622,000	395,300	1417,006

* Workers may be counted in more than one category.

Appendix D (cont.)

* PLANT: BRUNSWICK 1.2 (BHR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSON-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	PERSON-REMS	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.																
MAINTENANCE PERSONNEL	1	3	0	0	0	0	0	0	0	0	0	0	0	0	0	1.204
OPERATING PERSONNEL	111	0	0	0	0	0	0	0	105.533	0	0	0	0	0	0	0.200
HEALTH PHYSICS PERSONNEL	31	15	0	0	0	0	0	0	18.914	0	0	0	0	0	0	16.927
SUPERVISORY PERSONNEL	2	0	0	0	0	0	0	0	0.846	0	0	0	0	0	0	0.000
ENGINEERING PERSONNEL	19	0	0	0	0	0	0	0	7.594	0	0	0	0	0	0	0.451
TOTAL	164	18	0	0	0	0	182	182	133.790	0	0	0.235	0	0	0	18.782
ROUTINE MAINTENANCE																
MAINTENANCE PERSONNEL	260	357	20	0	0	0	0	0	263.671	0	0	23.355	0	0	0	239.597
OPERATING PERSONNEL	0	19	0	0	0	0	0	0	0.000	0	0	0.000	0	0	0	8.763
HEALTH PHYSICS PERSONNEL	11	28	0	0	0	0	0	0	14.977	0	0	0.000	0	0	0	30.997
SUPERVISORY PERSONNEL	0	6	0	0	0	0	0	0	0.085	0	0	0.020	0	0	0	2.073
ENGINEERING PERSONNEL	34	144	5	0	0	0	0	0	14.052	0	0	1.503	0	0	0	128.585
TOTAL	305	554	25	0	0	0	884	884	292.785	0	0	24.878	0	0	0	410.015
IN-SERVICE INSPECTION																
MAINTENANCE PERSONNEL	15	57	1	0	0	0	0	0	5.572	0	0	1.557	0	0	0	30.691
OPERATING PERSONNEL	0	1	0	0	0	0	0	0	0.000	0	0	0.000	0	0	0	0.570
HEALTH PHYSICS PERSONNEL	6	15	0	0	0	0	0	0	7.806	0	0	0.000	0	0	0	16.156
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0.045	0	0	0.000	0	0	0	0.015
ENGINEERING PERSONNEL	12	80	1	0	0	0	0	0	4.480	0	0	0.525	0	0	0	90.711
TOTAL	33	153	2	0	0	0	188	188	17.903	0	0	2.082	0	0	0	138.143
SPECIAL MAINTENANCE																
MAINTENANCE PERSONNEL	267	1021	99	0	0	0	0	0	208.116	0	0	116.778	0	0	0	1404.156
OPERATING PERSONNEL	0	101	0	0	0	0	0	0	0.000	0	0	0.000	0	0	0	132.460
HEALTH PHYSICS PERSONNEL	32	83	0	0	0	0	0	0	43.551	0	0	0.000	0	0	0	90.136
SUPERVISORY PERSONNEL	0	6	0	0	0	0	0	0	0.168	0	0	0.135	0	0	0	1.798
ENGINEERING PERSONNEL	47	256	18	0	0	0	0	0	23.235	0	0	8.735	0	0	0	157.798
TOTAL	346	1467	118	0	0	0	1931	1931	275.070	0	0	125.668	0	0	0	1786.348
WASTE PROCESSING																
MAINTENANCE PERSONNEL	35	53	4	0	0	0	0	0	14.486	0	0	4.671	0	0	0	32.949
OPERATING PERSONNEL	24	0	0	0	0	0	0	0	14.705	0	0	0.000	0	0	0	0.142
HEALTH PHYSICS PERSONNEL	15	5	0	0	0	0	0	0	12.154	0	0	0.000	0	0	0	5.011
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0.000	0	0	0.000	0	0	0	0.000
ENGINEERING PERSONNEL	1	3	0	0	0	0	0	0	0.175	0	0	0.100	0	0	0	1.099
TOTAL	75	61	4	0	0	0	140	140	41.520	0	0	4.771	0	0	0	39.201
REFUELING																
MAINTENANCE PERSONNEL	25	69	8	0	0	0	0	0	17.952	0	0	9.342	0	0	0	102.055
OPERATING PERSONNEL	6	0	0	0	0	0	0	0	5.554	0	0	0.000	0	0	0	0.085
HEALTH PHYSICS PERSONNEL	6	15	0	0	0	0	0	0	7.730	0	0	0.000	0	0	0	15.998
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0.010	0	0	0.000	0	0	0	0.000
ENGINEERING PERSONNEL	5	39	3	0	0	0	0	0	1.571	0	0	1.029	0	0	0	22.129
TOTAL	42	123	11	0	0	0	176	176	32.817	0	0	10.371	0	0	0	140.267
TOTAL BY JOB FUNCTION																
MAINTENANCE PERSONNEL	603	1560	132	0	0	0	0	0	510.700	0	0	155.703	0	0	0	1810.652
OPERATING PERSONNEL	141	121	0	0	0	0	0	0	125.792	0	0	0.035	0	0	0	142.220
HEALTH PHYSICS PERSONNEL	101	161	0	0	0	0	0	0	105.132	0	0	0.000	0	0	0	175.225
SUPERVISORY PERSONNEL	2	1	1	0	0	0	0	0	1.154	0	0	0.185	0	0	0	3.886
ENGINEERING PERSONNEL	118	667	27	0	0	0	0	0	51.107	0	0	12.082	0	0	0	400.773
GRAND TOTAL	965	2376	160	0	0	0	3501	3501	793.885	0	0	168.005	0	0	0	2532.756

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: * CALVERT CLIFFS 1,2 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			TOTAL PERSON-REMS		
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSON-REMS	TOTAL PERSON-REMS
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	5	7	0		0.896	1.352	0.000	0.000	
OPERATING PERSONNEL	61	0	0		25.060	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	22	2	26		8.684	0.609	10.728	0.000	
SUPERVISORY PERSONNEL	4	1	0		0.505	0.230	0.000	0.000	
ENGINEERING PERSONNEL	2	0	0		0.230	0.000	0.000	0.000	
TOTAL	94	10	26	130	35.375	2.191	10.728	0.000	48.294
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	129	49	32		39.631	10.566	7.235	0.000	
OPERATING PERSONNEL	30	0	1		8.403	0.000	0.280	0.000	
HEALTH PHYSICS PERSONNEL	36	3	34		19.116	0.326	12.138	0.000	
SUPERVISORY PERSONNEL	2	0	1		0.274	0.000	0.353	0.000	
ENGINEERING PERSONNEL	4	0	3		0.601	0.000	0.143	0.000	
TOTAL	201	52	71	324	68.025	10.892	20.149	0.000	99.066
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	18	36	16		11.093	40.042	7.046	0.000	
OPERATING PERSONNEL	1	0	0		0.194	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	10	3	4		1.812	0.322	0.686	0.000	
SUPERVISORY PERSONNEL	1	3	2		1.890	0.582	0.718	0.000	
ENGINEERING PERSONNEL	4	0	0		1.245	0.000	0.000	0.000	
TOTAL	34	42	22	98	16.234	40.946	8.450	0.000	65.630
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	92	35	22		42.711	9.129	4.884	0.000	
OPERATING PERSONNEL	9	0	0		4.275	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	8	4	5		3.581	1.578	1.897	0.000	
SUPERVISORY PERSONNEL	1	0	3		0.235	0.000	0.577	0.000	
ENGINEERING PERSONNEL	3	0	4		0.595	0.000	0.830	0.000	
TOTAL	113	39	34	186	51.397	10.707	8.188	0.000	70.292
WASTE PROCESSING									
MAINTENANCE PERSONNEL	4	0	2		1.322	0.000	0.656	0.000	
OPERATING PERSONNEL	2	0	0		0.281	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	28	10	24		21.683	2.430	9.461	0.000	
SUPERVISORY PERSONNEL	1	0	1		1.413	0.000	0.152	0.000	
ENGINEERING PERSONNEL	0	0	0		0.000	0.000	0.000	0.000	
TOTAL	35	10	27	72	24.699	2.430	10.269	0.000	37.398
REFUELING									
MAINTENANCE PERSONNEL	52	41	6		30.050	19.036	1.308	0.000	
OPERATING PERSONNEL	8	0	0		1.429	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	7	6	12		1.438	1.145	2.864	0.000	
SUPERVISORY PERSONNEL	1	0	1		0.111	0.000	0.101	0.000	
ENGINEERING PERSONNEL	2	0	1		0.267	0.000	0.135	0.000	
TOTAL	70	47	20	137	33.295	20.181	4.408	0.000	57.884
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	300 (180)	168 (121)	78 (69)	546 (370)	125.703	80.125	21.129	0.000	226.957
OPERATING PERSONNEL	111 (95)	0 (1)	1 (1)	112 (97)	39.642	0.000	0.280	0.000	39.922
HEALTH PHYSICS PERSONNEL	111 (57)	28 (15)	105 (68)	244 (140)	56.314	6.410	37.774	0.000	100.498
SUPERVISORY PERSONNEL	10 (13)	4 (3)	10 (9)	24 (25)	4.428	0.812	1.901	0.000	7.141
ENGINEERING PERSONNEL	15 (16)	0 (0)	6 (6)	21 (22)	2.938	0.000	1.108	0.000	4.046
GRAND TOTAL	547 (361)	200 (140)	200 (133)	947 (654)	229.025	87.347	62.192	0.000	378.564

*Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)
 NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: *COOK 1,2	(PMR)	1984				TOTAL PERSONS	TOTAL PERSON-REMS			
		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	STATION EMPLOYEES		UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSON-REMS	
WORK & JOB FUNCTION		NUMBER OF PERSONNEL (>100 M-REM)				TOTAL PERSONS	TOTAL PERSON-REMS			
REACTOR OPERATIONS & SURV.		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSON-REMS	TOTAL PERSON-REMS
MAINTENANCE PERSONNEL	3	0	8	8	19	0.380	0.000	1.485	2.365	2.365
OPERATING PERSONNEL	60	1	8	8	71	14.673	0.165	4.914	20.752	20.752
HEALTH PHYSICS PERSONNEL	10	0	42	0	52	1.809	0.000	14.125	16.634	16.634
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	1	4	1	1	7	0.100	0.595	0.100	0.795	0.795
TOTAL	74	5	59	138	246	16.962	0.760	20.624	38.346	38.346
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	106	5	311	0	422	77.885	2.404	166.632	246.921	246.921
OPERATING PERSONNEL	26	0	10	0	36	7.713	0.000	2.959	10.672	10.672
HEALTH PHYSICS PERSONNEL	27	0	43	0	70	7.674	0.000	11.035	18.709	18.709
SUPERVISORY PERSONNEL	6	1	3	0	10	2.104	0.589	1.041	3.734	3.734
ENGINEERING PERSONNEL	8	2	6	0	16	2.012	0.223	1.335	3.570	3.570
TOTAL	173	8	373	554	1008	97.388	3.216	183.002	283.606	283.606
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	16	1	141	0	158	5.629	0.703	77.451	83.783	83.783
OPERATING PERSONNEL	19	0	8	0	27	3.671	0.000	1.356	5.027	5.027
HEALTH PHYSICS PERSONNEL	7	0	43	0	50	0.881	0.000	12.509	13.390	13.390
SUPERVISORY PERSONNEL	0	0	2	0	2	0.000	0.000	0.271	0.271	0.271
ENGINEERING PERSONNEL	2	1	8	0	11	0.467	0.125	1.502	2.094	2.094
TOTAL	44	2	202	248	296	10.648	0.828	93.089	104.565	104.565
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	9	3	246	0	258	1.521	0.663	171.518	173.742	173.742
OPERATING PERSONNEL	3	0	22	0	25	0.479	0.000	5.685	6.164	6.164
HEALTH PHYSICS PERSONNEL	2	0	28	0	30	0.235	0.000	6.742	6.977	6.977
SUPERVISORY PERSONNEL	0	1	3	0	4	0.000	0.297	0.551	0.848	0.848
ENGINEERING PERSONNEL	2	6	8	0	16	0.450	1.325	4.933	6.708	6.708
TOTAL	16	10	307	333	656	2.685	2.285	189.429	194.399	194.399
WASTE PROCESSING										
MAINTENANCE PERSONNEL	14	0	44	0	58	5.144	0.000	16.505	21.649	21.649
OPERATING PERSONNEL	0	0	1	0	1	0.000	0.000	0.570	0.570	0.570
HEALTH PHYSICS PERSONNEL	4	0	5	0	9	0.629	0.000	2.172	2.801	2.801
SUPERVISORY PERSONNEL	3	0	0	0	3	1.004	0.000	0.000	1.004	1.004
ENGINEERING PERSONNEL	1	0	0	0	1	0.260	0.000	0.000	0.260	0.260
TOTAL	22	0	50	72	144	7.037	0.000	19.247	26.284	26.284
REFUELING										
MAINTENANCE PERSONNEL	17	1	43	0	61	3.521	0.209	27.462	31.192	31.192
OPERATING PERSONNEL	6	0	3	0	9	1.978	0.000	2.639	4.617	4.617
HEALTH PHYSICS PERSONNEL	0	0	13	0	13	0.000	0.000	2.827	2.827	2.827
SUPERVISORY PERSONNEL	1	0	0	0	1	0.404	0.000	0.000	0.404	0.404
ENGINEERING PERSONNEL	3	0	1	0	4	0.406	0.000	0.165	0.571	0.571
TOTAL	27	1	60	88	175	6.309	0.209	33.093	39.611	39.611
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	165 (111)	10 (6)	793 (581)	968 (698)	1934 (1496)	94.080	3.979	461.053	559.112	559.112
OPERATING PERSONNEL	114 (81)	1 (1)	52 (35)	167 (117)	234 (164)	28.514	0.165	18.123	46.802	46.802
HEALTH PHYSICS PERSONNEL	50 (35)	0 (0)	174 (73)	224 (108)	448 (213)	11.228	0.000	49.410	60.638	60.638
SUPERVISORY PERSONNEL	10 (9)	2 (1)	8 (5)	20 (15)	39 (30)	3.512	0.886	1.863	6.261	6.261
ENGINEERING PERSONNEL	17 (13)	13 (12)	24 (22)	54 (47)	108 (92)	3.695	2.268	8.035	13.998	13.998
GRAND TOTAL	356 (249)	26 (20)	1051 (716)	1433 (985)	5066 (3720)	141.029	7.238	538.484	686.811	686.811

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: COOPER STATION (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES		STATION EMPLOYEES	UTILITY EMPLOYEES	
REACTOR OPERATIONS & SURV.	9	16	163	39,731	0.500	0.615
MAINTENANCE PERSONNEL	47	0		19,972	0.000	0.000
OPERATING PERSONNEL	18	0		11,120	0.000	0.000
HEALTH PHYSICS PERSONNEL	16	7		3,410	0.000	0.626
SUPERVISORY PERSONNEL	18	6		4,729	0.000	0.092
ENGINEERING PERSONNEL	108	7	163	39,731	0.146	1.386
TOTAL	109	36	194	81,829	0.426	2,719
ROUTINE MAINTENANCE	109	0		79,091	0.000	6,079
MAINTENANCE PERSONNEL	3	0		0.022	0.000	0.000
OPERATING PERSONNEL	13	0		1,317	0.000	0.000
HEALTH PHYSICS PERSONNEL	5	6		0.924	0.000	0.000
SUPERVISORY PERSONNEL	3	12		0.475	0.000	1.158
ENGINEERING PERSONNEL	133	7	194	81,829	0.426	8,617
TOTAL	0	8		0.000	0.000	4,445
IN-SERVICE INSPECTION	1	0		0.005	0.000	0.000
MAINTENANCE PERSONNEL	0	1		0.000	0.000	0.007
OPERATING PERSONNEL	0	0		0.101	0.000	0.000
HEALTH PHYSICS PERSONNEL	2	1		0.000	0.000	0.160
SUPERVISORY PERSONNEL	0	1		0.000	0.052	0.000
ENGINEERING PERSONNEL	3	10	14	0.106	0.052	4,612
TOTAL	0	412		0.000	0.456	471,449
SPECIAL MAINTENANCE	37	0		3,258	0.000	0.000
MAINTENANCE PERSONNEL	16	17		8,829	0.000	13,263
OPERATING PERSONNEL	3	68		0.438	1,331	83,680
HEALTH PHYSICS PERSONNEL	6	12		0.429	2,049	5,171
SUPERVISORY PERSONNEL	62	509	585	12,954	3,836	573,563
ENGINEERING PERSONNEL	0	2		0.772	0.000	0.106
TOTAL	12	0		3,341	0.000	0.000
WASTE PROCESSING	20	0		2,715	0.000	0.000
MAINTENANCE PERSONNEL	15	0		0.154	0.000	0.000
OPERATING PERSONNEL	3	0		0.108	0.000	0.000
HEALTH PHYSICS PERSONNEL	1	0		7,090	0.000	0.106
SUPERVISORY PERSONNEL	51	2	53	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	1		0.000	0.000	0.091
TOTAL	46	0	47	6,226	0.000	0.091
REFUELING	0	0		0.000	0.000	0.000
MAINTENANCE PERSONNEL	40	0		5,863	0.000	0.000
OPERATING PERSONNEL	1	0		0.018	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	0		0.221	0.000	0.000
SUPERVISORY PERSONNEL	2	0		0.124	0.000	0.000
ENGINEERING PERSONNEL	46	0	47	6,226	0.000	0.000
TOTAL	130 (109)	1 (1)	606 (541)	80,363	0.456	482,785
MAINTENANCE PERSONNEL	148 (50)	0 (0)	148 (50)	32,461	0.000	0.000
OPERATING PERSONNEL	63 (18)	0 (0)	88 (35)	23,999	0.000	0.000
HEALTH PHYSICS PERSONNEL	32 (16)	8 (4)	120 (89)	5,248	1,541	37,895
SUPERVISORY PERSONNEL	30 (18)	23 (10)	94 (50)	5,865	2,671	85,152
ENGINEERING PERSONNEL	403 (211)	32 (15)	1,056 (765)	147,936	4,668	7,875
TOTAL	403 (211)	32 (15)	1,056 (765)	147,936	4,668	589,708
GRAND TOTAL	403 (211)	32 (15)	1,056 (765)	147,936	4,668	589,708
TOTAL BY JOB FUNCTION	130 (109)	1 (1)	606 (541)	80,363	0.456	482,785
MAINTENANCE PERSONNEL	148 (50)	0 (0)	148 (50)	32,461	0.000	0.000
OPERATING PERSONNEL	63 (18)	0 (0)	88 (35)	23,999	0.000	0.000
HEALTH PHYSICS PERSONNEL	32 (16)	8 (4)	120 (89)	5,248	1,541	37,895
SUPERVISORY PERSONNEL	30 (18)	23 (10)	94 (50)	5,865	2,671	85,152
ENGINEERING PERSONNEL	403 (211)	32 (15)	1,056 (765)	147,936	4,668	7,875
TOTAL	403 (211)	32 (15)	1,056 (765)	147,936	4,668	589,708

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

PLANT: CRYSTAL RIVER 3 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	CONTRACT & OTHERS	TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES							
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	1	0	0	0	0	0.316	0.071	0.110	0.071	0.110	0.110
OPERATING PERSONNEL	25	0	0	0	0	6.934	0.000	0.480	0.000	0.480	0.480
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.263	0.084	0.000	0.084	0.000	0.084
SUPERVISORY PERSONNEL	1	0	0	0	0	0.563	0.204	0.298	0.204	0.298	0.298
ENGINEERING PERSONNEL	0	0	0	0	0	0.036	0.243	0.221	0.243	0.221	0.221
TOTAL	27	0	0	0	27	8.112	0.602	1.109	0.602	1.109	9.823
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	33	3	3	61	61	9.837	1.103	14.949	1.103	14.949	14.949
OPERATING PERSONNEL	0	0	0	0	0	0.377	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	12	0	0	17	17	2.921	0.036	4.283	0.036	4.283	4.283
SUPERVISORY PERSONNEL	0	0	0	2	2	0.272	0.000	0.725	0.000	0.725	0.725
ENGINEERING PERSONNEL	2	0	0	0	0	0.451	0.101	0.299	0.101	0.299	0.299
TOTAL	47	3	3	80	130	13.858	1.255	20.256	1.255	20.256	35.369
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	0	0	0	0	0	0.019	0.000	0.002	0.000	0.002	0.002
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.032	0.000	0.032	0.000	0.032
ENGINEERING PERSONNEL	0	1	1	0	0	0.132	0.225	0.054	0.225	0.054	0.225
TOTAL	0	1	1	0	1	0.151	0.348	0.056	0.348	0.056	0.555
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
WASTE PROCESSING											
MAINTENANCE PERSONNEL	0	0	0	0	0	0.006	0.000	0.016	0.000	0.016	0.016
OPERATING PERSONNEL	1	0	0	0	0	0.524	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	0	0	0	0	1.598	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	1	1	0.035	0.000	0.669	0.035	0.669	0.669
ENGINEERING PERSONNEL	0	0	0	0	0	0.002	0.000	0.004	0.000	0.004	0.004
TOTAL	4	0	0	1	5	2.165	0.000	0.689	0.000	0.689	2.854
REFUELING											
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	34	3	3	61	98	10.178	1.174	15.077	1.174	15.077	26.429
OPERATING PERSONNEL	26	0	0	0	26	7.835	0.106	0.480	0.106	0.480	8.421
HEALTH PHYSICS PERSONNEL	15	0	0	17	32	4.782	0.120	4.283	0.120	4.283	9.185
SUPERVISORY PERSONNEL	1	0	0	3	4	0.870	0.236	1.692	0.236	1.692	2.798
ENGINEERING PERSONNEL	2	1	1	0	3	0.621	0.569	0.578	0.569	0.578	1.768
GRAND TOTAL	78	4	4	81	163	24.286	2.205	22.110	2.205	22.110	48.601

Appendix D (cont.)

PLANT: DAVIS-BESSE (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			TOTAL MAN-REMS			
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.										
MAINTENANCE PERSONNEL	10	1	27		0.310			0.005	1.115	
OPERATING PERSONNEL	76	0	29		7.820			0.000	1.155	
HEALTH PHYSICS PERSONNEL	18	0	0		1.090			0.000	0.000	
SUPERVISORY PERSONNEL	15	0	16		0.615			0.000	0.550	
ENGINEERING PERSONNEL	14	1	0		0.435			0.000	0.000	
TOTAL	133	2	72	207	10.270			0.010	2.820	13.100
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	111	20	267		7.600			1.385	17.255	
OPERATING PERSONNEL	25	0	0		1.890			0.000	0.000	
HEALTH PHYSICS PERSONNEL	28	0	74		5.770			0.000	31.150	
SUPERVISORY PERSONNEL	18	0	11		1.280			0.000	0.510	
ENGINEERING PERSONNEL	16	1	1		1.005			0.065	0.025	
TOTAL	198	21	353	572	17.545			1.450	48.940	67.935
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	9	1	36		0.490			0.050	1.675	
OPERATING PERSONNEL	2	0	0		0.285			0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	1		0.000			0.000	0.060	
SUPERVISORY PERSONNEL	4	0	2		0.240			0.000	0.035	
ENGINEERING PERSONNEL	2	0	2		0.170			0.000	0.020	
TOTAL	17	1	41	59	1.185			0.050	1.790	3.025
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	114	32	326		16.630			3.540	72.795	
OPERATING PERSONNEL	33	0	0		2.165			0.000	0.000	
HEALTH PHYSICS PERSONNEL	16	0	25		3.460			0.000	4.065	
SUPERVISORY PERSONNEL	25	0	10		5.490			0.000	2.545	
ENGINEERING PERSONNEL	31	0	2		1.060			0.000	0.055	
TOTAL	219	32	363	614	28.805			3.540	79.460	111.805
WASTE PROCESSING										
MAINTENANCE PERSONNEL	10	2	2		0.185			0.050	0.135	
OPERATING PERSONNEL	14	0	0		0.320			0.000	0.000	
HEALTH PHYSICS PERSONNEL	8	0	18		2.670			0.000	1.250	
SUPERVISORY PERSONNEL	2	0	0		0.040			0.000	0.000	
ENGINEERING PERSONNEL	2	0	0		0.015			0.000	0.000	
TOTAL	36	2	20	58	3.230			0.050	1.385	4.665
FUELING										
MAINTENANCE PERSONNEL	35	4	122		2.915			0.660	29.045	
OPERATING PERSONNEL	23	0	0		1.125			0.000	0.000	
HEALTH PHYSICS PERSONNEL	8	0	9		1.570			0.000	3.140	
SUPERVISORY PERSONNEL	8	0	4		1.300			0.000	0.895	
ENGINEERING PERSONNEL	11	1	0		0.995			0.210	0.000	
TOTAL	85	5	135	225	7.905			0.870	33.080	41.855
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	289	60	780	1129	28.130			5.690	122.020	155.840
OPERATING PERSONNEL	173	0	29	202	13.605			0.000	1.155	14.760
HEALTH PHYSICS PERSONNEL	78	0	127	205	14.560			0.000	39.665	54.225
SUPERVISORY PERSONNEL	72	0	43	115	8.965			0.000	4.535	13.500
ENGINEERING PERSONNEL	76	3	5	84	3.680			0.280	0.100	4.060
GRAND TOTAL	688	63	984	1735	68.940			5.970	167.475	242.385

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: DRESDEN 1.2.3 (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION
1984

†

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL		STATION		TOTAL		TOTAL MAN-REMS	
	EMPLOYEES	UTILITY EMPLOYEES	EMPLOYEES	PERSONS	EMPLOYEES	UTILITY EMPLOYEES	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
MAINTENANCE PERSONNEL										
MAINTENANCE PERSONNEL	30	8	37	110	37	110	4	870	4	870
OPERATING PERSONNEL	65	0	65	980	65	980	0	0	0	610
HEALTH PHYSICS PERSONNEL	3	0	3	930	3	930	0	0	0	0
SUPERVISORY PERSONNEL	22	0	22	520	22	520	0	0	0	0
ENGINEERING PERSONNEL	4	1	5	100	4	100	0	230	0	230
TOTAL	124	9	133	134	133	134	4	1100	4	1100
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	200	99	299	380	299	380	60	340	60	340
OPERATING PERSONNEL	28	0	28	980	28	980	0	0	0	0
HEALTH PHYSICS PERSONNEL	38	0	38	260	38	260	0	0	0	0
SUPERVISORY PERSONNEL	73	0	73	060	73	060	0	0	0	0
ENGINEERING PERSONNEL	64	31	95	620	95	620	4	860	4	860
TOTAL	403	130	533	963	533	963	64	200	64	200
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	43	40	83	600	83	600	22	330	22	330
OPERATING PERSONNEL	7	0	7	200	7	200	0	0	0	0
HEALTH PHYSICS PERSONNEL	7	0	7	870	7	870	0	0	0	0
SUPERVISORY PERSONNEL	10	0	10	710	10	710	0	0	0	0
ENGINEERING PERSONNEL	14	1	15	770	15	770	0	230	0	230
TOTAL	81	41	122	227	122	227	22	560	22	560
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	0	0	0	0	0	0	0	0	0	0
OPERATING PERSONNEL	0	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0	0	0	0	0
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	0	0	0	0	0	0	0	0	0	0
TOTAL	0	0	0	0	0	0	0	0	0	0
WASTE PROCESSING										
MAINTENANCE PERSONNEL	23	13	36	860	36	860	7	790	7	790
OPERATING PERSONNEL	42	0	42	530	42	530	0	0	0	0
HEALTH PHYSICS PERSONNEL	17	18	35	670	35	670	0	0	0	0
SUPERVISORY PERSONNEL	29	0	29	020	29	020	0	0	0	0
ENGINEERING PERSONNEL	5	2	7	510	7	510	0	290	0	290
TOTAL	116	15	131	206	131	206	7	800	7	800
REFUELLING										
MAINTENANCE PERSONNEL	37	0	37	350	37	350	0	0	0	0
OPERATING PERSONNEL	6	0	6	360	6	360	0	0	0	0
HEALTH PHYSICS PERSONNEL	4	0	4	930	4	930	0	0	0	0
SUPERVISORY PERSONNEL	12	0	12	800	12	800	0	0	0	0
ENGINEERING PERSONNEL	4	2	6	260	6	260	0	110	0	110
TOTAL	63	2	65	65	65	65	0	110	0	110
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	333	160	493	1033	493	1033	95	330	95	330
OPERATING PERSONNEL	148	0	148	168	148	168	0	0	0	0
HEALTH PHYSICS PERSONNEL	69	0	69	83	69	83	0	0	0	0
SUPERVISORY PERSONNEL	146	0	146	146	146	146	0	0	0	0
ENGINEERING PERSONNEL	91	37	128	165	128	165	5	720	5	720
GRAND TOTAL	787	197	984	1595	984	1595	101	050	101	050
TOTAL	124	9	133	134	133	134	4	1100	4	1100
TOTAL	403	130	533	963	533	963	64	200	64	200
TOTAL	81	41	122	227	122	227	22	560	22	560
TOTAL	116	15	131	206	131	206	7	800	7	800
TOTAL	63	2	65	65	65	65	0	110	0	110
GRAND TOTAL	787	197	984	1595	984	1595	101	050	101	050

Appendix D (cont.)

PLANT: DUANE ARNOLD (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION
1984

WORK & JOB FUNCTION	STATION		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		UTILITY EMPLOYEES	TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS		EMPLOYEES	CONTRACT & OTHERS		UTILITY EMPLOYEES	CONTRACT & OTHERS
WORK & JOB FUNCTION										
REACTOR OPERATIONS & SURV.										
MAINTENANCE PERSONNEL	34	18	0	0	18	0.498	0.000	0.000	0.246	
OPERATING PERSONNEL	50	12	2	0	12	22.347	0.056	0.056	1.482	
HEALTH PHYSICS PERSONNEL	22	12	0	0	12	1.982	0.000	0.000	1.167	
SUPERVISORY PERSONNEL	10	3	1	0	3	0.502	0.005	0.005	0.030	
ENGINEERING PERSONNEL	11	16	4	0	16	1.186	0.201	0.201	0.513	
TOTAL	127	61	7	0	195	26.515	0.262	0.262	3.438	30.215
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	65	118	0	0	118	22.688	0.000	0.000	29.113	
OPERATING PERSONNEL	12	11	0	0	11	0.230	0.000	0.000	0.144	
HEALTH PHYSICS PERSONNEL	37	20	0	0	20	3.305	0.000	0.000	1.887	
SUPERVISORY PERSONNEL	4	20	2	0	20	0.485	0.022	0.022	2.362	
ENGINEERING PERSONNEL	4	24	9	0	24	0.192	0.328	0.328	1.099	
TOTAL	122	193	11	0	326	26.900	0.350	0.350	34.605	61.855
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	12	78	0	0	78	0.120	0.000	0.000	13.826	
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	25	21	0	0	21	3.088	0.000	0.000	2.821	
SUPERVISORY PERSONNEL	8	15	0	0	15	0.491	0.000	0.000	0.529	
ENGINEERING PERSONNEL	12	44	12	0	44	2.143	1.487	1.487	11.254	
TOTAL	57	158	12	0	227	5.842	1.487	1.487	28.430	35.759
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	57	131	0	0	131	8.726	0.000	0.000	39.598	
OPERATING PERSONNEL	14	7	0	0	7	0.231	0.000	0.000	0.105	
HEALTH PHYSICS PERSONNEL	23	22	0	0	22	3.302	0.000	0.000	4.644	
SUPERVISORY PERSONNEL	6	21	0	0	21	0.273	0.000	0.000	1.835	
ENGINEERING PERSONNEL	13	49	8	0	49	1.388	0.256	0.256	9.857	
TOTAL	113	230	8	0	351	13.920	0.256	0.256	56.039	70.215
WASTE PROCESSING										
MAINTENANCE PERSONNEL	22	6	0	0	6	0.488	0.000	0.000	0.065	
OPERATING PERSONNEL	20	14	0	0	14	2.987	0.000	0.000	4.228	
HEALTH PHYSICS PERSONNEL	13	8	0	0	8	0.213	0.000	0.000	0.596	
SUPERVISORY PERSONNEL	0	2	0	0	2	0.000	0.000	0.000	0.147	
ENGINEERING PERSONNEL	4	3	1	0	3	0.031	0.005	0.005	0.050	
TOTAL	59	33	1	0	93	3.719	0.005	0.005	5.086	8.810
REFUELING										
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	
TOTAL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	190(78)	351(166)	0(0)	0(0)	541(244)	32.520	0.000	0.000	82.848	115.368
OPERATING PERSONNEL	96(66)	44(29)	2(2)	0(0)	142(97)	25.795	0.056	0.056	5.959	31.810
HEALTH PHYSICS PERSONNEL	120(48)	83(32)	0(0)	0(0)	203(80)	11.890	0.000	0.000	11.115	23.005
SUPERVISORY PERSONNEL	28(19)	61(37)	3(3)	0(0)	92(59)	1.751	0.027	0.027	4.903	6.681
ENGINEERING PERSONNEL	44(23)	136(62)	34(15)	0(0)	214(100)	4.940	2.277	2.277	22.773	29.990
GRAND TOTAL	478(234)	675(326)	39(20)	0(0)	1192(580)	76.896	2.360	2.360	127.598	206.854

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

PLANT: FARLEY 1.2 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS		TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS	EMPLOYEES	EMPLOYEES	EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS		
REACTOR OPERATIONS & SURV.	58	5	41	12	2,824	0.280	0.280	3.210	3.210		
MAINTENANCE PERSONNEL	146	6	12	12	42,249	2.925	0.900	0.900	0.900		
HEALTH PHYSICS PERSONNEL	93	8	103	103	37,148	1.421	46.913	46.913	46.913		
SUPERVISORY PERSONNEL	177	18	22	22	20,034	1.470	1.693	1.693	1.693		
ENGINEERING PERSONNEL	51	20	138	138	5,192	1.704	9.450	9.450	9.450		
TOTAL	525	57	316	316	107,447	7.800	62.166	62.166	62.166		177.413
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	160	8	80	80	27,830	1.081	15.160	15.160	15.160		
OPERATING PERSONNEL	120	6	0	0	45,318	0.194	0.000	0.000	0.000		
HEALTH PHYSICS PERSONNEL	44	1	38	38	7,225	0.004	1.426	1.426	1.426		
SUPERVISORY PERSONNEL	48	4	2	2	4,515	0.174	1.380	1.380	1.380		
ENGINEERING PERSONNEL	23	14	83	83	0.994	0.555	14.493	14.493	14.493		
TOTAL	395	33	303	303	85,882	2.008	32.459	32.459	32.459		120.349
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	2	1	21	21	0.104	0.020	1.675	1.675	1.675		
OPERATING PERSONNEL	2	0	0	0	0.120	0.000	0.000	0.000	0.000		
HEALTH PHYSICS PERSONNEL	2	0	6	6	0.002	0.000	0.236	0.236	0.236		
SUPERVISORY PERSONNEL	5	2	0	0	0.238	0.129	0.000	0.000	0.000		
ENGINEERING PERSONNEL	8	10	41	41	0.975	0.709	3.842	3.842	3.842		
TOTAL	19	13	68	68	1,439	0.858	5.753	5.753	5.753		8.050
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	144	8	398	398	115,054	2.871	274.741	274.741	274.741		
OPERATING PERSONNEL	120	6	1	1	32,465	0.198	0.060	0.060	0.060		
HEALTH PHYSICS PERSONNEL	49	2	53	53	14,843	0.085	9.115	9.115	9.115		
SUPERVISORY PERSONNEL	60	3	7	7	12,081	0.667	0.650	0.650	0.650		
ENGINEERING PERSONNEL	34	20	449	449	7.016	1.926	112.921	112.921	112.921		
TOTAL	407	39	908	908	181,439	5.747	397.487	397.487	397.487		584.693
WASTE PROCESSING											
MAINTENANCE PERSONNEL	1	0	1	1	0.012	0.000	1.970	1.970	1.970		
OPERATING PERSONNEL	6	0	0	0	0.534	0.000	0.000	0.000	0.000		
HEALTH PHYSICS PERSONNEL	6	0	6	6	0.795	0.000	0.104	0.104	0.104		
SUPERVISORY PERSONNEL	3	0	0	0	0.821	0.000	0.000	0.000	0.000		
ENGINEERING PERSONNEL	0	0	3	3	0.000	0.000	0.047	0.047	0.047		
TOTAL	16	0	10	10	2,162	0.000	2.121	2.121	2.121		4.283
REFUELING											
MAINTENANCE PERSONNEL	9	0	49	49	0.947	0.000	3.138	3.138	3.138		
OPERATING PERSONNEL	1	0	0	0	0.028	0.000	0.000	0.000	0.000		
HEALTH PHYSICS PERSONNEL	3	0	6	6	0.604	0.000	0.451	0.451	0.451		
SUPERVISORY PERSONNEL	9	0	0	0	0.341	0.000	0.000	0.000	0.000		
ENGINEERING PERSONNEL	3	3	9	9	0.221	0.159	0.635	0.635	0.635		
TOTAL	25	3	64	64	2,141	0.159	4.224	4.224	4.224		6.524
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	374	22	590	590	146,771	4.252	299.894	299.894	299.894		450.917
OPERATING PERSONNEL	395	18	13	13	120,714	3.317	0.960	0.960	0.960		124.991
HEALTH PHYSICS PERSONNEL	197	11	212	212	60,617	1.510	58.245	58.245	58.245		120.372
SUPERVISORY PERSONNEL	302	27	31	31	38,030	2.440	3.723	3.723	3.723		44.193
ENGINEERING PERSONNEL	119	67	823	823	14,398	5.053	141.388	141.388	141.388		160.839
GRAND TOTAL	1,387	145	1,669	1,669	380,530	16.572	504.210	504.210	504.210		901.312

* Workers may be counted in more than one category.

Appendix D (cont.)

*† PLANT: FIITPATRICK (BMR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)				TOTAL				TOTAL MAN-REMS			
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.	50	0	10	60	5,932	0.000	0.888	6,820	0.000	0.000	0.888	7,708
MAINTENANCE PERSONNEL	108	0	31	139	23,549	0.000	1,614	25,163	0.000	0.000	1,614	26,777
HEALTH PHYSICS PERSONNEL	34	0	0	34	21,740	0.000	25,940	47,680	0.000	0.000	25,940	73,620
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	19	0	5	24	2,351	0.000	0.041	2,392	0.000	0.000	0.041	2,433
TOTAL	211	0	46	257	53,572	0.000	28,483	82,055	0.000	0.000	28,483	110,538
ROUTINE MAINTENANCE	205	0	190	395	185,108	0.000	52,407	237,515	0.000	0.000	52,407	290,922
MAINTENANCE PERSONNEL	78	0	11	89	11,186	0.000	1,786	12,972	0.000	0.000	1,786	14,758
OPERATING PERSONNEL	17	0	14	31	1,110	0.000	1,010	2,120	0.000	0.000	1,010	3,130
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	29	0	63	92	10,416	0.000	6,909	17,325	0.000	0.000	6,909	24,234
ENGINEERING PERSONNEL	329	0	278	607	207,820	0.000	62,112	269,932	0.000	0.000	62,112	332,044
TOTAL	329	0	278	607	207,820	0.000	62,112	269,932	0.000	0.000	62,112	332,044
IN-SERVICE INSPECTION	83	0	84	167	5,805	0.000	5,986	11,791	0.000	0.000	5,986	17,777
MAINTENANCE PERSONNEL	98	0	5	103	7,545	0.000	0,453	8,000	0.000	0.000	0,453	8,453
OPERATING PERSONNEL	11	0	6	17	0,412	0.000	0,165	577	0.000	0.000	0,165	742
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	35	0	88	123	6,020	0.000	44,424	50,444	0.000	0.000	44,424	94,868
ENGINEERING PERSONNEL	227	0	183	410	19,782	0.000	51,028	70,810	0.000	0.000	51,028	121,838
TOTAL	227	0	183	410	19,782	0.000	51,028	70,810	0.000	0.000	51,028	121,838
SPECIAL MAINTENANCE	153	0	380	533	161,104	0.000	267,983	429,087	0.000	0.000	267,983	697,070
MAINTENANCE PERSONNEL	80	0	11	91	16,535	0.000	2,860	19,395	0.000	0.000	2,860	22,255
OPERATING PERSONNEL	10	0	9	19	0,585	0.000	1,326	1,911	0.000	0.000	1,326	3,237
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	31	0	130	161	7,320	0.000	0.000	7,320	0.000	0.000	0.000	7,320
ENGINEERING PERSONNEL	274	0	530	804	185,544	0.000	317,925	503,469	0.000	0.000	317,925	821,394
TOTAL	274	0	530	804	185,544	0.000	317,925	503,469	0.000	0.000	317,925	821,394
WASTE PROCESSING	144	0	19	163	26,613	0.000	2,124	28,737	0.000	0.000	2,124	30,861
MAINTENANCE PERSONNEL	40	0	2	42	9,770	0.000	3,218	12,988	0.000	0.000	3,218	16,206
OPERATING PERSONNEL	9	0	4	13	0,996	0.000	0,255	1,251	0.000	0.000	0,255	1,506
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	0	9	11	0,024	0.000	0.000	0,024	0.000	0.000	0.000	0,024
ENGINEERING PERSONNEL	195	0	34	229	37,403	0.000	7,491	44,894	0.000	0.000	7,491	52,385
TOTAL	195	0	34	229	37,403	0.000	7,491	44,894	0.000	0.000	7,491	52,385
REFUELLING	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION	635	0	683	1318	384,562	0.000	329,388	713,950	0.000	0.000	329,388	1,043,338
MAINTENANCE PERSONNEL	404	0	60	464	68,585	0.000	9,931	78,516	0.000	0.000	9,931	88,447
OPERATING PERSONNEL	81	0	33	114	24,843	0.000	28,696	53,539	0.000	0.000	28,696	82,235
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	116	0	295	411	26,131	0.000	99,024	125,155	0.000	0.000	99,024	224,179
ENGINEERING PERSONNEL	1236	0	1071	2307	504,121	0.000	467,039	971,160	0.000	0.000	467,039	1,438,199
GRAND TOTAL	1236	0	1071	2307	504,121	0.000	467,039	971,160	0.000	0.000	467,039	1,438,199

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: FORT CALHOUN (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		UTILITY EMPLOYEES	TOTAL MAN-REMS		TOTAL MAN-REMS
	STATION EMPLOYEES	CONTRACT & OTHERS		STATION EMPLOYEES	CONTRACT & OTHERS		UTILITY EMPLOYEES	CONTRACT & OTHERS	
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	5	20		1,750		0.775	17.893		
OPERATING PERSONNEL	30	0		13,578		0.160	0.000		
HEALTH PHYSICS PERSONNEL	17	0		19,585		0.000	22.035		
SUPERVISORY PERSONNEL	3	23		0.944		0.187	0.000		
ENGINEERING PERSONNEL	15	13		4,238		1.575	4.997		
TOTAL	70	56	129	40,095		2,697	44,925		87,717
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	31	42		13,531		24.685	26.563		
OPERATING PERSONNEL	0	0		0.092		0.000	0.000		
HEALTH PHYSICS PERSONNEL	1	2		0.250		0.000	2.429		
SUPERVISORY PERSONNEL	0	0		0.135		0.045	0.000		
ENGINEERING PERSONNEL	2	1		1,123		0.835	0.419		
TOTAL	34	45	130	15,131		25,565	29,411		70,107
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	4	42		1,998		4.212	37.564		
OPERATING PERSONNEL	0	0		0.083		0.000	0.000		
HEALTH PHYSICS PERSONNEL	3	3		1,052		0.000	0.880		
SUPERVISORY PERSONNEL	0	0		0.000		0.044	0.000		
ENGINEERING PERSONNEL	5	6		2,532		2.662	4,546		
TOTAL	12	51	80	5,665		6,918	42,990		55,573
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	38	215		32,038		31.619	149,146		
OPERATING PERSONNEL	0	0		0.549		0.000	0.000		
HEALTH PHYSICS PERSONNEL	9	2		6,486		0.000	1,138		
SUPERVISORY PERSONNEL	3	1		1,001		0.775	0.060		
ENGINEERING PERSONNEL	15	12		14,350		11,150	5,811		
TOTAL	65	230	375	54,424		43,544	156,155		254,123
WASTE PROCESSING									
MAINTENANCE PERSONNEL	9	22		2,870		1,529	10,138		
OPERATING PERSONNEL	20	0		5,122		0.446	0.000		
HEALTH PHYSICS PERSONNEL	6	0		8,895		0.000	0.005		
SUPERVISORY PERSONNEL	0	0		0.000		0.000	0.000		
ENGINEERING PERSONNEL	0	0		0.197		0.059	0.010		
TOTAL	35	22	62	17,084		2,034	10,153		29,271
REFUELING									
MAINTENANCE PERSONNEL	14	34		6,331		14,165	17,443		
OPERATING PERSONNEL	26	0		4,272		0.035	0.000		
HEALTH PHYSICS PERSONNEL	2	0		0.682		0.000	0.165		
SUPERVISORY PERSONNEL	8	0		1,452		0.000	0.000		
ENGINEERING PERSONNEL	2	6		1,344		0.230	1,710		
TOTAL	52	40	123	14,081		14,430	19,318		47,829
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	101	157	633	58,518		76,985	258,747		394,250
OPERATING PERSONNEL	76	1	77	23,696		0.641	0.000		24,337
HEALTH PHYSICS PERSONNEL	38	0	45	36,950		0.000	26,652		63,602
SUPERVISORY PERSONNEL	14	1	39	3,532		1,051	0,060		4,643
ENGINEERING PERSONNEL	39	28	105	23,784		16,511	17,493		57,788
GRAND TOTAL	268 (135)	187 (100)	899 (568)	146,480		95,188	302,952		544,620

*Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: *GINNA

(PMR) NUMBER OF PERSONNEL (>100 M-REM) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES	UTILITY EMPLOYEES	TOTAL MAN-REMS	
	STATION EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS			UTILITY EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.								
MAINTENANCE PERSONNEL	42	98	144		6,100	10,260	14,900	
OPERATING PERSONNEL	23	0	1		11,080	0,590	0,000	
HEALTH PHYSICS PERSONNEL	14	46	3		1,170	0,160	12,140	
SUPERVISORY PERSONNEL	20	20	8		4,730	0,850	1,490	
ENGINEERING PERSONNEL	1	29	2		0,030	0,000	2,430	
TOTAL	100	193	158	451	23,110	11,860	30,960	65,930
ROUTINE MAINTENANCE								
MAINTENANCE PERSONNEL	40	95	123		4,460	10,130	5,120	
OPERATING PERSONNEL	17	0	0		0,270	0,000	0,000	
HEALTH PHYSICS PERSONNEL	13	46	4		1,320	0,160	5,510	
SUPERVISORY PERSONNEL	20	19	10		1,590	1,700	2,560	
ENGINEERING PERSONNEL	1	17	1		0,010	0,010	5,850	
TOTAL	91	177	138	406	7,650	12,000	19,040	38,690
IN-SERVICE INSPECTION								
MAINTENANCE PERSONNEL	28	31	66		2,010	1,100	3,800	
OPERATING PERSONNEL	1	0	0		0,020	0,000	0,000	
HEALTH PHYSICS PERSONNEL	2	26	0		0,050	0,000	1,290	
SUPERVISORY PERSONNEL	11	15	7		0,770	0,430	1,080	
ENGINEERING PERSONNEL	0	4	2		0,000	0,040	0,070	
TOTAL	42	76	75	193	2,850	1,570	6,240	10,660
SPECIAL MAINTENANCE								
MAINTENANCE PERSONNEL	42	122	150		19,740	125,200	39,920	
OPERATING PERSONNEL	17	0	1		0,680	0,020	0,000	
HEALTH PHYSICS PERSONNEL	13	47	4		3,020	0,120	21,230	
SUPERVISORY PERSONNEL	19	19	10		3,880	3,840	12,200	
ENGINEERING PERSONNEL	1	41	2		0,020	0,560	5,880	
TOTAL	92	229	167	488	27,340	129,740	79,230	236,310
MASTE PROCESSING								
MAINTENANCE PERSONNEL	26	31	44		1,190	1,370	1,520	
OPERATING PERSONNEL	9	0	0		0,330	0,000	0,000	
HEALTH PHYSICS PERSONNEL	8	38	3		0,330	0,000	10,300	
SUPERVISORY PERSONNEL	9	10	3		0,200	0,560	1,250	
ENGINEERING PERSONNEL	0	0	0		0,000	0,000	0,000	
TOTAL	52	79	50	181	2,050	1,930	13,070	17,050
REFUELING								
MAINTENANCE PERSONNEL	21	16	36		2,790	4,300	3,080	
OPERATING PERSONNEL	4	0	0		0,730	0,000	0,000	
HEALTH PHYSICS PERSONNEL	2	23	0		0,260	0,000	52,350	
SUPERVISORY PERSONNEL	4	6	5		0,000	0,560	19,600	
ENGINEERING PERSONNEL	0	21	1		0,000	0,000	0,240	
TOTAL	31	66	42	139	3,780	4,860	75,270	83,910
TOTAL BY JOB FUNCTION								
MAINTENANCE PERSONNEL	199 (43)	393 (136)	563 (151)	1155 (330)	36,290	152,360	68,340	256,990
OPERATING PERSONNEL	71 (23)	0 (0)	2 (1)	73 (24)	13,110	0,610	0,000	13,720
HEALTH PHYSICS PERSONNEL	52 (14)	226 (47)	14 (4)	292 (65)	6,150	0,440	102,820	109,410
SUPERVISORY PERSONNEL	83 (21)	89 (24)	43 (11)	215 (56)	11,170	7,940	38,180	57,290
ENGINEERING PERSONNEL	3 (1)	112 (42)	8 (2)	123 (45)	0,060	0,610	14,470	15,140
GRAND TOTAL	408 (102)	820 (249)	630 (169)	1858 (520)	66,780	161,960	223,810	452,550

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: HADDAM NECK (PWR)	1984											
	NUMBER OF PERSONNEL (>100 M-REM)					TOTAL MAN-REMS						
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
WORK & JOB FUNCTION												
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	7	0	2		3,210	0.160	0.890					
OPERATING PERSONNEL	51	0	11		60,700	0.050	3.660					
HEALTH PHYSICS PERSONNEL	32	2	75		19,460	2.710	59.150					
SUPERVISORY PERSONNEL	3	0	0		0.640	0.000	0.000					
ENGINEERING PERSONNEL	3	3	0		1.380	1.100	0.000					
TOTAL	96	5	88	189	85,390	4.020	63.830					153.240
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	59	72	159		95,090	24.200	146.320					
OPERATING PERSONNEL	5	0	0		3,030	0.040	0.400					
HEALTH PHYSICS PERSONNEL	23	2	66		12,770	0.390	23.850					
SUPERVISORY PERSONNEL	1	0	0		0.290	0.000	0.020					
ENGINEERING PERSONNEL	12	16	18		3,660	5.190	11.470					
TOTAL	100	90	243	433	114,840	29.820	182.060					326.720
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	17	11	145		11,630	4.230	141.650					
OPERATING PERSONNEL	1	0	0		0.470	0.010	0.070					
HEALTH PHYSICS PERSONNEL	3	1	32		1,840	0.420	12.560					
SUPERVISORY PERSONNEL	0	0	0		0.000	0.000	0.000					
ENGINEERING PERSONNEL	9	10	100		7,750	3.910	156.740					
TOTAL	30	22	277	329	21,690	8.570	311.020					341.280
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	31	49	158		38,120	46.850	93.000					
OPERATING PERSONNEL	2	0	1		0.860	0.010	0.260					
HEALTH PHYSICS PERSONNEL	8	0	24		2,580	0.260	10.710					
SUPERVISORY PERSONNEL	0	0	1		0.050	0.000	1.220					
ENGINEERING PERSONNEL	4	18	12		1,210	11.910	7.990					
TOTAL	45	67	196	308	42,820	59.030	113.180					215.030
WASTE PROCESSING												
MAINTENANCE PERSONNEL	0	0	2		0.310	0.070	0.890					
OPERATING PERSONNEL	0	0	0		0.370	0.000	0.000					
HEALTH PHYSICS PERSONNEL	16	1	46		22,490	0.240	39.970					
SUPERVISORY PERSONNEL	0	0	0		0.000	0.000	0.000					
ENGINEERING PERSONNEL	1	2	0		0.340	0.480	0.150					
TOTAL	17	3	48	68	23,510	0.790	41.010					65.310
REFUELING												
MAINTENANCE PERSONNEL	26	3	62		13,020	1.530	74.760					
OPERATING PERSONNEL	0	0	2		0.430	0.010	2.600					
HEALTH PHYSICS PERSONNEL	7	0	20		3,370	0.000	5.740					
SUPERVISORY PERSONNEL	1	0	0		0.420	0.000	0.000					
ENGINEERING PERSONNEL	1	0	7		0.380	0.080	2.630					
TOTAL	35	3	91	129	17,620	1.620	85.730					104.970
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	140	135	528	803	161,380	77.040	457.510					695.930
OPERATING PERSONNEL	59	0	14	73	65,860	0.120	6.990					72.970
HEALTH PHYSICS PERSONNEL	89	6	263	358	62,510	4.020	151.980					218.510
SUPERVISORY PERSONNEL	5	0	1	6	1,400	0.000	1.240					2.640
ENGINEERING PERSONNEL	30	49	137	216	14,720	22.670	179.110					216.500
GRAND TOTAL	323	190	943	1456	305,870	103.850	796.830					1206.550

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

(BHR)

1984

PLANT: HATCH 1,2	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL		STATION		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	PERSONS	CONTRACT & OTHERS	EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	MAN-REMS
WORK & JOB FUNCTION								
REACTOR OPERATIONS & SURV.								
MAINTENANCE PERSONNEL	13	0	49		4,882	0.025	22,571	
OPERATING PERSONNEL	104	0	0		57,466	0.020	0.034	
HEALTH PHYSICS PERSONNEL	47	1	139		28,685	0.389	118,967	
SUPERVISORY PERSONNEL	82	2	8		21,926	1.481	4,107	
ENGINEERING PERSONNEL	42	4	13		27,435	1.234	6,862	
TOTAL	288	7	209	504	140,394	3,149	152,541	296,084
ROUTINE MAINTENANCE								
MAINTENANCE PERSONNEL	158	3	197		137,595	1.680	135,182	
OPERATING PERSONNEL	30	0	1		17,870	0.000	0.109	
HEALTH PHYSICS PERSONNEL	22	0	40		11,223	0.034	43,343	
SUPERVISORY PERSONNEL	16	3	8		6,309	1.608	5,401	
ENGINEERING PERSONNEL	2	0	15		1,257	0.179	6,268	
TOTAL	228	6	261	495	174,254	3,501	190,303	368,058
IN-SERVICE INSPECTION								
MAINTENANCE PERSONNEL	0	0	47		0,099	0.005	26,963	
OPERATING PERSONNEL	0	0	0		0,227	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	4		0,154	0.046	1,354	
SUPERVISORY PERSONNEL	1	0	7		0,766	0.013	4,349	
ENGINEERING PERSONNEL	0	0	9		0,009	0.000	8,216	
TOTAL	1	0	67	68	1,255	0.064	40,882	42,201
SPECIAL MAINTENANCE								
MAINTENANCE PERSONNEL	13	0	1402		10,624	0.084	1166,354	
OPERATING PERSONNEL	1	0	1		1,048	0.272	0.000	
HEALTH PHYSICS PERSONNEL	0	0	45		0,157	0.000	43,244	
SUPERVISORY PERSONNEL	1	3	45		0,242	1.943	26,513	
ENGINEERING PERSONNEL	8	1	194		1,666	0.715	106,664	
TOTAL	23	4	1687	1714	13,737	2,742	1343,047	1359,526
WASTE PROCESSING								
MAINTENANCE PERSONNEL	0	0	47		0,070	0.005	22,043	
OPERATING PERSONNEL	0	0	0		0,173	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	8		0,174	0.000	7,510	
SUPERVISORY PERSONNEL	0	0	1		0,065	0.002	0,177	
ENGINEERING PERSONNEL	0	0	0		0,009	0.000	0,399	
TOTAL	0	0	56	56	0,491	0.007	30,129	30,627
REFUELING								
MAINTENANCE PERSONNEL	0	0	36		0,074	0.005	13,163	
OPERATING PERSONNEL	0	0	0		0,173	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	4		0,154	0.000	1,283	
SUPERVISORY PERSONNEL	0	0	1		0,053	0.002	0,177	
ENGINEERING PERSONNEL	0	0	0		0,009	0.000	0,436	
TOTAL	0	0	41	41	0,463	0.007	15,059	15,529
TOTAL BY JOB FUNCTION								
MAINTENANCE PERSONNEL	184	3	778	1965	153,344	1.804	1386,276	1541,424
OPERATING PERSONNEL	135	0	2	137	76,957	0.020	0,415	77,392
HEALTH PHYSICS PERSONNEL	69	1	240	310	40,547	0,469	215,701	256,717
SUPERVISORY PERSONNEL	100	8	70	178	29,361	5,049	40,724	75,134
ENGINEERING PERSONNEL	52	5	231	288	30,385	2,128	128,845	161,358
GRAND TOTAL	540	15	2321	2878	330,594	9,470	1771,961	2112,025

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: INDIAN POINT 2 (PWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	MAN-REMS
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	75	161	670		19,998	30,277	158,772		
OPERATING PERSONNEL	83	2	6		134,595	0,213	3,964		
HEALTH PHYSICS PERSONNEL	19	0	149		35,805	0,000	165,880		
SUPERVISORY PERSONNEL	54	29	58		24,872	6,842	8,369		
ENGINEERING PERSONNEL	50	43	28		20,260	9,739	13,189		
TOTAL	281	235	911	1427	235,530	47,071	350,174	632,775	
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	71	141	321		73,757	28,921	64,324		
OPERATING PERSONNEL	29	1	2		5,041	0,005	0,510		
HEALTH PHYSICS PERSONNEL	5	0	53		0,075	0,000	1,920		
SUPERVISORY PERSONNEL	28	22	17		15,988	3,343	3,361		
ENGINEERING PERSONNEL	33	17	7		4,119	1,370	0,730		
TOTAL	166	181	400	747	98,980	33,639	70,845	203,464	
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	33	57	81		2,090	4,029	12,240		
OPERATING PERSONNEL	5	1	1		0,270	0,045	0,010		
HEALTH PHYSICS PERSONNEL	4	0	6		0,220	0,000	0,220		
SUPERVISORY PERSONNEL	17	19	8		1,283	1,171	1,205		
ENGINEERING PERSONNEL	6	5	6		0,370	0,120	0,117		
TOTAL	65	82	102	249	4,233	5,365	13,792	23,390	
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	73	205	1153		28,719	120,451	1000,461		
OPERATING PERSONNEL	70	2	8		15,101	0,810	1,250		
HEALTH PHYSICS PERSONNEL	18	0	130		3,228	0,000	40,174		
SUPERVISORY PERSONNEL	44	34	84		18,662	21,455	32,987		
ENGINEERING PERSONNEL	47	37	26		7,550	15,884	17,494		
TOTAL	252	278	1401	1931	73,260	158,600	1092,366	1324,226	
WASTE PROCESSING									
MAINTENANCE PERSONNEL	38	53	321		8,096	1,315	137,532		
OPERATING PERSONNEL	39	0	3		1,467	0,000	2,592		
HEALTH PHYSICS PERSONNEL	8	0	41		0,147	0,000	10,375		
SUPERVISORY PERSONNEL	21	8	17		5,276	8,861	8,861		
ENGINEERING PERSONNEL	25	12	4		1,936	1,614	2,005		
TOTAL	131	73	386	590	16,922	3,012	161,365	181,299	
REFUELING									
MAINTENANCE PERSONNEL	32	123	200		4,566	51,464	123,978		
OPERATING PERSONNEL	57	0	3		10,463	0,000	0,598		
HEALTH PHYSICS PERSONNEL	1	0	6		0,180	0,000	0,350		
SUPERVISORY PERSONNEL	17	13	4		3,808	8,733	0,280		
ENGINEERING PERSONNEL	10	13	6		3,925	1,164	0,269		
TOTAL	117	149	219	485	22,942	61,361	125,475	209,778	
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	322 (79)	740 (211)	2746 (1295)	3808 (1585)	137,226	236,457	1497,307	1870,990	
OPERATING PERSONNEL	283 (84)	6 (2)	23 (11)	312 (97)	166,937	1,073	8,924	176,934	
HEALTH PHYSICS PERSONNEL	55 (19)	0 (2)	385 (162)	440 (183)	39,655	0,000	218,919	258,574	
SUPERVISORY PERSONNEL	181 (57)	125 (37)	188 (91)	494 (185)	69,889	41,627	55,063	166,579	
ENGINEERING PERSONNEL	171 (51)	127 (43)	77 (33)	375 (127)	38,160	29,891	33,804	101,855	
GRAND TOTAL	1012 (290)	998 (295)	3419 (1592)	5429 (2177)	451,867	309,048	1814,017	2574,932	

*Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

PLANT: INDIAN POINT 3 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES					CONTRACT & OTHERS	TOTAL
REACTOR OPERATIONS & SURV.	15	1	12	111	111	42,538	0.331	0.000	0.331	2,112
MAINTENANCE PERSONNEL	41	0	2			3,746	0.331	0.104	0.331	0.104
OPERATING PERSONNEL	19	0	8			14,476	0.000	0.166	0.000	0.166
HEALTH PHYSICS PERSONNEL	22	0	1			11,516	0.000	1.600	0.000	1.600
SUPERVISORY PERSONNEL	1	0	0			12,910	0.000	0.242	0.000	0.242
ENGINEERING PERSONNEL	98	1	12			0,090	0.000	0.000	0.000	0.000
TOTAL	155	1	24	111	111	42,538	0.331	2.112	0.331	2,112
ROUTINE MAINTENANCE	33	0	28			8,901	0.000	15,911	0.000	15,911
MAINTENANCE PERSONNEL	23	1	2			3,202	0.076	1,250	0.076	1,250
OPERATING PERSONNEL	17	0	34			5,141	0.000	0.700	0.000	0.700
HEALTH PHYSICS PERSONNEL	5	0	0			1,090	0.000	11,282	0.000	11,282
SUPERVISORY PERSONNEL	1	0	0			0,152	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	79	1	64	144	144	18,486	0.076	29,143	0.076	29,143
TOTAL	79	1	64	144	144	18,486	0.076	29,143	0.076	29,143
IN-SERVICE INSPECTION	0	1	0			0,000	0.076	0.000	0.076	0.000
MAINTENANCE PERSONNEL	15	2	5			1,773	0.366	0.725	0.366	0.725
OPERATING PERSONNEL	0	0	1			0,000	0.000	0.083	0.000	0.083
HEALTH PHYSICS PERSONNEL	5	0	0			0,655	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	1	3			0,179	0.097	0.366	0.097	0.366
ENGINEERING PERSONNEL	22	4	9	35	35	2,607	0.539	1,174	0.539	1,174
TOTAL	22	4	9	35	35	2,607	0.539	1,174	0.539	1,174
SPECIAL MAINTENANCE	45	0	177			21,438	0.000	77,314	0.000	77,314
MAINTENANCE PERSONNEL	18	1	8			4,623	0.076	1,408	0.076	1,408
OPERATING PERSONNEL	1	0	0			0,124	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	11	0	0			3,795	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	75	1	185	261	261	29,980	0.076	78,722	0.076	78,722
TOTAL	75	1	185	261	261	29,980	0.076	78,722	0.076	78,722
WASTE PROCESSING	8	0	13			1,622	0.000	5,568	0.000	5,568
MAINTENANCE PERSONNEL	0	0	1			0,000	0.000	2,250	0.000	2,250
OPERATING PERSONNEL	1	0	0			0,138	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	1	0	0			0,518	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	10	0	14	24	24	2,278	0.000	7,818	0.000	7,818
TOTAL	10	0	14	24	24	2,278	0.000	7,818	0.000	7,818
REFUELING	0	0	0			0,000	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0			0,000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0	0,000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION	101	2	219	322	322	35,707	0.407	98,897	0.407	98,897
MAINTENANCE PERSONNEL	97	4	18	119	119	24,074	0.518	5,799	0.518	5,799
OPERATING PERSONNEL	38	0	43	81	81	16,719	0.000	2,383	0.000	2,383
HEALTH PHYSICS PERSONNEL	44	0	1	45	45	18,968	0.000	11,524	0.000	11,524
SUPERVISORY PERSONNEL	4	1	3	8	8	0,421	0.097	0,366	0.097	0,366
ENGINEERING PERSONNEL	284	7	284	575	575	95,889	1,022	118,969	1,022	118,969
GRAND TOTAL	284	7	284	575	575	95,889	1,022	118,969	1,022	118,969

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: * LACROSSE (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)		
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	21	0	0	0	17,838	0.010	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	20	0	4	4	68,149	0.000	0.000	2.485	0.000	0.000	2.485	0.000
HEALTH PHYSICS PERSONNEL	11	0	0	0	23,727	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	19	0	0	0	18,392	0.032	0.000	0.317	0.000	0.000	0.317	0.000
ENGINEERING PERSONNEL	8	0	3	3	5,704	0.121	0.000	1.132	0.000	0.000	1.132	0.000
TOTAL	79	0	7	86	133,810	0.163	0.000	3.934	0.000	0.000	3.934	0.000
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	19	1	0	0	26,793	0.630	0.000	0.103	0.000	0.000	0.103	0.000
OPERATING PERSONNEL	20	0	0	0	7,376	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	7	0	0	0	3,353	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	14	0	0	0	9,931	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	6	0	0	0	7,148	0.030	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	66	1	0	67	54,601	0.660	0.000	0.103	0.000	0.000	0.103	0.000
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	17	3	4	4	11,800	2.810	0.000	1.104	0.000	0.000	1.104	0.000
OPERATING PERSONNEL	11	0	0	0	4,149	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	0	0	1,205	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	17	0	0	0	11,533	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	0	0	0	0,794	0.050	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	52	3	4	59	29,481	2.860	0.000	1.104	0.000	0.000	1.104	0.000
WASTE PROCESSING												
MAINTENANCE PERSONNEL	5	0	0	0	2,205	0.000	0.000	0.068	0.000	0.000	0.068	0.000
OPERATING PERSONNEL	8	0	0	0	2,446	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	8	0	0	0	6,660	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	6	0	0	0	6,414	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	0	0	0	1,165	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	30	0	0	30	18,890	0.000	0.000	0.068	0.000	0.000	0.068	0.000
REFUELING												
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.017	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.035	0.000	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.015	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0.067	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	62 (21)	4 (4)	4 (4)	70 (29)	58,636	3.450	0.000	1.275	0.000	0.000	1.275	0.000
OPERATING PERSONNEL	59 (20)	0 (0)	4 (4)	63 (24)	82,120	0.000	0.000	2.485	0.000	0.000	2.485	0.000
HEALTH PHYSICS PERSONNEL	30 (11)	0 (0)	0 (0)	30 (11)	34,962	0.000	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	56 (20)	0 (0)	0 (0)	56 (20)	46,305	0.032	0.000	0.317	0.000	0.000	0.317	0.000
ENGINEERING PERSONNEL	20 (8)	0 (0)	3 (3)	23 (11)	14,826	0.201	0.000	1.132	0.000	0.000	1.132	0.000
GRAND TOTAL	227 (80)	4 (4)	11 (11)	242 (95)	236,849	3.683	0.000	5.209	0.000	0.000	5.209	0.067

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D(cont.)

PLANT: LASALLE 1 (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM) 1984		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS CONTRACT & OTHERS		TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS	MAN-REMS
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	14	1	15	0	5,563	0	0	0	0.000	0.000	0.000
OPERATING PERSONNEL	13	0	13	0	3,479	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	8	0	8	0	4,112	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	39	0	39	0	4,515	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	43	7	50	8	4,897	0	0	0	1,499	1,499	1,499
TOTAL	117	8	125	8	22,566	0	0	0	1,499	1,499	24,753
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	116	5	121	155	47,279	0	0	0	35,096	35,096	35,096
OPERATING PERSONNEL	26	0	26	0	6,958	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	16	0	16	0	8,226	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	39	0	39	0	4,515	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	7	7	50	0.000	0	0	0	8,991	8,991	8,991
TOTAL	197	12	209	205	66,978	0	0	0	44,087	44,087	111,897
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	6	1	7	13	2,781	0	0	0	2,925	2,925	2,925
OPERATING PERSONNEL	7	0	7	0	1,741	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	4	0	2,057	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	20	0	20	0	3,762	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	43	16	59	4	4,896	0	0	0	0.749	0.749	0.749
TOTAL	80	17	97	17	15,237	0	0	0	3,674	3,674	20,266
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	0	1	1	91	0.000	0	0	0	20,473	20,473	20,473
OPERATING PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	7	7	21	0.000	0	0	0	3,746	3,746	3,746
TOTAL	0	8	8	112	0.000	0	0	0	24,219	24,219	24,907
WASTE PROCESSING											
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
OPERATING PERSONNEL	87	0	87	0	22,614	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	12	0	12	0	6,170	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	33	0	33	0	2,258	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
TOTAL	132	0	132	0	31,042	0	0	0	0.000	0.000	31,042
REFUELING											
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
TOTAL	0	0	0	0	0.000	0	0	0	0.000	0.000	0.000
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	136	8	144	259	55,623	0	0	0	58,494	58,494	114,357
OPERATING PERSONNEL	133	0	133	0	34,792	0	0	0	0.000	0.000	34,792
HEALTH PHYSICS PERSONNEL	40	0	40	0	20,565	0	0	0	0.000	0.000	20,565
SUPERVISORY PERSONNEL	131	0	131	0	15,050	0	0	0	0.000	0.000	15,050
ENGINEERING PERSONNEL	86	37	123	83	9,793	0	0	0	14,985	14,985	28,101
GRAND TOTAL	526	45	571	342	135,823	0	0	0	73,479	73,479	212,865

*Workers may be counted in more than one category.

aNRC mandated work contributed 25 man-rem.

Appendix D (cont.)

PLANT: MAINE YANKEE (PMR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.	0	0	0	0	0	0	0.160	0.000	0.395
MAINTENANCE PERSONNEL	17	0	0	0	17	0	4.500	0.000	0.000
OPERATING PERSONNEL	8	0	0	0	8	0	1.920	0.000	0.000
HEALTH PHYSICS PERSONNEL	2	0	1	0	3	1	1.035	0.000	0.775
SUPERVISORY PERSONNEL	2	1	0	0	3	0	0.560	0.110	0.165
ENGINEERING PERSONNEL	29	1	1	1	31	1	8.175	0.110	1.365
TOTAL	53	1	20	1	73	20	20.285	0.000	6.396
ROUTINE MAINTENANCE	21	0	18	0	39	0	9.110	0.000	5.821
MAINTENANCE PERSONNEL	7	0	0	0	7	0	2.275	0.000	0.000
OPERATING PERSONNEL	5	0	0	0	5	0	2.265	0.000	0.000
HEALTH PHYSICS PERSONNEL	20	0	2	0	22	0	6.185	0.000	0.030
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.450	0.000	0.440
ENGINEERING PERSONNEL	53	0	20	0	73	0	20.285	0.000	6.396
TOTAL	10	0	118	0	128	0	4.230	0.010	76.260
IN-SERVICE INSPECTION	0	0	0	0	0	0	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.010
OPERATING PERSONNEL	2	0	3	0	5	0	1.610	0.000	0.000
HEALTH PHYSICS PERSONNEL	10	0	14	0	24	0	5.320	0.000	0.960
SUPERVISORY PERSONNEL	1	0	1	0	2	0	0.960	0.000	0.000
ENGINEERING PERSONNEL	22	0	135	0	157	0	11.160	0.010	87.990
TOTAL	15	0	338	0	353	0	7.975	0.420	333.261
SPECIAL MAINTENANCE	4	0	0	0	4	0	1.060	0.000	0.000
MAINTENANCE PERSONNEL	0	0	2	0	2	0	0.370	0.000	2.270
OPERATING PERSONNEL	11	0	5	0	16	0	4.285	0.000	4.065
HEALTH PHYSICS PERSONNEL	1	0	36	0	37	0	4.700	0.005	28.085
SUPERVISORY PERSONNEL	1	0	381	0	382	0	18.390	0.425	367.681
ENGINEERING PERSONNEL	41	0	422	0	463	0	18.390	0.425	367.681
TOTAL	2	0	5	0	7	0	0.525	0.000	2.050
WASTE PROCESSING	1	0	0	0	1	0	1.230	0.000	0.000
MAINTENANCE PERSONNEL	4	0	0	0	4	0	3.260	0.000	0.000
OPERATING PERSONNEL	10	0	0	0	10	0	3.990	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	2	0	2	0	0.000	0.000	0.030
SUPERVISORY PERSONNEL	0	0	7	0	7	0	9.005	0.000	0.225
ENGINEERING PERSONNEL	17	0	392	0	409	0	9.005	0.000	2.305
TOTAL	29	7	276	0	312	7	21.360	2.300	187.966
REFUELLING	48	0	0	0	48	0	28.035	0.000	0.000
MAINTENANCE PERSONNEL	18	0	61	0	79	0	10.565	0.000	57.035
OPERATING PERSONNEL	59	0	27	0	86	0	50.167	0.025	16.075
HEALTH PHYSICS PERSONNEL	24	1	28	0	53	1	10.690	0.205	12.040
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000
ENGINEERING PERSONNEL	178	8	392	0	578	8	120.817	2.530	273.116
TOTAL	29	7	276	0	312	7	21.360	2.300	187.966
OPERATING PERSONNEL	48	0	0	0	48	0	28.035	0.000	0.000
HEALTH PHYSICS PERSONNEL	18	0	61	0	79	0	10.565	0.000	57.035
SUPERVISORY PERSONNEL	59	0	27	0	86	0	50.167	0.025	16.075
ENGINEERING PERSONNEL	24	1	28	0	53	1	10.690	0.205	12.040
TOTAL	178	8	392	0	578	8	120.817	2.530	273.116
TOTAL BY JOB FUNCTION	77	7	755	0	839	7	43.360	2.730	605.753
MAINTENANCE PERSONNEL	77	0	0	0	77	0	37.100	0.000	0.000
OPERATING PERSONNEL	35	0	63	0	98	0	18.380	0.000	59.375
HEALTH PHYSICS PERSONNEL	104	0	38	0	142	0	67.272	0.025	22.345
SUPERVISORY PERSONNEL	47	2	80	0	129	2	21.720	0.320	51.380
ENGINEERING PERSONNEL	340	9	936	0	1285	9	187.832	3.075	738.853
GRAND TOTAL	340	9	936	0	1285	9	187.832	3.075	738.853

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: * MCGUIRE 1	(PMR)	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)	
		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
WORK & JOB FUNCTION		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
REACTOR OPERATIONS & SURV.		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	131	324	35	3.395	4.523	0.500							
OPERATING PERSONNEL	97	10	21	16.211	0.775	0.215							
HEALTH PHYSICS PERSONNEL	64	0	108	7.959	0.000	6.245							
SUPERVISORY PERSONNEL	12	0	0	0.405	0.000	0.000							
ENGINEERING PERSONNEL	68	12	8	4.795	0.620	0.010							
TOTAL	372	346	172	32.765	5.918	6.970						45.653	
ROUTINE MAINTENANCE		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	138	313	43	23.683	37.295	5.297							
OPERATING PERSONNEL	91	8	39	14.880	2.095	23.204							
HEALTH PHYSICS PERSONNEL	63	0	107	16.575	0.000	24.889							
SUPERVISORY PERSONNEL	12	0	0	0.820	0.000	0.000							
ENGINEERING PERSONNEL	60	12	8	6.885	1.595	0.360							
TOTAL	364	333	197	62.843	40.885	53.750						157.478	
IN-SERVICE INSPECTION		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	30	116	21	1.035	45.180	12.555							
OPERATING PERSONNEL	9	0	14	0.060	0.000	0.360							
HEALTH PHYSICS PERSONNEL	38	0	60	6.540	0.000	7.655							
SUPERVISORY PERSONNEL	2	0	0	0.120	0.000	0.000							
ENGINEERING PERSONNEL	39	6	12	15.090	1.135	4.455							
TOTAL	118	122	107	22.845	46.315	25.025						94.185	
SPECIAL MAINTENANCE		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	131	339	60	41.150	137.100	15.534							
OPERATING PERSONNEL	57	7	23	2.685	0.105	0.510							
HEALTH PHYSICS PERSONNEL	53	0	85	11.855	0.000	14.130							
SUPERVISORY PERSONNEL	8	0	0	1.400	0.000	0.000							
ENGINEERING PERSONNEL	60	13	21	13.920	0.875	5.785							
TOTAL	309	359	189	71.010	138.030	35.959						245.049	
WASTE PROCESSING		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	18	19	0	0.350	0.085	0.000							
OPERATING PERSONNEL	22	2	13	0.320	0.000	1.950							
HEALTH PHYSICS PERSONNEL	33	0	23	12.175	0.000	1.265							
SUPERVISORY PERSONNEL	2	0	0	0.235	0.000	0.000							
ENGINEERING PERSONNEL	12	1	0	0.075	0.000	0.000							
TOTAL	87	22	36	13.155	0.085	3.215						16.455	
REFUELING		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	54	91	13	7.715	12.245	0.780							
OPERATING PERSONNEL	39	1	7	3.260	0.000	0.320							
HEALTH PHYSICS PERSONNEL	33	0	34	0.535	0.000	0.985							
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000							
ENGINEERING PERSONNEL	34	2	5	2.000	0.005	0.930							
TOTAL	160	94	59	13.510	12.250	3.015						28.775	
TOTAL BY JOB FUNCTION		STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES	STATION EMPLOYEES
MAINTENANCE PERSONNEL	502	1202	172	77.328	236.428	34.666						348.422	
OPERATING PERSONNEL	315	28	117	37.416	2.975	26.559						66.950	
HEALTH PHYSICS PERSONNEL	284	0	417	55.639	0.000	55.169						110.808	
SUPERVISORY PERSONNEL	36	0	0	2.980	0.000	0.000						2.980	
ENGINEERING PERSONNEL	273	46	54	42.765	4.130	11.540						58.435	
GRAND TOTAL	1410	1276	760	216.128	243.533	127.934						587.595	

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: *MILLSTONE 1 (BMR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	STATION EMPLOYEES		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.	17	0	0	7	8,610	4,320	0.160	4.320	0.160	4.320
MAINTENANCE PERSONNEL	55	0	0	0	52,710	0.070	0.000	0.070	0.000	0.070
OPERATING PERSONNEL	21	1	1	12	6,880	4.340	0.400	4.340	0.400	4.340
HEALTH PHYSICS PERSONNEL	1	0	0	0	0.020	0.140	0.000	0.140	0.000	0.140
SUPERVISORY PERSONNEL	1	0	4	3	0.600	1.360	1.490	1.360	1.490	1.360
ENGINEERING PERSONNEL	95	5	5	22	68,820	10.230	2.050	10.230	2.050	10.230
TOTAL	177	5	5	22	122	81.100	2.050	81.100	2.050	81.100
ROUTINE MAINTENANCE	50	12	12	176	20,590	67.450	6.350	67.450	6.350	67.450
MAINTENANCE PERSONNEL	11	0	0	11	4,380	2.480	0.000	2.480	0.000	2.480
OPERATING PERSONNEL	19	1	1	31	7,080	9.460	0.320	9.460	0.320	9.460
HEALTH PHYSICS PERSONNEL	0	0	0	1	0.060	0.420	0.000	0.420	0.000	0.420
SUPERVISORY PERSONNEL	8	13	13	22	2,580	5.590	0.000	5.590	0.000	5.590
ENGINEERING PERSONNEL	88	26	26	241	34,690	85.400	3.810	85.400	3.810	85.400
TOTAL	107	26	26	241	355	130.570	10.480	130.570	10.480	130.570
IN-SERVICE INSPECTION	0	1	1	31	0.570	24.640	0.530	24.640	0.530	24.640
MAINTENANCE PERSONNEL	1	0	0	0	1.030	0.010	0.000	0.010	0.000	0.010
OPERATING PERSONNEL	1	0	0	3	0.540	3.000	0.010	3.000	0.010	3.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	3	7	7	18	1.350	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	5	8	8	52	3,490	44.740	4.340	44.740	4.340	44.740
TOTAL	10	8	8	52	65	53.110	4.880	53.110	4.880	53.110
SPECIAL MAINTENANCE	75	64	64	506	49,010	300.720	20.520	300.720	20.520	300.720
MAINTENANCE PERSONNEL	16	0	0	8	5,820	2.970	0.060	2.970	0.060	2.970
OPERATING PERSONNEL	20	0	0	52	8,650	21.670	0.090	21.670	0.090	21.670
HEALTH PHYSICS PERSONNEL	0	0	0	6	0.040	2.600	0.000	2.600	0.000	2.600
SUPERVISORY PERSONNEL	11	27	27	56	4,030	34.600	12.180	34.600	12.180	34.600
ENGINEERING PERSONNEL	122	91	91	628	67,550	362.560	32.870	362.560	32.870	362.560
TOTAL	122	91	91	628	841	462.980	32.870	462.980	32.870	462.980
WASTE PROCESSING	4	0	0	21	1,490	16.490	0.000	16.490	0.000	16.490
MAINTENANCE PERSONNEL	8	0	0	0	2,930	0.020	0.000	0.020	0.000	0.020
OPERATING PERSONNEL	11	0	0	8	6,980	3.940	0.010	3.940	0.010	3.940
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	0	0	3	0.550	0.090	0.000	0.090	0.000	0.090
ENGINEERING PERSONNEL	25	0	0	32	11,950	20.540	0.010	20.540	0.010	20.540
TOTAL	25	0	0	32	57	32.500	0.010	32.500	0.010	32.500
REFUELING	57	44	44	24	32,980	9.050	15.230	9.050	15.230	9.050
MAINTENANCE PERSONNEL	38	0	0	0	16,970	0.160	0.000	0.160	0.000	0.160
OPERATING PERSONNEL	5	0	0	17	2,060	5.070	0.200	5.070	0.200	5.070
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.020	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	7	3	3	2	3,430	0.770	1.130	0.770	1.130	0.770
ENGINEERING PERSONNEL	107	47	47	43	55,460	15.050	16.560	15.050	16.560	15.050
TOTAL	107	47	47	43	197	87.070	16.560	87.070	16.560	87.070
TOTAL BY JOB FUNCTION	203	121	121	765	1,089	422.670	42.790	422.670	42.790	422.670
MAINTENANCE PERSONNEL	129	0	0	19	83,840	5.710	0.060	5.710	0.060	5.710
OPERATING PERSONNEL	77	2	2	123	32,190	47.480	1.030	47.480	1.030	47.480
HEALTH PHYSICS PERSONNEL	1	0	0	7	0.140	3.320	0.020	3.320	0.020	3.320
SUPERVISORY PERSONNEL	32	54	54	104	12,540	59.500	22.950	59.500	22.950	59.500
ENGINEERING PERSONNEL	442	177	177	1,018	241,960	538.520	66.850	538.520	66.850	538.520
GRAND TOTAL	442	177	177	1,018	1,637	847.330	87.070	847.330	87.070	847.330

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: MILLSTONE 2	(PWR)	NUMBER OF PERSONNEL (>100 M-REM)					TOTAL MAN-REMS				
		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS		
WORK & JOB FUNCTION											
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	1	0	0	0	0	0.540	0.000	0.050	0.000	0.000	0.050
OPERATING PERSONNEL	16	0	0	0	0	4.710	0.000	0.030	0.000	0.000	0.030
HEALTH PHYSICS PERSONNEL	10	0	2	0	2	4.130	0.020	0.660	0.000	0.000	0.660
SUPERVISORY PERSONNEL	0	0	0	0	0	0.050	0.000	0.020	0.000	0.000	0.020
ENGINEERING PERSONNEL	2	0	0	0	0	1.020	0.010	0.020	0.000	0.000	0.020
TOTAL	29	0	2	0	31	10.450	0.030	0.780	0.000	0.000	11.260
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	54	0	15	0	15	26.260	0.030	5.070	0.000	0.000	5.070
OPERATING PERSONNEL	2	0	0	0	0	1.070	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	3	0	3	1.130	0.030	0.770	0.000	0.000	0.770
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	0	1	0	1	1.070	0.160	0.670	0.000	0.000	0.670
TOTAL	63	0	19	0	82	29.530	0.220	6.510	0.000	0.000	36.260
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.010	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.010	0.000	0.000	0.010
ENGINEERING PERSONNEL	2	0	0	0	0	0.530	0.160	0.000	0.000	0.000	0.530
TOTAL	2	0	0	0	2	0.540	0.160	0.010	0.000	0.000	0.710
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	18	0	52	0	52	6.460	0.040	26.700	0.000	0.000	26.700
OPERATING PERSONNEL	0	0	0	0	0	0.340	0.000	0.020	0.000	0.000	0.020
HEALTH PHYSICS PERSONNEL	2	0	4	0	4	0.680	0.040	1.000	0.000	0.000	1.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	13	0	13	0.120	0.220	5.930	0.000	0.000	5.930
TOTAL	20	0	69	0	89	7.600	0.300	33.650	0.000	0.000	41.550
WASTE PROCESSING											
MAINTENANCE PERSONNEL	0	0	29	0	29	0.110	0.000	13.180	0.000	0.000	13.180
OPERATING PERSONNEL	6	0	0	0	0	1.850	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	6	0	6	0	6	5.840	0.000	3.470	0.000	0.000	3.470
SUPERVISORY PERSONNEL	2	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	2	0	5	0	5	1.190	0.000	1.430	0.000	0.000	1.430
TOTAL	14	0	40	0	54	8.990	0.000	18.080	0.000	0.000	27.070
REFUELING											
MAINTENANCE PERSONNEL	0	0	2	0	2	0.130	0.000	0.530	0.000	0.000	0.530
OPERATING PERSONNEL	0	0	0	0	0	0.080	0.000	0.010	0.000	0.000	0.010
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.110	0.000	0.000	0.110
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	16	0	16	0.020	0.090	3.580	0.000	0.000	3.580
TOTAL	0	0	18	0	18	0.230	0.090	4.230	0.000	0.000	4.550
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	73	0	98	0	171	33.500	0.070	45.530	0.000	0.000	79.100
OPERATING PERSONNEL	24	0	0	0	24	8.050	0.000	0.060	0.000	0.000	8.110
HEALTH PHYSICS PERSONNEL	22	0	15	0	37	11.790	0.090	6.010	0.000	0.000	17.890
SUPERVISORY PERSONNEL	0	0	0	0	0	0.050	0.000	0.030	0.000	0.000	0.080
ENGINEERING PERSONNEL	9	0	35	0	44	3.950	0.640	11.630	0.000	0.000	16.220
GRAND TOTAL	128	0	148	0	276	57.340	0.800	63.260	0.000	0.000	121.400

^aIncludes sparger repair, flow restrictor replacement, steam generator modifications, decontamination, etc.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: MONTICELLO (BWR) 1984

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	43	16	149	0	16	0	21,453	88,563	3,329	0.000	0.000	3.329
OPERATING PERSONNEL	42	0	0	0	0	0	33,099	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	15	42	8	45	42	45	5,529	0.000	0.000	26,528	12,797	26.528
SUPERVISORY PERSONNEL	22	0	0	0	0	0	5,202	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	122	103	157	0	382	0	65,283	89,936	42,654	0.000	0.000	197,873
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	31	111	252	0	111	0	20,989	118,721	35,254	0.000	0.000	35.254
OPERATING PERSONNEL	4	0	0	0	0	0	0.682	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	2	16	2	25	16	25	0.529	0.000	0.000	5,316	11,730	5.316
SUPERVISORY PERSONNEL	7	0	0	0	0	0	1,504	0.204	0.000	0.000	0.000	0.204
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	44	152	254	0	450	0	23,704	118,925	52,300	0.000	0.000	194,929
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	1	14	16	0	14	0	0.118	7,117	5,669	0.000	0.000	5.669
OPERATING PERSONNEL	2	0	0	0	0	0	0.221	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	14	3	14	14	14	0.000	0.584	0.000	5,618	0.000	5.618
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	3	28	19	0	50	0	0.339	7,701	11,287	0.000	0.000	19,327
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	37	305	495	0	305	0	47,322	1,007,766	338,123	0.000	0.000	338.123
OPERATING PERSONNEL	48	1	0	0	1	0	43,130	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	9	65	22	266	65	266	6,559	0.000	0.000	64,553	366,990	64.553
SUPERVISORY PERSONNEL	11	0	0	0	0	0	4,693	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	4	0	0	4	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	105	641	517	0	1,263	0	101,704	1,020,243	770,517	0.000	0.000	1,892,464
WASTE PROCESSING												
MAINTENANCE PERSONNEL	11	0	34	0	0	0	4,318	14,330	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	2	0	0	0	0	0	0.683	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	4	0	4	4	4	0.718	0.000	0.000	0.632	3,239	0.632
SUPERVISORY PERSONNEL	2	0	0	0	0	0	0.226	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	18	6	34	0	58	0	5,945	14,330	3,871	0.000	0.000	24,146
REFUELING												
MAINTENANCE PERSONNEL	0	0	2	0	0	0	0.000	0.267	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	40	0	0	0	0	0	9,866	0.000	0.000	0.382	0.000	0.382
HEALTH PHYSICS PERSONNEL	0	2	0	0	2	0	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	0	0	0	0	0	0.824	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	42	2	2	0	46	0	10,690	0.267	0.382	0.000	0.000	11,339
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	123	446	948	0	446	0	94,200	1,236,764	382,375	0.000	0.000	1,713,339
OPERATING PERSONNEL	138	1	0	0	1	0	87,681	0.000	0.000	0.737	0.000	88,418
HEALTH PHYSICS PERSONNEL	29	129	0	158	129	158	13,335	0.000	0.000	97,029	110,364	110,364
SUPERVISORY PERSONNEL	44	352	35	431	431	431	12,449	14,638	400,374	427,461	427,461	
ENGINEERING PERSONNEL	0	4	0	4	4	4	0.000	0.000	0.000	0.000	0.000	
GRAND TOTAL	334	932	983	0	2,249	0	207,665	1,251,402	881,011	0.000	0.000	2,340,078

* Workers may be counted in more than one category.

^a Special maintenance includes maintenance in primary containment, recirc. pipe replacement, reactor water clean up heat exchanger mods., and condenser retube.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: NINE MILE POINT (BWR) 1984

WORK & JOB FUNCTION	STATION EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		TOTAL MAN-REMS		TOTAL MAN-REMS
	EMPLOYEES	UTILITY EMPLOYEES	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS		
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	392	10	160		65,475	0,787	8,583		
OPERATING PERSONNEL	293	51	148		30,154	3,204	10,209		
HEALTH PHYSICS PERSONNEL	119	4	18		14,889	0,092	4,842		
SUPERVISORY PERSONNEL	47	3	13		9,773	0,012	0,558		
ENGINEERING PERSONNEL	40	24	73		5,573	0,825	5,687		
TOTAL	891	92	412	1395	125,864	4,920	29,679		160,463
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	485	8	314		46,041	0,258	98,822		
OPERATING PERSONNEL	345	33	166		18,586	0,827	13,578		
HEALTH PHYSICS PERSONNEL	85	4	15		3,769	0,021	0,942		
SUPERVISORY PERSONNEL	44	0	17		2,383	0,000	4,434		
ENGINEERING PERSONNEL	59	10	81		1,665	0,080	8,854		
TOTAL	1018	55	593	1666	72,444	1,186	126,630		200,260
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	134	1	117		7,485	0,003	52,919		
OPERATING PERSONNEL	120	3	59		3,804	0,076	23,631		
HEALTH PHYSICS PERSONNEL	7	0	9		0,048	0,000	0,329		
SUPERVISORY PERSONNEL	10	0	6		0,586	0,000	3,481		
ENGINEERING PERSONNEL	14	4	33		1,109	0,211	9,265		
TOTAL	285	8	224	517	13,032	0,290	89,625		102,947
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	1382	5	656		145,128	0,363	57,891		
OPERATING PERSONNEL	468	24	294		39,507	0,397	22,709		
HEALTH PHYSICS PERSONNEL	161	0	54		24,169	0,000	4,939		
SUPERVISORY PERSONNEL	85	0	17		5,885	0,000	1,295		
ENGINEERING PERSONNEL	120	21	167		3,786	0,647	14,004		
TOTAL	2216	50	1188	3454	218,475	1,407	100,838		320,720
WASTE PROCESSING									
MAINTENANCE PERSONNEL	95	2	28		6,372	0,017	1,743		
OPERATING PERSONNEL	71	4	30		38,426	0,050	5,242		
HEALTH PHYSICS PERSONNEL	45	0	11		3,205	0,000	4,021		
SUPERVISORY PERSONNEL	6	0	1		0,594	0,000	0,001		
ENGINEERING PERSONNEL	10	1	10		0,153	0,018	2,994		
TOTAL	227	7	80	314	48,750	0,085	14,001		62,836
REFUELING									
MAINTENANCE PERSONNEL	81	0	24		13,972	0,000	4,692		
OPERATING PERSONNEL	55	1	12		7,280	0,015	0,239		
HEALTH PHYSICS PERSONNEL	15	0	2		0,247	0,000	0,045		
SUPERVISORY PERSONNEL	16	0	1		1,352	0,000	0,020		
ENGINEERING PERSONNEL	10	0	9		0,283	0,000	0,111		
TOTAL	177	1	48	226	23,134	0,015	5,107		28,256
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	2569	26	1299	3894	284,473	1,428	224,650		510,551
OPERATING PERSONNEL	1352	116	709	2177	137,757	4,569	75,608		217,934
HEALTH PHYSICS PERSONNEL	432	8	109	549	46,327	0,113	15,118		61,558
SUPERVISORY PERSONNEL	208	3	55	266	20,573	0,012	9,789		30,374
ENGINEERING PERSONNEL	253	60	373	686	12,569	1,781	40,715		55,065
GRAND TOTAL	4814	213	2545	7572	501,699	7,903	365,880		875,482

*Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: NORTH ANNA 1,2 (PWR)

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS		
REACTOR OPERATIONS & SURV.	168	47	653	16,965	1,159	31,846	228	18	183	0.515	22,128
MAINTENANCE PERSONNEL	228	1	18	41,839	0.005	0.515	46	8	46	0.092	1,092
OPERATING PERSONNEL	54	1	9	1,568	0.002	1.225	47	74	121	0.234	1,225
HEALTH PHYSICS PERSONNEL	46	22	74	1,358	0.002	1.225	543	79	622	1.500	55,806
SUPERVISORY PERSONNEL	47	79	937	95,187	1,559	55,806	158	71	229	18,365	237,755
ENGINEERING PERSONNEL	543	79	937	95,187	1,559	55,806	134	0	134	0.000	1,500
TOTAL	543	79	937	95,187	1,559	55,806	46	6	52	1,196	93,678
ROUTINE MAINTENANCE	158	71	737	164,002	0.260	4.094	37	7	44	0.300	0.440
OPERATING PERSONNEL	134	0	23	63,347	0.000	0.010	40	22	62	0.297	6,700
HEALTH PHYSICS PERSONNEL	46	6	189	33,585	0.000	1.524	415	104	519	20,158	339,873
SUPERVISORY PERSONNEL	37	5	7	4,464	0.000	0.000	12	8	20	0.260	4.094
ENGINEERING PERSONNEL	40	22	79	3,965	0.015	0.000	13	1	14	0.000	0.010
TOTAL	415	104	1035	269,363	0.260	4.094	12	1	13	0.000	0.010
IN-SERVICE INSPECTION	12	8	53	0.990	0.260	4.094	13	0	13	0.000	0.010
OPERATING PERSONNEL	13	1	34	2,478	0.000	0.010	5	1	6	0.025	1.524
HEALTH PHYSICS PERSONNEL	5	1	34	0.243	0.000	0.000	1	0	1	0.000	0.000
SUPERVISORY PERSONNEL	1	0	0	0.015	0.000	0.000	3	1	4	0.010	0.064
ENGINEERING PERSONNEL	3	1	4	0.015	0.010	0.064	34	10	44	0.297	6,700
TOTAL	34	10	92	3,741	0.295	5.692	73	19	92	1,554	629,394
SPECIAL MAINTENANCE	73	19	1139	11,445	1.944	786,286	35	0	35	0.000	0.000
OPERATING PERSONNEL	35	0	22	5,566	0.000	6.674	36	2	38	0.000	0.000
HEALTH PHYSICS PERSONNEL	11	1	16	6,124	0.115	81,222	11	1	12	0.008	10,684
SUPERVISORY PERSONNEL	12	12	68	0.616	0.008	10,684	12	12	24	1.354	32,024
ENGINEERING PERSONNEL	167	34	1394	26,204	3.421	916,890	167	34	201	9.166	946,515
TOTAL	167	34	1394	26,204	3.421	916,890	167	34	201	9.166	946,515
WASTE PROCESSING	54	9	122	4,425	0.246	14,316	34	0	34	0.000	0.000
OPERATING PERSONNEL	34	0	5	13,085	0.000	5,916	45	0	45	0.000	0.000
HEALTH PHYSICS PERSONNEL	45	0	115	18,885	0.000	14,942	7	0	7	0.000	0.000
SUPERVISORY PERSONNEL	7	0	0	1,369	0.000	0.000	1	0	1	0.000	0.000
ENGINEERING PERSONNEL	1	7	7	0.002	0.000	0.685	1	7	8	0.000	0.000
TOTAL	141	9	249	37,766	0.246	35,659	141	9	150	0.246	73,671
REFUELING	84	28	156	31,451	13,214	26,905	75	3	78	0.166	1,780
OPERATING PERSONNEL	75	18	112	14,849	0.166	1,780	14	2	16	0.014	11,497
HEALTH PHYSICS PERSONNEL	14	3	4	0.452	0.014	11,497	11	4	15	0.270	0.270
SUPERVISORY PERSONNEL	11	2	26	1,021	0.461	0.270	6	12	18	0.270	3,110
ENGINEERING PERSONNEL	6	12	26	0.200	1.541	3,110	190	48	238	15,396	43,562
TOTAL	190	48	316	47,973	15,396	43,562	190	48	238	15,396	106,931
TOTAL BY JOB FUNCTION	549	182	2860	229,278	35,188	1101,202	519	4	523	0.171	16,195
OPERATING PERSONNEL	519	4	782	141,164	0.171	16,195	200	19	219	0.450	224,991
HEALTH PHYSICS PERSONNEL	200	19	36	92,746	0.771	11,486	113	10	123	0.771	21,310
SUPERVISORY PERSONNEL	113	10	258	9,053	0.771	11,486	109	69	178	3.436	43,608
ENGINEERING PERSONNEL	109	69	4023	7,993	3.436	43,608	1490	284	1774	13,977	1918,732
GRAND TOTAL	1490	284	4023	480,234	41,016	1,397,482	1490	284	1774	41,016	1,918,732

*Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: OONEE 1,2,3 (PMR)	NUMBER OF PERSONNEL (>100 M-REM) 1984									
	WORK & JOB FUNCTION		STATION EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.										
MAINTENANCE PERSONNEL	202	126	417	126	3,050	3,650	0,915	3,050	0,915	
OPERATING PERSONNEL	154	23	1	23	45,480	0,645	1,235	45,480	1,235	
HEALTH PHYSICS PERSONNEL	62	44	2	44	2,300	0,070	0,840	2,300	0,840	
SUPERVISORY PERSONNEL	35	0	0	0	1,135	0,000	0,000	1,135	0,000	
ENGINEERING PERSONNEL	82	4	27	4	11,566	0,435	0,000	11,566	0,435	
TOTAL	535	197	447	1179	63,531	4,800	2,990	63,531	2,990	71,321
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	221	93	474	93	118,055	96,107	41,540	118,055	41,540	
OPERATING PERSONNEL	137	55	1	55	19,060	0,235	55,340	19,060	55,340	
HEALTH PHYSICS PERSONNEL	75	92	2	92	35,645	0,370	37,929	35,645	37,929	
SUPERVISORY PERSONNEL	31	0	0	0	4,246	0,000	0,000	4,246	0,000	
ENGINEERING PERSONNEL	79	3	16	3	11,455	1,500	0,960	11,455	0,960	
TOTAL	543	243	493	1279	188,461	98,212	135,769	188,461	135,769	422,442
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	86	70	206	70	7,305	45,435	33,775	7,305	33,775	
OPERATING PERSONNEL	11	16	0	16	0,150	0,000	0,400	0,150	0,400	
HEALTH PHYSICS PERSONNEL	42	65	1	65	2,935	0,000	8,235	2,935	8,235	
SUPERVISORY PERSONNEL	3	0	0	0	0,015	0,000	0,000	0,015	0,000	
ENGINEERING PERSONNEL	55	3	4	3	11,020	0,330	1,425	11,020	1,425	
TOTAL	197	154	211	562	21,425	45,765	43,835	21,425	43,835	111,025
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	195	134	553	134	55,480	327,620	59,905	55,480	59,905	
OPERATING PERSONNEL	68	36	1	36	2,125	0,015	2,150	2,125	2,150	
HEALTH PHYSICS PERSONNEL	54	88	1	88	12,685	0,015	22,280	12,685	22,280	
SUPERVISORY PERSONNEL	16	0	0	0	0,940	0,000	0,000	0,940	0,000	
ENGINEERING PERSONNEL	79	4	24	4	19,845	8,680	0,685	19,845	0,685	
TOTAL	412	262	579	1253	91,075	336,330	85,020	91,075	85,020	512,425
WASTE PROCESSING										
MAINTENANCE PERSONNEL	79	0	62	0	2,420	3,185	0,000	2,420	0,000	
OPERATING PERSONNEL	60	50	0	50	15,065	0,000	8,400	15,065	8,400	
HEALTH PHYSICS PERSONNEL	60	22	1	22	8,675	0,015	0,800	8,675	0,800	
SUPERVISORY PERSONNEL	15	0	0	0	1,535	0,000	0,000	1,535	0,000	
ENGINEERING PERSONNEL	25	0	3	0	0,830	0,440	0,000	0,830	0,000	
TOTAL	239	72	66	377	28,505	3,640	9,200	28,505	9,200	41,345
REFUELING										
MAINTENANCE PERSONNEL	125	38	113	38	31,450	12,135	7,675	31,450	7,675	
OPERATING PERSONNEL	123	13	1	13	20,985	0,245	1,565	20,985	1,565	
HEALTH PHYSICS PERSONNEL	28	61	1	61	1,435	0,005	6,805	1,435	6,805	
SUPERVISORY PERSONNEL	9	0	0	0	1,490	0,000	0,000	1,490	0,000	
ENGINEERING PERSONNEL	34	1	3	1	1,940	0,195	0,120	1,940	0,120	
TOTAL	319	113	118	550	57,300	12,580	16,165	57,300	16,165	86,045
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	908 (223)	461 (167)	1825 (574)	461 (167)	217,760	488,132	143,810	217,760	143,810	849,702
OPERATING PERSONNEL	553 (155)	193 (62)	4 (1)	193 (62)	102,845	1,140	69,090	102,845	69,090	173,075
HEALTH PHYSICS PERSONNEL	321 (75)	372 (92)	8 (2)	372 (92)	63,675	0,475	76,889	63,675	76,889	141,039
SUPERVISORY PERSONNEL	109 (35)	0 (0)	0 (0)	0 (0)	9,361	0,000	0,000	9,361	0,000	9,361
ENGINEERING PERSONNEL	354 (92)	15 (5)	77 (29)	15 (5)	56,656	11,580	3,190	56,656	3,190	71,426
GRAND TOTAL	2245 (580)	1041 (326)	1914 (606)	1041 (326)	450,297	501,327	292,979	450,297	292,979	1244,603

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

PLANT: OYSTER CREEK (BWR)

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.																
MAINTENANCE PERSONNEL	144	475	31		18,621		18,621		5,978			30,081				
OPERATING PERSONNEL	156	10	1		35,844		35,844		0,015			0,990				
HEALTH PHYSICS PERSONNEL	54	114	0		6,850		6,850		0,000			18,041				
SUPERVISORY PERSONNEL	41	0	2		2,278		2,278		0,055			0,000				
ENGINEERING PERSONNEL	46	11	0		2,461		2,461		0,000			0,487				
TOTAL	441	610	34		66,054		66,054		6,048			49,599				121,701
ROUTINE MAINTENANCE																
MAINTENANCE PERSONNEL	209	1013	43		84,437		84,437		11,574			313,269				
OPERATING PERSONNEL	218	37	1		18,122		18,122		0,045			1,706				
HEALTH PHYSICS PERSONNEL	61	103	0		7,440		7,440		0,000			15,075				
SUPERVISORY PERSONNEL	94	1	1		8,070		8,070		0,125			0,005				
ENGINEERING PERSONNEL	55	15	0		2,077		2,077		0,000			0,937				
TOTAL	637	1169	45		120,146		120,146		11,744			330,992				462,882
IN-SERVICE INSPECTION																
MAINTENANCE PERSONNEL	3	23	1		0,160		0,160		0,000			2,885				
OPERATING PERSONNEL	3	1	0		0,350		0,350		0,000			0,015				
HEALTH PHYSICS PERSONNEL	1	5	0		0,028		0,028		0,000			0,090				
SUPERVISORY PERSONNEL	1	0	0		0,090		0,090		0,000			0,000				
ENGINEERING PERSONNEL	0	1	0		0,000		0,000		0,000			0,055				
TOTAL	8	30	1		0,628		0,628		0,000			3,045				3,673
SPECIAL MAINTENANCE																
MAINTENANCE PERSONNEL	194	1244	43		99,222		99,222		25,405			790,082				
OPERATING PERSONNEL	154	16	1		39,793		39,793		0,918			6,777				
HEALTH PHYSICS PERSONNEL	34	119	0		22,971		22,971		0,000			42,168				
SUPERVISORY PERSONNEL	55	1	2		10,199		10,199		1,778			0,073				
ENGINEERING PERSONNEL	56	15	0		10,362		10,362		0,000			2,545				
TOTAL	493	1395	46		182,547		182,547		28,101			841,645				1052,293
WASTE PROCESSING																
MAINTENANCE PERSONNEL	97	336	0		4,267		4,267		0,000			127,119				
OPERATING PERSONNEL	29	5	0		0,737		0,737		0,000			0,083				
HEALTH PHYSICS PERSONNEL	22	67	0		1,584		1,584		0,000			7,178				
SUPERVISORY PERSONNEL	9	0	0		0,368		0,368		0,000			0,000				
ENGINEERING PERSONNEL	2	0	0		0,126		0,126		0,000			0,000				
TOTAL	159	408	0		7,082		7,082		0,000			134,380				141,462
REFUELING																
MAINTENANCE PERSONNEL	96	175	6		29,080		29,080		0,220			36,225				
OPERATING PERSONNEL	61	5	0		15,748		15,748		0,000			0,949				
HEALTH PHYSICS PERSONNEL	15	21	0		0,478		0,478		0,000			1,281				
SUPERVISORY PERSONNEL	13	0	0		2,637		2,637		0,000			0,000				
ENGINEERING PERSONNEL	3	1	0		0,020		0,020		0,000			0,010				
TOTAL	188	202	6		47,963		47,963		0,220			38,465				86,648
TOTAL BY JOB FUNCTION																
MAINTENANCE PERSONNEL	745 (224)	3266 (1461)	124 (44)		235,787		235,787		43,177			1299,661				1578,625
OPERATING PERSONNEL	621 (242)	74 (48)	3 (1)		110,594		110,594		0,978			10,520				122,092
HEALTH PHYSICS PERSONNEL	187 (67)	429 (142)	0 (0)		39,351		39,351		0,000			83,833				123,184
SUPERVISORY PERSONNEL	213 (97)	2 (1)	5 (2)		23,642		23,642		1,958			0,078				25,678
ENGINEERING PERSONNEL	162 (79)	43 (23)	0 (0)		15,046		15,046		0,000			6,034				19,080
GRAND TOTAL	1926 (709)	3814 (1675)	132 (47)		424,420		424,420		46,113			1398,126				1868,659

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

(BMR)

PLANT: PALISADES

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL		STATION		TOTAL MAN-REMS		TOTAL
	STATION EMPLOYEES	UTILITY EMPLOYEES	PERSONS	PERSONS	EMPLOYEES	EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	1	1	4		0.698		1.036	1.932	
OPERATING PERSONNEL	26	0	0		15.950		0.000	0.008	
HEALTH PHYSICS PERSONNEL	35	11	51		17.101		4.049	30.572	
SUPERVISORY PERSONNEL	0	0	0		0.299		0.014	0.000	
ENGINEERING PERSONNEL	1	2	0		0.551		1.280	0.000	
TOTAL	63	14	55	132	34.599		6.379	32.512	73.490
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	50	38	27		30.407		31.146	12.872	
OPERATING PERSONNEL	7	0	0		4.190		0.000	0.000	
HEALTH PHYSICS PERSONNEL	5	1	7		2.228		0.528	3.985	
SUPERVISORY PERSONNEL	0	0	0		0.053		0.121	0.000	
ENGINEERING PERSONNEL	1	4	0		0.507		3.332	0.000	
TOTAL	63	43	34	140	37.585		35.127	16.857	89.369
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	0	1	13		0.257		0.618	6.249	
OPERATING PERSONNEL	11	0	0		6.707		0.000	0.003	
HEALTH PHYSICS PERSONNEL	0	0	0		0.165		0.039	0.296	
SUPERVISORY PERSONNEL	1	0	0		0.496		0.103	0.021	
ENGINEERING PERSONNEL	7	40	0		4.305		32.593	0.163	
TOTAL	19	41	13	73	11.930		33.353	6.732	52.015
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	38	13	310		23.024		11.069	146.515	
OPERATING PERSONNEL	17	0	0		10.261		0.000	0.004	
HEALTH PHYSICS PERSONNEL	12	4	18		6.002		1.421	10.729	
SUPERVISORY PERSONNEL	0	1	0		0.087		0.000	0.000	
ENGINEERING PERSONNEL	6	29	0		3.585		23.545	0.000	
TOTAL	73	47	328	448	42.959		36.607	157.248	236.814
WASTE PROCESSING									
MAINTENANCE PERSONNEL	23	0	4		13.977		0.000	2.007	
OPERATING PERSONNEL	8	0	0		4.860		0.000	0.000	
HEALTH PHYSICS PERSONNEL	5	2	8		2.711		0.642	4.847	
SUPERVISORY PERSONNEL	0	0	0		0.089		0.000	0.000	
ENGINEERING PERSONNEL	0	0	0		0.032		0.211	0.000	
TOTAL	36	2	12	50	21.669		0.853	6.854	29.376
REFUELING									
MAINTENANCE PERSONNEL	29	20	0		17.694		16.778	0.000	
OPERATING PERSONNEL	6	0	0		3.819		0.000	0.002	
HEALTH PHYSICS PERSONNEL	1	0	1		0.254		0.060	0.453	
SUPERVISORY PERSONNEL	1	0	0		0.715		0.035	0.000	
ENGINEERING PERSONNEL	3	9	0		1.582		7.335	0.000	
TOTAL	40	29	1	70	24.064		24.208	0.455	48.727
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	141	73	358	572	86.057		60.647	169.575	316.279
OPERATING PERSONNEL	75	0	0	75	45.787		0.000	0.017	45.804
HEALTH PHYSICS PERSONNEL	58	18	85	161	28.461		6.739	50.882	86.082
SUPERVISORY PERSONNEL	2	1	0	3	1.739		0.845	0.021	2.605
ENGINEERING PERSONNEL	18	84	0	102	10.562		68.296	0.163	79.021
GRAND TOTAL	294	176	443	913	172.606		136.527	220.658	529.791

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: PEACH BOTTOM 2,3 (BWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			TOTAL PERSONS	STATION EMPLOYEES			TOTAL MAN-REMS UTILITY EMPLOYEES	TOTAL MAN-REMS CONTRACT & OTHERS			TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS					
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	2	163	472		0.371		16.765	33.010				
OPERATING PERSONNEL	71	26	129		39.540		2.337	19.304				
HEALTH PHYSICS PERSONNEL	66	25	87		37.021		1.934	29.884				
SUPERVISORY PERSONNEL	1	4	5		0.095		0.104	0.203				
ENGINEERING PERSONNEL	64	14	23		30.514		2.061	4.537				
TOTAL	204	232	716	1152	107.541		23.201	86.938			217.680	
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	9	611	1728		0.812		228.742	1510.163				
OPERATING PERSONNEL	45	24	159		3.063		1.437	41.723				
HEALTH PHYSICS PERSONNEL	48	8	122		9.188		0.423	114.560				
SUPERVISORY PERSONNEL	0	4	5		0.000		0.106	0.089				
ENGINEERING PERSONNEL	27	40	30		2.307		5.033	10.148				
TOTAL	129	687	2044	2860	15.370		235.741	1676.683			1927.794	
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	0	7	123		0.000		0.261	21.802				
OPERATING PERSONNEL	1	0	0		0.017		0.000	0.000				
HEALTH PHYSICS PERSONNEL	0	0	5		0.000		0.000	0.309				
SUPERVISORY PERSONNEL	0	0	0		0.000		0.000	0.000				
ENGINEERING PERSONNEL	0	1	2		0.000		0.048	0.585				
TOTAL	1	8	130	139	0.017		0.309	22.496			22.822	
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	0	8	329		0.000		0.162	124.872				
OPERATING PERSONNEL	1	0	25		0.056		0.000	6.245				
HEALTH PHYSICS PERSONNEL	1	0	5		0.018		0.000	0.119				
SUPERVISORY PERSONNEL	0	2	0		0.000		0.000	0.000				
ENGINEERING PERSONNEL	4	0	3		0.092		0.060	2.497				
TOTAL	6	10	362	378	0.166		0.222	133.733			134.121	
WASTE PROCESSING												
MAINTENANCE PERSONNEL	0	26	210		0.000		1.024	18.418				
OPERATING PERSONNEL	4	1	13		2.325		0.004	0.677				
HEALTH PHYSICS PERSONNEL	5	3	21		0.777		0.080	1.614				
SUPERVISORY PERSONNEL	0	0	0		0.000		0.000	0.000				
ENGINEERING PERSONNEL	1	4	4		0.010		0.110	0.323				
TOTAL	10	34	248	292	3.112		1.218	21.032			25.362	
REFUELING												
MAINTENANCE PERSONNEL	0	44	209		0.000		3.576	33.563				
OPERATING PERSONNEL	6	1	7		0.522		0.020	0.310				
HEALTH PHYSICS PERSONNEL	10	1	21		0.642		0.042	3.212				
SUPERVISORY PERSONNEL	0	1	0		0.000		0.031	0.000				
ENGINEERING PERSONNEL	0	3	2		0.000		0.057	0.131				
TOTAL	16	50	239	305	1.164		3.726	37.216			42.106	
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	11 (9)	859 (639)	3071 (1901)	3941 (2549)	1.183		250.530	1741.828			1993.541	
OPERATING PERSONNEL	128 (83)	52 (42)	333 (230)	45.523 (355)	45.523		3.798	68.259			117.580	
HEALTH PHYSICS PERSONNEL	130 (70)	37 (28)	261 (138)	428 (236)	47.646		2.479	149.698			199.823	
SUPERVISORY PERSONNEL	1 (1)	11 (8)	10 (8)	22 (17)	0.095		0.241	0.628			0.628	
ENGINEERING PERSONNEL	96 (67)	62 (45)	64 (42)	222 (154)	32.923		7.369	18.021			58.313	
GRAND TOTAL	366 (230)	1021 (762)	3739 (2319)	5126 (3311)	127.370		264.417	1978.098			2369.885	

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: PILGRIM (BMR)

1984

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	131	2570	11		2570		25,700		1,275		438,885	
OPERATING PERSONNEL	70	46	0		116		21,890		0,000		4,435	
HEALTH PHYSICS PERSONNEL	59	203	0		262		10,005		0,000		77,665	
SUPERVISORY PERSONNEL	75	87	59		132		8,135		3,045		13,230	
ENGINEERING PERSONNEL	42	243	24		266		2,815		1,190		20,790	
TOTAL	377	3149	94		3620		68,545		5,510		555,005	629,060
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	98	2030	7		2037		74,060		4,190		727,765	
OPERATING PERSONNEL	50	20	0		70		37,215		0,000		2,760	
HEALTH PHYSICS PERSONNEL	35	172	0		207		8,960		0,000		122,705	
SUPERVISORY PERSONNEL	42	52	20		72		10,810		2,010		12,060	
ENGINEERING PERSONNEL	27	163	15		192		3,825		3,445		46,005	
TOTAL	252	2437	42		2731		134,870		9,645		911,295	1055,810
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	35	531	0		566		1,465		0,000		67,280	
OPERATING PERSONNEL	33	11	0		44		2,850		0,000		2,140	
HEALTH PHYSICS PERSONNEL	4	81	0		85		0,420		0,000		9,520	
SUPERVISORY PERSONNEL	1	19	0		20		0,240		0,000		4,010	
ENGINEERING PERSONNEL	24	70	0		94		3,025		0,000		11,315	
TOTAL	97	712	0		809		8,000		0,000		94,265	102,265
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	62	1769	1		1828		11,650		0,155		1915,945	
OPERATING PERSONNEL	40	15	0		55		4,485		0,000		9,435	
HEALTH PHYSICS PERSONNEL	20	122	0		142		2,265		0,000		16,015	
SUPERVISORY PERSONNEL	27	57	12		96		5,190		1,330		40,035	
ENGINEERING PERSONNEL	26	152	9		187		2,450		2,410		51,470	
TOTAL	175	2115	22		2312		26,040		3,895		2032,900	2062,835
WASTE PROCESSING												
MAINTENANCE PERSONNEL	40	274	0		314		5,380		0,000		32,895	
OPERATING PERSONNEL	8	2	0		10		5,995		0,000		0,700	
HEALTH PHYSICS PERSONNEL	21	78	0		99		2,405		0,000		16,525	
SUPERVISORY PERSONNEL	5	6	0		11		0,675		0,000		3,055	
ENGINEERING PERSONNEL	0	0	0		0		0,000		0,000		0,000	
TOTAL	74	360	0		434		14,455		0,000		53,175	67,630
REFUELING												
MAINTENANCE PERSONNEL	44	187	0		231		27,900		0,000		8,965	
OPERATING PERSONNEL	28	0	0		28		2,245		0,000		0,000	
HEALTH PHYSICS PERSONNEL	0	47	0		47		0,000		0,000		4,495	
SUPERVISORY PERSONNEL	14	0	0		14		4,795		0,000		0,000	
ENGINEERING PERSONNEL	3	1	0		4		0,290		0,000		0,100	
TOTAL	89	235	0		324		35,230		0,000		13,560	48,790
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	410 (126)	7361 (2542)	19 (11)		7790 (2679)		146,155		5,620		3191,735	3343,510
OPERATING PERSONNEL	229 (66)	94 (48)	0 (0)		323 (114)		74,680		0,000		19,470	94,150
HEALTH PHYSICS PERSONNEL	139 (57)	703 (191)	0 (0)		842 (248)		24,055		0,000		246,925	270,980
SUPERVISORY PERSONNEL	164 (73)	221 (94)	91 (62)		476 (229)		29,845		6,385		72,390	108,620
ENGINEERING PERSONNEL	122 (45)	629 (253)	48 (24)		799 (322)		12,405		7,045		129,680	149,130
GRAND TOTAL	1064 (367)	9008 (3128)	158 (97)		10230 (3592)		287,140		19,050		3660,200	3966,390

*Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

†MRC mandated work, including torus mods., TMI mods., steam discharge volume, IGSCC ISI, pipe hangers and bolts, and equipment qualifications, contributed 501.5 man-rems

Appendix D (cont.)
NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION
 1984

Plant: Point Beach 1,2 (PMR)

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 mem)				TOTAL MAN-REMS			
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REM
Reactor Operations & Surv.								
Maintenance Personnel					0.000			
Operating Personnel					53.560			
Health Physics Personnel					55.430			
Supervisory Personnel					2.900			
Engineering Personnel					0.000			
TOTAL					111.890		1.250	113.140
Routine Maintenance								
Maintenance Personnel					44.070			
Operating Personnel					0.000			
Health Physics Personnel					0.000			
Supervisory Personnel					0.000			
Engineering Personnel					0.000			
TOTAL					44.070		0.000	44.070
In-Service Inspection								
Maintenance Personnel					6.080			
Operating Personnel					13.940			
Health Physics Personnel					0.000			
Supervisory Personnel					4.560			
Engineering Personnel					1.220			
TOTAL					25.800		42.330	68.130
Special Maintenance								
Maintenance Personnel					60.865			
Operating Personnel					0.000			
Health Physics Personnel					0.000			
Supervisory Personnel					0.000			
Engineering Personnel					0.000			
TOTAL					60.865		352.590	413.455
Waste Processing								
Maintenance Personnel					0.000			
Operating Personnel					17.830			
Health Physics Personnel					3.400			
Supervisory Personnel					0.000			
Engineering Personnel					0.000			
TOTAL					21.230		30.300	51.530
Refueling								
Maintenance Personnel					36.520			
Operating Personnel					6.880			
Health Physics Personnel					0.830			
Supervisory Personnel					0.320			
Engineering Personnel					1.490			
TOTAL					46.040		0.790	46.830
Total By Job Function								
Maintenance Personnel	116				147.535			
Operating Personnel	75				92.210			
Health Physics Personnel	29				59.660			
Supervisory Personnel	20				7.780			
Engineering Personnel	4				2.710			
GRAND TOTAL	244		540	784	309.895		427.260	737.155

* Includes 246 rems from the steam generator replacement in Unit 1.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

*+ PLANT: PRAIRIE ISLAND 1,2 (PWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			TOTAL MAN-REMS			
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.	14	1	0	4,478	0.482	0.166	
MAINTENANCE PERSONNEL	29	0	0	6,416	0.000	0.000	
OPERATING PERSONNEL	12	0	2	3,048	0.000	0.660	
HEALTH PHYSICS PERSONNEL	0	0	0	0.464	0.030	0.013	
SUPERVISORY PERSONNEL	2	0	1	0.591	0.114	0.402	
ENGINEERING PERSONNEL	57	1	3	14,997	0.626	1.241	16.864
TOTAL	120	2	6	30,592	1.152	2.462	
ROUTINE MAINTENANCE	12	6	0	4,221	2.665	0.143	
MAINTENANCE PERSONNEL	0	0	0	0.036	0.000	0.000	
OPERATING PERSONNEL	0	0	0	0.189	0.000	0.117	
HEALTH PHYSICS PERSONNEL	5	0	0	1,373	0.009	0.068	
SUPERVISORY PERSONNEL	3	0	3	1,153	0.064	0.576	
ENGINEERING PERSONNEL	20	6	3	6,972	2.738	0.904	10.614
TOTAL	40	12	3	13,765	5.476	1.761	
IN-SERVICE INSPECTION	16	9	51	5,211	2,191	28,879	
MAINTENANCE PERSONNEL	0	0	0	0.010	0.000	0.000	
OPERATING PERSONNEL	1	0	10	0.379	0.000	2.470	
HEALTH PHYSICS PERSONNEL	0	0	0	0.066	0.000	0.000	
SUPERVISORY PERSONNEL	4	0	8	3,094	0.086	4.460	
ENGINEERING PERSONNEL	21	9	69	8,760	2,277	35,809	46.846
TOTAL	41	19	88	14,445	2,363	43,749	
SPECIAL MAINTENANCE	19	59	11	7,129	24,774	5,372	
MAINTENANCE PERSONNEL	0	0	0	0.011	0.000	0.000	
OPERATING PERSONNEL	5	0	11	1,538	0.000	3.332	
HEALTH PHYSICS PERSONNEL	1	0	0	0.075	0.402	0.008	
SUPERVISORY PERSONNEL	3	2	3	1,137	1.405	0.980	
ENGINEERING PERSONNEL	28	61	25	10,217	26,254	9,692	46.163
TOTAL	56	122	40	18,092	28,133	14,672	
WASTE PROCESSING	6	0	0	1,970	0.518	0.159	
MAINTENANCE PERSONNEL	0	0	0	0.134	0.000	0.000	
OPERATING PERSONNEL	4	0	0	1,261	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0	0.023	0.000	0.000	
ENGINEERING PERSONNEL	10	0	0	3,388	0.518	0.159	4.065
TOTAL	20	0	0	6,649	1.036	0.318	
REFUELING	24	14	0	5,656	4,385	0.100	
MAINTENANCE PERSONNEL	0	0	0	0.304	0.000	0.000	
OPERATING PERSONNEL	0	0	0	0.055	0.000	0.070	
HEALTH PHYSICS PERSONNEL	0	0	0	0.027	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0	0.316	0.000	0.014	
ENGINEERING PERSONNEL	24	14	0	6,358	4.481	0.184	11.023
TOTAL	48	28	0	12,714	8.866	0.368	
TOTAL BY JOB FUNCTION	91	89	62	28,665	35,015	34,819	98.499
MAINTENANCE PERSONNEL	29	0	29	6,911	0.000	0.000	6.911
OPERATING PERSONNEL	22	0	45	6,470	0.000	6.649	13.119
HEALTH PHYSICS PERSONNEL	6	0	6	2,332	0.114	0.089	2.535
SUPERVISORY PERSONNEL	12	2	15	6,314	1.765	6.432	14.511
ENGINEERING PERSONNEL	160	91	100	50,692	36,894	47,989	135.575
GRAND TOTAL	300	282	242	88,864	102,624	102,624	397.199

*Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: QUAD CITIES 1,2 (BWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (<100 M-REM)			TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	TOTAL MAN-REMS	CONTRACT & OTHERS	TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS						
REACTOR OPERATIONS & SURV.	21	1	25	108	77	40	225	92,660	1,559	23,342	117,561	
MAINTENANCE PERSONNEL	42	0	1									17,544
OPERATING PERSONNEL	9	0	7						0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	27	0	0						0.000	0.000	0.000	3,603
SUPERVISORY PERSONNEL	9	76	0						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	108	77	40						1,522	2,192	4,665	2,192
TOTAL	108	77	40	225	225	40	225	92,660	1,559	23,342	117,561	
ROUTINE MAINTENANCE	94	27	223									
MAINTENANCE PERSONNEL	49	0	2									155,127
OPERATING PERSONNEL	16	0	2						0.000	0.000	0.000	0.132
HEALTH PHYSICS PERSONNEL	69	0	0						0.000	0.000	0.000	0.832
SUPERVISORY PERSONNEL	23	58	15						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	251	85	247	583	233,967	160,556	817,3	402,696	1,162	4,665	4,665	4,665
TOTAL	251	85	247	583	233,967	160,556	817,3	402,696	1,162	4,665	4,665	4,665
IN-SERVICE INSPECTION	5	1	533									
MAINTENANCE PERSONNEL	4	0	2						0.260	0.000	0.000	0.260
OPERATING PERSONNEL	6	0	0						0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	0	0						0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	20	75	177						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	38	76	712	826	24,722	1,757	1,757	452,862	1,497	54,235	54,235	54,235
TOTAL	38	76	712	826	24,722	1,757	1,757	452,862	1,497	54,235	54,235	54,235
SPECIAL MAINTENANCE	3	42	540									
MAINTENANCE PERSONNEL	4	0	38						11,289	0.000	0.000	11,289
OPERATING PERSONNEL	8	0	55						0.000	0.000	0.000	0.664
HEALTH PHYSICS PERSONNEL	4	0	0						0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	22	3	66						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	41	45	699	785	26,386	11,348	11,348	460,876	0.059	20,298	20,298	20,298
TOTAL	41	45	699	785	26,386	11,348	11,348	460,876	0.059	20,298	20,298	20,298
WASIE PROCESSING	0	0	3									
MAINTENANCE PERSONNEL	44	0	1						0.000	0.000	0.000	1,847
OPERATING PERSONNEL	6	0	0						0.000	0.000	0.000	0.014
HEALTH PHYSICS PERSONNEL	17	0	0						0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	67	0	4	71	53,567	1,861	1,861	55,428	0.000	0.000	0.000	0.000
TOTAL	67	0	4	71	53,567	1,861	1,861	55,428	0.000	0.000	0.000	0.000
REFUELING	9	0	2									
MAINTENANCE PERSONNEL	10	0	0						0.000	0.000	0.000	0.923
OPERATING PERSONNEL	4	0	0						0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	11	0	0						0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	1	0	0						0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	35	0	2	37	31,792	0.000	0.000	32,715	0.000	0.000	0.000	0.000
TOTAL	35	0	2	37	31,792	0.000	0.000	32,715	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION	132	71	1326	1529	183,488	18,597	18,597	1125,462	0.000	923,377	923,377	1125,462
MAINTENANCE PERSONNEL	153	0	49	202	134,922	0.000	0.000	135,762	0.000	0.840	0.840	135,762
OPERATING PERSONNEL	49	0	64	113	51,265	0.000	0.000	30,800	0.000	30,800	30,800	82,065
HEALTH PHYSICS PERSONNEL	131	0	0	131	63,694	0.000	0.000	63,694	0.000	0.000	0.000	63,694
SUPERVISORY PERSONNEL	75	212	265	552	29,725	4,240	4,240	81,190	0.000	81,190	81,190	115,155
ENGINEERING PERSONNEL	540	283	1704	2527	463,094	22,837	22,837	1522,138	0.000	1036,207	1036,207	1522,138
GRAND TOTAL	540	283	1704	2527	463,094	22,837	22,837	1522,138	0.000	1036,207	1036,207	1522,138

^aNRC mandated special maintenance contributed 461 man-rems.

PLANT: * RANCHO SECO (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)				NUMBER OF PERSONNEL (>100 M-REM)				TOTAL MAN-REMS					
	STATION EMPLOYEES		UTILITY EMPLOYEES		STATION EMPLOYEES		UTILITY EMPLOYEES		STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.	66	140	0	140	10,240	0.000	0.000	0.000	0.000	2,910	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	105	144	0	144	21,855	0.000	0.000	0.000	0.000	0.260	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	34	49	0	49	4,745	0.000	0.000	0.000	0.000	17,365	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	30	43	0	43	0,260	0.000	0.000	0.000	0.000	1,190	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	106	188	4	188	4,555	0.060	0.000	0.000	0.000	2,675	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	341	564	9	564	41,655	0.065	0.000	0.000	0.000	24,400	0.000	0.000	0.000	0.000
TOTAL				914										66,120
ROUTINE MAINTENANCE	35	63	0	63	13,010	0.000	0.000	0.000	0.000	8,680	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	1	1	0	1	0,720	0.000	0.000	0.000	0.000	0,095	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	1	1	0	1	0,700	0.000	0.000	0.000	0.000	0,740	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	1	1	0	1	0,145	0.000	0.000	0.000	0.000	0,110	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	9	10	0	10	1,540	0.000	0.000	0.000	0.000	0,530	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	47	77	0	77	16,115	0.000	0.000	0.000	0.000	10,155	0.000	0.000	0.000	0.000
TOTAL				124										26,270
IN-SERVICE INSPECTION	11	47	0	47	6,340	0.000	0.000	0.000	0.000	22,090	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	1	0	1	0,060	0.000	0.000	0.000	0.000	0,410	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0,275	0.000	0.000	0.000	0.000	0,310	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	4	0	4	0,000	0.000	0.000	0.000	0.000	0,120	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	11	17	0	17	4,965	0.000	0.000	0.000	0.000	4,370	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	22	69	0	69	11,640	0.000	0.000	0.000	0.000	27,300	0.000	0.000	0.000	0.000
TOTAL				91										38,940
SPECIAL MAINTENANCE	23	54	0	54	9,640	0.000	0.000	0.000	0.000	19,995	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	2	0	0	0	1,135	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	1	0	1	0,595	0.000	0.000	0.000	0.000	2,470	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	1	6	0	6	0,035	0.000	0.000	0.000	0.000	4,100	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	6	7	0	7	1,345	0.000	0.000	0.000	0.000	1,265	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	32	68	0	68	12,750	0.000	0.000	0.000	0.000	27,830	0.000	0.000	0.000	0.000
TOTAL				100										40,580
WASTE PROCESSING	14	34	0	34	5,175	0.000	0.000	0.000	0.000	10,070	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	0	0	0	0,345	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	12	8	0	8	8,865	0.000	0.000	0.000	0.000	4,550	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	1	0	0	0	0,070	0.000	0.000	0.000	0.000	0,105	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	1	0	0	0	0,160	0.000	0.000	0.000	0.000	0,240	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	28	42	0	42	14,615	0.000	0.000	0.000	0.000	14,965	0.000	0.000	0.000	0.000
TOTAL				70										29,580
REFUELING	1	0	0	0	0,065	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	1	0	0	0	0,410	0.000	0.000	0.000	0.000	0,010	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	2	0	0	0	0,095	0.000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	4	0	0	0	0,570	0.000	0.000	0.000	0.000	0,015	0.000	0.000	0.000	0.000
TOTAL				4										0,585
TOTAL BY JOB FUNCTION	150	338	0	338	44,470	0.000	0.000	0.000	0.000	63,745	0.000	0.000	0.000	108,215
MAINTENANCE PERSONNEL	109	146	0	146	24,525	0.000	0.000	0.000	0.000	0,775	0.000	0.000	0.000	25,300
OPERATING PERSONNEL	47	59	0	59	15,180	0.000	0.000	0.000	0.000	25,435	0.000	0.000	0.000	40,615
HEALTH PHYSICS PERSONNEL	33	55	5	55	0,510	0.000	0.000	0.000	0.000	5,630	0.000	0.000	0.000	6,145
SUPERVISORY PERSONNEL	135	222	4	222	12,660	0.060	0.000	0.000	0.000	9,080	0.000	0.000	0.000	21,800
ENGINEERING PERSONNEL	474	820	9	820	97,345	0.065	0.000	0.000	0.000	104,665	0.000	0.000	0.000	202,075
GRAND TOTAL				1303										

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: * ROBINSON 2 (PMR)

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS	CONTRACT & OTHERS	MAN-REMS
REACTOR OPERATIONS & SURV.										
MAINTENANCE PERSONNEL	16	4	70		6,373	1,340	36,801			
OPERATING PERSONNEL	19	1	0		9,582	0,245	0,000			
HEALTH PHYSICS PERSONNEL	20	0	59		14,678	0,000	66,125			
SUPERVISORY PERSONNEL	1	0	0		0,995	0,000	0,000			
ENGINEERING PERSONNEL	25	15	158		7,515	6,990	81,387			
TOTAL	81	20	287	388	39,143	8,575	184,313			232,031
ROUTINE MAINTENANCE										
MAINTENANCE PERSONNEL	22	21	17		17,056	11,680	28,567			
OPERATING PERSONNEL	2	0	0		0,670	0,000	0,000			
HEALTH PHYSICS PERSONNEL	3	0	6		2,565	0,000	4,640			
SUPERVISORY PERSONNEL	0	0	0		0,000	0,000	0,000			
ENGINEERING PERSONNEL	5	1	14		1,628	0,200	7,710			
TOTAL	32	22	37	91	21,919	11,880	40,917			74,716
IN-SERVICE INSPECTION										
MAINTENANCE PERSONNEL	4	0	67		1,150	0,000	75,641			
OPERATING PERSONNEL	0	0	0		0,025	0,000	0,000			
HEALTH PHYSICS PERSONNEL	1	0	14		1,025	0,000	15,850			
SUPERVISORY PERSONNEL	0	0	0		0,000	0,000	0,000			
ENGINEERING PERSONNEL	18	0	38		5,696	0,025	37,840			
TOTAL	23	0	119	142	7,896	0,025	129,331			137,252
SPECIAL MAINTENANCE										
MAINTENANCE PERSONNEL	129	38	1463		96,285	39,630	1870,446			
OPERATING PERSONNEL	15	0	0		7,515	0,000	0,000			
HEALTH PHYSICS PERSONNEL	45	1	148		34,246	0,250	172,920			
SUPERVISORY PERSONNEL	0	0	0		0,000	0,000	0,000			
ENGINEERING PERSONNEL	51	11	309		15,782	4,860	554,678			
TOTAL	240	50	1920	2210	153,828	44,740	2598,044			2796,612
WASTE PROCESSING										
MAINTENANCE PERSONNEL	6	6	2		5,785	2,575	0,575			
OPERATING PERSONNEL	27	0	0		14,373	0,000	0,000			
HEALTH PHYSICS PERSONNEL	4	0	2		2,775	0,000	1,185			
SUPERVISORY PERSONNEL	0	0	0		0,000	0,000	0,000			
ENGINEERING PERSONNEL	0	0	0		0,025	0,000	0,000			
TOTAL	37	6	4	47	22,958	2,575	1,760			27,293
REFUELING										
MAINTENANCE PERSONNEL	41	29	52		39,500	30,675	45,526			
OPERATING PERSONNEL	7	0	0		3,600	0,080	0,000			
HEALTH PHYSICS PERSONNEL	2	0	5		1,835	0,000	3,775			
SUPERVISORY PERSONNEL	0	0	0		0,000	0,000	0,000			
ENGINEERING PERSONNEL	9	2	21		2,600	0,450	12,225			
TOTAL	59	31	78	168	47,535	31,205	61,526			140,266
TOTAL BY JOB FUNCTION										
MAINTENANCE PERSONNEL	218	98	1671	1987	166,149	85,900	2057,556			2309,605
OPERATING PERSONNEL	70	1	0	71	35,765	0,325	0,000			36,090
HEALTH PHYSICS PERSONNEL	75	1	234	310	57,124	0,250	264,495			321,869
SUPERVISORY PERSONNEL	1	0	0	1	0,995	0,000	0,000			0,995
ENGINEERING PERSONNEL	108	29	540	677	33,246	12,525	693,840			739,611
GRAND TOTAL	472	129	2445	3046	293,279	99,000	3015,891			3408,170

* Workers may be counted in more than one category.

Appendix D (cont.)

*- PLANT: SALEM 0 (PWR) a NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES	TOTAL MAN-REMS		TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES			UTILITY EMPLOYEES	CONTRACT & OTHERS	
REACTOR OPERATIONS & SURV.	0	0	0	0	0	0.000	0.000	0.000	0.000
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
TOTAL	0	0	0	0	0	0.000	0.000	0.000	0.000
ROUTINE MAINTENANCE	1	0	6	0	7	1.950	0.025	2.604	2.604
MAINTENANCE PERSONNEL	2	0	0	0	2	1.965	0.050	0.010	0.010
OPERATING PERSONNEL	6	0	2	0	8	2.870	0.000	1.525	1.525
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.010	0.000	0.000
SUPERVISORY PERSONNEL	1	0	0	0	1	0.215	0.065	0.000	0.000
ENGINEERING PERSONNEL	10	0	8	0	18	7.000	0.150	4.139	4.139
TOTAL	10	0	8	0	18	7.000	0.150	4.139	4.139
IN-SERVICE INSPECTION	0	0	2	0	2	0.000	0.000	0.510	0.510
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.000	0.000	0.045	0.045
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
TOTAL	0	0	2	0	2	0.000	0.000	0.555	0.555
SPECIAL MAINTENANCE	2	0	0	0	2	1.130	0.000	0.505	0.505
MAINTENANCE PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.150	0.040	0.150	0.150
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.010	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.010	0.000	0.000
ENGINEERING PERSONNEL	2	0	0	0	2	1.280	0.060	0.655	0.655
TOTAL	2	0	0	0	2	1.280	0.060	0.655	0.655
WASTE PROCESSING	12	0	5	0	17	4.245	0.055	2.009	2.009
MAINTENANCE PERSONNEL	1	0	0	0	1	0.450	0.020	0.010	0.010
OPERATING PERSONNEL	5	0	50	0	55	1.605	0.000	24.326	24.326
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.010	0.010
SUPERVISORY PERSONNEL	0	1	0	0	1	0.010	0.300	0.000	0.000
ENGINEERING PERSONNEL	18	1	55	0	74	6.310	0.375	26.355	26.355
TOTAL	18	1	55	0	74	6.310	0.375	26.355	26.355
REFUELING	0	0	0	0	0	0.115	0.000	0.125	0.125
MAINTENANCE PERSONNEL	0	0	0	0	0	0.010	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0	0.010	0.000	0.010	0.010
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0	0.135	0.000	0.135	0.135
TOTAL	0	0	0	0	0	0.135	0.000	0.135	0.135
TOTAL BY JOB FUNCTION	15	0	13	0	28	7.440	0.080	5.753	5.753
MAINTENANCE PERSONNEL	3	0	0	0	3	2.425	0.070	0.020	0.020
OPERATING PERSONNEL	11	0	52	0	63	4.635	0.040	26.056	26.056
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0.000	0.020	0.010	0.010
SUPERVISORY PERSONNEL	1	1	0	0	2	0.225	0.375	0.000	0.000
ENGINEERING PERSONNEL	30	1	65	0	96	14.725	0.585	31.839	31.839
GRAND TOTAL	30	1	65	0	96	14.725	0.585	31.839	31.839

* Workers may be counted in more than one category.

a Salem 0 is for work common to both Salem 1 and 2.

Appendix D (cont.)

PLANT: SALEM 1 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

* 1 SALEM 1 (PWR) 1984

NUMBER OF PERSONNEL (>100 M-REM)

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.	2	0	0	0	1,712	0.375	0.020	0.375
MAINTENANCE PERSONNEL	0	0	0	0	1,820	0.000	0.041	0.000
OPERATING PERSONNEL	0	0	0	0	1,824	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	5	5	1,984	0.000	1.880	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.090	0.000	0.115	0.080
TOTAL	2	0	5	7	3,906	0.176	2.439	6.521
ROUTINE MAINTENANCE	7	0	4	4	4,370	0.000	0.000	4.874
MAINTENANCE PERSONNEL	0	0	0	0	0.180	0.000	0.000	0.000
OPERATING PERSONNEL	0	0	2	2	0.315	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.130
SUPERVISORY PERSONNEL	0	0	0	0	0.000	0.000	0.138	0.000
ENGINEERING PERSONNEL	0	0	0	0	4.865	0.138	6.884	0.000
TOTAL	7	0	6	13	4,865	0.138	6.884	11.887
IN-SERVICE INSPECTION	0	0	8	8	0.253	0.035	0.035	2.295
MAINTENANCE PERSONNEL	0	1	0	0	0.078	0.290	0.000	0.000
OPERATING PERSONNEL	0	0	1	1	0.023	0.000	0.000	0.265
HEALTH PHYSICS PERSONNEL	0	1	0	0	0.000	0.165	0.045	0.000
SUPERVISORY PERSONNEL	0	1	0	0	0.000	0.280	0.020	0.000
ENGINEERING PERSONNEL	0	3	9	12	0.354	0.770	2.625	3.749
TOTAL	0	3	9	12	0.354	0.770	2.625	3.749
SPECIAL MAINTENANCE	142	10	174	174	59,500	4.795	69.336	151.633
MAINTENANCE PERSONNEL	2	1	0	0	0.635	0.520	0.000	0.000
OPERATING PERSONNEL	0	0	44	44	0.410	0.010	14.175	0.000
HEALTH PHYSICS PERSONNEL	0	0	4	4	0.000	0.030	1.205	0.000
SUPERVISORY PERSONNEL	0	5	0	0	0.075	0.920	0.000	0.000
ENGINEERING PERSONNEL	0	16	222	222	60.642	6.275	84.716	0.000
TOTAL	144	16	222	382	60.642	6.275	84.716	151.633
WASTE PROCESSING	4	0	7	7	1.025	0.000	2.860	0.000
MAINTENANCE PERSONNEL	0	0	0	0	0.000	0.015	0.000	0.000
OPERATING PERSONNEL	0	0	0	0	0.040	0.000	0.510	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.055	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0.012	0.015	0.000	0.000
ENGINEERING PERSONNEL	0	0	7	7	1.077	0.030	3.425	0.000
TOTAL	4	0	7	11	1.077	0.030	3.425	4.532
REFUELING	409	11	749	749	120,284	3.430	300.399	585.505
MAINTENANCE PERSONNEL	62	2	0	0	22,521	0.844	0.035	0.000
OPERATING PERSONNEL	11	0	317	317	5,087	0.130	115.380	0.000
HEALTH PHYSICS PERSONNEL	0	1	19	19	0.000	0.275	8.861	0.000
SUPERVISORY PERSONNEL	0	18	4	4	0.100	7.066	1.093	0.000
ENGINEERING PERSONNEL	0	32	1089	1089	147.992	11.745	425.768	0.000
TOTAL	482	32	1089	1603	147.992	11.745	425.768	585.505
TOTAL BY JOB FUNCTION	564	21	942	1527	187,144	8.280	380.139	575.563
MAINTENANCE PERSONNEL	64	4	0	68	25,234	1.710	0.035	26.979
OPERATING PERSONNEL	11	0	369	380	6,181	0.140	134.194	140.515
HEALTH PHYSICS PERSONNEL	0	2	23	25	0.000	0.470	10.296	10.766
SUPERVISORY PERSONNEL	0	24	4	28	0.277	8.534	1.193	10.004
ENGINEERING PERSONNEL	639	51	1338	2028	218.836	19.134	525.857	763.827
GRAND TOTAL	639	51	1338	2028	218.836	19.134	525.857	763.827

* Workers may be counted in more than one category.
 a Excludes work common to both units, Salem 1 and 2.
 * Dose incurred during various maintenance and special maintenance activities while Salem 1 was refueling was attributed to the refueling work function.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: SALEM 2

(PMR)

1984

NUMBER OF PERSONNEL (>100 M-REM)

1984

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	MAN-REMS	MAN-REMS
REACTOR OPERATIONS & SURV.																
MAINTENANCE PERSONNEL	2	0	0	0	0	0	2	0	2	0	0	0	0	0	0	0
OPERATING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	2	0	0	0	0	0	2	0	2	0	0	0	0	0	0	0
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL	4	0	0	0	0	0	4	0	4	0	0	0	0	0	0	7.216
ROUTINE MAINTENANCE																
MAINTENANCE PERSONNEL	29	1	1	0	60	0	91	1	11,898	0	0	0	0	23,648	0	0
OPERATING PERSONNEL	1	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	5	4	0	0	4	0	9	0	3,120	0	0	0	0	3,240	0	0
SUPERVISORY PERSONNEL	0	0	0	0	5	0	5	0	0	0	0	0	0	2,102	0	0
ENGINEERING PERSONNEL	0	1	1	0	0	0	2	0	0	0	0	0	0	0	0	0
TOTAL	35	2	2	0	69	0	79	1	15,753	0	0	0	0	29,090	0	0
IN-SERVICE INSPECTION																
MAINTENANCE PERSONNEL	0	0	0	0	11	0	11	0	0	0	0	0	0	2,799	0	0
OPERATING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SUPERVISORY PERSONNEL	0	1	0	0	1	0	1	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL	0	0	0	0	12	0	12	0	0	0	0	0	0	3,188	0	0
SPECIAL MAINTENANCE																
MAINTENANCE PERSONNEL	11	0	0	0	124	0	135	0	5,964	0	0	0	0	44,272	0	0
OPERATING PERSONNEL	1	0	2	0	0	0	2	0	1,917	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	14	0	0	0	21	0	21	0	5,035	0	0	0	0	7,602	0	0
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	3	0	0	0	3	0	3	0	1,010	0	0	0	0	1,026	0	0
TOTAL	29	0	2	0	148	0	150	0	13,926	0	0	0	0	52,990	0	0
WASTE PROCESSING																
MAINTENANCE PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
OPERATING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	0	0	0	0	2	0	2	0	0	0	0	0	0	1,880	0	0
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL	0	0	0	0	2	0	2	0	0	0	0	0	0	2,005	0	0
REFUELING																
MAINTENANCE PERSONNEL	9	0	0	0	18	0	27	0	4,555	0	0	0	0	6,939	0	0
OPERATING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	1,085	0	0
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
ENGINEERING PERSONNEL	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL	9	0	0	0	18	0	27	0	5,304	0	0	0	0	8,319	0	0
TOTAL BY JOB FUNCTION																
MAINTENANCE PERSONNEL	51	1	1	0	213	0	265	0	24,883	0	0	0	0	78,297	0	0
OPERATING PERSONNEL	2	0	2	0	0	0	4	0	4,095	0	0	0	0	0	0	0
HEALTH PHYSICS PERSONNEL	21	0	0	0	27	0	48	0	10,449	0	0	0	0	14,934	0	0
SUPERVISORY PERSONNEL	0	0	0	0	6	0	6	0	0	0	0	0	0	3,752	0	0
ENGINEERING PERSONNEL	3	1	1	0	3	0	7	0	1,160	0	0	0	0	0	0	0
GRAND TOTAL	77	4	4	0	249	0	330	0	40,602	0	0	0	0	97,318	0	0

*Workers may be counted in more than one category.

^aExcludes work common to both units, Salem 1 and 2.

Appendix D (cont.)

PLANT: * SAN ONDRE 1 (PMR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	STATION EMPLOYEES	UTILITY EMPLOYEES		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	2	1	43			0.148	0.012	2.551	
OPERATING PERSONNEL	22	1	0			13.283	0.153	0.000	
HEALTH PHYSICS PERSONNEL	20	1	38			12.546	0.553	16.718	
SUPERVISORY PERSONNEL	0	0	4			0.000	0.000	0.352	
ENGINEERING PERSONNEL	12	9	117			1.644	0.492	8.451	
TOTAL	56	12	202	270	270	27.621	1.210	28.072	56.903
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	27	4	466			13.787	0.704	65.853	
OPERATING PERSONNEL	4	0	1			0.118	0.000	0.101	
HEALTH PHYSICS PERSONNEL	21	2	116			2.746	1.233	29.135	
SUPERVISORY PERSONNEL	0	0	10			0.000	0.000	1.138	
ENGINEERING PERSONNEL	20	11	216			7.386	2.679	30.474	
TOTAL	72	17	809	898	898	24.037	4.616	126.701	155.354
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	7	0	11			0.268	0.000	0.050	
OPERATING PERSONNEL	0	0	0			0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	1			0.000	0.000	0.060	
SUPERVISORY PERSONNEL	0	0	1			0.000	0.000	0.000	
ENGINEERING PERSONNEL	2	2	51			0.008	0.011	0.228	
TOTAL	9	2	64	75	75	0.276	0.011	0.338	0.625
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	21	3	482			7.434	0.392	185.745	
OPERATING PERSONNEL	0	0	0			0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	3	0	37			0.025	0.000	2.381	
SUPERVISORY PERSONNEL	0	0	7			0.000	0.000	1.373	
ENGINEERING PERSONNEL	12	5	117			0.602	0.829	17.027	
TOTAL	36	8	643	687	687	8.061	1.221	206.526	215.808
WASTE PROCESSING									
MAINTENANCE PERSONNEL	0	0	8			0.000	0.000	0.464	
OPERATING PERSONNEL	0	0	0			0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	1	47			0.000	0.149	3.971	
SUPERVISORY PERSONNEL	0	0	0			0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	1	0			0.000	0.000	0.000	
TOTAL	0	2	55	57	57	0.000	0.109	4.435	4.693
REFUELING									
MAINTENANCE PERSONNEL	0	0	1			0.000	0.000	0.012	
OPERATING PERSONNEL	0	0	0			0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0			0.000	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0			0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	0	3			0.000	0.000	0.000	
TOTAL	0	0	4	4	4	0.000	0.000	0.000	0.017
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	57 (28)	8 (4)	1011 (545)	1076 (577)	1076 (577)	21.637	1.108	254.675	277.420
OPERATING PERSONNEL	26 (22)	1 (1)	1 (1)	28 (24)	28 (24)	13.401	0.153	0.101	13.655
HEALTH PHYSICS PERSONNEL	44 (22)	4 (1)	239 (118)	287 (141)	287 (141)	15.317	1.935	52.265	69.517
SUPERVISORY PERSONNEL	0 (0)	0 (0)	22 (11)	22 (11)	22 (11)	0.000	0.000	2.863	2.863
ENGINEERING PERSONNEL	46 (26)	28 (13)	504 (236)	578 (375)	578 (375)	9.640	4.120	56.185	69.945
GRAND TOTAL	173 (98)	41 (20)	1777 (911)	1991 (1029)	1991 (1029)	59.995	7.316	366.089	433.400

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: SAN ONOFRE 2 (PWR)

NUMBER OF PERSONNEL (>100 M-REM)
1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		CONTRACT & OTHERS		TOTAL PERSONS	STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSONS		EMPLOYEES	EMPLOYEES	CONTRACT & OTHERS	MAN-REMS	CONTRACT & OTHERS	MAN-REMS
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	11	5	8			0.164	0.069	0.038			
OPERATING PERSONNEL	34	0	1			4.819	0.000	0.081			
HEALTH PHYSICS PERSONNEL	33	5	65			8.362	0.912	15.761			
SUPERVISORY PERSONNEL	0	0	1			0.000	0.000	0.009			
ENGINEERING PERSONNEL	14	5	52			0.936	0.072	1.374			
TOTAL	92	15	127	234		14.281	1.053	17.263			32.597
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	58	29	319			20.056	7.578	52.605			
OPERATING PERSONNEL	33	0	1			2.350	0.000	0.055			
HEALTH PHYSICS PERSONNEL	32	5	171			6.624	0.623	50.180			
SUPERVISORY PERSONNEL	0	1	1			0.000	0.307	0.047			
ENGINEERING PERSONNEL	24	13	147			3.795	2.051	17.181			
TOTAL	147	48	639	834		32.825	10.559	120.068			163.452
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	18	5	40			0.101	0.084	1.224			
OPERATING PERSONNEL	1	0	0			0.005	0.000	0.000			
HEALTH PHYSICS PERSONNEL	2	0	5			0.024	0.000	0.160			
SUPERVISORY PERSONNEL	0	0	2			0.000	0.000	0.005			
ENGINEERING PERSONNEL	15	10	63			1.119	0.255	1.713			
TOTAL	36	15	110	161		1.249	0.339	3.102			4.690
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	41	14	369			2.026	0.496	151.338			
OPERATING PERSONNEL	1	0	0			0.000	0.000	0.000			
HEALTH PHYSICS PERSONNEL	3	2	84			0.276	0.045	7.714			
SUPERVISORY PERSONNEL	0	0	3			0.000	0.000	0.353			
ENGINEERING PERSONNEL	11	9	140			0.364	0.240	27.926			
TOTAL	55	25	596	676		2.666	0.781	187.331			190.778
WASTE PROCESSING											
MAINTENANCE PERSONNEL	1	1	6			0.016	0.003	0.129			
OPERATING PERSONNEL	1	0	0			0.004	0.000	0.000			
HEALTH PHYSICS PERSONNEL	0	0	37			0.000	0.000	2.439			
SUPERVISORY PERSONNEL	0	0	0			0.000	0.000	0.000			
ENGINEERING PERSONNEL	0	0	0			0.000	0.000	0.000			
TOTAL	2	1	43	46		0.020	0.003	2.568			2.591
REFUELING											
MAINTENANCE PERSONNEL	0	2	63			0.000	0.335	6.121			
OPERATING PERSONNEL	0	0	0			0.000	0.000	0.000			
HEALTH PHYSICS PERSONNEL	1	0	5			0.043	0.000	0.055			
SUPERVISORY PERSONNEL	0	1	1			0.000	0.019	0.089			
ENGINEERING PERSONNEL	5	6	63			0.152	0.046	4.904			
TOTAL	6	9	132	147		0.195	0.400	11.169			11.764
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	129 (58)	56 (29)	805 (436)	990 (523)		22.363	8.565	211.455			242.383
OPERATING PERSONNEL	69 (34)	0 (0)	2 (1)	71 (35)		7.178	0.000	0.136			7.314
HEALTH PHYSICS PERSONNEL	71 (34)	12 (6)	367 (188)	450 (228)		15.329	1.580	76.309			93.218
SUPERVISORY PERSONNEL	0 (0)	2 (1)	8 (3)	10 (4)		0.000	0.326	0.503			0.829
ENGINEERING PERSONNEL	69 (27)	43 (13)	465 (186)	577 (226)		6.366	2.664	53.098			62.128
GRAND TOTAL	338 (153)	113 (49)	1647 (814)	2098 (1016)		51.236	13.135	341.501			405.812

* Workers may be counted in more than one category. Numbers in parentheses are total numbers of individuals.

Appendix D (cont.)

PLANT: *SEQUOYAH 1,2 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)			NUMBER OF PERSONNEL (>100 M-REM)		
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	503	562	9	1074	25,907	21,450	0.548	47,899	25,907	21,450	0.548	47,899
OPERATING PERSONNEL	95	0	0	95	16,703	0.000	0.000	16,703	16,703	0.000	0.000	16,703
HEALTH PHYSICS PERSONNEL	60	2	58	120	19,472	0.000	21,220	38,944	19,472	0.000	21,220	40,164
SUPERVISORY PERSONNEL	74	22	2	98	10,738	2,388	0.226	13,354	10,738	2,388	0.226	13,354
ENGINEERING PERSONNEL	62	106	27	195	12,357	15,559	1,218	29,134	12,357	15,559	1,218	29,134
TOTAL	794	692	96	1582	85,177	39,397	23,212	147,786	85,177	39,397	23,212	147,786
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	540	587	3	1130	120,746	72,022	0.030	192,805	120,746	72,022	0.030	192,805
OPERATING PERSONNEL	82	0	0	82	1,737	0.000	0.000	1,737	1,737	0.000	0.000	1,737
HEALTH PHYSICS PERSONNEL	59	1	51	111	4,741	0.000	1,288	6,029	4,741	0.000	1,288	6,029
SUPERVISORY PERSONNEL	63	23	2	88	6,177	2,743	0.103	9,023	6,177	2,743	0.103	9,023
ENGINEERING PERSONNEL	62	95	39	136	10,448	8,477	30.117	49,032	10,448	8,477	30.117	49,032
TOTAL	806	706	95	1607	143,849	83,242	31,538	258,629	143,849	83,242	31,538	258,629
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	226	236	9	471	34,218	37,399	7.001	78,617	34,218	37,399	7.001	78,617
OPERATING PERSONNEL	26	0	0	26	0.400	0.000	0.000	0.400	0.400	0.000	0.000	0.400
HEALTH PHYSICS PERSONNEL	30	0	35	65	2,024	0.000	6,798	8,822	2,024	0.000	6,798	8,822
SUPERVISORY PERSONNEL	19	6	2	27	0.938	2.191	0.053	3.122	0.938	2.191	0.053	3.122
ENGINEERING PERSONNEL	55	54	47	156	5,960	13,607	31.173	25,537	5,960	13,607	31.173	25,537
TOTAL	356	296	93	745	43,540	53,197	45,025	141,762	43,540	53,197	45,025	141,762
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	415	622	6	1043	37,351	229,127	1,955	308,433	37,351	229,127	1,955	308,433
OPERATING PERSONNEL	75	0	0	75	0.990	0.000	0.000	0.990	0.990	0.000	0.000	0.990
HEALTH PHYSICS PERSONNEL	57	0	37	94	5,936	0.618	0.618	6,554	5,936	0.618	0.618	6,554
SUPERVISORY PERSONNEL	60	18	1	79	8,158	2,120	0.032	10,310	8,158	2,120	0.032	10,310
ENGINEERING PERSONNEL	58	83	11	152	12,280	10,183	1,670	24,133	12,280	10,183	1,670	24,133
TOTAL	665	723	55	1443	64,715	241,430	4,275	310,420	64,715	241,430	4,275	310,420
WASTE PROCESSING												
MAINTENANCE PERSONNEL	368	271	3	642	19,822	8,197	0.840	28,859	19,822	8,197	0.840	28,859
OPERATING PERSONNEL	91	0	0	91	11,831	0.000	0.000	11,831	11,831	0.000	0.000	11,831
HEALTH PHYSICS PERSONNEL	60	0	47	107	5,849	0.000	0.721	6,570	5,849	0.000	0.721	6,570
SUPERVISORY PERSONNEL	40	9	1	50	0.992	0.105	0.007	1.099	0.992	0.105	0.007	1.099
ENGINEERING PERSONNEL	45	40	2	87	0.193	1,024	0.005	1,217	0.193	1,024	0.005	1,217
TOTAL	604	320	53	977	38,687	9,326	1,573	49,586	38,687	9,326	1,573	49,586
REFUELING												
MAINTENANCE PERSONNEL	352	347	4	703	69,132	64,188	0.025	133,345	69,132	64,188	0.025	133,345
OPERATING PERSONNEL	66	0	0	66	10,394	0.000	0.000	10,394	10,394	0.000	0.000	10,394
HEALTH PHYSICS PERSONNEL	47	0	30	77	1,698	0.000	1,106	2,804	1,698	0.000	1,106	2,804
SUPERVISORY PERSONNEL	35	3	1	39	12,428	0.997	0.137	13,562	12,428	0.997	0.137	13,562
ENGINEERING PERSONNEL	55	36	5	96	8,856	5,648	0.798	14,300	8,856	5,648	0.798	14,300
TOTAL	555	386	40	981	102,508	70,833	2,066	175,407	102,508	70,833	2,066	175,407
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	2404	2625	34	5063	307,176	432,383	10,399	749,958	307,176	432,383	10,399	749,958
OPERATING PERSONNEL	435	0	0	435	42,055	0.000	0.000	42,055	42,055	0.000	0.000	42,055
HEALTH PHYSICS PERSONNEL	313	3	258	574	39,720	0.000	31,751	71,471	39,720	0.000	31,751	71,471
SUPERVISORY PERSONNEL	291	81	9	381	39,431	10,544	0,558	50,533	39,431	10,544	0,558	50,533
ENGINEERING PERSONNEL	337	414	131	882	50,094	54,498	64,981	169,573	50,094	54,498	64,981	169,573
GRAND TOTAL	3780	3123	432	7335	478,476	497,625	107,689	1083,590	478,476	497,625	107,689	1083,590

* Workers may be counted in more than one category.

Appendix D (cont.)

PLANT: *SUMMER 1 (PWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

1984
(>100 M-REM)

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSONS	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL MAN-REMS
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS		EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	
REACTOR OPERATIONS & SURV.							118							29.642
MAINTENANCE PERSONNEL	1	0	0	0	0	0	0	0.255	0.000	0.000	0.000	0.000	0.000	
OPERATING PERSONNEL	36	0	0	0	2	0	10.418	10.418	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	5	0	0	0	73	0	0.965	0.000	0.000	0.000	0.000	17.674	0.000	
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	1	0	0	0	0	0	0.110	0.110	0.000	0.000	0.000	0.000	0.000	
TOTAL	43	0	0	0	75	0	118	11.748	0.000	0.000	0.000	17.894	0.000	29.642
ROUTINE MAINTENANCE														
MAINTENANCE PERSONNEL	27	0	0	0	45	0	4.107	4.107	0.000	0.000	0.000	10.808	0.000	
OPERATING PERSONNEL	1	0	0	0	0	0	0.130	0.130	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0	6	0	0.000	0.000	0.000	0.000	0.000	0.797	0.000	
SUPERVISORY PERSONNEL	1	0	0	0	0	0	0.140	0.140	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	5	1	1	0	3	0	0.681	0.681	0.125	0.125	0.000	0.515	0.000	
TOTAL	34	1	1	0	54	0	89	5.058	0.125	0.125	0.000	12.120	0.515	17.303
IN-SERVICE INSPECTION														
MAINTENANCE PERSONNEL	26	0	0	0	27	0	8.210	8.210	0.000	0.000	0.000	10.828	0.000	
OPERATING PERSONNEL	3	0	0	0	0	0	0.440	0.440	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0	15	0	0.000	0.000	0.000	0.000	0.000	2.640	0.000	
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	5	7	7	1	11	0	2.055	2.055	2.515	2.515	0.000	9.267	0.000	
TOTAL	34	7	7	1	53	0	94	10.705	2.515	2.515	0.000	22.735	9.267	35.955
SPECIAL MAINTENANCE														
MAINTENANCE PERSONNEL	95	0	0	0	190	0	52.053	52.053	0.000	0.000	0.000	82.397	0.000	
OPERATING PERSONNEL	3	0	0	0	1	0	0.470	0.470	0.000	0.000	0.000	0.275	0.000	
HEALTH PHYSICS PERSONNEL	1	0	0	0	69	0	0.230	0.230	0.000	0.000	0.000	24.671	0.000	
SUPERVISORY PERSONNEL	1	0	0	0	0	0	0.220	0.220	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	6	14	14	0	40	0	2.325	2.325	4.142	4.142	0.000	23.636	0.000	
TOTAL	106	14	14	0	300	0	420	55.298	4.142	4.142	0.000	130.979	23.636	190.419
WASTE PROCESSING														
MAINTENANCE PERSONNEL	1	0	0	0	16	0	0.175	0.175	0.000	0.000	0.000	4.392	0.000	
OPERATING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0	4	0	0.000	0.000	0.000	0.000	0.000	0.750	0.000	
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
TOTAL	1	0	0	0	20	0	21	0.175	0.000	0.000	0.000	5.142	0.000	5.317
REFUELING														
MAINTENANCE PERSONNEL	13	0	0	0	49	0	3.542	3.542	0.000	0.000	0.000	15.969	0.000	
OPERATING PERSONNEL	0	0	0	0	1	0	0.000	0.000	0.000	0.000	0.000	0.660	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0	0	3	0	0.000	0.000	0.000	0.000	0.000	0.860	0.000	
SUPERVISORY PERSONNEL	0	0	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	1	3	3	0	0	0	0.140	0.140	0.940	0.940	0.000	0.000	0.000	
TOTAL	14	3	3	0	53	0	70	3.682	0.940	0.940	0.000	17.489	0.000	22.111
TOTAL BY JOB FUNCTION														
MAINTENANCE PERSONNEL	163	0	0	0	327	0	490	68.342	0.000	0.000	0.000	124.394	0.000	192.736
OPERATING PERSONNEL	43	0	0	0	4	0	47	11.458	0.000	0.000	0.000	1.155	0.000	12.613
HEALTH PHYSICS PERSONNEL	6	0	0	0	170	0	176	1.195	0.000	0.000	0.000	47.392	0.000	48.587
SUPERVISORY PERSONNEL	2	0	0	0	0	0	2	0.360	0.000	0.000	0.000	0.000	0.000	0.360
ENGINEERING PERSONNEL	18	25	25	0	54	0	97	5.311	7.722	7.722	0.000	33.418	0.000	46.451
GRAND TOTAL	232	25	25	0	555	0	812	86.666	7.722	7.722	0.000	206.359	33.418	300.747

*Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REMS BY WORK AND JOB FUNCTION

PLANT: *SURRY 1,2 (PMR)	NUMBER OF PERSONNEL (>100 M-REM) 1984		STATION EMPLOYEES		TOTAL PERSONS	STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	EMPLOYEES	CONTRACT & OTHERS		EMPLOYEES	CONTRACT & OTHERS	UTILITY EMPLOYEES	CONTRACT & OTHERS
WORK & JOB FUNCTION									
REACTOR OPERATIONS & SURV.									
MAINTENANCE PERSONNEL	84	3	132		1018	4.902	0.004	6.894	
OPERATING PERSONNEL	233	19	32			158.822	0.614	0.662	
HEALTH PHYSICS PERSONNEL	51	1	242			40.520	0.009	237.458	
SUPERVISORY PERSONNEL	59	3	5			14.378	0.039	0.880	
ENGINEERING PERSONNEL	40	18	96			8.534	0.441	10.300	
TOTAL	467	44	507		1018	227.156	1.107	256.194	484.457
ROUTINE MAINTENANCE									
MAINTENANCE PERSONNEL	210	49	896			260.484	12.583	683.454	
OPERATING PERSONNEL	79	17	57			11.647	1.022	9.458	
HEALTH PHYSICS PERSONNEL	23	1	163			12.681	0.501	90.139	
SUPERVISORY PERSONNEL	34	0	3			14.102	0.000	0.618	
ENGINEERING PERSONNEL	21	3	194			5.013	0.080	67.232	
TOTAL	367	70	1313		1750	303.927	14.186	850.901	1169.014
IN-SERVICE INSPECTION									
MAINTENANCE PERSONNEL	29	0	102			1.994	0.000	11.376	
OPERATING PERSONNEL	122	1	11			14.800	0.003	1.447	
HEALTH PHYSICS PERSONNEL	0	0	3			0.000	0.000	0.019	
SUPERVISORY PERSONNEL	12	0	0			0.268	0.000	0.000	
ENGINEERING PERSONNEL	14	1	14			3.023	0.012	4.360	
TOTAL	177	2	130		309	20.085	0.015	17.202	37.302
SPECIAL MAINTENANCE									
MAINTENANCE PERSONNEL	48	2	536			2.788	0.007	212.864	
OPERATING PERSONNEL	19	0	29			4.393	0.227	7.363	
HEALTH PHYSICS PERSONNEL	1	0	17			0.240	0.000	1.324	
SUPERVISORY PERSONNEL	3	0	0			0.242	0.000	0.000	
ENGINEERING PERSONNEL	2	1	93			0.027	0.015	28.980	
TOTAL	73	3	675		751	7.690	0.249	250.531	258.470
WASTE PROCESSING									
MAINTENANCE PERSONNEL	8	0	84			0.090	0.000	3.474	
OPERATING PERSONNEL	28	0	0			11.303	0.000	0.000	
HEALTH PHYSICS PERSONNEL	5	0	77			1.126	0.000	17.588	
SUPERVISORY PERSONNEL	6	0	3			2.436	0.000	0.121	
ENGINEERING PERSONNEL	0	0	11			0.000	0.000	0.055	
TOTAL	47	0	175		222	14.955	0.000	21.238	36.193
REFUELING									
MAINTENANCE PERSONNEL	46	0	55			12.345	0.000	19.321	
OPERATING PERSONNEL	23	13	6			3.619	0.000	0.678	
HEALTH PHYSICS PERSONNEL	1	0	2			0.005	0.573	0.029	
SUPERVISORY PERSONNEL	8	0	0			1.122	0.000	0.000	
ENGINEERING PERSONNEL	0	0	34			0.000	0.000	5.972	
TOTAL	78	13	97		188	17.091	0.573	26.000	43.664
TOTAL BY JOB FUNCTION									
MAINTENANCE PERSONNEL	425	54	1805		2284	282.603	12.594	937.383	1232.580
OPERATING PERSONNEL	504	50	135		689	204.584	1.866	19.608	226.058
HEALTH PHYSICS PERSONNEL	81	2	504		587	54.572	1.083	346.557	402.212
SUPERVISORY PERSONNEL	122	3	11		136	32.548	0.039	1.619	34.206
ENGINEERING PERSONNEL	77	23	442		542	16.597	0.548	116.899	134.044
GRAND TOTAL	1209	132	2897		4238	590.904	16.130	1422.066	2029.100

*Workers may be counted in more than one category.

^aUncorrected pocket dosimeter totals for everyone whose dose > 1 mrem.

Appendix D (cont.)

PLANT: SUSQUEHANANA 1 (BWR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS		STATION EMPLOYEES		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES & OTHERS	STATION EMPLOYEES	UTILITY EMPLOYEES & OTHERS
REACTOR OPERATIONS & SURV.								
MAINTENANCE PERSONNEL	10	3	3,055	0.307	3,055	0.307	0.611	
OPERATING PERSONNEL	57	5	19,234	0.120	19,234	0.120	0.639	
HEALTH PHYSICS PERSONNEL	7	14	2,708	0.000	2,708	0.000	5.617	
SUPERVISORY PERSONNEL	4	0	0,979	0.000	0,979	0.000	0.000	
ENGINEERING PERSONNEL	0	2	0.000	1.403	0.000	1.403	0.000	
TOTAL	78	22	25,976	1.830	25,976	1.830	6.867	34.673
ROUTINE MAINTENANCE								
MAINTENANCE PERSONNEL	61	73	19,133	26.958	19,133	26.958	21.189	
OPERATING PERSONNEL	5	5	0.914	0.000	0.914	0.000	1.011	
HEALTH PHYSICS PERSONNEL	8	26	2,483	0.000	2,483	0.000	7.899	
SUPERVISORY PERSONNEL	5	0	1,199	0.000	1,199	0.000	0.000	
ENGINEERING PERSONNEL	0	8	0.000	2.191	0.000	2.191	0.000	
TOTAL	79	112	23,729	26.958	23,729	26.958	32.290	82.977
IN-SERVICE INSPECTION								
MAINTENANCE PERSONNEL	0	1	0.000	0.157	0.000	0.157	0.202	
OPERATING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
TOTAL	0	1	0.000	0.157	0.000	0.157	0.202	0.359
SPECIAL MAINTENANCE								
MAINTENANCE PERSONNEL	0	47	0.000	4.792	0.000	4.792	8.438	
OPERATING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	2	0.000	0.000	0.000	0.000	0.242	
SUPERVISORY PERSONNEL	1	0	0.117	0.000	0.117	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
TOTAL	1	49	0.117	4.792	0.117	4.792	8.680	13.589
WASTE PROCESSING								
MAINTENANCE PERSONNEL	0	18	0.000	1.375	0.000	1.375	6.436	
OPERATING PERSONNEL	1	9	0.199	0.000	0.199	0.000	8.290	
HEALTH PHYSICS PERSONNEL	6	2	2,660	0.000	2,660	0.000	0.390	
SUPERVISORY PERSONNEL	1	0	0.388	0.000	0.388	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
TOTAL	8	29	3,247	1.375	3,247	1.375	15.116	19.738
REFUELING								
MAINTENANCE PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
OPERATING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
HEALTH PHYSICS PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
SUPERVISORY PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
ENGINEERING PERSONNEL	0	0	0.000	0.000	0.000	0.000	0.000	
TOTAL	0	0	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL BY JOB FUNCTION								
MAINTENANCE PERSONNEL	71	142	22,188	33.589	22,188	33.589	36.876	92.653
OPERATING PERSONNEL	63	19	20,347	0.120	20,347	0.120	9.940	30.407
HEALTH PHYSICS PERSONNEL	21	65	7,851	0.000	7,851	0.000	14.148	21.999
SUPERVISORY PERSONNEL	11	0	2,683	0.000	2,683	0.000	0.000	2.683
ENGINEERING PERSONNEL	0	8	0.000	1.403	0.000	1.403	2.191	3.594
GRAND TOTAL	166	213	53,069	35.112	53,069	35.112	63.155	151.336

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WUKK AND JOB FUNCTION

* † PLANT: THREE MILE ISLAND 1 (PMR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		TOTAL		STATION		TOTAL MAN-REMS	
	STATION EMPLOYEES	UTILITY EMPLOYEES	PERSONS	EMPLOYEES	EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	MAN-REMS
REACTOR OPERATIONS & SURV.								
MAINTENANCE PERSONNEL	133	1	47	0.796	0.010	0.049		
OPERATING PERSONNEL	94	0	10	6.192	0.000	0.016		
HEALTH PHYSICS PERSONNEL	115	6	39	7.866	0.002	0.013		
SUPERVISORY PERSONNEL	220	76	51	3.769	0.047	0.119		
ENGINEERING PERSONNEL	75	43	79	1.973	0.303	0.304		
TOTAL	637	126	226	20.596	0.092	0.501		21.189
ROUTINE MAINTENANCE								
MAINTENANCE PERSONNEL	174	0	18	14.424	0.000	0.332		
OPERATING PERSONNEL	60	0	8	0.135	0.000	0.688		
HEALTH PHYSICS PERSONNEL	60	0	2	0.915	0.000	0.000		
SUPERVISORY PERSONNEL	86	3	10	2.295	0.004	0.361		
ENGINEERING PERSONNEL	28	7	21	0.335	0.018	0.148		
TOTAL	408	10	477	18.104	0.022	1.529		19.655
IN-SERVICE INSPECTION								
MAINTENANCE PERSONNEL	29	0	20	0.973	0.000	1.133		
OPERATING PERSONNEL	10	0	4	0.003	0.000	0.293		
HEALTH PHYSICS PERSONNEL	26	0	0	0.090	0.000	0.000		
SUPERVISORY PERSONNEL	32	11	11	0.291	0.002	0.149		
ENGINEERING PERSONNEL	29	3	43	0.195	0.002	2.956		
TOTAL	126	14	78	1.552	0.004	4.531		6.087
SPECIAL MAINTENANCE								
MAINTENANCE PERSONNEL	139	1	153	52.301	0.000	5.746		
OPERATING PERSONNEL	60	0	7	29.603	0.000	0.900		
HEALTH PHYSICS PERSONNEL	32	1	1	5.694	0.000	0.003		
SUPERVISORY PERSONNEL	98	9	25	7.620	0.001	1.776		
ENGINEERING PERSONNEL	46	13	46	4.259	0.145	0.957		
TOTAL	375	23	232	99.477	0.146	9.382		109.005
WASTE PROCESSING								
MAINTENANCE PERSONNEL	96	0	11	2.313	0.000	0.008		
OPERATING PERSONNEL	58	0	9	3.705	0.000	0.630		
HEALTH PHYSICS PERSONNEL	34	0	4	0.527	0.000	0.145		
SUPERVISORY PERSONNEL	37	0	4	1.118	0.000	0.248		
ENGINEERING PERSONNEL	15	2	5	0.884	0.003	0.043		
TOTAL	240	2	33	8.547	0.003	1.074		9.624
REFUELLING								
MAINTENANCE PERSONNEL	0	0	0	0.000	0.000	0.000		
OPERATING PERSONNEL	0	0	0	0.000	0.000	0.000		
HEALTH PHYSICS PERSONNEL	0	0	0	0.000	0.000	0.000		
SUPERVISORY PERSONNEL	0	0	0	0.000	0.000	0.000		
ENGINEERING PERSONNEL	0	0	0	0.000	0.000	0.000		
TOTAL	0	0	0	0.000	0.000	0.000		0.000
TOTAL BY JOB FUNCTION								
MAINTENANCE PERSONNEL	571	2	249	70.807	0.010	7.268		78.085
OPERATING PERSONNEL	282	0	38	39.638	0.000	2.527		42.165
HEALTH PHYSICS PERSONNEL	267	6	46	15.092	0.002	0.161		15.255
SUPERVISORY PERSONNEL	473	99	101	15.093	0.054	2.653		17.800
ENGINEERING PERSONNEL	193	68	194	7.646	0.201	4.408		12.255
GRAND TOTAL	1786	175	628	148.276	0.267	17.017		165.560

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION
1984

*† PLANT: THREE MILE ISLAND 2 (PWR)

WORK & JOB FUNCTION	STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS
REACTOR OPERATIONS & SURV.	358	11	225	594	26,139	0.072	10,016	36,227				
MAINTENANCE PERSONNEL	73	0	72		1,414	0.000	0.449					
OPERATING PERSONNEL	59	0	3		11,113	0.000	0.006					
HEALTH PHYSICS PERSONNEL	98	2	67		12,112	0.000	6.601					
SUPERVISORY PERSONNEL	98	9	32		0.971	0.000	1.587					
ENGINEERING PERSONNEL	30	0	51		0.529	0.072	1.373					
TOTAL	358	11	225	594	26,139	0.072	10,016	36,227				
ROUTINE MAINTENANCE	91	2	166		42,735	0.002	4.503					
MAINTENANCE PERSONNEL	52	0	3		4,478	0.000	0.149					
OPERATING PERSONNEL	75	0	36		5,773	0.000	2.461					
HEALTH PHYSICS PERSONNEL	61	0	21		3,002	0.000	2.023					
SUPERVISORY PERSONNEL	24	2	61		0.619	0.002	2.528					
ENGINEERING PERSONNEL	303	4	287	594	56,607	0.004	11.664	68,275				
TOTAL	72	0	27	99	1,469	0.000	1.677	3,146				
IN-SERVICE INSPECTION	14	0	7		1,089	0.000	0.183					
MAINTENANCE PERSONNEL	37	0	1		0.021	0.000	0.027					
OPERATING PERSONNEL	7	0	5		0.019	0.000	0.023					
HEALTH PHYSICS PERSONNEL	11	0	4		0.324	0.000	0.168					
SUPERVISORY PERSONNEL	3	0	10		0.016	0.000	1.276					
ENGINEERING PERSONNEL	72	0	27	99	1,469	0.000	1.677	3,146				
TOTAL	91	0	241		80,762	0.000	280.918					
MAINTENANCE PERSONNEL	57	0	5		18,973	0.000	0.512					
OPERATING PERSONNEL	84	0	50		30,980	0.000	14.842					
HEALTH PHYSICS PERSONNEL	81	4	41		17,841	0.234	13.552					
SUPERVISORY PERSONNEL	30	0	67		6,545	0.000	25.235					
ENGINEERING PERSONNEL	343	4	404	751	155,101	0.234	335.059	490,394				
TOTAL	100	1	190		9,636	0.000	5.836					
MAINTENANCE PERSONNEL	78	0	6		8,424	0.000	0.650					
OPERATING PERSONNEL	80	0	58		6,397	0.000	1.538					
HEALTH PHYSICS PERSONNEL	83	4	29		1,766	0.000	0.395					
SUPERVISORY PERSONNEL	28	2	68		1,550	0.009	0.450					
ENGINEERING PERSONNEL	369	7	351	727	27,773	0.009	8.869	36,651				
TOTAL	0	0	0	0	0.000	0.000	0.000	0.000				
MAINTENANCE PERSONNEL	0	0	0		0.000	0.000	0.000					
OPERATING PERSONNEL	0	0	0		0.000	0.000	0.000					
HEALTH PHYSICS PERSONNEL	0	0	0		0.000	0.000	0.000					
SUPERVISORY PERSONNEL	0	0	0		0.000	0.000	0.000					
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000				
TOTAL	0	0	0	0	0.000	0.000	0.000	0.000				
TOTAL BY JOB FUNCTION	369	3	676	1048	135,636	0.002	291.889	427,527				
MAINTENANCE PERSONNEL	283	0	18	301	43,009	0.000	1.344	44,353				
OPERATING PERSONNEL	344	2	216	562	55,281	0.000	25.746	80,746				
HEALTH PHYSICS PERSONNEL	334	17	127	478	23,904	0.234	17.725	41,863				
SUPERVISORY PERSONNEL	115	4	257	376	9,259	0.083	30.862	40,204				
ENGINEERING PERSONNEL	1445	26	1294	2765	267,089	0.319	367.285	634,693				
GRAND TOTAL												

* Workers may be counted in more than one category.

a Includes reactor building decon and dose reduction, reactor defueling, reactor systems disassembly, primary coolant decon.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: TROJAN	(PWR)	1984									
		NUMBER OF PERSONNEL (>100 M-REM)					TOTAL MAN-REMS				
		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS		
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	6	2	6		2,160	0.720	1.920				
OPERATING PERSONNEL	30	0	0		14,330	0.000	0.000				
HEALTH PHYSICS PERSONNEL	28	0	38		9,370	0.070	11.530				
SUPERVISORY PERSONNEL	5	0	13		1,500	1.170	4.490				
ENGINEERING PERSONNEL	1	3	1		0,660	1.260	0.240				
TOTAL	70	5	58	133	28,020	2,220	18,180			48,420	
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	64	44	156		27,470	17.820	138.410				
OPERATING PERSONNEL	1	0	0		0,710	0.000	0.000				
HEALTH PHYSICS PERSONNEL	32	2	59		18,560	0.840	30.980				
SUPERVISORY PERSONNEL	14	4	0		5,830	1.100	0.020				
ENGINEERING PERSONNEL	2	0	0		0,870	0.240	0.020				
TOTAL	113	50	215	378	53,440	20,000	169,430			242,870	
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	0	0	0		0.000	0.000	0.000				
OPERATING PERSONNEL	0	0	0		0.000	0.000	0.000				
HEALTH PHYSICS PERSONNEL	0	0	0		0.000	0.000	0.000				
SUPERVISORY PERSONNEL	0	0	0		0.000	0.000	0.000				
ENGINEERING PERSONNEL	0	0	0		0.000	0.000	0.000				
TOTAL	0	0	0	0	0.000	0.000	0.000			0.000	
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	60	26	125		36,210	14.100	49.420				
OPERATING PERSONNEL	8	0	0		3,220	0.000	0.000				
HEALTH PHYSICS PERSONNEL	30	6	26		13,880	2.900	10.760				
SUPERVISORY PERSONNEL	11	1	1		3,450	0.830	0.560				
ENGINEERING PERSONNEL	6	3	0		3,210	0.830	0.030				
TOTAL	115	36	152	303	59,970	18,660	60,770			139,400	
WASTE PROCESSING											
MAINTENANCE PERSONNEL	0	1	15		0.280	0.300	4.140				
OPERATING PERSONNEL	2	0	0		0.780	0.000	0.000				
HEALTH PHYSICS PERSONNEL	30	11	33		15,300	2.650	13.070				
SUPERVISORY PERSONNEL	1	0	0		0.100	0.010	0.040				
ENGINEERING PERSONNEL	0	0	0		0.050	0.010	0.000				
TOTAL	33	12	48	93	16,510	2,970	17,250			36,730	
REFUELING											
MAINTENANCE PERSONNEL	21	9	10		18,600	5.270	3.940				
OPERATING PERSONNEL	12	0	0		9,160	0.000	0.000				
HEALTH PHYSICS PERSONNEL	14	2	13		4,690	0.560	4.310				
SUPERVISORY PERSONNEL	2	2	0		0.840	0.310	0.010				
ENGINEERING PERSONNEL	0	0	0		0.180	0.160	0.000				
TOTAL	49	13	23	85	33,470	6,300	8,260			48,030	
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	151	82	312	545	84,720	38,210	197,830			320,760	
OPERATING PERSONNEL	53	0	0	53	28,200	0.000	0.000			28,200	
HEALTH PHYSICS PERSONNEL	134	21	169	324	61,800	7,020	70,650			139,470	
SUPERVISORY PERSONNEL	33	7	14	54	11,720	2,420	5,120			19,260	
ENGINEERING PERSONNEL	9	6	1	16	4,970	2,500	0,290			7,760	
GRAND TOTAL	380	116	496	992	191,410	50,150	273,890			515,450	

* Workers may be counted in more than one category.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: * TURKEY POINT 3,4 (PWR) 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	CONTRACT & OTHERS								
REACTOR OPERATIONS & SURV.												
MAINTENANCE PERSONNEL	133	4	88		520	106,150	3,860	148,010	258,020			
OPERATING PERSONNEL	37	0	0									
HEALTH PHYSICS PERSONNEL	24	0	111									
SUPERVISORY PERSONNEL	26	2	23									
ENGINEERING PERSONNEL	31	3	38									
TOTAL	251	9	260		520	106,150	3,860	148,010	258,020			
ROUTINE MAINTENANCE												
MAINTENANCE PERSONNEL	166	32	189									
OPERATING PERSONNEL	24	0	0									
HEALTH PHYSICS PERSONNEL	10	0	14									
SUPERVISORY PERSONNEL	9	0	7									
ENGINEERING PERSONNEL	8	0	6									
TOTAL	217	32	216		465	176,605	18,035	90,930	285,570			
IN-SERVICE INSPECTION												
MAINTENANCE PERSONNEL	29	5	93									
OPERATING PERSONNEL	4	0	0									
HEALTH PHYSICS PERSONNEL	4	0	6									
SUPERVISORY PERSONNEL	4	1	2									
ENGINEERING PERSONNEL	6	1	1									
TOTAL	47	7	102		156	15,205	2,210	58,010	75,425			
SPECIAL MAINTENANCE												
MAINTENANCE PERSONNEL	46	9	612									
OPERATING PERSONNEL	5	0	0									
HEALTH PHYSICS PERSONNEL	2	0	7									
SUPERVISORY PERSONNEL	3	2	46									
ENGINEERING PERSONNEL	4	1	20									
TOTAL	60	12	685		757	20,360	4,935	724,245	749,540			
WASTE PROCESSING												
MAINTENANCE PERSONNEL	14	4	6									
OPERATING PERSONNEL	0	0	0									
HEALTH PHYSICS PERSONNEL	10	0	15									
SUPERVISORY PERSONNEL	1	0	0									
ENGINEERING PERSONNEL	2	0	0									
TOTAL	27	4	21		52	22,970	1,725	6,385	31,080			
REFUELING												
MAINTENANCE PERSONNEL	0	22	19									
OPERATING PERSONNEL	35	0	0									
HEALTH PHYSICS PERSONNEL	0	0	4									
SUPERVISORY PERSONNEL	9	0	12									
ENGINEERING PERSONNEL	7	0	2									
TOTAL	51	22	37		110	61,090	17,325	11,985	90,400			
TOTAL BY JOB FUNCTION												
MAINTENANCE PERSONNEL	388(195)	76(39)	1007(733)		1471(967)	262,710	42,630	869,540	1174,880			
OPERATING PERSONNEL	105(61)	0(0)	0(0)		105(61)	61,085	0,165	0,000	61,250			
HEALTH PHYSICS PERSONNEL	50(25)	0(0)	157(118)		207(143)	38,955	0,005	101,020	139,980			
SUPERVISORY PERSONNEL	52(30)	5(4)	90(56)		147(80)	18,875	3,205	38,990	61,100			
ENGINEERING PERSONNEL	58(44)	5(4)	67(57)		130(105)	20,755	2,055	30,015	52,825			
GRAND TOTAL	653(355)	87(47)	1321(964)		2060(1366)	402,380	48,090	1039,565	1490,035			

* Workers may be counted in more than one category. In parentheses are total numbers of individuals.

Appendix D (cont.)

NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION

PLANT: VERMONT YANKEE (BMR)	NUMBER OF PERSONNEL (>100 M-REM) 1984															
	STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL PERSONS		STATION EMPLOYEES		UTILITY EMPLOYEES		CONTRACT & OTHERS		TOTAL MAN-REMS	
	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	PERSONS	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	EMPLOYEES	CONTRACT & OTHERS	MAN-REMS	CONTRACT & OTHERS
WORK & JOB FUNCTION	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
REACTOR OPERATIONS & SURV.																
MAINTENANCE PERSONNEL	2	0	0	2	4,262	0.000	0.286	0.000	4,262	0.000	0.286	0.000	4,262	0.000	0.286	0.000
OPERATING PERSONNEL	30	0	20	50	27,882	0.000	3,954	0.000	27,882	0.000	3,954	0.000	27,882	0.000	3,954	0.000
HEALTH PHYSICS PERSONNEL	8	0	16	24	15,640	0.010	20,707	0.010	15,640	0.010	20,707	0.010	15,640	0.010	20,707	0.010
SUPERVISORY PERSONNEL	1	0	0	1	0,163	0.000	0.000	0.000	0,163	0.000	0.000	0.000	0,163	0.000	0.000	0.000
ENGINEERING PERSONNEL	5	0	3	8	6,113	0.025	1,254	0.025	6,113	0.025	1,254	0.025	6,113	0.025	1,254	0.025
TOTAL	46	0	39	85	54,060	0.035	26,201	0.035	54,060	0.035	26,201	0.035	54,060	0.035	26,201	80,296
ROUTINE MAINTENANCE																
MAINTENANCE PERSONNEL	13	27	37	77	37,076	135.328	211,449	135.328	37,076	135.328	211,449	135.328	37,076	135.328	211,449	135.328
OPERATING PERSONNEL	11	0	0	11	4,890	0.000	0.034	0.000	4,890	0.000	0.034	0.000	4,890	0.000	0.034	0.000
HEALTH PHYSICS PERSONNEL	3	0	10	13	1,336	0.025	4,370	0.025	1,336	0.025	4,370	0.025	1,336	0.025	4,370	0.025
SUPERVISORY PERSONNEL	0	0	0	0	0,536	0.052	0.029	0.052	0,536	0.052	0.029	0.052	0,536	0.052	0.029	0.052
ENGINEERING PERSONNEL	2	0	1	3	1,390	0.000	0.201	0.000	1,390	0.000	0.201	0.000	1,390	0.000	0.201	0.000
TOTAL	29	27	48	104	45,228	135.405	216,083	135.405	45,228	135.405	216,083	135.405	45,228	135.405	216,083	396,716
IN-SERVICE INSPECTION																
MAINTENANCE PERSONNEL	1	21	70	72	9,071	34.536	56,937	34.536	9,071	34.536	56,937	34.536	9,071	34.536	56,937	34.536
OPERATING PERSONNEL	0	0	0	0	1,170	0.000	0.000	0.000	1,170	0.000	0.000	0.000	1,170	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0,398	0.000	1,073	0.000	0,398	0.000	1,073	0.000	0,398	0.000	1,073	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0,126	0.010	0.000	0.010	0,126	0.010	0.000	0.010	0,126	0.010	0.000	0.010
ENGINEERING PERSONNEL	0	0	0	0	0,392	0.000	0.049	0.000	0,392	0.000	0.049	0.000	0,392	0.000	0.049	0.000
TOTAL	1	21	70	92	11,157	34.546	58,059	34.546	11,157	34.546	58,059	34.546	11,157	34.546	58,059	103,762
SPECIAL MAINTENANCE																
MAINTENANCE PERSONNEL	1	20	22	23	0,745	9.908	5,137	9.908	0,745	9.908	5,137	9.908	0,745	9.908	5,137	9.908
OPERATING PERSONNEL	0	0	0	0	0,050	0.000	0.000	0.000	0,050	0.000	0.000	0.000	0,050	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0,013	0.000	0.046	0.000	0,013	0.000	0.046	0.000	0,013	0.000	0.046	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0,011	0.253	0.000	0.253	0,011	0.253	0.000	0.253	0,011	0.253	0.000	0.253
ENGINEERING PERSONNEL	1	0	0	1	0,898	0.000	0.002	0.000	0,898	0.000	0.002	0.000	0,898	0.000	0.002	0.000
TOTAL	2	20	22	44	1,717	10.161	5,185	10.161	1,717	10.161	5,185	10.161	1,717	10.161	5,185	17,063
WASTE PROCESSING																
MAINTENANCE PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000
OPERATING PERSONNEL	6	0	0	6	3,108	0.000	0.423	0.000	3,108	0.000	0.423	0.000	3,108	0.000	0.423	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0,319	0.000	0.000	0.000	0,319	0.000	0.000	0.000	0,319	0.000	0.000	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000
TOTAL	6	0	0	6	3,427	0.000	0.423	0.000	3,427	0.000	0.423	0.000	3,427	0.000	0.423	3,850
REFUELING																
MAINTENANCE PERSONNEL	0	0	2	2	0,140	0.086	0.490	0.086	0,140	0.086	0.490	0.086	0,140	0.086	0.490	0.086
OPERATING PERSONNEL	0	0	0	0	0,119	0.000	0.000	0.000	0,119	0.000	0.000	0.000	0,119	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	0	0	0,000	0.000	0.074	0.000	0,000	0.000	0.074	0.000	0,000	0.000	0.074	0.000
SUPERVISORY PERSONNEL	0	0	0	0	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000	0,000	0.000	0.000	0.000
ENGINEERING PERSONNEL	1	0	0	1	0,155	0.000	0.000	0.000	0,155	0.000	0.000	0.000	0,155	0.000	0.000	0.000
TOTAL	1	0	2	3	0,414	0.086	0.564	0.086	0,414	0.086	0.564	0.086	0,414	0.086	0.564	1,064
TOTAL BY JOB FUNCTION																
MAINTENANCE PERSONNEL	17	68	131	216	51,294	179,858	274,299	179,858	51,294	179,858	274,299	179,858	51,294	179,858	274,299	505,451
OPERATING PERSONNEL	47	0	20	67	37,219	0.000	3,988	0.000	37,219	0.000	3,988	0.000	37,219	0.000	3,988	41,207
HEALTH PHYSICS PERSONNEL	11	0	26	37	17,706	0.035	26,693	0.035	17,706	0.035	26,693	0.035	17,706	0.035	26,693	44,434
SUPERVISORY PERSONNEL	1	0	0	1	0,836	0.315	0.029	0.315	0,836	0.315	0.029	0.315	0,836	0.315	0.029	1,180
ENGINEERING PERSONNEL	9	0	4	13	8,948	0.025	1,506	0.025	8,948	0.025	1,506	0.025	8,948	0.025	1,506	10,479
GRAND TOTAL	85	68	181	334	116,003	180,233	306,515	180,233	116,003	180,233	306,515	180,233	116,003	180,233	306,515	602,751

^aNRC mandated work on environmental qualifications contributed 13 man-rems.

Appendix D (cont.)

PLANT: *YANKEE ROWE (PMR) NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION 1984

WORK & JOB FUNCTION	NUMBER OF PERSONNEL (>100 M-REM)		NUMBER OF PERSONNEL (>100 M-REM)		STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL PERSONS								
REACTOR OPERATIONS & SURV.	39	2	2	43	14,145	1,095	0.850	16,090	14,145	1,095	0.850	16,090
MAINTENANCE PERSONNEL	1	2	0	3	0.700	0.830	0.000	1.530	0.700	0.830	0.000	1.530
OPERATING PERSONNEL	25	0	0	25	8,732	0.000	0.000	8,732	8,732	0.000	0.000	8,732
HEALTH PHYSICS PERSONNEL	13	0	2	15	4,363	0.000	0.760	5,123	4,363	0.000	0.760	5,123
SUPERVISORY PERSONNEL	0	0	0	0	0.145	0.000	0.080	0.225	0.145	0.000	0.080	0.225
ENGINEERING PERSONNEL	0	0	0	0	0.205	0.265	0.010	0.480	0.205	0.265	0.010	0.480
TOTAL	39	2	2	43	14,145	1,095	0.850	16,090	14,145	1,095	0.850	16,090
ROUTINE MAINTENANCE	23	39	5	67	10,227	11,930	1.577	22,734	10,227	11,930	1.577	22,734
MAINTENANCE PERSONNEL	2	0	0	2	0.623	0.000	0.000	0.623	0.623	0.000	0.000	0.623
OPERATING PERSONNEL	6	0	11	17	3,605	0.000	10.205	13,810	3,605	0.000	10.205	13,810
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.010	0.000	0.080	0.090	0.010	0.000	0.080	0.090
SUPERVISORY PERSONNEL	0	0	0	0	0.018	0.160	0.000	0.178	0.018	0.160	0.000	0.178
ENGINEERING PERSONNEL	0	0	0	0	0.018	0.160	0.000	0.178	0.018	0.160	0.000	0.178
TOTAL	31	39	16	86	14,483	12,090	11.862	26,575	14,483	12,090	11.862	26,575
IN-SERVICE INSPECTION	11	43	58	112	5,390	21,637	61.629	27,056	5,390	21,637	61.629	27,056
MAINTENANCE PERSONNEL	0	0	0	0	0.735	0.000	0.030	0.765	0.735	0.000	0.030	0.765
OPERATING PERSONNEL	11	0	30	41	9,525	0.000	15.385	24,910	9,525	0.000	15.385	24,910
HEALTH PHYSICS PERSONNEL	6	0	0	6	7,250	0.000	0.040	7,290	7,250	0.000	0.040	7,290
SUPERVISORY PERSONNEL	6	4	8	18	7,980	2,035	6.560	16,555	7,980	2,035	6.560	16,555
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	34	47	96	177	30,880	23,672	83.644	54,552	30,880	23,672	83.644	54,552
SPECIAL MAINTENANCE	22	80	29	131	12,890	33,370	12.295	46,260	12,890	33,370	12.295	46,260
MAINTENANCE PERSONNEL	17	0	0	17	5,202	0.000	0.000	5,202	5,202	0.000	0.000	5,202
OPERATING PERSONNEL	9	0	18	27	2,460	0.000	4.860	7,320	2,460	0.000	4.860	7,320
HEALTH PHYSICS PERSONNEL	1	0	0	1	1,295	0.000	0.010	1,305	1,295	0.000	0.010	1,305
SUPERVISORY PERSONNEL	1	9	0	10	0.695	2.335	0.235	3.265	0.695	2.335	0.235	3,265
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	50	89	47	186	22,542	35,705	17.400	58,247	22,542	35,705	17.400	58,247
WASTE PROCESSING	0	0	0	0	0.305	0.935	0.155	1.395	0.305	0.935	0.155	1.395
MAINTENANCE PERSONNEL	7	0	0	7	2,620	0.000	0.000	2,620	2,620	0.000	0.000	2,620
OPERATING PERSONNEL	4	0	26	30	6,465	0.000	15.820	22,285	6,465	0.000	15.820	22,285
HEALTH PHYSICS PERSONNEL	0	0	0	0	0.000	0.000	0.095	0.095	0.000	0.095	0.000	0.095
SUPERVISORY PERSONNEL	0	0	0	0	0.010	0.040	0.000	0.050	0.010	0.040	0.000	0.050
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	11	0	26	37	9,400	0.975	16.070	26,445	9,400	0.975	16.070	26,445
REFUELING	25	72	22	119	10,975	26,035	6.100	37,110	10,975	26,035	6.100	37,110
MAINTENANCE PERSONNEL	32	0	0	32	14,025	0.000	0.000	14,025	14,025	0.000	0.000	14,025
OPERATING PERSONNEL	10	0	33	43	3,850	0.000	15.695	19,545	3,850	0.000	15.695	19,545
HEALTH PHYSICS PERSONNEL	2	0	0	2	0.740	0.000	0.085	0.825	0.740	0.000	0.085	0.825
SUPERVISORY PERSONNEL	4	10	0	14	0.760	2.461	0.665	3.881	0.760	2.461	0.665	3,881
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	73	82	55	210	30,350	28,496	22.545	81,391	30,350	28,496	22.545	81,391
TOTAL BY JOB FUNCTION	82	236	114	432	40,487	94,737	81.756	135,980	40,487	94,737	81.756	135,980
MAINTENANCE PERSONNEL	83	0	0	83	31,937	0.000	0.030	31,967	31,937	0.000	0.030	31,967
OPERATING PERSONNEL	53	0	120	173	30,268	0.000	62.725	92,993	30,268	0.000	62.725	92,993
HEALTH PHYSICS PERSONNEL	9	0	0	9	9,440	0.000	0.390	9,830	9,440	0.000	0.390	9,830
SUPERVISORY PERSONNEL	11	23	8	42	9,668	7,296	7.470	24,434	9,668	7,296	7.470	24,434
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	238	259	242	739	121,800	102,033	152.371	376,204	121,800	102,033	152.371	376,204

* Workers may be counted in more than one category.

Appendix D (cont.)
 NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION
 1984

PLANT: ZION 1,2 (PMR)	NUMBER OF PERSONNEL (>100 M-REM)				TOTAL				TOTAL MAN-REMS		
	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSONS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT & OTHERS	PERSONS	UTILITY EMPLOYEES	CONTRACT & OTHERS	TOTAL MAN-REMS
WORK & JOB FUNCTION											
REACTOR OPERATIONS & SURV.											
MAINTENANCE PERSONNEL	40	0	0	0	0.010	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	45	0	11	11	4.000	0.000	0.000	0.000	0.000	1.570	1.570
HEALTH PHYSICS PERSONNEL	9	0	12	12	3.750	0.000	0.000	0.000	0.000	2.300	2.300
SUPERVISORY PERSONNEL	93	0	0	0	2.600	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	30	0	0	0	7.454	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	217	0	23	240	17.814	0.000	0.000	0.000	0.000	3.870	21.684
ROUTINE MAINTENANCE											
MAINTENANCE PERSONNEL	52	0	411	411	74.041	0.000	0.000	0.000	0.000	227.073	227.073
OPERATING PERSONNEL	23	0	0	0	16.650	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	15	0	72	72	13.026	0.000	0.000	0.000	0.000	52.790	52.790
SUPERVISORY PERSONNEL	71	0	0	0	9.260	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	19	139	84	84	5.264	1.230	1.230	1.230	1.230	5.305	5.305
TOTAL	180	139	567	886	118.241	1.230	1.230	1.230	1.230	285.168	404.639
IN-SERVICE INSPECTION											
MAINTENANCE PERSONNEL	0	0	28	28	0.000	0.000	0.000	0.000	0.000	22.000	22.000
OPERATING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	0	0	9	9	0.000	0.000	0.000	0.000	0.000	4.650	4.650
SUPERVISORY PERSONNEL	18	0	0	0	2.350	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	4	0	40	40	3.450	0.000	0.000	0.000	0.000	8.040	8.040
TOTAL	22	0	77	99	5.800	0.000	0.000	0.000	0.000	34.690	40.490
SPECIAL MAINTENANCE											
MAINTENANCE PERSONNEL	31	83	372	372	16.000	1.237	1.237	1.237	1.237	172.000	172.000
OPERATING PERSONNEL	17	0	0	0	3.650	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	43	43	1.450	0.000	0.000	0.000	0.000	18.650	18.650
SUPERVISORY PERSONNEL	24	0	0	0	4.500	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	4	83	42	42	2.340	0.460	0.460	0.460	0.460	9.320	9.320
TOTAL	80	166	457	703	27.940	1.697	1.697	1.697	1.697	199.970	229.607
WASTE PROCESSING											
MAINTENANCE PERSONNEL	0	0	17	17	0.000	0.000	0.000	0.000	0.000	2.400	2.400
OPERATING PERSONNEL	18	0	0	0	2.150	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	4	0	3	3	1.050	0.000	0.000	0.000	0.000	1.420	1.420
SUPERVISORY PERSONNEL	9	0	0	0	0.650	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	0	0	0	0	0.000	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	31	0	20	51	3.850	0.000	0.000	0.000	0.000	3.820	7.670
REFUELLING											
MAINTENANCE PERSONNEL	31	0	0	0	32.000	0.000	0.000	0.000	0.000	0.000	0.000
OPERATING PERSONNEL	17	0	0	0	0.695	0.000	0.000	0.000	0.000	0.000	0.000
HEALTH PHYSICS PERSONNEL	3	0	0	0	3.850	0.000	0.000	0.000	0.000	0.000	0.000
SUPERVISORY PERSONNEL	11	0	0	0	3.700	0.000	0.000	0.000	0.000	0.000	0.000
ENGINEERING PERSONNEL	3	0	0	0	1.260	0.000	0.000	0.000	0.000	0.000	0.000
TOTAL	65	0	0	65	41.505	0.000	0.000	0.000	0.000	0.000	41.505
TOTAL BY JOB FUNCTION											
MAINTENANCE PERSONNEL	154	83	828	1065	122.051	1.237	1.237	1.237	1.237	423.473	546.761
OPERATING PERSONNEL	120	0	11	131	27.145	0.000	0.000	0.000	0.000	1.570	28.715
HEALTH PHYSICS PERSONNEL	35	0	139	174	23.126	0.000	0.000	0.000	0.000	79.810	102.936
SUPERVISORY PERSONNEL	226	0	0	226	23.060	0.000	0.000	0.000	0.000	0.000	23.060
ENGINEERING PERSONNEL	60	222	166	448	19.768	1.690	1.690	1.690	1.690	22.665	44.123
GRAND TOTAL	595	305	1144	2044	215.150	2.927	2.927	2.927	2.927	527.518	745.595

* Workers may be counted in more than one category.
 a NRC mandated special maintenance contributed 230 man-rems.

APPENDIX E
Summary of Annual Whole Body Dose Distributions
by Year and Reactor Type
1980 - 1984

* Appendix E
 SUMMARY OF ANNUAL WHOLE BODY DOSE DISTRIBUTIONS BY YEAR AND REACTOR TYPE
 1980 - 1984

Year and Reactor Type	Number of Individuals with Whole Body Doses in the Following Range (rems or cSv)													Total Number Monitored	Number with Measurable Doses	Collective Dose (person-rems or person-cSv)			
	No Measurable Exposure	Measurable <0.10	0.10 - 0.25	0.25 - 0.50	0.50 - 0.75	0.75 - 1.0	1.0 - 2.0	2.0 - 3.0	3.0 - 4.0	4.0 - 5.0	5.0 - 6.0	6.0 - 7.0	7.0 - 8.0				8.0 - 9.0	9.0 - 10.0	10.0 - 12.0
1984 - BWRs	21741	14997	6165	4907	3033	2398	5679	2714	994	218							62846	41105	27074
1984 - PWRs	37875	24887	8599	6585	4133	2998	6774	2253	681	77							94862	56987	28140
1984 - LWRs	59616	39884	14764	11492	7166	5396	12453	4967	1675	295							157708	98092	55214
1983 - BWRs	17721	10475	4317	4036	2607	1925	5659	2890	1252	299	63	16	4				51194	33473	27455
1983 - PWRs	33350	21425	7894	6260	3863	2783	6512	2421	698	315	2						85523	52173	29016
1983 - LWRs	51071	31900	12211	10296	6470	4708	12171	5311	1950	544	65	16	4				136717	85646	56471
1982 - BWRs	15661	9944	4431	4403	2839	2046	4794	2358	1183	230	7						47896	32235	24437
1982 - PWRs	29232	21536	8262	6411	3900	2749	6061	2328	631	202	49	13	4	0	1		81378	52146	27753
1982 - LWRs	44893	31480	12693	10814	6739	4795	10855	4686	1814	432	56	13	4	0	1		129275	84381	52190
1981 - BWRs	15345	11130	4869	4536	2939	2326	5373	2485	911	224	32	4	2	0	0	1	50177	34832	25471
1981 - PWRs	26978	18202	7348	5790	3686	2577	6393	2061	882	262	61	77	9	2	1		74329	47351	28671
1981 - LWRs	42323	29332	12217	10326	6625	4903	11766	4546	1793	486	93	81	11	2	1		124506	82183	54142
1980 - BWRs	13971	9765	4671	4283	2803	2090	5884	2831	1073	503	129	60	2				48065	34094	29530
1980 - PWRs	33406	19873	7079	5537	3275	2428	5590	1684	464	183	63	38	16	3			79643	46237	24266
1980 - LWRs	47377	29638	11750	9820	6082	4518	11474	4515	1537	686	192	98	18	3			127708	80331	53796

* Figures contained herein are uncorrected for multiple reporting of transient individuals.

BIBLIOGRAPHIC DATA SHEET

NUREG-0713, Vol. 6

SEE INSTRUCTIONS ON THE REVERSE

2. TITLE AND SUBTITLE

Occupational Radiation Exposure at Commercial Nuclear
Power Reactors and Other Facilities 1984
Seventeenth Annual Report

3. LEAVE BLANK

4. DATE REPORT COMPLETED

MONTH

YEAR

June

1986

6. DATE REPORT ISSUED

MONTH

YEAR

October

1986

5. AUTHOR(S)

Barbara Brooks

7. PERFORMING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)

Division of Regulatory Applications
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

8. PROJECT/TASK/WORK UNIT NUMBER

9. FIN OR GRANT NUMBER

10. SPONSORING ORGANIZATION NAME AND MAILING ADDRESS (Include Zip Code)

Division of Regulatory Applications
Office of Nuclear Regulatory Research
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

11a. TYPE OF REPORT

Annual

b. PERIOD COVERED (Inclusive dates)

1984

12. SUPPLEMENTARY NOTES

13. ABSTRACT (200 words or less)

This report summarizes the occupational radiation exposure information that has been reported to the NRC's Radiation Exposure Information Reporting System (REIRS) by nuclear power facilities and certain other categories of NRC licensees during the years 1969 through 1984. The bulk of the data presented in the report was obtained from annual radiation exposure reports submitted in accordance with the requirements of 10 CFR 20.407. Data on workers terminating their employment at certain NRC licensed facilities were obtained from reports submitted pursuant to 10 CFR 20.408. The 1984 annual reports submitted by about 500 licensees indicated that approximately 195,000 individuals were monitored, 171,000 of whom were monitored by nuclear power facilities. They incurred an average individual dose of 0.30 rem (cSv) and an average measurable dose of 0.55 rem (cSv). Termination radiation exposure reports were analyzed to reveal that about 67,500 individuals completed their employment with one or more of the 500 covered licensees during 1984*. Some 66,100 of these individuals terminated from power reactor facilities, and about 5,500 of them were considered to be transient workers who received an average dose of 0.91 rem (cSv).

*These figures may be incomplete because data for about 15% of the individuals terminating during 1984 has not been entered into REIRS.

14. DOCUMENT ANALYSIS - a. KEYWORDS/DESCRIPTORS

occupational radiation exposure
industrial radiography
power reactors transient workers
collective dose fuel fabricators
average dose

b. IDENTIFIERS/OPEN-ENDED TERMS

15. AVAILABILITY STATEMENT
Unlimited

16. SECURITY CLASSIFICATION
(This page)
Unclassified
(This report)
Unclassified

17. NUMBER OF PAGES

18. PRICE

**UNITED STATES
NUCLEAR REGULATORY COMMISSION
WASHINGTON, D.C. 20555**

**OFFICIAL BUSINESS
PENALTY FOR PRIVATE USE, \$300**

**SPECIAL FOURTH-CLASS RATE
POSTAGE & FEES PAID
USNRC
WASH. D.C.
PERMIT No. G-67**