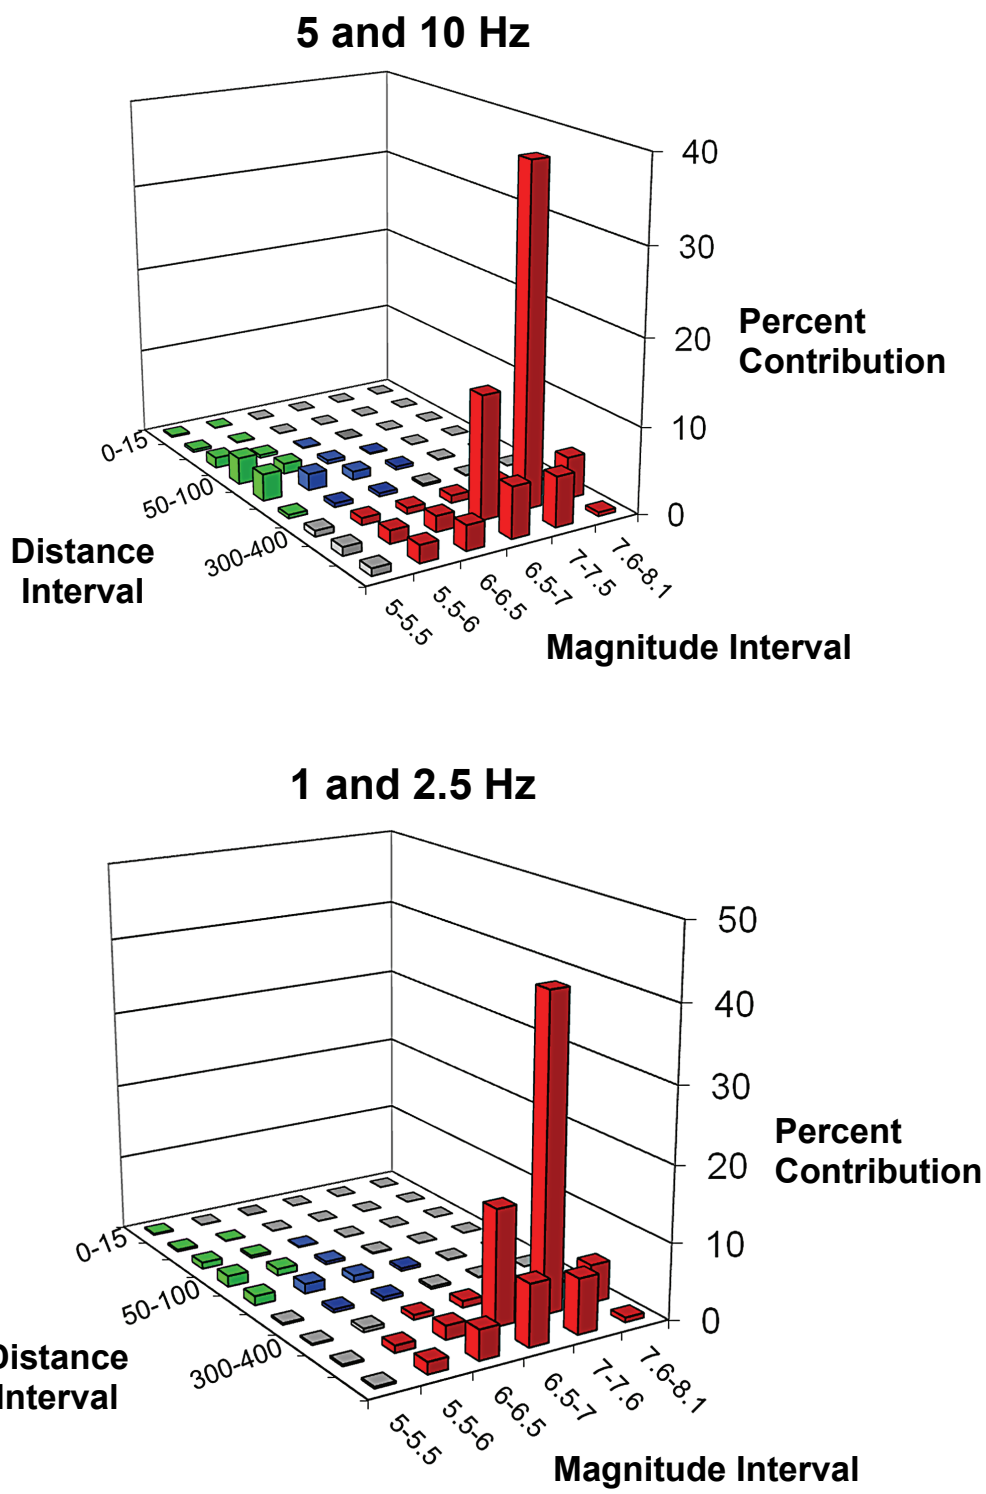

Progress Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 2, Final Safety Analysis Report

Deaggregation of Mean 10^{-3} Hazard from CEUS SSC Model

FIGURE 2.5.2-341 Rev 5