



September 18, 2012

Document Control Room
U.S. Nuclear Regulatory Commission
Two White Flint North
11545 Rockville pike
(Mail Code: 03H8)
Rockville, Maryland 20852-2738

RE: University of Michigan - Ford Nuclear Reactor
Final Disposition of FNR Storage Ports
Docket 50-2 / License R-28

Decommissioning Branch:

Please find enclosed a draft copy of the Final Disposition of the Below-Grade Storage Ports report to be used in conjunction with the Final Status Survey (FSS) of the University of Michigan – Ford Nuclear Reactor (License R-28 / Docket 50-2). A final copy of this report will be submitted along with the final FSS report.

Thank you for your time, effort, and consideration with respect to your review of this FSS-related document. Please do not hesitate to contact me at OSEH / Radiation Safety Service [(734) 647-2251] should you have any questions or comments regarding this draft copy of the Final Disposition of the FNR Storage Ports report.

Sincerely,

A handwritten signature in black ink that reads "Mark L. Driscoll".

Mark L. Driscoll
Director / Radiation Safety Officer
Radiation Safety Service / OSEH

MLD/mld
NRCFNRD&DFSSQAPlan091712.doc

cc: Terry Alexander, Executive Director, OCS
Robert Blackburn, Manager, Laboratory Operations, MMPP
Theodore Smith, FNR Project Manager, NRC Headquarters (Mailstop T-8F5)
FNR Decommissioning Files

A handwritten note in black ink that reads "FSGME 2D".



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

DRAFT

Ford Nuclear Reactor Facility Final Disposition of the Storage Ports

February 24, 2012

Submitted By:

FNR Decommissioning Project Director

Date

Final Approval:

Chairman, Decommissioning Review Committee

Date



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Table of Contents

Executive Summary	3
Description of the Storage Ports Construction and Use.....	5
Characterization of the Storage Ports	9
<i>Characterization of Storage Port Internal Contamination.....</i>	9
<i>Determination of DCGLs for the Neutron Activated Soil around Storage Port 1</i>	10
<i>Characterization of Neutron Activated Soil around Storage Port 1.....</i>	13
<i>Characterization of Neutron Activated Concrete around Storage Port No. 1</i>	15
Storage Port and Contaminated Soil Removal Activity	17
<i>Removal of Storage Port Vent Lines</i>	18
<i>Removal of Storage Ports and Concrete Support Wall</i>	19
Final Status Confirmation Surveys	20
<i>Free Release Survey of Sections of Storage Ports Remaining in the FNR Wall.....</i>	22
<i>Soil and Concrete Survey and Analysis around Storage Port No. 1</i>	23
<i>Final Status Survey Conclusion</i>	25
NRC Confirmation Surveys.....	25
Appendices under Separate Cover	27

A	Pre-Removal Internal Characterization of the Storage Ports
B	Analytical Data for Activated Soil Characterization around Storage Port No. 1
C	Pre-Excavation Soil Analysis around Storage Port No. 1
D	Analysis of Concrete Support Wall around Storage Port No. 1 Eberline Analytical
E	Storage Port Vent Lines Survey Data Sheet
F	Radiological Survey and Swipe Analysis for Storage Port Ends Remaining in FNR Wall
G	Radiological Survey Report of Excavation Zone Former Storage Port No. 1 Location
H	Analytical Data for Final Status Survey of Soil Located Behind the Section of Support Wall Removed
I	Analytical Data for Final Status Survey of Soil Located Behind the Section of Support Wall Removed
J	Analytical Results from Eberline Analytical for Final Status Survey of the Soil under the Former Storage Port No. 1
K	ORISE Confirmation Samples Collected by NRC



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Executive Summary

Fifty storage ports extended through the west wall of the first floor of the reactor and were designed for and used to store beam port plugs, collimators or other equipment from the beam ports. The storage ports were also used to store items with elevated dose readings. The storage ports consisted of forty-two 6" and eight 8" schedule 40 carbon steel pipes that extended 8'-10" into the soil; terminating into an 8" thick concrete wall providing structural support for the pipes ends. The storage ports were arranged in three levels.

Of specific interest was Storage Port No. 1 that was used to store two large Pu²³⁸Be sources from approximately November 1971 to February 2003 when they were relocated to another U-M facility in preparation for decommissioning the reactor facility. These Pu²³⁸Be sources were capable of producing approximately 1.7E+8 neutrons sec⁻¹ which would be spread in all directions. The other ports were used for storing materials that would not produce a neutron flux capable of activating surrounding soil materials. Therefor the primary areas of concern during the remediation efforts were from:

- Contaminated surfaces and debris inside the storage ports from reactor equipment
- Activated soils surrounding Storage Port No. 1
- Concrete surfaces that may have been within the radius of influence from the Pu²³⁸Be sources in Storage Port No. 1 and become partially activated

During November/December 2008 excavation activity was undertaken to expose the storage ports to facilitate their removal. Activities involved:

- Installation of sheet piling to establish the northern, western and southern limits of the approximately 10' by 52' excavation.
- Excavation from the ground surface down to the bottom of the east/west running storage port pipes at a depth of approximately 13'. All excavated soil from storage ports 4 through 50 was stockpiled for re-use in backfilling the excavation zone. Soil from around storage ports 1 through 3 was removed for disposal.
- The seventeen one inch vent lines and 50 six and eight inch storage ports were cut and removed in a controlled manner.
- The concrete support wall around Storage Port Nos. 1 through 3 was cut and removed from the excavation for disposal.

With the excavation completed and the storage ports all removed, the project moved into a final status survey mode to confirm the ability to backfill and close the site. This involved radiological surveys of the excavation zone where the Pu²³⁸Be sources had been stored in Storage Port No. 1, confirmation soil samples of the area under the former Storage Port No. 1 and to the west of the area where the concrete support wall had been removed, and confirmation of the remaining concrete support wall. In addition, all of the storage port ends remaining in the wall into the FNR facility were surveyed for free release to allow them to remain in place.

The surveys and analytical work performed on remaining soil and the concrete support wall have not identified contamination remaining in the excavation associated with the operation of the storage ports, in particular Storage Port No. 1 that had been used to house high level neutron sources in the form of Pu²³⁸Be. The final status survey supports the conclusion that all remedial



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

activity has been adequately completed to comply with the Default Screening Values of Table 6.91 in NUREG 5512.

On Monday, March 25, 2009 the NRC visited the FNR facility to conduct confirmatory sampling of the storage port soil and concrete for their independent analysis. The NRC radiological analyses of the soil concurred with the analyses conducted by the FNR staff and Eberline Analytical. The excavation was subsequently backfilled.



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Description of the Storage Ports Construction and Use

Fifty storage ports extended through the west wall of the first floor of the reactor and were designed for and used to store beam port plugs, collimators or other equipment from the beam ports. The storage ports were also used to store items with elevated dose readings. The storage ports consisted of forty-two 6" and eight 8" schedule 40 (1/4" wall thickness) carbon steel pipes that extended 8'-10" into the soil; terminating into an 8" thick, 10'-9" tall concrete wall providing structural support for the pipes ends. The storage ports were arranged in three levels with the top and bottom levels aligned vertically and the middle level staggered horizontally between adjacent pairs. The configuration resulted in 17 storage ports in the top row, 17 storage ports in the middle row, and 16 storage ports in the bottom row. The storage ports are numbered one through fifty going from south to north and top to bottom (see Figure 1).

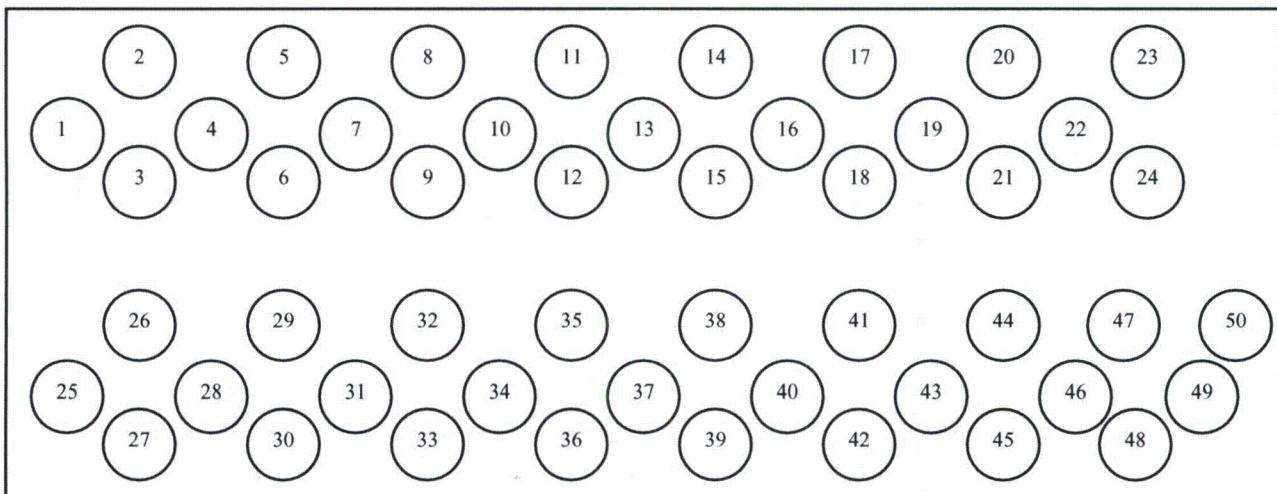


Figure 1, Storage Ports numbering system starting with no. 1 to the south and ending with no. 50 to the north (note they are shown stacked here only for convenience of illustration)

Each storage port had a 1/2" vent line attached near the end of the pipe to provide for air passage into or out of the storage port as the tight fitting beam port plugs, collimators or other equipment were inserted or withdrawn. With the exception of the storage ports at the north and south ends, the vents lines from three storage ports (one each from the top, middle, and bottom rows) were connected to a common vent line using "Y" fittings, and increasing from 1/2 inch pipe at the lowest storage port to 1 inch pipe at the upper storage port (see Figures 2 and 3). The common vent line then turned horizontal and ran parallel to and 3'-6" above the upper storage port to return through the west wall of the reactor building for connection to the Stack 2 exhaust system. The north and south end upper and lower storage ports were connected to common vent lines and run into the west wall of the facility in a similar manner.



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

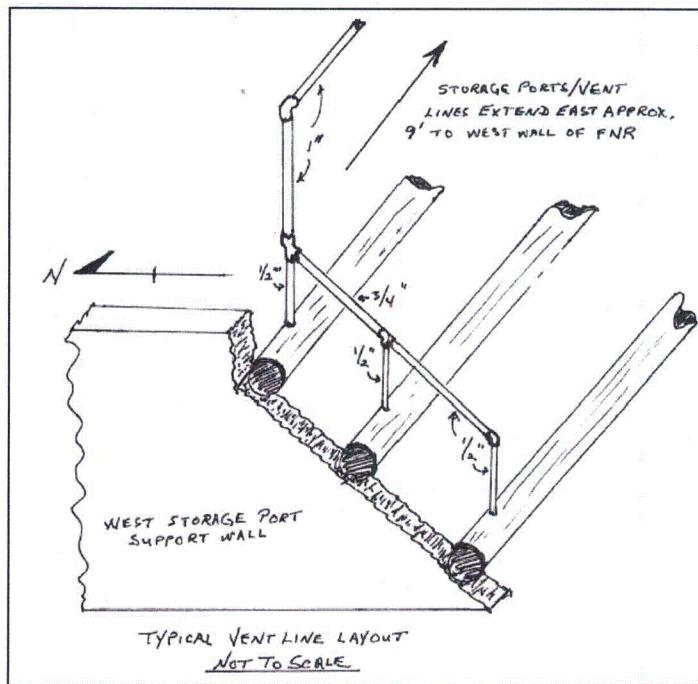


Figure 2, Typical Vent Line Layout for the Storage Ports

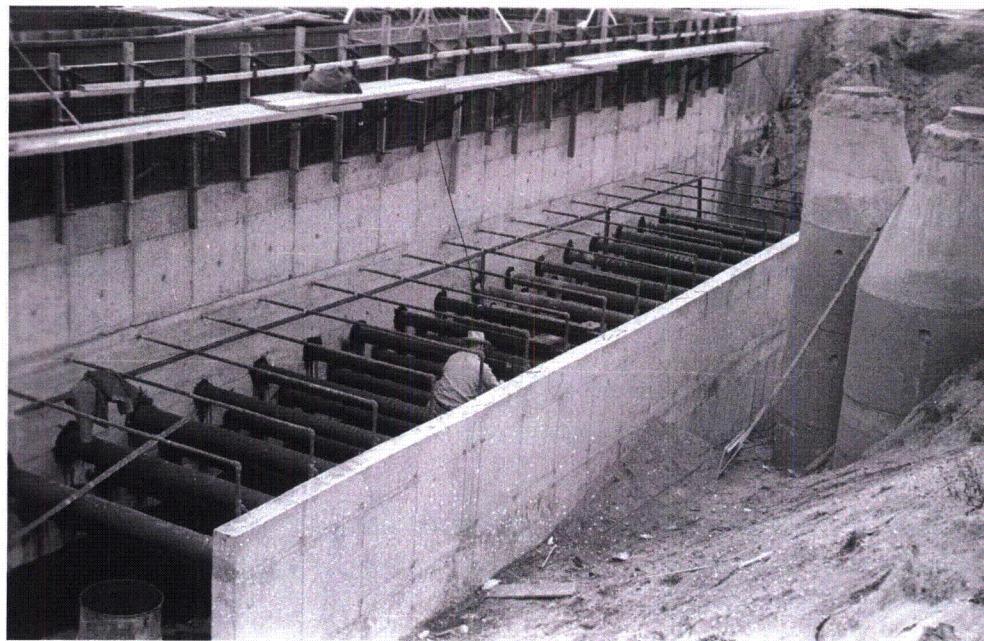


Figure 3, Storage Ports under Construction – view from NW looking toward SE

The entire installation of storage ports was buried along the west wall of the reactor building, running south to north 48'. The vent lines were located approximately 7'-10" below ground surface, the top row of storage ports were located approximately 10'-2" below ground surface, and the bottom row of storage ports were located approximately 12'-10" below ground surface. (See Figures 4 through 7)



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

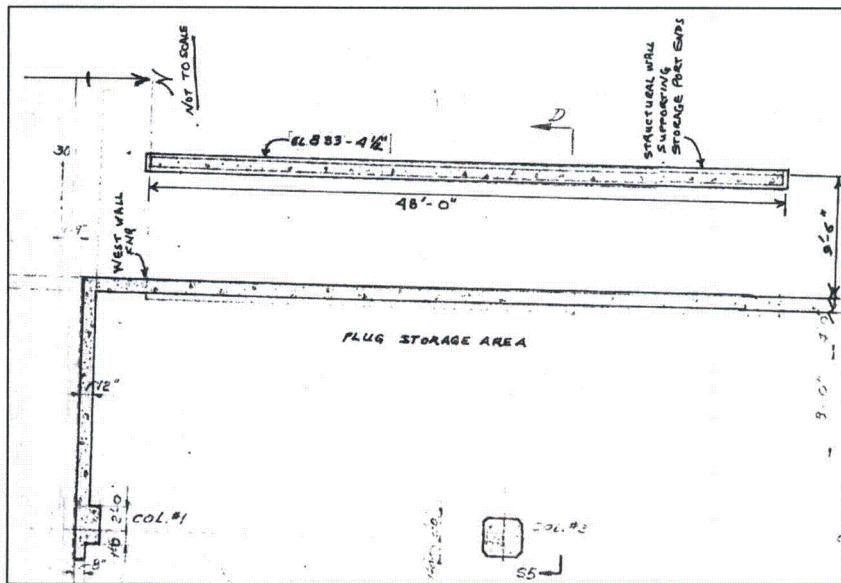


Figure 4, Plan view of Storage Port design (January 1958)



Figure 5, Storage Ports under Construction – view from NE corner looking toward SW and showing location of Storage Port No. 1



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

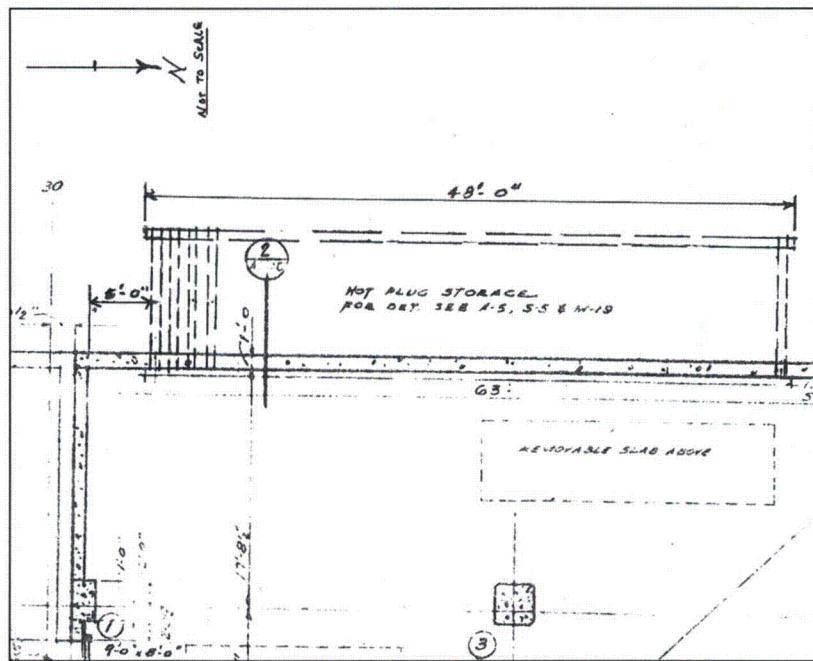


Figure 6, Plan view of Storage Port design (January 1958)

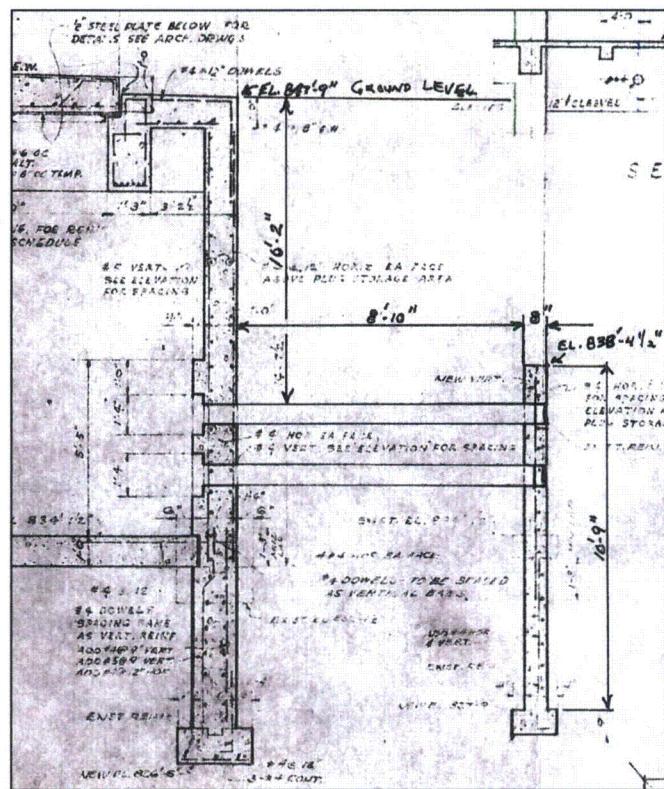


Figure 7, Section view of Storage Port design looking from north to south (January 1958)



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Characterization of the Storage Ports

The 50 storage ports were designed for and used to store beam port plugs, collimators or other equipment from the beam ports as well as items with elevated dose readings. Of specific interest was Storage Port No. 1 that was used to store two large Pu²³⁸Be sources from approximately November 1971 to February 2003 when they were relocated to another U-M facility in preparation for decommissioning the reactor facility. These Pu²³⁸Be sources were capable of producing approximately 1.7E+8 neutrons sec⁻¹ (from the paper work provided by Monsanto with the sources) which would be spread 4π from the source in all directions such that at 8 cm from the source, neutron flux in air would be approximately 6E+5 neutrons cm² sec⁻¹. The other ports were used for storing materials that would not produce a neutron flux capable of activating surrounding soil materials. Therefor the primary areas of concern during the remediation efforts were from:

- Contaminated surfaces and debris inside the storage ports from reactor equipment
- Activated soils surrounding Storage Port No. 1
- Concrete surfaces that may have been within the radius of influence from the Pu²³⁸Be sources in Storage Port No. 1 and become partially activated

Characterization of Storage Port Internal Contamination

To determine internal contamination of the ports, survey work was performed using one minute static gamma measurements at approximately 9" intervals from the entrance to the back of each of the storage ports using a Ludlum 44-10 2" by 2" NaI detector (serial no. 24815). The detector was placed in a 6" or 8" cradle specifically constructed to center the NaI detector in each 6" or 8" storage port. The detector was then connected using a 20' R-59 cable to a Ludlum 2221 Scaler Ratemeter (serial no. 218602). The gross count measurements for each storage port are summarized in Table 1 below with additional data and plots of gross gamma counts as a function of position for each storage port provided in Appendix A (separate binder).

From these measurements, the following observations were made:

- Storage Port No. 1: The activation of the carbon steel wall of by the Pu²³⁸Be sources yielded a peak activity approximately 2' in from the end of the storage port. This agreed with operational knowledge that the Pu²³⁸Be sources were stored approximately one to two feet from the end of the storage port. Removable activity was found at one survey point.
- Storage Port No. 10: The high gamma measurement at the end indicated that there was a piece of activated metal stored at the very end of the storage port and that piece of metal potentially had a high specific activity. Subsequent visual inspection by camera did not identify a source of the elevated measurements. Removable activity was found at three survey points.
- Storage Port No. 48: The high gamma measurement 1' from the end indicated that there may be a piece of activated metal that required removal. Subsequent visual inspection by camera did not identify a source of the elevated measurements. Removable activity was found at three survey points.
- Storage Port No. 12, 13, 26, 29-49: Removable activity was found at various survey points.



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Table 1, Storage Port pre-removal survey results summary

Port Number	Highest Gross CPM During Scan	Highest Smear in dpm/100cm ²	Port Number	Highest Gross CPM During Scan	Highest Smear in dpm/100cm ²
Port 1	2400 @ 8 ft	121	Port 26	1200 @ 7 ft	45
Port 2	600 @ 10 ft	<MDA	Port 27	300-350	<MDA
Port 3	300-350	<MDA	Port 28	300-350	<MDA
Port 4	300-350	<MDA	Port 29	1000 @ 6.5 ft	33
Port 5	586 @ 5 ft	<MDA	Port 30	300-350	1220
Port 6	800 @ 5.5 ft	<MDA	Port 31	300-350	37
Port 7	300-350	<MDA	Port 32	1300 @ 10 ft	205
Port 8	300-350	<MDA	Port 33	1400 @ 5 ft	71
Port 9	300-350	<MDA	Port 34	300-350	5.80 α only
Port 10	52,000 @ 9 ft	96	Port 35	3000 @ 8 ft	83
Port 11	300-350	<MDA	Port 36	3000 @ 8 ft	343
Port 12	400-450	73	Port 37	300-350	31
Port 13	1000 @ 5 ft	1078	Port 38	600 @ 7 ft	60
Port 14	300-350	<MDA	Port 39	300-350	140
Port 15	300-350	<MDA	Port 40	370 @ 10 ft	31
Port 16	300-350	<MDA	Port 41	1700 @ 6 ft, 600 @ 9 ft	79
Port 17	400-450	<MDA	Port 42	500-600 all	92
Port 18	300-350	<MDA	Port 43	4300 @ 6ft	73
Port 19	300-350	<MDA	Port 44	300-350	22
Port 20	1000 4-10 ft	<MDA	Port 45	1100 @ 9 ft	690
Port 21	300-350	<MDA	Port 46	300-500 all	119
Port 22	300-350	<MDA	Port 47	300-350	25
Port 23	300-350	<MDA	Port 48	1300-9200 @ 10 ft	217
Port 24	300-350	<MDA	Port 49	5000 @ 10 ft	58
Port 25	300-350	<MDA	Port 50	400-700 all	<MDA

No feasible method could be identified that would allow characterization of the small diameter vent lines in order to leave them in place. Based on the need to remove the vent lines and the three storage ports with elevated measurements, it was determined the most expeditious route was to remove all storage ports for disposal.

Determination of DCGLs for the Neutron Activated Soil around Storage Port 1

Soil samples were collected north of the storage port area in November 2008 to determine a background concentration for the isotopes of concern in the soil near Storage Port No. 1 that may have become activated due to proximity to the Pu²³⁸Be sources. Using a 2 inch diameter dual tube direct push soil sampler, three samples were collected from a depth of 8 feet to 12 feet below the surface (the approximate depth of the storage ports) at a point north of Storage Port No. 50. The soil samples were collected in acetate liners and processed following ASTM (2005) C 999, *Soil Sample Preparation for the Determination of Radionuclides*. The material from the three acetate tubes was dried for two days at 110 degrees C until reaching a constant weight. The sample material from the three samples was combined into one sample, UM2008-11-06-01. The sample was split then into two portions using an ELLE sample splitter and 186 grams of



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

sample material from the first split was sent to Oregon State University for determination of the content of the soil using Instrumental Neutron Activation Analysis (INAA) (refer to the following site for information:

http://serc.carleton.edu/research_education/geochemsheets/techniques/INAA.html.

The purpose of the Oregon State University analyses was two-fold: first to determine the elemental composition of the soil, and second to give an indication of what radio-isotopes might stand out given exposure to a higher neutron flux rate. In addition it was suspected that certain other elements of possible concern may be present in the soil at levels not detected by the Oregon State University analyses; in particular, tin, molybdenum, and certain of the rare earth elements (REE). Gerhard Erdtmann, Neutron Activation Tables, 1976 was consulted based on the Oregon State University results and the suspect elements to determine what additional radioisotopes might have been produced by neutron activation of the soil. Only those radio-isotopes with a half-life greater than 100 days and absorption cross section of milli-barns or larger were considered in the analysis as others would be present at levels approximately 10E-9 pCi/g or lower.

It was necessary to make reasonable assumptions about the suspect elements concentrations in the soil in order to calculate an estimated activity for their neutron activation products. Since it is known that the REE elements, with the exceptions of europium and cerium, behave geochemically in a predictable way¹, their behavior can be used to estimate the concentration of REEs of interest based on those that were detected in the Oregon State University analyses and the commonly accepted REE pattern in the upper continental crust (UCC) as reported by Taylor and McLennan².

Based on this analysis, the elemental concentration of metal with activation potential and the subsequent significant activation radionuclides and their estimated concentrations are listed in Table 2.

Table 2, Metals in soil with activation potential from Storage Port 1 Activity

Natural Element	Concentration	Activation Radionuclide	Target isotope % abundance	Activation Cross Section (barn)	Half Life (d-days, a-years)
Activation by Thermal Neutrons					
Iron	15325 µg/g	Fe-55	5.8	2.25	2.7 a
Europium	0.60 µg/g	Eu-152 Eu-154	47.8 52.2	5900 390	12.4 a 8.5 a
Cobalt	5.0µg/g	Co-60	100	37.2	5.272 a
Cesium	0.92 µg/g	Cs-134	100	29	2.06 a
Barium	292 µg/g	Ba-133	0.095	8.5	10.4 a
Cerium	26 µg/g	La-137 Ce-139	0.193 0.26	7.25 1.1	60,000 a 137.5 d

¹ Cornell University, Geol. 655 Isotope Geochemistry, Lecture 7, Spring 2003, GEOCHRONOLOGY III, THE SM-NND SYSTEM

² Taylor and McLennan, The Continental Crust: its Composition and Evolution, Blackwell Scientific Publications, 1985, Table 2.15 Chemical composition of the upper continental crust, p.46



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Chromium	5.0 $\mu\text{g/g}$	None ²	-	-	-
Antimony	0.53 $\mu\text{g/g}$	None ²	-	-	-
Hafnium	0.0044 $\mu\text{g/g}$	None ²	-	-	-
Neodymium	13 $\mu\text{g/g}$	Sm-151	5.62	1.2	93 a
Nickel	12 $\mu\text{g/g}$	Ni-59 Ni-63	67.88 3.66	4.6 14.2	75,000 a 100 a
Rubidium	42 $\mu\text{g/g}$	None ²	-	-	-
Scandium	4.7 $\mu\text{g/g}$	None ²	-	-	-
Strontium	202 $\mu\text{g/g}$	None ²	-	-	-
Tantalum	310 $\mu\text{g/g}$	Ta-182	99.998	21	115 d
Terbium	349 $\mu\text{g/g}$	None ²	-	-	-
Zinc	48 $\mu\text{g/g}$	Zn-65	48.9	0.78	243.7 d
Zirconium	160 $\mu\text{g/g}$	Zr-93	17.11	260×10^{-3}	1.5×10^6 a
Tin	5.5 $\mu\text{g/g}$	Sn-113	0.96	1.15	115.1 d
		Sn-119m	24.03	16×10^{-3}	245 d
		Sn-121m	32.85	1×10^{-3}	50 a
		Sn-123	4.72	180×10^{-3}	129.2 d
		Sm-145	3.1	0.7	340 d
Samarium	4.5 $\mu\text{g/g}$	Sm-151	7.4	102	93 a
		Eu-155	22.8	5.5	4.96 a
Gadolinium	3.8 $\mu\text{g/g}$	Gd-153	0.2	1100	241.5 d
Lutetium	0.32 $\mu\text{g/g}$	Lu-177m	2.6	7	161 d
Activation by Fast Neutrons					
Iron	15325 $\mu\text{g/g}$	Mn-54	5.8	82.5×10^{-3}	312.5 d
Barium	292 $\mu\text{g/g}$	Cs-134	2.42		
Hafnium	0.0044 $\mu\text{g/g}$	La-137	0.17	2.2×10^{-3}	1.37 a
Nickel	12 $\mu\text{g/g}$	Co-60		4.4×10^{-3}	5.272 a
Terbium	349 $\mu\text{g/g}$	Tb-158	100	3.2×10^{-3}	150 a
Molybdenum	1.5 $\mu\text{g/g}$	Tc-99	23.78	130×10^{-3}	2.15×10^5 a
Tin	5.5 $\mu\text{g/g}$	Sb-125	5.8	134×10^{-3}	2.77 a

² No activation product with a half-life of greater than 100 day or an absorption cross section smaller than millibarn.

The concentration of activity formed in the soil from a given element by activation of the neutrons from the Pu²³⁸Be source is described by the activation equation:

$$C_{\text{pCi/g}} = C_{\mu\text{g/g}} * \frac{0.6023 * a\%}{1 \times 10^6 * MW_{\text{g/mole}}} (\phi * \sigma_{a-\text{barns}}) * \left(1 - 2^{-\frac{t_{\text{irradiation}}}{T_{1/2}}} \right)_{\text{Buildup}} * \left(2^{-\frac{t_{\text{decay}}}{T_{1/2}}} \right)_{\text{Decay}}$$

Where:

- $C_{\mu\text{g/g}}$ is the concentration of the element in the soil surrounding the storage port
- $a\%$ is the abundance of the isotope of the radionuclide to be measured
- MW is the atomic weight of the element
- ϕ is the neutron flux from the Pu²³⁸Be source
- σ_a is the cross section for the corresponding reaction
- $t_{\text{irradiation}}$ is the length of time the soil was exposed to neutrons from the Pu²³⁸Be source
- t_{decay} is the length of time after the irradiation the soil decayed before being excavated
- $T_{1/2}$ is the half-life of the activation product



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

1,000 grams of sample material from the first split was placed into a 500 ml wide mouth Nalgene bottle and analyzed using the U-M high purity germanium (HPGe) detector. The HPGe was calibrated using a 2.09 g cm⁻³ epoxy, 500 ml Nalgene, multi-nuclide standard (Am-241 – 60 keV through Y-99 1836 keV). This sample analysis allows a determination of the isotopic concentration of the above nuclides to less than 25% of the concentration (pCi g⁻¹) that is equivalent to 25 mrem yr⁻¹ for various radio nuclides listed in Table 6.91 of NUREG 5512 Vol 3 (1999), *Residual Radioactive Contamination from Decommissioning – Parameter Analysis*. This sample serves as background for the analyses of the soil around Storage Port No. 1; results are shown in Tables 3 and 4. Analytical reports are available in Appendix B (separate binder).

Table 3, Nuclides of Concern in soil surrounding Storage Port No. 1

	Concentration (pCi g ⁻¹) equivalent to 25 mrem yr ⁻¹	EPA Consultation Trigger (pCi g ⁻¹) for Residual Soil Contamination	Typical MDA (pCi g ⁻¹) for 50,000 second analysis
Mn-54	13.9	69	3×10^{-2}
Fe-55	9,350	269,000	N/A
Co-60	3.68	4	3×10^{-2}
Ba-133			5×10^{-2}
Cs-134	5.36	16	3×10^{-2}
Eu-152	8.66	4	5×10^{-2}
Eu-154	8.0	5	5×10^{-2}

Table 4, Background soil analysis (sample no. UM2008-11-06-01) for Storage Port Area

Identified Radionuclide	Measured Concentration (pCi g ⁻¹)	Minimum Detectable Activity (pCi g ⁻¹)	Default Screening Values (pCi/ g ⁻¹)
Mn-54	Not Identified	1.77×10^{-2}	13.9
Fe-55	Not Identified	Not Detectable	9,350
Co-60	Not Identified	1.76×10^{-2}	3.68
Ba-133	Not Identified	2.73×10^{-2}	
Cs-134	Not Identified	1.90×10^{-2}	5.36
Eu-152	Not Identified	2.88×10^{-2}	8.66
Eu-154	Not Identified	2.05×10^{-2}	8.0

Characterization of Neutron Activated Soil around Storage Port 1

In September 2008 three soil samples were collected along Storage Port No. 1, approximately 1.5' from the end of the pipe where the Pu²³⁸Be sources had been stored. The purpose of these samples was to compare them to the radio-isotopes of concern identified in Tables 3 and 4 to determine if the soil had activation products that exceeded the Default Screening Values, requiring removal.

Using a 2 inch diameter dual tube direct push soil sampler, three sample tubes were collected at the two locations along Storage Port No. 1 from a depth of 8 feet to 12 feet below the surface. The soil from the third set of tubes (the approximate depth of the storage ports) was collected for analysis. The sample material from the two geo-probes was identified as sample numbers UM2008-11-20-01 and UM2008-11-20-02. In addition, a 6" hole was hand dug directly over



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

and down to Storage Port No. 1 where sample number UM2008-12-18-01 was collected. All samples were processed following ASTM (2005) C 999, *Soil Sample Preparation for the Determination of Radionuclides*. The material was dried for two days at 110 degrees C until reaching a constant weight. 1,000 grams of sample material from each was placed into 500 ml wide mouth Nalgene bottles and analyzed using the U-M high purity germanium (HPGe) detector calibrated using a 2.09 g cm⁻³ epoxy, 500 ml Nalgene, multi-nuclide standard (Am-241 – 60 keV through Y-99 1836 keV). Results shown in Table 5 indicate soil activation products from the Pu²³⁸Be source material that had been stored in the Storage Port No. 1. Analytical reports are in Appendix C (separate binder).

Table 5, Pre-excavation soil samples collected at Storage Port No. 1

Identified Radionuclide	Measured Concentration (pCi g ⁻¹) ³	Minimum Detectable Activity (pCi g ⁻¹)	Default Screening Values – Table 3 (pCi/ g ⁻¹)
Sample No. UM2008-11-20-02: Dual Tube sample 1.5' from end of Storage Port No. 1, along south side of port, depth at 8' to -11' [calculated unity factor of 0.03]			
Mn-54	1.31 x 10 ⁻²	1.30 x 10 ⁻²	13.9
Fe-55	1.6	-	9,350
Co-60	2.52 x 10 ⁻²	2.34 x 10 ⁻²	3.68
Ba-133	Not Identified	3.06 x 10 ⁻²	
Cs-134	Not Identified	2.14 x 10 ⁻²	5.36
Eu-152	0.257	4.08 x 10 ⁻²	8.66
Eu-154	Not Identified	2.63 x 10 ⁻²	8.0
Sample No. UM2008-11-20-01: Dual Tube sample 1.5' from end of Storage Port No. 1, along center line of port, depth at 8' to -12' [calculated unity factor of 0.04]			
Mn-54	Not Identified	1.96 x 10 ⁻²	13.9
Fe-55	1.6	-	9,350
Co-60	2.42 x 10 ⁻²	2.05 x 10 ⁻²	3.68
Ba-133	Not Identified	3.02 x 10 ⁻²	
Cs-134	Not Identified	2.11 x 10 ⁻²	5.36
Eu-152	0.194	3.78 x 10 ⁻²	8.66
Eu-154	Not Identified	2.53 x 10 ⁻²	8.0
Sample No. UM2008-12-18-01: Hand dug soil from within 6 inches of Storage Port No. 1 – [calculated unity factor of 0.37]			
Mn-54	<MDA	2.2 x 10 ⁻²	13.9
Fe-55	2.9	-	9,350
Co-60	0.462	2.61 x 10 ⁻²	3.68
Ba-133	Not Identified	3.19 x 10 ⁻²	
Cs-134	2.77 x 10 ⁻²	1.59 x 10 ⁻²	5.36
Eu-152	2.08	6.37 x 10 ⁻²	8.66
Eu-154	< MDA	5.35 x 10 ⁻²	8.00

Because the radionuclides are in a mixture, a sum-of-fractions calculation was performed on the samples to determine if the 25 mrem/yr equivalent had been exceeded in the soil. As shown in Table 5, the calculated unity factors ranged from 0.03 to 0.37. The samples indicate some activation of soil particles surrounding Storage Port No. 1 but not to the extent the soil exceeds the Default Screening Values of Table 6.91 in NUREG 5512.

³ Fe-55 Estimated by activation calculation bases upon measured Cu-152 and Co-60 concentrations

Because the default screening values are based on an assumption that there is at least a 1 meter separation between the activated soil and groundwater, a determination was made that the separation does exist. Based on data collected from a monitoring well located approximately 200' south of the storage port location, the groundwater zone was 25' (7.7 m) below the depth of Storage Port No. 1.

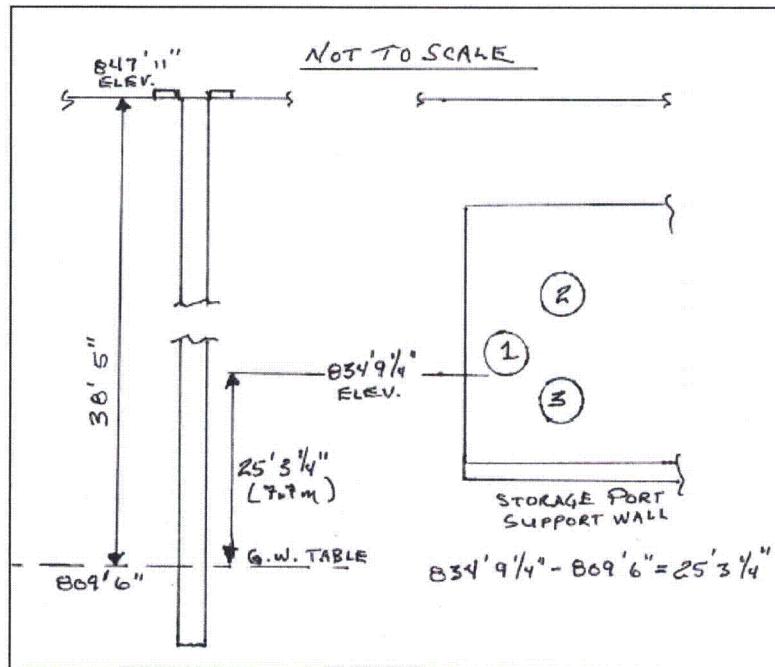


Figure 8, Depth to Groundwater Determination

Characterization of Neutron Activated Concrete around Storage Port No. 1

Samples of the concrete from the wall supporting the west end of Storage Port No. 1 were collected to analyze for isotopes that may have been activated by the storage of the Pu²³⁸Be sources approximately 1.5' from the end of the storage port. Two samples from the wall were collected after the storage port had been removed. The first was a circular pattern 12" diameter from the centerline of the storage port (UM2009-02-26-01) and the second was a circular pattern 18" diameter from the centerline (UM2009-03-04091). In each sample collection, a clean, 1" rotor-hammer bit was used to drill a series of holes approximately 7" deep in a circular pattern around the centerline of the storage port (see Figure 9).

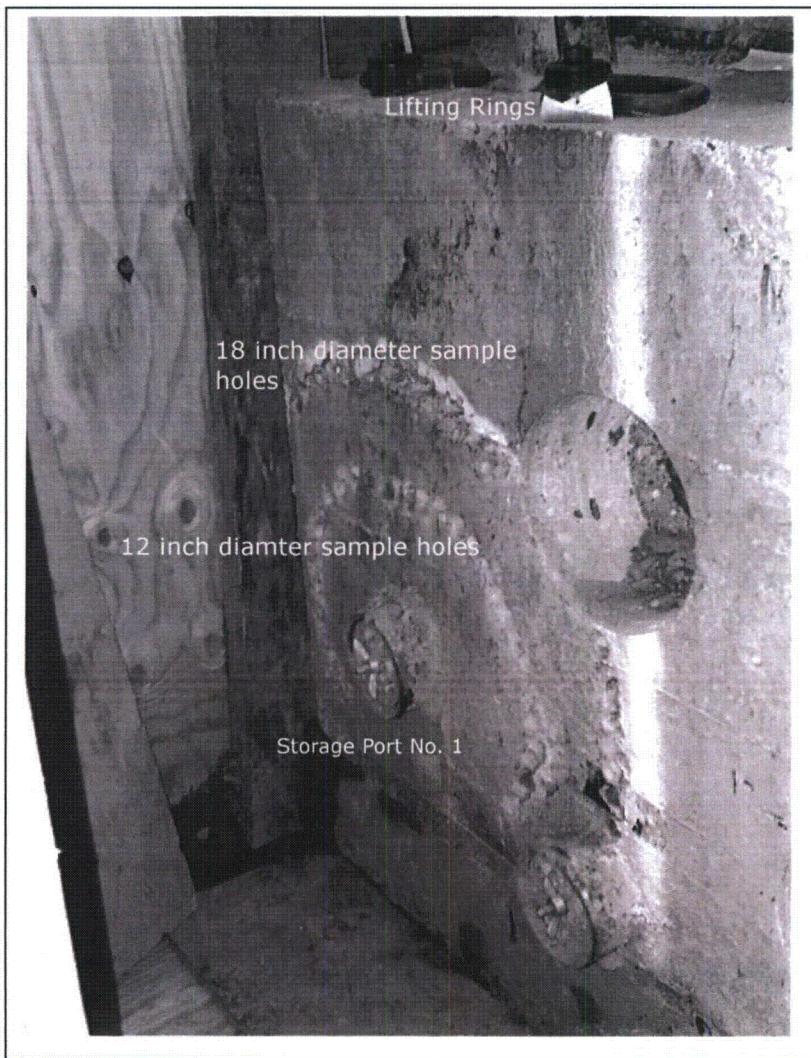


Figure 9, Concrete sampling around Storage Port 1 to check for activation products

Fines from the drilling operation were collected in a clean "Minute Man Vacuum" purchased specifically for the project. The fines were collected in a paper filter bag from which they were removed for analysis. A total of approximately 1.5 gallons of material were collected for each set of sample drill holes. The samples were submitted to Eberline Analytical for characterization and the results are shown in Table 6. Analytical data sheets are in Attachment D.

Table 6, Characterization of concrete around Storage Port No. 1 end cap (Analysis performed by Eberline)

Identified Radionuclide	Measured Concentration (pCi g^{-1})	Minimum Detectable Activity (pCi g^{-1})	Default Screening Values – Table 3 (pCi/ g^{-1})
Sample No. UM2009-02-26-01: Concrete wall 12" from centerline of Storage Port No. 1 [calculated unity factor of 0.37]			
Mn-54	<MDA	1.74×10^{-1}	13.9
Fe-55	1.48	11.4	9,350
Co-60	2.75×10^{-1}	9.66×10^{-2}	3.68



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Ag-108m	1.32×10^{-2}	9.07×10^{-2}	
Ba-133	6.89×10^{-2}	1.02×10^{-1}	
Cs-134	9.35×10^{-3}	1.05×10^{-1}	5.36
Eu-152	1.73	3.94×10^{-1}	8.66
Eu-154	7.48×10^{-2}	2.88×10^{-1}	8.0
Eu-155	3.23×10^{-1}	2.09×10^{-1}	282

Sample No. UM2009-03-04-01: Concrete wall 18" from centerline of Storage Port No. 1 [calculated unity factor of 0.1]			
Mn-54	2.33×10^{-2}	1.43×10^{-1}	13.9
Fe-55	<MDA	10.5	9,350
Co-60	8.9×10^{-2}	8.18×10^{-2}	3.68
Ag-108m	1.28×10^{-2}	6.94×10^{-2}	
Ba-133	<MDA	7.56×10^{-2}	
Cs-134	3.59×10^{-2}	8.61×10^{-2}	5.36
Eu-152	4.94×10^{-1}	6.03×10^{-1}	8.66
Eu-154	4.89×10^{-2}	2.18×10^{-1}	8.0
Eu-155	8.28×10^{-2}	1.76×10^{-1}	282

Results of the analysis indicate some activation of the concrete from the Pu²³⁸-Be neutron source but at levels below the Default Screening Values. Because the radionuclides are in a mixture, a sum-of-fractions calculation was performed on the samples to determine if the 25 mrem/yr equivalent had been exceeded in the concrete. Calculated sample unity factors were 0.37 and 0.1. The samples indicate some activation of concrete particles surrounding Storage Port No. 1 but not to the extent the concrete exceeds the Default Screening Values of Table 6.91 in NUREG 5512. A decision was made to cut the concrete section of the wall from around Storage Port No. 1 for disposal.

Storage Port and Contaminated Soil Removal Activity

During November/December 2008 excavation activity was undertaken to expose the storage ports to facilitate their removal. Activities involved:

- Installation of sheet piling to establish the northern, western and southern limits of the approximately 10' by 52' excavation (the eastern limit of the excavation was established by the western wall of the building) as shown on figure 10.
- Excavation from the ground surface down to the bottom of the east/west running storage port pipes at a depth of approximately 13'. All excavated soil from storage ports 4 through 50 was stockpiled for re-use in backfilling the excavation zone. Soil from around storage ports 1 through 3 was removed for disposal.
- The seventeen one inch vent lines and 50 six and eight inch storage ports were cut and removed in a controlled manner.
- The concrete support wall around Storage Port Nos. 1 through 3 was cut and removed from the excavation for disposal.

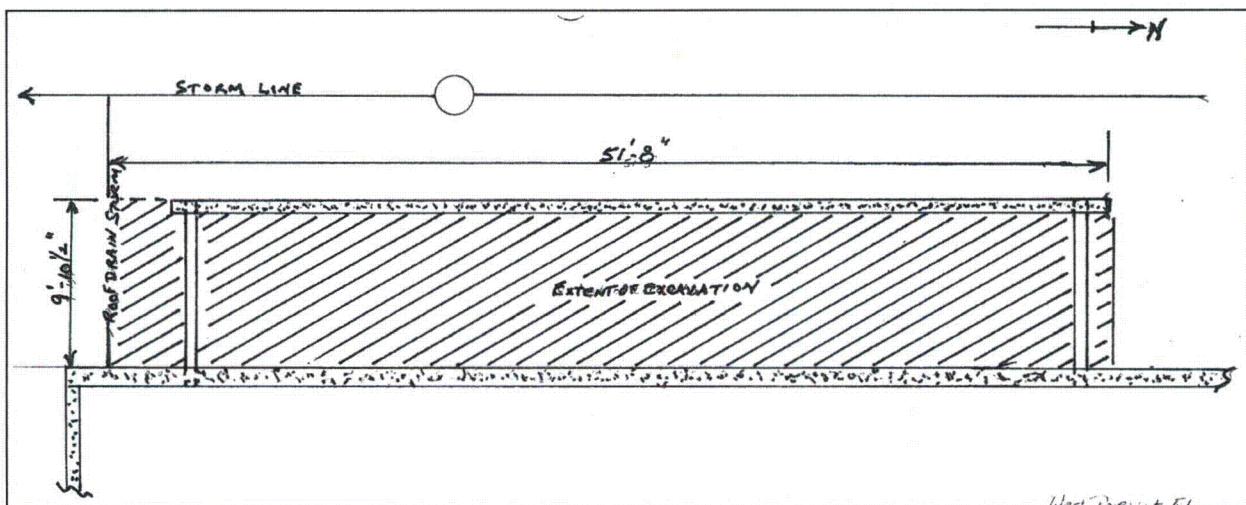


Figure 10, Storage Port excavation zone

Removal of Storage Port Vent Lines

Seventeen 1" vent lines running from the west ends of the storage ports, in an easterly direction back to and through the wall of the FNR facility were removed on December 10, 2008 using a band saw. A cardboard tray was placed under each cut line to contain pipe shavings from the band saw operation. The shavings were placed in a radioactive materials slurry/piping drum for proper disposal.

Following the cutting operation the pipes were wipe sampled at each end, and then taped to seal the openings. The pipes were then placed in the FNR radioactive material area inside FNR and eventually sent for proper disposal. All wipe samples measured below L_c levels. The cardboard tray was checked using a frisker probe Model 44-142, serial no. PR249243, and wipe samples collected and analyzed on a Tenelec Series 5, serial no. 2161, measured below L_c levels. Refer to Appendix E for the survey data sheet.



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

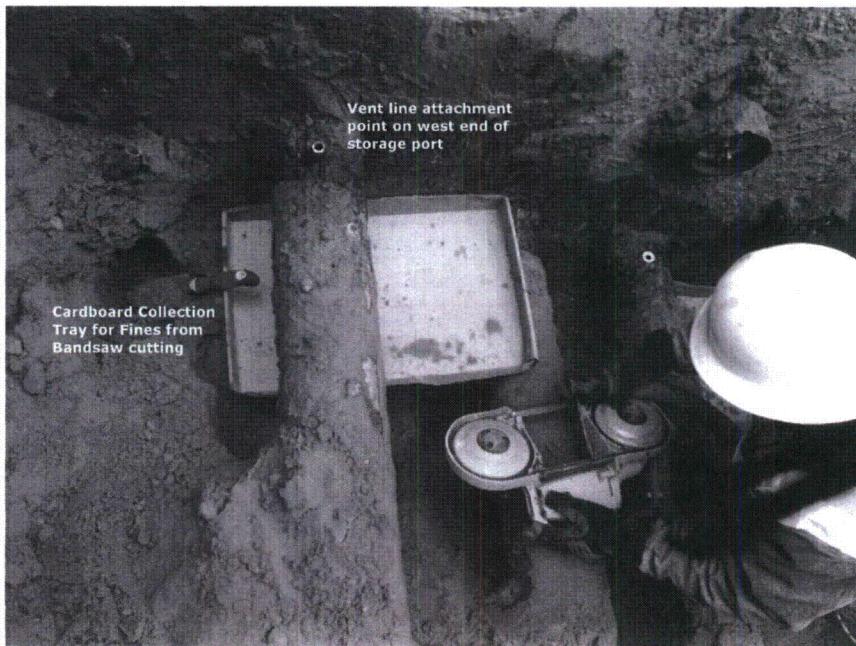


Figure 11, Cutting vent lines from the storage ports

Removal of Storage Ports and Concrete Support Wall

In December 2008 all 50 storage ports were uncovered, cut, and removed from the excavation zone. The storage ports were moved inside the FNR building for processing and ultimately disposed as low level radioactive waste in a controlled manner. As anticipated from the preliminary soil sampling activities, the soil immediately surrounding Storage Port No. 1 exhibited low-level soil activation from the Pu²³⁸Be sources that had been stored in the storage port. The soil and concrete in a cube approximately 40-inches on a side or approximately 37 cubic feet was removed in a controlled manner and disposed as radioactive waste.

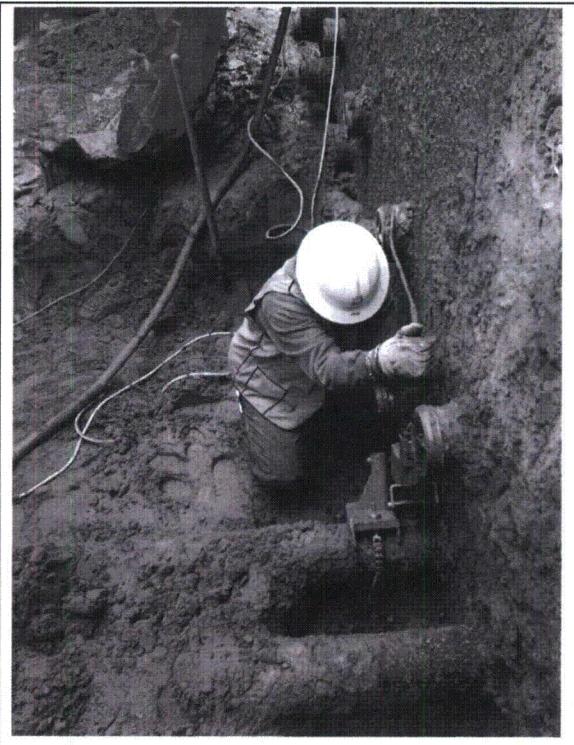


Figure 11, Cutting Storage Ports

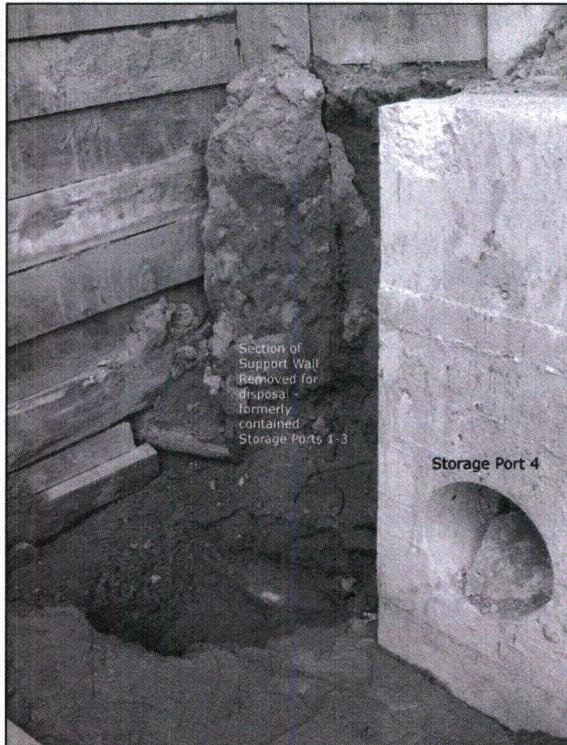


Figure 12, Concrete support wall section removed

Final Status Confirmation Surveys

With the excavation completed and the storage ports all removed, the project moved into a final status survey mode to confirm the ability to backfill and close the site. This involved radiological surveys of the excavation zone where the Pu²³⁸Be sources had been stored in Storage Port No. 1, confirmation soil samples of the area under the former Storage Port No. 1 and to the west of the area where the concrete support wall had been removed, and confirmation of the remaining concrete support wall. In addition, all of the storage port ends remaining in the wall into the FNR facility were surveyed for free release to allow them to remain in place. The NRC then made a site visit and collected samples of the soil and concrete to confirm the analysis in order to allow backfilling of the excavation. Figure 13 identifies the sample locations.

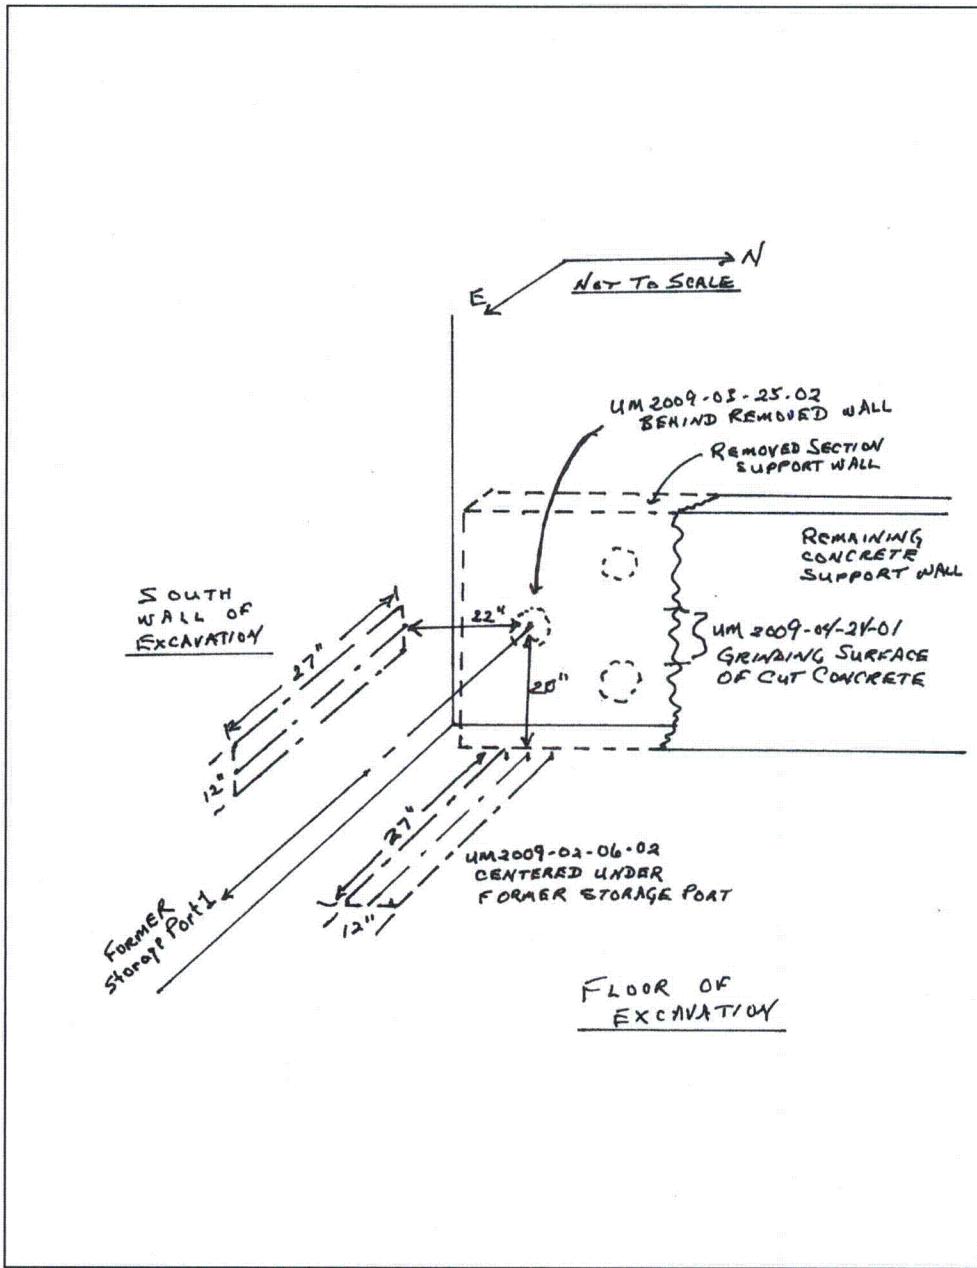


Figure 13, Final Status Survey sample locations for Storage Port No. 1

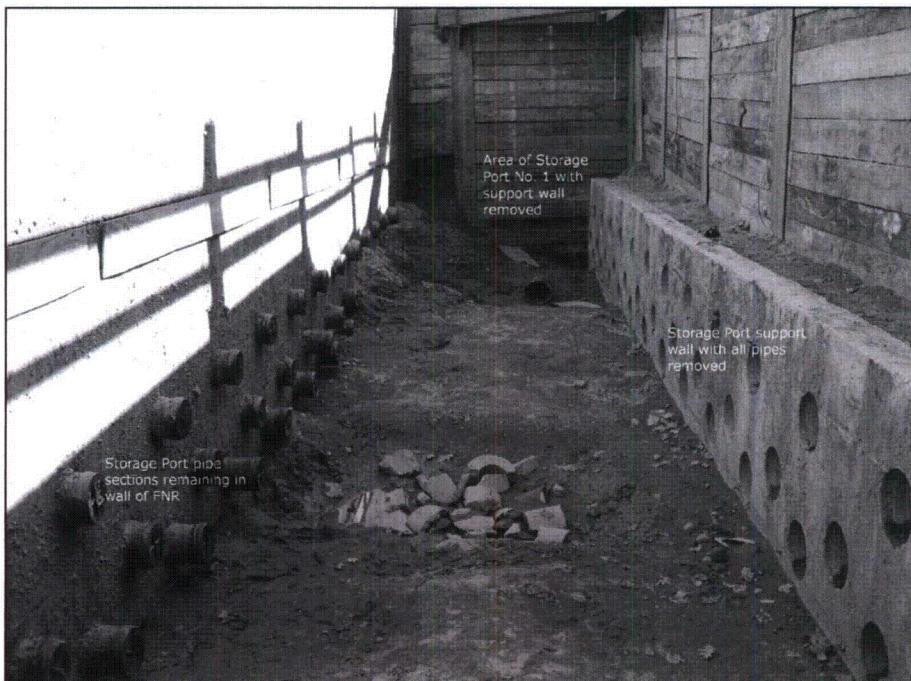


Figure 14, Storage port excavation ready for final survey work

Free Release Survey of Sections of Storage Ports Remaining in the FNR Wall

To determine the ability to free-release and leave in the wall the remaining sections of storage ports that could not be removed, survey work was performed using one minute static gamma measurements at two locations on each pipe end. The survey was performed using a Ludlum 44-1 NaI detector, serial no. PR249243, on January 9, 2009. Swipe samples were also collected and analyzed for alpha and beta using a Tenelec S5-XLB, serial no. 2161. The measurements for each storage port are summarized in Table 7 below with survey data sheets provided in Appendix F (separate binder).

The survey results indicate the pipe ends can all be free-released and left in the wall of the FNR. The ends were plugged and capped to prevent soil infiltration to the FNR facility during backfill of the excavation.



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Table 7, Final Status Survey of Storage Port pipe-ends remaining in FNR wall

Port Number	Highest Gross CPM During Scan	Highest Smear in dpm/100cm ²	Port Number	Highest Gross CPM During Scan	Highest Smear in dpm/100cm ²
Port 1	<MDA	<MDA	Port 26	<MDA	<MDA
Port 2	<MDA	<MDA	Port 27	<MDA	<MDA
Port 3	<MDA	<MDA	Port 28	<MDA	<MDA
Port 4	<MDA	<MDA	Port 29	<MDA	<MDA
Port 5	<MDA	<MDA	Port 30	<MDA	<MDA
Port 6	<MDA	<MDA	Port 31	<MDA	<MDA
Port 7	<MDA	<MDA	Port 32	<MDA	<MDA
Port 8	<MDA	<MDA	Port 33	<MDA	<MDA
Port 9	<MDA	<MDA	Port 34	<MDA	<MDA
Port 10	<MDA	<MDA	Port 35	<MDA	<MDA
Port 11	<MDA	<MDA	Port 36	<MDA	<MDA
Port 12	<MDA	<MDA	Port 37	<MDA	<MDA
Port 13	<MDA	<MDA	Port 38	<MDA	<MDA
Port 14	<MDA	<MDA	Port 39	<MDA	<MDA
Port 15	<MDA	<MDA	Port 40	<MDA	<MDA
Port 16	<MDA	<MDA	Port 41	<MDA	<MDA
Port 17	<MDA	<MDA	Port 42	<MDA	<MDA
Port 18	<MDA	<MDA	Port 43	<MDA	<MDA
Port 19	<MDA	<MDA	Port 44	<MDA	<MDA
Port 20	<MDA	<MDA	Port 45	<MDA	<MDA
Port 21	<MDA	<MDA	Port 46	<MDA	<MDA
Port 22	<MDA	<MDA	Port 47	<MDA	<MDA
Port 23	<MDA	<MDA	Port 48	<MDA	<MDA
Port 24	<MDA	<MDA	Port 49	<MDA	<MDA
Port 25	<MDA	<MDA	Port 50	<MDA	<MDA

Soil and Concrete Survey and Analysis around Storage Port No. 1

On April 13, 2009 a survey of the soil and concrete support wall around the former location of Storage Port No. 1 was conducted using a Ludlum Model 19 MicroR Meter, serial no. 101763. All measurements were at or below the background levels as determined through measurements at the north end of the excavation zone. Appendix G (separate binder) is the Radiological Survey Report for this effort.

Following removal of the section of concrete support wall from the south end, up through Storage Port No. 3 including the concrete around Storage Port No. 1, a sample of the cut edge of the remaining concrete was collected and analyzed to determine residual activation products. The sample was collected using a diamond grinder with a new diamond wheel to grind the concrete surface. Dust from the grinding was collected in a clean Minuteman vacuum designated specifically for sample collection. The sample was processed and analyzed using the U-M high purity germanium (HPGe) detector calibrated using a 2.09 g cm⁻³ epoxy, 500 ml Nalgene, multi-nuclide standard (Am-241 – 60 keV through Y-99 1836 keV). The samples are compared to the activation products identified in the concrete prior to removal. Table 8 below provides results of that analysis and the analytical data is in Appendix H (separate binder).



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Table 8, Final Status Survey Characterization of concrete support wall remaining in the excavation zone

Identified Radionuclide	Pre-Removal Measured Concentration (pCi g^{-1})	Post-Removal Measured Concentration (pCi g^{-1})	Minimum Detectable Activity (pCi g^{-1})	Default Screening Values – Table 3 (pCi/g^{-1})
Sample No. UM2009-04-24-01: Edge of remaining concrete wall at centerline of removed Storage Port No. 1				
Mn-54	<MDA	<MDA	3.72×10^{-1}	13.9
Fe-55	1.48	<MDA	11.4	9,350
Co-60	2.75×10^{-1}	<MDA	5.84×10^{-2}	3.68
Ag-108m	1.32×10^{-2}	<MDA	2.9×10^{-2}	
Ba-133	6.89×10^{-2}	<MDA	7.88×10^{-1}	
Cs-134	9.35×10^{-3}	<MDA	1.05×10^{-1}	5.36
Eu-152	1.73	8.58×10^{-2}	7.26×10^{-2}	8.66
Eu-154	7.48×10^{-2}	<MDA	5.83×10^{-2}	8.0
Eu-155	3.23×10^{-1}	ND	ND	282

Following removal of the support wall section for Storage Port No. 1 the soil behind the wall was analyzed to determine if the soil was impacted by the neutron flux from the former Pu²³⁸Be sources stored in the vicinity. The soil sample was collected using a clean flat scoop using ASTM D5633 (2004) methodology. The sample was processed following ASTM (2005) C 999, *Soil Sample Preparation for the Determination of Radionuclides*. The material was dried for two days at 110 degrees C until reaching a constant weight. 1,000 grams of sample material from each was placed into 500 ml wide mouth Nalgene bottles and analyzed using the U-M high purity germanium (HPGe) detector calibrated using a 2.09 g cm⁻³ epoxy, 500 ml Nalgene, multi-nuclide standard (Am-241 – 60 keV through Y-99 1836 keV). Table 9 below provides results of that analysis and the analytical data is in Appendix I (separate binder).

Table 9, Final Status Survey soil sample from behind support wall for Storage Port No. 1

Identified Radionuclide	Measured Concentration (pCi g^{-1}) ⁴	Minimum Detectable Activity (pCi g^{-1})	Default Screening Values – Table 3 (pCi/g^{-1})
Sample No. UM2009-03-25-02: Soil from behind support wall for Storage Port No. 1			
Mn-54	<MDA	2.4×10^{-1}	13.9
Fe-55	<MDA	-	9,350
Co-60	<MDA	3.7×10^{-2}	3.68
Ba-133	<MDA	5.36×10^{-2}	
Cs-134	<MDA	5.23×10^{-2}	5.36
Eu-152	<MDA	5.29×10^{-2}	8.66
Eu-154	<MDA	4.4×10^{-2}	8.0

The only original soil remaining from around Storage Port No. 1 was the bottom of the excavation, approximately 20" below the former storage port, and the south wall of the excavation approximately 22" from the former storage port. The soil from the top, north, and east sides was removed. Soil samples were collected from these locations using a clean flat scoop. The samples were processed and sent to Eberline Analytical for final status survey determination of final closure of the excavation. Figure 13 above shows the sample locations

⁴ Fe-55 Estimated by activation calculation bases upon measured Cu-152 and Co-60 concentrations



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

and orientation with the former storage port. Table 10 below provides results of that analysis and the analytical data is in Appendix J (separate binder).

Table 10, Final Status Survey Soil samples from around the former Storage Port No. 1 (Eberline Analytical)

Identified Radionuclide	Measured Concentration (pCi g^{-1}) ⁵	Minimum Detectable Activity (pCi g^{-1})	Default Screening Values – Table 3 (pCi g^{-1})
Sample No. UM2009-02-06-02: Soil on floor of excavation directly under former Pu²³⁸Be source in Storage Port No. 1 [calculated unity factor of 0.08]			
Mn-54	<MDA	5.36×10^{-2}	13.9
Fe-55	<MDA	3.87	9,350
Co-60	7.64×10^{-2}	6.51×10^{-2}	3.68
Ba-133	Not Identified	Not Identified	
Cs-134	<MDA	5.38×10^{-2}	5.36
Eu-152	5.1×10^{-1}	3.58×10^{-1}	8.66
Eu-154	<MDA	1.77×10^{-1}	8.0
Sample No. UM2009-02-06-04: Soil on south wall of excavation directly adjacent to former Pu²³⁸Be source in Storage Port No. 1			
Mn-54	<MDA	1.11×10^{-1}	13.9
Fe-55	<MDA	4.16	9,350
Co-60	<MDA	1.58×10^{-1}	3.68
Ba-133	Not Identified	Not Identified	
Cs-134	<MDA	1.00×10^{-1}	5.36
Eu-152	<MDA	1.00	8.66
Eu-154	<MDA	2.99×10^{-1}	8.0

Because the radionuclides are in a mixture, a sum-of-fractions calculation was performed on the samples to determine if the 25 mrem/yr equivalent had been exceeded in the soil. As shown in Table 10, the calculated unity factor for the soil under the former Pu²³⁸Be sources was 0.08, indicating the remaining soils in the excavation do not exceed the Default Screening Values of Table 6.91 in NUREG 5512.

Final Status Survey Conclusion

The surveys and analytical work performed on remaining soil and the concrete support wall have not identified contamination remaining in the excavation associated with the operation of the storage ports, in particular Storage Port No. 1 that had been used to house high level neutron sources in the form of Pu²³⁸Be. The final status survey supports the conclusion that all remedial activity has been adequately completed to comply with the Default Screening Values of Table 6.91 in NUREG 5512.

NRC Confirmation Surveys

On December 11, 2008, the decommissioning branch of the NRC conducted an inspection of activities at the FNR facility. The NRC inspection team consisted of Senior Health Physicist Bill Snell and staff Health Physicist Jeremy Tapp. The purpose of the inspection was to determine

⁵ Fe-55 Estimated by activation calculation bases upon measured Cu-152 and Co-60 concentrations



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

whether the decommissioning activities were conducted safely and in accordance with NRC requirements. Specifically, the two inspectors evaluated decommissioning activities and radioactive waste management. The primary activity observed during the inspection was the removal of the underground storage ports and associated vent lines. The inspectors determined that the University of Michigan was effectively completing decontamination and dismantlement activities along with adequate calibration of survey equipment and completion of associated documentation. In an NRC inspection report dated December 23, 2008, the NRC noted that no radiological concerns were identified during facility tours and observations of work in progress.

On Monday, March 25, 2009 the NRC visited the FNR facility to conduct confirmatory sampling of the storage port soil and concrete for their independent analysis. The NRC radiological analyses of the soil concurred with the analyses conducted by the FNR staff and Eberline Analytical. The excavation was subsequently backfilled. Table 11 below provides results of the NRC confirmation sampling and the data sheets are provided in Appendix K (separate binder).

Table 11, NRC confirmation sampling/analytical through ORISE

Identified Radionuclide	Measured Concentration (pCi g^{-1}) ⁶	Minimum Detectable Concentration (pCi g^{-1})	Default Screening Values – Table 3 (pCi/ g^{-1})
Sample No. UOM-09-1-01: Soil sample from area of former Storage Port No. 1			
Fe-55	0.03	2.4	9,350
Co-60	0.03	0.03	3.68
Eu-152	0.02	0.03	8.66
Sample No. UOM-09-1-02: Soil sample from area of former Storage Port No. 1			
Fe-55	0.07	2.4	9,350
Co-60	0.01	0.03	3.68
Eu-152	0.06	0.04	8.66
Sample No. UOM-09-1-03: Concrete support wall sample			
Fe-55	0.07	2.3	9,350
Co-60	0.04	0.05	3.68
Eu-152	0.08	0.06	8.66

⁶ Fe-55 Estimated by activation calculation bases upon measured Cu-152 and Co-60 concentrations



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendices under Separate Cover

- A Pre-Removal Internal Characterization of the Storage Ports
- B Analytical Data for Activated Soil Characterization around Storage Port No. 1
- C Pre-Excavation Soil Analysis around Storage Port No. 1
- D Analysis of Concrete Support Wall around Storage Port No. 1 Eberline Analytical
- E Storage Port Vent Lines Survey Data Sheet
- F Radiological Survey and Swipe Analysis for Storage Port Ends Remaining in FNR Wall
- G Radiological Survey Report of Excavation Zone Former Storage Port No. 1 Location
- H Analytical Data for Final Status Survey of Soil Located Behind the Section of Support Wall Removed
- I Analytical Data for Final Status Survey of Soil Located Behind the Section of Support Wall Removed
- J Analytical Results from Eberline Analytical for Final Status Survey of the Soil under the Former Storage Port No. 1
- K ORISE Confirmation Samples Collected by NRC



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix A

Pre-Removal Internal Characterization of the Storage Ports



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix B

Analytical Data for Activated Soil Characterization around Storage Port No. 1



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix C

Pre-Excavation Soil Analysis around Storage Port No. 1



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix D

Analysis of Concrete Support Wall around Storage Port No. 1

Eberline Analytical



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix E Storage Port Vent Lines Survey Data Sheet



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix F

Radiological Survey and Swipe Analysis for Storage Port Ends Remaining in FNR Wall



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix G

Radiological Survey Report of Excavation Zone Former Storage Port No. 1 Location



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix H

Analytical Data for Final Status Survey of Concrete Support Wall Remaining in Excavation



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix I

Analytical Data for Final Status Survey of Soil Located Behind the Section of Support Wall Removed



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix J

Analytical Results from Eberline Analytical for Final Status Survey Of the Soil under the Former Storage Port No. 1



Ford Nuclear Reactor Storage Ports - Final Disposition

Revision: 00, DRAFT

Appendix K ORISE Confirmation Samples Collected by NRC

APPENDIX A

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

Ford Nuclear Reactor Decommissioning Project
Storage Port Characterization Surveys

The following surveys were performed using a Ludlum 2221 meter (Serial No. 218602) and a 2" x 2" NaI probe (Ludlum 4410; Serial No. 242815). Removable activity surveys (disc smears) were also performed at each point whenever practical. Removable activity smears were counted on a L-2929 counter.

Survey Method: The NaI probe was placed onto a circular jig (see attached photos). The jig ensured the probe remained centered within the storage port. The jig was attached to a string. The jig/probe was inserted into the storage port and measurements were taken at one foot (1-ft.) increments.

Survey point #1 represents the first measurement as the probe breaks the plane of the storage point. The August, 2006 measurements have elevated counts at the first port due to high exposure rates from staged radioactive materials on the Beam Port Floor (BPF).

Since exposure rates were elevated by radioactive materials in the areas surrounding the Storage Ports, corresponding graphs do not plot Pt. #1 for the August, 2006 characterization surveys. Although the May, 2007 survey data show less elevated exposure rates for Pt. #1, statistics also exclude Pt. #1 to be consistent with the August, 2006 survey statistics.

Gross Gamma (cpm) vs Depth into Storage Port


Port	Position (feet into port)													Average. (excluding Pt. #1)	Stand. Dev. (excluding Pt. #1)	Survey Date	Survey Log No.	Removable Activity Detected?
	1	2	3	4	5	6	7	8	9	10	11	12	13					
1	4649	4904	4897	4886	5098	5064	5130	5578	8986	20081	20581	14651	11696	9296	6053	5/17/2007	2007-0997	Y
2	5249	4754	4847	4785	4708	4761	4463	4666	4977	5377	5702	5549	5027	4968	381	5/17/2007	2007-0998	N
3	20700	6768	5732	5219	5209	5004	5131	5311	5953	7366	8065	6968	6348	6090	1010	8/21/2006	2006-0383	N
4	21232	5890	5433	5251	5113	5040	4985	5015	5273	5386	5711	5335	5172	5300	277	8/21/2006	2006-0384	N
5	17429	5261	5204	5126	5116	5247	5292	5030	5342	5147	5013	5027	5042	5154	114	8/30/2006	2006-0470	N
6	16368	6776	5596	5248	5273	4920	5057	5081	5241	5471	5535	5332	5124	5388	481	8/29/2006	2006-0467	not surveyed
7	21008	6206	5550	5353	5169	5250	5156	5081	5323	5287	5359	5488	5121	5362	302	8/29/2006	2006-0468	not surveyed
8	19735	5734	5510	5317	5106	5017	5175	5321	5267	5451	5850	5350	5041	5345	259	8/29/2006	2006-0469	not surveyed
9	21066	6005	5901	5728	5350	5532	5517	5623	5879	6255	6368	6103	5512	5814	324	8/30/2006	2006-0471	not surveyed
10	6868	5706	8363	5822	5272	5303	5244	5688	6783	10533	15106	23606	71422	14071	18877	5/17/2007	2007-0999	Y
11	21228	5926	5541	5553	5298	5070	5234	5221	5336	5866	5662	5599	5206	5459	274	8/30/2006	2006-0473	not surveyed
12	20019	5935	5814	5579	5722	5766	5827	6013	6331	6913	7324	7434	7991	6387	814	8/30/2006	2006-0472	not surveyed
13	22436	7342	6583	5894	6130	6616	6540	6414	6017	5719	5729	5825	5382	6183	537	8/30/2006	2006-0474	not surveyed
14	24569	5605	5567	5311	5203	5137	5557	5354	5354	5369	5427	5281	5002	5347	180	8/30/2006	2006-0475	not surveyed
15	16088	5469	5376	5439	5384	5129	5150	4984	5238	5027	5064	5032	5264	5213	173	8/30/2006	2006-0476	not surveyed
16	27251	5631	5241	5199	5288	5328	5252	5131	5202	5126	5213	5108	5352	5256	141	8/30/2006	2006-0477	not surveyed
17	27156	5722	5599	5461	5635	5359	5597	5569	6064	6361	6056	5883	6507	5818	361	8/30/2006	2006-0478	not surveyed
18	27724	5711	5410	5075	5125	5149	5068	5014	5047	5168	5156	5236	5281	5203	194	8/30/2006	2006-0479	not surveyed
19	32823	5451	5040	5152	5208	5039	5114	5118	5198	5107	5126	5110	5090	5146	109	8/31/2006	2006-0492	not surveyed
20	35160	5613	5039	4942	5290	5594	5732	5677	5559	5670	5710	5802	5795	5535	288	8/31/2006	2006-0493	not surveyed
21	33633	5609	4980	5094	5078	4869	5140	5089	5056	5159	5207	5263	5069	5134	181	8/31/2006	2006-0494	not surveyed
22	42950	5855	4988	4777	4817	4866	4981	5039	5047	5051	5067	5125	5182	5066	276	8/31/2006	2006-0495	not surveyed
23	43985	5299	4628	4557	4923	4677	4794	4834	4931	5041	5219	5258	5202	4947	258	8/31/2006	2006-0496	not surveyed
24	42749	7809	5631	5108	5058	5062	4958	4979	5076	5152	5112	5181	5057	5349	794	8/31/2006	2006-0497	not surveyed
25	6050	5636	4482	4547	4649	4395	4617	4555	4689	4759	4813	4923	4822	4741	321	5/17/2007	2007-1000	N
26	4879	4485	4486	4623	4830	5097	5378	5218	5730	6219	5809	5395	5399	5222	547	5/17/2007	2007-1001	N
27	5198	4708	4758	4636	4599	4539	4617	4818	4881	4844	4897	4960	4983	4770	149	5/17/2007	2007-1002	N

Ford Nuclear Reactor Decommissioning Project
Storage Port Characterization Surveys

Gross Gamma (cpm) vs Depth into Storage Port


Port	Position (feet into port)													Average. (excluding Pt. #1)	Stand. Dev. (excluding Pt. #1)	Survey Date	Survey Log No.	Removable Activity Detected?
	1	2	3	4	5	6	7	8	9	10	11	12	13					
28	5634	4848	4729	4488	4667	4536	4668	4960	4792	4768	4737	4790	4717	4725	128	5/17/2007	2007-1003	N
29	5702	4769	4720	4909	4794	4843	4998	4923	5057	5099	5209	5239	5466	5002	222	5/17/2007	2007-1004	N
30	5235	4747	4888	4738	4542	4627	4758	4763	4735	4902	5000	4891	4819	4784	126	5/17/2007	2007-1005	N
31	5383	5146	5213	4957	5011	5294	5526	5205	5246	5516	5476	5295	5240	5260	180	5/17/2007	2007-1006	N
32	5100	4644	4894	5101	4879	5142	5072	5426	5814	6372	6237	5689	5298	5381	545	5/17/2007	2007-1007	N
33	5524	4912	4794	4850	5129	5867	5327	5174	5221	5037	4984	4780	4654	5061	324	5/17/2007	2007-1008	N
34	6153	5020	4815	4905	4995	5004	5179	5275	5418	5500	5140	5088	4760	5092	226	5/17/2007	2007-1009	N
35	6332	5654	6958	6524	6566	7129	6802	6271	6426	6068	5468	5610	5141	6218	633	5/17/2007	2007-1010	N
36	6538	4834	4702	5125	5401	5247	5654	5398	5583	5773	5783	5248	5091	5320	348	5/17/2007	2007-1011	Y
37	6381	4722	4712	4640	4808	4798	5006	4981	5220	5224	5321	5316	5121	4989	249	5/18/2007	2007-1025	N
38	7396	4902	4813	4693	5036	5248	5362	5425	5450	5497	5443	5508	5308	5224	288	5/18/2007	2007-1024	N
39	6253	5825	5247	5254	5135	5262	5271	5291	5259	5540	5413	5339	4924	5313	218	5/18/2007	2007-1023	N
40	7462	4784	4955	4999	4969	4977	5708	5549	5525	5328	5186	5005	4949	5161	296	5/18/2007	2007-1022	N
41	8923	5190	5170	5034	5439	5390	5625	5525	5708	5536	5525	5252	5093	5374	221	5/18/2007	2007-1021	N
42	8539	5476	5303	5134	5092	5280	5355	5326	5208	5365	5365	5103	4941	5246	152	5/18/2007	2007-1020	N
43	7128	5153	5044	4921	4934	5049	5015	5038	4954	4981	5344	4984	4708	5010	149	5/21/2007	2007-1037	Y
44	8479	5381	4910	4585	4730	4725	4736	4791	5023	4890	4927	4917	4621	4853	212	5/21/2007	2007-1038	N
45	7727	5420	5466	5179	5024	5031	5162	5249	4938	5212	5027	5012	4729	5121	205	5/21/2007	2007-1039	Y
46	11016	7470	6062	5392	5233	5319	5390	5451	4949	5092	5071	4936	4716	5423	729	5/21/2007	2007-1040	Y
47	8747	4933	4404	4731	4707	4824	4947	5091	4973	5031	4965	5102	4764	4873	199	5/21/2007	2007-1041	Y
48	7889	5782	5474	5893	6407	5874	5759	5942	6312	6553	6945	9954	7384	6523	1211	5/21/2007	2007-1042	Y
49	11190	5707	5309	5186	5274	5072	5199	5479	6491	6490	6109	7789	5993	5842	793	5/21/2007	2007-1043	Y
50	7208	5017	4607	4605	4616	4550	4742	4786	4883	4985	5000	5034	4848	4806	181	5/21/2007	2007-1044	Y

FNR Storage Port #1: NaI Gross Gamma vs Depth

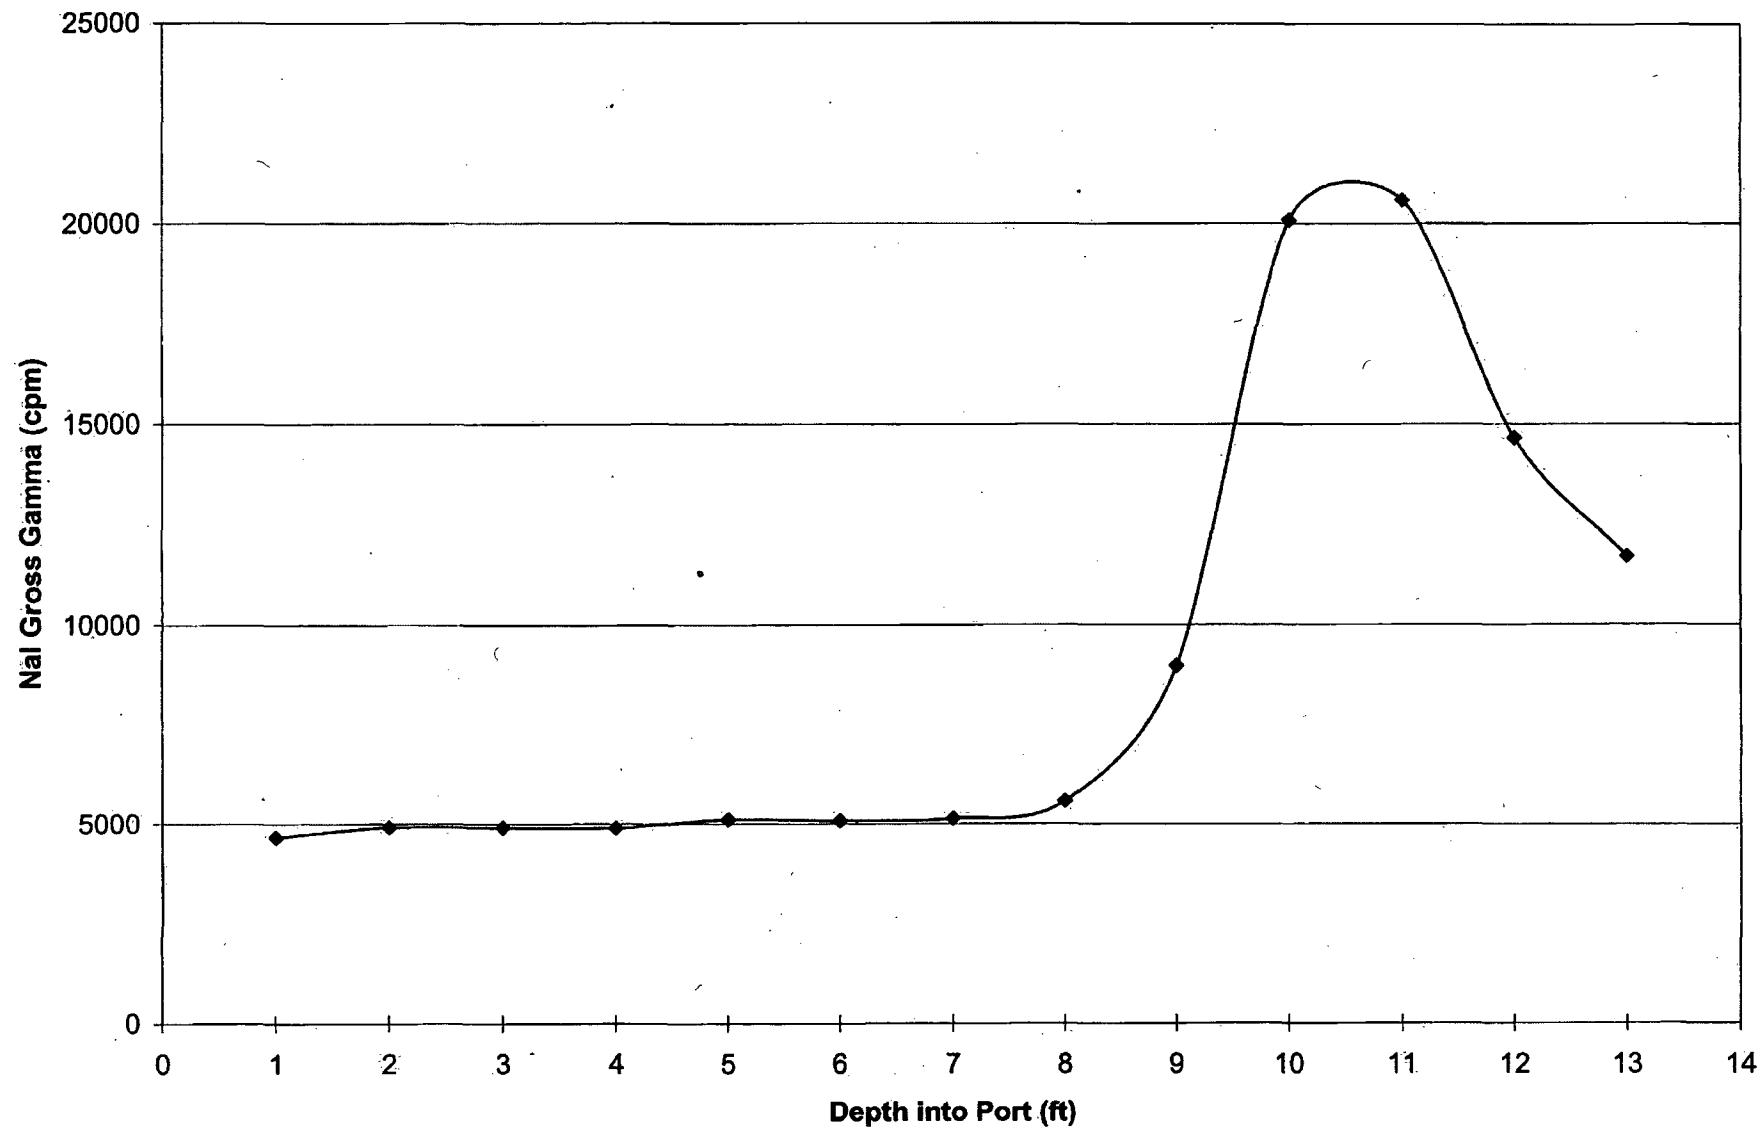


Surveyed: 5-17-2007

FNR Storage Port #2: NaI Gross Gamma vs Depth

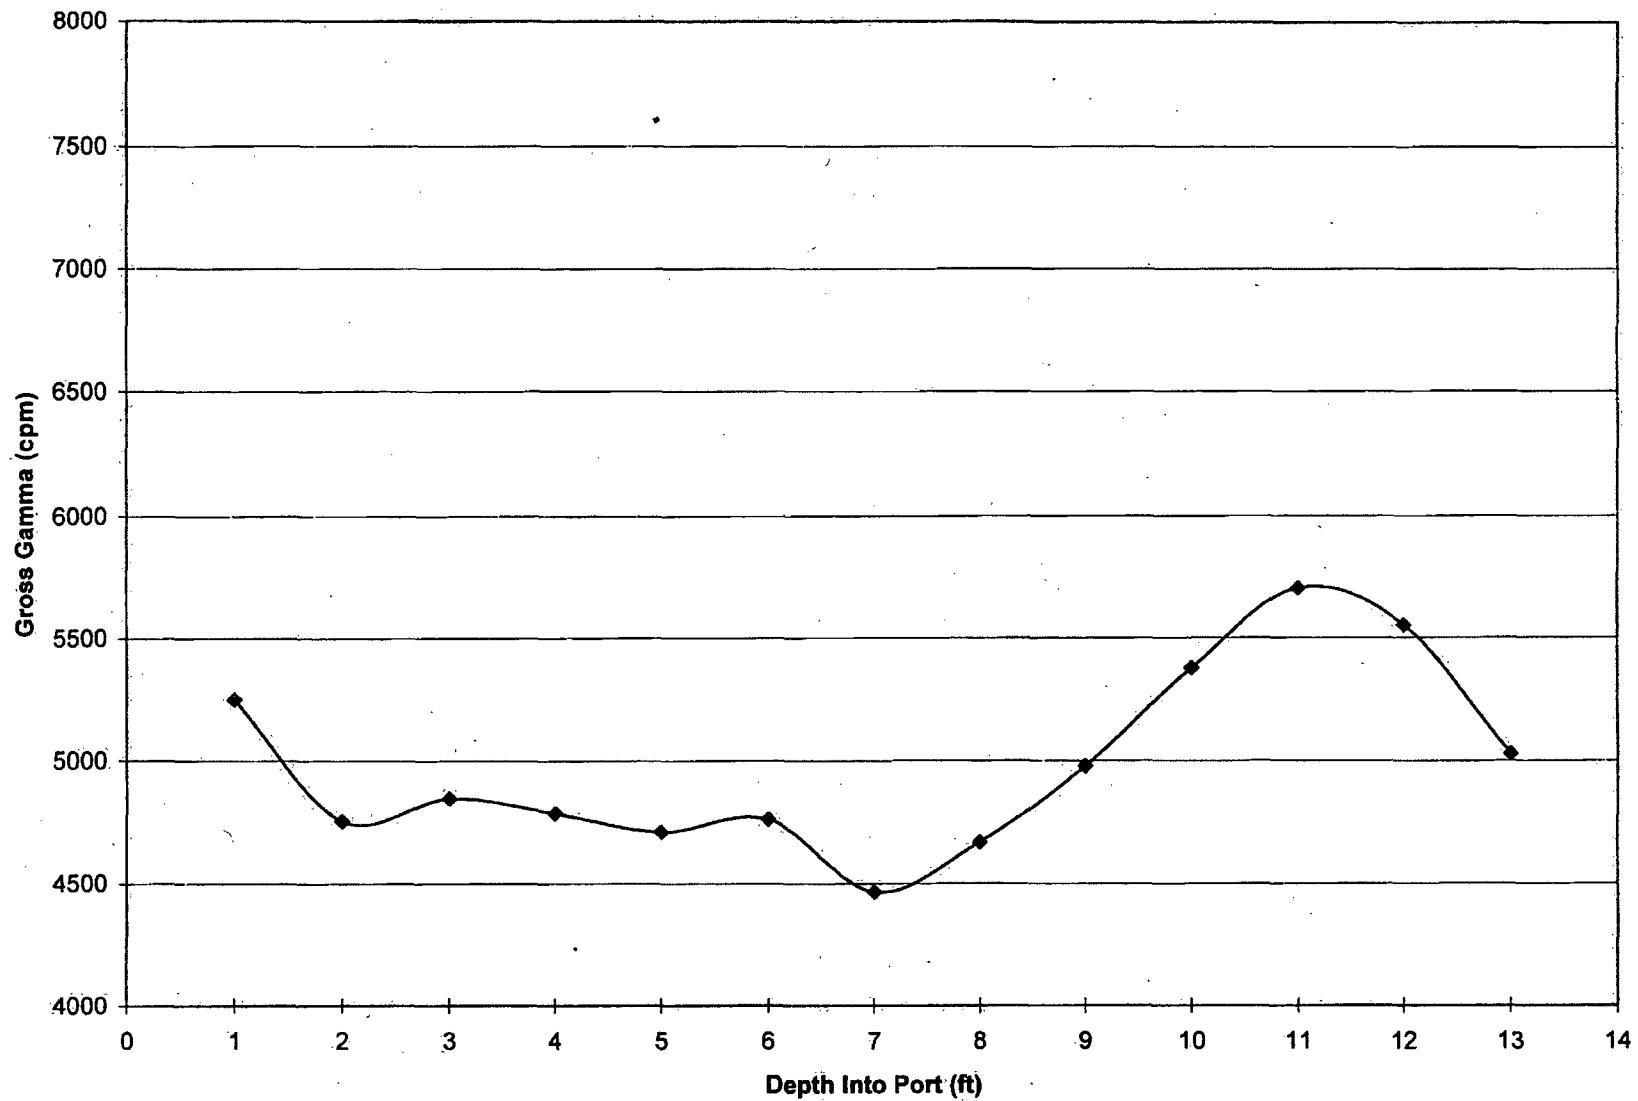


Surveyed: 5-17-2007

FNR Storage Port #3: NaI Gross Gamma vs Depth

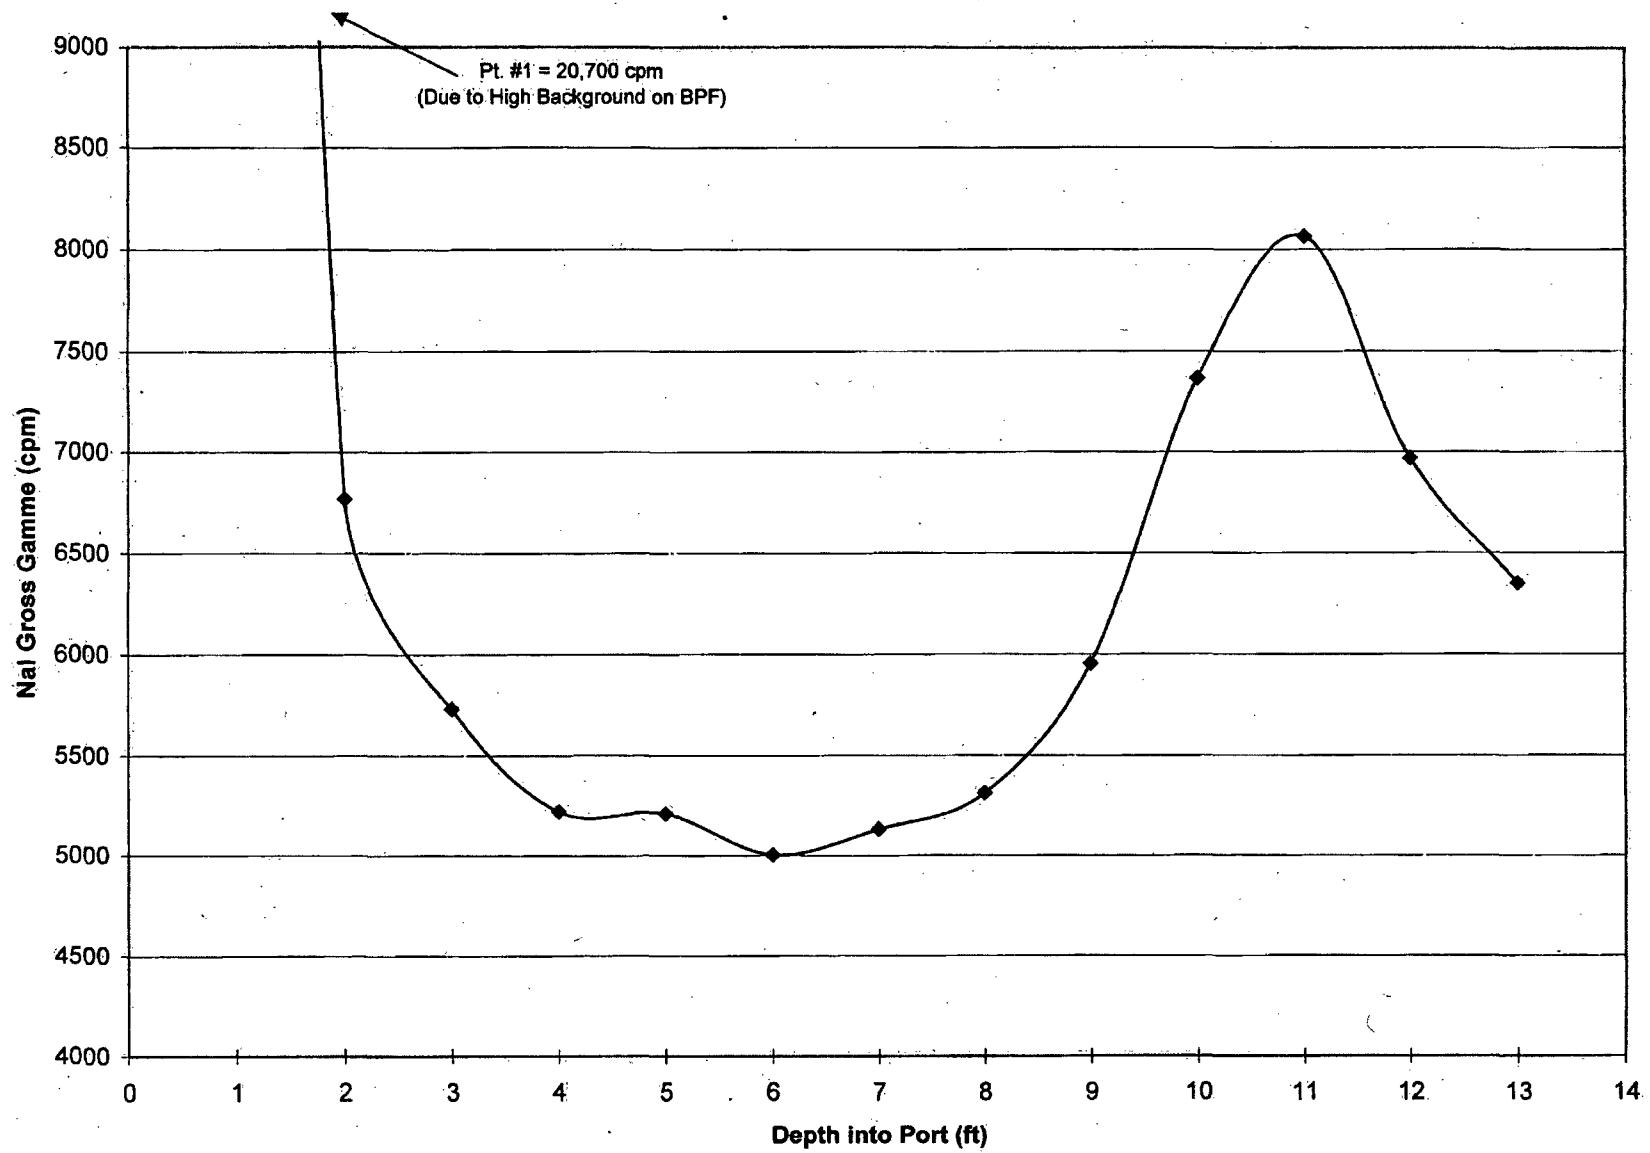


Surveyed: 8-21-2006

FNR Storage Port #4: NaI Gross Gamma vs Depth

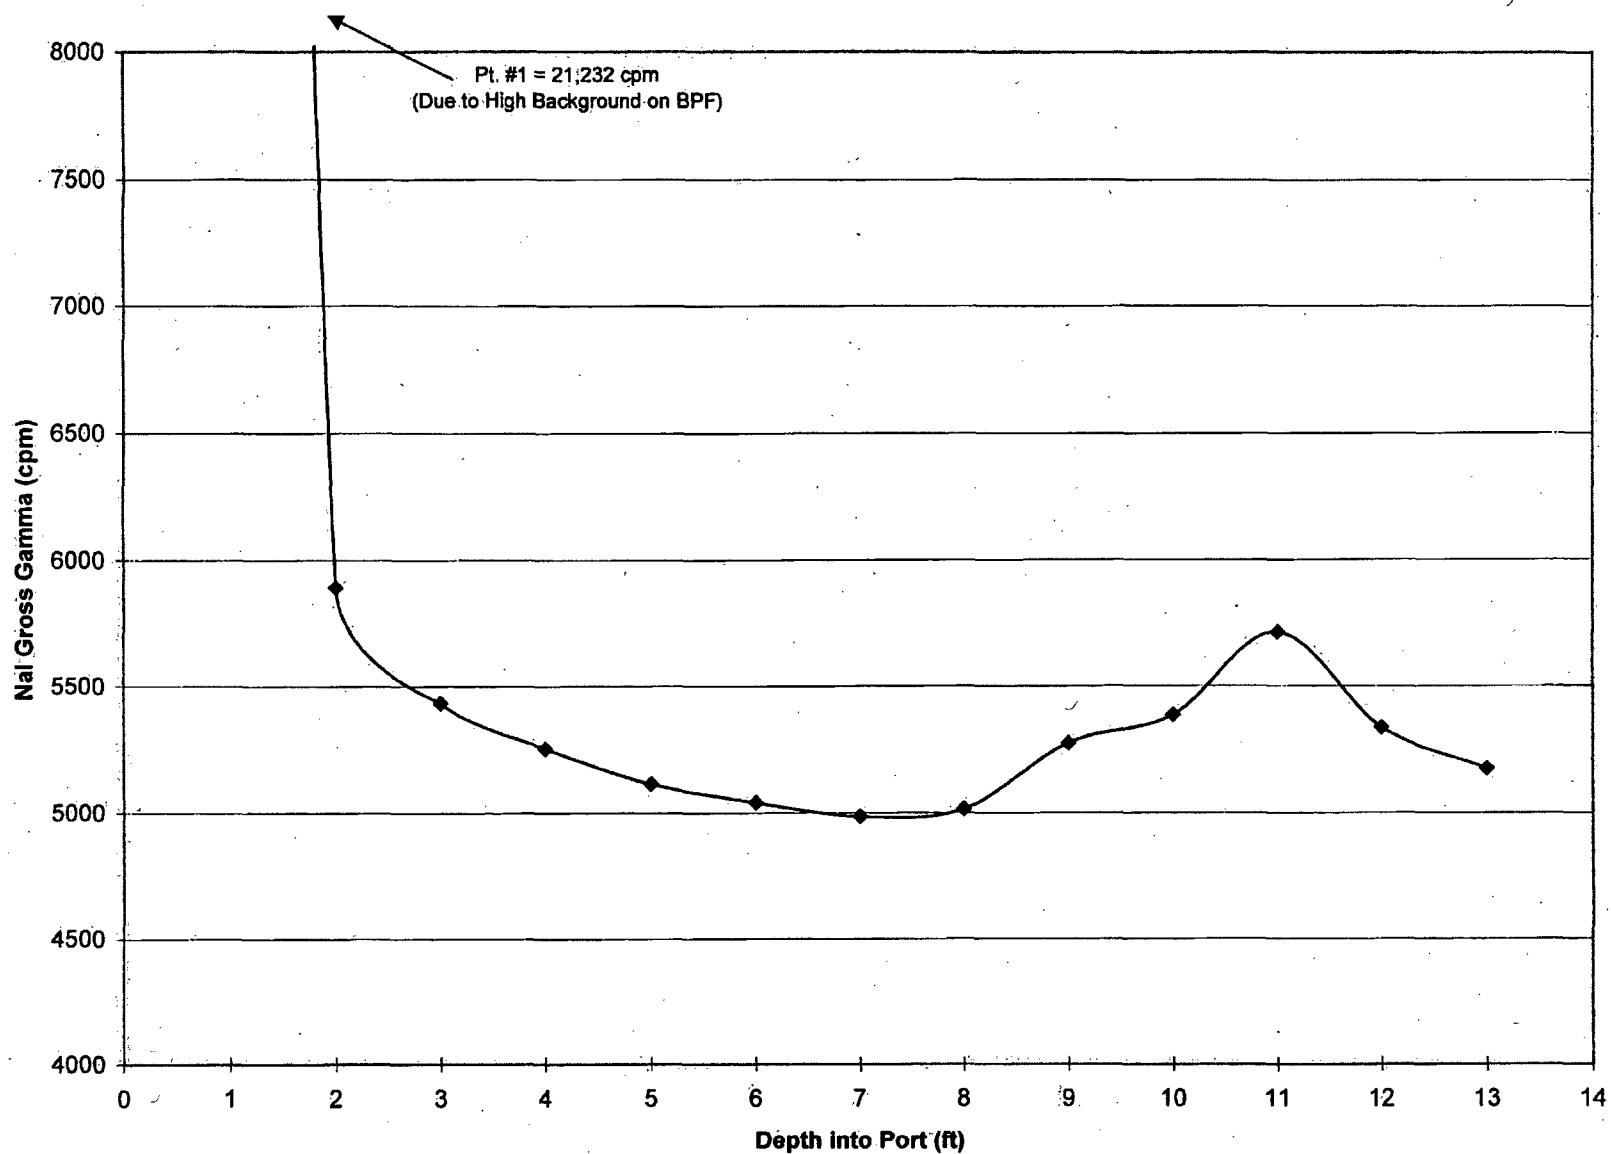


Surveyed: 8-21-2006

FNR Storage Port #5: NaI Gross Gamma vs Depth

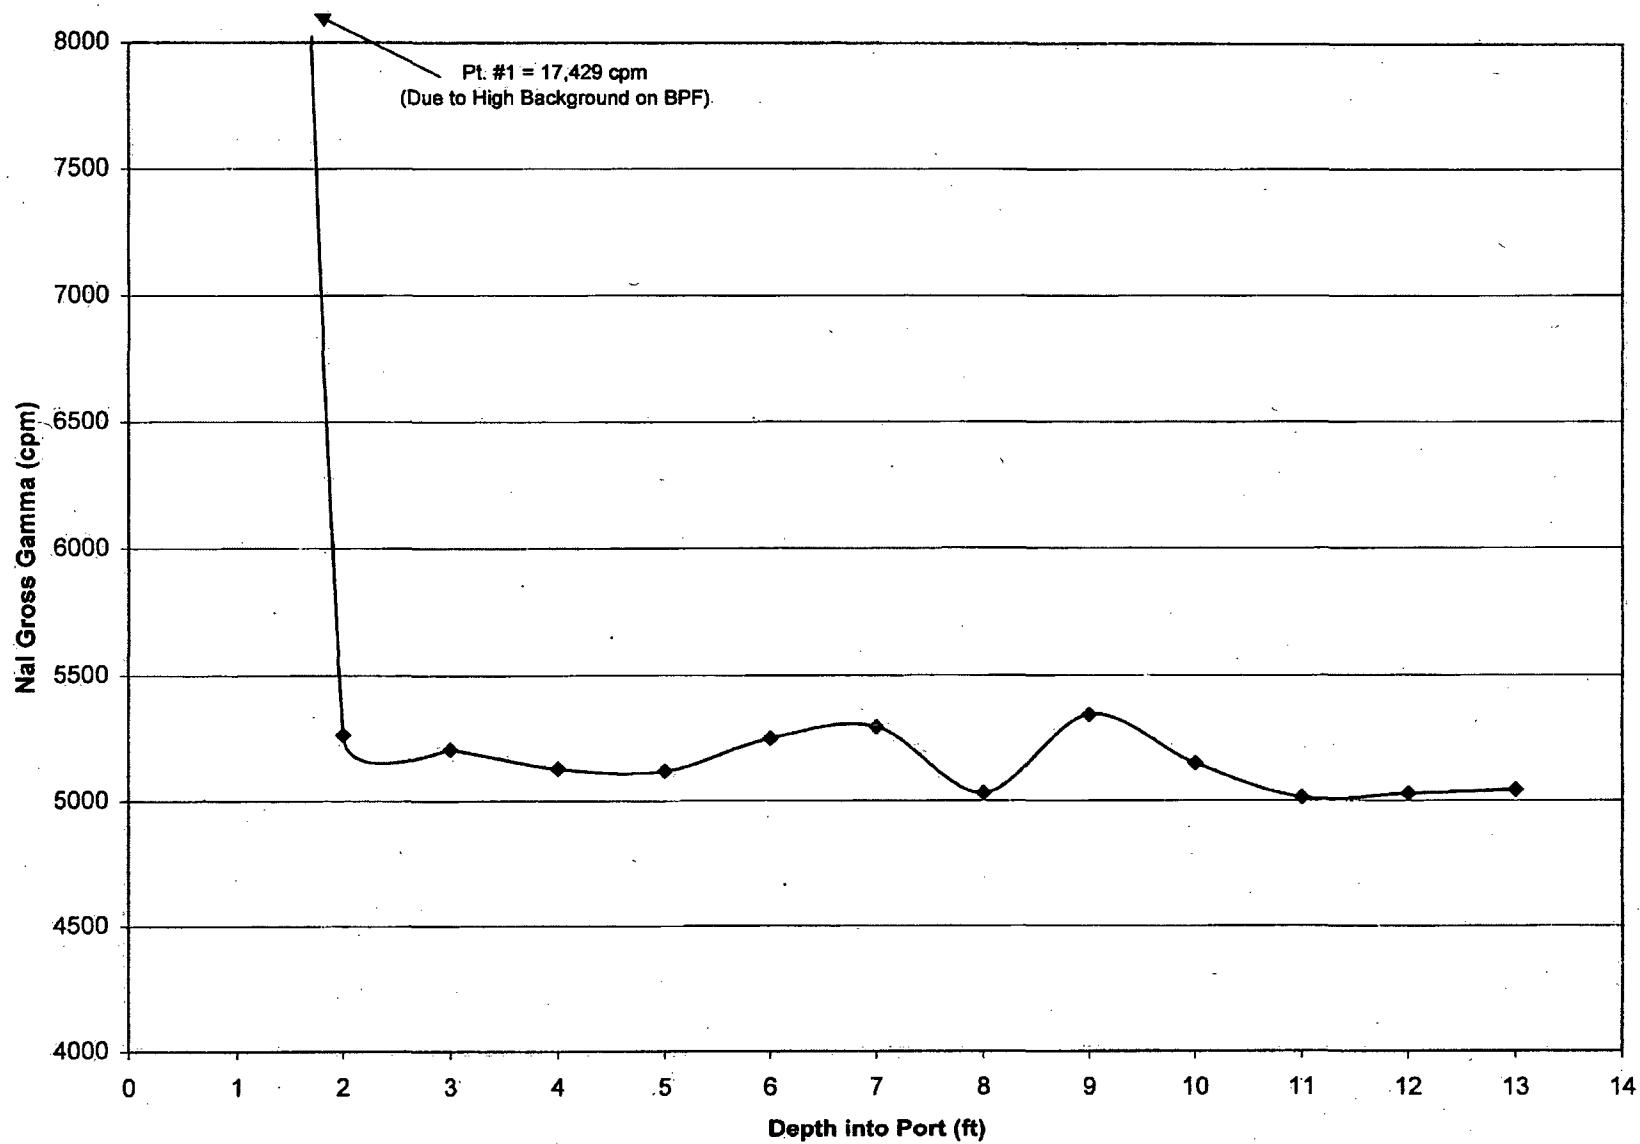


Surveyed: 8-30-2006

FNR Storage Port #6: NaI Gross Gamma vs Depth

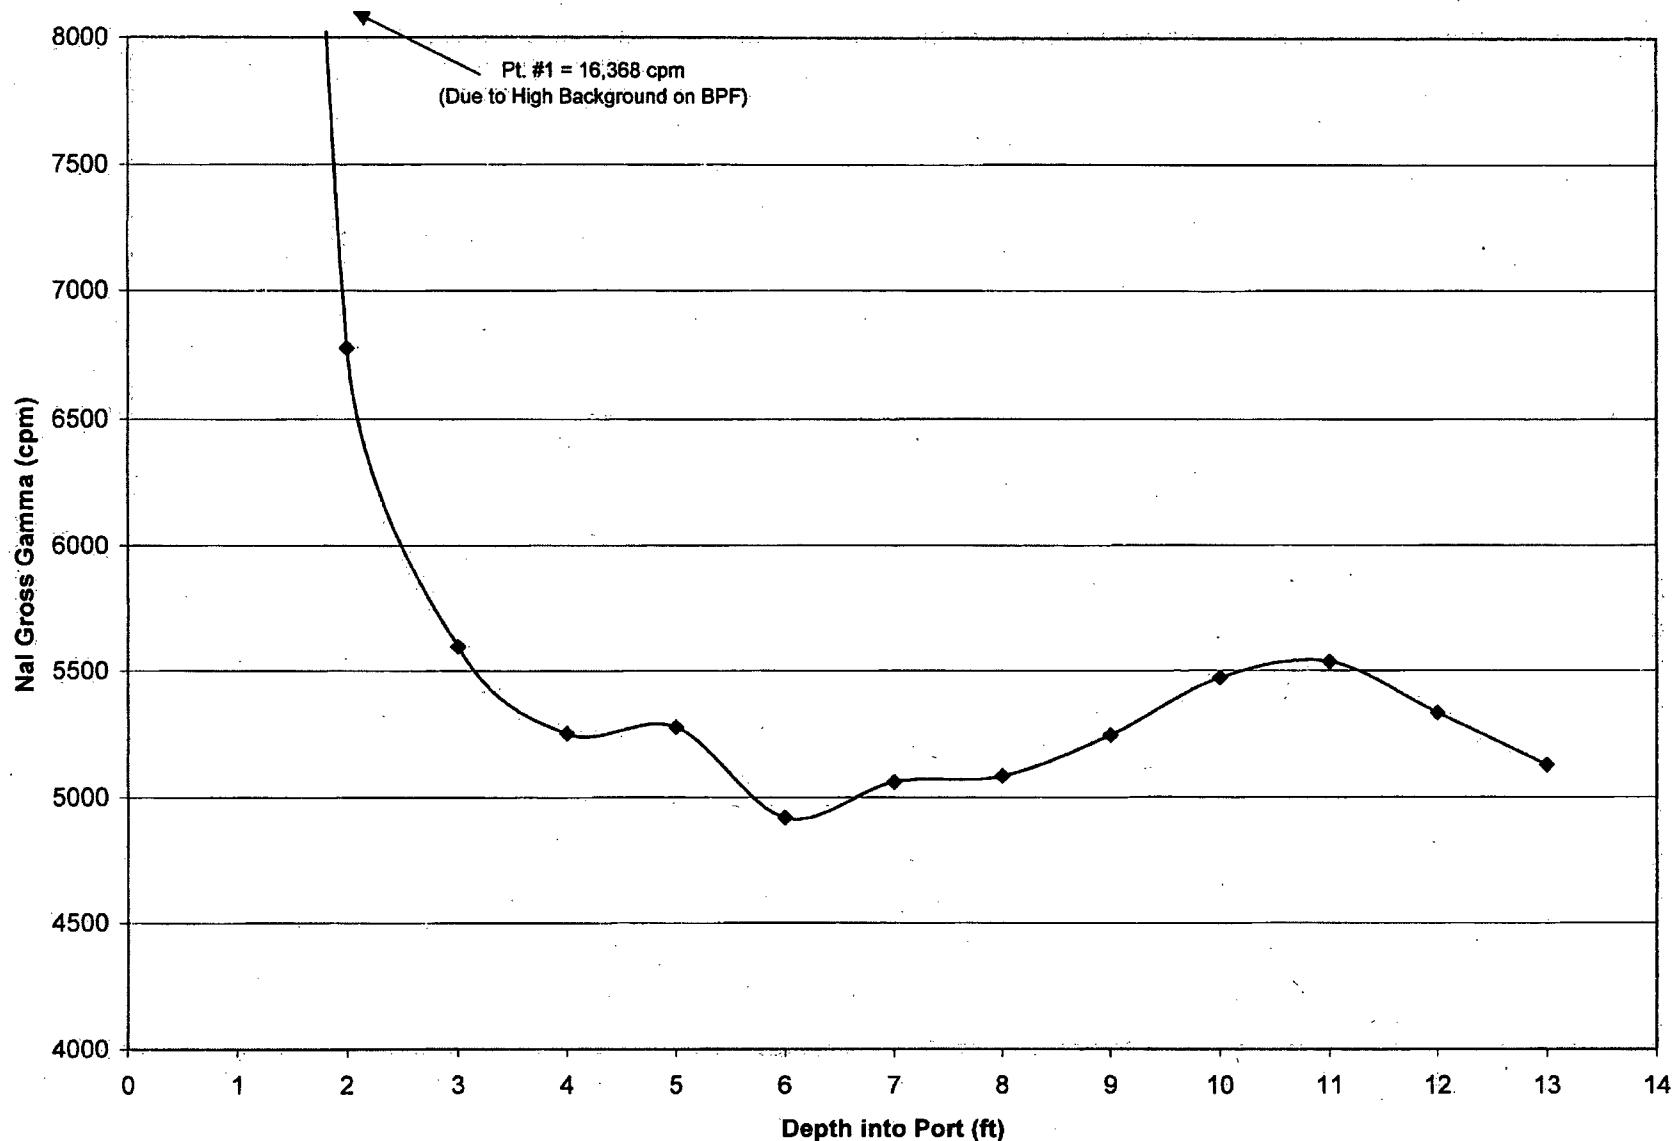


Surveyed: 08-29-2006

FNR Storage Port #7: NaI Gross Gamma vs Depth

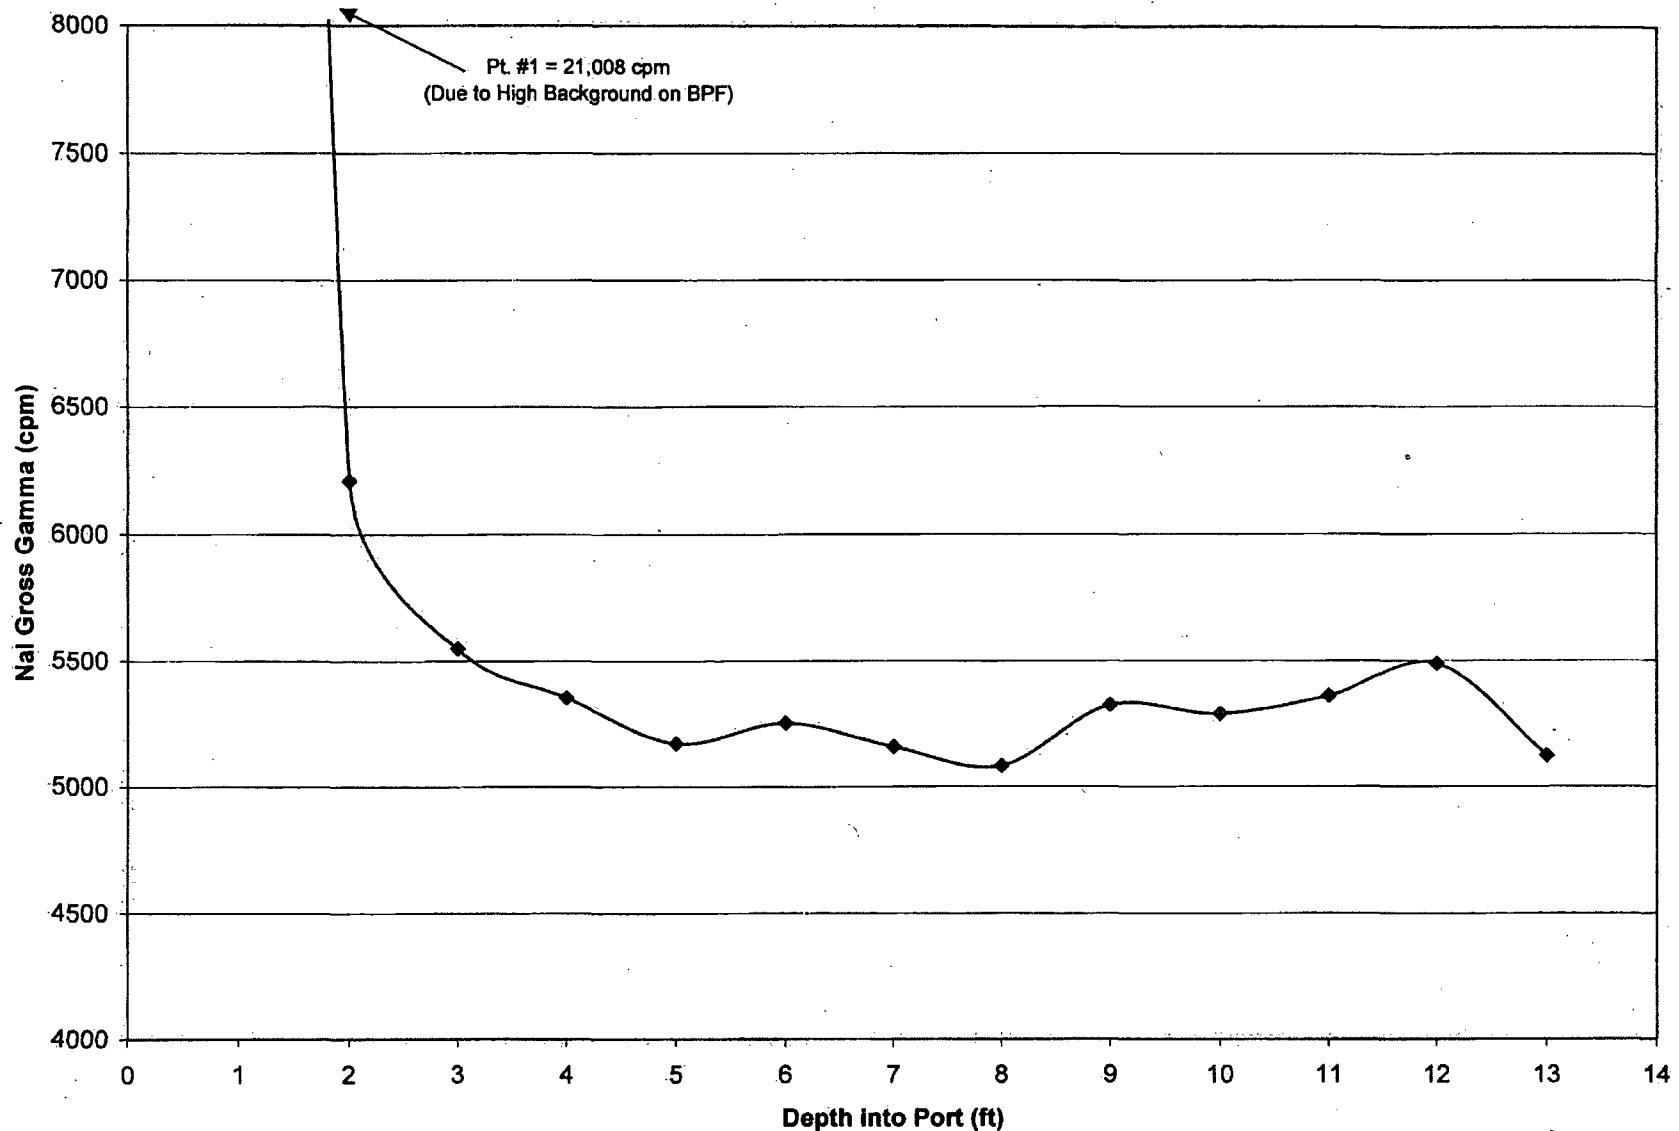


Surveyed: 08-29-2006

FNR Storage Port #8: NaI Gross Gamma vs Depth

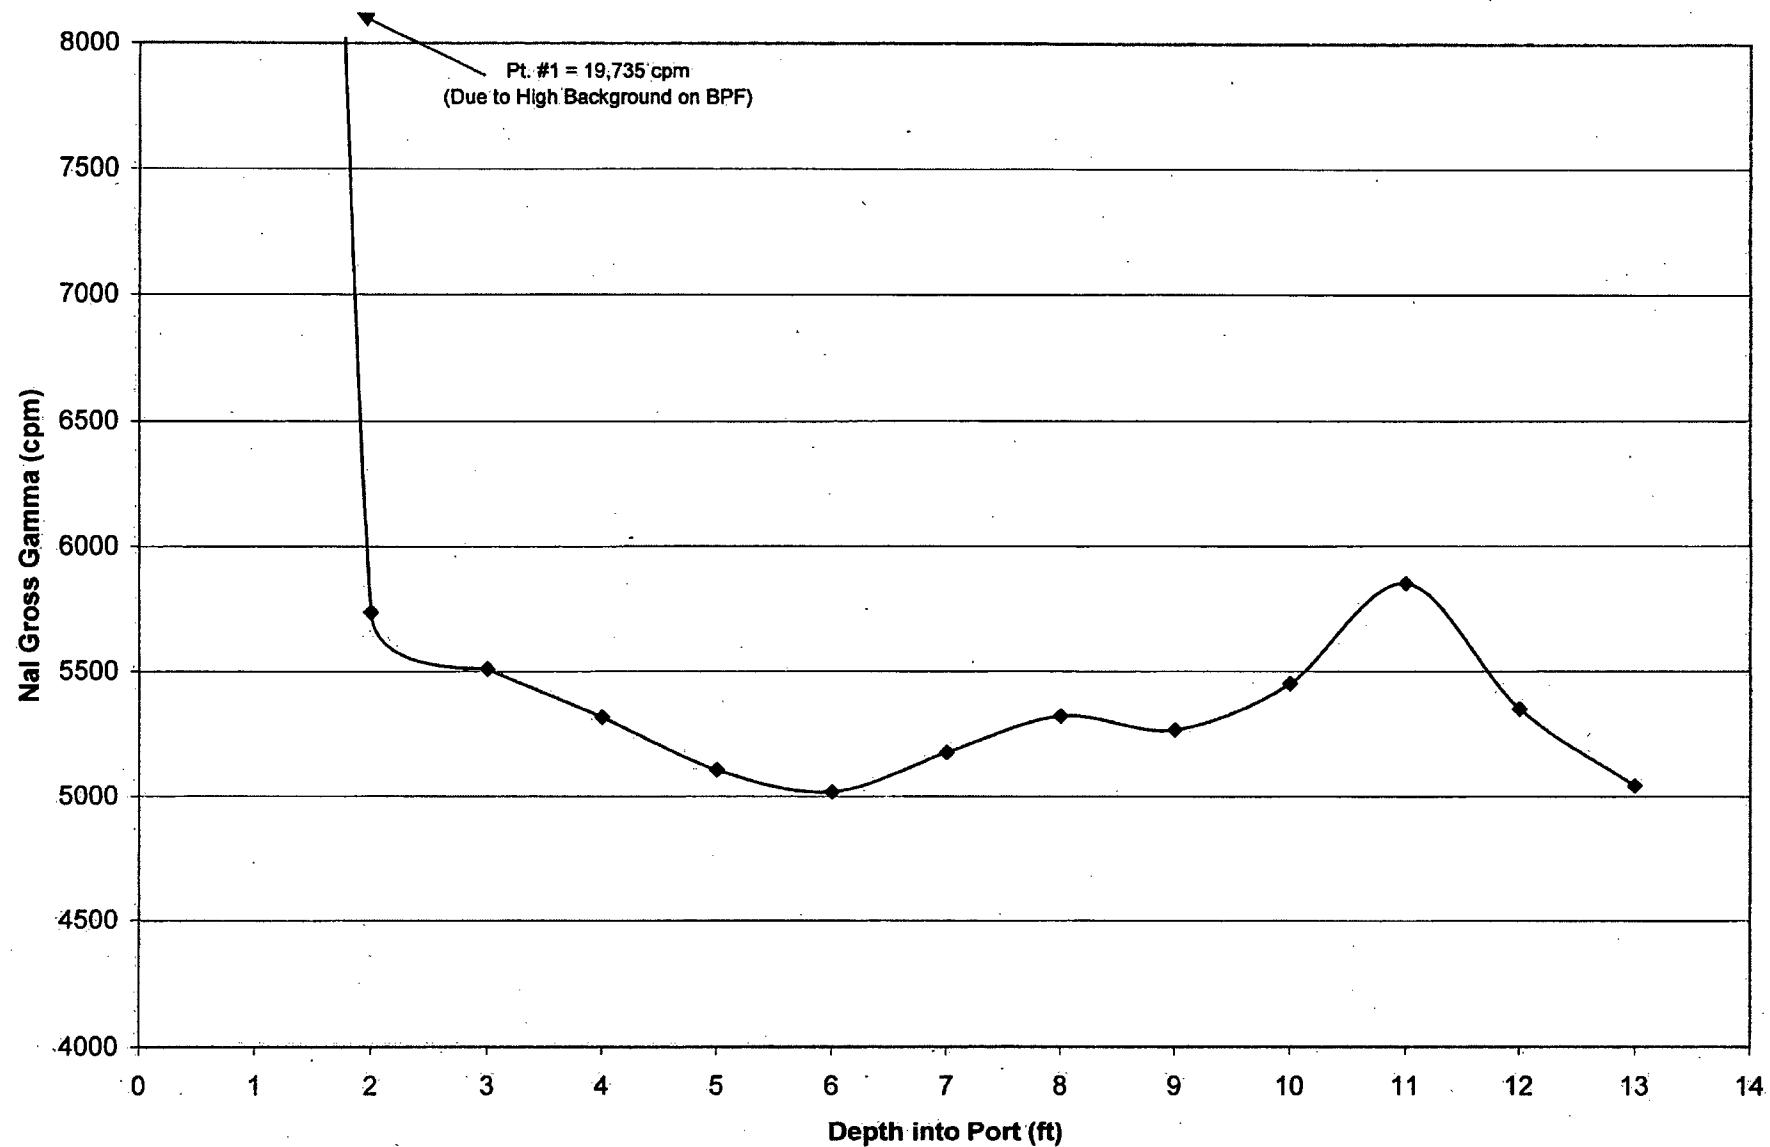


Surveyed: 08-29-2006

FNR Storage Port #9: NaI Gross Gamma vs Depth

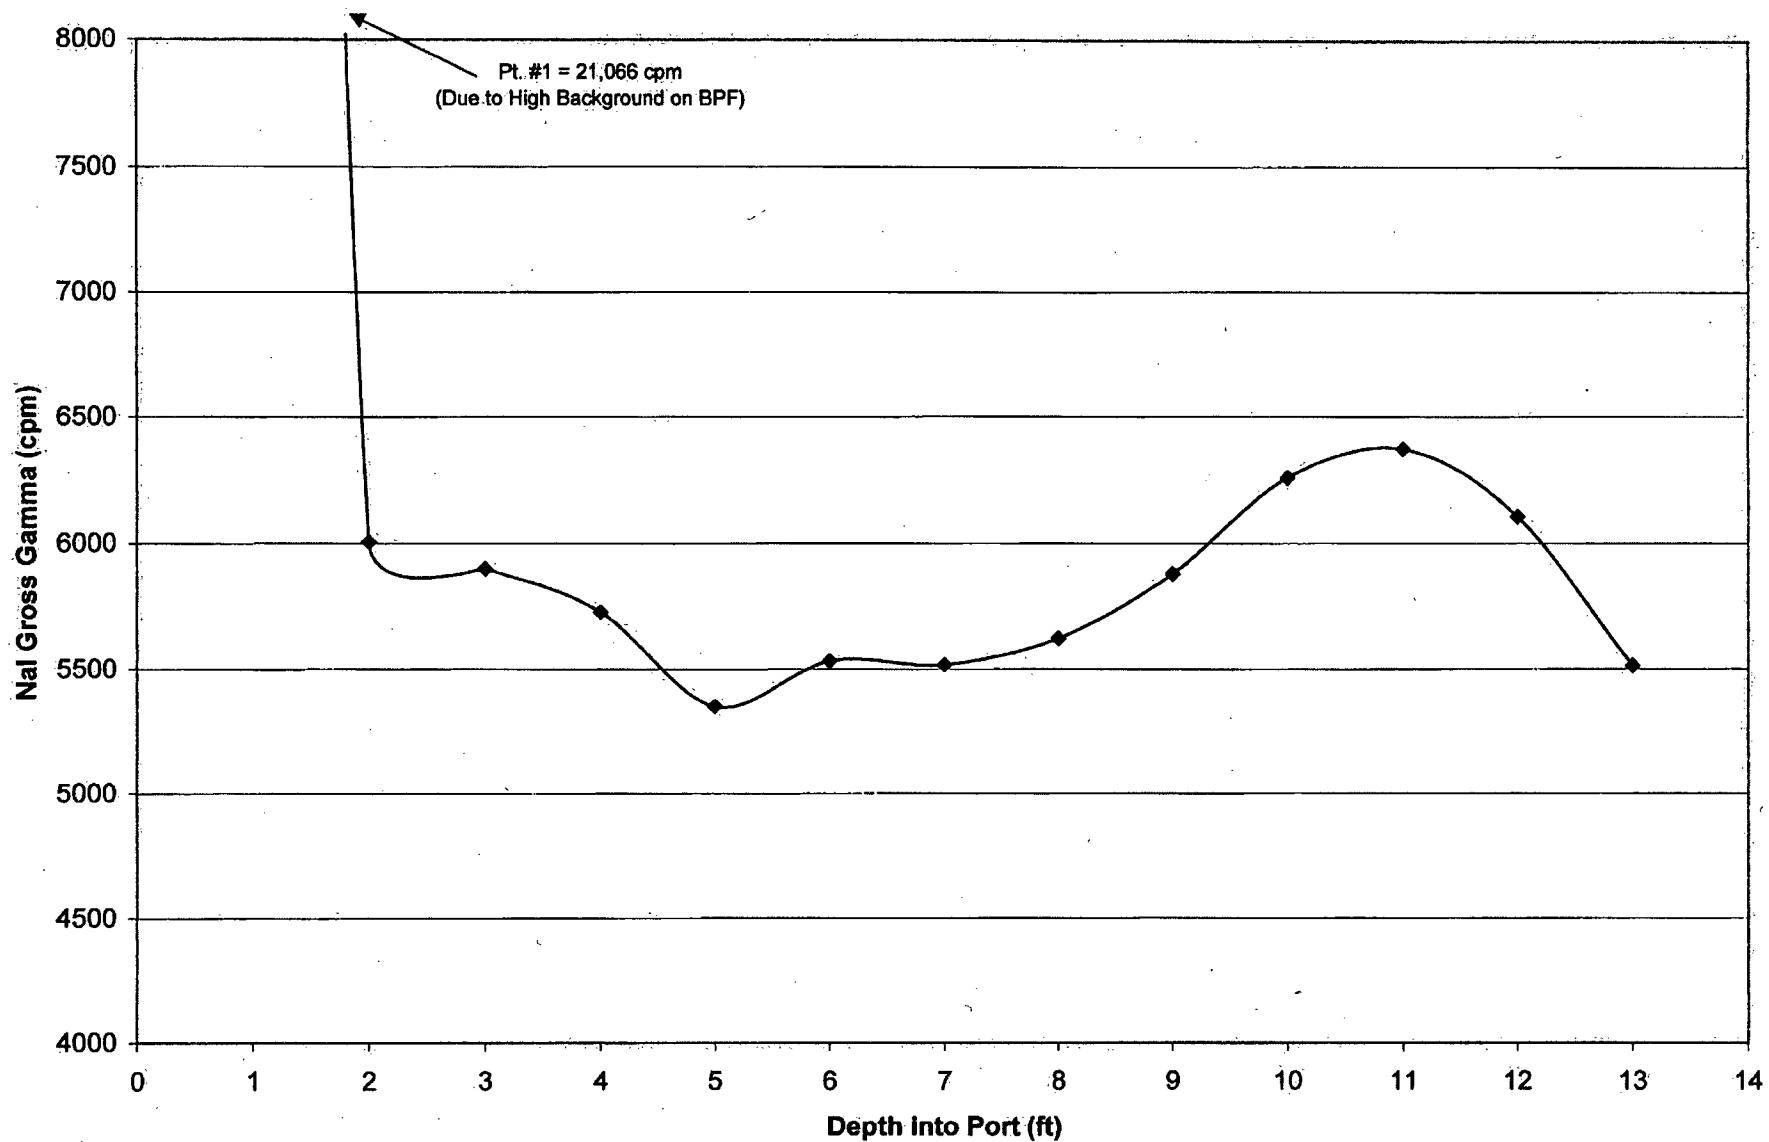


Surveyed: 08-30-2006

FNR Storage Port #10: NaI Gross Gamma vs Depth

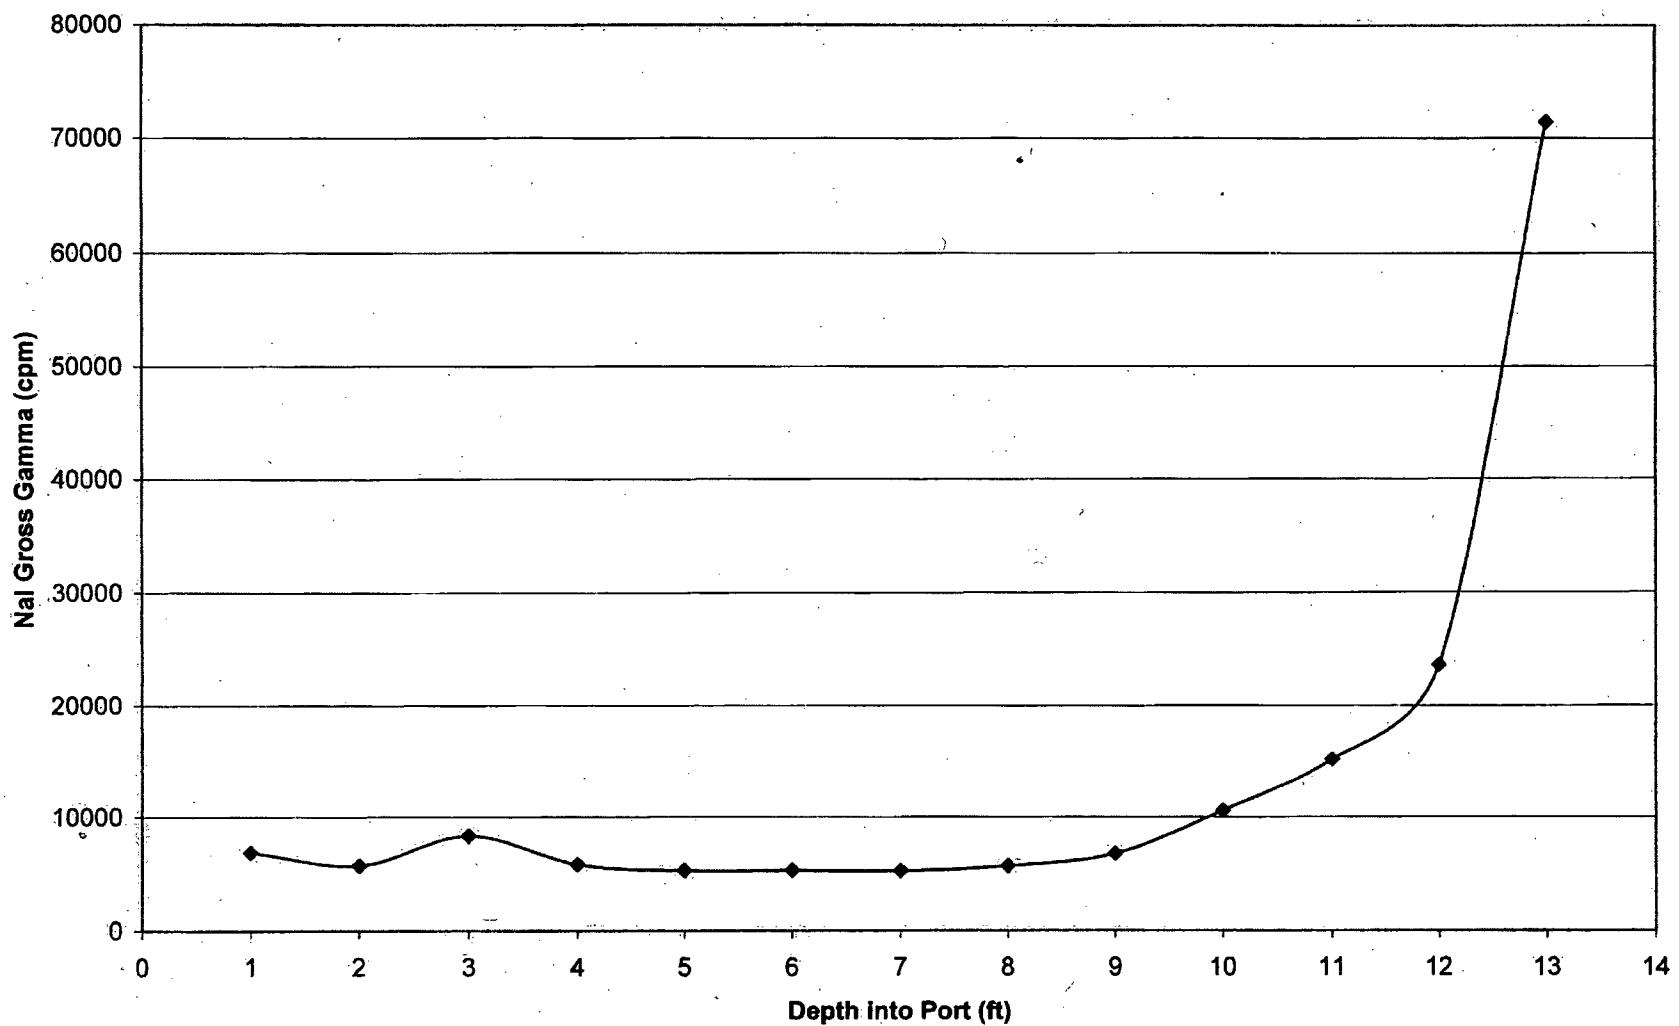


Surveyed: 05-17-2007

FNR Storage Port #11: NaI Gross Gamma vs Depth

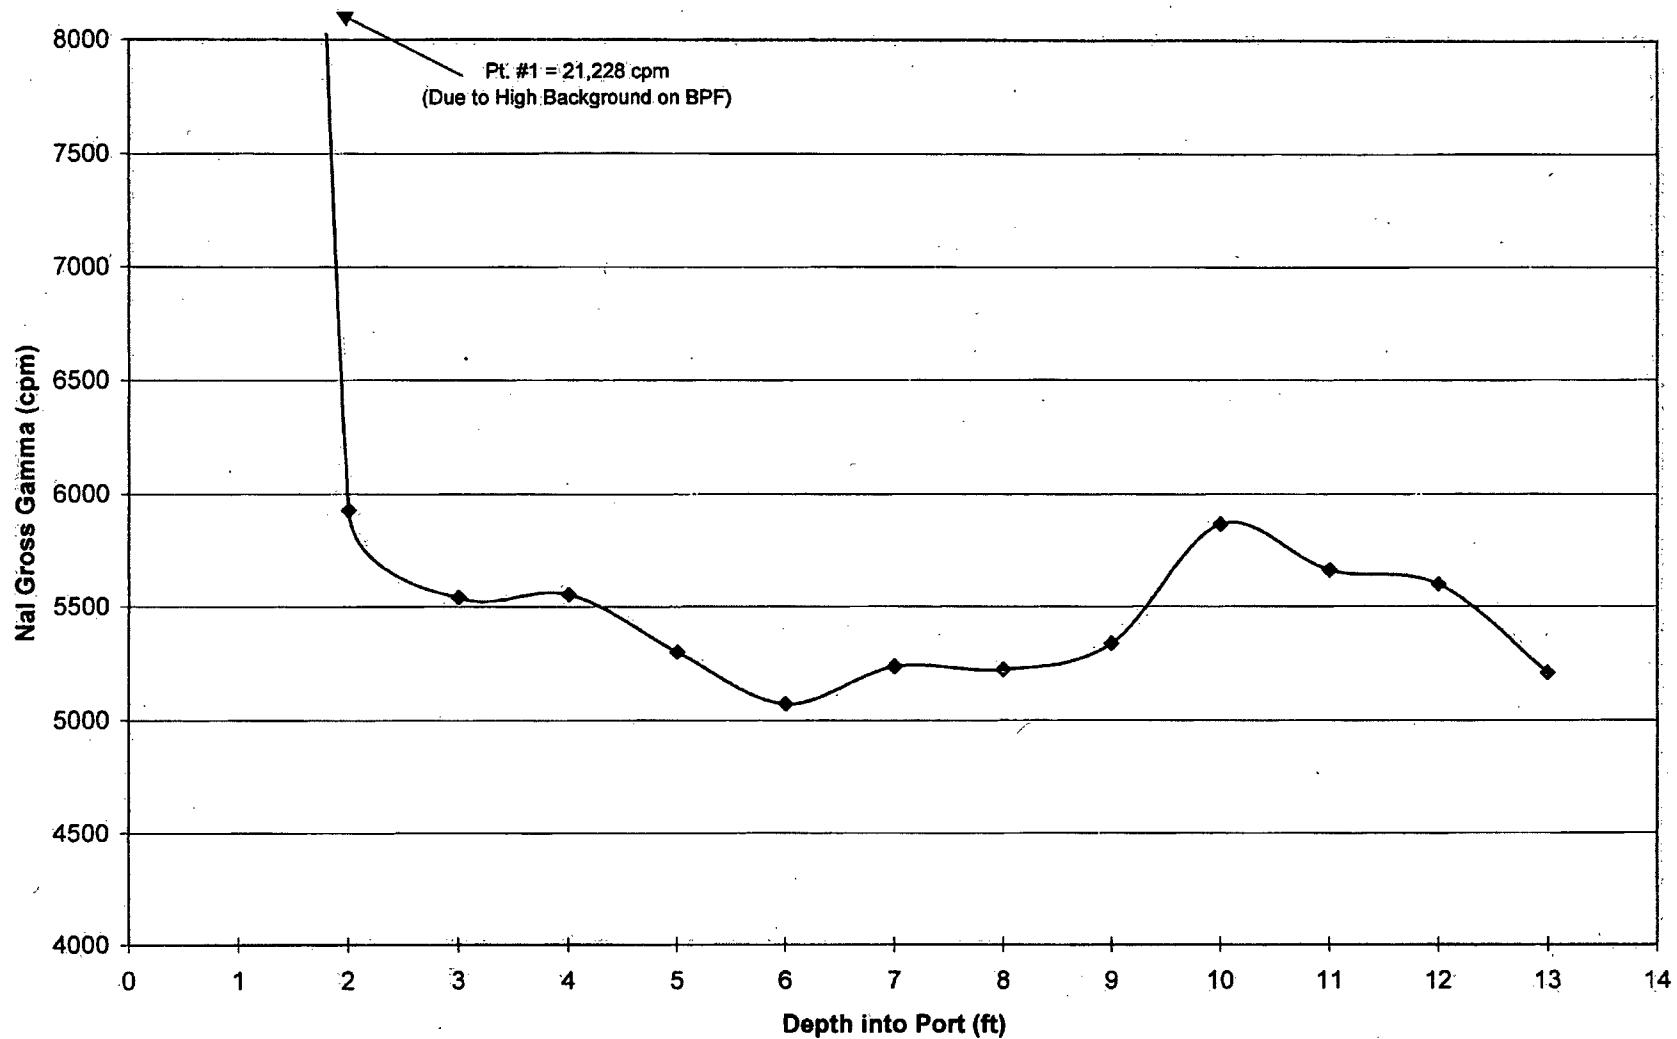


Surveyed: 08-30-2006

FNR Storage Port #12: NaI Gross Gamma vs Depth

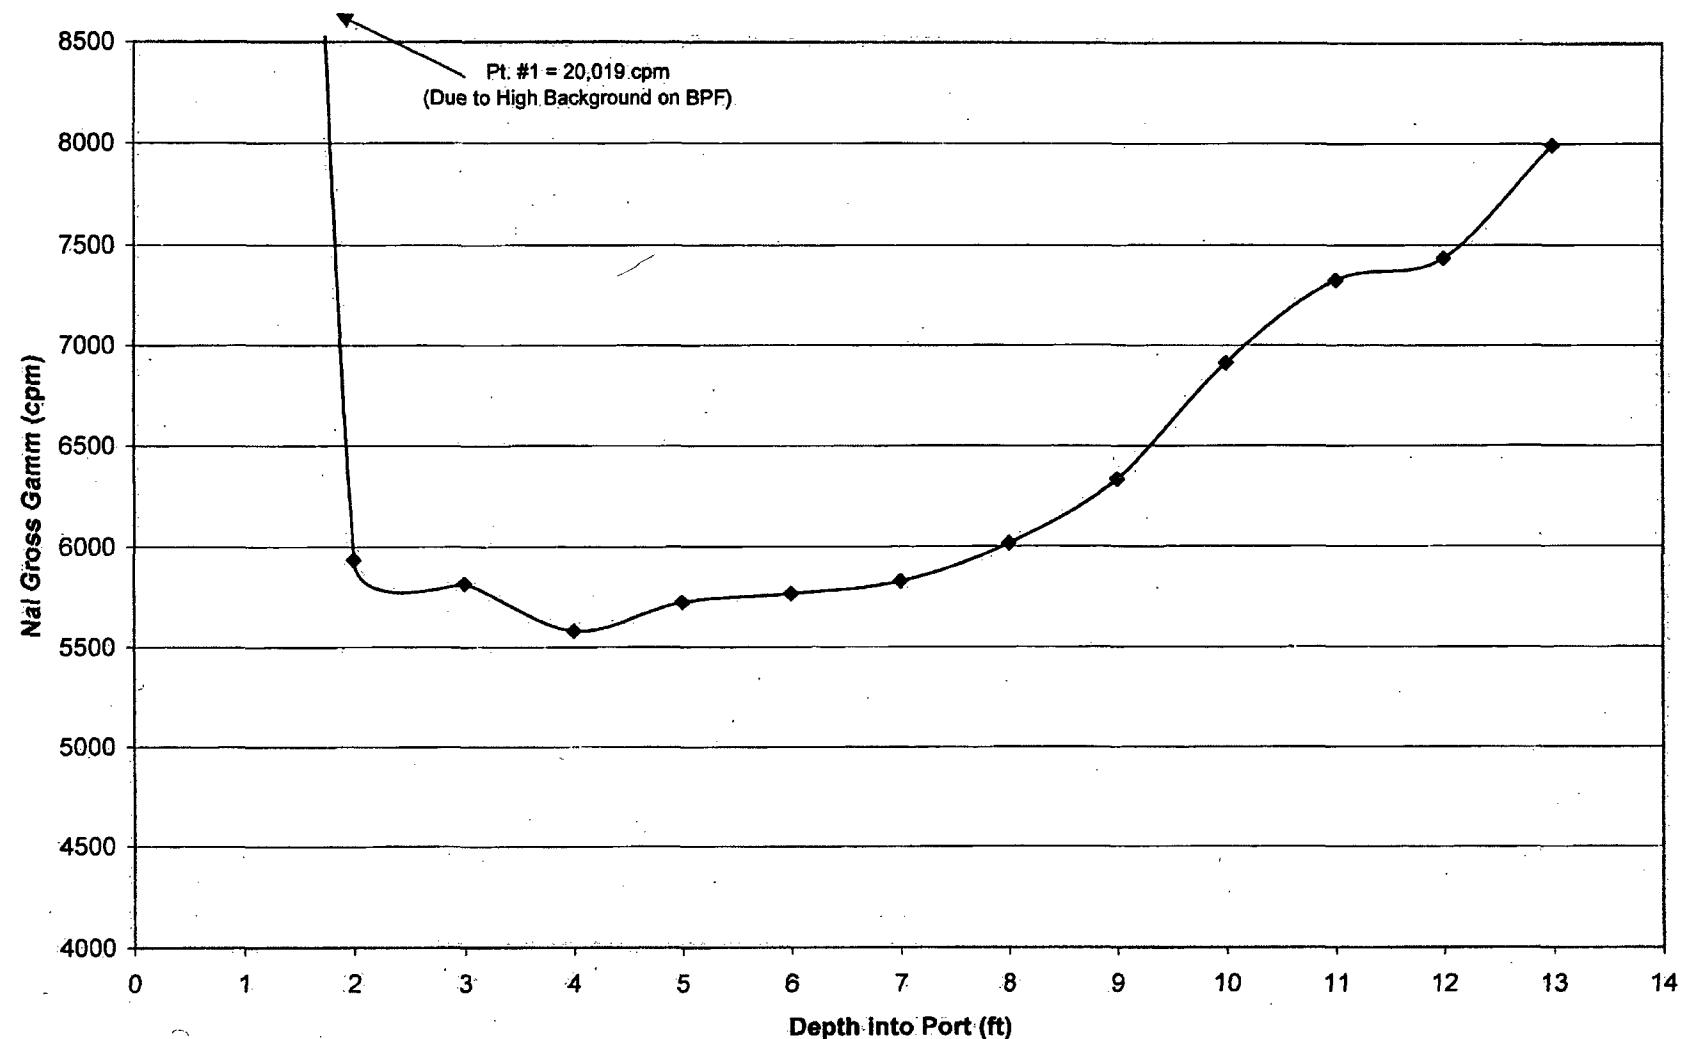


Surveyed: 08-30-2006

FNR Storage Port #13: NaI Gross Gamma vs Depth

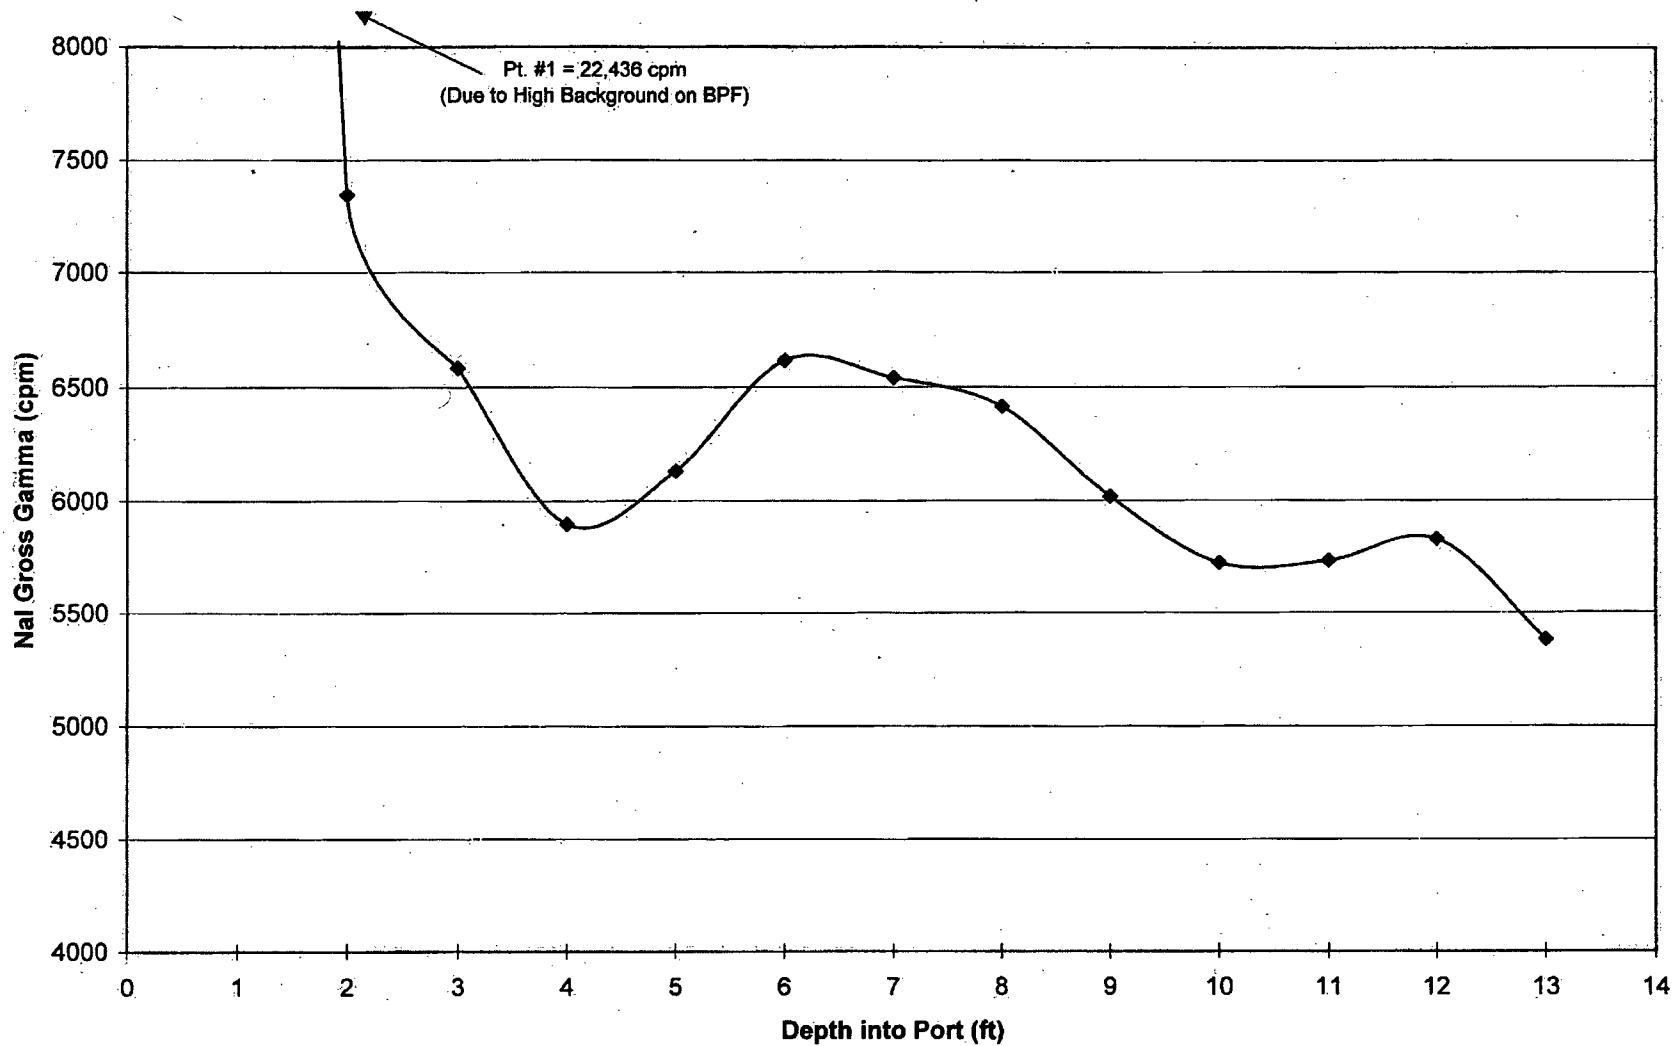


Surveyed: 08-30-2006

FNR Storage Port #14: NaI Gross Gamma vs Depth

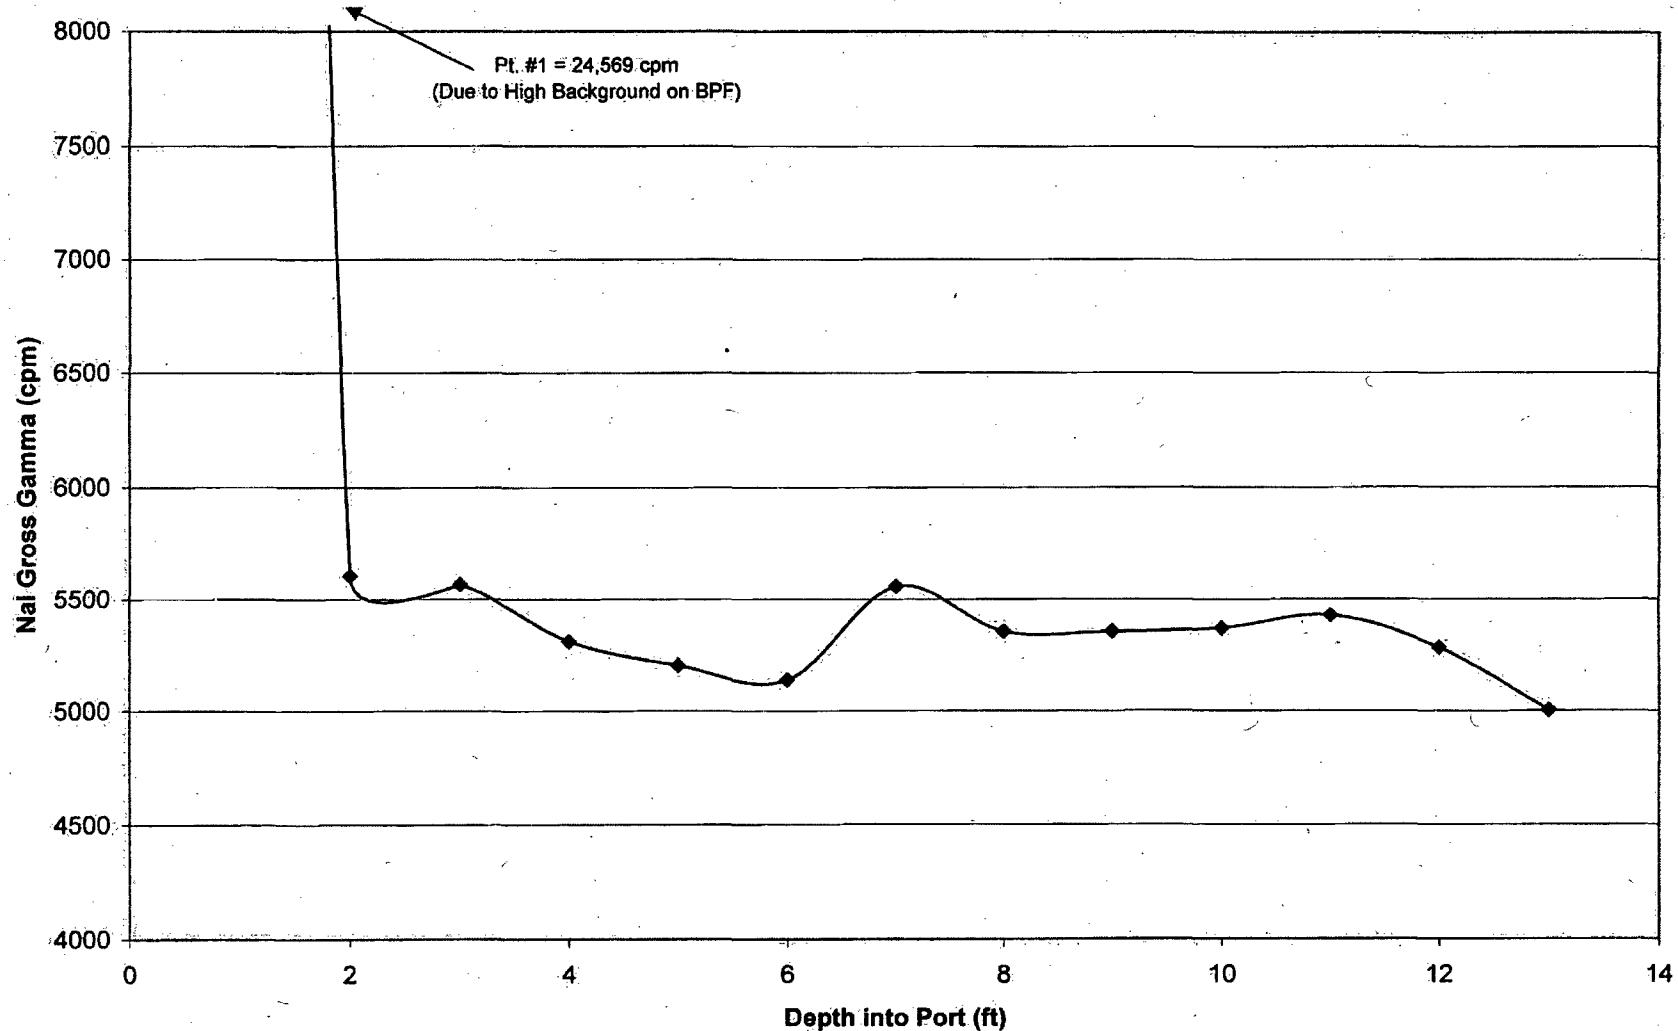


Surveyed: 08-30-2006

FNR Storage Port #15: NaI Gross Gamma vs Depth

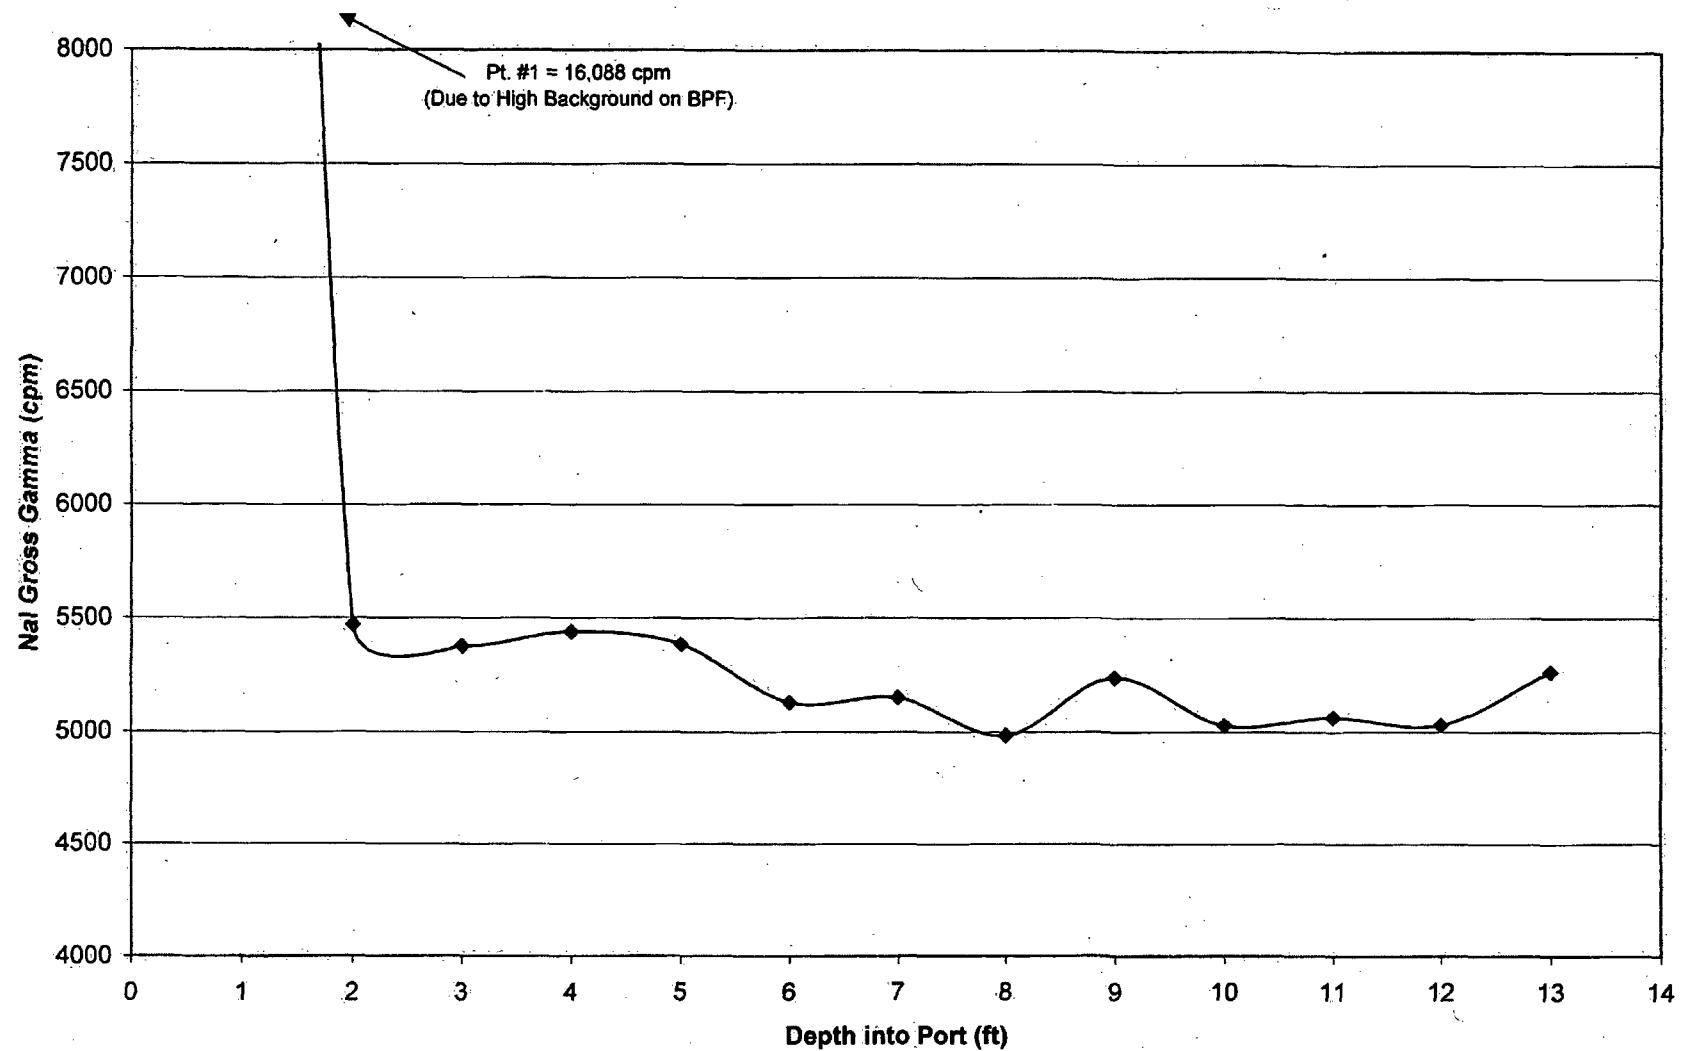


Surveyed: 08-30-2006

FNR Storage Port #16: NaI Gross Gamma vs Depth

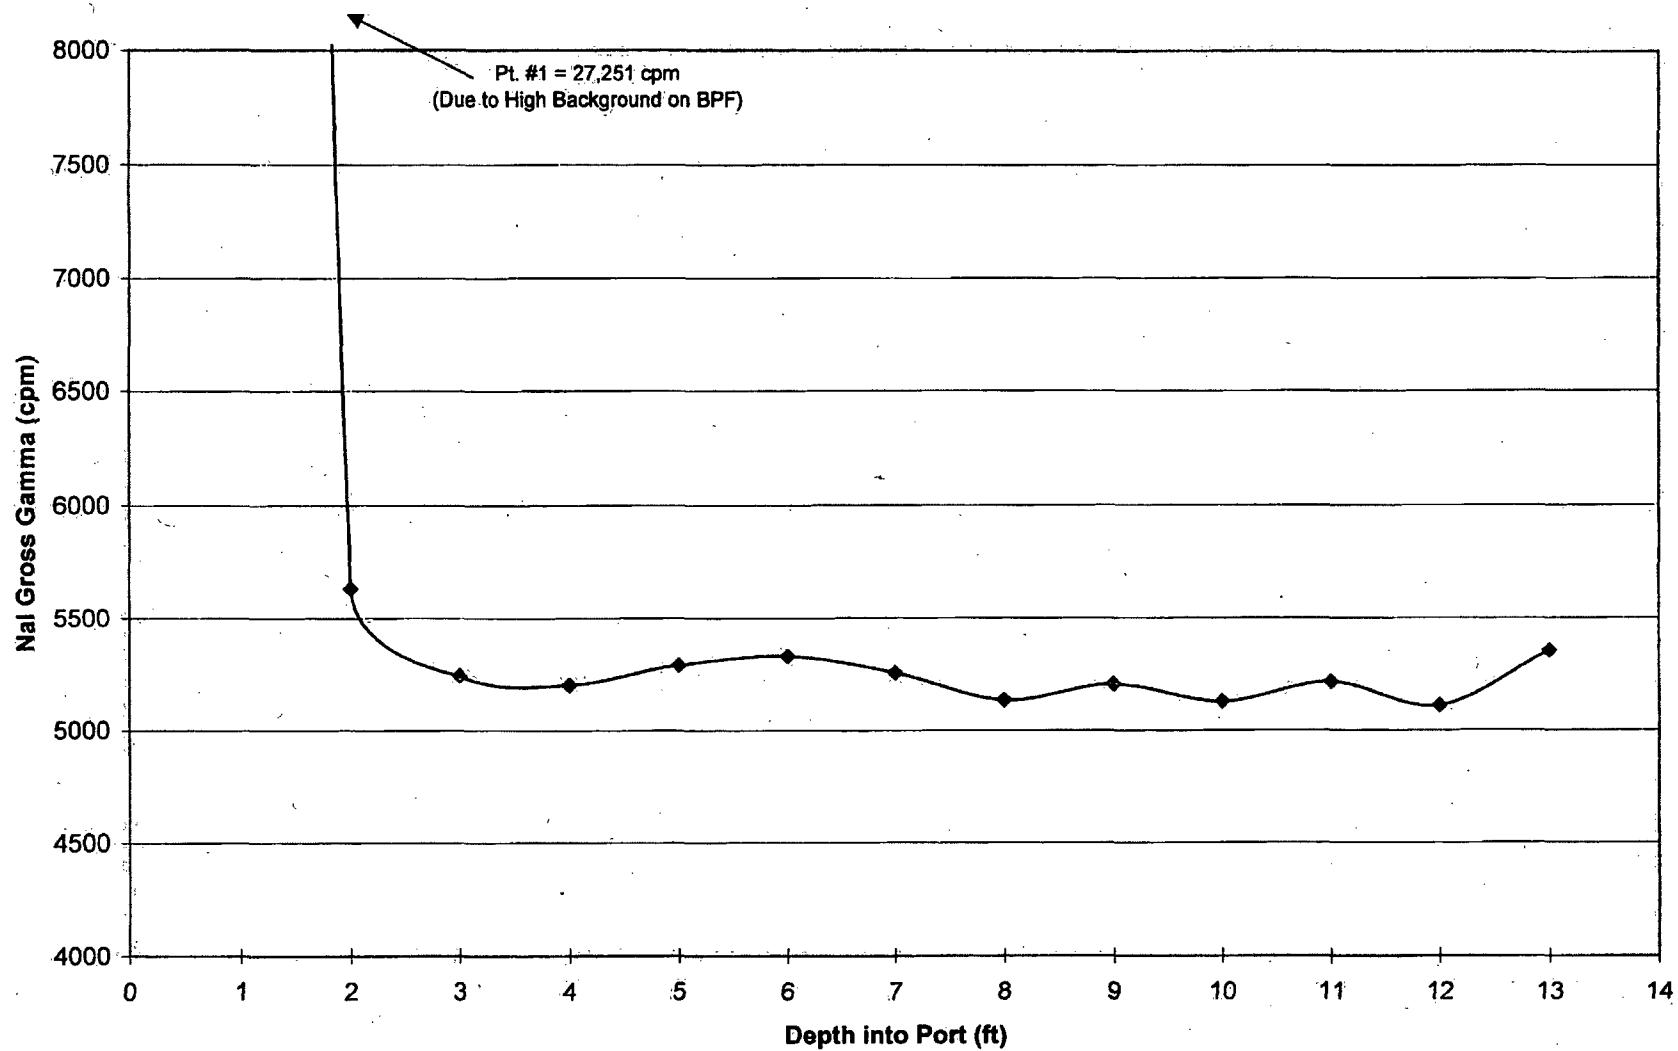


Surveyed: 08-30-2006

FNR Storage Port #17: NaI Gross Gamma vs Depth

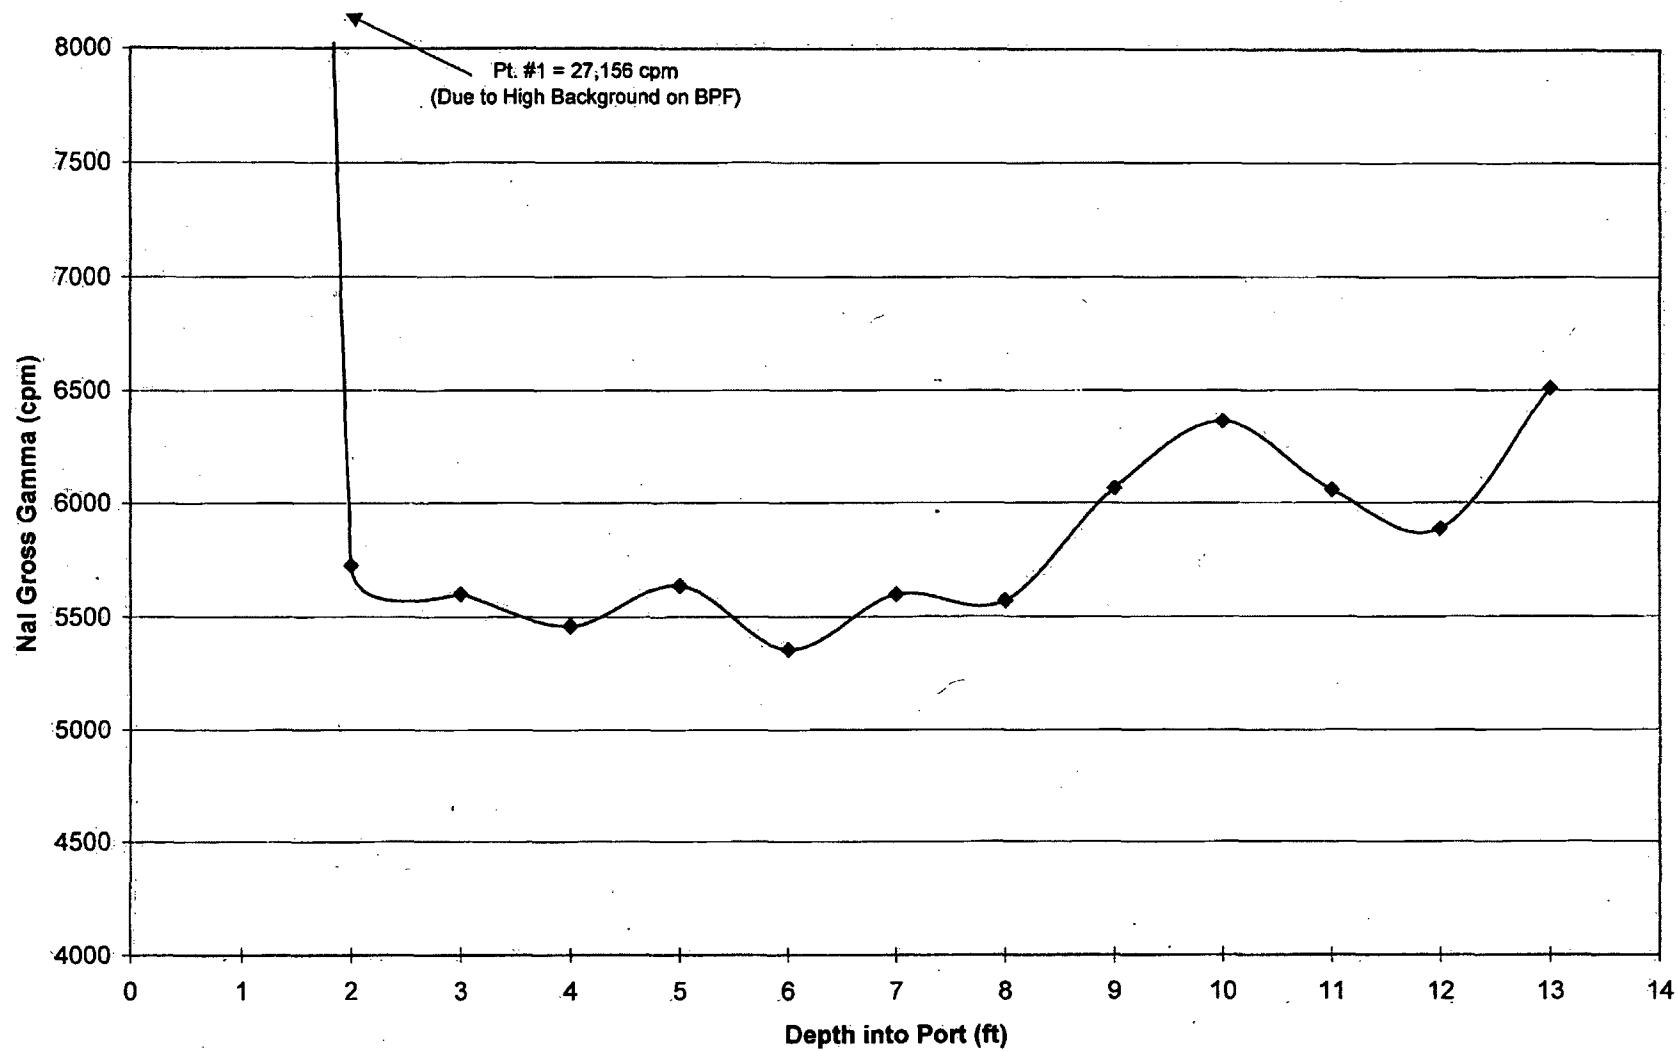


Surveyed: 08-30-2006

FNR Storage Port #18: NaI Gross Gamma vs Depth

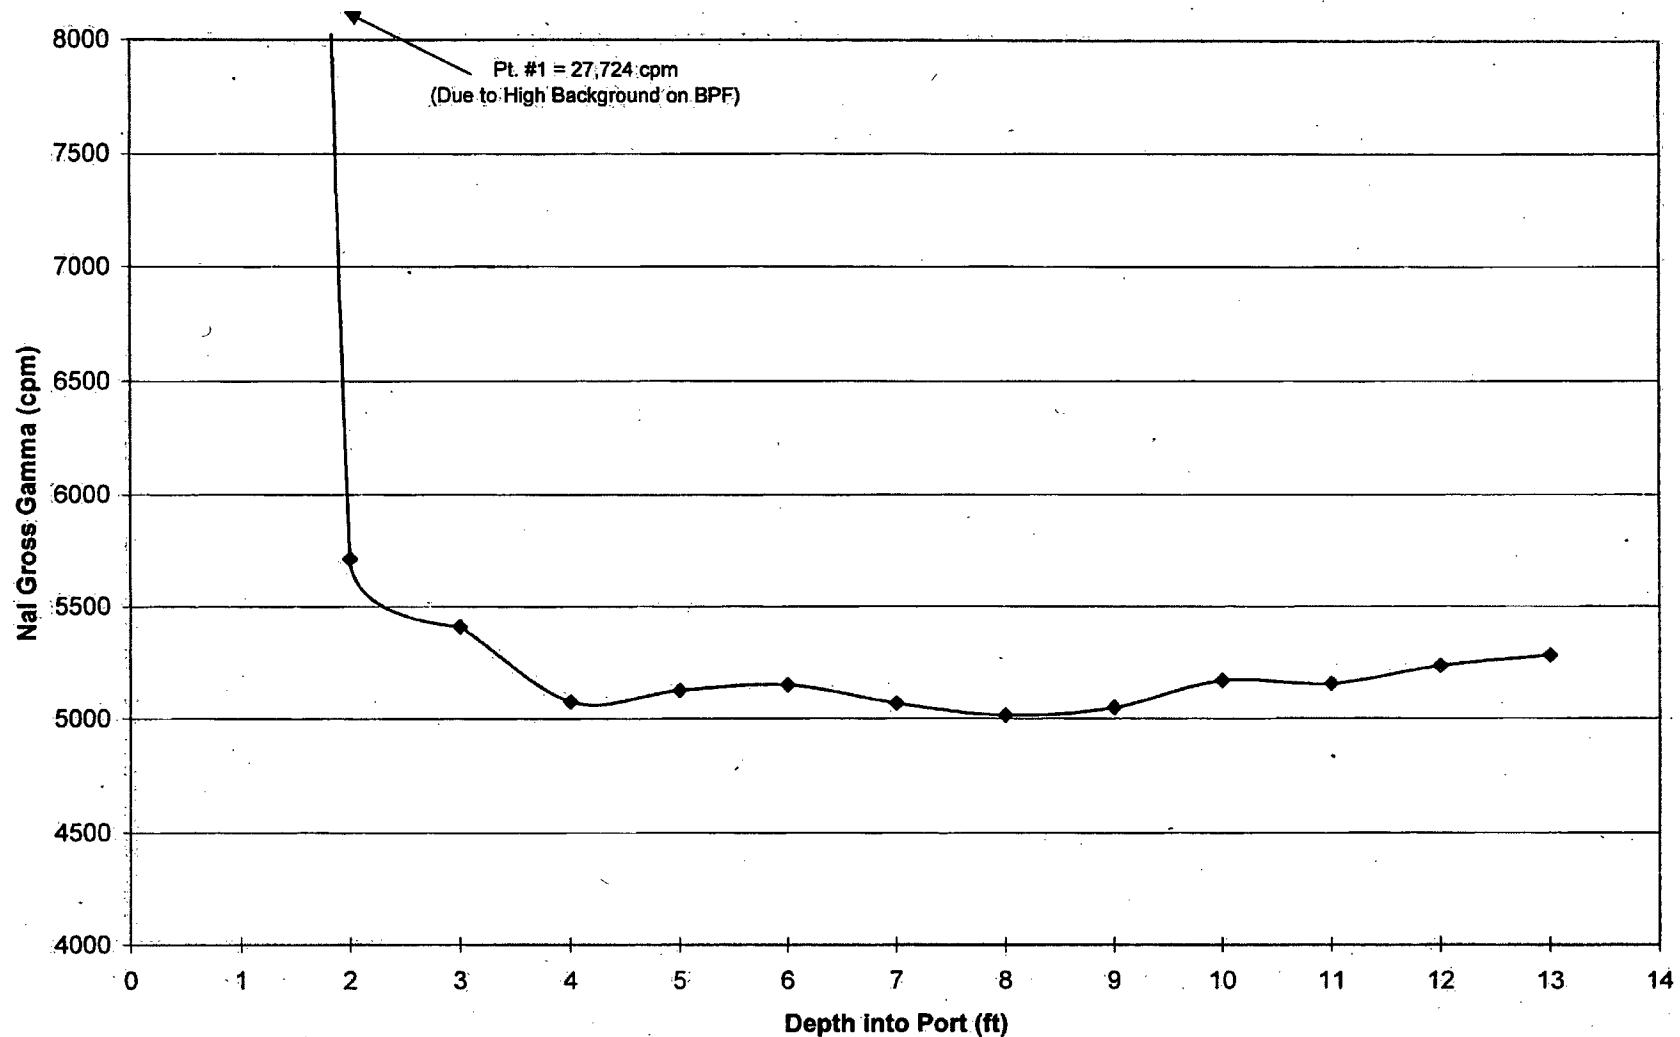


Surveyed: 08-30-2006

FNR Storage Port #19: NaI Gross Gamma vs Depth

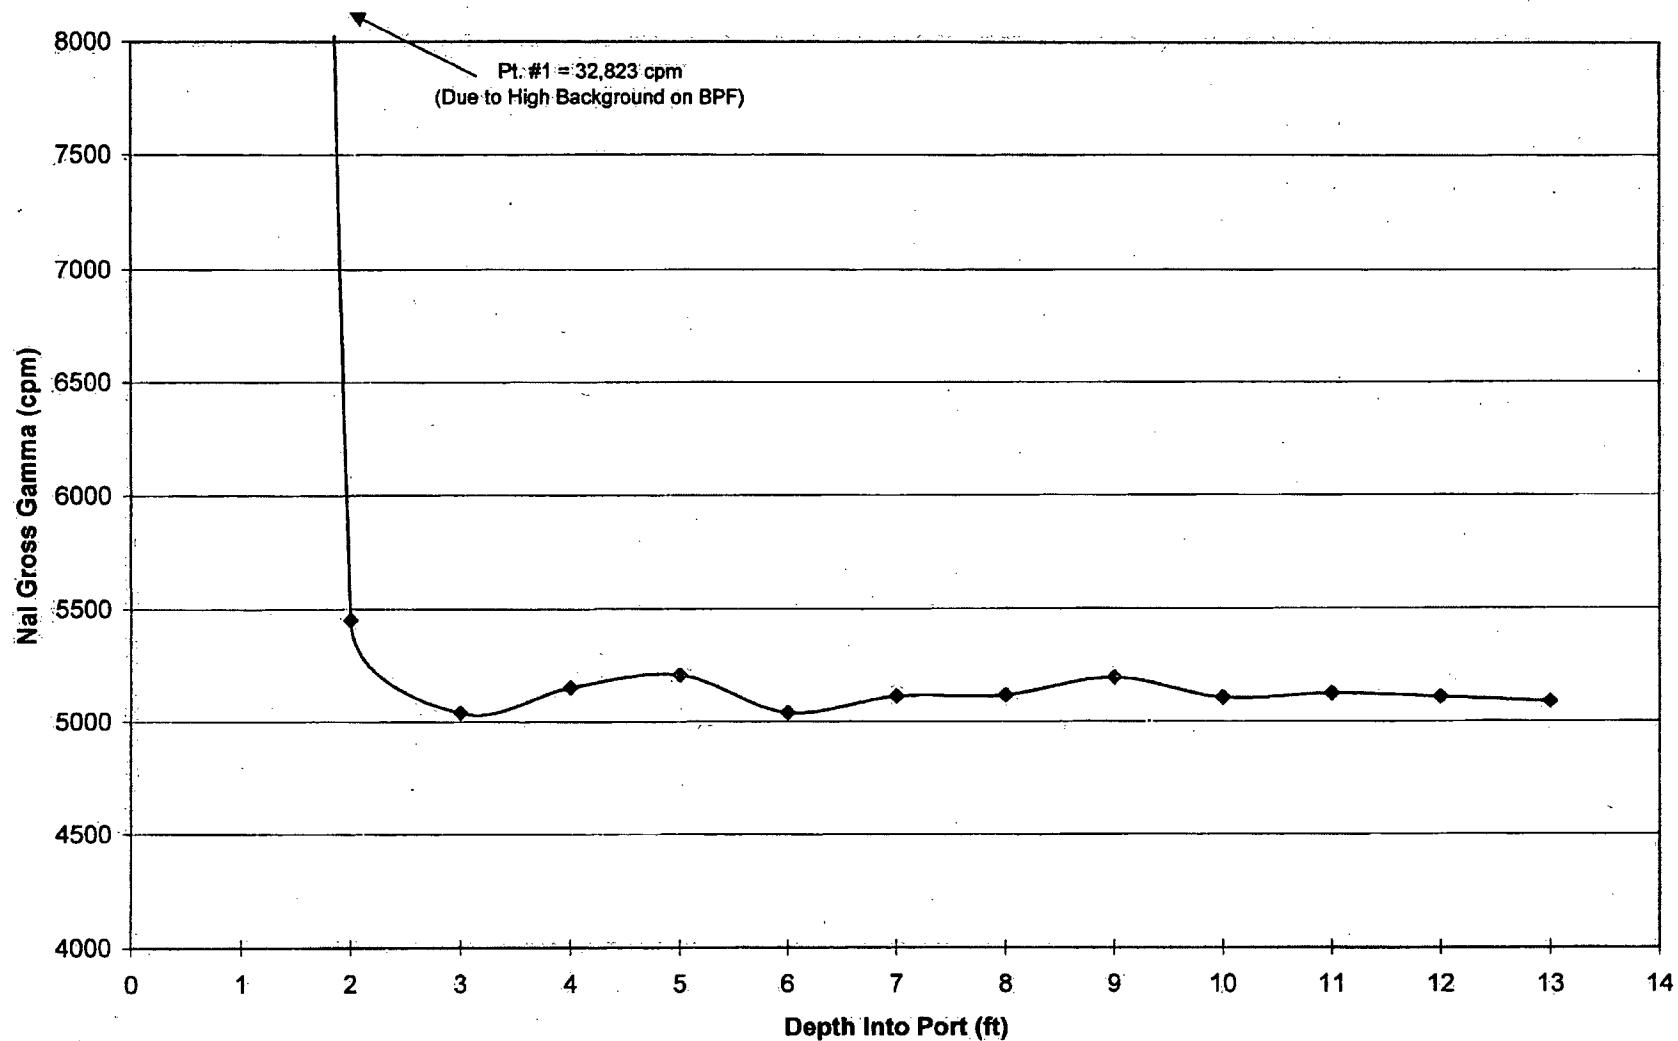


Surveyed: 08-31-2006

FNR Storage Port #20: Nal Gross Gamma vs Depth

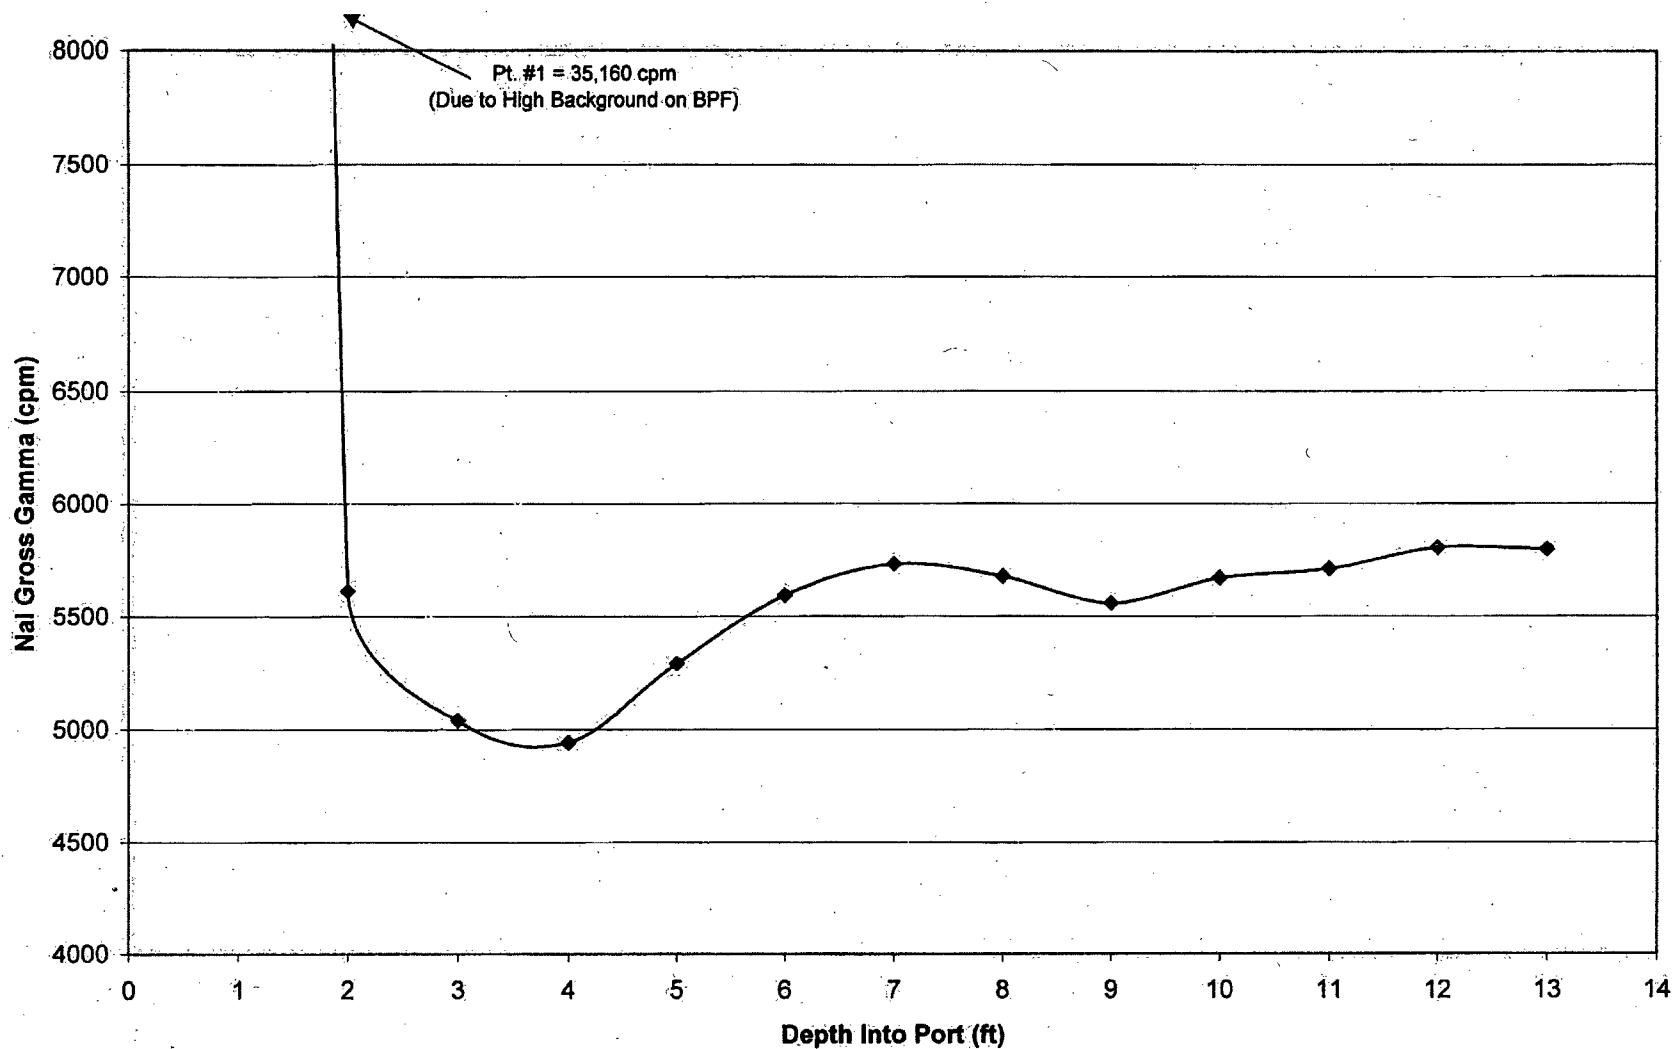


Surveyed: 08-31-2006

FNR Storage Port #21: NaI Gross Gamma vs Depth

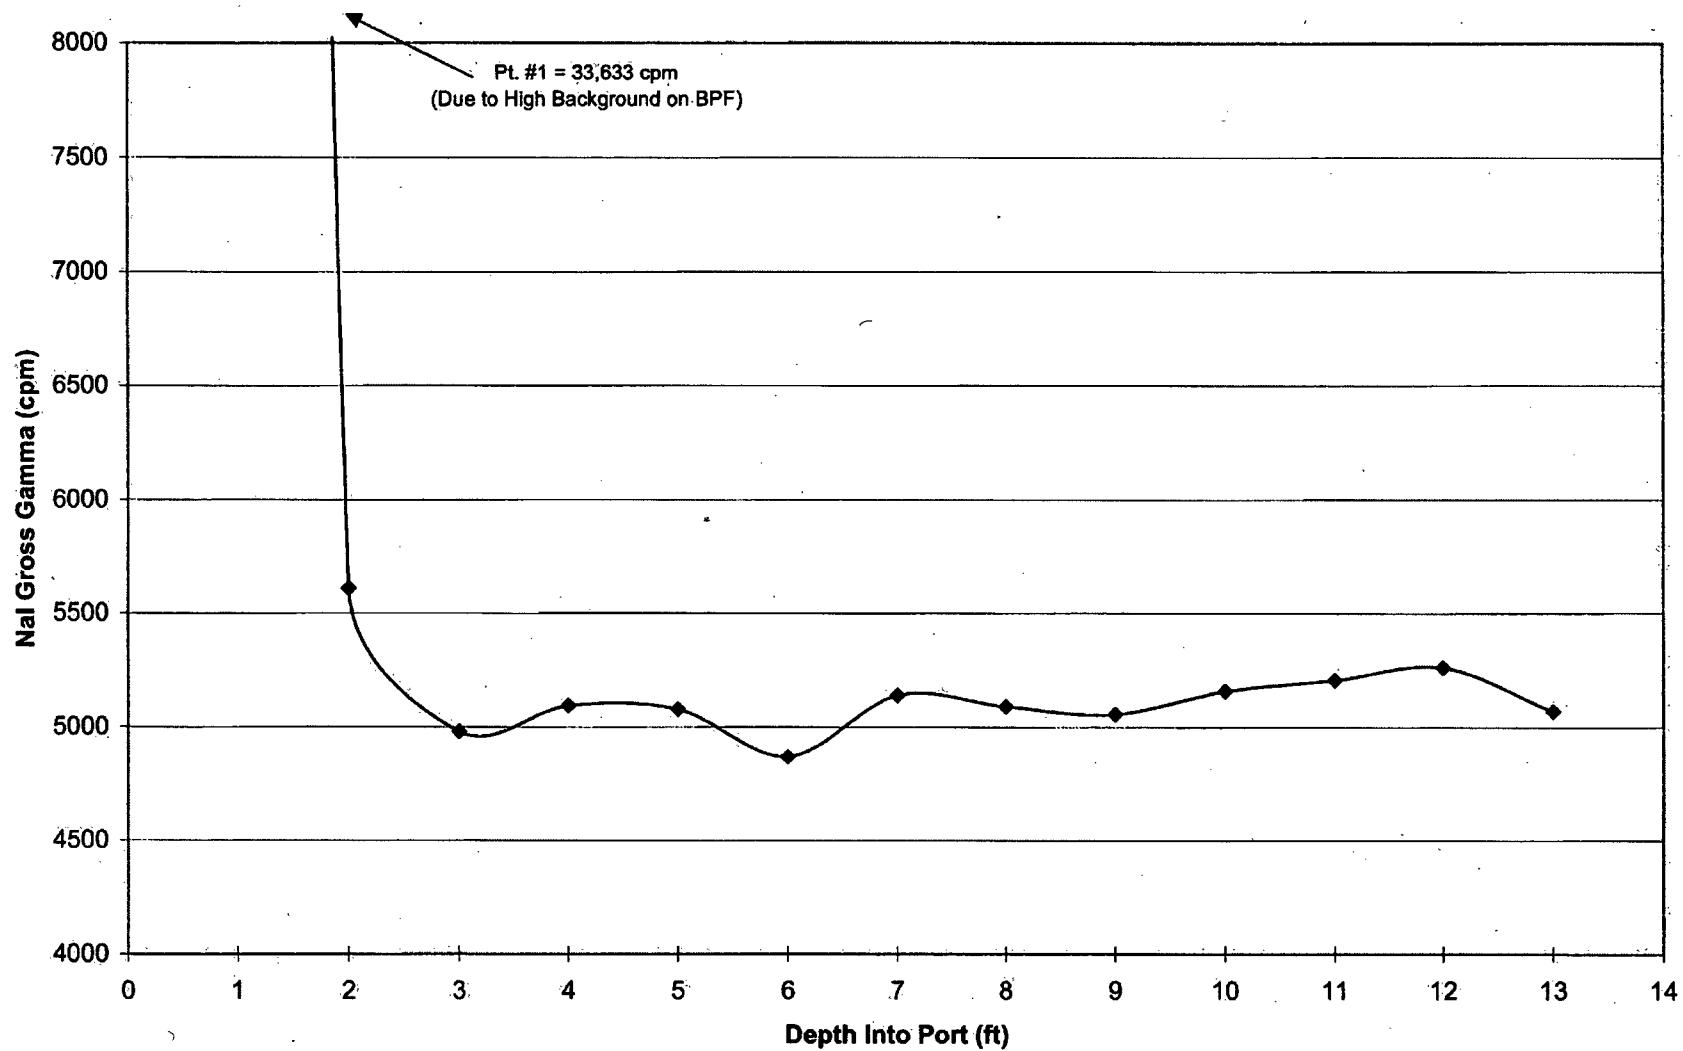


Surveyed: 08-31-2006

FNR Storage Port #22: NaI Gross Gamma vs Depth

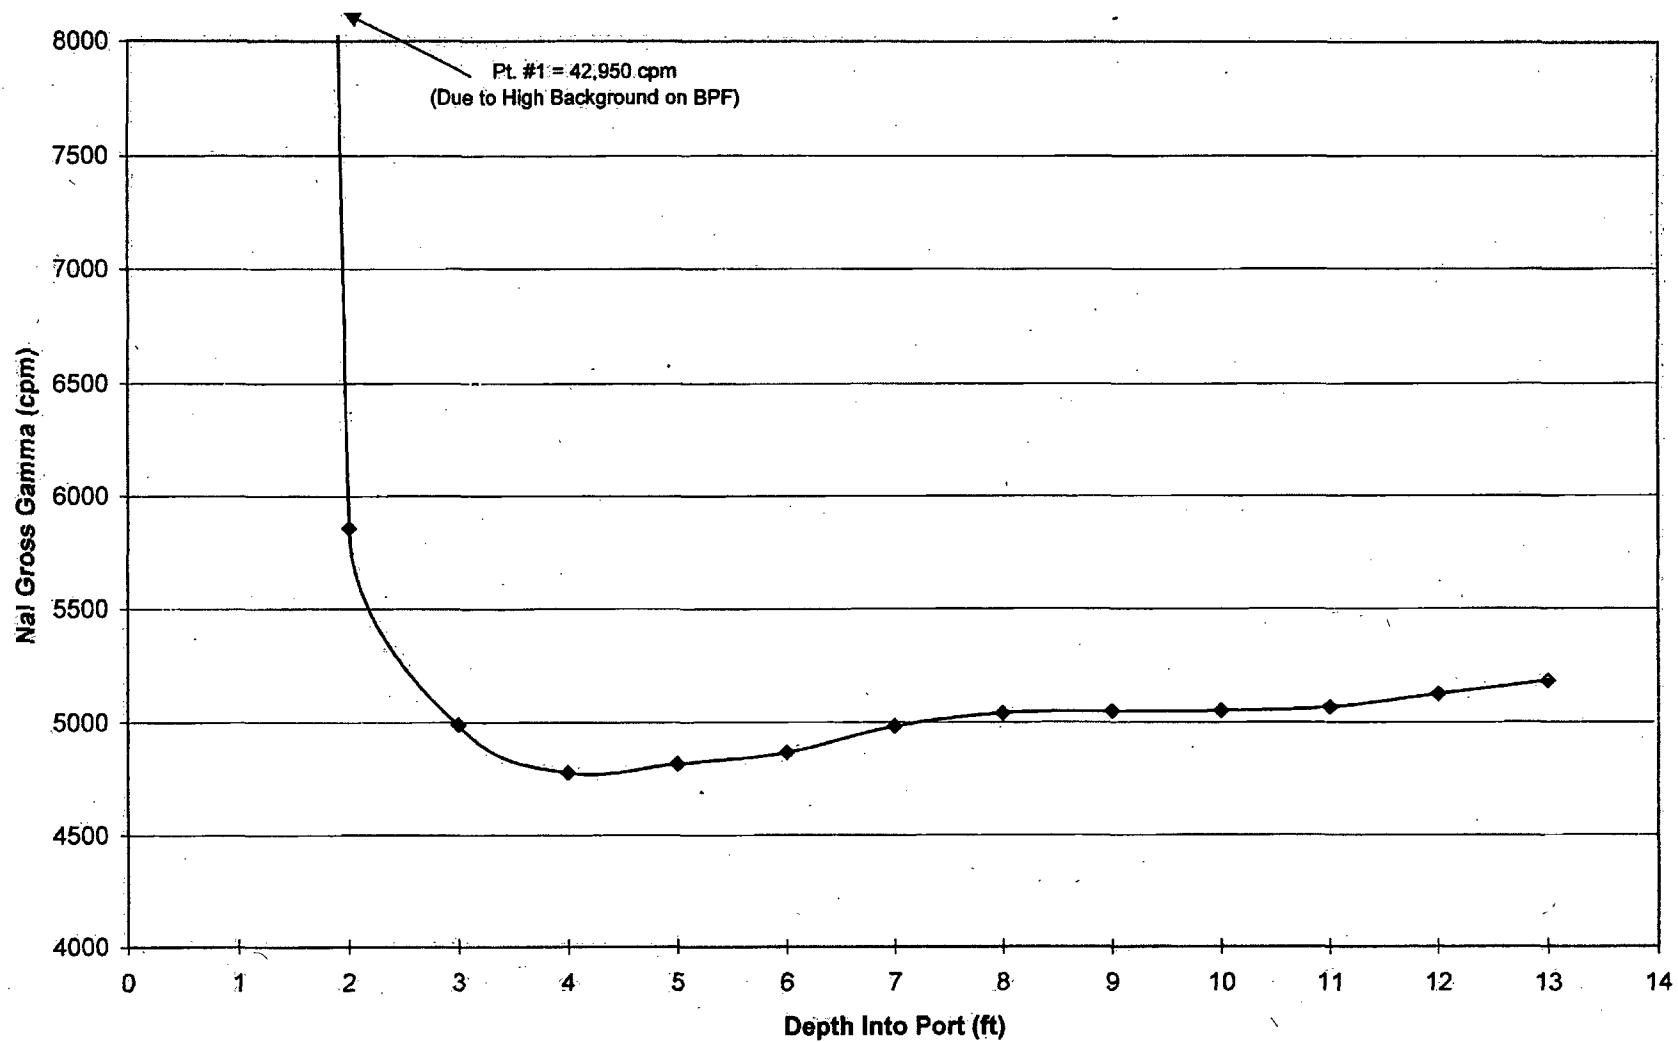


Surveyed: 08-31-2006

FNR Storage Port #23: NaI Gross Gamma vs Depth

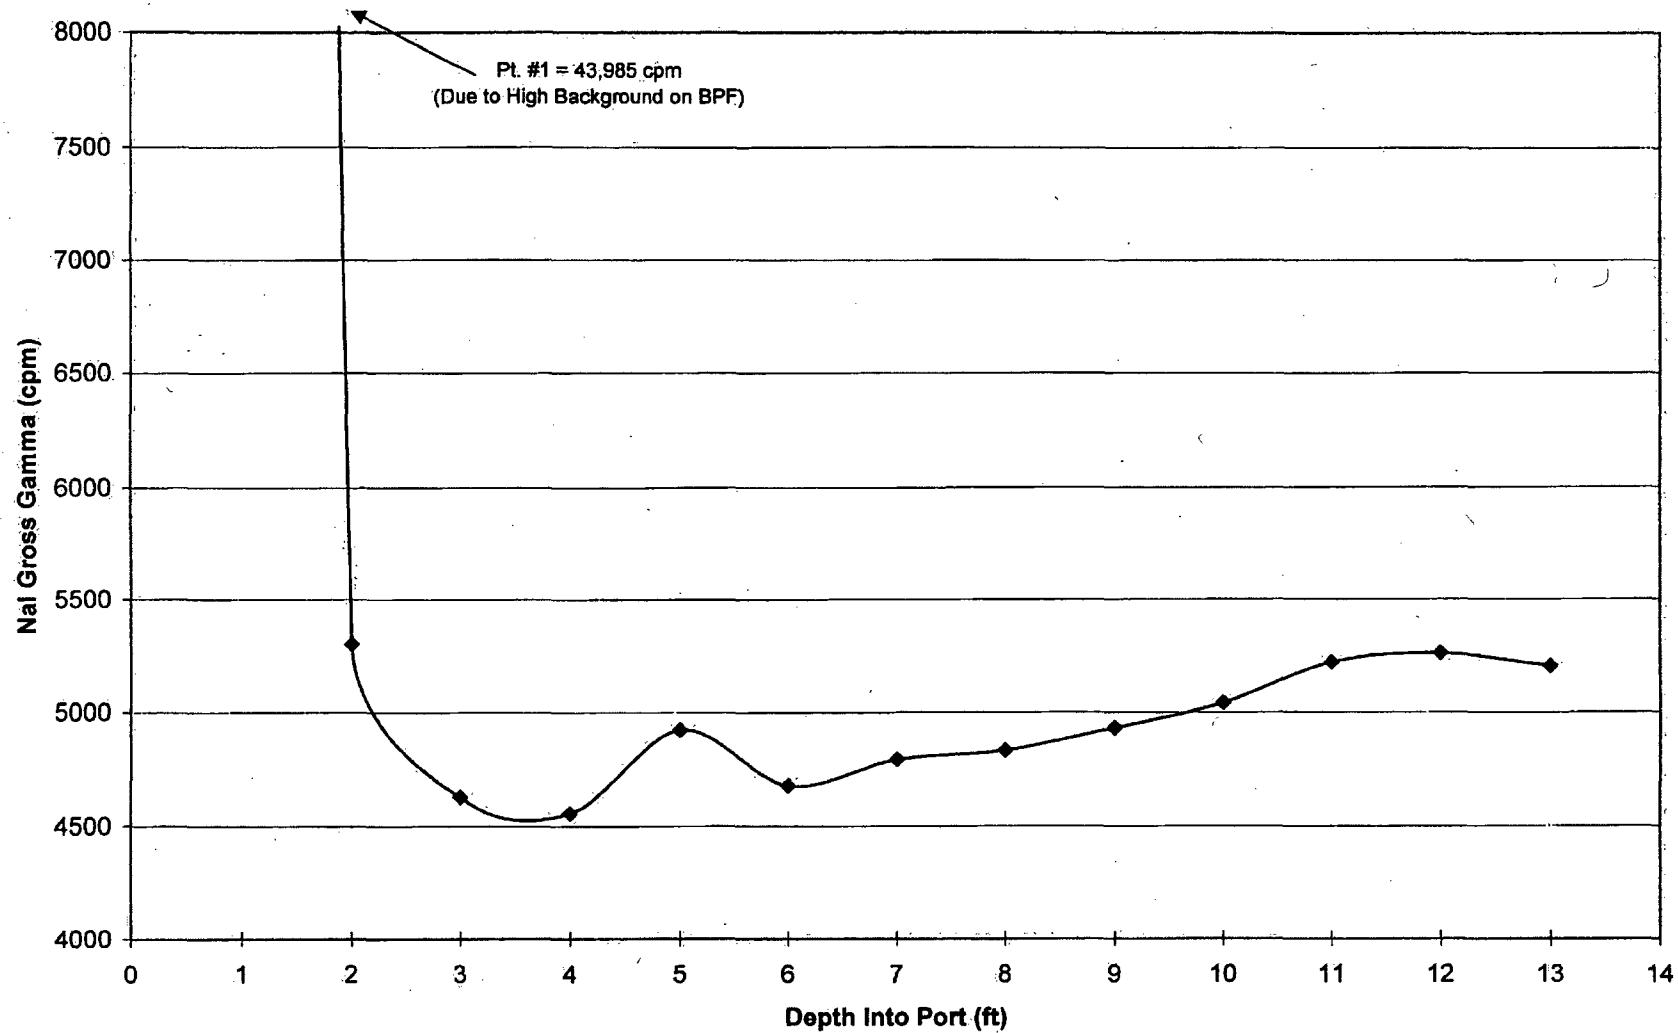


Surveyed: 08-31-2006

FNR Storage Port #24: NaI Gross Gamma vs Depth

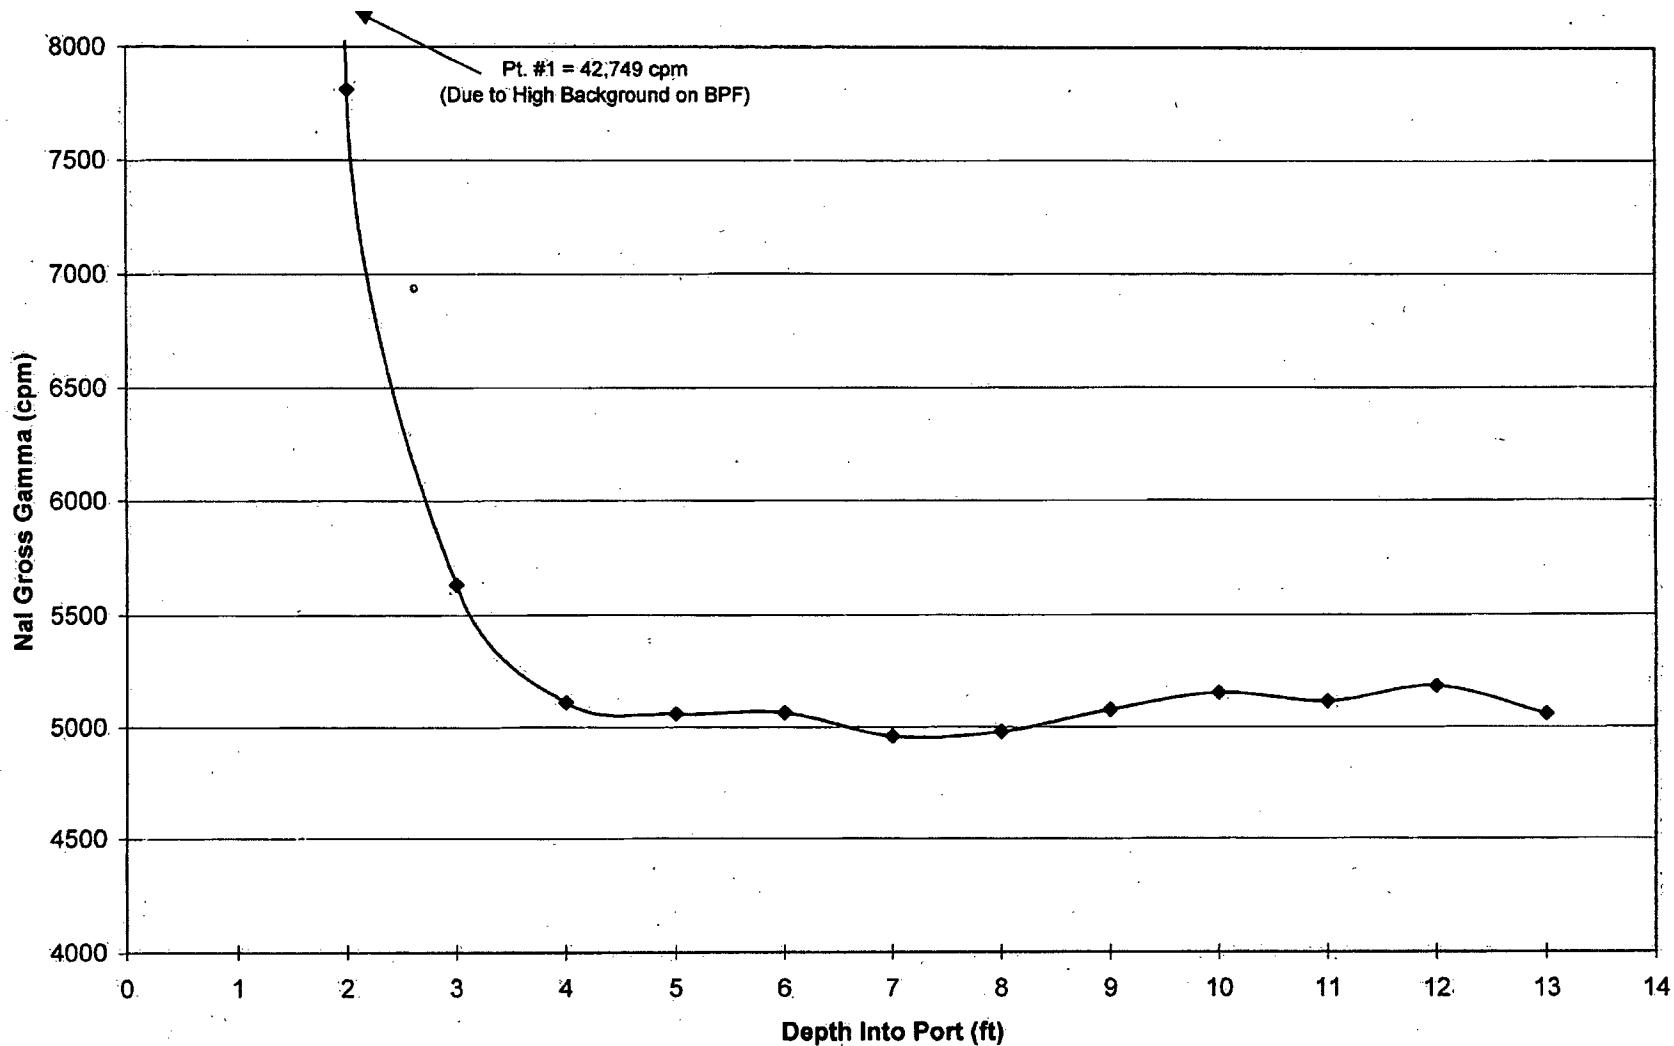


Surveyed: 08-31-2006

FNR Storage Port #25: NaI Gross Gamma vs Depth

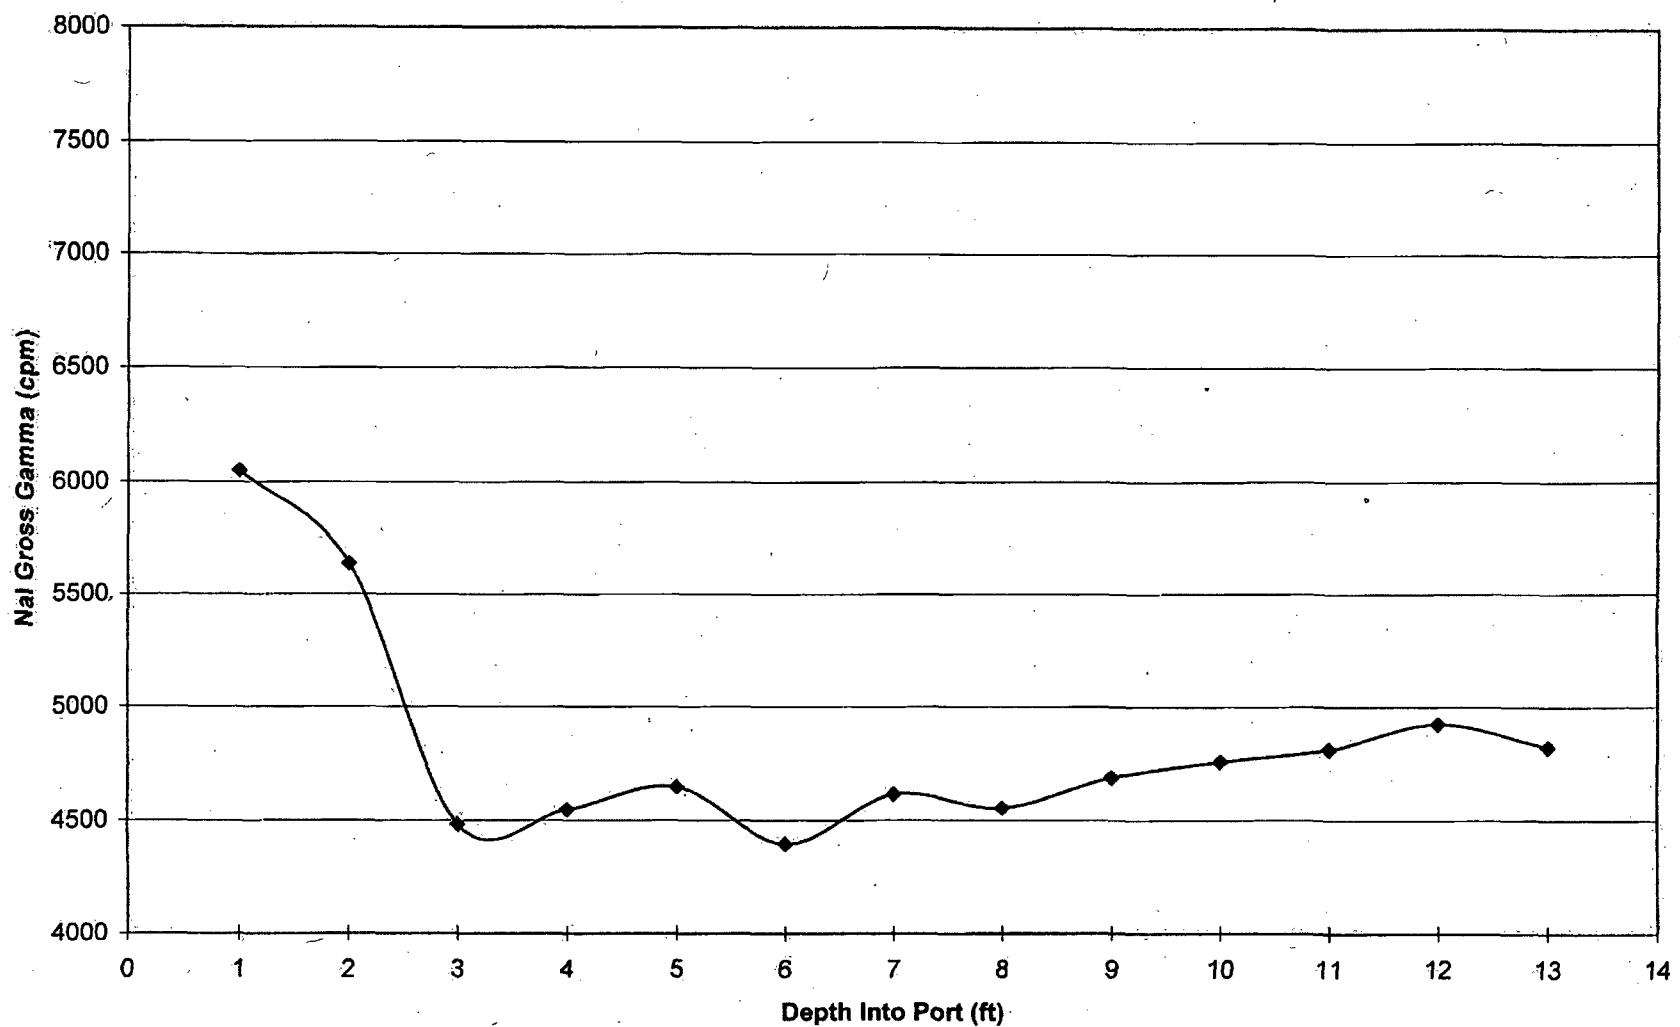


Surveyed: 05-17-2007

FNR Storage Port #26: NaI Gross Gamma vs Depth

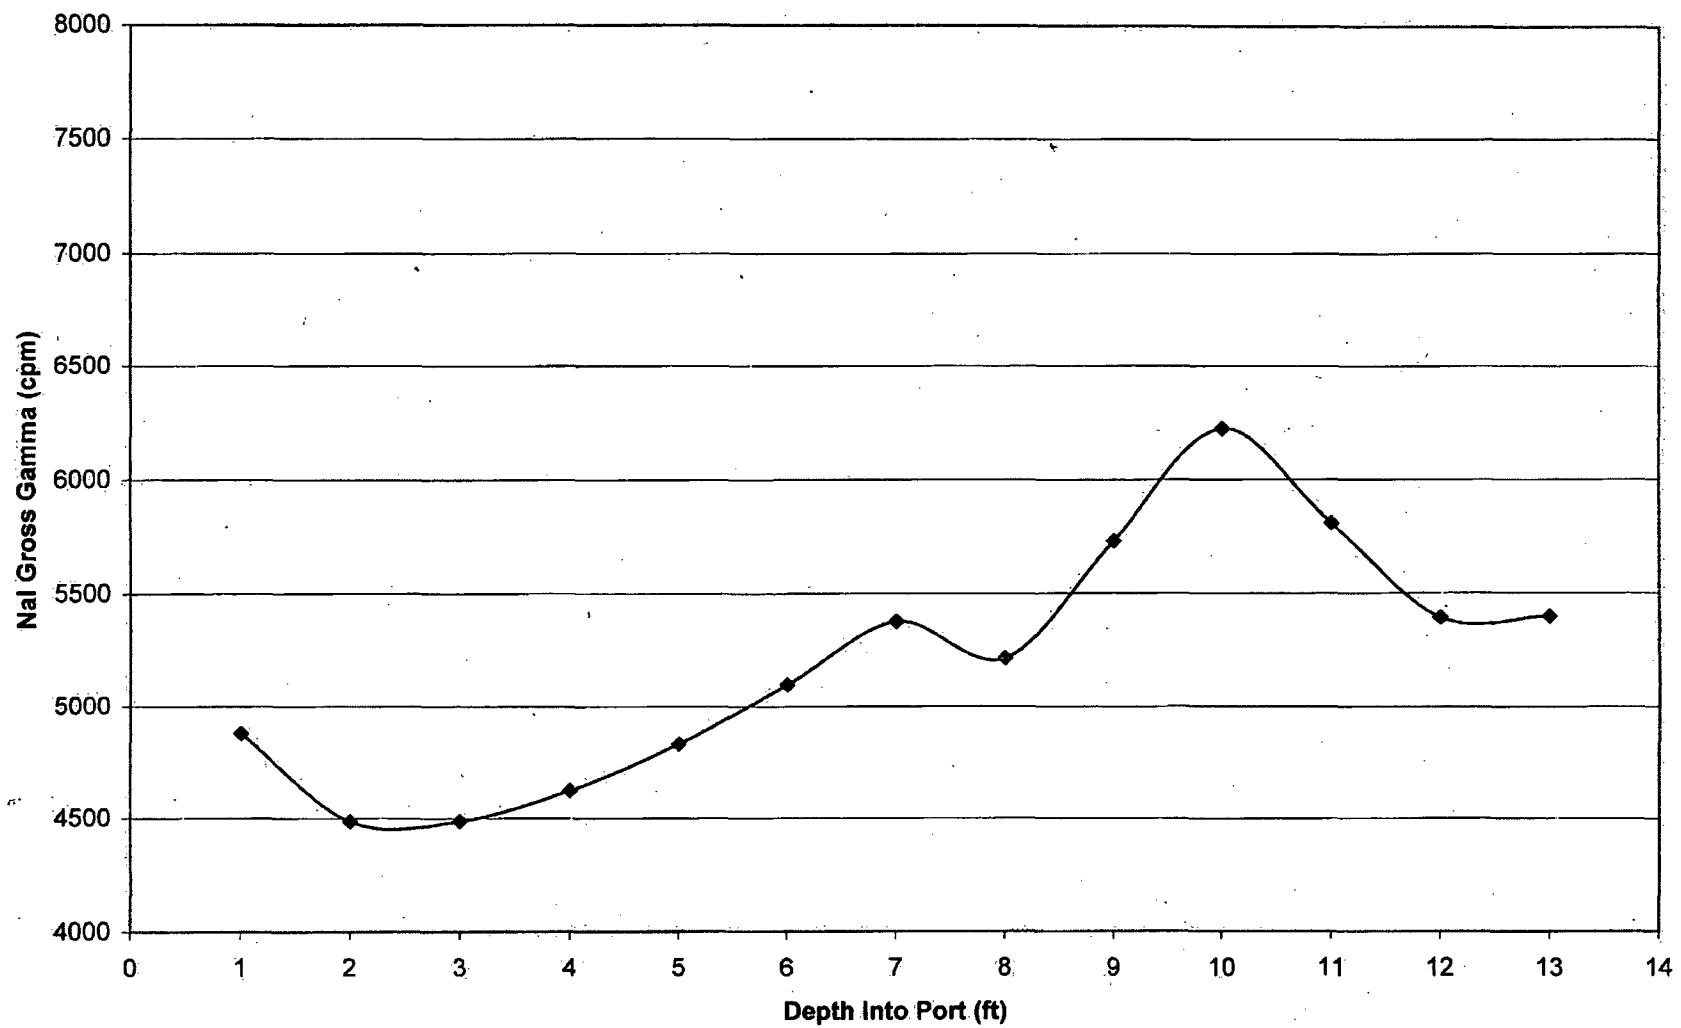


Surveyed: 05-17-2007

FNR Storage Port #27: NaI Gross Gamma vs Depth

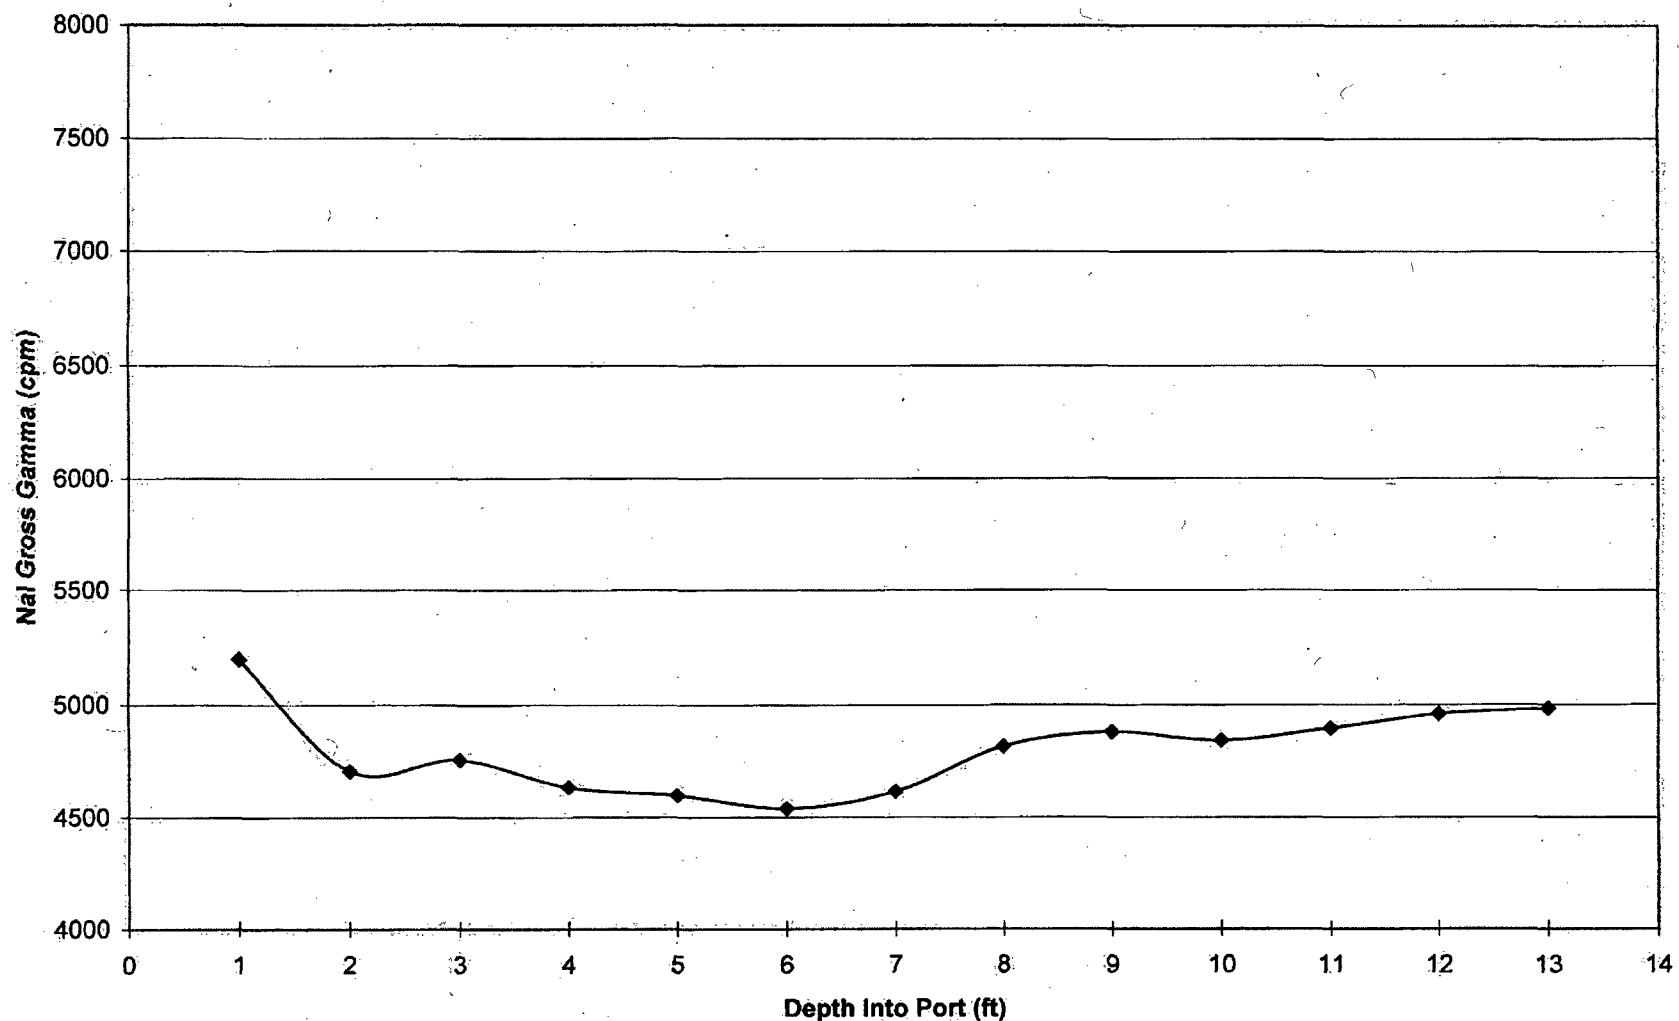


Surveyed: 05-17-2007

FNR Storage Port #28: NaI Gross Gamma vs Depth

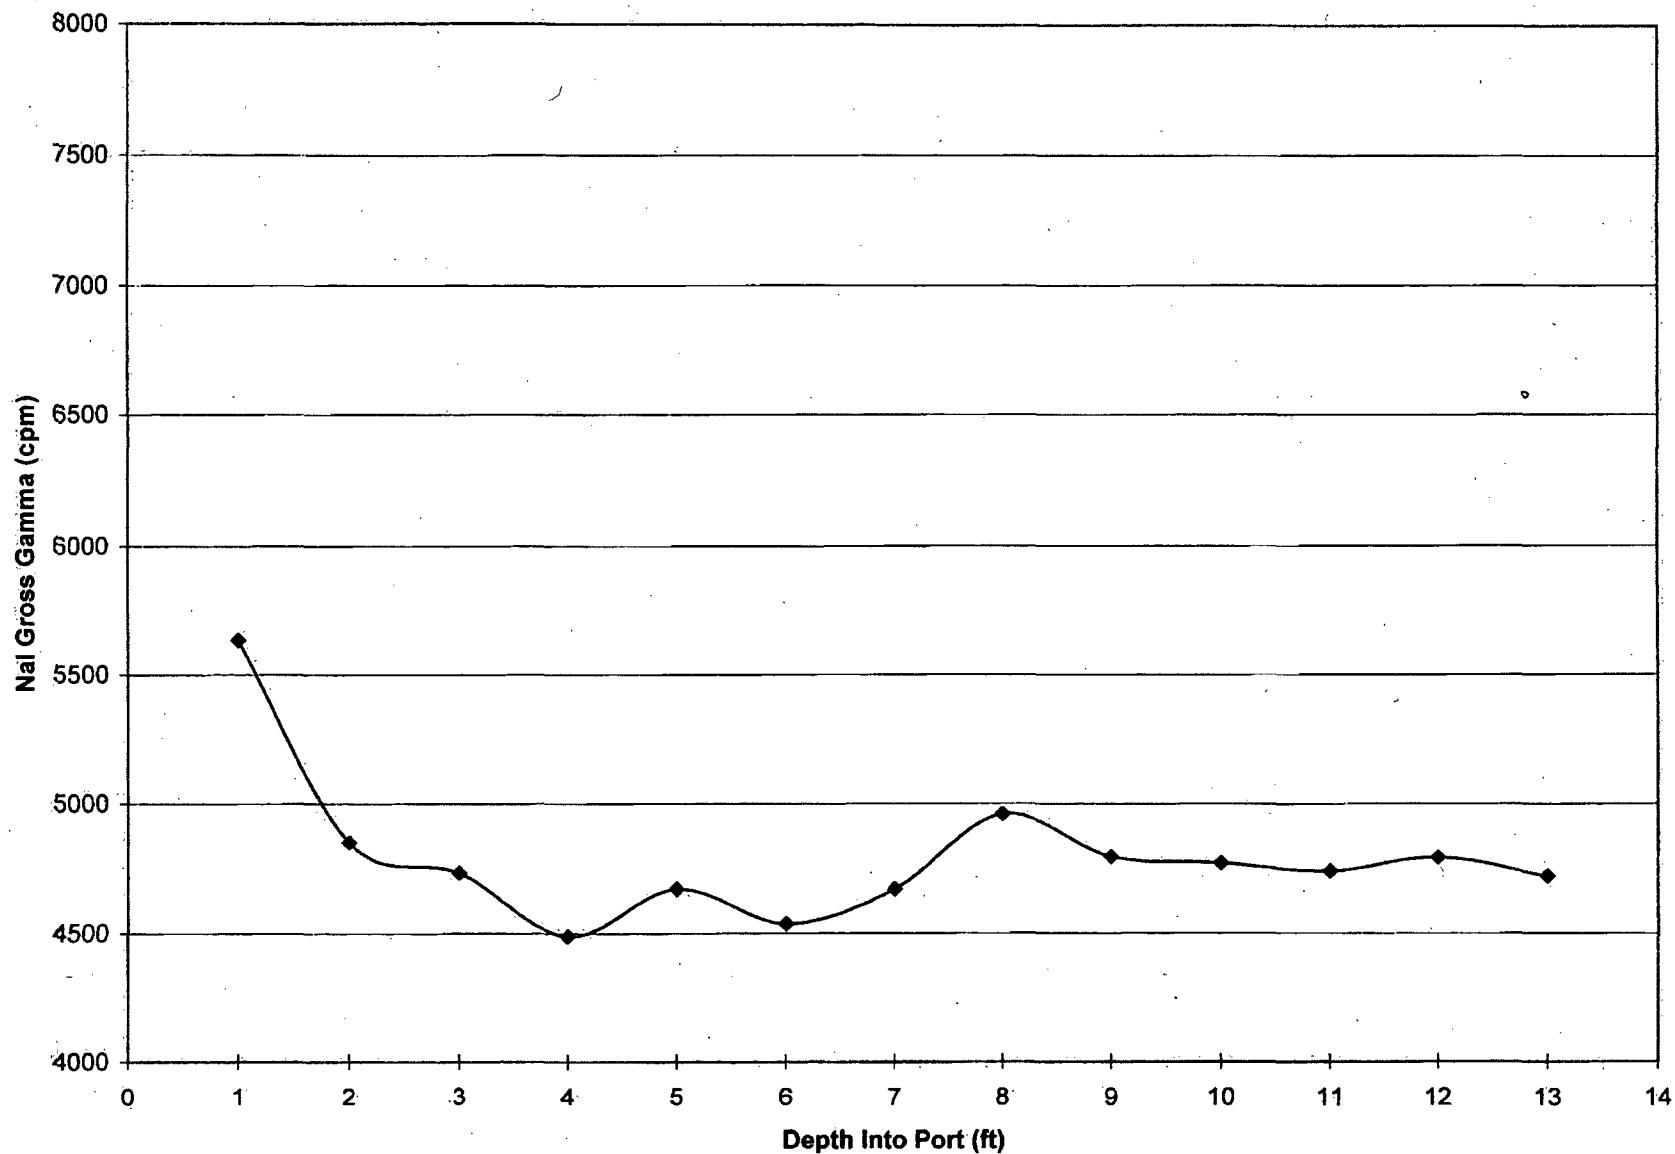


Surveyed: 05-17-2007

FNR Storage Port #29: NaI Gross Gamma vs Depth

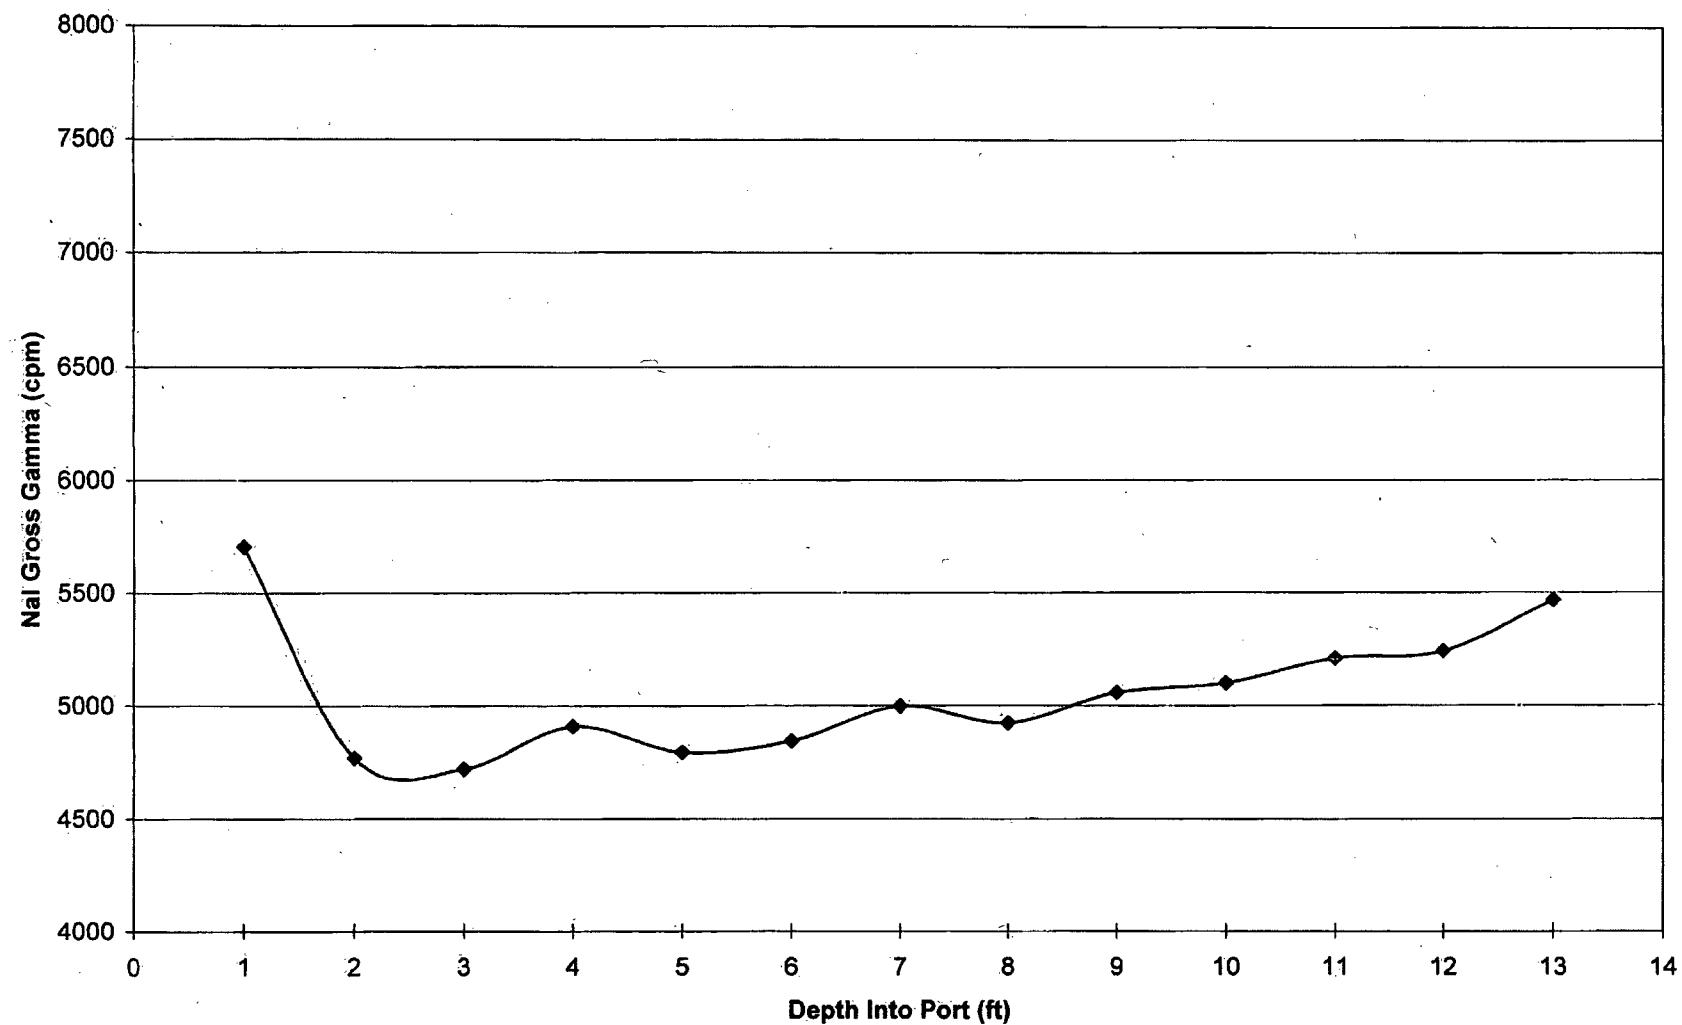


Surveyed: 05-17-2007

FNR Storage Port #30: NaI Gross Gamma vs Depth

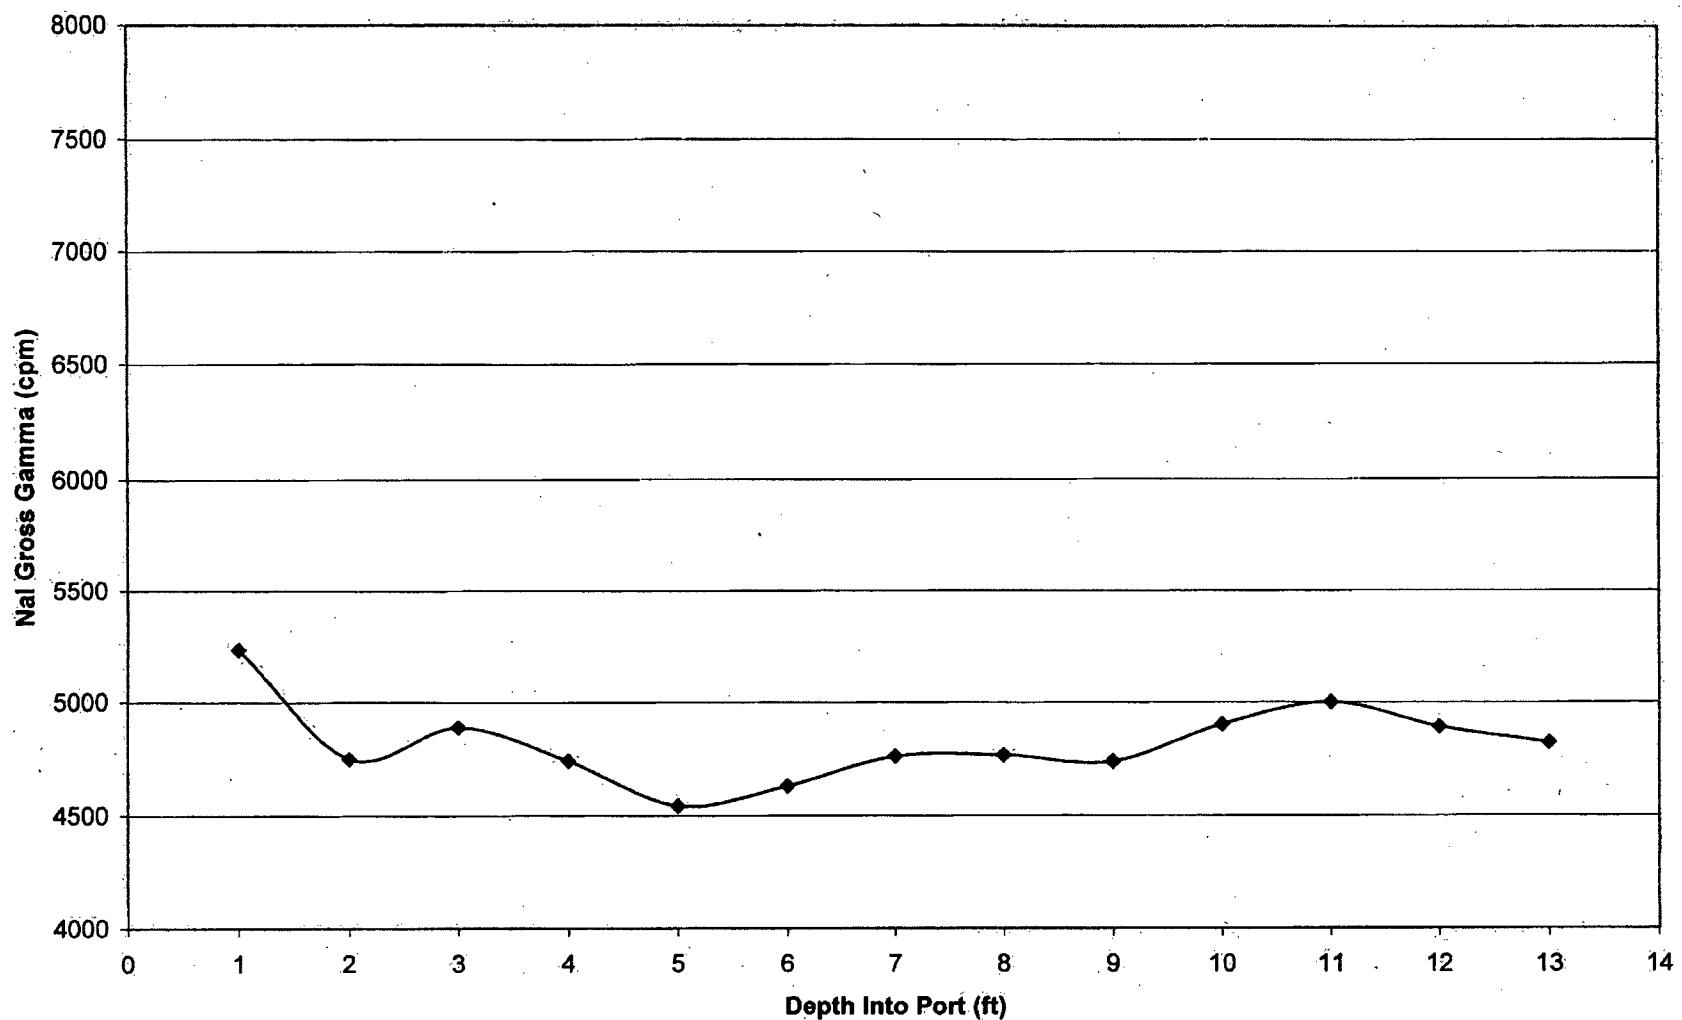


Surveyed: 05-17-2007

FNR Storage Port #31: NaI Gross Gamma vs Depth

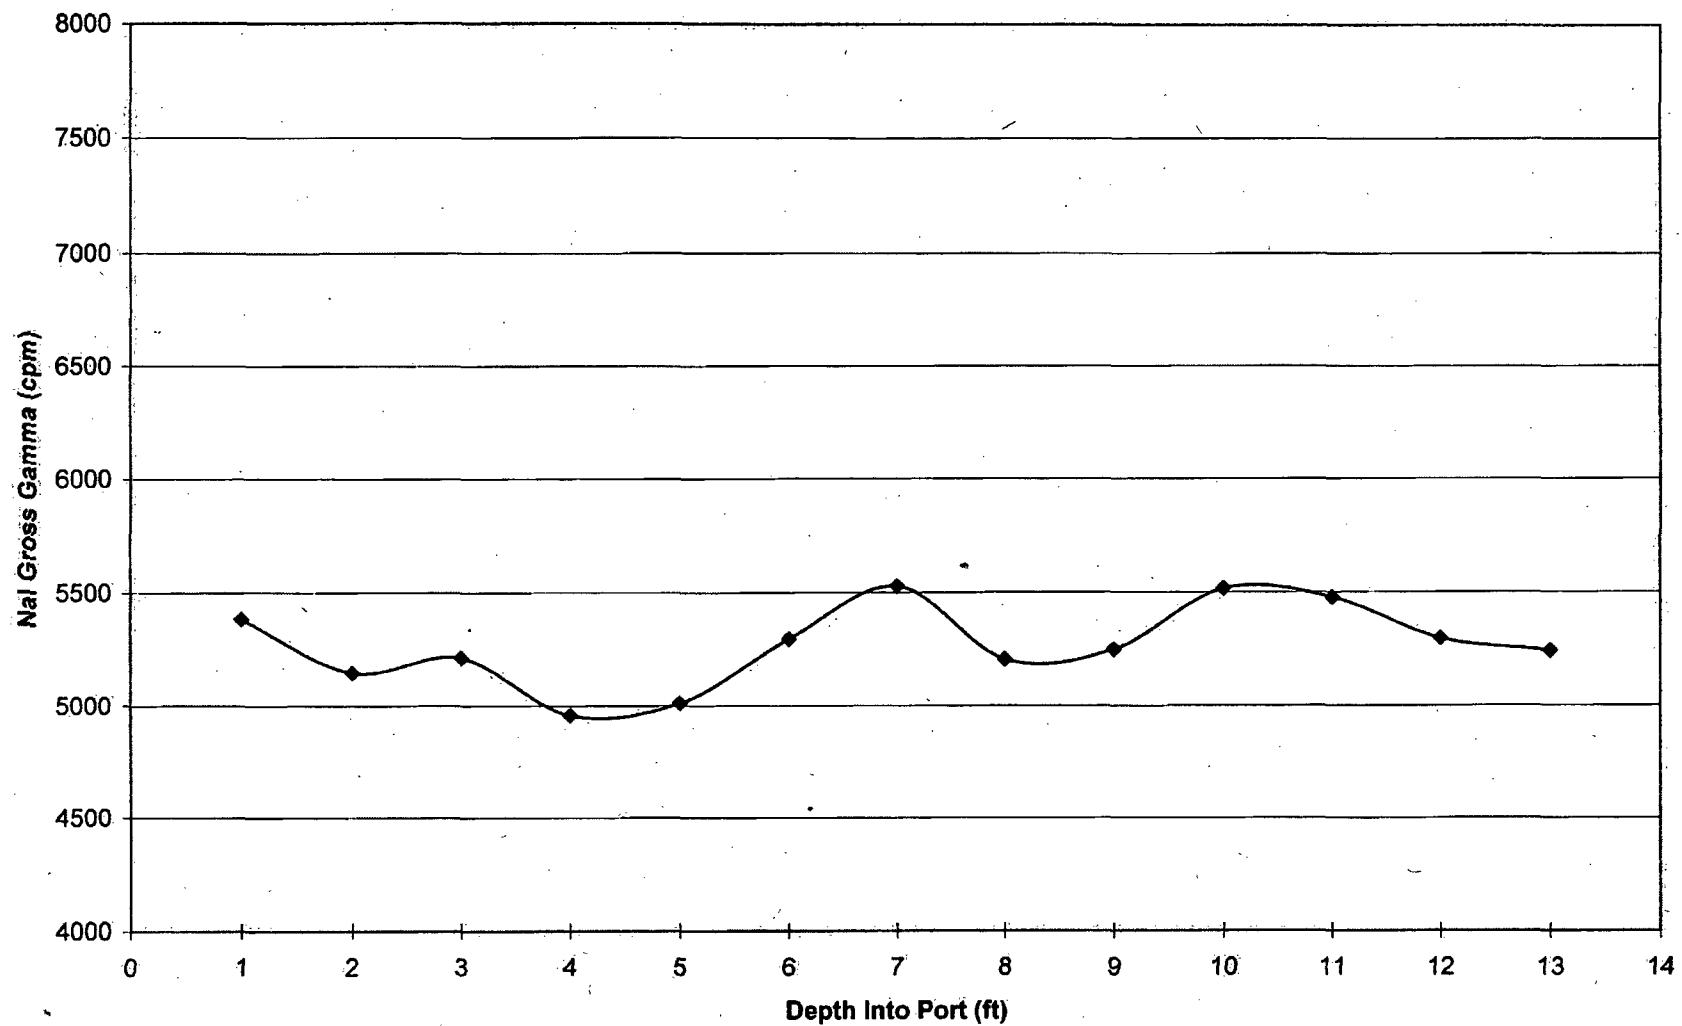


Surveyed: 05-17-2007

FNR Storage Port #32: NaI Gross Gamma vs Depth

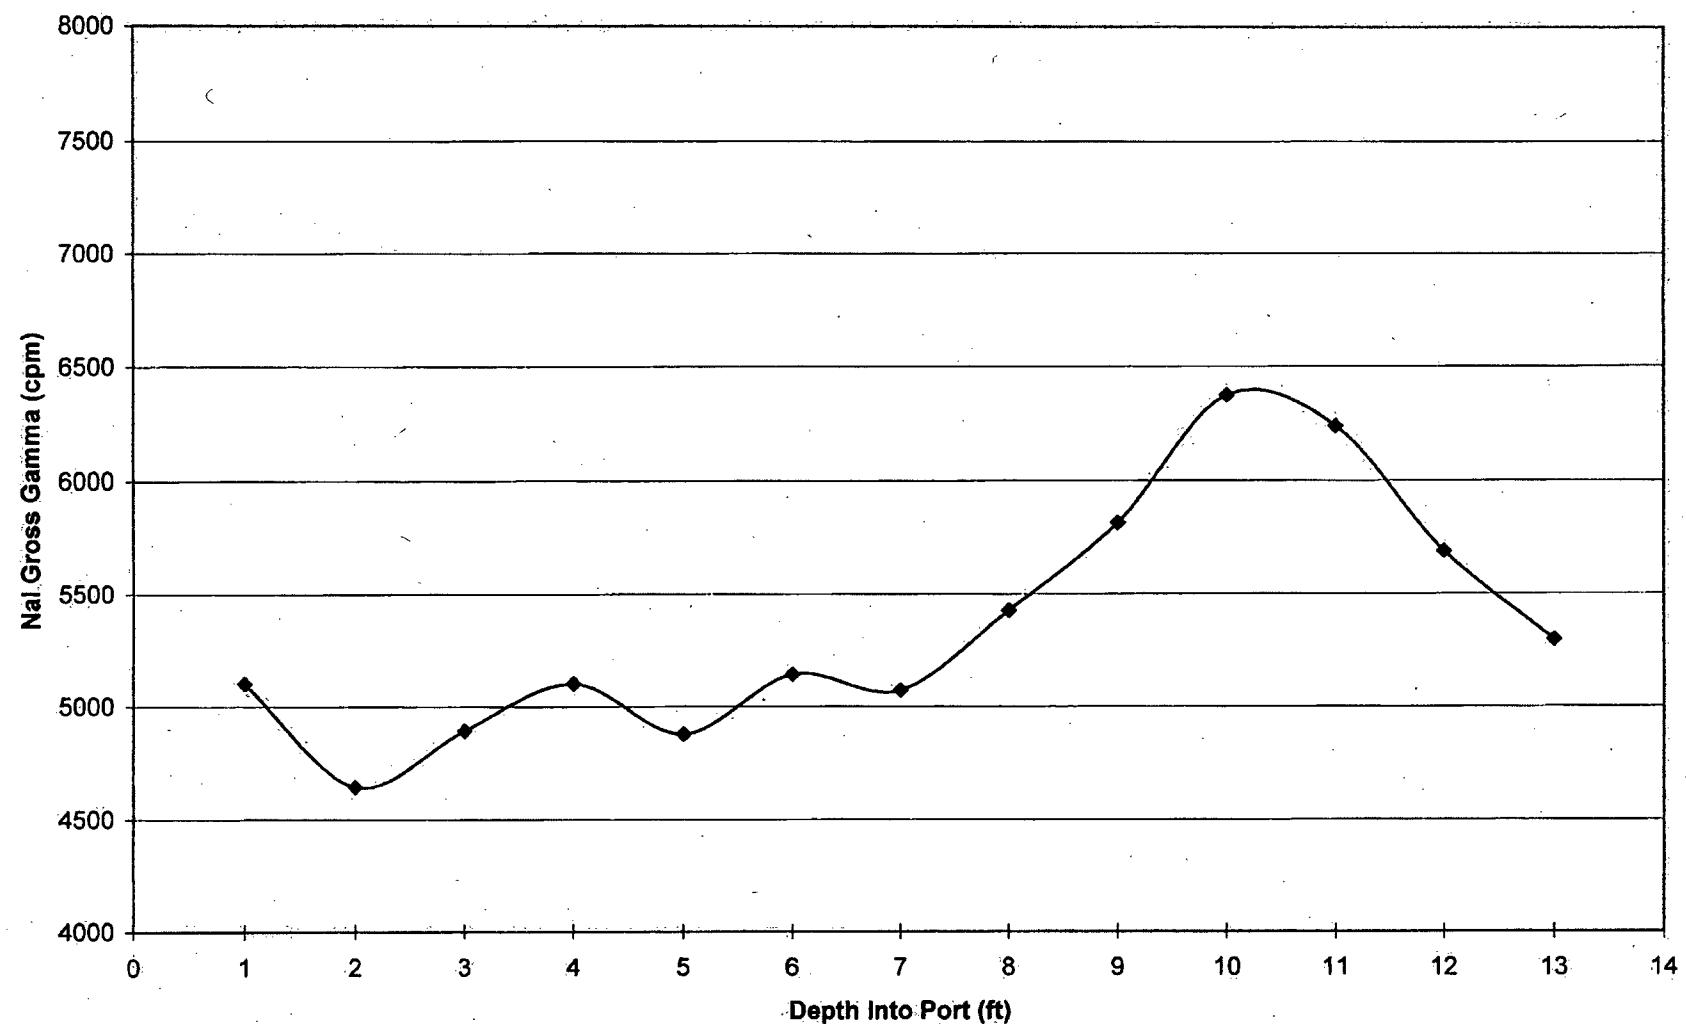


Surveyed: 05-17-2007

FNR Storage Port #33: NaI Gross Gamma vs Depth

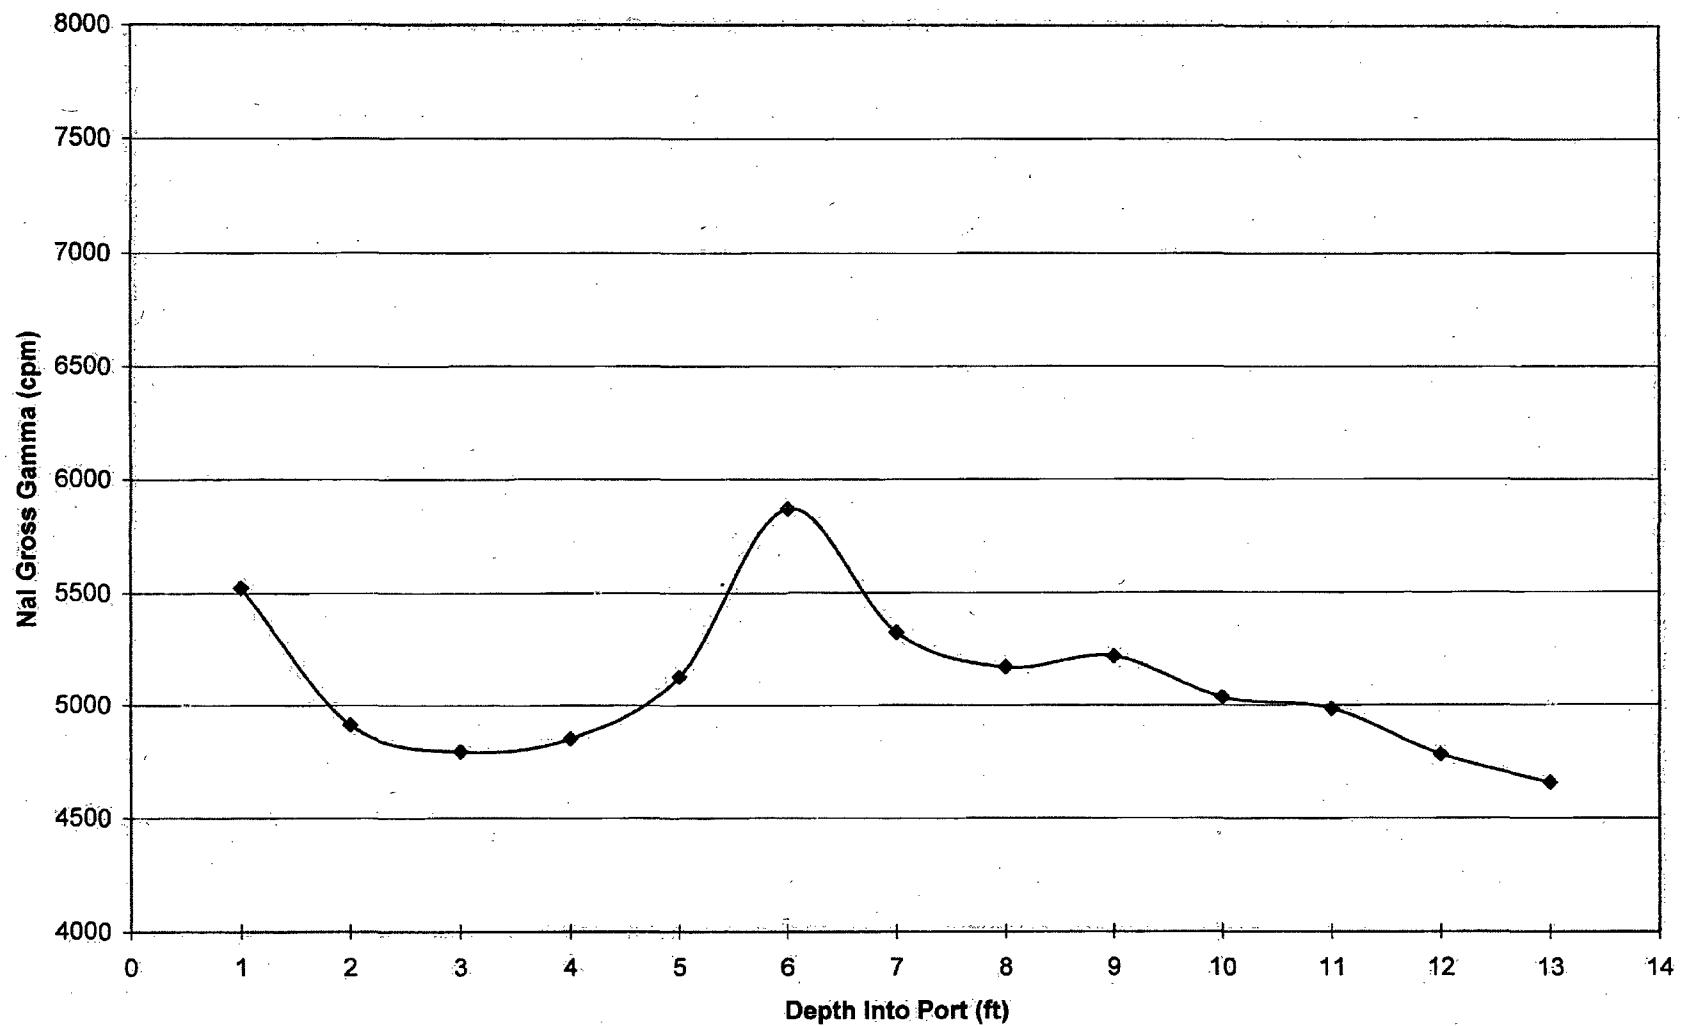


Surveyed: 05-17-2007

FNR Storage Port #34: NaI Gross Gamma vs Depth

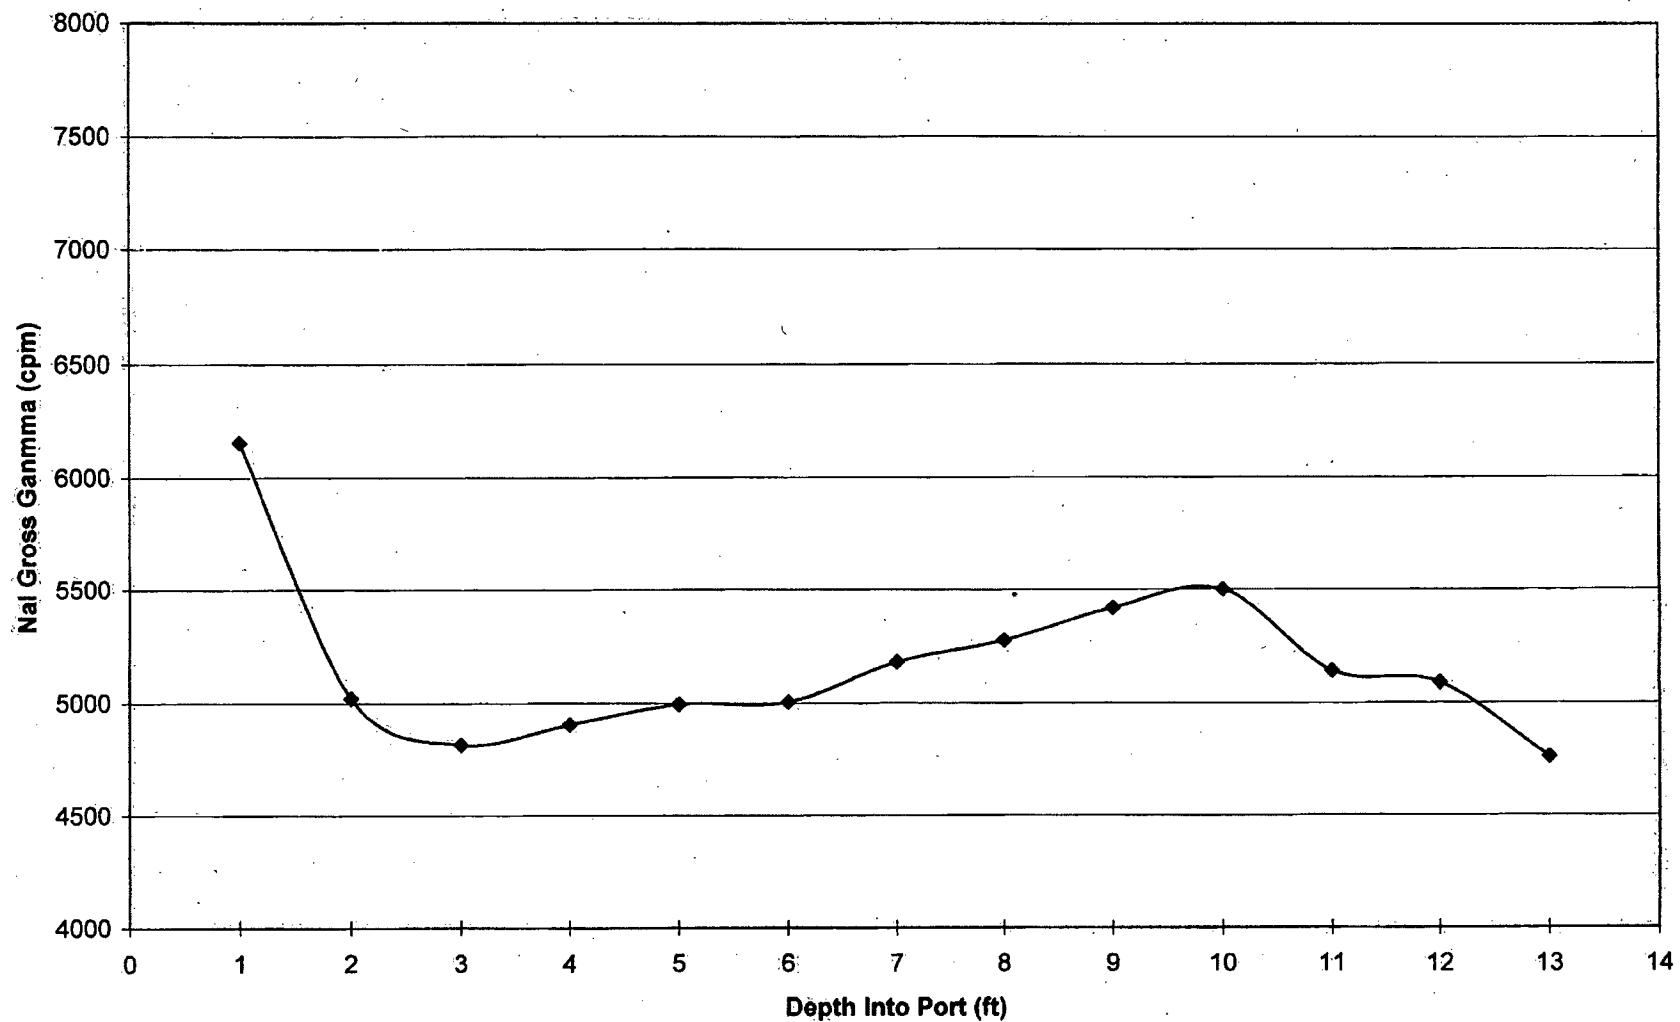


Surveyed: 05-17-2007

FNR Storage Port #35: NaI Gross Gamma vs Depth

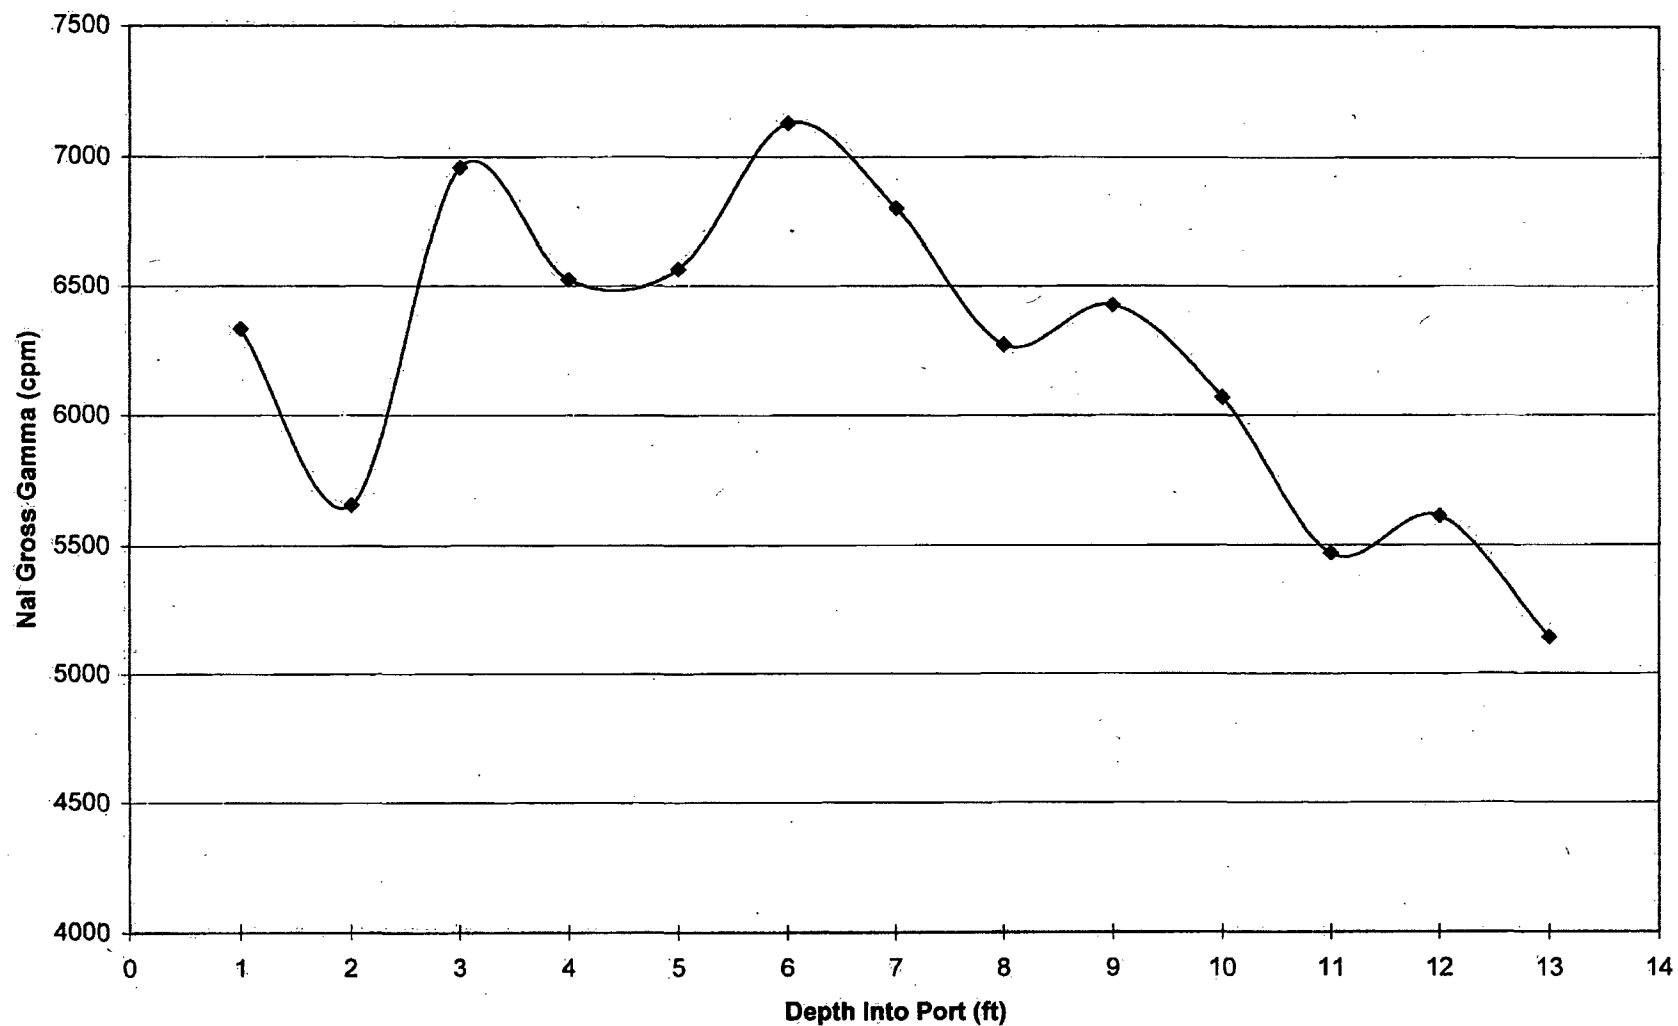


Surveyed: 05-17-2007

FNR Storage Port #36: NaI Gross Gamma vs Depth

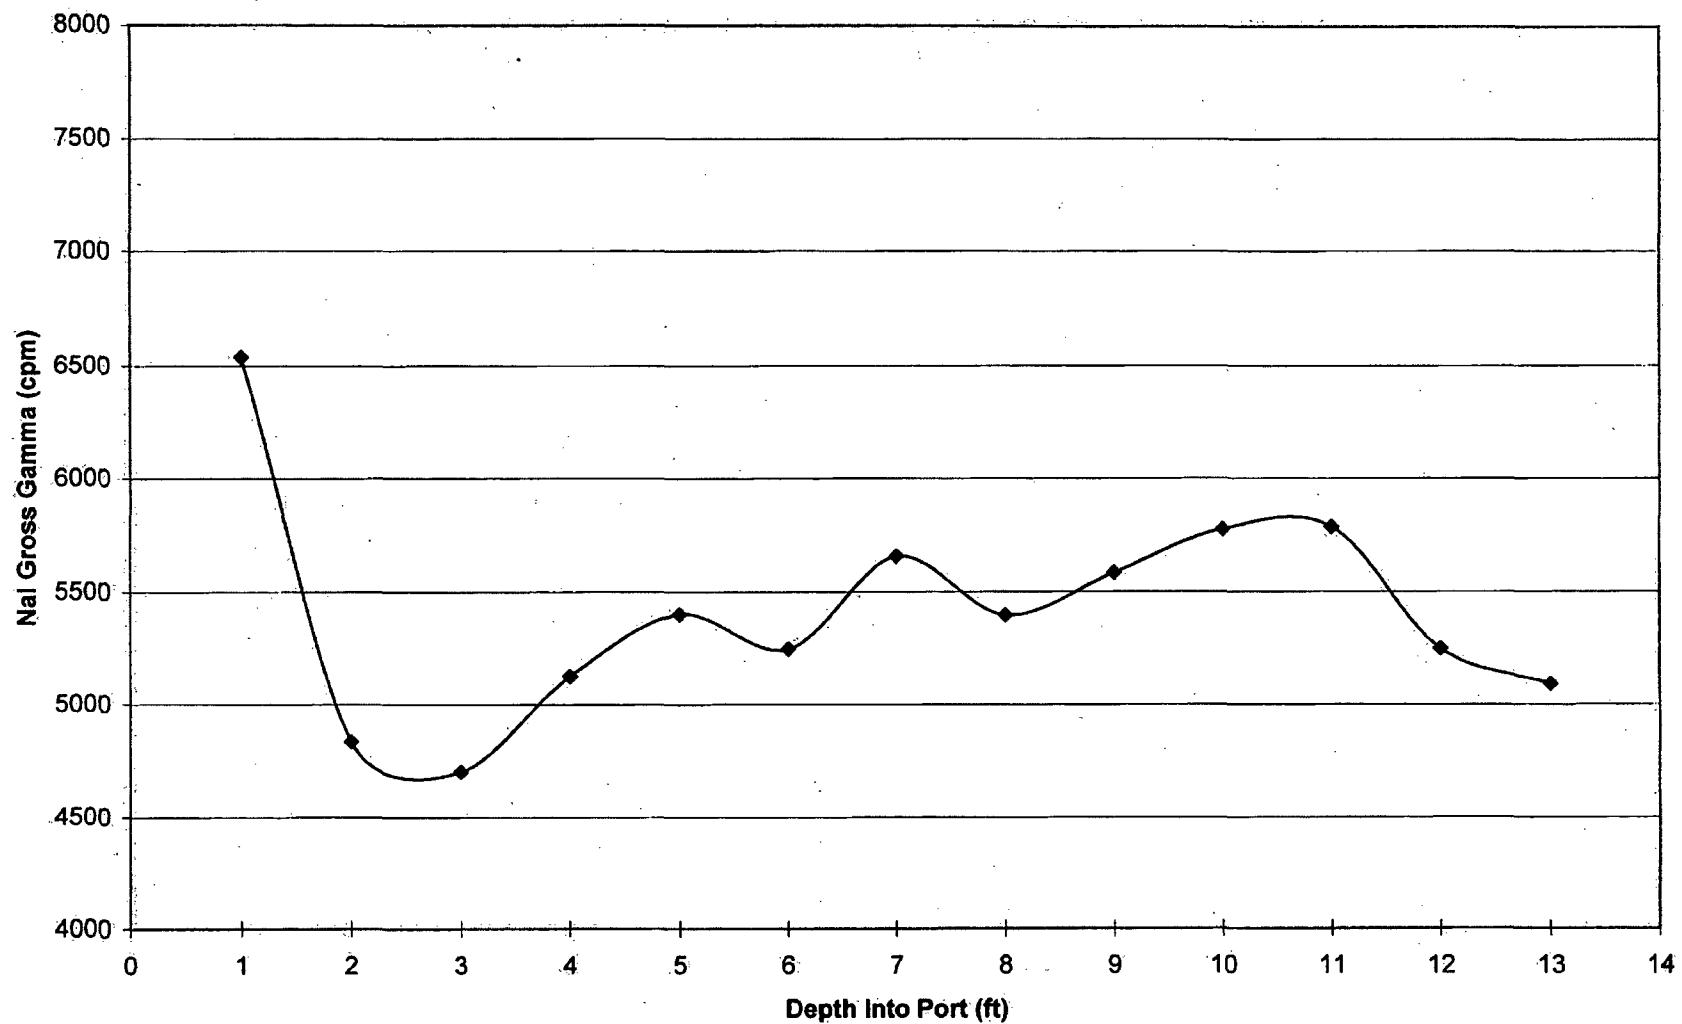


Surveyed: 05-17-2007

FNR Storage Port #37: NaI Gross Gamma vs Depth

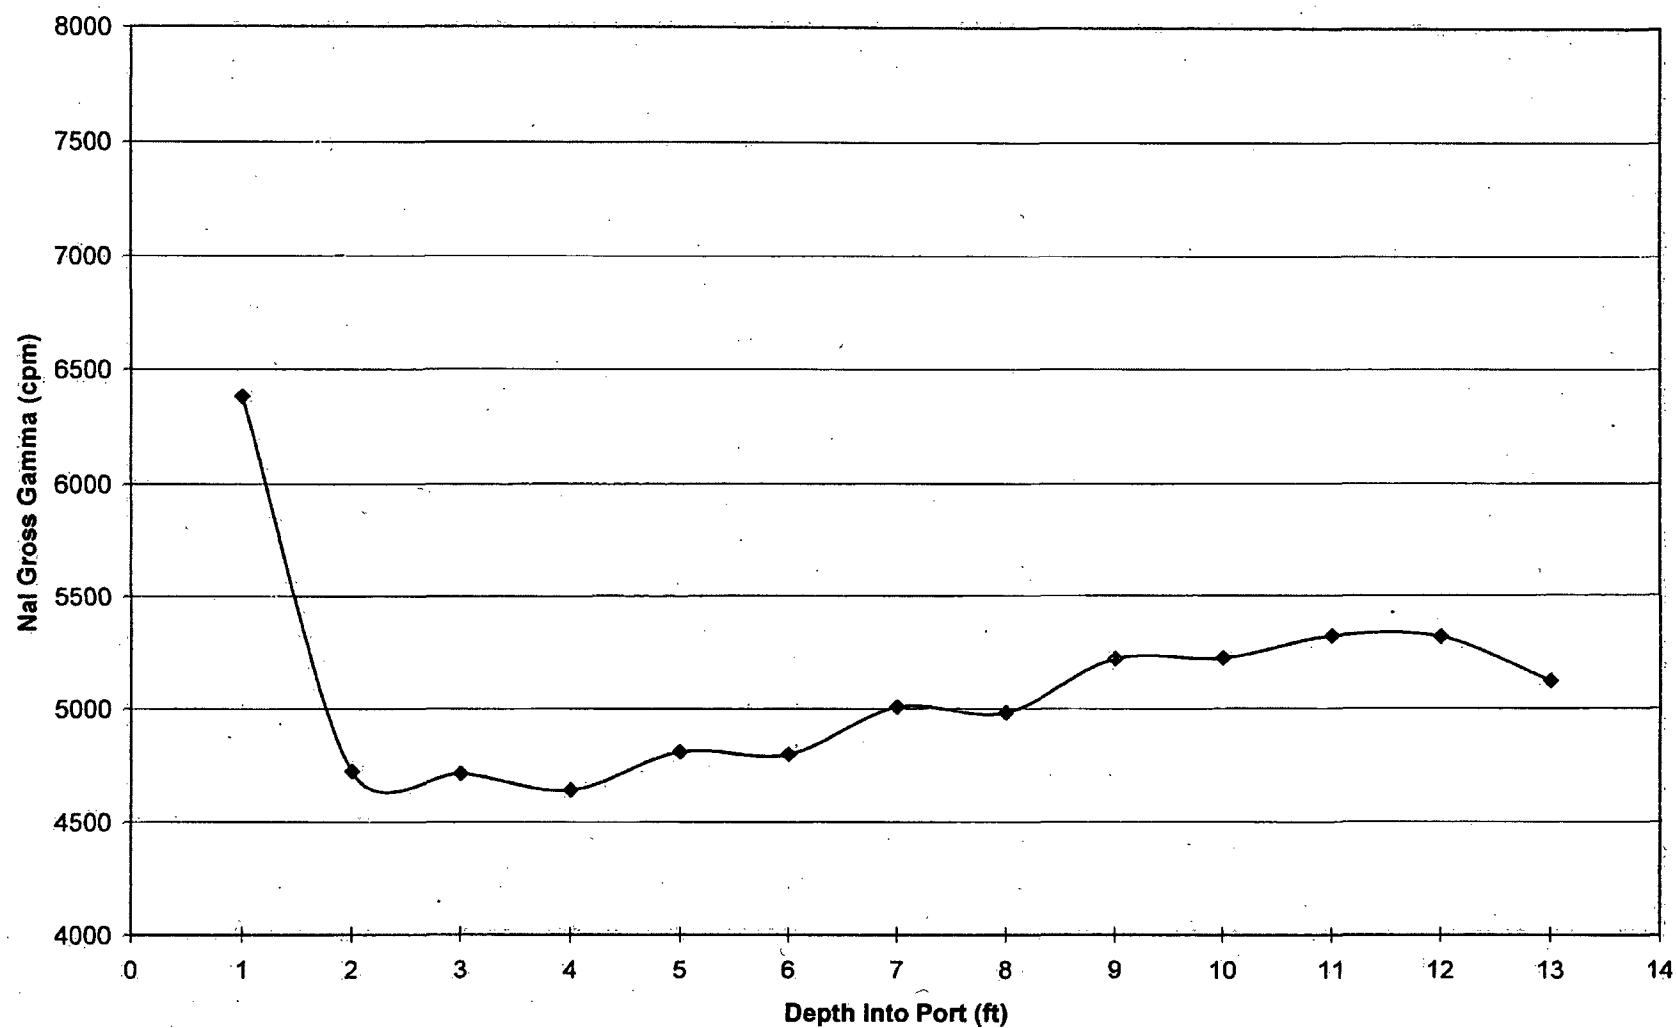


Surveyed: 05-18-2007

FNR Storage Port #38: NaI Gross Gamma vs Depth

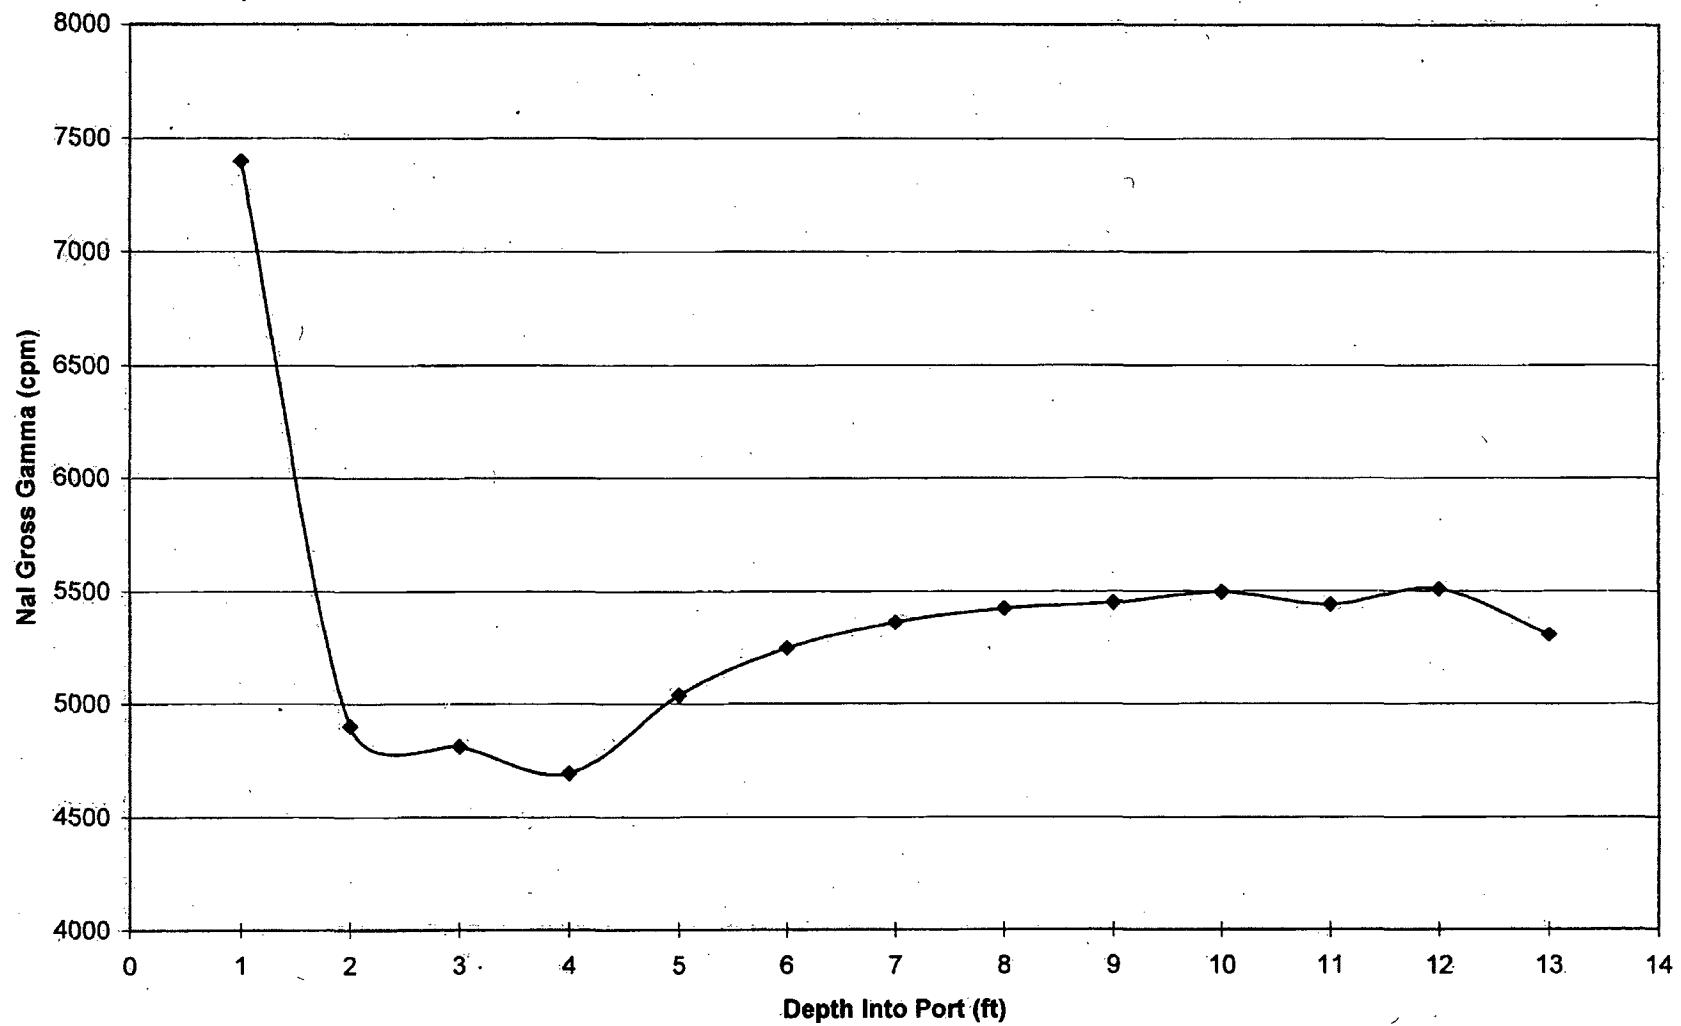


Surveyed: 05-17-2007

FNR Storage Port #39: NaI Gross Gamma vs Depth

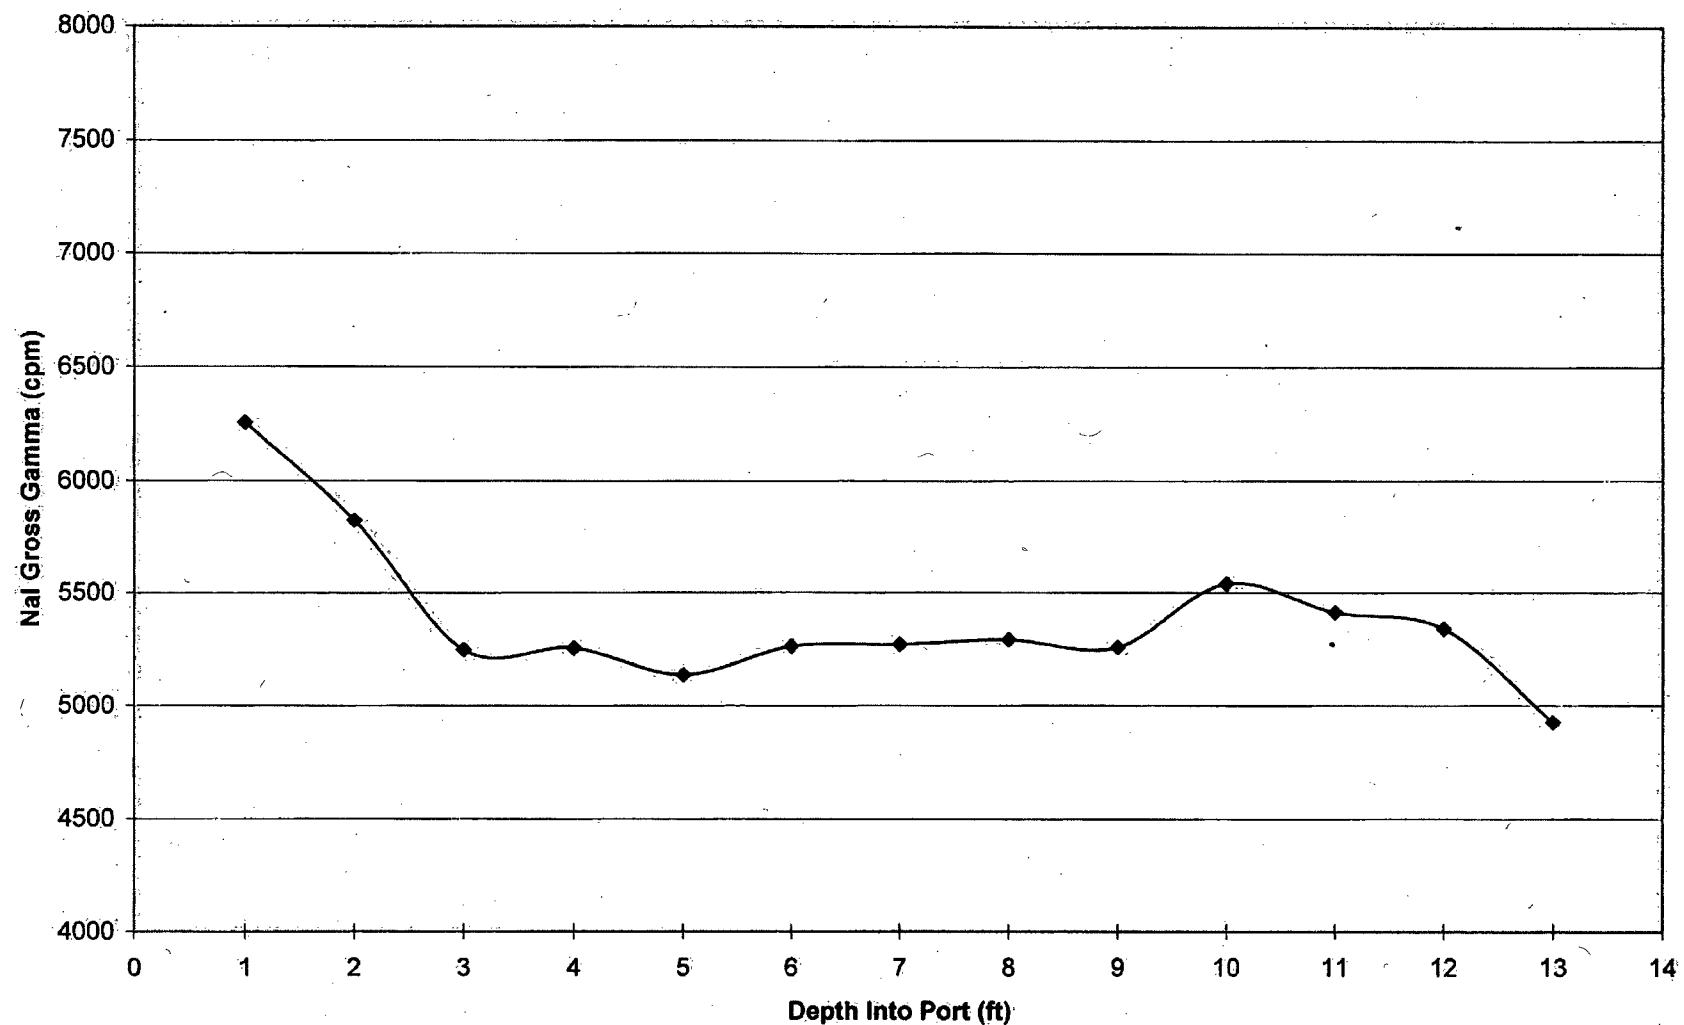


Surveyed: 05-18-2007

FNR Storage Port #40: Nal Gross Gamma vs Depth

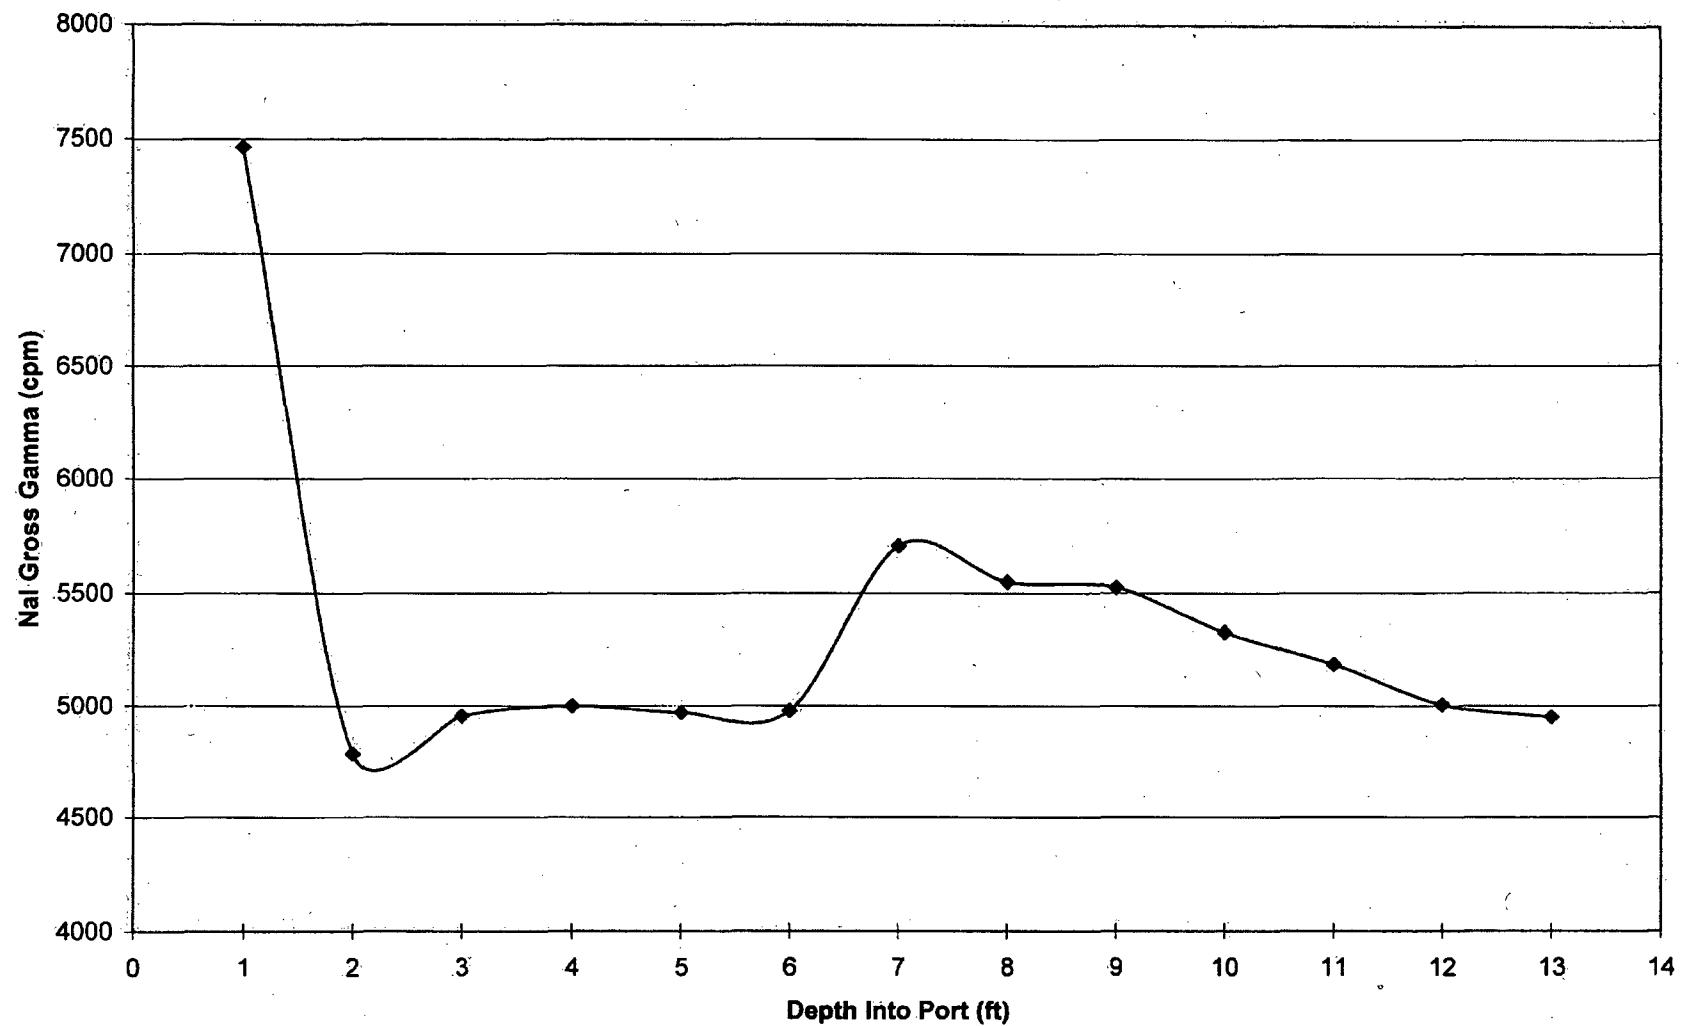


Surveyed: 05-18-2007

FNR Storage Port #41: NaI Gross Gamma vs Depth

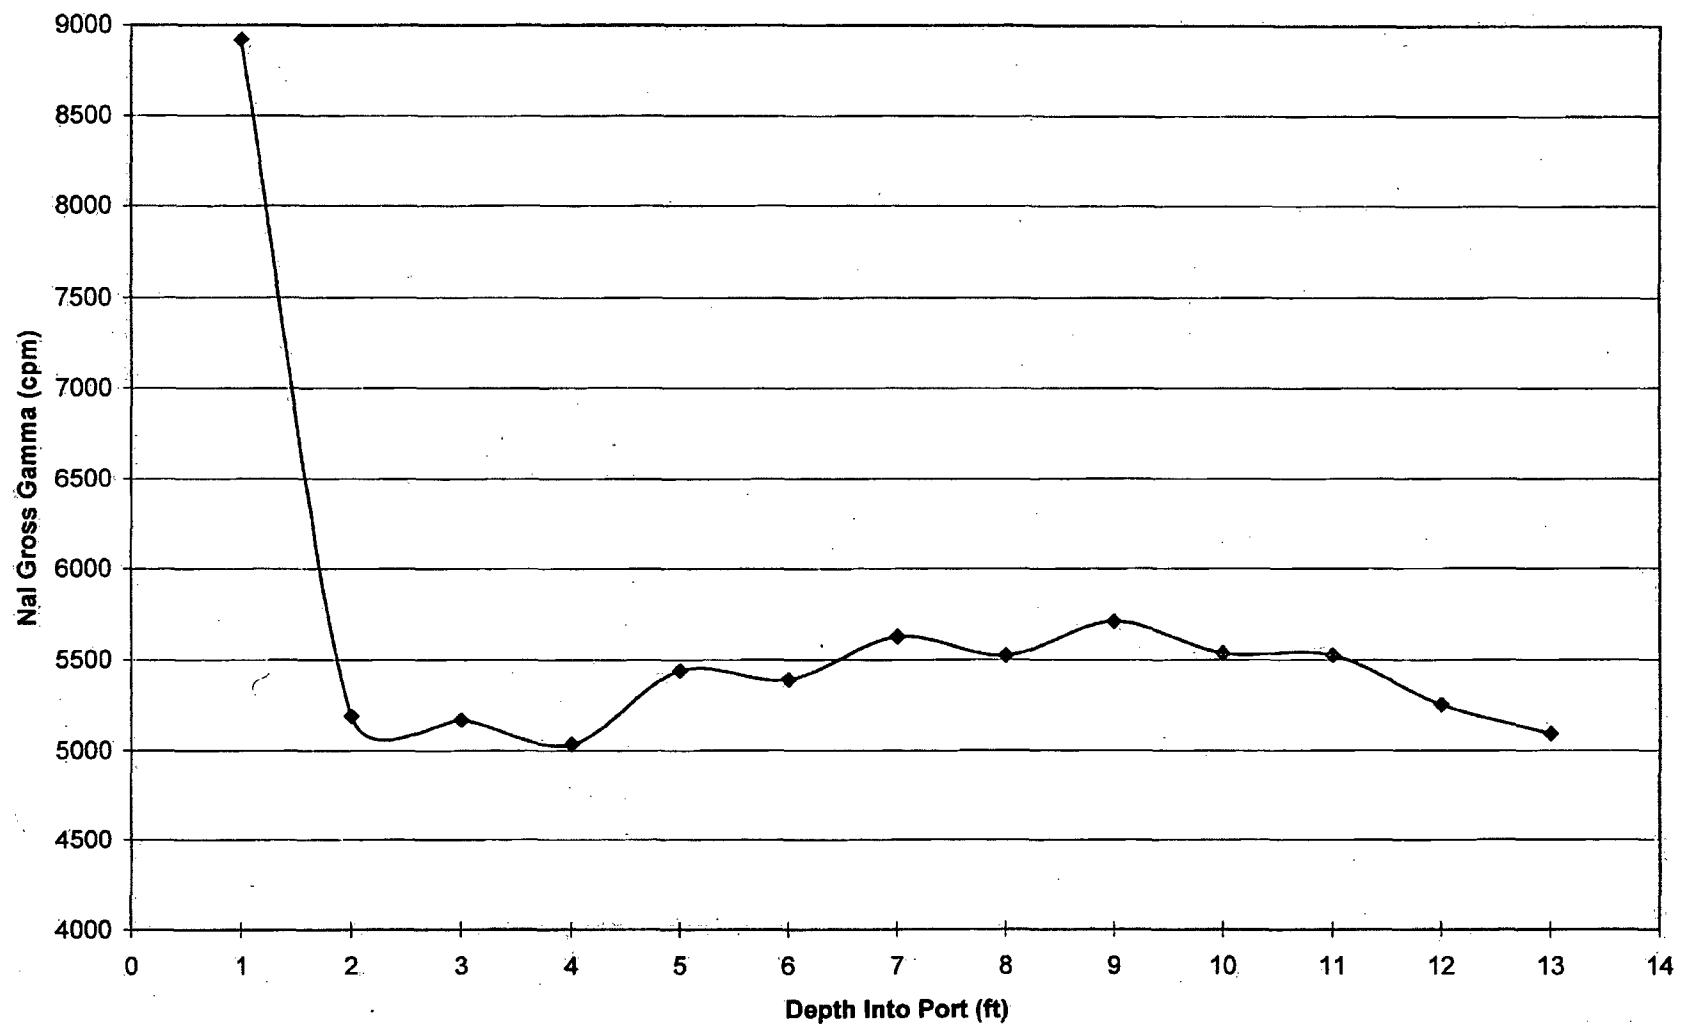


Surveyed: 05-18-2007

FNR Storage Port #42: NaI Gross Gamma vs Depth

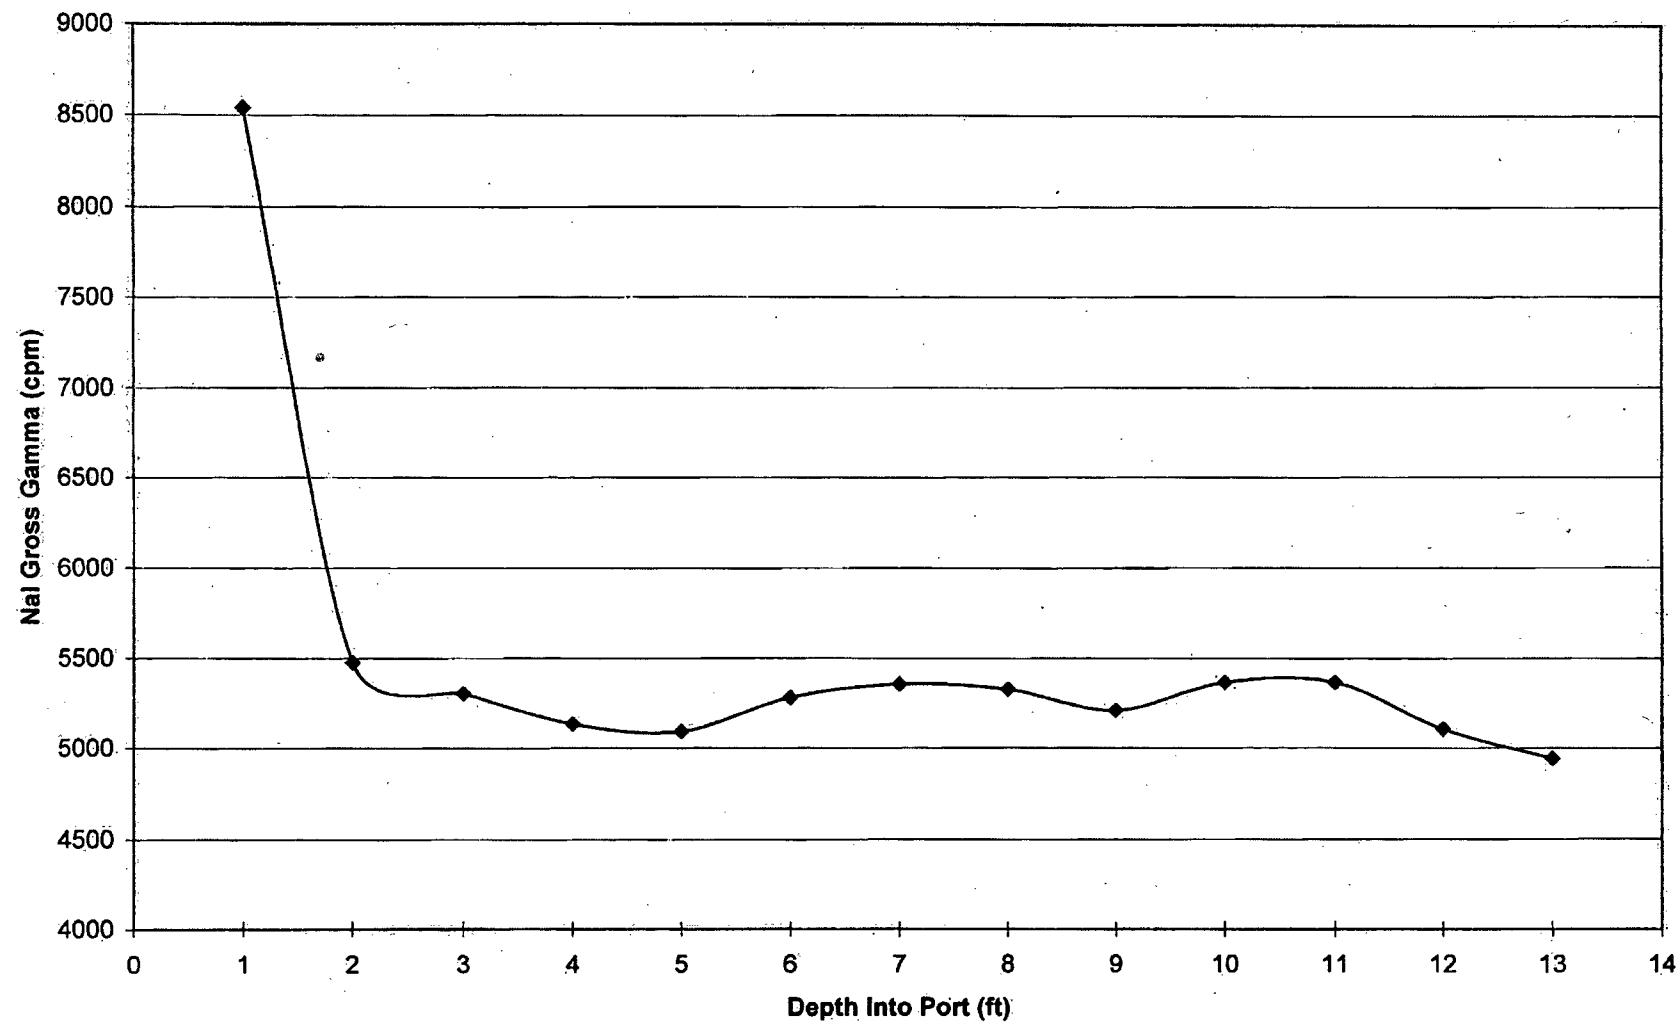


Surveyed: 05-18-2007

FNR Storage Port #43: NaI Gross Gamma vs Depth

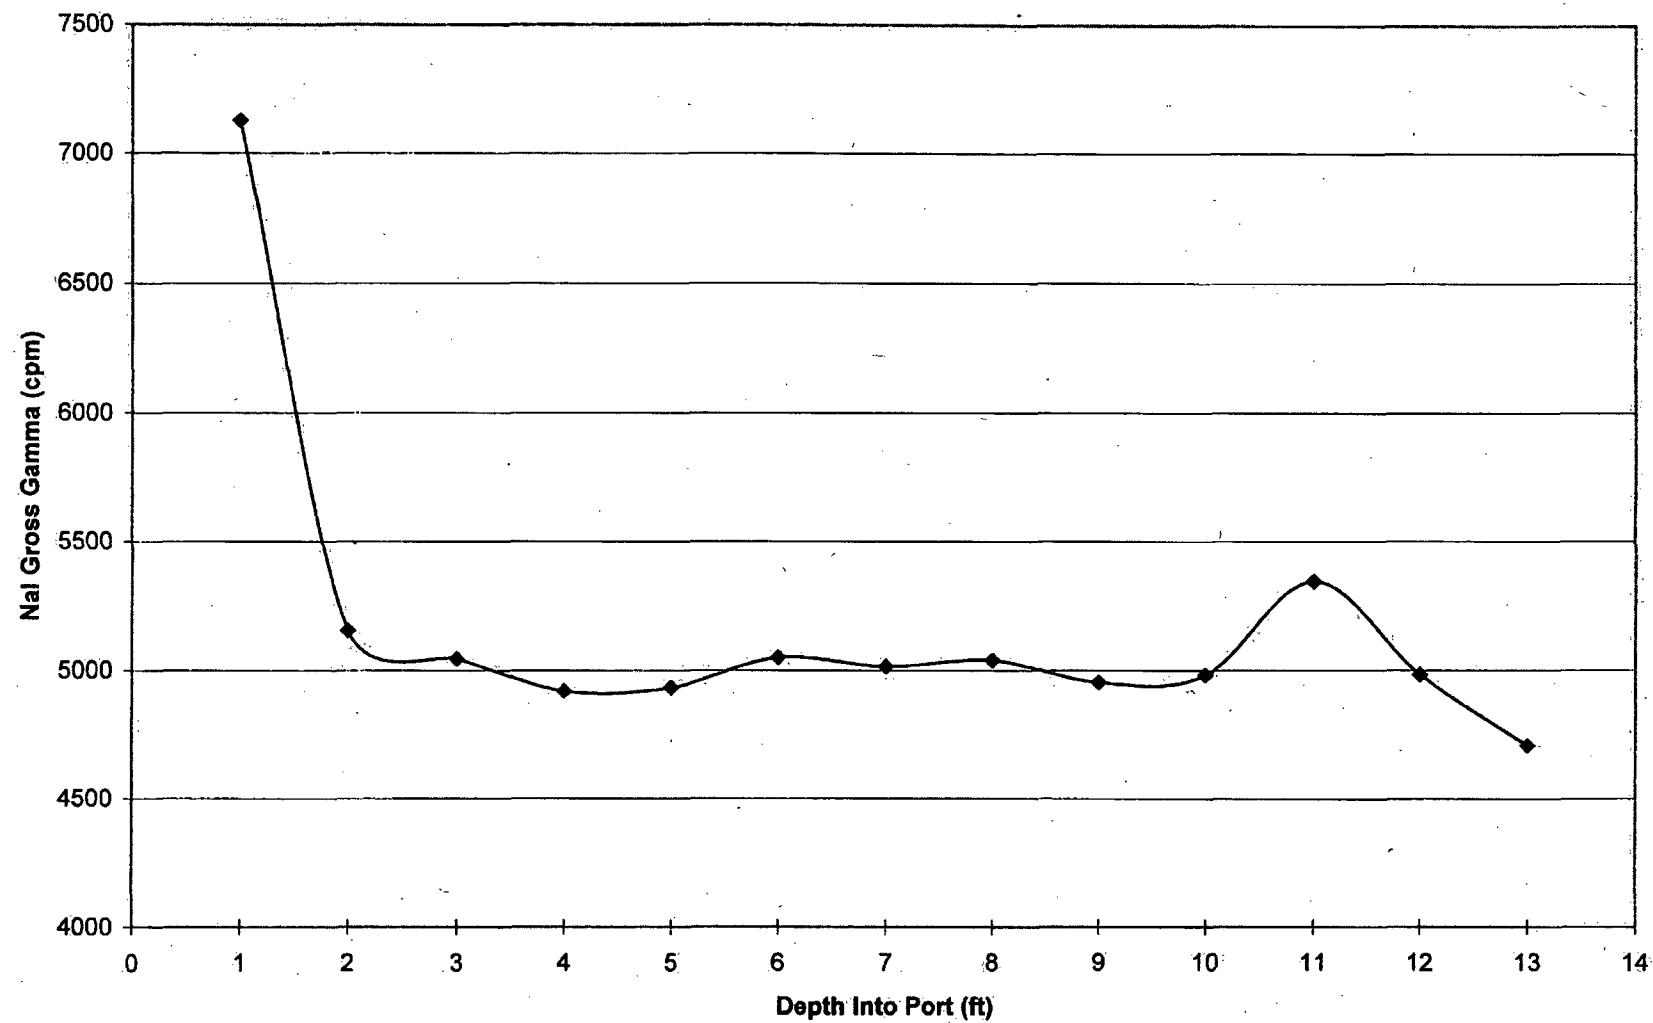


Surveyed: 05-21-2007

FNR Storage Port #44: NaI Gross Gamma vs Depth

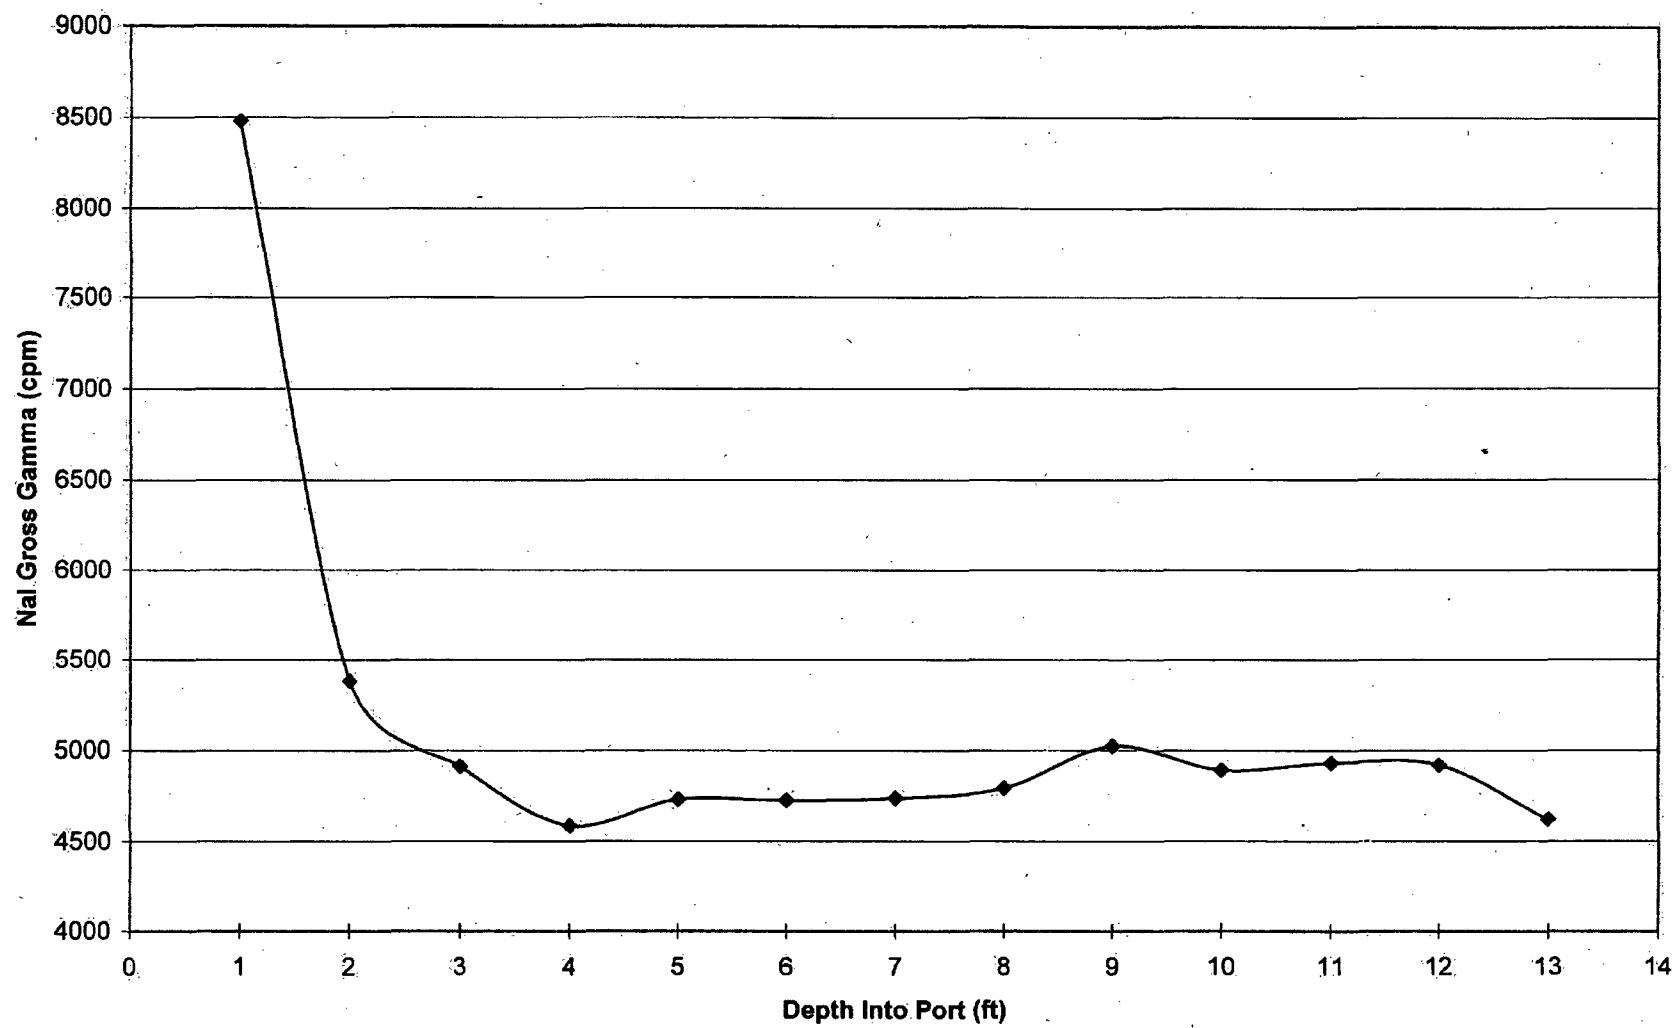


Surveyed: 05-21-2007

FNR Storage Port #45: NaI Gross Gamma vs Depth

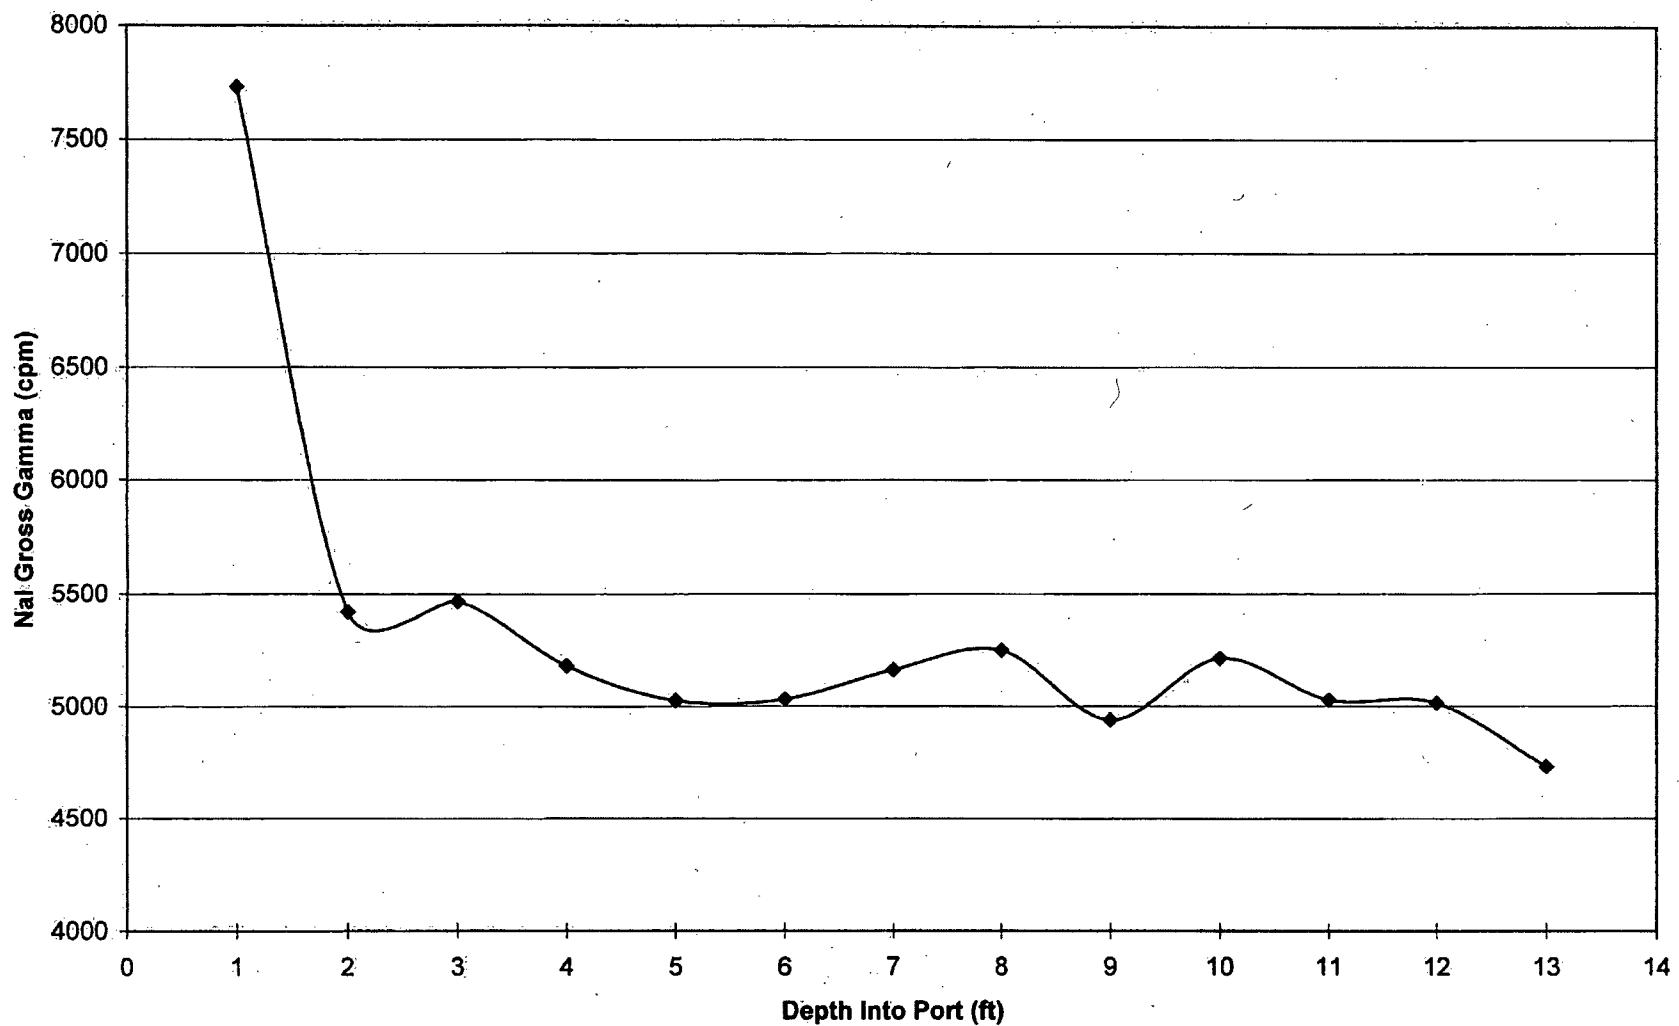


Surveyed: 05-21-2007

FNR Storage Port #46: NaI Gross Gamma vs Depth

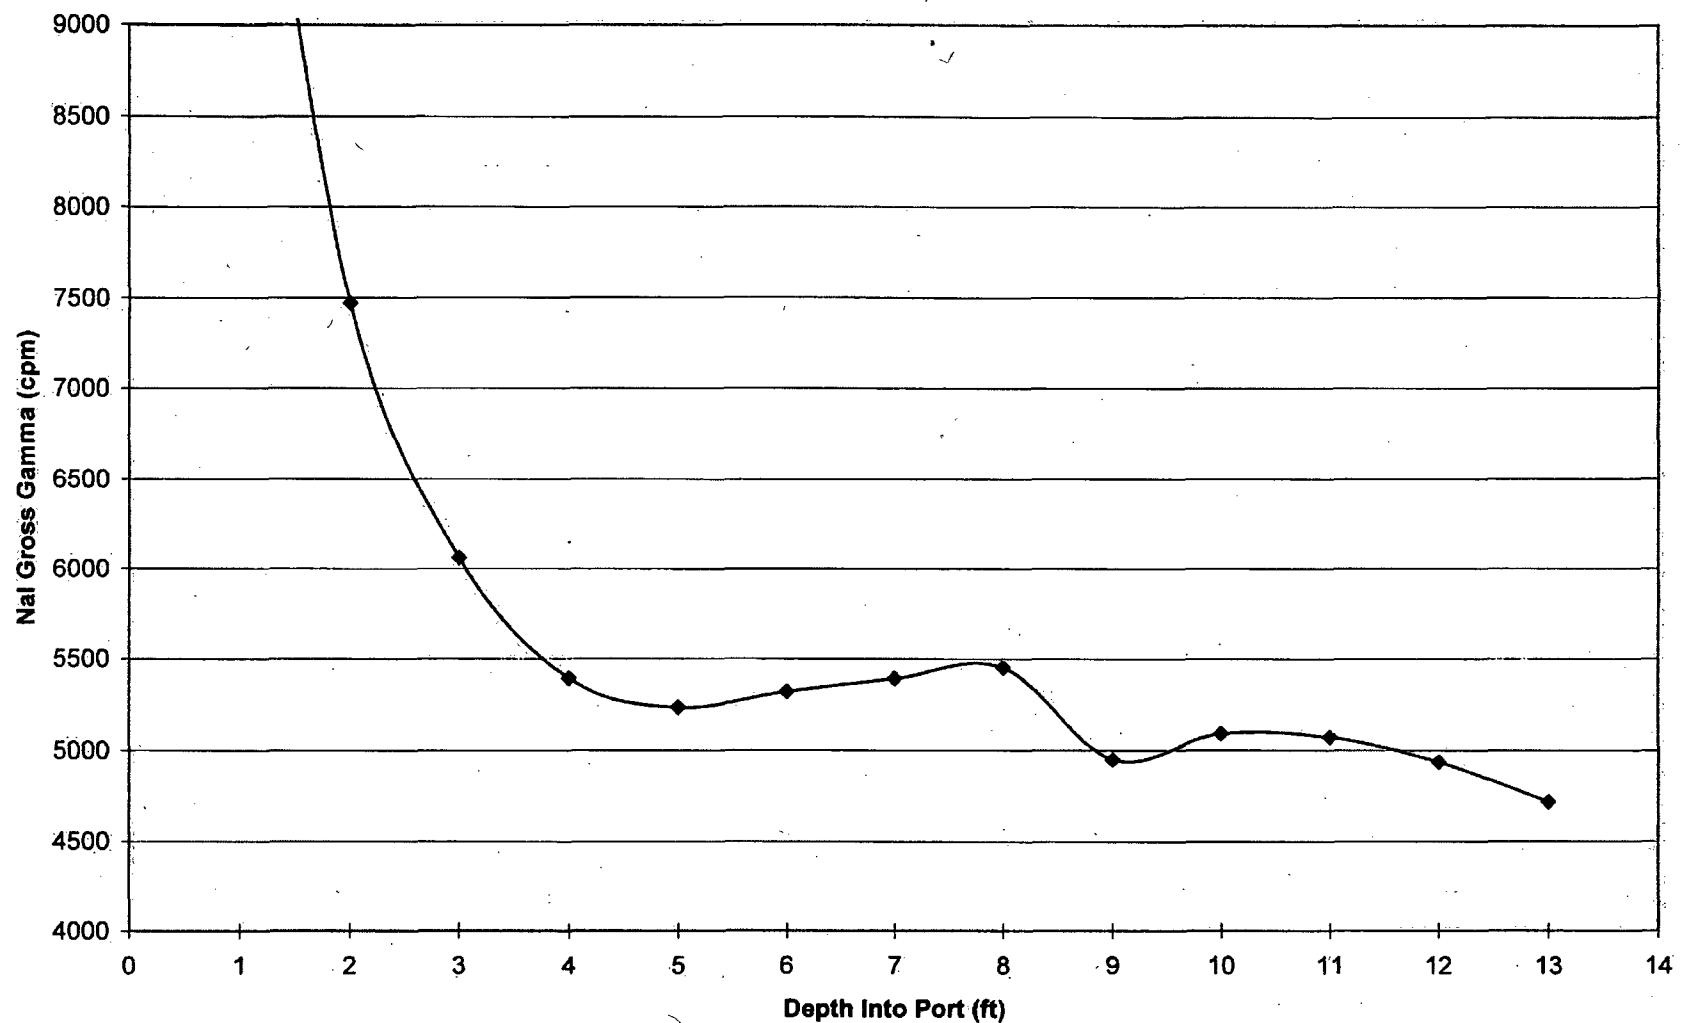


Surveyed: 05-21-2007

FNR Storage Port #47: NaI Gross Gamma vs Depth

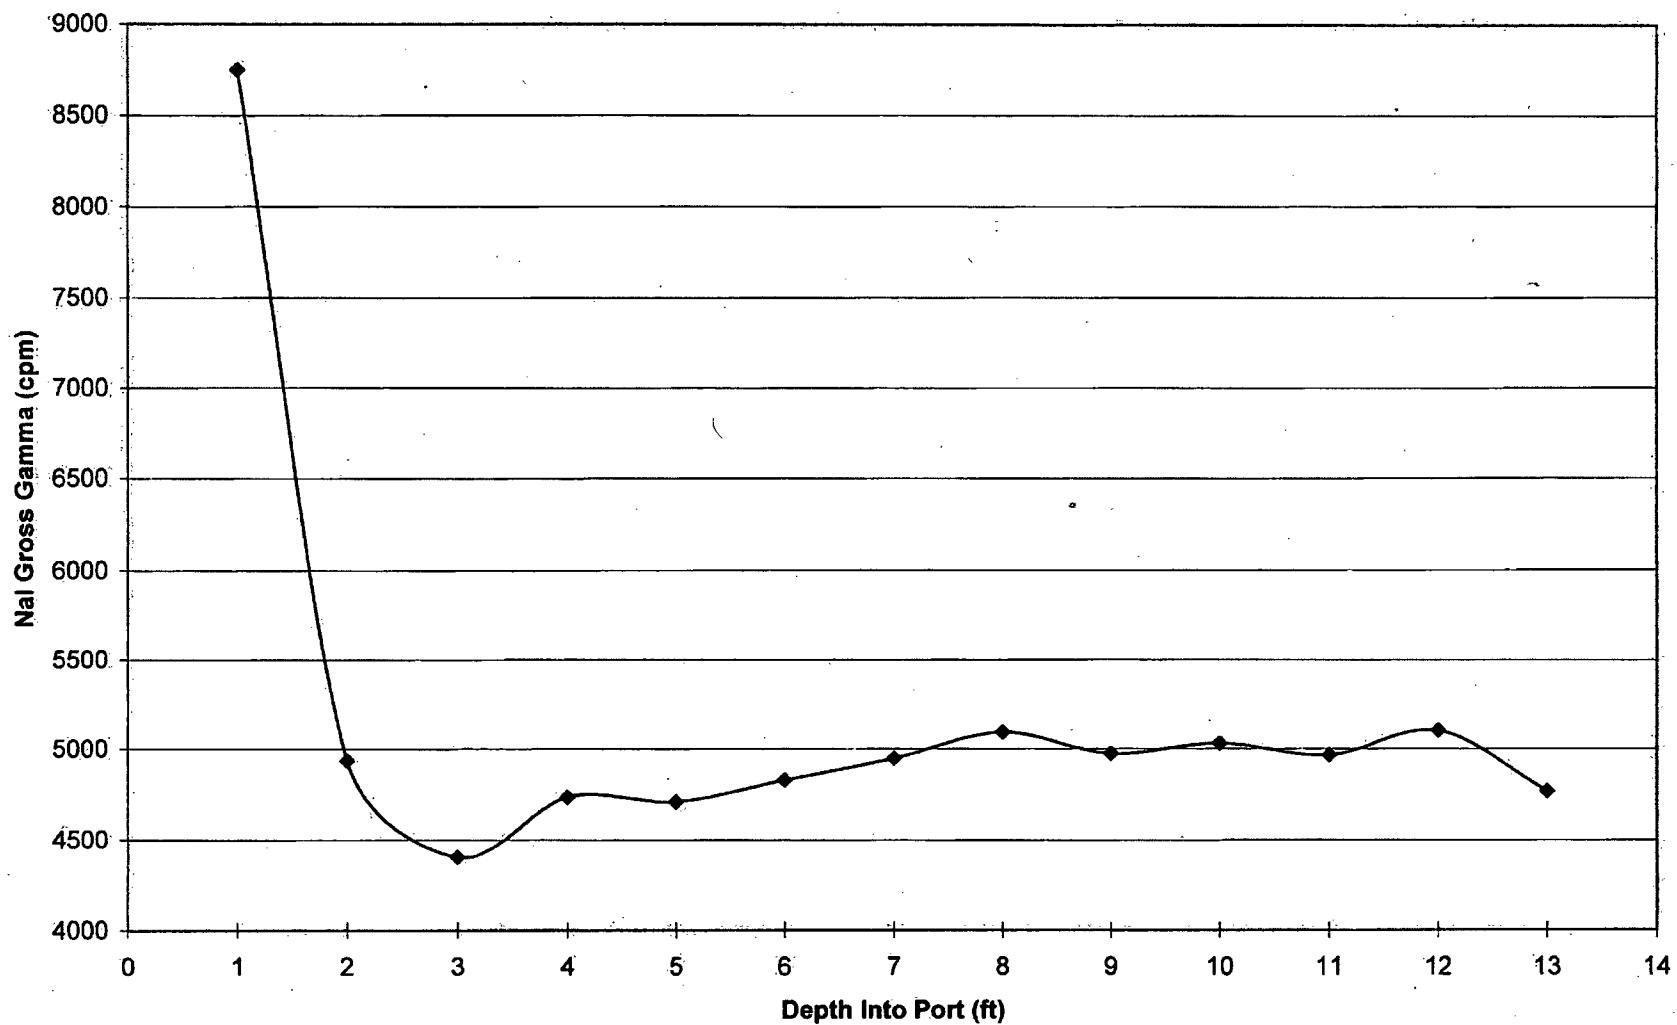


Surveyed: 05-21-2007

FNR Storage Port #48: Nal Gross Gamma vs Depth

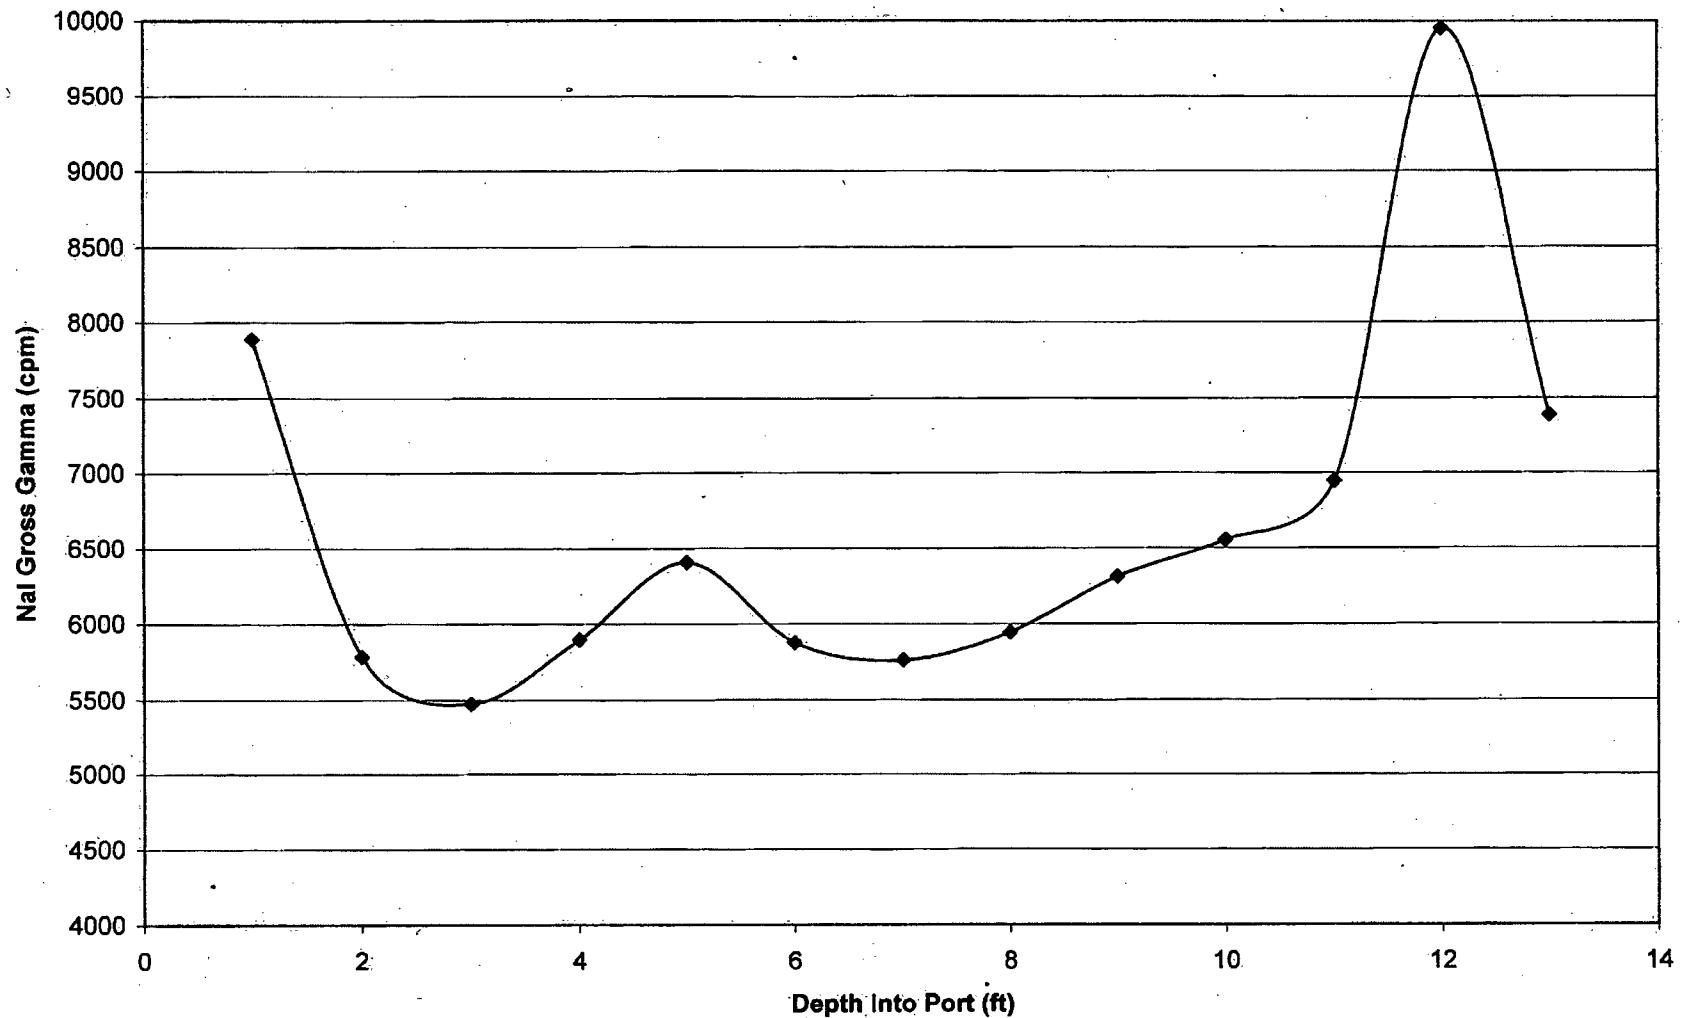


Surveyed: 05-21-2007

FNR Storage Port #49: Nal Gross Gamma vs Depth

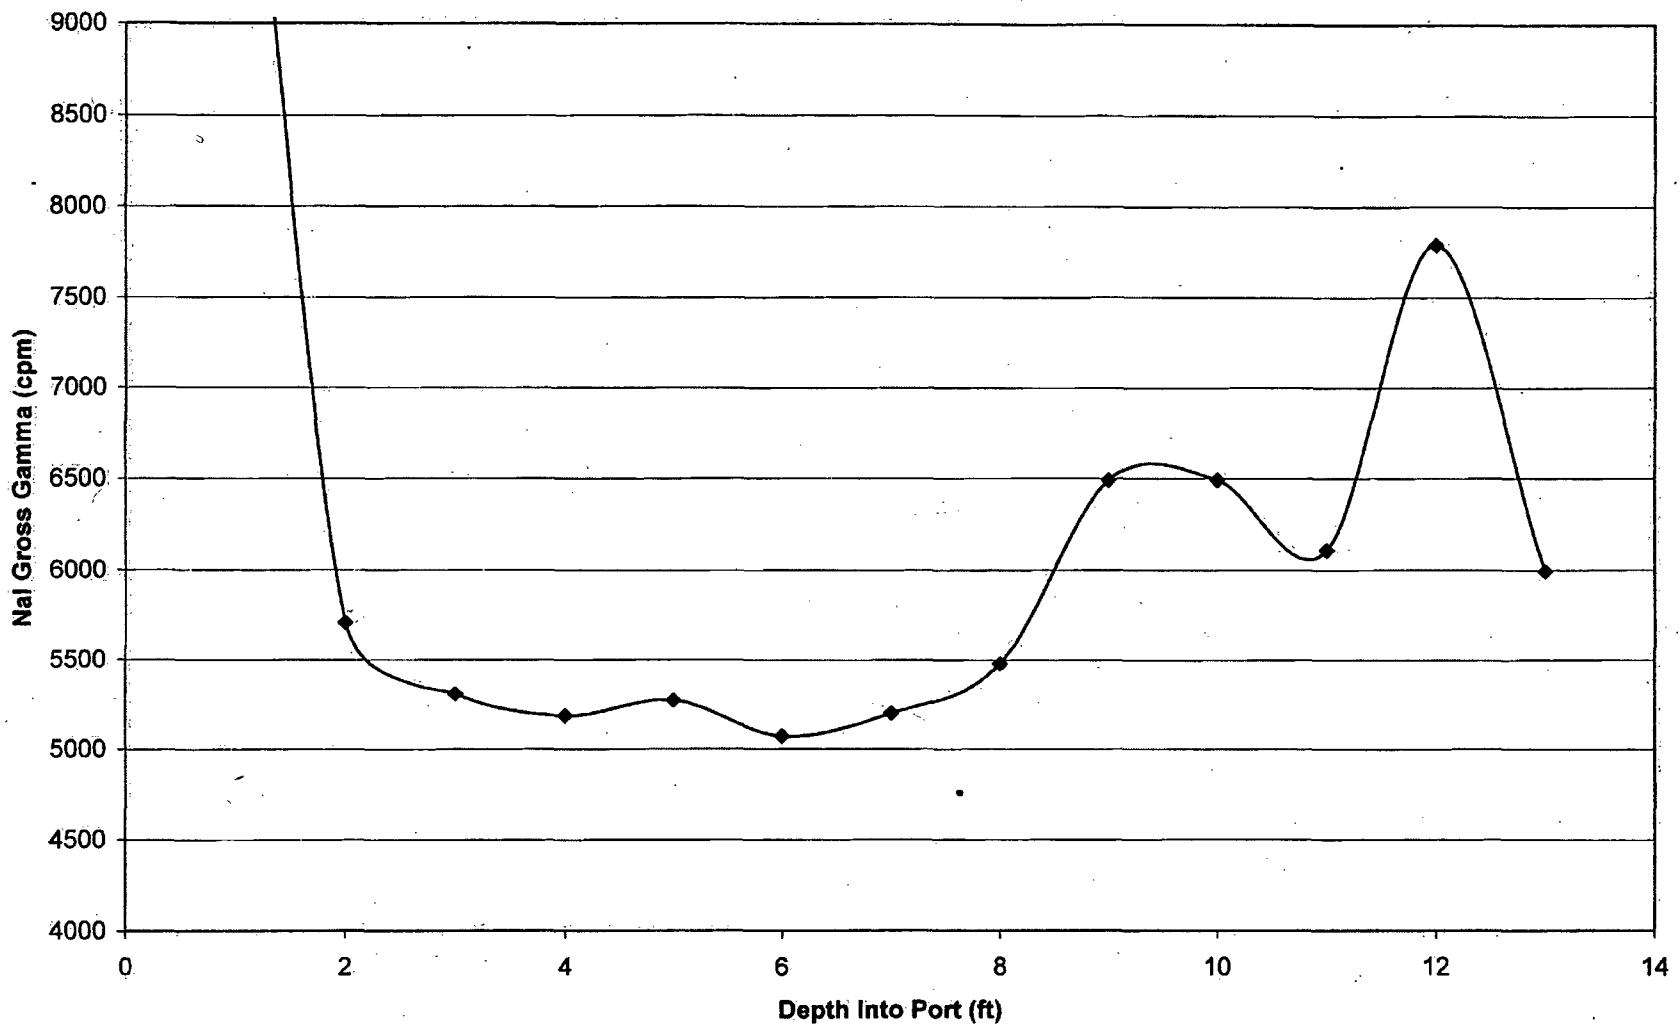

Surveyed: 05-21-2007

FNR Storage Port #50: NaI Gross Gamma vs Depth

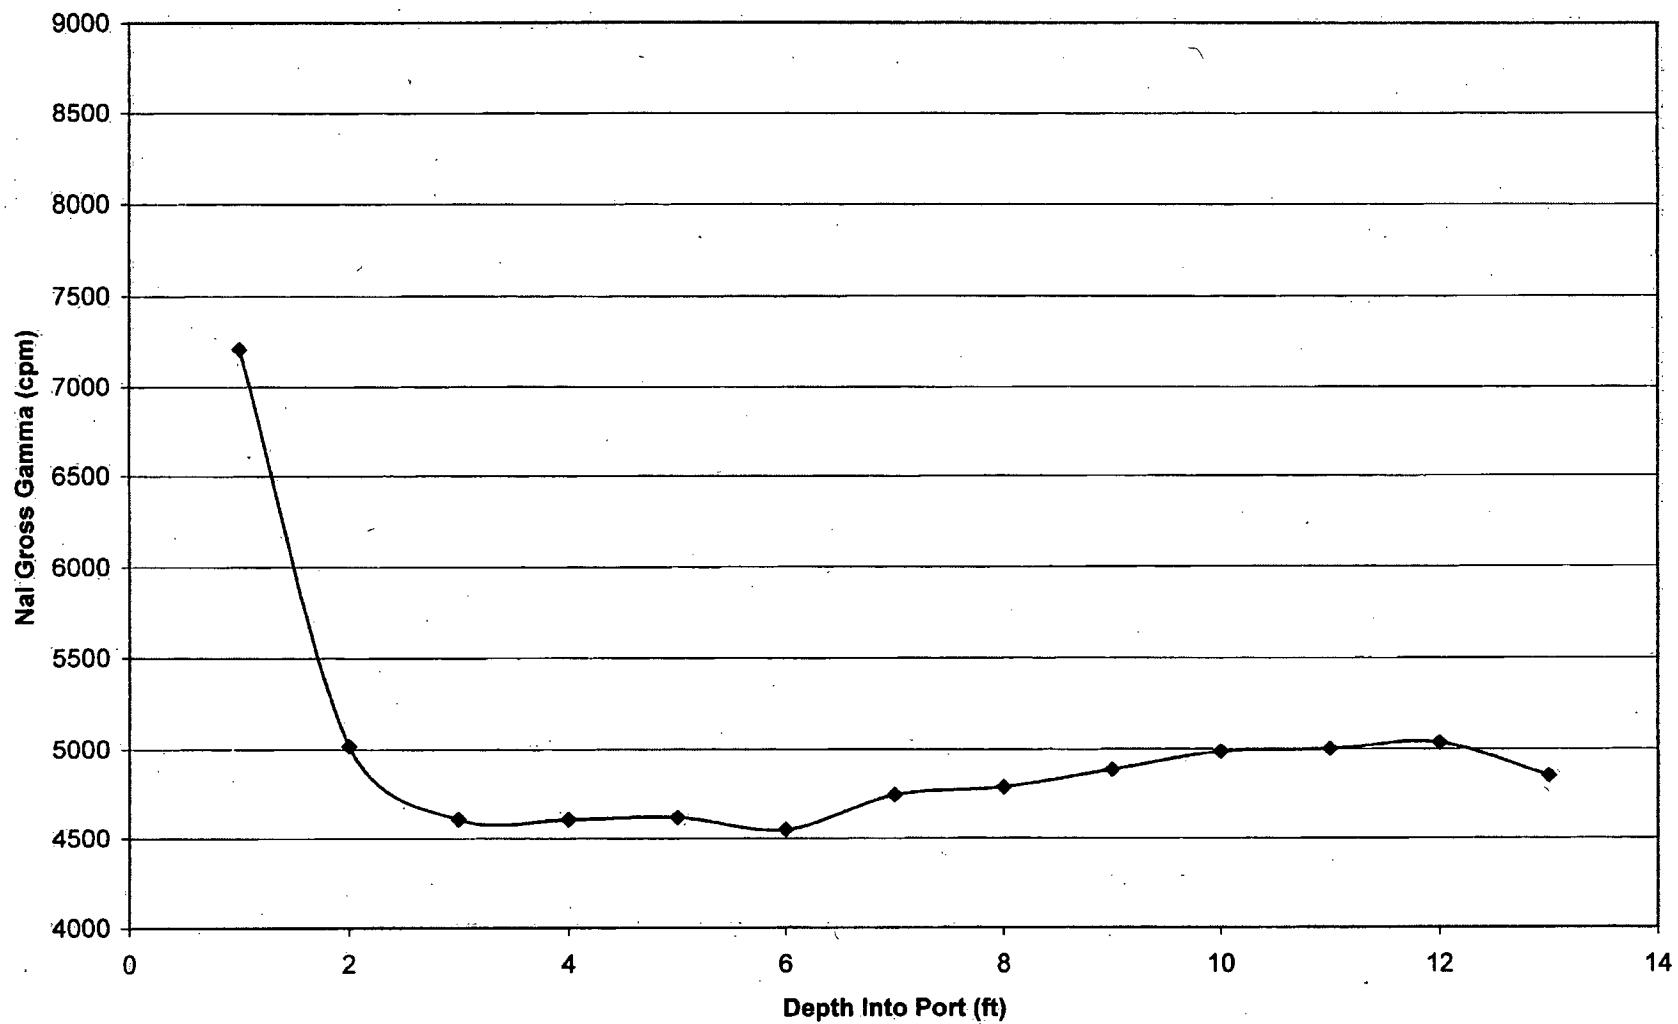

Surveyed: 05-21-2007

APPENDIX B

UNIVERSITY OF MICHIGAN

FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A S E C T R U M A N A L Y S I S *****

Filename: C:\Soil\2008-11-06-01\2008-11-06-01N_100000_2008Nov10.CNF

Report Generated On : 12/17/2008 6:07:55 PM

Sample Title : Soil Background - Storage Port Fill

Sample Description : 500 ml nalgene

Sample Identification : UM-2008-11-06-01

Sample Type : soil

Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00

Peak Locate Range (in channels) : 1 - 8192

Peak Area Range (in channels) : 5 - 8192

Identification Energy Tolerance : 1.000 keV

Sample Size : 1.000E+003 g

Sample Taken On : 9/1/2008 11:45:00 PM

Acquisition Started : 11/10/2008 9:07:01 AM

Live Time : 1000000.0 seconds

Real Time : 100100.3 seconds

Dead Time : 0.10 %

Energy Calibration Used Done On : 12/17/2008

***** NUCLIDE MDA REPORT *****

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: Soil Background - Storage Port Fill
 Nuclide Library Used: C:\GENIE2K\CAMFILES\LIBRARIES\Soil_DCGL

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	Pb x-ray	72.80	61.00	1.7312E-008	1.73E-008	-6.8954E-009
		75.00*	100.00	1.8854E-008		4.9930E-008
		84.90*	36.00	2.1462E-008		1.8456E-008
		87.60*	10.00	9.0358E-008		2.1696E-007
+	BE-7	477.59	10.42	2.8147E-007	2.81E-007	2.8645E-008
	K-40	1460.75*	10.67	2.0949E-007	2.09E-007	8.9679E-006
	MN-54	834.83	99.98	1.7669E-008	1.77E-008	-4.3999E-009
	CO-60	1173.24	99.90	2.0256E-008	1.76E-008	8.3258E-009
		1332.50	99.98	1.7643E-008		1.5454E-008
		511.00	2.83	7.5535E-007	5.71E-008	-7.9533E-008
+	ZN-65	1115.55	50.70	5.7140E-008		-4.0718E-009
		702.62	97.90	1.4098E-008	1.41E-008	3.1511E-009
	NB-94x	871.09	99.90	1.4750E-008		5.3043E-009
		79.13	6.60	1.6780E-007	1.30E-008	1.6613E-008
+	AG-108m	433.94	90.50	1.3046E-008		8.7054E-009
		614.28	89.80	2.5348E-008		2.2054E-010
		722.94	90.80	1.6153E-008		4.0493E-009
	CD-109	88.03*	3.61	2.7407E-007	2.74E-007	6.5808E-007
+	AG-110m	446.81	3.75	3.6686E-007	1.64E-008	1.5427E-007
		620.36	2.81	5.4534E-007		-1.1882E-007
		657.76	94.60	1.6445E-008		6.0295E-010
		677.62	10.35	1.4631E-007		-6.8294E-008
		687.02	6.44	2.4955E-007		4.0062E-008
		706.68	16.44	1.0337E-007		8.7489E-008
		744.28	4.73	3.6893E-007		1.4310E-007
		763.94	22.29	8.8737E-008		1.8806E-008
		818.03	7.34	2.3929E-007		6.7159E-009
		884.68	72.70	2.4825E-008		-2.5776E-010
		937.49	34.36	5.7360E-008		-8.6489E-009
		1384.30	24.28	8.1767E-008		4.3171E-008
		1475.79	3.99	3.6941E-007		1.1523E-007
	SB-125	1505.04	13.04	1.3429E-007		-8.3139E-008
		1562.30	1.03	1.4606E-006		4.8391E-007
		176.33	6.79	1.5043E-007	4.02E-008	-7.9700E-008
		380.43	1.52	7.5359E-007		3.8838E-008
		427.89	29.40	4.0236E-008		-1.7034E-008
		463.38	10.45	1.2215E-007		1.6248E-007
		600.56	17.78	7.5604E-008		6.5278E-008
		606.64	5.02	5.0997E-007		-5.8991E-008
		635.90	11.32	1.1386E-007		2.8665E-010
		671.41	1.80	7.5226E-007		-1.3293E-007
	BA-133	53.16	2.20	3.7734E-007	2.73E-008	1.7622E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	79.62	2.62	4.2479E-007	2.73E-008	-1.9400E-009
	81.00	34.10	2.7340E-008		-1.1400E-008
	160.61	0.64	1.4401E-006		7.0942E-007
	223.23	0.45	2.2985E-006		7.5210E-007
	276.40	7.16	1.4778E-007		3.9165E-008
	302.85	18.33	5.7083E-008		3.8433E-010
	356.02	62.05	2.8064E-008		-2.7673E-008
	383.85	8.94	1.2801E-007		6.5646E-008
	475.35	1.46	8.5311E-007		-2.8470E-007
	563.23	8.38	1.5525E-007		-7.4280E-011
CS-134	569.32	15.43	8.5974E-008	1.90E-008	8.6071E-009
	604.70	97.60	2.0763E-008		-3.0739E-009
	795.84	85.40	1.9032E-008		2.3069E-008
	801.93	8.73	1.7546E-007		-7.2547E-008
	1038.57	1.00	1.8112E-006		-4.1042E-007
	1167.94	1.80	1.1535E-006		1.0394E-006
	1365.15	3.04	4.9918E-007		3.8692E-007
	661.66	85.21	1.6079E-008	1.61E-008	7.4697E-009
EU-152x	121.78	28.40	2.8786E-008		1.0174E-009
	244.70	7.49	1.5999E-007		2.0757E-009
	344.28	26.60	4.1085E-008		-6.0935E-009
	411.11	2.23	5.2242E-007		-1.2062E-007
	443.98	2.78	4.1100E-007		-1.3841E-007
	778.90	12.96	1.1246E-007		-8.9233E-009
	867.39	4.15	3.6246E-007		5.2208E-008
	964.13	14.34	1.3505E-007		-3.9789E-008
	1085.91	9.92	1.7523E-007		-9.4027E-009
	1089.70	1.71	1.0295E-006		3.0797E-007
EU-154	1112.12	13.55	1.3612E-007	2.05E-008	1.8966E-008
	1212.95	1.40	1.5750E-006		-7.2865E-007
	1299.12	1.63	1.0407E-006		1.3197E-007
	1408.01	20.87	7.8480E-008		1.0402E-007
	123.07	40.40	2.0536E-008		1.1116E-009
	188.25	0.23	4.9960E-006		-9.2005E-007
	247.93	6.83	1.4678E-007		-9.6790E-009
	401.30	0.19	6.0017E-006		-9.1079E-007
	444.39	0.55	2.0762E-006		-1.0161E-006
	478.26	0.21	5.7388E-006		9.3377E-007
EU-154	557.56	0.25	4.7266E-006	2.05E-008	-2.3068E-006
	582.00	0.89	1.9537E-006		1.0025E-005
	591.76	4.91	2.4453E-007		-2.3015E-007
	625.22	0.32	3.9055E-006		-1.6843E-006
	676.59	0.14	9.2642E-006		-4.9429E-006
	692.42	1.78	7.6497E-007		-5.9129E-008
	715.76	0.17	7.7322E-006		-5.2589E-006
	722.30	20.00	7.0082E-008		-2.3892E-008
	756.86	4.50	3.2676E-007		-7.5369E-009
	815.55	0.50	2.8984E-006		-1.7062E-006
845.39	0.58	2.5718E-006	6.3928E-006	2.7820E-006	-1.4378E-006
	850.64	0.23			
873.20	12.09	1.2349E-007	1.2349E-007	2.7098E-008	2.7098E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	3.0741E-006	2.05E-008	-1.2778E-007
	904.05	0.85	1.8100E-006		1.5800E-007
	996.30	10.34	1.5704E-007		-1.1905E-008
	1004.76	17.90	9.7292E-008		1.2028E-007
	1128.40	0.29	6.3588E-006		-3.5137E-006
	1140.90	0.22	8.5255E-006		-6.8257E-007
	1241.60	0.13	1.9085E-005		-9.0839E-006
	1246.60	0.80	2.5117E-006		-3.5308E-006
	1274.51	34.40	5.2824E-008		-6.9981E-008
	1494.08	0.71	1.8543E-006		-7.9253E-007
+ TL-208B	1596.45	1.80	7.7621E-007	1.79E-008	-7.5055E-008
	72.80	2.02	5.2279E-007		-2.0823E-007
	74.97*	3.41	5.5290E-007		1.4642E-006
	84.90*	1.51	5.1168E-007		4.4002E-007
	277.36*	6.31	1.2898E-007		7.9916E-008
	510.77*	22.60	1.1666E-007		1.3365E-007
	583.19*	84.50	1.8279E-008		7.9848E-008
	763.13	1.81	8.7109E-007		-5.9783E-008
	860.56*	12.42	1.5089E-007		1.1443E-007
	2614.53*	99.16	1.7922E-008		9.1687E-008
+ Pb-210	46.52*	4.05	2.3910E-007	2.39E-007	3.8653E-007
+ PB-212B	74.81*	10.50	1.7956E-007	4.76E-008	4.7552E-007
	77.11*	17.60	1.0722E-007		4.5689E-007
	87.30*	7.90	1.1438E-007		2.7463E-007
	238.63*	43.60	4.7555E-008		2.6027E-007
	300.09*	3.34	3.1207E-007		1.3451E-007
+ BI-214B	609.31*	44.80	4.8603E-008	4.86E-008	3.8037E-007
	665.45*	1.29	9.2101E-007		6.6909E-007
	768.36*	4.80	4.0987E-007		4.5556E-007
	806.17*	1.12	1.5595E-006		8.4699E-007
	934.06*	3.03	7.4092E-007		1.6421E-007
	1120.29*	14.80	1.9382E-007		4.3643E-007
	1155.19	1.64	1.2132E-006		1.3175E-006
	1238.11*	5.86	4.2833E-007		5.5968E-007
	1280.96	1.44	1.3007E-006		1.7046E-006
	1377.67*	3.92	4.2373E-007		3.7318E-007
	1401.50*	1.55	9.1760E-007		4.8399E-007
	1407.98*	2.80	5.3286E-007		3.7594E-007
	1509.23*	2.12	7.7084E-007		5.5296E-007
	1661.28	1.14	1.0383E-006		-3.6302E-007
	1729.59*	2.88	6.1080E-007		3.8151E-007
	1764.49*	15.36	1.4213E-007		3.7158E-007
	1847.42*	2.04	9.1315E-007		8.0059E-007
	2118.55	1.14	1.1561E-006		-2.1082E-007
	2204.21*	4.86	2.8591E-007		7.3993E-007
	2447.86*	1.50	1.2947E-006		4.2322E-007
+ PB-214B	53.23*	1.11	7.0559E-007	4.57E-008	3.5720E-007
	74.81*	5.90	3.1956E-007		8.4626E-007
	77.11*	9.90	1.9061E-007		8.1226E-007
	87.30*	4.41	2.0489E-007		4.9197E-007
	241.98*	7.50	2.8262E-007		4.6078E-007

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	PB-214B	295.21*	18.50	7.9660E-008	4.57E-008	4.0375E-007
		351.92*	35.80	4.5726E-008		3.9887E-007
+	RA-226	186.10*	3.50	3.6333E-007	3.63E-007	6.8903E-007
+	AC-228B	12.95	15.10	1.6557E-006	7.09E-008	-1.1996E-005
		16.15	20.00	4.4331E-007		-2.6600E-006
		19.11	4.60	9.2538E-007		-1.5923E-006
		89.96*	3.40	3.9161E-007		3.8590E-007
		93.35*	5.60	2.5957E-007		4.6363E-007
		99.55*	1.30	5.4002E-007		4.6691E-007
		105.36	2.00	4.0651E-007		4.7495E-008
		129.03*	2.90	2.6337E-007		1.4655E-007
		209.39*	4.10	2.1806E-007		2.7152E-007
		270.26*	3.80	3.4606E-007		2.4428E-007
		328.07*	3.50	2.7746E-007		2.2795E-007
		338.42*	12.40	8.4379E-008		2.9111E-007
		409.62*	2.20	6.2330E-007		2.0545E-007
		463.10*	4.60	2.6564E-007		3.5236E-007
		562.65	1.01	1.2141E-006		-2.1701E-007
		755.28	1.32	1.1028E-006		9.0669E-008
		772.28	1.09	1.5442E-006		6.3911E-008
		794.79*	4.60	2.8188E-007		2.2660E-007
		835.60	1.71	8.9855E-007		-1.2797E-007
		911.16*	29.00	7.0879E-008		2.2971E-007
		964.64*	5.80	2.4653E-007		1.9612E-007
		968.97*	17.40	8.4908E-008		2.6778E-007
		1459.19	1.06	5.6817E-006		9.3381E-005
		1496.00	1.05	1.2553E-006		4.6106E-007
		1588.23	3.60	4.3444E-007		-7.8049E-008
		1630.47	1.95	6.5277E-007		4.6825E-007
	PA-234B	63.00	3.20	2.8589E-007	3.50E-008	-8.4035E-008
		94.67	14.30	6.6056E-008		-1.1601E-008
		98.44	23.00	3.4991E-008		3.4064E-009
		99.70	4.80	1.6839E-007		3.4916E-008
		111.00	10.80	7.6730E-008		3.6766E-008
		125.40	1.00	8.4102E-007		-4.4674E-007
		131.20	20.00	4.3648E-008		5.8143E-009
		152.70	6.70	1.3965E-007		-3.4542E-008
		186.00	2.00	5.8159E-007		2.3512E-006
		200.90	1.00	1.0212E-006		1.5893E-007
		202.90	1.20	8.5387E-007		8.1785E-008
		226.40	5.90	1.7491E-007		-1.0841E-007
		227.20	5.50	1.8848E-007		-8.1392E-008
		248.90	2.80	3.5761E-007		-6.9412E-008
		272.10	1.00	1.1039E-006		-3.5589E-007
		293.70	3.90	3.6928E-007		-1.2072E-007
		369.80	2.90	3.8494E-007		1.9626E-007
		372.40	1.30	8.4695E-007		-1.2731E-007
		458.80	1.50	7.9411E-007		-2.9967E-008
		506.80	1.60	1.0030E-006		-2.6117E-007
		513.70	1.30	1.3535E-006		5.0962E-008
		565.90	1.40	9.0435E-007		5.7709E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	3.8179E-007	3.50E-008	-2.5676E-008
	569.50	10.00	1.2613E-007		1.2628E-008
	574.00	2.00	6.2872E-007		-2.1914E-007
	664.80	1.30	1.0724E-006		1.3361E-006
	666.70	1.60	8.6195E-007		3.0313E-007
	669.90	1.40	9.4827E-007		-1.6473E-007
	692.70	1.50	9.0478E-007		-4.1787E-008
	699.00	4.60	2.9748E-007		-2.1391E-007
	706.10	3.10	4.5650E-007		5.3844E-007
	733.00	9.00	1.6937E-007		2.1644E-009
	738.00	1.00	1.4768E-006		-2.6685E-007
	742.81	2.40	6.0690E-007		9.7801E-008
	755.60	1.40	1.0416E-006		-6.7296E-009
	780.70	1.10	1.3520E-006		-4.6143E-008
	786.27	1.40	1.0551E-006		-8.3617E-007
	793.60	1.50	1.0392E-006		1.5215E-006
	796.30	3.80	4.0829E-007		6.5897E-007
	805.80	3.30	4.4124E-007		2.9526E-007
	819.60	2.60	5.6820E-007		4.5623E-008
	826.30	4.00	3.8135E-007		3.2153E-007
	831.60	5.50	2.7817E-007		1.3670E-007
	876.40	4.00	3.6869E-007		-4.3722E-008
	880.50	4.00	3.6424E-007		-3.0321E-007
	880.51	9.00	1.6188E-007		-1.3476E-007
	883.24	15.00	9.9918E-008		3.3205E-008
	899.00	4.10	3.7150E-007		-5.0801E-009
	925.00	2.90	5.2849E-007		7.4763E-008
	926.00	11.00	1.3835E-007		-3.0267E-008
	927.10	11.00	1.3780E-007		-9.0792E-008
	946.00	12.00	1.3229E-007		7.5176E-008
	949.00	8.00	1.9753E-007		1.6926E-007
	978.80	1.40	1.0857E-006		-1.3248E-007
	980.50	2.00	7.6961E-007		2.4922E-007
	980.50	3.00	5.1307E-007		1.6615E-007
	984.00	1.90	8.2918E-007		6.9079E-008
	1353.30	1.70	8.8483E-007		-2.4300E-007
	1394.10	3.00	4.5838E-007		2.5716E-008
	1452.70	1.00	1.8093E-006		-2.5344E-007
	1668.50	1.20	9.4669E-007		-7.4170E-007
	1694.60	1.20	1.0156E-006		-4.8341E-007
+	TH-234	63.29*	4.50	1.7585E-006	1.76E-006
		92.38	2.60	2.8420E-006	
		92.80*	2.60	4.1278E-006	
+	U-235	72.70	0.11	9.4758E-006	2.21E-008
		89.95*	2.80	4.6931E-007	
		93.35*	4.50	3.1880E-007	
		94.00	0.40	2.3388E-006	
		105.00	2.10	3.8144E-007	
		109.16	1.50	5.3782E-007	
		140.76	0.22	4.1492E-006	
		143.76*	10.90	8.9113E-008	

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	U-235	163.33	5.00	1.8444E-007	2.21E-008	6.4852E-009
		182.61	0.40	2.6956E-006		-4.0257E-006
		185.71*	57.50	2.2114E-008		4.1937E-008
		194.94	0.59	1.6992E-006		3.3220E-008
		202.11	1.00	1.0055E-006		-5.1415E-007
		205.31	5.00	2.0423E-007		-1.1028E-008
		279.50	0.27	3.7867E-006		3.2493E-006

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX C - I

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A S E C T R U M A N A L Y S I S *****

Filename: C:\Soil\2008-12-18-01\2008-12-18-01N_100000_2009Jan2.CNF

Report Generated On : 1/5/2009 3:47:54 PM

Sample Title : Soil Immediately in vicinity of Storage
Sample Description : 500 ml Nalgene
Sample Identification : 2008-12-18-01N
Sample Type : Soil 2.0 g/cc
Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00

Peak Locate Range (in channels) : 8 - 8192

Peak Area Range (in channels) : 8 - 8192

Identification Energy Tolerance : 1.000 keV

Sample Size : 1.000E+003 g

Sample Taken On : 12/18/2008 11:55:00 AM

Acquisition Started : 1/2/2009 10:37:40 PM

Live Time : 100000.0 seconds

Real Time : 100007.8 seconds

Dead Time : 0.01 %

Energy Calibration Used Done On : 12/18/2008

Efficiency Calibration Used Done On : 12/17/2008

Efficiency ID :

***** N U C L I D E M D A R E P O R T *****

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: Soil Immediately in vicinity of Storage
 Nuclide Library Used: C:\GENIE2K\CAMFILES\LIBraries\Soil_DCGL

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ Pb x-ray	72.80	61.00	2.2790E-008	1.99E-008	-7.3552E-009
	75.00*	100.00	1.9939E-008		6.2027E-008
	84.90*	36.00	9.9714E-008		7.8783E-008
	87.60*	10.00	3.5953E-007		4.7002E-007
+ BE-7	477.59	10.42	1.9989E-007	2.00E-007	9.2997E-008
+ K-40	1460.75*	10.67	2.1220E-007	2.12E-007	1.1019E-005
+ MN-54	834.83*	99.98	2.2026E-008	2.20E-008	<u>1.5932E-008</u>
+ CO-60	1173.24*	99.90	4.0304E-008	2.61E-008	4.6182E-007
	1332.50*	99.98	2.6145E-008		4.4833E-007
ZN-65	511.00	2.83	8.2718E-007	8.26E-008	4.6003E-006
	1115.55	50.70	8.2641E-008		6.7304E-007
NB-94x	702.62	97.90	2.0800E-008	2.08E-008	1.3779E-008
	871.09	99.90	2.8204E-008		1.4854E-008
AG-108m	79.13	6.60	2.1680E-007	1.77E-008	-3.3509E-007
	433.94	90.50	1.7691E-008		-1.0709E-008
	614.28	89.80	2.8847E-008		-2.9331E-008
	722.94	90.80	2.5222E-008		1.1850E-008
+ CD-109	88.03*	3.61	1.0163E-006	1.02E-006	1.3286E-006
AG-110m	446.81	3.75	5.1169E-007	2.15E-008	-1.0785E-007
	620.36	2.81	7.0796E-007		-3.5764E-007
	657.76	94.60	2.1492E-008		-2.0575E-008
	677.62	10.35	2.0031E-007		1.2930E-007
	687.02	6.44	3.3201E-007		1.1237E-007
	706.68	16.44	1.2912E-007		-3.6883E-008
	744.28	4.73	4.8487E-007		1.3469E-007
	763.94	22.29	1.1253E-007		-6.3800E-008
	818.03	7.34	3.2259E-007		-2.2853E-008
	884.68	72.70	3.4213E-008		7.6985E-009
	937.49	34.36	7.4316E-008		-7.5817E-009
	1384.30	24.28	7.4132E-008		-4.2231E-008
	1475.79	3.99	3.4329E-007		-1.9457E-007
	1505.04	13.04	1.1881E-007		-1.5693E-008
	1562.30	1.03	1.2901E-006		-6.2532E-007
SB-125	176.33	6.79	2.1164E-007	5.53E-008	-3.4249E-008
	380.43	1.52	1.0219E-006		-7.0704E-007
	427.89	29.40	5.5274E-008		-1.8866E-008
	463.38	10.45	1.6231E-007		5.8298E-008
	600.56	17.78	1.1099E-007		4.1788E-010
	606.64	5.02	5.7244E-007		-2.3331E-008
	635.90	11.32	1.6916E-007		3.2118E-008
	671.41	1.80	1.1021E-006		-1.0918E-006
BA-133	53.16	2.20	4.9756E-007	3.19E-008	1.0735E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	79.62	2.62	5.4466E-007	3.19E-008	-8.4640E-007
	81.00	34.10	3.8162E-008		-1.6450E-007
	160.61	0.64	2.1384E-006		2.8297E-006
	223.23	0.45	3.3399E-006		1.1284E-006
	276.40	7.16	2.0579E-007		5.2598E-008
	302.85	18.33	8.0133E-008		-1.6931E-008
	356.02	62.05	3.1866E-008		-1.0333E-007
	383.85	8.94	1.7541E-007		-4.4408E-009
	475.35	1.46	1.1640E-006	1.59E-008	2.7777E-008
	563.23*	8.38	1.5977E-007		5.5290E-008
+ CS-134	569.32	15.43	1.2439E-007		-3.5171E-008
	604.70*	97.60	1.5930E-008		1.9392E-008
	795.84*	85.40	2.0223E-008		2.7770E-008
	801.93	8.73	2.5819E-007		-2.2145E-007
	1038.57	1.00	2.3764E-006		-2.9657E-006
	1167.94	1.80	2.3336E-006		4.2343E-007
	1365.15	3.04	5.3262E-007		2.1101E-007
	661.66	85.21	2.3295E-008	2.33E-008	6.7507E-009
	121.78*	28.40	6.3672E-008	6.37E-008	1.9663E-006
	244.70*	7.49	4.6185E-007		1.9143E-006
+ CS-137	344.28*	26.60	7.0919E-008		1.8879E-006
	411.11*	2.23	7.8608E-007		2.1749E-006
	443.98*	2.78	7.1092E-007		2.2104E-006
	778.90*	12.96	1.7189E-007		2.0531E-006
	867.39*	4.15	6.1539E-007		1.8145E-006
	964.13*	14.34	2.9108E-007		2.0566E-006
	1085.91*	9.92	4.6298E-007		2.0919E-006
	1089.70*	1.71	2.7021E-006		2.6391E-006
	1112.12*	13.55	2.4919E-007		2.0369E-006
	1212.95*	1.40	1.7558E-006		2.2261E-006
+ EU-152x	1299.12*	1.63	1.1766E-006		1.9564E-006
	1408.01*	20.87	9.5893E-008		2.0823E-006
	123.07	40.40	5.3508E-008	5.35E-008	-4.5774E-009
	188.25	0.23	6.7518E-006		-3.6636E-006
	247.93	6.83	2.6435E-007		1.4184E-006
	401.30	0.19	8.3321E-006		3.1884E-006
	444.39	0.55	3.3662E-006		1.1169E-005
	478.26	0.21	8.1163E-006		5.2896E-006
	557.56	0.25	7.2431E-006		-5.1831E-006
	582.00	0.89	2.6094E-006		9.6606E-006
EU-154	591.76	4.91	3.8831E-007		-2.7262E-007
	625.22	0.32	5.9727E-006		-2.9648E-008
	676.59	0.14	1.4582E-005		-2.2096E-006
	692.42	1.78	1.1787E-006		-5.1231E-008
	715.76	0.17	1.2112E-005		2.6098E-006
	722.30	20.00	1.1154E-007		4.5687E-008
	756.86	4.50	5.1234E-007		2.6612E-007
	815.55	0.50	4.5640E-006		3.6749E-007
	845.39	0.58	4.0517E-006		2.2147E-006
	850.64	0.23	9.9898E-006		-5.8306E-006
	873.20	12.09	2.2458E-007		-2.9083E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	4.8349E-006	5.35E-008	1.8677E-006
	904.05	0.85	2.8602E-006		-4.8653E-007
	996.30	10.34	2.3656E-007		2.5683E-008
	1004.76	17.90	1.4756E-007		2.3828E-007
	1128.40	0.29	8.5146E-006		-9.5004E-006
	1140.90	0.22	1.1294E-005		-7.9772E-006
	1241.60	0.13	2.0896E-005		-1.4188E-005
	1246.60	0.80	2.9608E-006		-1.9684E-006
	1274.51	34.40	7.0414E-008		1.3229E-007
	1494.08	0.71	1.9605E-006		-3.3617E-007
	1596.45	1.80	8.8063E-007		-4.5685E-008
+ TL-208B	72.80	2.02	6.8822E-007	2.61E-008	-2.2211E-007
	74.97*	3.41	5.8472E-007		1.8190E-006
	84.90*	1.51	2.3773E-006		1.8783E-006
	277.36*	6.31	1.6686E-007		7.3518E-008
	510.77*	22.60	1.3009E-007		9.1441E-008
	583.19*	84.50	2.6114E-008		9.9847E-008
	763.13	1.81	1.3183E-006		-8.4216E-007
	860.56*	12.42	1.4468E-007		1.3066E-007
	2614.53	99.16	2.8487E-008		1.2778E-007
+ Pb-210	46.52*	4.05	3.8975E-007	3.90E-007	1.4607E-006
+ PB-212B	74.81*	10.50	1.8989E-007	7.93E-008	5.9073E-007
	77.11*	17.60	1.1208E-007		5.2798E-007
	87.30*	7.90	4.5511E-007		5.9496E-007
	238.63*	43.60	7.9280E-008		3.4815E-007
	300.09*	3.34	4.0858E-007		4.0355E-007
+ BI-214B	609.31*	44.80	4.6571E-008	4.66E-008	5.4444E-007
	665.45	1.29	1.5492E-006		8.1125E-007
	768.36*	4.80	3.8640E-007		6.2775E-007
	806.17	1.12	2.0246E-006		6.5388E-007
	934.06*	3.03	8.5674E-007		5.0205E-007
	1120.29*	14.80	1.9604E-007		5.6662E-007
	1155.19*	1.64	1.2889E-006		1.3812E-006
	1238.11*	5.86	3.8957E-007		7.3543E-007
	1280.96	1.44	1.6059E-006		1.1556E-006
	1377.67*	3.92	4.0913E-007		7.3397E-007
	1401.50*	1.55	1.0090E-006		5.2258E-007
	1407.98*	2.80	7.1529E-007		1.5532E-005
	1509.23*	2.12	8.4472E-007		1.0995E-006
	1661.28*	1.14	1.2716E-006		6.1785E-007
	1729.59*	2.88	3.5610E-007		6.0672E-007
	1764.49*	15.36	9.8206E-008		5.9582E-007
	1847.42*	2.04	6.6568E-007		5.6918E-007
	2118.55	1.14	1.2111E-006		-9.1058E-009
	2204.21*	4.86	4.7675E-007		6.7652E-007
	2447.86*	1.50	5.3151E-007		5.2608E-007
+ PB-214B	53.23*	1.11	7.3322E-007	5.09E-008	5.4642E-007
	74.81*	5.90	3.3795E-007		1.0513E-006
	77.11*	9.90	1.9926E-007		9.3863E-007
	87.30*	4.41	8.1527E-007		1.0658E-006
	241.98*	7.50	4.5906E-007		7.3976E-007

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	PB-214B	295.21*	18.50	8.8721E-008	5.09E-008	6.4590E-007
		351.92*	35.80	5.0880E-008		5.8294E-007
+	RA-226	186.10*	3.50	4.6241E-007	4.62E-007	9.7896E-007
+	AC-228B	12.95	15.10	1.0284E-006	9.54E-008	-9.3529E-009
		16.15	20.00	4.1228E-007		7.2653E-008
		19.11	4.60	1.0510E-006		-3.8324E-007
		89.96*	3.40	1.0702E-006		7.7066E-007
		93.35*	5.60	6.5366E-007		4.2049E-007
		99.55	1.30	9.7011E-007		6.8496E-007
		105.36	2.00	6.2999E-007		6.9668E-008
		129.03*	2.90	3.6627E-007		2.8412E-007
		209.39*	4.10	2.8160E-007		2.0020E-007
		270.26*	3.80	4.8039E-007		6.3653E-007
		328.07*	3.50	4.6898E-007		4.9838E-007
		338.42*	12.40	1.2720E-007		2.2411E-007
		409.62	2.20	8.1479E-007		2.1817E-006
		463.10*	4.60	2.7360E-007		3.9123E-007
		562.65*	1.01	1.3107E-006		4.5359E-007
		755.28	1.32	1.7386E-006		9.1203E-007
		772.28	1.09	2.2972E-006		-1.9324E-007
		794.79*	4.60	3.7124E-007		5.0978E-007
		835.60*	1.71	1.2464E-006		9.0152E-007
		911.16*	29.00	9.5369E-008		3.3640E-007
		964.64*	5.80	7.2023E-007		5.0887E-006
		968.97*	17.40	2.4479E-007		4.0219E-007
		1459.19	1.06	6.2056E-006		1.1293E-004
		1496.00	1.05	1.3325E-006		6.5624E-007
		1588.23	3.60	4.6012E-007		3.2593E-007
		1630.47	1.95	6.6862E-007		-4.2890E-007
	PA-234B	63.00	3.20	3.6937E-007	5.48E-008	8.1753E-007
		94.67	14.30	9.4719E-008		-6.7474E-008
		98.44	23.00	5.4760E-008		-1.8959E-008
		99.70	4.80	2.6241E-007		1.5368E-007
		111.00	10.80	1.1953E-007		3.4364E-008
		125.40	1.00	1.5861E-006		-1.8845E-006
		131.20	20.00	6.0649E-008		-1.0088E-008
		152.70	6.70	2.0276E-007		2.6111E-007
		186.00	2.00	7.8496E-007		2.8385E-006
		200.90	1.00	1.4599E-006		-8.8002E-007
		202.90	1.20	1.2187E-006		-7.0006E-007
		226.40	5.90	2.5304E-007		2.9514E-008
		227.20	5.50	2.6979E-007		-1.4786E-007
		248.90	2.80	5.8582E-007		-2.4409E-006
		272.10	1.00	1.4953E-006		-8.5579E-007
		293.70	3.90	4.5665E-007		-2.2556E-007
		369.80	2.90	5.5821E-007		6.8400E-007
		372.40	1.30	1.2208E-006		-5.9671E-007
		458.80	1.50	1.1212E-006		-1.5552E-006
		506.80	1.60	1.3293E-006		-9.2358E-008
		513.70	1.30	1.7102E-006		-1.0790E-006
		565.90	1.40	1.3769E-006		2.9473E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	5.8083E-007	5.48E-008	-2.0564E-007
	569.50	10.00	1.8983E-007		-5.3675E-008
	574.00	2.00	9.5072E-007		-1.8218E-007
	664.80	1.30	1.5363E-006		6.3837E-007
	666.70	1.60	1.2578E-006		7.7283E-007
	669.90	1.40	1.4171E-006		-6.3550E-007
	692.70	1.50	1.3933E-006		1.2949E-007
	699.00	4.60	4.4232E-007		-6.6417E-008
	706.10	3.10	6.5587E-007		-2.3926E-007
	733.00	9.00	2.5459E-007		1.2239E-007
	738.00	1.00	2.1906E-006		-6.3777E-007
	742.81	2.40	9.1527E-007		-1.8839E-007
	755.60	1.40	1.6382E-006		4.1169E-007
	780.70	1.10	2.9876E-006		2.2651E-005
	786.27	1.40	1.6805E-006		-5.5459E-006
	793.60	1.50	1.5487E-006		2.6658E-006
	796.30	3.80	6.0802E-007		3.9786E-007
	805.80	3.30	6.8495E-007		1.4754E-007
	819.60	2.60	8.6663E-007		-3.1580E-007
	826.30	4.00	5.7048E-007		2.9071E-007
	831.60	5.50	4.2067E-007		7.3590E-008
	876.40	4.00	6.1878E-007		1.5853E-007
	880.50	4.00	5.9431E-007		-1.8105E-007
	880.51	9.00	2.6414E-007		-8.0469E-008
	883.24	15.00	1.5919E-007		9.3824E-008
	899.00	4.10	5.8677E-007		-1.8587E-007
	925.00	2.90	8.3614E-007		2.6960E-007
	926.00	11.00	2.1969E-007		-5.9510E-008
	927.10	11.00	2.1890E-007		6.8320E-009
	946.00	12.00	1.9941E-007		1.3339E-007
	949.00	8.00	2.9850E-007		-9.1904E-008
	978.80	1.40	1.6283E-006		-1.1024E-007
	980.50	2.00	1.1374E-006		-2.4057E-007
	980.50	3.00	7.5825E-007		-1.6038E-007
	984.00	1.90	1.1918E-006		-7.6146E-007
	1353.30	1.70	9.5839E-007		-5.1743E-007
	1394.10	3.00	5.1917E-007		-2.5184E-008
	1452.70	1.00	2.3612E-006		-1.5479E-006
	1668.50	1.20	1.0105E-006		3.1367E-007
	1694.60	1.20	9.6053E-007		-2.6350E-007
+	TH-234	63.29*	4.50	4.5348E-007	5.4959E-007
		92.38	2.60	8.4581E-007	2.8175E-006
		92.80*	2.60	2.2256E-006	1.4317E-006
+	U-235	72.70	0.11	1.2603E-005	2.81E-008
		89.95*	2.80	1.2957E-006	9.3307E-007
		93.35*	4.50	8.1106E-007	5.2175E-007
		94.00	0.40	3.3771E-006	-1.7096E-006
		105.00	2.10	5.9784E-007	1.6501E-007
		109.16	1.50	8.4920E-007	-7.0172E-007
		140.76	0.22	5.8894E-006	-2.5483E-006
		143.76*	10.90	1.1233E-007	2.4408E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ U-235	163.33	5.00	2.7595E-007	2.81E-008	3.0782E-007
	182.61	0.40	3.7883E-006		-3.1668E-006
	185.71*	57.50	2.8146E-008		5.9587E-008
	194.94	0.59	2.4691E-006		1.3618E-006
	202.11	1.00	1.4597E-006		-6.4174E-007
	205.31	5.00	2.9598E-007		-1.5979E-007
	279.50	0.27	5.4954E-006		1.3447E-006

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX C - 2

UNIVERSITY OF MICHIGAN

FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A SPECTRUM A N A L Y S I S *****

Filename: C:\Soil\2008-11-20-01\2008-11-20-01N_100000_2008November28.CN

Report Generated On : 12/17/2008 8:02:02 PM

Sample Title : 2008-11-20-01-Nalgene

Sample Description : 500 ml Nalgene

Sample Identification : 208-11-20-01

Sample Type : 500 ml Nalgene

Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00

Peak Locate Range (in channels) : 1 - 8192

Peak Area Range (in channels) : 14 - 8192

Identification Energy Tolerance : 1.000 keV

Sample Size : 1.000E+003 g

Sample Taken On : 9/19/2008 8:45:00 AM

Acquisition Started : 11/28/2008 9:26:59 AM

Live Time : 1000000.0 seconds

Real Time : 100005.3 seconds

Dead Time : 0.01 %

Energy Calibration Used Done On : 12/17/2008

Efficiency Calibration Used Done On : 12/17/2008

Efficiency ID :

NUCLIDE MDA REPORT

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: 2008-11-20-01-Nalgene
 Nuclide Library Used: C:\GENIE2K\CAMFILES\LIBRARIES\Soil_DCGL_

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ Pb x-ray		72.80	61.00	1.9507E-008	1.95E-008	-1.1788E-008
		75.00*	100.00	2.5030E-008		5.8326E-008
		84.90*	36.00	2.1262E-008		4.2712E-008
		87.60*	10.00	9.6304E-008		2.8112E-007
+ BE-7		477.59	10.42	2.9187E-007	2.92E-007	-5.3608E-008
+ K-40		1460.75*	10.67	2.1724E-007	2.17E-007	1.0665E-005
MN-54		834.83	99.98	1.9611E-008	1.96E-008	1.1128E-008
+ CO-60		1173.24*	99.90	2.7008E-008	2.05E-008	1.9877E-008
		1332.50*	99.98	2.0547E-008		2.4214E-008
ZN-65		511.00	2.83	8.0625E-007	6.39E-008	5.0777E-006
		1115.55	50.70	6.3872E-008		2.4557E-007
NB-94x		702.62	97.90	1.5116E-008	1.51E-008	5.1081E-009
		871.09	99.90	1.6684E-008		1.3197E-008
AG-108m		79.13	6.60	1.8470E-007	1.39E-008	3.2637E-007
		433.94	90.50	1.3925E-008		8.7007E-009
		614.28	89.80	2.7449E-008		-1.5479E-008
		722.94	90.80	1.7939E-008		3.8441E-009
+ CD-109		88.03*	3.61	2.9235E-007	2.92E-007	8.5340E-007
AG-110m		446.81	3.75	3.9862E-007	1.79E-008	1.1423E-007
		620.36	2.81	6.0346E-007		-3.2289E-008
		657.76	94.60	1.7878E-008		-2.0951E-009
		677.62	10.35	1.6847E-007		-6.2273E-008
		687.02	6.44	2.6959E-007		-3.0201E-008
		706.68	16.44	1.0788E-007		5.4925E-008
		744.28	4.73	3.9769E-007		2.0204E-007
		763.94	22.29	9.8240E-008		-8.1510E-008
		818.03	7.34	2.6493E-007		1.0330E-007
		884.68	72.70	2.6939E-008		8.0247E-009
		937.49	34.36	6.3323E-008		2.2241E-008
		1384.30	24.28	9.1513E-008		-2.1218E-008
		1475.79	3.99	3.7431E-007		-2.4713E-007
		1505.04	13.04	1.4862E-007		5.4234E-009
		1562.30	1.03	1.5068E-006		1.2057E-006
SB-125		176.33	6.79	1.6836E-007	4.44E-008	-3.6817E-008
		380.43	1.52	8.3286E-007		6.4043E-009
		427.89	29.40	4.4422E-008		-8.8267E-009
		463.38	10.45	1.3023E-007		1.3505E-007
		600.56	17.78	8.2433E-008		1.4410E-008
		606.64	5.02	5.5368E-007		-1.3854E-007
		635.90	11.32	1.2411E-007		-6.6792E-008
		671.41	1.80	8.3897E-007		1.6433E-007
BA-133		53.16	2.20	4.1784E-007	3.02E-008	4.6551E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	79.62	2.62	4.6780E-007	3.02E-008	1.1162E-006
	81.00	34.10	3.0161E-008		-4.2266E-007
	160.61	0.64	1.6256E-006		2.8150E-007
	223.23	0.45	2.5148E-006		-1.9541E-006
	276.40	7.16	1.6088E-007		-2.6087E-008
	302.85	18.33	6.3475E-008		-1.3120E-008
	356.02	62.05	3.0221E-008		-2.1460E-008
	383.85	8.94	1.3845E-007		-3.6701E-008
	475.35	1.46	8.8912E-007		1.4056E-007
	563.23	8.38	1.7097E-007		-8.6160E-008
CS-134	569.32	15.43	9.3636E-008	2.11E-008	-7.3711E-009
	604.70	97.60	2.2582E-008		-7.9836E-009
	795.84	85.40	2.1078E-008		1.7273E-008
	801.93	8.73	1.9847E-007		-1.1229E-007
	1038.57	1.00	1.9187E-006		-1.0387E-006
	1167.94	1.80	1.3183E-006		3.3212E-007
	1365.15	3.04	5.5730E-007		5.1356E-008
	661.66	85.21	1.6851E-008	1.69E-008	-8.8619E-009
EU-152x	121.78*	28.40	3.7810E-008		1.1047E-007
	244.70*	7.49	1.1806E-007		4.9216E-008
	344.28*	26.60	4.2745E-008		9.9522E-008
	411.11	2.23	5.8722E-007		3.2492E-007
	443.98	2.78	4.4942E-007		6.5840E-008
	778.90*	12.96	1.0771E-007		1.0168E-007
	867.39	4.15	4.0912E-007		-1.0085E-007
	964.13*	14.34	2.0822E-007		2.5714E-007
	1085.91	9.92	2.0233E-007		9.2358E-008
	1089.70	1.71	1.1737E-006		2.9125E-007
EU-154	1112.12*	13.55	2.1184E-007	2.53E-008	1.2403E-007
	1212.95	1.40	1.6550E-006		4.2269E-007
	1299.12	1.63	1.1314E-006		2.6851E-007
	1408.01*	20.87	6.5551E-008		1.9388E-007
	123.07	40.40	2.5252E-008		-1.4260E-009
	188.25	0.23	5.5681E-006		-1.5640E-005
	247.93	6.83	1.6584E-007		5.0769E-008
	401.30	0.19	6.6345E-006		2.3022E-006
	444.39	0.55	2.2641E-006		1.5647E-007
	478.26	0.21	5.9116E-006		-5.7596E-007
EU-154	557.56	0.25	5.3097E-006	2.53E-008	-3.0550E-006
	582.00	0.89	2.2019E-006		1.3428E-005
	591.76	4.91	2.8125E-007		-1.0302E-007
	625.22	0.32	4.3906E-006		-4.5490E-006
	676.59	0.14	1.0620E-005		-7.7876E-006
	692.42	1.78	8.3313E-007		4.6020E-008
	715.76	0.17	8.7511E-006		4.0263E-006
	722.30	20.00	7.8827E-008		2.5177E-008
	756.86	4.50	3.5812E-007		2.9098E-009
	815.55	0.50	3.1869E-006		-3.3612E-007
	845.39	0.58	2.8545E-006		-3.7930E-007
	850.64	0.23	6.9718E-006		-9.2890E-006
	873.20	12.09	1.3957E-007		1.6585E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	3.2917E-006	2.53E-008	-9.0941E-007
	904.05	0.85	2.0472E-006		5.2964E-007
	996.30	10.34	1.7569E-007		-3.8026E-008
	1004.76	17.90	1.0729E-007		-1.3880E-008
	1128.40	0.29	6.9146E-006		-1.8266E-006
	1140.90	0.22	9.2528E-006		-1.7067E-006
	1241.60	0.13	2.0273E-005		4.0159E-005
	1246.60	0.80	2.7411E-006		-2.2812E-006
	1274.51	34.40	5.8399E-008		1.0686E-008
	1494.08	0.71	1.9753E-006		-6.5782E-007
+ TL-208B	1596.45	1.80	8.4962E-007	1.99E-008	-2.8908E-007
	72.80	2.02	5.8907E-007		-3.5598E-007
	74.97*	3.41	7.3401E-007		1.7104E-006
	84.90*	1.51	5.0692E-007		1.0183E-006
	277.36*	6.31	1.6163E-007		2.0963E-007
	510.77*	22.60	1.2084E-007		1.4063E-007
	583.19*	84.50	2.0727E-008		1.2109E-007
	763.13	1.81	9.7589E-007		-8.3550E-007
	860.56*	12.42	1.3708E-007		1.5753E-007
	2614.53*	99.16	1.9892E-008		1.0345E-007
+ Pb-210	46.52*	4.05	3.0358E-007	3.04E-007	6.3411E-007
+ PB-212B	74.81*	10.50	2.3838E-007	4.62E-008	5.5548E-007
	77.11*	17.60	1.4218E-007		5.3836E-007
	87.30*	7.90	1.2190E-007		3.5585E-007
	238.63*	43.60	4.6238E-008		3.3362E-007
	300.09*	3.34	2.8958E-007		3.8694E-007
+ BI-214B	609.31*	44.80	4.2857E-008	4.29E-008	5.9788E-007
	665.45*	1.29	9.8018E-007		6.9112E-007
	768.36*	4.80	3.1441E-007		5.8983E-007
	806.17	1.12	1.4330E-006		-1.7565E-007
	934.06*	3.03	5.8323E-007		7.9035E-007
	1120.29*	14.80	1.5241E-007		6.6197E-007
	1155.19*	1.64	1.1806E-006		8.1112E-007
	1238.11*	5.86	3.6751E-007		7.0365E-007
	1280.96*	1.44	1.6815E-006		8.0497E-007
	1377.67*	3.92	7.8218E-007		1.0423E-006
	1401.50	1.55	1.1505E-006		-7.3310E-007
	1407.98*	2.80	4.9029E-007		1.4501E-006
	1509.23*	2.12	1.0308E-006		1.6538E-007
	1661.28*	1.14	1.2923E-006		1.1331E-006
	1729.59*	2.88	3.7642E-007		7.2990E-007
	1764.49*	15.36	1.2965E-007		6.8308E-007
	1847.42*	2.04	4.8305E-007		1.3387E-006
	2118.55*	1.14	1.3079E-006		4.8343E-007
	2204.21*	4.86	3.2401E-007		9.9062E-007
	2447.86*	1.50	7.2595E-007		1.4171E-006
+ PB-214B	53.23*	1.11	6.9333E-007	4.47E-008	6.0276E-007
	74.81*	5.90	4.2423E-007		9.8857E-007
	77.11*	9.90	2.5276E-007		9.5708E-007
	87.30*	4.41	2.1838E-007		6.3746E-007
	241.98*	7.50	2.6946E-007		7.3934E-007

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	PB-214B	295.21*	18.50	7.7561E-008	4.47E-008	6.1113E-007
		351.92*	35.80	4.4676E-008		6.0289E-007
+	RA-226	186.10*	3.50	3.6694E-007	3.67E-007	1.2533E-006
+	AC-228B	12.95*	15.10	8.0507E-007	7.67E-008	4.3442E-007
		16.15	20.00	3.4020E-007		-6.2293E-008
		19.11	4.60	8.6488E-007		1.3943E-007
		89.96*	3.40	1.9819E-007		5.1562E-007
		93.35*	5.60	2.1872E-007		4.6177E-007
		99.55*	1.30	6.5781E-007		3.9880E-007
		105.36*	2.00	3.1788E-007		2.0236E-007
		129.03*	2.90	3.2153E-007		2.9308E-007
		209.39*	4.10	2.3730E-007		4.2225E-007
		270.26*	3.80	3.2268E-007		5.7734E-007
		328.07*	3.50	3.0666E-007		2.7969E-007
		338.42*	12.40	1.0797E-007		2.8263E-007
		409.62*	2.20	5.1529E-007		2.6377E-007
		463.10*	4.60	2.6449E-007		4.1318E-007
		562.65	1.01	1.3577E-006		1.3747E-007
		755.28*	1.32	1.3977E-006		7.0994E-007
		772.28	1.09	1.6902E-006		-1.5779E-007
		794.79*	4.60	3.1624E-007		3.4805E-007
		835.60	1.71	9.9980E-007		1.0275E-006
		911.16*	29.00	7.6685E-008		3.2727E-007
		964.64*	5.80	5.1660E-007		6.3796E-007
		968.97*	17.40	1.8138E-007		3.4843E-007
		1459.19	1.06	6.1602E-006		1.0870E-004
		1496.00	1.05	1.3443E-006		-5.2200E-007
		1588.23*	3.60	3.0148E-007		4.0019E-007
		1630.47*	1.95	6.5202E-007		1.3895E-007
	PA-234B	63.00	3.20	3.1476E-007	3.99E-008	-1.3943E-007
		94.67	14.30	7.2975E-008		-9.3142E-009
		98.44	23.00	3.9881E-008		2.1110E-008
		99.70	4.80	1.9088E-007		1.9327E-007
		111.00	10.80	8.5952E-008		2.9189E-008
		125.40	1.00	9.6376E-007		-5.7600E-007
		131.20	20.00	4.8884E-008		-1.8954E-008
		152.70	6.70	1.5819E-007		2.8734E-008
		186.00	2.00	6.4333E-007		2.8236E-006
		200.90	1.00	1.1440E-006		-5.0799E-007
		202.90	1.20	9.5428E-007		5.8837E-008
		226.40	5.90	1.9453E-007		-2.2644E-008
		227.20	5.50	2.0971E-007		6.4071E-008
		248.90	2.80	4.0017E-007		1.6924E-007
		272.10	1.00	1.2014E-006		-1.8479E-007
		293.70	3.90	3.9988E-007		4.7164E-008
		369.80	2.90	4.0940E-007		-6.1541E-008
		372.40	1.30	9.2200E-007		2.4178E-007
		458.80	1.50	8.4807E-007		-1.8687E-007
		506.80	1.60	1.0870E-006		6.4392E-008
		513.70	1.30	1.4540E-006		-1.2781E-007
		565.90	1.40	9.8645E-007		2.1464E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	4.1447E-007	3.99E-008	-3.0886E-007
	569.50	10.00	1.3731E-007		-1.0809E-008
	574.00	2.00	6.8905E-007		-4.1730E-007
	664.80	1.30	1.1409E-006		6.2704E-007
	666.70	1.60	9.2665E-007		1.2331E-007
	669.90	1.40	1.0651E-006		1.3819E-007
	692.70	1.50	9.8682E-007		1.0637E-007
	699.00	4.60	3.2873E-007		1.7670E-007
	706.10	3.10	4.7590E-007		2.0801E-007
	733.00	9.00	1.8609E-007		-1.7127E-007
	738.00	1.00	1.5698E-006		4.5560E-007
	742.81	2.40	6.5164E-007		-1.2292E-007
	755.60	1.40	1.1407E-006		-8.5827E-008
	780.70	1.10	1.5705E-006		1.1282E-006
	786.27	1.40	1.2091E-006		9.3691E-007
	793.60	1.50	1.1518E-006		8.5026E-007
	796.30	3.80	4.4993E-007		2.6752E-007
	805.80	3.30	4.8573E-007		-1.3166E-007
	819.60	2.60	6.2647E-007		1.4057E-008
	826.30	4.00	4.0474E-007		2.1854E-008
	831.60	5.50	3.0061E-007		3.2026E-009
	876.40	4.00	4.1302E-007		-2.6478E-009
	880.50	4.00	4.0555E-007		-9.4975E-008
	880.51	9.00	1.8025E-007		-4.2211E-008
	883.24	15.00	1.0787E-007		5.2396E-008
	899.00	4.10	4.2108E-007		2.6449E-007
	925.00	2.90	5.8504E-007		-2.4454E-008
	926.00	11.00	1.5346E-007		-4.0452E-008
	927.10	11.00	1.5337E-007		-4.0489E-008
	946.00	12.00	1.4576E-007		-1.9021E-008
	949.00	8.00	2.2334E-007		5.1564E-008
	978.80	1.40	1.2359E-006		2.5749E-007
	980.50	2.00	8.6001E-007		-1.0936E-007
	980.50	3.00	5.7334E-007		-7.2908E-008
	984.00	1.90	9.0444E-007		-1.8261E-007
	1353.30	1.70	9.4914E-007		-3.5773E-007
	1394.10	3.00	5.0216E-007		-6.7873E-007
	1452.70	1.00	1.8495E-006		-1.8362E-007
	1668.50	1.20	1.0676E-006		2.1472E-007
	1694.60	1.20	1.0206E-006		-2.4406E-007
+	TH-234	63.29*	4.50	1.8596E-006	1.9361E-006
		92.38	2.60	3.1727E-006	1.5315E-005
		92.80*	2.60	3.5422E-006	7.4782E-006
+	U-235	72.70	0.11	1.0676E-005	2.23E-008
		89.95*	2.80	2.3748E-007	6.1785E-007
		93.35*	4.50	2.6860E-007	5.6706E-007
		94.00*	0.40	2.7204E-006	9.7656E-007
		105.00	2.10	4.2494E-007	-1.7311E-007
		109.16	1.50	6.0659E-007	-1.1882E-008
		140.76	0.22	4.6037E-006	-1.0799E-006
		143.76*	10.90	8.8770E-008	2.5756E-008

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	U-235	163.33	5.00	2.0827E-007	2.23E-008	1.1497E-007
		182.61	0.40	2.9829E-006		-1.8655E-006
		185.71*	57.50	2.2334E-008		7.6280E-008
		194.94	0.59	1.9023E-006		4.9723E-007
		202.11	1.00	1.1279E-006		-6.2595E-007
		205.31	5.00	2.2681E-007		-1.4373E-007
		279.50	0.27	4.1731E-006		5.8468E-007

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX C-3

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A S E C T R U M A N A L Y S I S *****

Filename: HPGE

Report Generated On : 12/18/2008 9:37:24 AM

Sample Title : 2008-11-20-02N_2008Dec16
Sample Description : 500 ml Nalgène
Sample Identification : 2008-11-20-02
Sample Type : 500 ml Nalgene
Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00
Peak Locate Range (in channels) : 8 - 8192
Peak Area Range (in channels) : 8 - 8192
Identification Energy Tolerance : 1.000 keV

Sample Size : 1.000E+003 g

Sample Taken On : 9/19/2008 9:45:00 AM
Acquisition Started : 12/16/2008 7:47:05 PM

Live Time : 100000.0. seconds
Real Time : 100005.5 seconds

Dead Time : 0.01 %

NUCLIDE MDA REPORT

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: 2008-11-20-02N_2008Dec16
 Nuclide Library Used: C:\GENIE2K\CAMFILES\LIBRARIES\Soil_DCGL

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	Pb x-ray	72.80	61.00	1.9771E-008	1.70E-008	-8.6747E-009
		75.00*	100.00	1.7035E-008		5.9513E-008
		84.90*	36.00	7.6710E-008		3.7817E-008
		87.60*	10.00	2.7870E-007		3.0898E-007
+	BE-7	477.59	10.42	3.8459E-007	3.85E-007	6.1627E-008
	K-40	1460.75*	10.67	2.0511E-007	2.05E-007	1.0819E-005
+	MN-54	834.83*	99.98	1.3015E-008	1.30E-008	1.3105E-008
+	CO-60	1173.24*	99.90	2.5642E-008	2.34E-008	2.5243E-008
		1332.50*	99.98	2.3358E-008		3.8339E-008
	ZN-65	511.00	2.83	8.5220E-007	6.76E-008	5.2298E-006
		1115.55	50.70	6.7579E-008		4.7919E-008
+	NB-94x	702.62	97.90	1.5128E-008	1.51E-008	-5.2693E-009
		871.09	99.90	1.7004E-008		2.0479E-008
+	AG-108m	79.13	6.60	1.8821E-007	1.41E-008	-2.1692E-007
		433.94	90.50	1.4120E-008		-3.2291E-009
		614.28	89.80	2.7175E-008		-3.4055E-009
		722.94	90.80	1.8051E-008		5.5084E-011
+	CD-109	88.03*	3.61	8.6664E-007	8.67E-007	9.6082E-007
	AG-110m	446.81	3.75	4.2884E-007	1.94E-008	2.4598E-007
		620.36	2.81	6.1394E-007		-3.2693E-007
		657.76	94.60	1.9351E-008		-6.3456E-009
		677.62	10.35	1.7154E-007		1.5469E-008
		687.02	6.44	2.8142E-007		-2.5619E-008
		706.68	16.44	1.1544E-007		5.1336E-008
		744.28	4.73	4.3196E-007		3.2756E-007
		763.94	22.29	1.0525E-007		-6.7215E-008
		818.03	7.34	2.8249E-007		-7.4947E-008
		884.68	72.70	2.9505E-008		3.4660E-008
		937.49	34.36	6.8598E-008		6.5659E-008
		1384.30	24.28	9.5936E-008		-1.3727E-008
SB-125	1475.79	3.99	4.1688E-007		-1.1341E-007	
	1505.04	13.04	1.5747E-007		-3.8006E-009	
	1562.30	1.03	1.5491E-006		-4.7912E-008	
	176.33	6.79	1.7348E-007	4.47E-008	-4.1221E-008	
	380.43	1.52	8.6771E-007		4.5805E-007	
	427.89	29.40	4.4716E-008		-1.3415E-008	
	463.38	10.45	1.3349E-007		7.2608E-008	
	600.56	17.78	8.2960E-008		1.8588E-008	
	606.64	5.02	5.6297E-007		-3.1577E-008	
	635.90	11.32	1.2756E-007		-6.6065E-008	
BA-133	671.41	1.80	8.4704E-007		-8.4606E-007	
	53.16	2.20	4.1852E-007	3.06E-008	7.5555E-009	

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	79.62	2.62	4.7747E-007	3.06E-008	-8.0979E-007
	81.00	34.10	3.1095E-008		-6.2254E-008
	160.61	0.64	1.6661E-006		4.0547E-007
	223.23	0.45	2.6022E-006		-5.3629E-008
	276.40	7.16	1.6340E-007		6.7523E-008
	302.85	18.33	6.4449E-008		-2.6511E-008
	356.02	62.05	3.0553E-008		-3.2892E-009
	383.85	8.94	1.4087E-007		-7.9324E-008
	475.35	1.46	9.3177E-007	2.14E-008	-5.0733E-007
	563.23	8.38	1.7768E-007		1.0518E-007
CS-134	569.32	15.43	9.7569E-008		5.3462E-008
	604.70	97.60	2.3175E-008		-1.6525E-009
	795.84	85.40	2.1356E-008		2.0855E-008
	801.93	8.73	2.0733E-007		-2.6268E-008
	1038.57	1.00	2.0034E-006		1.4765E-007
	1167.94	1.80	1.3827E-006		4.2514E-007
	1365.15	3.04	5.3616E-007		7.3781E-008
	661.66	85.21	1.7767E-008	1.78E-008	1.4619E-008
	121.78*	28.40	4.6101E-008	4.08E-008	1.4464E-007
	244.70*	7.49	1.0767E-007		8.3944E-008
EU-152x	344.28*	26.60	4.0780E-008		1.2562E-007
	411.11*	2.23	5.2569E-007		2.5166E-007
	443.98	2.78	4.5722E-007		-2.5908E-007
	778.90*	12.96	9.8501E-008		1.3014E-007
	867.39	4.15	4.0891E-007		8.9574E-008
	964.13*	14.34	2.3266E-007		2.9035E-007
	1085.91*	9.92	1.4649E-007		1.8209E-007
	1089.70	1.71	1.1904E-006		8.3829E-007
	1112.12*	13.55	1.2694E-007		1.3322E-007
	1212.95	1.40	1.6795E-006		-4.2966E-007
EU-154	1299.12	1.63	1.1335E-006		3.2769E-007
	1408.01*	20.87	7.7087E-008		2.5664E-007
	123.07	40.40	2.6289E-008	2.63E-008	-8.4530E-009
	188.25	0.23	5.6072E-006		-2.2803E-006
	247.93	6.83	1.6781E-007		-3.5039E-008
	401.30	0.19	6.7091E-006		9.8740E-007
	444.39	0.55	2.3206E-006		-1.6490E-006
	478.26	0.21	6.1364E-006		2.3715E-006
	557.56	0.25	5.3843E-006		-5.9162E-006
	582.00	0.89	2.2155E-006		1.2670E-005
EU-156	591.76	4.91	2.8105E-007		-1.7564E-007
	625.22	0.32	4.3548E-006		8.2460E-007
	676.59	0.14	1.0440E-005		-9.4933E-008
	692.42	1.78	8.4264E-007		5.2719E-007
	715.76	0.17	8.7491E-006		-3.9570E-006
	722.30	20.00	7.9877E-008		-1.5282E-009
	756.86	4.50	3.5858E-007		-2.1530E-007
	815.55	0.50	3.3010E-006		-7.1129E-007
	845.39	0.58	2.8982E-006		-2.2735E-006
	850.64	0.23	7.2629E-006		-1.9087E-006
EU-158	873.20	12.09	1.4097E-007		-9.2267E-010

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	3.4459E-006	2.63E-008	-9.0880E-007
	904.05	0.85	2.1205E-006		-5.4565E-007
	996.30	10.34	1.7581E-007		9.2446E-008
	1004.76	17.90	1.0626E-007		9.7160E-009
	1128.40	0.29	6.9690E-006		2.4773E-006
	1140.90	0.22	9.3566E-006		-5.5021E-006
	1241.60	0.13	2.0231E-005		-7.4913E-006
	1246.60	0.80	2.7278E-006		-1.0292E-006
	1274.51	34.40	5.6790E-008		-4.8507E-008
	1494.08	0.71	1.9773E-006		-4.5929E-007
+ TL-208B	1596.45	1.80	8.3011E-007		-7.6348E-007
	72.80	2.02	5.9703E-007	1.94E-008	-2.6196E-007
	74.97*	3.41	4.9956E-007		1.7453E-006
	84.90*	1.51	1.8288E-006		9.0161E-007
	277.36	6.31	1.8668E-007		8.6203E-008
	510.77*	22.60	1.2357E-007		2.0574E-007
	583.19*	84.50	2.2918E-008		1.0971E-007
	763.13	1.81	1.0010E-006		-8.0631E-007
	860.56*	12.42	1.4830E-007		1.1172E-007
	2614.53*	99.16	1.9417E-008		1.0530E-007
+ Pb-210	46.52*	4.05	3.1938E-007	3.19E-007	5.6445E-007
+ PB-212B	74.81*	10.50	1.6224E-007	4.68E-008	5.6679E-007
	77.11*	17.60	9.6064E-008		5.4901E-007
	87.30*	7.90	3.5278E-007		3.9112E-007
	238.63*	43.60	4.6835E-008		3.5217E-007
	300.09*	3.34	2.5827E-007		4.3141E-007
+ BI-214B	609.31*	44.80	4.8205E-008	4.82E-008	6.0001E-007
	665.45	1.29	1.1884E-006		9.1470E-007
	768.36*	4.80	4.4949E-007		4.8782E-007
	806.17*	1.12	1.2558E-006		7.6897E-007
	934.06*	3.03	5.4109E-007		6.6708E-007
	1120.29*	14.80	2.3865E-007		6.9791E-007
	1155.19	1.64	1.3133E-006		-6.4333E-007
	1238.11*	5.86	4.4230E-007		5.7377E-007
	1280.96	1.44	1.4246E-006		7.5732E-007
	1377.67*	3.92	4.5776E-007		7.7039E-007
	1401.50*	1.55	8.3668E-007		8.7994E-007
	1407.98*	2.80	5.7710E-007		1.9213E-006
	1509.23*	2.12	1.0154E-006		1.2189E-006
	1661.28	1.14	1.1431E-006		2.9841E-008
	1729.59*	2.88	6.1631E-007		9.5715E-007
	1764.49*	15.36	1.7542E-007		6.8580E-007
	1847.42*	2.04	5.7644E-007		9.2342E-007
	2118.55	1.14	1.1962E-006		7.0094E-007
	2204.21*	4.86	2.7413E-007		6.8161E-007
	2447.86	1.50	9.2179E-007		2.9824E-007
+ PB-214B	53.23*	1.11	7.8030E-007	5.00E-008	5.1161E-007
	74.81*	5.90	2.8873E-007		1.0087E-006
	77.11*	9.90	1.7078E-007		9.7603E-007
	87.30*	4.41	6.3197E-007		7.0065E-007
	241.98*	7.50	2.7650E-007		7.5057E-007

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	PB-214B	295.21*	18.50	8.2709E-008	5.00E-008	6.2956E-007
		351.92*	35.80	5.0034E-008		6.4621E-007
+	RA-226	186.10*	3.50	4.2818E-007	4.28E-007	8.3083E-007
+	AC-228B	12.95	15.10	1.0109E-006	6.09E-008	-2.0875E-006
		16.15	20.00	3.7554E-007		3.9494E-008
		19.11	4.60	9.0977E-007		-2.0883E-007
		89.96*	3.40	8.0925E-007		5.2632E-007
		93.35*	5.60	5.0886E-007		3.8076E-007
		99.55	1.30	7.1038E-007		-1.6147E-007
		105.36*	2.00	4.4940E-007		2.6570E-007
		129.03*	2.90	2.9300E-007		3.0412E-007
		209.39*	4.10	2.4257E-007		4.2862E-007
		270.26*	3.80	3.4880E-007		6.3227E-007
		328.07*	3.50	3.7750E-007		5.3944E-007
		338.42*	12.40	1.2303E-007		3.6875E-007
		409.62*	2.20	5.4166E-007		4.9087E-007
		463.10*	4.60	3.3399E-007		5.3332E-007
		562.65*	1.01	1.0648E-006		2.8323E-007
		755.28	1.32	1.2170E-006		5.2264E-007
		772.28	1.09	1.7317E-006		-8.5947E-007
		794.79*	4.60	4.8564E-007		4.1544E-007
		835.60*	1.71	6.3503E-007		6.3941E-007
		911.16*	29.00	6.0947E-008		3.2663E-007
		964.64*	5.80	5.7777E-007		7.2103E-007
		968.97*	17.40	1.9729E-007		3.6263E-007
		1459.19	1.06	6.2360E-006		1.1114E-004
		1496.00	1.05	1.3450E-006		3.8894E-009
		1588.23*	3.60	3.1427E-007		3.1969E-007
		1630.47	1.95	6.6328E-007		-6.5222E-007
	PA-234B	63.00	3.20	3.1930E-007	4.03E-008	8.2375E-007
		94.67	14.30	7.4421E-008		-5.9071E-008
		98.44	23.00	4.0335E-008		-3.3875E-008
		99.70	4.80	1.9264E-007		-2.0025E-008
		111.00	10.80	8.7144E-008		1.3006E-008
		125.40	1.00	9.9209E-007		-1.1251E-006
		131.20	20.00	4.9283E-008		3.1355E-009
		152.70	6.70	1.6122E-007		9.9171E-008
		186.00	2.00	6.5039E-007		3.0795E-006
		200.90	1.00	1.1711E-006		-5.7985E-007
		202.90	1.20	9.7608E-007		4.1131E-007
		226.40	5.90	1.9900E-007		-3.8803E-008
		227.20	5.50	2.1435E-007		-2.0708E-008
		248.90	2.80	4.0345E-007		-1.9161E-007
		272.10	1.00	1.2216E-006		-2.4644E-007
		293.70	3.90	4.1064E-007		-3.6712E-008
		369.80	2.90	4.2418E-007		6.6356E-008
		372.40	1.30	9.4794E-007		-2.2619E-007
		458.80	1.50	8.9522E-007		1.1678E-007
		506.80	1.60	1.0811E-006		-2.5258E-008
		513.70	1.30	1.4649E-006		-9.4003E-008
		565.90	1.40	1.0159E-006		2.9432E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	4.2519E-007	4.03E-008	2.0013E-007
	569.50	10.00	1.4117E-007		7.7352E-008
	574.00	2.00	7.0874E-007		-7.7288E-009
	664.80	1.30	1.1788E-006		9.3773E-007
	666.70	1.60	9.6063E-007		1.0111E-006
	669.90	1.40	1.0680E-006		2.0256E-007
	692.70	1.50	1.0047E-006		8.5147E-007
	699.00	4.60	3.3092E-007		2.0942E-008
	706.10	3.10	4.8836E-007		2.0943E-007
	733.00	9.00	1.9137E-007		-1.0508E-007
	738.00	1.00	1.6096E-006		-6.8019E-007
	742.81	2.40	6.7675E-007		1.0238E-007
	755.60	1.40	1.1497E-006		5.0565E-007
	780.70	1.10	1.6728E-006		1.5689E-006
	786.27	1.40	1.2676E-006		9.1301E-007
	793.60	1.50	1.1498E-006		-3.5347E-007
	796.30	3.80	4.4995E-007		3.1342E-007
	805.80	3.30	5.1877E-007		3.5842E-007
	819.60	2.60	6.3198E-007		-1.9968E-007
	826.30	4.00	4.0872E-007		-1.5979E-007
	831.60	5.50	3.0206E-007		-5.2989E-008
	876.40	4.00	4.2382E-007		-1.3958E-007
	880.50	4.00	4.2285E-007		6.0178E-008
	880.51	9.00	1.8793E-007		2.6746E-008
	883.24	15.00	1.1120E-007		-8.6320E-008
	899.00	4.10	4.3127E-007		8.7464E-008
	925.00	2.90	5.9652E-007		-3.8424E-008
	926.00	11.00	1.5680E-007		-4.1726E-008
	927.10	11.00	1.5482E-007		-1.1219E-007
	946.00	12.00	1.4904E-007		-2.9778E-008
	949.00	8.00	2.2381E-007		-7.4685E-008
	978.80	1.40	1.2364E-006		6.9376E-007
	980.50	2.00	8.7779E-007		7.7073E-007
	980.50	3.00	5.8519E-007		5.1382E-007
	984.00	1.90	9.1474E-007		-7.1859E-007
	1353.30	1.70	9.3560E-007		-1.6114E-007
	1394.10	3.00	4.9737E-007		-4.4321E-007
	1452.70	1.00	2.0321E-006		-4.9964E-007
	1668.50	1.20	1.0436E-006		-1.7203E-009
	1694.60	1.20	1.0459E-006		1.0262E-007
+ TH-234	63.29*	4.50	3.0689E-006	3.07E-006	3.0594E-006
	92.38	2.60	5.4557E-006		2.7366E-005
	92.80*	2.60	1.3936E-005		1.0428E-005
+ U-235	72.70	0.11	1.0782E-005	2.61E-008	-4.7310E-006
	89.95*	2.80	9.6631E-007		6.2847E-007
	93.35*	4.50	6.2271E-007		4.6594E-007
	94.00	0.40	2.6213E-006		-1.3384E-006
	105.00*	2.10	4.2087E-007		2.4884E-007
	109.16	1.50	6.1658E-007		1.8173E-008
	140.76	0.22	4.6861E-006		-4.9986E-007
	143.76	10.90	9.5719E-008		2.1991E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ U-235	163.33	5.00	2.1145E-007	2.61E-008	1.7451E-007
	182.61	0.40	3.0207E-006		-1.4635E-006
	185.71*	57.50	2.6060E-008		5.0567E-008
	194.94	0.59	1.9468E-006		2.0713E-006
	202.11	1.00	1.1528E-006		-6.5152E-008
	205.31	5.00	2.3340E-007		-6.6598E-008
	279.50	0.27	4.2900E-006		6.4679E-007

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX D -I

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

UNIVERSITY OF MICHIGAN

Concrete Material

**STANDARD LEVEL IV
REPORT OF ANALYSIS**

WORK ORDER #10-02134-OR

April 19, 2010

**EBERLINE ANALYTICAL/OAK RIDGE LABORATORY
OAK RIDGE, TN**

Eberline Analytical Final Report of Analysis		Report To:				Work Order Details:							
		Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109				SDG: 10-02134							
						Purchase Order: 5000002634							
						Analysis Category: ENVIRONMENTAL							
						Sample Matrix: SO							
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.45E+03	4.05E+01			pCi/g
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.44E+03	1.42E+01	1.44E+01	5.66E+00	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	4.03E+00	3.30E+00	3.30E+00	5.51E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	4.10E-01	6.64E-01	6.64E-01	1.12E+00	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	5.95E-01	5.95E-01	1.02E+00	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	6.46E-01	6.46E-01	1.10E+00	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	3.97E-01	6.43E-01	6.43E-01	1.09E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.67E+00	6.99E-01	6.99E-01	1.14E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	3.56E+00	7.01E-01	7.01E-01	1.08E+00	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	5.31E+00	7.52E-01	7.52E-01	1.12E+00	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	6.25E-01	6.25E-01	1.07E+00	pCi/g
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	3.91E+02	8.60E+00			pCi/g
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	3.90E+02	6.29E+00	6.29E+00	6.54E-01	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	2.81E-01	8.54E-02	8.54E-02	1.18E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	4.32E-02	6.35E-02	6.35E-02	1.08E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	-8.86E-03	5.80E-02	5.80E-02	1.05E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	-3.25E-02	6.24E-02	6.24E-02	1.16E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	2.82E-02	5.25E-02	5.25E-02	9.11E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	-2.81E-02	5.98E-02	5.98E-02	1.11E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	2.67E-02	5.58E-02	5.58E-02	9.71E-02	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	2.40E-02	5.92E-02	5.92E-02	1.03E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-Cl-B Modified	-2.00E-02	6.38E-02	6.38E-02	1.17E-01	pCi/g
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	3.50E+02	1.26E+01			pCi/g
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	3.24E+02	4.24E+00	3.62E+01	2.06E+00	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.58E+00	1.24E+00	1.25E+00	2.08E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.68E+00	1.31E+00	1.32E+00	2.18E+00	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.65E+00	1.29E+00	1.30E+00	2.14E+00	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.64E+00	1.28E+00	1.29E+00	2.13E+00	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.57E+00	1.23E+00	1.24E+00	2.04E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.67E+00	1.30E+00	1.32E+00	2.17E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.67E+00	1.31E+00	1.32E+00	2.17E+00	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.70E+00	1.33E+00	1.34E+00	2.21E+00	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	0.00E+00	1.23E+00	1.23E+00	2.11E+00	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis				Report To:				Work Order Details:						
				Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109				SDG: 10-02134		Purchase Order: 5000002634				
								Analysis Category: ENVIRONMENTAL						
								Sample Matrix: SO						
Lab ID	Sample Type	Client ID		Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Americium-241	LANL ER-130 Modified	3.66E+03	1.14E+02			pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Cobalt-57	LANL ER-130 Modified	1.14E+03	3.42E+01			pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Americium-241	LANL ER-130 Modified	3.59E+03	3.03E+02	3.03E+02	5.09E+00	pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Cobalt-57	LANL ER-130 Modified	1.23E+03	1.98E+02	1.98E+02	4.11E+00	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-1.45E+00	6.43E+00	6.43E+00	1.07E+01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01		02/26/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-6.74E+00	1.10E+01	1.10E+01	1.11E+01	pCi/g
10-02134-04	DO	UM-2009-02-26-01		02/26/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	1.48E+00	6.62E+00	6.62E+00	1.14E+01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01		03/06/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-8.82E+00	1.12E+01	1.12E+01	1.05E+01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01		06/29/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	2.27E+00	5.08E+00	5.08E+00	7.72E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01		06/22/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	2.74E+00	5.84E+00	5.84E+00	8.17E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01		06/24/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-5.07E+00	9.54E+00	9.54E+00	1.17E+01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	4.61E+00	8.08E+00	8.08E+00	1.04E+01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-6.66E+00	1.02E+01	1.02E+01	9.03E+00	pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	1.34E+02	3.81E+00			pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	8.08E+01	2.26E+00			pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	1.38E+02	1.08E+01	1.08E+01	7.52E-01	pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	8.50E+01	8.03E+00	8.03E+00	6.77E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	-9.39E-03	1.46E-02	1.46E-02	2.28E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	9.54E-03	1.80E-02	1.80E-02	3.25E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	1.05E-02	1.81E-02	1.81E-02	3.58E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	3.08E-03	1.34E-02	1.34E-02	2.86E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-2.25E-03	1.54E-02	1.54E-02	2.53E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-3.45E-03	1.77E-02	1.77E-02	3.26E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	8.88E-02	9.91E-02	9.91E-02	2.46E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	4.03E-02	4.83E-02	4.83E-02	1.06E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	1.43E-02	2.80E-02	2.80E-02	4.92E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	1.75E-03	1.32E-02	1.32E-02	2.63E-02	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis			Report To:					Work Order Details:					
			Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109					SDG:	10-02134				
								Purchase Order:	5000002634				
								Analysis Category:	ENVIRONMENTAL				
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	2.81E-04	4.70E-02	4.70E-02	8.39E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	7.75E-02	1.15E-01	1.15E-01	2.19E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	2.46E-02	5.98E-02	5.98E-02	9.94E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	3.00E-01	7.99E-02	7.99E-02	1.18E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-7.18E-03	6.34E-02	6.34E-02	9.98E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	2.71E-02	4.74E-02	4.74E-02	8.95E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	1.49E+00	6.15E-01	6.15E-01	1.13E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	1.12E-01	1.42E-01	1.42E-01	2.84E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	2.71E-01	1.37E-01	1.37E-01	2.08E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-1.94E-03	9.94E-02	9.94E-02	1.77E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.32E-02	5.55E-02	5.55E-02	9.07E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.77E-02	1.13E-01	1.13E-01	1.96E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	6.89E-02	5.83E-02	5.83E-02	1.02E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	2.75E-01	6.71E-02	6.71E-02	9.86E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	9.35E-03	6.48E-02	6.48E-02	1.05E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-6.31E-03	4.54E-02	4.54E-02	8.07E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	1.73E+00	3.41E-01	3.41E-01	3.94E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	7.48E-02	1.51E-01	1.51E-01	2.88E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	3.23E-01	1.38E-01	1.38E-01	2.09E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-6.45E-02	1.05E-01	1.05E-01	1.74E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.28E-02	4.08E-02	4.08E-02	6.94E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-1.78E-02	7.96E-02	7.96E-02	1.44E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	-3.55E-02	5.39E-02	5.39E-02	7.56E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	8.90E-02	4.67E-02	4.67E-02	8.18E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	3.59E-02	3.36E-02	3.36E-02	8.61E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-1.53E-02	3.55E-02	3.55E-02	6.30E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	4.94E-01	3.76E-01	3.76E-01	6.03E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	4.89E-02	1.12E-01	1.12E-01	2.18E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	8.28E-02	1.25E-01	1.25E-01	1.76E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	2.33E-02	7.58E-02	7.58E-02	1.43E-01	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
 SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical

Final Report of Analysis

Report To:							Work Order Details:						
Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109							SDG:	10-02134					
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.17E-02	2.33E-02	2.33E-02	4.64E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.76E-02	4.23E-02	4.23E-02	6.80E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	5.82E-02	3.06E-02	3.06E-02	6.01E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.05E-02	2.22E-02	2.22E-02	5.00E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-4.30E-04	3.24E-02	3.24E-02	5.28E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	5.68E-03	2.21E-02	2.21E-02	4.24E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	2.49E-02	1.58E-01	1.58E-01	3.16E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	1.31E-02	4.70E-02	4.70E-02	1.04E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	-2.76E-02	4.57E-02	4.57E-02	6.55E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	6.45E-03	3.73E-02	3.73E-02	7.17E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	3.04E-01	4.45E-02	4.45E-02	7.69E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	1.76E-03	6.67E-02	6.67E-02	1.24E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	6.06E-01	1.07E-01	1.07E-01	8.59E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	5.51E-01	8.02E-02	8.02E-02	5.98E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	7.58E-03	4.75E-02	4.75E-02	7.97E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-2.32E-02	3.75E-02	3.75E-02	6.53E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	2.24E-01	2.83E-01	2.83E-01	5.49E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	-6.17E-02	1.16E-01	1.16E-01	1.96E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	1.26E-01	1.07E-01	1.07E-01	1.44E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-3.33E-02	7.11E-02	7.11E-02	1.23E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.35E-01	5.13E-02	5.13E-02	1.12E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	3.74E-02	1.15E-01	1.15E-01	1.94E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	4.79E-02	7.47E-02	7.47E-02	1.27E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.31E-01	1.04E-01	1.04E-01	1.40E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-3.52E-02	8.00E-02	8.00E-02	1.21E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	2.41E-01	1.17E-01	1.17E-01	1.07E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	7.59E-01	4.04E-01	4.04E-01	9.14E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	2.27E-01	2.87E-01	2.87E-01	3.55E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	1.05E-01	1.59E-01	1.59E-01	2.45E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	3.67E-02	1.04E-01	1.04E-01	1.92E-01	pCi/g

CU=Counting Uncertainty;CSU=Combined Standard Uncertainty (2-sigma);MDA=Minimal Detected Activity;LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
 SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis				Report To:				Work Order Details:					
				Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109				SDG: 10-02134		Purchase Order: 5000002634			
								Analysis Category: ENVIRONMENTAL					
				Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA
													Report Units
10-02134-08	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Silver-108m	LANL ER-130 Modified	3.58E-01	6.57E-02	6.57E-02	1.32E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Silver-110m	LANL ER-130 Modified	2.02E-01	1.52E-01	1.52E-01	2.67E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Barium-133	LANL ER-130 Modified	1.83E-02	9.37E-02	9.37E-02	1.43E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.21E+00	3.62E-01	3.62E-01	1.31E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cesium-134	LANL ER-130 Modified	7.26E-02	4.03E-02	4.03E-02	1.31E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cesium-137	LANL ER-130 Modified	1.77E+00	3.08E-01	3.08E-01	1.17E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-152	LANL ER-130 Modified	3.52E-01	3.64E-01	3.64E-01	7.19E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-154	LANL ER-130 Modified	6.98E-02	1.84E-01	1.84E-01	3.45E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-155	LANL ER-130 Modified	1.80E-01	1.76E-01	1.76E-01	2.67E-01 pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Manganese-54	LANL ER-130 Modified	3.85E-03	1.35E-01	1.35E-01	2.38E-01 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Silver-108m	LANL ER-130 Modified	-1.49E-02	4.39E-02	4.39E-02	7.69E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.03E-02	3.89E-02	3.89E-02	6.49E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Barium-133	LANL ER-130 Modified	-6.26E-03	5.88E-02	5.88E-02	9.42E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cobalt-60	LANL ER-130 Modified	-2.42E-02	4.78E-02	4.78E-02	8.14E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cesium-134	LANL ER-130 Modified	-3.16E-02	4.67E-02	4.67E-02	6.92E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cesium-137	LANL ER-130 Modified	-5.63E-03	4.03E-02	4.03E-02	7.27E-02 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-152	LANL ER-130 Modified	1.80E-01	2.59E-01	2.59E-01	5.37E-01 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-154	LANL ER-130 Modified	-1.98E-02	1.23E-01	1.23E-01	2.22E-01 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-155	LANL ER-130 Modified	4.15E-02	1.46E-01	1.46E-01	1.91E-01 pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Manganese-54	LANL ER-130 Modified	-1.18E-02	4.69E-02	4.69E-02	8.28E-02 pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original



EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

APPENDIX D - 2

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

UNIVERSITY OF MICHIGAN

Concrete Material

**STANDARD LEVEL IV
REPORT OF ANALYSIS**

WORK ORDER #10-02134-OR

April 19, 2010

**EBERLINE ANALYTICAL/OAK RIDGE LABORATORY
OAK RIDGE, TN**

Eberline Analytical Final Report of Analysis		Report To:				Work Order Details:							
		Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109				SDG: 10-02134		Purchase Order: 5000002634					
						Analysis Category: ENVIRONMENTAL		Analysis Category: ENVIRONMENTAL					
		Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units	
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.45E+03	4.05E+01		pCi/g	
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.44E+03	1.42E+01	1.44E+01	5.66E+00	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	4.03E+00	3.30E+00	3.30E+00	5.51E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	4.10E-01	6.64E-01	6.64E-01	1.12E+00	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	5.95E-01	5.95E-01	1.02E+00	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	6.46E-01	6.46E-01	1.10E+00	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	3.97E-01	6.43E-01	6.43E-01	1.09E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	1.67E+00	6.99E-01	6.99E-01	1.14E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	3.56E+00	7.01E-01	7.01E-01	1.08E+00	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	5.31E+00	7.52E-01	7.52E-01	1.12E+00	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/18/2010	10-02134	Carbon-14	EPA 520.0 Modified	0.00E+00	6.25E-01	6.25E-01	1.07E+00	pCi/g
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	3.91E+02	8.60E+00			pCi/g
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	3.80E+02	6.29E+00	6.29E+00	6.54E-01	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	2.81E-01	8.54E-02	8.54E-02	1.18E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	4.32E-02	6.35E-02	6.35E-02	1.08E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	-8.86E-03	5.80E-02	5.80E-02	1.05E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	-3.25E-02	6.24E-02	6.24E-02	1.16E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	2.82E-02	5.25E-02	5.25E-02	9.11E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	-2.81E-02	5.98E-02	5.98E-02	1.11E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	2.87E-02	5.58E-02	5.58E-02	9.71E-02	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	2.40E-02	5.92E-02	5.92E-02	1.03E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/4/2010	10-02134	Chlorine-36	4500-CI-B Modified	-2.00E-02	6.38E-02	6.38E-02	1.17E-01	pCi/g
10-02134-01	LCS	KNOWN	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	3.50E+02	1.26E+01			pCi/g
10-02134-01	LCS	SPIKE	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	3.24E+02	4.24E+00	3.62E+01	2.08E+00	pCi/g
10-02134-02	MBL	BLANK	02/24/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.58E+00	1.24E+00	1.25E+00	2.08E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.68E+00	1.31E+00	1.32E+00	2.18E+00	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.65E+00	1.29E+00	1.30E+00	2.14E+00	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.64E+00	1.28E+00	1.29E+00	2.13E+00	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.57E+00	1.23E+00	1.24E+00	2.04E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.67E+00	1.30E+00	1.32E+00	2.17E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.67E+00	1.31E+00	1.32E+00	2.17E+00	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	1.70E+00	1.33E+00	1.34E+00	2.21E+00	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/19/2010	10-02134	Tritium	LANL ER-210 Modified	0.00E+00	1.23E+00	1.23E+00	2.11E+00	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis				Report To:				Work Order Details:						
				Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109				SDG:	10-02134					
								Purchase Order:	5000002634					
								Analysis Category:	ENVIRONMENTAL					
Lab ID	Sample Type	Client ID		Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Americium-241	LANL ER-130 Modified	3.66E+03	1.14E+02			pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Cobalt-57	LANL ER-130 Modified	1.14E+03	3.42E+01			pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Americium-241	LANL ER-130 Modified	3.59E+03	3.03E+02	3.03E+02	5.09E+00	pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Cobalt-57	LANL ER-130 Modified	1.23E+03	1.98E+02	1.98E+02	4.11E+00	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-1.45E+00	6.43E+00	6.43E+00	1.07E+01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01		02/26/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-6.74E+00	1.10E+01	1.10E+01	1.11E+01	pCi/g
10-02134-04	DO	UM-2009-02-26-01		02/26/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	1.48E+00	6.62E+00	6.62E+00	1.14E+01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01		03/06/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-8.82E+00	1.12E+01	1.12E+01	1.05E+01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01		06/29/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	2.27E+00	5.08E+00	5.08E+00	7.72E+00	pCi/g
10-02134-07	TRG	UM-2009-06-10-01		06/22/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	2.74E+00	5.64E+00	5.64E+00	8.17E+00	pCi/g
10-02134-08	TRG	UM-2009-06-12-01		06/24/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-5.07E+00	9.54E+00	9.54E+00	1.17E+01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01		06/25/09 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	4.61E+00	8.08E+00	8.08E+00	1.04E+01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01		01/29/10 00:00	2/24/2010	3/15/2010	10-02134	Iron-55	LANL ER-130 Modified	-6.66E+00	1.02E+01	1.02E+01	9.03E+00	pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-80	LANL ER-130 Modified	1.34E+02	3.81E+00			pCi/g
10-02134-01	LCS	KNOWN		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	8.08E+01	2.26E+00			pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-80	LANL ER-130 Modified	1.39E+02	1.08E+01	1.08E+01	7.52E-01	pCi/g
10-02134-01	LCS	SPIKE		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	8.50E+01	8.03E+00	8.03E+00	6.77E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	-9.39E-03	1.46E-02	1.46E-02	2.28E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	9.54E-03	1.60E-02	1.60E-02	3.25E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	1.05E-02	1.81E-02	1.81E-02	3.58E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	3.08E-03	1.34E-02	1.34E-02	2.86E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-2.25E-03	1.54E-02	1.54E-02	2.53E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-3.45E-03	1.77E-02	1.77E-02	3.26E-02	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	8.88E-02	9.91E-02	9.91E-02	2.46E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	4.03E-02	4.83E-02	4.83E-02	1.06E-01	pCi/g
10-02134-02	MBL	BLANK		02/24/10 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	1.75E-03	1.32E-02	1.32E-02	2.63E-02	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
 SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis			Report To:					Work Order Details:					
			Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109					SDG:	10-02134				
								Purchase Order:	5000002634				
								Analysis Category:	ENVIRONMENTAL				
								Sample Matrix:	SO				
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	2.81E-04	4.70E-02	4.70E-02	8.39E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	7.75E-02	1.15E-01	1.15E-01	2.19E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	2.46E-02	5.98E-02	5.98E-02	9.94E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	3.00E-01	7.99E-02	7.99E-02	1.18E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-7.18E-03	6.34E-02	6.34E-02	9.98E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	2.71E-02	4.74E-02	4.74E-02	8.95E-02	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	1.49E+00	6.15E-01	6.15E-01	1.13E+00	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	1.12E-01	1.42E-01	1.42E-01	2.84E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	2.71E-01	1.37E-01	1.37E-01	2.08E-01	pCi/g
10-02134-03	DUP	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-1.94E-03	9.94E-02	9.94E-02	1.77E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.32E-02	5.55E-02	5.55E-02	9.07E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.77E-02	1.13E-01	1.13E-01	1.96E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	6.89E-02	5.83E-02	5.83E-02	1.02E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	2.75E-01	6.71E-02	6.71E-02	9.86E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	9.35E-03	6.48E-02	6.48E-02	1.05E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-6.31E-03	4.54E-02	4.54E-02	8.07E-02	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	1.73E+00	3.41E-01	3.41E-01	3.94E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	7.48E-02	1.51E-01	1.51E-01	2.88E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	3.23E-01	1.38E-01	1.38E-01	2.09E-01	pCi/g
10-02134-04	DO	UM-2009-02-26-01	02/26/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-6.45E-02	1.05E-01	1.05E-01	1.74E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.28E-02	4.08E-02	4.08E-02	6.94E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-1.78E-02	7.96E-02	7.96E-02	1.44E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	-3.55E-02	5.39E-02	5.39E-02	7.56E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	8.90E-02	4.67E-02	4.67E-02	8.18E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	3.59E-02	3.36E-02	3.36E-02	8.81E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-1.53E-02	3.55E-02	3.55E-02	6.30E-02	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	4.94E-01	3.76E-01	3.76E-01	6.03E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	4.89E-02	1.12E-01	1.12E-01	2.18E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	8.28E-02	1.25E-01	1.25E-01	1.76E-01	pCi/g
10-02134-05	TRG	UM-2009-03-04-01	03/06/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	2.33E-02	7.58E-02	7.58E-02	1.43E-01	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis		Report To:					Work Order Details:						
		Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109					SDG:	10-02134					
							Purchase Order:	5000002634					
							Analysis Category:	ENVIRONMENTAL					
		Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Sample Matrix:	SO					
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.17E-02	2.33E-02	2.33E-02	4.64E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.76E-02	4.23E-02	4.23E-02	6.80E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	5.82E-02	3.06E-02	3.06E-02	6.01E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.05E-02	2.22E-02	2.22E-02	5.00E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-4.30E-04	3.24E-02	3.24E-02	5.28E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	5.68E-03	2.21E-02	2.21E-02	4.24E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	2.49E-02	1.58E-01	1.58E-01	3.16E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	1.31E-02	4.70E-02	4.70E-02	1.04E-01	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	-2.76E-02	4.57E-02	4.57E-02	6.55E-02	pCi/g
10-02134-06	TRG	UM-2009-06-08-01	06/29/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	6.45E-03	3.73E-02	3.73E-02	7.17E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	3.04E-01	4.45E-02	4.45E-02	7.69E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	1.76E-03	6.67E-02	6.67E-02	1.24E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	8.06E-01	1.07E-01	1.07E-01	8.59E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	5.51E-01	8.02E-02	8.02E-02	5.98E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	7.58E-03	4.75E-02	4.75E-02	7.97E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	-2.32E-02	3.75E-02	3.75E-02	6.53E-02	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	2.24E-01	2.83E-01	2.83E-01	5.49E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	-6.17E-02	1.16E-01	1.16E-01	1.96E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	1.26E-01	1.07E-01	1.07E-01	1.44E-01	pCi/g
10-02134-07	TRG	UM-2009-06-10-01	06/22/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	-3.33E-02	7.11E-02	7.11E-02	1.23E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-108m	LANL ER-130 Modified	1.35E-01	5.13E-02	5.13E-02	1.12E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Silver-110m	LANL ER-130 Modified	3.74E-02	1.15E-01	1.15E-01	1.94E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Barium-133	LANL ER-130 Modified	4.79E-02	7.47E-02	7.47E-02	1.27E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.31E-01	1.04E-01	1.04E-01	1.40E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-134	LANL ER-130 Modified	-3.52E-02	8.00E-02	8.00E-02	1.21E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Cesium-137	LANL ER-130 Modified	2.41E-01	1.17E-01	1.17E-01	1.07E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-152	LANL ER-130 Modified	7.59E-01	4.04E-01	4.04E-01	9.14E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-154	LANL ER-130 Modified	2.27E-01	2.67E-01	2.67E-01	3.55E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Europium-155	LANL ER-130 Modified	1.05E-01	1.59E-01	1.59E-01	2.45E-01	pCi/g
10-02134-08	TRG	UM-2009-06-12-01	06/24/09 00:00	2/24/2010	3/4/2010	10-02134	Manganese-54	LANL ER-130 Modified	3.67E-02	1.04E-01	1.04E-01	1.92E-01	pCi/g

CU=Counting Uncertainty;CSU=Combined Standard Uncertainty (2-sigma);MDA=Minimal Detected Activity;LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical

Final Report of Analysis

Report To: Mark L. Driscoll Univ of MI, Occupational Safety & Env Heal 1239 Kepke Drive Ann Arbor, MI 48109							Work Order Details:						
							SDG:	10-02134					
							Purchase Order:	5000002634					
							Analysis Category:	ENVIRONMENTAL					
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Silver-108m	LANL ER-130 Modified	3.58E-01	6.57E-02	6.57E-02	1.32E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Silver-110m	LANL ER-130 Modified	2.02E-01	1.52E-01	1.52E-01	2.67E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Barium-133	LANL ER-130 Modified	1.83E-02	9.37E-02	9.37E-02	1.43E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cobalt-60	LANL ER-130 Modified	4.21E+00	3.62E-01	3.62E-01	1.31E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cesium-134	LANL ER-130 Modified	7.26E-02	4.03E-02	4.03E-02	1.31E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Cesium-137	LANL ER-130 Modified	1.77E+00	3.08E-01	3.08E-01	1.17E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-152	LANL ER-130 Modified	3.52E-01	3.64E-01	3.64E-01	7.19E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-154	LANL ER-130 Modified	6.98E-02	1.84E-01	1.84E-01	3.45E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Europium-155	LANL ER-130 Modified	1.80E-01	1.76E-01	1.76E-01	2.67E-01	pCi/g
10-02134-09	TRG	UM-2009-06-19-01	06/25/09 00:00	2/24/2010	3/5/2010	10-02134	Manganese-54	LANL ER-130 Modified	3.65E-03	1.35E-01	1.35E-01	2.38E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Silver-108m	LANL ER-130 Modified	-1.49E-02	4.39E-02	4.39E-02	7.69E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Silver-110m	LANL ER-130 Modified	-3.03E-02	3.89E-02	3.89E-02	6.49E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Barium-133	LANL ER-130 Modified	-8.26E-03	5.88E-02	5.88E-02	9.42E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cobalt-60	LANL ER-130 Modified	-2.42E-02	4.76E-02	4.76E-02	8.14E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cesium-134	LANL ER-130 Modified	-3.16E-02	4.67E-02	4.67E-02	6.92E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Cesium-137	LANL ER-130 Modified	-5.63E-03	4.03E-02	4.03E-02	7.27E-02	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-152	LANL ER-130 Modified	1.80E-01	2.59E-01	2.59E-01	5.37E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-154	LANL ER-130 Modified	-1.98E-02	1.23E-01	1.23E-01	2.22E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Europium-155	LANL ER-130 Modified	4.15E-02	1.46E-01	1.46E-01	1.91E-01	pCi/g
10-02134-10	TRG	UM-2010-01-29-01	01/29/10 00:00	2/24/2010	3/5/2010	10-02134	Manganese-54	LANL ER-130 Modified	-1.18E-02	4.69E-02	4.69E-02	8.26E-02	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original



EBERLINE
SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

APPENDIX E

UNIVERSITY OF MICHIGAN
FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012

Cutting of Storage Port Bleed-off Lines

Survey NO.: NA

DATE:	10-Dec-08	LOCATION:	O/S, West of FNR above Storage Ports	TIME:	15:30
Smear Information dpm		Frisking Probe Model # 44-142		Serial #	240718
ϵ_i	38	ϵ_a	0.25	Frisking Probe Efficiency 0.095	
1 Min BKG: 1. 335		2. 355		3. 342	
Avg. BKG: 344					
L _c Gross CPM: 394		L _c Net CPM: 50		L _d Gross CPM: 417	
L _d Net CPM: 73					

Note: Removed Storage Port Bleed-off Lines using a bandsaw. Bleed-off lines were 1" in diameter. Pipes were Large Area Wiped internally at each end after cut. (4) Lines were cut in total, starting with the north most pipe. All Large Area Wipes were <L_c. Pipe ends were then taped. All (4) now loose pipes were then placed in the FNR radioactive material area inside the FNR.

During cutting activities, a cardboard tray was used to collect any pipe shavings from cutting the pipes with the bandsaw. Shavings were disposed of as radioactive materials and placed in a radioactive materials slurry/piping drum. Frisk and wipes done for the cardboard tray were all <L_c. Large Area Wipe of the bandsaw was <L_c.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-142	218579 / 240714	8-Mar-09	0.095	344	773
		d'=1.38 p=0.5	t (sec) 2		2087
Frisker Detector HV = 1150 Vdc (240714)	Threshold Voltage = 350 mVdc		Detector cable type/length =	± 59/6ft	

Print/Signature of Surveyor: Jerry Shimel Jerry Shimel Date: 10-Dec-08

Comments: _____

Review By: J. Shimel Date: 2/21/2012

APPENDIX F

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 1 TIME: 16:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 32 30 3. 27

Avg. BKG: 30

L_C Gross CPM: 51

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	37	7	<MDA
2 Static 2	38	8	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	188
			d=1.38 p=0.5	t (sec) 3	377
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimel Date: 09-Jan-09

Comments: _____

Review By: Jeff H Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: <u>9-Jan-09</u>	LOCATION: <u>Port # 2</u>	TIME: <u>16:00</u>	
Smear Information <u>dpm</u>		Frisking Probe Model # <u>44-1</u>	Serial # <u>PR249243</u>
ϵ_1 <u>50.5</u>	ϵ_s <u>0.25</u>	Frisking Probe Efficiency <u>0.12625</u>	
1 Min BKG: 1. <u>32</u> 2. <u>28</u> 3. <u>38</u>			
Avg. BKG: <u>33</u>			
L _C Gross CPM: <u>54</u>		L _C Net CPM: <u>21</u>	
L _D Gross CPM: <u>N/A</u>		L _D Net CPM: <u>N/A</u>	

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	24	0	<MDA
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	33	196
			d'=1.38 p=0.5	t (sec) 3	395
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinn Deysel JP Date: 09 - Jan - 09

Comments: _____

Review By: John S. Date: 2/23/13

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 3 TIME: 15:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_e 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 38 31. 29

Avg. BKG: 33

L_C Gross CPM: 54

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	32	0	<MDA
2 Static 2	34	1	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
 Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1.	218597 / 249243	9-Dec-09	0.502	33	196
			d' = 1.38 p = 0.5	t (sec) 3	395
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length =	59 / 6 ft.

Print/Signature of Surveyor: Jerry Shimek, Dux, SHS Date: 09-Jan-09

Comments: _____

Review By: ABH Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: N/A

DATE: 9-Jan-09 LOCATION: Port #4 TIME: 15:15
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [32] [26] 3. [37]

Avg. BKG: [32]

L_c Gross CPM: [53] L_c Net CPM: [21]

L_d Gross CPM: [N/A] L_d Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	51	19	<MDA
2 Static 2	50	18	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 /44-1	218597 / 249243	9-Dec-09	0.502	32	193
			d=1.38 p=0.5	t(sec) 3	389
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length =	59 / 6 ft.

Print/Signature of Surveyor: Jerry Shinn / Guy Shinn Date: 09 - Jan - 09

Comments: _____

Review By: AKL Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 5 TIME: 15:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 28 2. 24 3. 32

Avg. BKG: 28

L_C Gross CPM: 49

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	41	13	<MDA
2 Static 2	42	14	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
 Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	28	183
				d=1.38 p=0.5	t(sec) 3 366
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek, Guy Shirek Date: 09-Jan-09

Comments: _____

Review By: Alfred L Date: 2/28/13

Storage Port Exterior Survey Report

Survey NO.: NA

DATE:	9-Jan-09	LOCATION:	Port # 6	TIME:	14:30
Smear Information dpm		Frisking Probe Model # 44-1		Serial #	PR249243
ϵ_1	50.5	ϵ_s	0.25	Frisking Probe Efficiency 0.12625	
1 Min BKG:		1. [27]	[32]	3. [31]	
Avg. BKG: [30]					
L _C Gross CPM:		[51]	L _C Net CPM:	[27]	
L _D Gross CPM:		[N/A]	L _D Net CPM:	[N/A]	

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	25	0	<MDA	
2 Static 2	39	9	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 90 cpm gross pre-decon.
Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	189
			d' = 1.38 p = 0.5	t (sec) 3	379
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length =	59 / 6 ft.

Print/Signature of Surveyor: Jerry Sjimek / Jerry Shand Date: 09-Jan-09

Comments: _____

Review By: ASML

Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 7 TIME: 14:15
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. 35 2. 29 3. 38
 Avg. BKG: 34
 L_C Gross CPM: 55 L_C Net CPM: 21
 L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	28	0	<MDA
2 Static 2	31	0	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	34	199
			d'=1.38 p=0.5	t(sec) 3	403
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = S9 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimle / Jim Shurtliff Date: 09-Jan-09

Comments: _____

Review By: A. D. H. Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 8 TIME: 13:50
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 37 2. 30 3. 27

Avg. BKG: 31

L_C Gross CPM: 52

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	<u>31</u>	<u>0</u>	<MDA
2 Static 2	<u>.51</u>	<u>20</u>	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 75 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	31	192
			d' = 1.38 p = 0.5	t (sec) 3	387
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Strehmel Date: 09-Jan-09

Comments: _____

Review By: Alekel Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 9 TIME: 13:30
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_1 50.5 ϵ_3 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 26 26 3. 28

Avg. BKG: 27

L_C Gross CPM: 48 L_C Net CPM: 27

L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	43	16	<MDA	
2 Static 2	46	19	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 65 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	27	179
			d'=1.38 p=0.5	t (sec) 3	357
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\theta = 23.00 \cdot a = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length =	59 / 6 ft.

Print/Signature of Surveyor: Jerry Shinnick Deny Shant Date: 09-Jan-09

Comments: _____

Review By: AK Date: 2/23/10

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: <u>9-Jan-09</u>	LOCATION: <u>Port # 10</u>	TIME: <u>13:00</u>
Smear Information <u>dpm</u>	Frisking Probe Model # <u>44-1</u>	Serial # <u>PR249243</u>
ϵ_i <u>50.5</u>	ϵ_s <u>0.25</u>	Frisking Probe Efficiency <u>0.12625</u>
1 Min BKG: <u>1.</u> <u>28</u>	<u>2.</u> <u>30</u>	<u>3.</u> <u>26</u>

Avg. BKG: 28

L_C Gross CPM: 49

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	38	10	<MDA	
2 Static 2	47	19	<MDA	
3 Static 3	40	12	<MDA	
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	28	183
			d'=1.38 p=0.5	t (sec) 3	366
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Slivick Gray Shurtliff Date: 09-Jan-09

Comments: _____

Review By: CDH Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09

LOCATION: Port # 11

TIME: 11:30

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_s 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG:

1. 30

29

3. 31

Avg. BKG: 30

L_C Gross CPM: 51

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	33	3	<MDA
2 Static 2	46	16	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	189
			d=1.38 p=0.5	t(sec) 3	379
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = .59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinde Deug Shant Date: 09-Jan-09

Comments: _____

Review By: Akdl

Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port #12 TIME: 10:45
 Smear Information dpm Frisking Probe Model #: 44-1 Serial #: PR249243

ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [35] [30] 3. [35]

Avg. BKG: [33]

L_C Gross CPM: [54] L_C Net CPM: [21]

L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	42	9	<MDA
2 Static 2	30	0	<MDA
3 Static 3	28	0	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 68 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	33	197
			d'=1.38 p=0.5	t(sec) 3	399
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek Date: 09-Jan-09

Comments: _____

Review By: Abel Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09

LOCATION: Port # 13

TIME: 10:00

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_a 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 40 41 3. 32

Avg. BKG: 38

L_c Gross CPM: 59

L_c Net CPM: 21

L_d Gross CPM: N/A

L_d Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	54	.16	<MDA
2 Static 2	45	7	≤MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	38	208
			$d=1.38$ $p=0.5$	$t(\text{sec})$ 3	424
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41$ $a = 17.25$	$\beta = 1.33$ $a = 0.00$	$\beta = 23.00$ $a = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinkle Aug 2009 Date: 09-Jan-09

Comments: _____

Review By: Abbie Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 14 TIME: 9:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [27] [35] 3. [27]

Avg. BKG: [30]

L_C Gross CPM: [51] L_C Net CPM: [21]

L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	38	8	<MDA
2 Static 2	33	3	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
 Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	188
			d=1.38 p=0.5	t (sec) 3	377
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek/Dugay Shirek Date: 09-Jan-09

Comments: _____

Review By: AKH Date: 3/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 15 TIME: 9:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 30 28 3. 37

Avg. BKG: 32

L_C Gross CPM: 53 L_C Net CPM: 27

L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	23	0	<MDA
2 Static 2	18	0	<MDA
3 Static 3	39	7	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	32	193
			$d=1.38$ $p=0.5$	$t(\text{sec})$ 3	389
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41$ $a = 17.25$	$\beta = 1.33$ $a = 0.00$	$\beta = 23.00$ $a = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = .59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shiner/Jerry Shiner Date: 08-Jan-09

Comments: _____

Review By: ABH Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 16 TIME: 9:00
 Smear Information dpm Frisking Probe Model #: 44-1 Serial #: PR249243
 ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. 42 3. 31
 Avg. BKG: 37
 L_C Gross CPM: 58 L_C Net CPM: 27
 L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	40	3	<MDA
2 Static 2	32	0	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
 Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	37	208
				d'=1.38 p=0.5	t(sec) 3 422
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \sigma = 17.25$	$\beta = 1.33 \sigma = 0.00$	$\beta = 23.00 \sigma = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimke / Jerry Shimke Date: 09-Jan-09

Comments: _____

Review By: A. A. H. Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 17 TIME: 8:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 25 2. 40 3. 39

Avg. BKG: 35

L_C Gross CPM: 56 L_C Net CPM: 21

L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	.37	2	<MDA
2 Static 2	.50	15	<MDA
3 Static 3	.41	6	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	35	201
			d'=1.38 p=0.5	t(sec) 3	407
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41$ $\alpha = 17.25$	$\beta = 1.33$ $\alpha = 0.00$	$\beta = 23.00$ $\alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimel / Jerry Shimb Date: 09 - Jan - 09

Comments: _____

Review By: AKH Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 18 TIME: 8:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 35 41 3. 36

Avg. BKG: 37

L_C Gross CPM: 58 L_C Net CPM: 21

L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	38	1	<MDA	
2 Static 2	50	13	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due.Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	37	208
			d'=1.38 p=0.5	t (sec) 3	422
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek Date: 09-Jan-09

Comments: _____

Review By: ABHIL Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 9-Jan-09 LOCATION: Port # 19 TIME: 8:10
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 37 2. 38 3. 25

Avg. BKG: 33

L_C Gross CPM: 54

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	32	0	<MDA	
2 Static 2	35	2	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221/44-1	218597 / 249243	9-Dec-09	0.502	33	197
			d=1.38 p=0.5	t(sec) 3	399
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shiner Jerry Shiner Date: 09-Jan-09

Comments: _____

Review By: John A. Bo Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 20 TIME: 14:15
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [40] 2. [28] 3. [33]

Avg. BKG: [34]

L_C Gross CPM: [55] L_C Net CPM: [21]

L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	39	5	<MDA
2 Static 2	35	1	<MDA
3 Static 3	52	18	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 60 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	34	198
			d'=1.38 p=0.5	t (sec) 3	401
Tenelēc Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinel Date: 08-Jan-09

Comments: _____

Review By: AKAHL Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 21 TIME: 14:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. 26 3. 34 3. 31
 Avg. BKG: 30
 L_C Gross CPM: 51 L_C Net CPM: 21
 L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	37	7	<MDA	
2 Static 2	33	3	<MDA	
3 Static 3	24	0	<MDA	
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	189
			d'=1.38 p=0.5	t (sec) 3	381
Tenelec Series S	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shuck, Guy Shuck Date: 08-Jan-09

Comments: _____

Review By: Ab Al Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09

LOCATION: Port # 22

TIME: 13:35

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_s 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 28 28 3. 31

Avg. BKG: 29

L_C Gross CPM: 50

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	36	7	<MDA
2 Static 2	26	0	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA.(DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	29	186
			d=1.38 p=0.5	t(sec) 3	372
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = .50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek Day Shift Date: 08-Jan-09

Comments: _____

Review By: A. Hall Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 23 TIME: 13:10
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. [32] 2. [43] 3. [37]
 Avg. BKG: [37]
 L_C Gross CPM: [58] L_C Net CPM: [27]
 L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	42	5	<MDA
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
 Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	37	208
			d'=1.38 p=0.5	t(sec) 3	422
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59' 6 ft.	

Print/Signature of Surveyor: Jerry Shimek / Jerry Shmke Date: 08-Jan-09

Comments: _____

Review By: DAJ Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 24 TIME: 13:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 31 2. 44 3. 35

Avg. BKG: 37

L_C Gross CPM: 58

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	36	0	<MDA	
2 Static 2	22	0	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	37	206
		d'=1.38 p=0.5	t(sec) 3	419	
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shiner / Jerry Shiner Date: 01-Jan-09

Comments: _____

Review By: CDK Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 25 TIME: 12:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 35 2. 33 3. 25

Avg. BKG: 31

L_C Gross CPM: 52

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	50	19	<MDA
2 Static 2	43	12	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	31	191
			d'=1.38 p=0.5	t (sec) 3	385
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimek / Jerry Shand Date: 01 - Jan - 09

Comments: _____

Review By: Abdullah Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09

LOCATION: Port # 26

TIME: 11:00

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_s 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 31

44

3. 39

Avg. BKG: 38

L_C Gross CPM: 59

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	55	17	<MDA
2 Static 2	53	15	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	38	209
				d=1.38 p=0.5	t(sec) 3 426
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41$ $a = 17.25$	$\beta = 1.33$ $a = 0.00$	$\beta = 23.00$ $a = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinich *Jerry Shinich* Date: 08-Jan-09

Comments: _____

Review By: *dksl* Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09	LOCATION: Port # 27	TIME: 10:25
Smear Information dpm		Frisking Probe Model #: 44-1
E_1 50.5	E_2 0.25	Serial # PR249243
		Frisking Probe Efficiency 0.12625
1 Min BKG: 1. [27]	2. [40]	3. [42]
Avg. BKG: [36]		
L _C Gross CPM: [67]	L _C Net CPM: [27]	
L _D Gross CPM: [N/A]	L _D Net CPM: [N/A]	

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	29	0	<MDA
2			
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	36	205
			d' = 1.38 p = 0.5	t (sec) 3	417
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimek / Guy Shimek Date: 08-Jan-09

Comments: _____

Review By: Colleagues Date: 2/28/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 28 TIME: 10:00

Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [29] [31] 3. [29]

Avg. BKG: [30]

L_C Gross CPM: [51]

L_C Net CPM: [21]

L_D Gross CPM: [N/A]

L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	40	10	<MDA	
2 Static 2	33	3	<MDA	
3 Static 3	31	1	<MDA	
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 60 cpm gross pre-decon.
Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	30	188
			d=1.38 p=0.5	t (sec) 3	377
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimsek / Guy Shultz Date: 08-Jan-09

Comments: _____

Review By: CDH Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 29 TIME: 9:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 35 3. 36 3. 38

Avg. BKG: 36

L_C Gross CPM: 57

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	44	8	<MDA
2 Static 2	40	4	<MDA
3 Static 3	25	0	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597-249243	9-Dec-09	0.502	36	205
			d=1.38 p=0.5	t (sec) 3	417
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinn/Jerry Shinn Date: 08-Jan-09

Comments: _____

Review By Jerry Shinn Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE:	8-Jan-09	LOCATION:	Port # 30	TIME:	9:20
Smear Information dpm		Frisking Probe Model # 44-1		Serial #	PR249243
ϵ_i	50.5	ϵ_s	0.25	Frisking Probe Efficiency 0.12625	
1 Min BKG: 1. [38]		[28]		3. [36]	
Avg. BKG: [34]					
L _C Gross CPM: [55]		L _C Net CPM: [21]			
L _D Gross CPM: [N/A]		L _D Net CPM: [N/A]			

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	43	9	<MDA	
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No Decon Necessary.
Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	34	199
			d'=1.38 p=0.5	t(sec) 3	403
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable.type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimek Date: 08-Jan-09

Comments: _____

Review By: A. B. D. Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 31 TIME: 9:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. [26] [38] 3. [39]
 Avg. BKG: [34]
 L_C Gross CPM: [55] L_C Net CPM: [27]
 L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	38	4	<MDA
2 Static 2	40	6	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 80 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	34	200
			d'=1.38 p=0.5	t (sec) 3	405
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50. mVdc			Detector cable type/length =	59 / 6 ft.

Print/Signature of Surveyor: Jerry Shultz / Jerry Shultz Date: 08-Jan-09

Comments:

Review By: Adele Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 32 TIME: 8:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 29 3. 31

Avg. BKG: 31

L_C Gross CPM: 52

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	47	16	<MDA
2 Static 2	49	18	<MDA
3 Static 3	44	13	<MDA
4 Static 4	47	16	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 61 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	31	191
			d'=1.38 p=0.5	t (sec) 3	385
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shineweh / Jerry Sh. Date: 08-Jan-09

Comments: _____

Review By: John A. Date: 2/25/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 33 TIME: 8:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. [32] [33] 3. [39]

Avg. BKG: [35]

L_C Gross CPM: [56]

L_C Net CPM: [21]

L_D Gross CPM: [N/A]

L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	50	15	<MDA	
2 Static 2	39	4	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 63 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	35	201
				d'=1.38 p=0.5	t(sec) 3 407
Tenelec Series 5.	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 08-Jan-09

Comments: _____

Review By: Jerry Shirek Date: 2/23/13

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 8-Jan-09 LOCATION: Port # 34 TIME: 8:10
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [36] 2. [28] 3. [24]

Avg. BKG: [29]

L_C Gross CPM: [50] L_C Net CPM: [27]

L_D Gross CPM: [N/A] L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	44	15	<MDA
2 Static 2	30	1	<MDA
3 Static 3	36	7	<MDA
4 Static 4	27	0	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 58 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	29	187
			d=1.38 p=0.5	t (sec) 3	374
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Doug J. Hahn Date: 08-Jan-09

Comments: _____

Review By: John A. Kline Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09

LOCATION: Port # 35

TIME: 11:30

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_s 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [32] [33] 3. [34]

Avg. BKG: 33

L_C Gross CPM: 54

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	48	15	<MDA
2 Static 2	45	12	<MDA
3 Static 3	34	1	<MDA
4 Static 4	32	0	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	33	197
			d=1.38 p=0.5	t (sec) 3	397
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 07-Jan-09

Comments: _____

Review By: Carl H Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09 LOCATION: Port # 36 TIME: 11:15
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 27 33 3. 37

Avg. BKG: 32

L_C Gross CPM: 53

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	50	18	<MDA	
2 Static 2	37	5	<MDA	
3 Static 3	33	1	<MDA	
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port.

Smear taken was <MDA. No Decon Necessary. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	32	195
			d=1.38 p=0.5	t(sec) 3	393
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vde (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 07-Jan-09

Comments: _____

Review By: Z. H. Kelle Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09 LOCATION: Port # 37 TIME: 11:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

E_1 50.5 ε_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 32 3. 38 3. 29

Avg. BKG: 33

L_C Gross CPM: 54

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	39	6	<MDA
2 Static 2	44	11	<MDA
3 Static 3	37	4	<MDA
4 Static 4	26	0	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port.

Smear taken was <MDA. No Decon Necessary. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	33	197
			d'=1.38 p=0.5	t (sec) 3	397
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker-Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shunk/Jerry Shunk Date: 07-Jan-09

Comments: _____

Review By: ABH Date: 2/22/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09 LOCATION: Port # 38 TIME: 10:50
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 30 3. 34 3. 29

Avg. BKG: 31

L_C Gross CPM: 52

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	50	19	<MDA
2 Static 2	39	8	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	31	191
			d'=1.38 p=0.5	t (sec) 3	385
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = S9 / 6 ft	

Print/Signature of Surveyor: Jerry Shimel / Dugay M.D. Date: 07-Jan-09

Comments: _____

Review By: Adler Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: <u>7-Jan-09</u>	LOCATION: <u>Port # 39</u>	TIME: <u>10:30</u>	
Smear Information <u>dpm</u>		Frisking Probe Model # <u>44-1</u>	Serial # <u>PR249243</u>
ϵ_i <u>50.5</u>	ϵ_s <u>0.25</u>	Frisking Probe Efficiency <u>0.12625</u>	
I Min BKG: <u>1.</u> <u>27</u>	<u>2.</u> <u>22</u>	<u>3.</u> <u>36</u>	
Avg. BKG: <u>28</u>			
L _C Gross CPM: <u>49</u>	L _C Net CPM: <u>21</u>		
L _D Gross CPM: <u>N/A</u>	L _D Net CPM: <u>N/A</u>		

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	43	15	<MDA	
2 Static 2	36	8	<MDA	
3 Static 3	33	5	<MDA	
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	28	184
			d' = 1.38 p = 0.5	t (sec) 3	368
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinn / Dugay SH Date: 07-Jan-09

Comments: _____

Review By: AKL Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09 LOCATION: Port # 40 TIME: 10:15
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. 34 34 3. 27
 Avg. BKG: 32
 L_C Gross CPM: 53 L_C Net CPM: 21
 L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	43	11	<MDA
2 Static 2	39	7	<MDA
3 Static 3	33	1	<MDA
4 Static 4	37	5	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port.

Smear taken was <MDA. No Decon Necessary. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	32	193
			d'=1.38 p=0.5	t(sec) 3	389
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek/Jerry Shirek Date: 07 - Jan - 09

Comments: _____

Review By: A. Kellie Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 7-Jan-09 LOCATION: Port # 41 TIME: 10:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 25 3. 32 3. 23

Avg. BKG: 27

L_C Gross CPM: 48

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	37	10	<MDA
2 Static 2	31	4	<MDA
3 Static 3	33	6	<MDA
4 Static 4	36	9	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 77 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	27	179
		d=1.38 p=0.5	t (sec) 3		357
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 07-Jan-09

Comments: _____

Review By: M. Shirek Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 42 TIME: 15:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_0 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 34 3. 37 3. 31

Avg. BKG: 34

L_C Gross CPM: 55 L_C Net CPM: 27

L_D Gross CPM: N/A L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	36	2	<MDA
2 Static 2	42	8	<MDA
3 Static 3	31	0	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 77 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	34	199
			d'=1.38 p=0.5	t (sec) 3	403
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 06 - Jan - 09

Comments: _____

Review By: Al Smith Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 43 TIME: 14:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i .50.5 ϵ_o 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 20 2. 32 3. 30

Avg. BKG: 27

L_C Gross CPM: 48

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	38	11	<MDA
2 Static 2	44	17	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts of the O/S portion end of each port. No decon necessary.

Smear taken was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	27	181
			d=1.38 p=0.5	t(sec) 3	361
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 06-Jan-09

Comments: _____

Review By: John Shirek Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 44 TIME: 14:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial #: PR249243

ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 22 36 3. 28

Avg. BKG: 29

L_C Gross CPM: 50

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	34	5	<MDA
2 Static 2	38	9	<MDA
3 Static 3	34	5	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 74 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	29	185
			d'=1.38 p=0.5	t (sec) 3	370
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)	Threshold Voltage = 50 mVdc			Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimek, Duyeshka Date: 06-Jan-09

Comments: _____

Review By: Adell Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 23-Dec-08 LOCATION: Port # 45 TIME: 14:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 30 42 3. 41

Avg. BKG: 38

L_C Gross CPM: 59

L_C Net CPM: 21

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	48	10	<MDA	
2 Static 2	46	8	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	38	208
			d=1.38 p=0.5	t(sec) 3	424
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Détecto HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Guy Edel Date: 23-Dec-08

Comments: _____

Review By: _____ Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 23-Dec-08

LOCATION: Port # 46

TIME: 13:45

Smear Information dpm

Frisking Probe Model # 44-1

Serial # PR249243

ϵ_i 50.5

ϵ_s 0.25

Frisking Probe Efficiency 0.12625

1 Min BKG: 1. [34] 2. [40] 3. [42]

Avg. BKG: [39]

L_C Gross CPM: [60]

L_C Net CPM: [21]

L_D Gross CPM: [N/A]

L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	33	0	<MDA
2 Static 2	29	0	<MDA
3 Static 3	35	0	<MDA
4 Static 4	49	10	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 /44-1	218597 / 249243	9-Dec-09	0.502	39	211
		d' = 1.38 p = 0.5	t (sec) 3		430
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \sigma = 17.25$	$\beta = 1.33 \sigma = 0.00$	$\beta = 23.00 \sigma = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirey/Jerry Shirey Date: 23-Dec-08

Comments:

Review By: Abbie Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 47 TIME: 14:00
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_s 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 27 2. 29 3. 27

Avg. BKG: 28

L_c Gross CPM: 49

L_c Net CPM: 27

L_d Gross CPM: N/A

L_d Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	44	16	<MDA
2 Static 2	34	6	<MDA
3 Static 3	37	9	<MDA
4 Static 4	41	13	<MDA
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Up to 100 cpm gross pre-decon.
 Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	28	182
			d' = 1.38 p = 0.5	t (sec) 3	364
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shinde / Guy Clark Date: 06 - Jan - 09

Comments:

Review By: AAH Date: 2/28/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 48 TIME: 13:45
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_1 50.5 ϵ_2 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 33 2. 29 3. 36

Avg. BKG: 33

L_C Gross CPM: 54

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	39	6	<MDA
2 Static 2	48	15	<MDA
3			
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	33	196
			d' = 1.38 p = 0.5	t (sec) 3	395
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shirek / Jerry Shirek Date: 06 - Jan - 09

Comments: _____

Review By: CDR Date: 2/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 6-Jan-09 LOCATION: Port # 49 TIME: 13:25
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243
 ϵ_i 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625
 1 Min BKG: 1. [31] [27] 3. [29]

Avg. BKG: [29]

L_C Gross CPM: [50]

L_C Net CPM: [27]

L_D Gross CPM: [N/A]

L_D Net CPM: [N/A]

Static Count No.	CPM (Gross)	CPM (Net)	DPM	
1 Static 1	41	12	<MDA	
2 Static 2	46	17	<MDA	
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				
13				
14				
15				
16				
17				
18				
19				
20				

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	29	186
			d' = 1.38 p = 0.6	t (sec) 3	372
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shink / Guy Shink Date: 06 - Jan - 09

Comments: _____

Review By: ✓ Shink Date: 3/23/12

Storage Port Exterior Survey Report

Survey NO.: NA

DATE: 23-Dec-08 LOCATION: Port # 50 TIME: 13:30
 Smear Information dpm Frisking Probe Model # 44-1 Serial # PR249243

ϵ_1 50.5 ϵ_a 0.25 Frisking Probe Efficiency 0.12625

1 Min BKG: 1. 34 3. 33 3. 42

Avg. BKG: 36

L_C Gross CPM: 57

L_C Net CPM: 27

L_D Gross CPM: N/A

L_D Net CPM: N/A

Static Count No.	CPM (Gross)	CPM (Net)	DPM
1 Static 1	45	9	<MDA
2 Static 2	50	14	<MDA
3 Static 3	39	3	<MDA
4			
5			
6			
7			
8			
9			
10			
11			
12			
13			
14			
15			
16			
17			
18			
19			
20			

*NOTE: All counts are 1 minute static counts post-decon of the O/S portion end of each port. Refer to initial port survey report for pre-decon contamination results. Smear taken post-decon was <MDA. Port end is free released up to plane of wall.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
L-2221 / 44-1	218597 / 249243	9-Dec-09	0.502	36	205
			d' = 1.38 p = 0.5	t (sec) 3	417
Tenelec Series 5	2161	28-Jul-09	$\beta = 17.41 \alpha = 17.25$	$\beta = 1.33 \alpha = 0.00$	$\beta = 23.00 \alpha = 5.23$
Frisker Detector HV = 700 Vdc (249243)		Threshold Voltage = 50 mVdc		Detector cable type/length = 59 / 6 ft.	

Print/Signature of Surveyor: Jerry Shimke / Guyallito Date: 23-Dec-08

Comments: _____

Review By: CDL Date: 2/22/12

Sample Report

Batch ID:	Smears - 200901121728	Count Date:	1/12/2009 5:28:10PM
Group:	B	Count Minutes:	3.00
Device:	S5-XLB	Count Mode:	Simultaneous
Batch Key:	233	Operating Volts:	1440
Selected	Swipe/Smear		

Efficiency (%)

Alpha: 17.25 ± 0.12
Beta: 17.41 ± 0.05

Sample ID	Sample Type	Alpha (dpm)	Unc	Alpha MDA (dpm)	Beta (dpm)	Unc	Beta MDA (dpm)
Unloaded Swipe	LCS	7.73	3.86	5.23	-1.91	5.07	23.00
Tc-99 Eberline Standard	LCS	27.05	7.23	5.23	14558.19	172.37	23.00
th-230 Eberline Standard	LCS	13851.28	189.21	5.23	2812.46	74.04	23.00
20090112173951-B1	Unknown	0.00	0.00	5.23	-1.91	5.07	23.00
20090112174311-B2	Unknown	0.00	0.00	5.23	3.83	6.05	23.00
20090112174621-B3	Unknown	0.00	0.00	5.23	0.00	5.42	23.00
20090112174941-B4	Unknown	0.00	0.00	5.23	1.91	5.74	23.00
20090112175301-B5	Unknown	1.93	1.93	5.23	-1.91	5.07	23.00
20090112175611-B6	Unknown	0.00	0.00	5.23	0.00	5.42	23.00
20090112175931-B7	Unknown	1.93	1.93	5.23	1.91	5.74	23.00
20090112180251-B8	Unknown	3.86	2.73	5.23	5.74	6.35	23.00
20090112180611-B9	Unknown	1.93	1.93	5.23	7.66	6.63	23.00
20090112180921-B10	Unknown	0.00	0.00	5.23	3.83	6.05	23.00
20090112181241-B11	Unknown	3.86	2.73	5.23	0.00	5.42	23.00
20090112181601-B12	Unknown	0.00	0.00	5.23	-1.91	5.07	23.00
20090112181911-B13	Unknown	0.00	0.00	5.23	-5.74	4.28	23.00
20090112182231-B14	Unknown	0.00	0.00	5.23	-5.74	4.28	23.00
20090112182551-B15	Unknown	0.00	0.00	5.23	5.74	6.35	23.00
20090112182911-B16	Unknown	0.00	0.00	5.23	5.74	6.35	23.00
20090112183221-B17	Unknown	0.00	0.00	5.23	-3.83	4.69	23.00
20090112183541-B18	Unknown	0.00	0.00	5.23	0.00	5.42	23.00
20090112183901-B19	Unknown	0.00	0.00	5.23	7.66	6.63	23.00
20090112184211-B20	Unknown	0.00	0.00	5.23	-3.83	4.69	23.00
20090112184531-B21	Unknown	0.00	0.00	5.23	-1.91	5.07	23.00
20090112184851-B22	Unknown	0.00	0.00	5.23	1.91	5.74	23.00
20090112185211-B23	Unknown	0.00	0.00	5.23	9.57	6.90	23.00
20090112185521-B24	Unknown	0.00	0.00	5.23	11.49	7.16	23.00
20090112185841-B25	Unknown	0.00	0.00	5.23	15.32	7.66	23.00
Unloaded Swipe	Background	Alpha (cpm): 0.00		Beta (cpm): 1.33			
Unloaded Swipe	LCS	1.93	1.93	5.23	1.91	5.74	23.00

Reviewed by:



2/23/12

Background Report

Batch ID:	Smears - 200901121728	Count Date:	1/12/2009 5:28:10PM
Group:	B	Count Minutes:	3.00
Device:	S5-XLB	Count Mode:	Simultaneous
Batch Key:	233	Operating Volts:	1440
Selected	Swipe/Smear		


Background (cpm)

Alpha Rate: 0.00 ± 0.00 **Beta Rate:** 1.33 ± 0.67

Sample ID	Alpha (cpm)	Unc	Beta (cpm)	Unc	Guard (cpm)
20090112172810-B141	1.33	0.67	1.00	0.58	217.67
20090112173311-B149	4.67	1.25	2,536.00	29.07	205.67
20090112173631-B150	2,389.67	28.22	491.00	12.79	213.33
20090112173951-B1	0.00	0.00	1.00	0.58	197.00
20090112174311-B2	0.00	0.00	2.00	0.82	222.67
20090112174621-B3	0.00	0.00	1.33	0.67	213.67
20090112174941-B4	0.00	0.00	1.67	0.75	210.67
20090112175301-B5	0.33	0.33	1.00	0.58	217.33
20090112175611-B6	0.00	0.00	1.33	0.67	213.00
20090112175931-B7	0.33	0.33	1.67	0.75	213.67
20090112180251-B8	0.67	0.47	2.33	0.88	216.33
20090112180611-B9	0.33	0.33	2.67	0.94	206.00
20090112180921-B10	0.00	0.00	2.00	0.82	217.00
20090112181241-B11	0.67	0.47	1.33	0.67	200.00
20090112181601-B12	0.00	0.00	1.00	0.58	209.67
20090112181911-B13	0.00	0.00	0.33	0.33	226.33
20090112182231-B14	0.00	0.00	0.33	0.33	209.67
20090112182551-B15	0.00	0.00	2.33	0.88	218.67
20090112182911-B16	0.00	0.00	2.33	0.88	229.33
20090112183221-B17	0.00	0.00	0.67	0.47	197.33
20090112183541-B18	0.00	0.00	1.33	0.67	221.00
20090112183901-B19	0.00	0.00	2.67	0.94	207.33
20090112184211-B20	0.00	0.00	0.67	0.47	218.00
20090112184531-B21	0.00	0.00	1.00	0.58	214.67
20090112184851-B22	0.00	0.00	1.67	0.75	194.00
20090112185211-B23	0.00	0.00	3.00	1.00	209.00
20090112185521-B24	0.00	0.00	3.33	1.05	210.67
20090112185841-B25	0.00	0.00	4.00	1.15	219.00
20090112190201-B143	0.00	0.00	1.33	0.67	202.67
20090112190511-B147	0.33	0.33	1.67	0.75	216.00

Guard Avg Rate: 212.24

Reviewed by:



2/23/12

Procedure: <input type="button" value="Smears"/> <input type="checkbox"/> Is Active <input type="radio"/> Count Mode <input type="radio"/> Alpha <input type="radio"/> Alpha then Beta <input type="radio"/> Simultaneous Discriminator Selection Alpha/Beta ROI: <input type="button" value="Tc-99 3.5% 0.8%"/> Beta Lower: <input type="text" value="0.25"/> Beta Upper: <input type="text" value="42.30"/> Alpha Lower: <input type="text" value="72.50"/>	Preselected Report: <input type="button" value="None"/> <input type="button" value="None"/> Preselected Group & Device: <input type="button" value="None"/> <input type="button" value="None"/> Sample Count Delay <input type="text" value="0.1"/> minutes (0 to 9,999 minutes)	Reporting Units: <input type="button" value="dpm"/> Background Subtraction <input type="radio"/> Disable <input checked="" type="radio"/> Enable <input type="radio"/> Previous Stored <input checked="" type="radio"/> Method Blank Spillover Correction <input checked="" type="radio"/> Disable <input type="radio"/> Enable Sample Activity <input type="radio"/> Disable <input checked="" type="radio"/> Enable Alpha Cal. Standard: <input type="button" value="Am-241 47 mm Fi"/> Beta Cal. Standard: <input type="button" value="Tc-99 47 mm Filt"/>
Presets: Count Time: <input type="text" value="3"/> minutes Alpha: <input type="text" value="0"/> counts Beta: <input type="text" value="0"/> counts		
<input type="button" value="New"/> <input type="button" value="Save"/> <input type="button" value="Save As"/> <input type="button" value="Print"/>		

Key 233
Group B

O/S Storage Ports 1-50

JS 1-12-09

APPENDIX G

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

Radiological Survey Report


DATE: 4/13/09 LOCATION: SW Corner of Storage Pits SURVEY NO.: 2009-0041 TIME: 1300

Smear Information

N/A

Survey Map

No.	Beta/ Gamma	Alpha (20%)
1		
2		
3		
4		
5		
6		
7		
8	10	
9		
10		
11		
12		
13		
14		
15		
16		
17		
18		
19		
20		

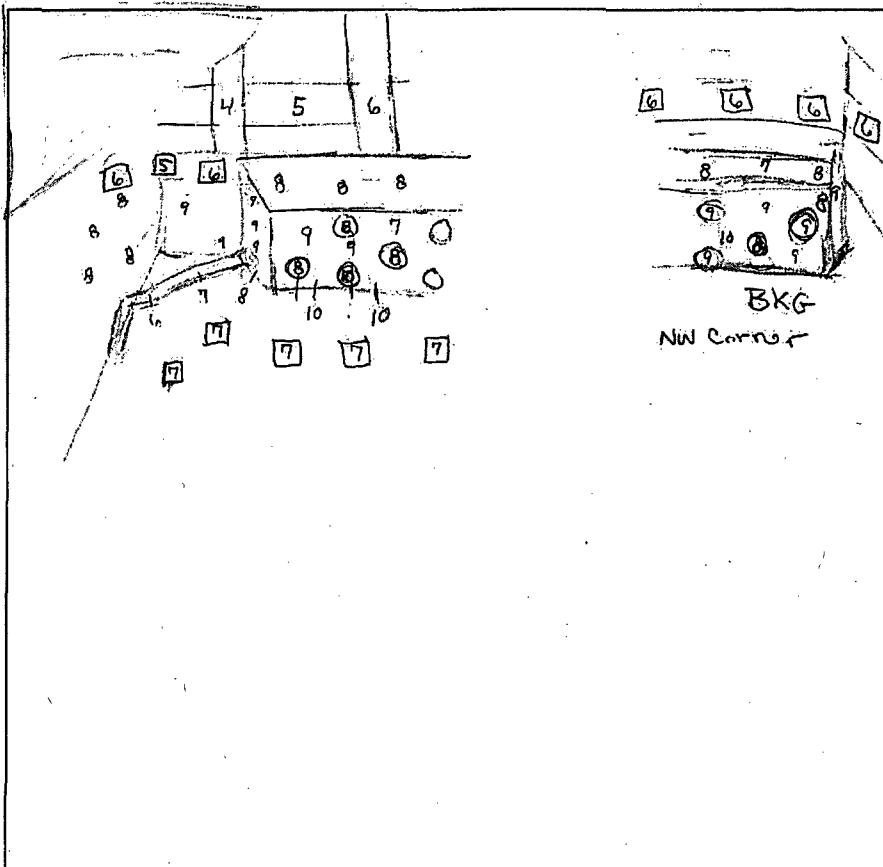

Legend: * = Contact; # / # = Contact Reading / General Area; # = General Area; ① = Smear location; Δ = Air Sample.

Note: Readings in mrem/hr unless noted otherwise.

Instrument	Serial Number	Cal. Due Date	Efficiency	Background (CPM)	MDA (DPM)
Model 19	101763	25 Jul 09	NA	NA	NA
Frisker Detector HV =	Vdc	Threshold Voltage =	mVdc	Detector cable length =	ft.

Print/Signature of Surveyor: Shannon M. Weger / Shannon M. Weger Date: 4/16/09

Comments: represents readings taken at one meter ^{out} and one meter ⁱⁿ.

BKG was taken at NW corner

Review By: C. J. Kelly

Date: 2/23/12

Ludlam Model 19 MicroR Meter

Equivalent to HP-101, Rev. 5, Attachment 1

Retention: LP+10

APPENDIX H

**UNIVERSITY OF MICHIGAN
FORD NUCLEAR REACTOR**

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A S E C T R U M A N A L Y S I S *****

Filename: C:\GENIE2K\CAMFILES\Det 264\StoragePortExcavation\UM-2009-04-

Report Generated On : 2/16/2012 5:13:27 PM

Sample Title : UM-2009-04-24-01
Sample Description : Concrete ground from north cut f
Sample Identification : 2009-04-24-01
Sample Type : concrete
Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00
Peak Locate Range (in channels) : 39 - 8192
Peak Area Range (in channels) : 47 - 8192
Identification Energy Tolerance : 0.750 FWHM

Sample Size : 6.000E+002 g

Sample Taken On : 2/24/2009 3:00:00 PM
Acquisition Started : 2/7/2012 4:05:55 PM

Live Time : 50000.0 seconds
Real Time : 50005.0 seconds

Dead Time : 0.01 %

Energy Calibration Used Done On : 2/16/2012
Efficiency Calibration Used Done On : 2/5/2012
Efficiency ID : 500ml 2.0 g/cc

Eu-152 8.6E-2 pCi/g MDA 7.3E-2 pCi/s
±2%

Neustrom 2/16/12

NUCLIDE MDA REPORT

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: UM-2009-04-24-01
 Nuclide Library Used: C:\GENIE2K\CAMFILES\Libraries\Soil_DCGL_

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BE-7	477.60	10.52	3.0238E-001	3.02E-001	2.8237E-002
K-40	1460.83*	10.67	3.2978E-007	3.30E-007	7.4985E-006
MN-54	834.85	99.98	3.7205E-007	3.72E-007	1.0129E-007
CO-60	1173.24*	99.97	5.8372E-008	5.84E-008	4.3962E-009
	1332.50*	99.99	5.9717E-008		5.6344E-008
ZN-65	1115.55	50.60	2.2101E-006	2.21E-006	-1.3088E-007
NB-94x	702.62	97.90	3.0977E-008	3.10E-008	-1.7010E-008
	871.09	99.90	3.3103E-008		2.8596E-008
AG-108m	21.10	59.10	2.9021E-007	2.90E-008	-4.2206E-008
	23.80	9.60	1.1000E-006		3.7623E-008
	79.13	8.76	3.0715E-007		-1.2767E-007
	433.94	90.50	2.9036E-008		1.1123E-008
	614.28	89.87	5.8451E-008		-8.9361E-009
	722.91	90.80	3.8072E-008		-5.5848E-009
CD-109	22.10	85.20	8.2472E-007	8.25E-007	-3.6121E-007
	25.02	16.81	2.6144E-006		-7.5823E-007
	88.03	3.61	3.1183E-006		2.8567E-007
AG-110m	446.81	3.72	1.2919E-005	6.13E-007	5.8616E-006
	620.36	2.79	1.9121E-005		-1.4550E-005
	657.76	94.00	6.1270E-007		2.0481E-007
	677.62	10.28	5.5135E-006		-2.1508E-006
	687.02	6.39	9.3357E-006		6.0910E-006
	706.68	16.33	3.7046E-006		2.9949E-006
	744.28	4.70	1.2706E-005		6.6709E-006
	763.94	22.14	3.1887E-006		-2.2700E-006
	818.03	7.34	8.5823E-006		2.4817E-006
	884.68	72.70	8.7968E-007		1.0407E-007
	937.49	34.36	2.1135E-006		1.6964E-006
	1384.30	24.28	2.8403E-006		-2.8642E-007
	1475.79	3.99	1.4517E-005		-1.3200E-006
	1505.04	13.04	5.2799E-006		-4.0265E-007
	1562.30	1.03	5.7636E-005		2.3703E-005
SB-125	176.33	6.79	6.3825E-007	1.86E-007	-2.0701E-007
	380.43	1.52	3.3788E-006		-2.3257E-006
	427.89	29.40	1.8592E-007		-8.1883E-008
	463.38	10.45	5.4579E-007		7.4082E-007
	600.56	17.78	3.4983E-007		1.2418E-008
	606.64	5.02	2.4829E-006		-7.2793E-008
	635.90	11.32	5.0898E-007		-3.8281E-009
	671.41	1.80	3.2759E-006		-3.0495E-006
BA-133	53.16	2.20	1.1860E-006	7.88E-008	6.1883E-007
	79.62	2.62	1.2292E-006		-5.1558E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	81.00	34.10	7.8831E-008	7.88E-008	-3.9516E-008
	160.61	0.64	3.7204E-006		-8.9237E-008
	223.23	0.45	6.0509E-006		1.0282E-006
	276.40	7.16	3.8953E-007		1.5544E-007
	302.85	18.33	1.6075E-007		1.3201E-007
	356.02	62.05	7.9624E-008		-1.2952E-008
	383.85	8.94	3.3550E-007		-2.7235E-007
	475.35	1.46	4.4711E-006	1.05E-007	2.5662E-006
	563.23	8.38	8.9872E-007		1.4368E-007
	569.32	15.43	4.7562E-007		5.6590E-008
CS-134	604.70	97.60	1.4184E-007		-1.8281E-008
	795.84	85.40	1.0511E-007		6.5436E-008
	801.93	8.73	9.7931E-007		4.3651E-007
	1038.57	1.00	9.2355E-006		-1.4515E-006
	1167.94	1.80	6.2161E-006		-1.7210E-006
	1365.15	3.04	2.8191E-006		6.4870E-007
	661.66	85.21	3.8032E-008	3.80E-008	1.9934E-008
	165.85	79.89	2.6052E-008	2.61E-008	-3.2693E-010
	121.78*	28.40	7.2633E-008	7.26E-008	8.5815E-008
	244.70*	7.49	3.0332E-007		5.1063E-008
+ CS-137	344.28*	26.60	8.2604E-008		8.2042E-008
	411.11	2.23	1.3423E-006		3.7311E-007
	443.98	2.78	9.9661E-007		-2.2806E-007
	778.90	12.96	2.7508E-007		-8.2245E-009
	867.39	4.15	9.3557E-007		1.0848E-007
	964.13	14.34	3.6014E-007		5.9676E-008
	1085.91	9.92	4.3500E-007		1.4024E-007
	1089.70	1.71	2.5341E-006		3.7245E-007
	1112.12	13.55	3.2576E-007		-1.9859E-009
	1212.95	1.40	3.3727E-006		1.6737E-006
CE-139	1299.12	1.63	2.5226E-006		9.1149E-008
	1408.01*	20.87	1.1873E-007		2.4679E-007
	123.07	40.40	5.8266E-008	5.83E-008	5.8094E-008
	188.25	0.23	1.4017E-005		-5.0999E-006
	247.93	6.83	4.1119E-007		2.7898E-008
	401.30	0.19	1.6072E-005		-9.9571E-006
	444.39	0.55	5.4894E-006		-2.0581E-006
	478.26	0.21	1.4817E-005		-2.0735E-006
	557.56	0.25	1.3557E-005		4.0431E-006
	582.00	0.89	5.4581E-006		1.6515E-005
EU-152x	591.76	4.91	6.9397E-007		-3.1158E-007
	625.22	0.32	1.0818E-005		3.8836E-007
	676.59	0.14	2.6160E-005		-1.5677E-005
	692.42	1.78	2.0895E-006		-1.1498E-006
	715.76	0.17	2.2879E-005		-1.0072E-005
	722.30	20.00	2.1599E-007		-2.0578E-009
	756.86	4.50	8.6176E-007		-6.7063E-008
	815.55	0.50	7.9101E-006		-3.3062E-006
	845.39	0.58	6.6414E-006		-1.9085E-007
	850.64	0.23	1.7313E-005		1.3369E-005
EU-154	873.20	12.09	3.4367E-007		1.3553E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	8.4607E-006	5.83E-008	2.9852E-006
	904.05	0.85	4.9222E-006		-3.8438E-006
	996.30	10.34	4.3746E-007		-1.1993E-007
	1004.76	17.90	2.5585E-007		4.1773E-008
	1128.40	0.29	1.5780E-005		-8.1276E-006
	1140.90	0.22	2.0837E-005		-8.9336E-006
	1241.60	0.13	4.8046E-005		-7.9671E-006
	1246.60	0.80	5.9038E-006		-4.7195E-006
	1274.51	34.40	1.2941E-007		-7.3095E-008
	1494.08	0.71	5.7687E-006		4.4402E-007
	1596.45	1.80	2.3964E-006		-4.1291E-007
+ TL-208B	72.80	2.02	1.5742E-006	5.50E-008	8.0762E-008
	74.97*	3.41	1.2160E-006		3.4242E-006
	84.90	1.51	1.8101E-006		1.0951E-006
	277.36	6.31	4.4674E-007		2.8983E-007
	510.77*	22.60	3.0421E-007		3.9585E-007
	583.19*	84.50	5.5003E-008		1.4500E-007
	763.13	1.81	2.3043E-006		-2.1353E-006
	860.56*	12.42	4.0579E-007		1.6762E-007
	2614.53	99.16	8.3734E-008		2.3516E-007
+ Pb-210	46.52*	4.05	7.6428E-007	7.64E-007	1.2997E-006
+ PB-212B	74.81*	10.50	3.9491E-007	1.54E-007	1.1121E-006
	77.11*	17.60	2.3351E-007		1.0611E-006
	87.30*	7.90	2.9624E-007		5.9477E-007
	238.63*	43.60	1.5368E-007		4.9668E-007
	300.09*	3.34	6.3681E-007		5.1091E-007
+ BI-214B	609.31*	44.80	1.1250E-007	1.12E-007	1.1332E-006
	665.45	1.29	2.8436E-006		1.8892E-006
	768.36*	4.80	7.6886E-007		7.2145E-007
	806.17	1.12	3.5813E-006		4.3837E-006
	934.06*	3.03	1.4667E-006		7.5853E-007
	1120.29*	14.80	4.2775E-007		1.0248E-006
	1155.19	1.64	2.9536E-006		1.5538E-006
	1238.11*	5.86	8.0533E-007		1.5287E-006
	1280.96*	1.44	3.0451E-006		3.1718E-006
	1377.67*	3.92	2.0322E-006		1.3195E-006
	1401.50*	1.55	2.6183E-006		1.2498E-006
	1407.98*	2.80	9.3357E-007		1.9406E-006
	1509.23	2.12	2.1046E-006		1.1105E-006
	1661.28	1.14	3.0500E-006		-9.8201E-008
	1729.59*	2.88	1.7145E-006		9.7237E-007
	1764.49*	15.36	2.9063E-007		1.2331E-006
	1847.42*	2.04	1.0027E-006		1.7854E-006
	2118.55*	1.14	1.4220E-006		2.9866E-006
	2204.21	4.86	1.0202E-006		1.2169E-006
	2447.86	1.50	2.9615E-006		2.8941E-006
+ PB-214B	53.23*	1.11	2.3899E-006	1.31E-007	6.1958E-007
	74.81*	5.90	7.0280E-007		1.9791E-006
	77.11*	9.90	4.1513E-007		1.8864E-006
	87.30*	4.41	5.3069E-007		1.0655E-006
	241.98*	7.50	8.7664E-007		1.5907E-006

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PB-214B	295.21*	18.50	2.0020E-007	1.31E-007	1.2695E-006
	351.92*	35.80	1.3081E-007		1.1792E-006
RA-226	186.10*	3.50	7.1912E-007	7.19E-007	1.6436E-006
AC-228B	12.95	15.10	2.0842E-007	1.96E-007	0.0000E+000
	16.15	20.00	2.5069E-006		7.6400E-006
	19.11	4.60	7.0440E-006		3.4197E-005
	89.96*	3.40	1.1582E-006		6.2816E-007
	93.35*	5.60	7.6131E-007		1.0898E-006
	99.55	1.30	1.6663E-006		-1.8988E-007
	105.36	2.00	1.0916E-006		-5.6032E-007
	129.03*	2.90	5.9468E-007		5.3074E-007
	209.39*	4.10	6.9177E-007		5.6981E-007
	270.26*	3.80	9.7025E-007		1.7062E-006
	328.07*	3.50	9.0526E-007		7.9729E-007
	338.42*	12.40	2.5904E-007		5.8412E-007
	409.62	2.20	1.4270E-006		2.3282E-007
	463.10*	4.60	7.3494E-007		8.7265E-007
	562.65	1.01	3.3551E-006		-1.2755E-006
	755.28	1.32	2.8325E-006		6.5265E-008
	772.28	1.09	3.9958E-006		-1.2434E-006
	794.79*	4.60	9.0227E-007		1.4130E-006
	835.60	1.71	2.4360E-006		1.0529E-006
	911.16*	29.00	1.9637E-007		4.4613E-007
	964.64	5.80	9.5092E-007		3.0068E-007
	968.97*	17.40	3.0238E-007		3.7422E-007
	1459.19	1.06	1.2019E-005		9.4817E-005
	1496.00	1.05	3.7125E-006		-2.3071E-006
	1588.23	3.60	1.2495E-006		8.5727E-007
	1630.47	1.95	1.8751E-006		2.8073E-007
PA-234B	63.00	3.20	8.7030E-007	9.45E-008	1.1614E-006
	94.67	14.30	1.8379E-007		-6.6375E-008
	98.44	23.00	9.4517E-008		1.7385E-008
	99.70	4.80	4.5318E-007		1.4763E-007
	111.00	10.80	2.0783E-007		-1.4722E-008
	125.40	1.00	2.2601E-006		-5.3145E-007
	131.20	20.00	1.1753E-007		5.1874E-008
	152.70	6.70	3.5868E-007		1.1431E-007
	186.00	2.00	1.5645E-006		4.7542E-006
	200.90	1.00	2.6639E-006		-3.0975E-008
	202.90	1.20	2.2191E-006		-3.1264E-007
	226.40	5.90	4.6867E-007		6.1141E-008
	227.20	5.50	5.0196E-007		-2.4374E-007
	248.90	2.80	9.5020E-007		-7.9629E-008
	272.10	1.00	3.0663E-006		-4.2847E-007
	293.70	3.90	1.0713E-006		1.7151E-009
	369.80	2.90	9.9836E-007		-4.6059E-007
	372.40	1.30	2.2495E-006		-2.7169E-007
	458.80	1.50	2.0759E-006		1.7249E-007
	506.80	1.60	3.0191E-006		-2.0448E-006
	513.70	1.30	3.9086E-006		-2.1919E-007
	565.90	1.40	2.4542E-006		1.2850E-006

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	1.0152E-006	9.45E-008	2.8251E-007
	569.50	10.00	3.3214E-007		6.1554E-008
	574.00	2.00	1.6077E-006		-1.2991E-006
	664.80	1.30	2.8518E-006		1.7045E-006
	666.70	1.60	2.2316E-006		-7.2171E-007
	669.90	1.40	2.5222E-006		1.1666E-006
	692.70	1.50	2.4138E-006		-1.6946E-007
	699.00	4.60	8.1634E-007		4.0541E-007
	706.10	3.10	1.1946E-006		3.1546E-007
	733.00	9.00	4.2152E-007		1.3331E-007
	738.00	1.00	3.5663E-006		3.1910E-008
	742.81	2.40	1.5084E-006		-4.0973E-007
	755.60	1.40	2.6643E-006		3.2781E-007
	780.70	1.10	3.6079E-006		1.6533E-006
	786.27	1.40	2.7699E-006		-7.4167E-007
	793.60	1.50	2.7595E-006		3.7125E-006
	796.30	3.80	1.0711E-006		6.2056E-008
	805.80	3.30	1.2055E-006		1.1891E-006
	819.60	2.60	1.5065E-006		-1.3913E-007
	826.30	4.00	9.8258E-007		2.1059E-007
	831.60	5.50	7.3214E-007		-1.6540E-007
	876.40	4.00	9.6031E-007		-5.7628E-007
	880.50	4.00	9.4959E-007		-3.6541E-008
	880.51	9.00	4.2204E-007		-1.6241E-008
	883.24	15.00	2.5255E-007		-3.6833E-008
	899.00	4.10	1.0078E-006		2.6378E-007
	925.00	2.90	1.4239E-006		6.0873E-007
	926.00	11.00	3.7798E-007		9.0370E-008
	927.10	11.00	3.7718E-007		-4.6172E-007
	946.00	12.00	3.4466E-007		-4.9891E-008
	949.00	8.00	5.2387E-007		-4.0844E-008
	978.80	1.40	2.9640E-006		5.8799E-007
	980.50	2.00	2.0775E-006		4.2875E-007
	980.50	3.00	1.3850E-006		2.8583E-007
	984.00	1.90	2.2035E-006		-7.0030E-007
	1353.30	1.70	2.1771E-006		-7.1542E-007
	1394.10	3.00	1.2357E-006		-5.5449E-007
	1452.70	1.00	4.6547E-006		-5.0377E-006
	1668.50	1.20	2.9992E-006		5.2892E-007
	1694.60	1.20	2.6785E-006		1.5344E-006
TH-234	63.29	4.50	1.4863E+007	1.49E+007	2.0735E+007
	92.38	2.60	2.5777E+007		1.1490E+008
	92.80	2.60	2.5596E+007		1.0897E+008
+ U-235	72.70	0.11	2.3570E-005	4.37E-008	1.2092E-006
	89.95*	2.80	1.1461E-006		6.2164E-007
	93.35*	4.50	7.7212E-007		1.1053E-006
	94.00	0.40	5.4278E-006		-5.4716E-007
	105.00	2.10	8.4662E-007		-2.4922E-007
	109.16	1.50	1.2132E-006		-1.4208E-007
	140.76	0.22	8.6649E-006		-6.3840E-007
	143.76*	10.90	2.3775E-007		1.6431E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ U-235	163.33	5.00	4.1311E-007	4.37E-008	7.1838E-008
	182.61	0.40	6.0901E-006		1.5608E-007
	185.71*	57.50	4.3717E-008		9.9919E-008
	194.94	0.59	3.6157E-006		-6.0892E-007
	202.11	1.00	2.1629E-006		-4.7616E-007
	205.31*	5.00	4.7894E-007		1.7975E-007
	279.50	0.27	8.4534E-006		-2.4896E-006

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX I

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

***** G A M M A S E C T R U M A N A L Y I S *****

Filename: C:\GENIE2K\CAMFILES\Det 264\StoragePortExcavation\UM-2009-03-

Report Generated On : 2/16/2012 4:18:35 PM

Sample Title : UM-2009-03-25-02

Sample Description : Soil sample from behind West sup

Sample Identification : 2009-03-25-02

Sample Type : soil

Sample Geometry : 500 ml Nalgene

Peak Locate Threshold : 3.00

Peak Locate Range (in channels) : 39 - 8192

Peak Area Range (in channels) : 47 - 8192

Identification Energy Tolerance : 0.750 FWHM

Sample Size : 1.000E+003 g

Sample Taken On : 3/25/2009 3:00:00 PM

Acquisition Started : 2/8/2012 7:31:14 PM

Live Time : 50000.0 seconds

Real Time : 50005.3 seconds

Dead Time : 0.01 %

Energy Calibration Used Done On : 2/8/2012

Efficiency Calibration Used Done On : 2/5/2012

Efficiency ID : 500ml 2.0 g/cc

*Eu-152 5.22E-2 pCi/s; MDA 5.29 pCi/s
±1.65*

A. Schreyer 2/16/12

NUCLIDE MDA REPORT

Detector Name: HPGE
 Sample Geometry: 500 ml Nalgene
 Sample Title: UM-2009-03-25-02
 Nuclide Library Used: C:\GENIE2K\CAMFILES\Libraries\Soil_DCGL_

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BE-7	477.60	10.52	1.6456E-001	1.65E-001	1.0882E-001
K-40	1460.83*	10.67	3.1760E-007	3.18E-007	1.0858E-005
MN-54	834.85	99.98	2.4037E-007	2.40E-007	1.6465E-008
CO-60	1173.24	99.97	4.4321E-008	3.70E-008	3.1633E-008
	1332.50	99.99	3.6979E-008		1.8919E-008
ZN-65	1115.55	50.60	1.4069E-006	1.41E-006	5.2555E-007
NB-94x	702.62	97.90	2.2608E-008	2.26E-008	-1.0627E-008
	871.09	99.90	2.3648E-008		1.8787E-008
AG-108m	21.10	59.10	1.9731E-007	1.96E-008	3.4438E-009
	23.80	9.60	7.7467E-007		-4.7816E-007
	79.13	8.76	2.1390E-007		-3.5145E-008
	433.94	90.50	1.9616E-008		7.2955E-009
	614.28	89.87	3.6118E-008		5.4458E-009
	722.91	90.80	2.6608E-008		-1.9056E-008
	22.10	85.20	5.4719E-007	5.47E-007	-1.4555E-007
CD-109	25.02	16.81	1.7679E-006		-4.7782E-007
	88.03	3.61	2.1691E-006		2.0459E-006
AG-110m	446.81	3.72	8.5387E-006	3.82E-007	-6.4813E-007
	620.36	2.79	1.2880E-005		-1.1860E-005
	657.76	94.00	3.8215E-007		-1.8735E-007
	677.62	10.28	3.6133E-006		-3.3784E-007
	687.02	6.39	6.2502E-006		2.8184E-007
	706.68	16.33	2.4534E-006		4.2788E-007
	744.28	4.70	8.4115E-006		3.3779E-006
	763.94	22.14	2.0195E-006		-9.1750E-007
	818.03	7.34	5.2690E-006		-1.7553E-006
	884.68	72.70	5.8287E-007		5.0385E-008
	937.49	34.36	1.3261E-006		-2.8503E-007
	1384.30	24.28	1.8113E-006		-1.0060E-006
	1475.79	3.99	8.2625E-006		1.0959E-006
SB-125	1505.04	13.04	3.0801E-006		3.0956E-007
	1562.30	1.03	2.9368E-005		1.5026E-005
	176.33	6.79	4.5856E-007	1.23E-007	-2.2914E-008
	380.43	1.52	2.3359E-006		1.3939E-006
	427.89	29.40	1.2257E-007		3.1802E-008
	463.38	10.45	3.7626E-007		5.0984E-007
	600.56	17.78	2.3678E-007		1.3155E-007
BA-133	606.64	5.02	1.5158E-006		1.0431E-005
	635.90	11.32	3.6155E-007		3.3139E-007
	671.41	1.80	2.2683E-006		2.4419E-007
	53.16	2.20	8.9274E-007	5.36E-008	2.6670E-007
	79.62	2.62	8.5178E-007		-1.4123E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
BA-133	81.00	34.10	5.7807E-008	5.36E-008	-1.0824E-008
	160.61	0.64	2.8696E-006		4.2189E-006
	223.23	0.45	4.3390E-006		-3.3091E-006
	276.40	7.16	2.7894E-007		8.5359E-009
	302.85	18.33	1.1607E-007		1.1813E-008
	356.02	62.05	5.3555E-008		-1.6372E-007
	383.85	8.94	2.2898E-007		-2.0086E-007
	475.35	1.46	3.3991E-006	5.23E-008	-3.9913E-007
	563.23	8.38	6.0952E-007		-7.2275E-008
	569.32	15.43	3.3739E-007		1.6637E-007
+ CS-134	604.70*	97.60	5.5194E-008		1.4989E-008
	795.84*	85.40	5.2280E-008		4.4372E-008
	801.93	8.73	7.0044E-007		-5.4224E-007
	1038.57	1.00	6.7490E-006		-7.9711E-007
	1167.94	1.80	4.2469E-006		-2.6214E-006
	1365.15*	3.04	1.4234E-006		3.1159E-007
	CS-137	661.66	85.21	2.5861E-008	-1.3351E-008
	CE-139	165.85	79.89	1.8967E-008	3.7266E-009
+ EU-152x	121.78*	28.40	5.2888E-008	5.29E-008	5.2165E-008
	244.70	7.49	2.8808E-007		-1.9642E-007
	344.28*	26.60	5.7823E-008		4.0024E-008
	411.11	2.23	9.6437E-007		5.5213E-007
	443.98	2.78	7.2525E-007		-1.6170E-007
	778.90	12.96	2.0089E-007		5.8606E-009
	867.39	4.15	6.4664E-007		-7.0299E-008
	964.13*	14.34	3.2956E-007		1.9433E-007
	1085.91	9.92	3.1585E-007		-1.5211E-007
	1089.70	1.71	1.8703E-006		-9.4496E-008
EU-154	1112.12	13.55	2.4456E-007		-3.2794E-008
	1212.95	1.40	2.7002E-006		1.3933E-006
	1299.12	1.63	1.9402E-006		1.0649E-006
	1408.01*	20.87	9.5035E-008		1.6590E-007
	123.07	40.40	4.4047E-008	4.40E-008	4.0526E-008
	188.25	0.23	9.7103E-006		-2.0107E-006
	247.93	6.83	2.9200E-007		-4.8052E-007
	401.30	0.19	1.1678E-005		-2.6578E-006
	444.39	0.55	3.9730E-006		-1.4680E-006
	478.26	0.21	1.1576E-005		6.5170E-006
EU-154	557.56	0.25	9.3724E-006		-6.5241E-006
	582.00	0.89	3.9237E-006		1.5521E-005
	591.76	4.91	4.8753E-007		-3.0548E-007
	625.22	0.32	7.7846E-006		-5.2081E-008
	676.59	0.14	1.8846E-005		1.4567E-005
	692.42	1.78	1.5915E-006		8.4011E-007
	715.76	0.17	1.5699E-005		3.3660E-006
	722.30	20.00	1.4674E-007		-1.0853E-007
	756.86	4.50	6.0252E-007		-1.1843E-008
	815.55	0.50	5.3237E-006		1.3015E-006
EU-154	845.39	0.58	4.9127E-006		1.1991E-006
	850.64	0.23	1.2719E-005		6.1022E-006
EU-154	873.20	12.09	2.4410E-007		-8.9822E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
EU-154	892.73	0.50	5.9369E-006	4.40E-008	-3.9812E-006
	904.05	0.85	3.6303E-006		7.5720E-007
	996.30	10.34	3.1409E-007		-5.2863E-008
	1004.76	17.90	1.8011E-007		1.1868E-007
	1128.40	0.29	1.2238E-005		2.5642E-006
	1140.90	0.22	1.6436E-005		-6.5126E-006
	1241.60	0.13	3.6399E-005		-1.0478E-005
	1246.60	0.80	5.0657E-006		-5.5569E-006
	1274.51	34.40	1.0241E-007		-1.8171E-008
	1494.08	0.71	3.4519E-006		-5.1743E-007
	1596.45	1.80	1.6311E-006		-5.4889E-007
	TL-208B	72.80	2.02	1.1090E-006	2.87E-008
		74.97*	3.41	8.6269E-007	
		84.90	1.51	1.2944E-006	
		277.36	6.31	3.1700E-007	
		510.77*	22.60	1.6905E-007	
		583.19*	84.50	3.3663E-008	
		763.13	1.81	1.5876E-006	
		860.56*	12.42	2.1580E-007	
		2614.53*	99.16	2.8733E-008	
		46.52*	4.05	5.5777E-007	5.58E-007
		74.81*	10.50	2.8017E-007	
		77.11*	17.60	1.6617E-007	
		87.30*	7.90	1.9957E-007	
		238.63*	43.60	7.9198E-008	
		300.09*	3.34	5.9844E-007	
	BI-214B	609.31*	44.80	7.1392E-008	7.14E-008
		665.45*	1.29	2.4325E-006	
		768.36*	4.80	5.9498E-007	
		806.17*	1.12	2.3089E-006	
		934.06*	3.03	9.9556E-007	
		1120.29*	14.80	3.2186E-007	
		1155.19	1.64	2.2033E-006	
		1238.11*	5.86	7.0030E-007	
		1280.96	1.44	2.3370E-006	
		1377.67	3.92	7.6579E-007	
		1401.50	1.55	1.9213E-006	
		1407.98*	2.80	7.4626E-007	
	PB-214B	1509.23*	2.12	1.1704E-006	6.88E-008
		1661.28*	1.14	2.2138E-006	
		1729.59*	2.88	7.8428E-007	
		1764.49*	15.36	2.5293E-007	
		1847.42*	2.04	1.1579E-006	
		2118.55*	1.14	1.7155E-006	
		2204.21*	4.86	4.3741E-007	
		2447.86	1.50	1.6636E-006	
		53.23*	1.11	1.4791E-006	
		74.81*	5.90	4.9861E-007	
		77.11*	9.90	2.9541E-007	
		87.30*	4.41	3.5750E-007	
		241.98*	7.50	4.3887E-007	

	Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+	PB-214B	295.21*	18.50	1.4388E-007	6.88E-008	7.0992E-007
		351.92*	35.80	6.8828E-008		6.9362E-007
+	RA-226	186.10*	3.50	5.8424E-007	5.84E-007	1.1772E-006
+	AC-228B	12.95	15.10	1.2439E-007	1.24E-007	0.0000E+000
		16.15	20.00	1.6790E-006		5.9664E-006
		19.11	4.60	4.7754E-006		2.8416E-005
		89.96*	3.40	4.7443E-007		2.8156E-007
		93.35*	5.60	3.1238E-007		4.1891E-007
		99.55	1.30	1.2654E-006		6.1971E-008
		105.36	2.00	8.0505E-007		-6.4090E-007
		129.03*	2.90	5.1759E-007		1.9787E-007
		209.39*	4.10	3.8404E-007		3.4966E-007
		270.26*	3.80	4.4207E-007		4.2689E-007
		328.07*	3.50	5.0172E-007		2.9218E-007
		338.42*	12.40	2.0369E-007		3.5388E-007
		409.62	2.20	1.0431E-006		4.9016E-007
		463.10*	4.60	4.3969E-007		4.9870E-007
		562.65	1.01	2.3373E-006		-4.8701E-008
		755.28	1.32	1.9926E-006		3.4770E-007
		772.28	1.09	2.7787E-006		-1.6951E-006
		794.79*	4.60	4.5063E-007		3.8247E-007
		835.60	1.71	1.6578E-006		-1.5997E-007
		911.16*	29.00	1.2384E-007		3.6938E-007
		964.64*	5.80	8.5840E-007		5.0618E-007
		968.97*	17.40	2.9849E-007		4.1136E-007
		1459.19	1.06	1.0954E-005		1.3648E-004
		1496.00	1.05	2.3240E-006		2.6956E-007
		1588.23*	3.60	7.3820E-007		7.4033E-007
		1630.47	1.95	1.2707E-006		-1.2856E-009
	PA-234B	63.00	3.20	6.5526E-007	7.21E-008	7.5600E-007
		94.67	14.30	1.3077E-007		1.9657E-007
		98.44	23.00	7.2108E-008		-5.6487E-008
		99.70	4.80	3.4264E-007		8.1515E-008
		111.00	10.80	1.5421E-007		9.7611E-008
		125.40	1.00	1.6968E-006		-1.1982E-007
		131.20	20.00	8.6539E-008		7.4436E-008
		152.70	6.70	2.6419E-007		2.7261E-007
		186.00	2.00	1.0999E-006		4.4341E-006
		200.90	1.00	2.0015E-006		2.6911E-007
		202.90	1.20	1.6733E-006		-3.8141E-007
		226.40	5.90	3.4537E-007		1.9175E-007
		227.20	5.50	3.7070E-007		1.9853E-007
		248.90	2.80	6.8903E-007		-3.8690E-007
		272.10	1.00	2.0459E-006		1.0987E-006
		293.70	3.90	7.1766E-007		3.6555E-006
		369.80	2.90	7.1962E-007		1.2002E-007
		372.40	1.30	1.5727E-006		-7.0560E-007
		458.80	1.50	1.4812E-006		1.3344E-007
		506.80	1.60	1.8958E-006		-5.5923E-007
		513.70	1.30	2.5046E-006		-2.2409E-007
		565.90	1.40	1.7269E-006		1.6773E-007

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
PA-234B	568.70	3.30	7.3234E-007	7.21E-008	5.6866E-008
	569.50	10.00	2.4177E-007		1.1922E-007
	574.00	2.00	1.1876E-006		-1.8042E-006
	664.80	1.30	1.9532E-006		-5.1278E-007
	666.70	1.60	1.5728E-006		1.0091E-006
	669.90	1.40	1.7662E-006		-5.0851E-008
	692.70	1.50	1.8270E-006		5.7135E-007
	699.00	4.60	5.9248E-007		2.5955E-007
	706.10	3.10	8.6171E-007		1.8698E-007
	733.00	9.00	3.0143E-007		1.4113E-007
	738.00	1.00	2.5147E-006		-2.3615E-006
	742.81	2.40	1.0934E-006		3.0386E-007
	755.60	1.40	1.8812E-006		2.8458E-007
	780.70	1.10	2.5166E-006		5.7929E-007
	786.27	1.40	1.9096E-006		-2.3880E-006
	793.60	1.50	1.9166E-006		1.1106E-006
	796.30	3.80	7.8208E-007		1.2383E-006
	805.80	3.30	8.2971E-007		-8.2459E-008
	819.60	2.60	9.9808E-007		9.8931E-008
	826.30	4.00	6.4387E-007		-8.0917E-008
	831.60	5.50	4.9043E-007		-1.6702E-007
	876.40	4.00	7.2922E-007		3.6447E-007
	880.50	4.00	7.2378E-007		1.5370E-007
	880.51	9.00	3.2168E-007		6.8312E-008
	883.24	15.00	1.9090E-007		9.7110E-008
	899.00	4.10	7.4940E-007		6.8371E-007
	925.00	2.90	1.0194E-006		2.4656E-007
	926.00	11.00	2.6327E-007		-1.5809E-008
	927.10	11.00	2.7007E-007		7.3471E-008
	946.00	12.00	2.5450E-007		2.4164E-007
	949.00	8.00	3.7757E-007		4.5851E-007
	978.80	1.40	2.2406E-006		1.0624E-006
	980.50	2.00	1.5673E-006		9.7550E-007
	980.50	3.00	1.0448E-006		6.5033E-007
	984.00	1.90	1.6338E-006		4.5651E-008
	1353.30	1.70	1.5263E-006		-1.4107E-006
	1394.10	3.00	8.4235E-007		-1.1945E-006
	1452.70	1.00	3.1833E-006		-1.0275E-005
	1668.50	1.20	1.7071E-006		2.5018E-007
	1694.60	1.20	1.7845E-006		8.7312E-008
TH-234	63.29	4.50	5.0533E+006	5.05E+006	4.9321E+006
	92.38	2.60	8.2775E+006		3.4568E+007
	92.80	2.60	8.2194E+006		3.1949E+007
U-235	72.70	0.11	1.6693E-005	3.55E-008	-2.5506E-006
	89.95*	2.80	4.7200E-007		2.8012E-007
	93.35*	4.50	3.1850E-007		4.2711E-007
	94.00	0.40	3.8695E-006		2.3803E-006
	105.00	2.10	6.2862E-007		-2.9521E-007
	109.16	1.50	8.9941E-007		-6.7060E-008
	140.76	0.22	6.4154E-006		4.1898E-007
	143.76*	10.90	1.3725E-007		-4.6871E-008

Nuclide Name	Energy (keV)	Yield (%)	Line MDA (uCi/g)	Nuclide MDA (uCi/g)	Activity (uCi/g)
+ U-235	163.33	5.00	3.0016E-007	3.55E-008	-1.0624E-007
	182.61	0.40	4.2747E-006		7.2673E-008
	185.71*	57.50	3.5518E-008		7.1566E-008
	194.94	0.59	2.7465E-006		1.3752E-006
	202.11	1.00	1.6475E-006		-6.0269E-007
	205.31	5.00	3.3227E-007		-7.3465E-008
	279.50	0.27	6.0267E-006		1.6219E-006

+ = Nuclide identified during the nuclide identification

* = Energy line found in the spectrum

> = MDA value not calculated

@ = Half-life too short to be able to perform the decay correction

APPENDIX J

**UNIVERSITY OF MICHIGAN
FORD NUCLEAR REACTOR**

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

UM-2009-02-01 (4)
Um-2009-02-02 (5)
Um-2009-02-06-03 (6)
Um-2009-02-06-04 (7)

University of Michigan

Phoenix Memorial Lab

STANDARD LEVEL IV REPORT OF ANALYSIS

WORK ORDER #09-02104-OR

March 3, 2009

**EBERLINE ANALYTICAL
OAK RIDGE LABORATORY
OAK RIDGE, TN**

001

UM-2009-02-06-02

TABLE OF CONTENTS

SECTION	DESCRIPTION	PAGE
I	Chain Of Custody	004
II	Sample Acknowledgement	008
III	Case Narrative	011
IV	Analytical Results Summary	014
V	Analytical Standard	017
VI	Quality Control Sample Results Summary	020
VII	Laboratory Technician's Notes	025
VIII	Analytical Data (Iron-55)	031
IX	Analytical Data (Gamma Spectroscopy)	146
	Last page	286



EBERLINE ANALYTICAL CORPORATION
601 SCARBORO ROAD
OAK RIDGE, TENNESSEE 37830
PHONE (865) 481-0683
FAX (865) 483-4621

EBS-OR-28435

March 3, 2009

Chris Becker
University of Michigan
Phoenix Memorial Lab
2301 Bonisteel Blvd.
Ann Arbor, MI 48109

CASE NARRATIVE
Work Order # 09-02104-OR

SAMPLE RECEIPT

This work order contains four soil samples received 2/23/2009. These samples were analyzed for Iron-55 and by Gamma Spectroscopy.

<u>CLIENT ID</u>	<u>LAB ID</u>	<u>CLIENT ID</u>	<u>LAB ID</u>
UM-2008-12-17-01	09-02104-04	UM-2009-02-06-03	09-02104-06
UM-2009-02-06-02	09-02104-05	UM-2009-02-06-04	09-02104-07

ANALYTICAL METHODS

Iron-55 was performed using EML Method E-Fe-01-01 modified. Gamma Spectroscopy was performed using Method LANL ER-130 Modified.

ANALYTICAL RESULTS

Combined Standard Uncertainty is reported at 2-sigma value.

IRON-55

A representative aliquot from each sample was placed into a Petri geometry container. Samples were then counted on a planar low energy photon spectroscopy (LEPS) detector.

Samples demonstrated non-detect equivalent results for Iron-55 activity. Results for the Iron-55 method blank demonstrated non-detect equivalent activity. Results for the Iron-55 replicate demonstrated a high relative percent difference; however, normalized difference is within acceptable limits for the analytical technique. Results for the Americium-241 and Cobalt-57 laboratory control sample demonstrated an acceptable percent recovery.

GAMMA SPECTROSCOPY

Samples for Gamma Spectroscopy analysis were prepared by transferring a known mass/aliquot of each prepared and homogenized sample to a standard geometry container. Samples were counted on High Purity Germanium (HPGe) gamma ray detectors.

ANALYTICAL RESULTS CONTINUED

GAMMA SPECTROSCOPY continued

Samples demonstrated non-detect equivalent results for Cerium-139, Cobalt-60, Cesium-134, Europium-152, Europium-154 and Manganese-54 activity. Results for the method blank demonstrated non-detect equivalent activity for all gamma-emitting radionuclides as reported. Results for the Cobalt-60, Cesium-134 and Europium-154 replicate demonstrated a high relative percent difference; however, normalized difference is within acceptable limits for the analytical technique. Results for the Cobalt-60 and Cesium-137 laboratory control sample demonstrated an acceptable percent recovery.

CERTIFICATION OF ACCURACY

I certify that this data report is in compliance with the terms and conditions of the Purchase Order, both technically and for completeness, for other than the conditions detailed above. Release of the data contained in this hard copy data package has been authorized by the cognizant project manager or his/her designee to be accurate as verified by the following signature.

M.R. McDougal
Laboratory Manager

Date: 3/3/2009

Eberline Analytical Final Report of Analysis		Report To:					Work Order Details:						
		Chris Becker					SDG:	09-02104					
		Phoenix Memorial Lab					Purchase Order:	5000002634					
		2301 Bonlsteel Blvd.					Analysis Category:	ENVIRONMENTAL					
		Ann Arbor, MI 48109					Sample Matrix:	SO					
Lab. ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
09-02104-01	LCS	KNOWN	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Americium-241	EML Fe-01-01 Modified	3.73E+03	1.16E+02			pCi/g
09-02104-01	LCS	KNOWN	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-57	EML Fe-01-01 Modified	1.18E+03	3.31E+01			pCi/g
09-02104-01	LCS	SPIKE	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Americium-241	EML Fe-01-01 Modified	3.62E+03	4.35E+02	4.35E+02	4.91E+00	pCi/g
09-02104-01	LCS	SPIKE	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-57	EML Fe-01-01 Modified	1.33E+03	1.35E+02	1.35E+02	4.80E+00	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	4.29E+00	8.18E+00	8.18E+00	9.13E+00	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	-7.20E-01	2.54E+00	2.54E+00	3.86E+00	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	-5.29E-01	2.43E+00	2.43E+00	3.89E+00	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	-1.46E+00	3.24E+00	3.24E+00	3.87E+00	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	-3.86E-01	2.07E+00	2.07E+00	3.37E+00	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Iron-55	EML Fe-01-01 Modified	-4.72E-01	2.55E+00	2.55E+00	4.16E+00	pCi/g
								LANL ER-130 Modified	1.23E+02	3.39E+00			pCi/g
09-02104-01	LCS	KNOWN	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	7.64E+01	2.22E+00			pCi/g
09-02104-01	LCS	KNOWN	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-137	LANL ER-130 Modified	1.30E+02	6.04E+00	8.04E+00	5.22E-01	pCi/g
09-02104-01	LCS	SPIKE	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	8.15E+01	5.30E+00	5.30E+00	4.71E-01	pCi/g
09-02104-01	LCS	SPIKE	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-137						
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	-5.06E-03	1.76E-02	1.76E-02	3.06E-02	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	-3.98E-03	3.63E-02	3.63E-02	6.69E-02	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	1.92E-02	3.02E-02	3.02E-02	5.60E-02	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	-4.75E-02	1.70E-01	1.70E-01	3.46E-01	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	-1.11E-02	8.19E-02	8.19E-02	1.68E-01	pCi/g
09-02104-02	MBL	BLANK	02/24/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	1.42E-02	2.83E-02	2.83E-02	5.88E-02	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	-1.48E-02	2.81E-02	2.81E-02	4.60E-02	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	2.56E-02	3.11E-02	3.11E-02	5.97E-02	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	1.33E-03	2.30E-02	2.30E-02	3.83E-02	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	-6.92E-02	2.08E-01	2.08E-01	3.14E-01	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	1.65E-02	7.33E-02	7.33E-02	1.36E-01	pCi/g
09-02104-03	DUP	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	2.06E-02	2.71E-02	2.71E-02	5.22E-02	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
 SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Eberline Analytical Final Report of Analysis		Report To:				Work Order Details:							
		Chris Becker Phoenix Memorial Lab 2301 Bonisteel Blvd. Ann Arbor, MI 48109				SDG:	09-02104						
						Purchase Order:	5000002634						
						Analysis Category:	ENVIRONMENTAL						
						Sample Matrix:	SO						
Lab ID	Sample Type	Client ID	Sample Date	Receipt Date	Analysis Date	Batch ID	Analyte	Method	Result	CU	CSU	MDA	Report Units
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	1.30E-02	2.78E-02	2.78E-02	4.83E-02	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	1.60E-03	2.77E-02	2.77E-02	5.04E-02	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	5.21E-03	2.57E-02	2.57E-02	4.30E-02	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	2.19E-01	2.23E-01	2.23E-01	3.17E-01	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	2.12E-02	8.37E-02	8.37E-02	1.53E-01	pCi/g
09-02104-04	DO	UM-2008-12-17-01	01/09/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	2.14E-02	2.82E-02	2.82E-02	4.82E-02	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	-1.60E-02	2.34E-02	2.34E-02	3.87E-02	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	7.64E-02	3.19E-02	3.19E-02	6.51E-02	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	1.79E-02	3.03E-02	3.03E-02	5.38E-02	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	5.10E-01	1.19E-01	1.19E-01	3.58E-01	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	-7.99E-02	1.08E-01	1.08E-01	1.77E-01	pCi/g
09-02104-05	TRG	UM-2009-02-06-02	02/11/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	-2.30E-04	2.90E-02	2.90E-02	5.38E-02	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	1.25E-02	4.03E-02	4.03E-02	7.04E-02	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	7.07E-02	8.29E-02	8.29E-02	1.58E-01	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	1.87E-02	6.21E-02	6.21E-02	1.00E-01	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	9.04E-01	5.11E-01	5.11E-01	1.00E+00	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	-4.91E-02	1.81E-01	1.81E-01	2.89E-01	pCi/g
09-02104-06	TRG	UM-2009-02-06-03	02/17/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	2.02E-02	6.08E-02	6.08E-02	1.11E-01	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Cerium-139	LANL ER-130 Modified	-1.17E-02	4.08E-02	4.08E-02	6.93E-02	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Cobalt-60	LANL ER-130 Modified	-4.62E-02	8.18E-02	8.18E-02	1.32E-01	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Cesium-134	LANL ER-130 Modified	7.58E-03	5.90E-02	5.90E-02	9.38E-02	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-152	LANL ER-130 Modified	3.87E-01	3.45E-01	3.45E-01	7.89E-01	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Europium-154	LANL ER-130 Modified	-6.13E-03	1.81E-01	1.81E-01	3.09E-01	pCi/g
09-02104-07	TRG	UM-2009-02-06-04	02/13/09 00:00	2/23/2009	2/24/2009	09-02104	Manganese-54	LANL ER-130 Modified	5.79E-03	6.36E-02	6.36E-02	1.13E-01	pCi/g

CU=Counting Uncertainty; CSU=Combined Standard Uncertainty (2-sigma); MDA=Minimal Detected Activity; LCS=Laboratory Control Sample; MBL=Blank; DUP=Duplicate; TRG=Normal Sample; DO=Duplicate Original


EBERLINE
 SERVICES

EBERLINE ANALYTICAL CORPORATION

601 SCARBORO ROAD OAK RIDGE, TN 37830 865/481-0683 FAX 865/483-4621

Preliminary Data Report & Analytical Calculations
Work Order: 09-02104-Fe055-1

Printed: 2/25/2009 10:05 AM
Page 1 of 1

Lab Fraction	Nuclide	Sample Desc	Client Identification	Activity Units	Results	Error Estimate	MDA	LSC Known	LCS %R	LCS Flag	RPD Flag	Sample Date	Sample Aliquot	Counting Date/Time	Identified
01	AM-241	LCS	LCS	pCi/g	3.62E+03	4.35E+02	4.91E+00	3.73E+03	97.12	OK		02/24/09 00:00	1.00E+00	02/24/09 12:48	YES
01	CO-57	LCS	LCS	pCi/g	1.33E+03	1.35E+02	4.80E+00	1.18E+03	112.24	OK		02/24/09 00:00	1.00E+00	02/24/09 12:48	YES
02	FE-55	MBL	BLANK	pCi/g	4.29E+00	8.18E+00	9.13E+00					02/24/09 00:00	1.00E+00	02/24/09 13:22	NO
03	FE-55	DUP	UM-2008-12-17-01	pCi/g	-7.20E-01	2.54E+00	3.88E+00				OK	01/09/09 00:00	2.97E+01	02/24/09 14:22	NO
04	FE-55	DO	UM-2008-12-17-01	pCi/g	-5.29E-01	2.43E+00	3.88E+00					01/09/09 00:00	2.97E+01	02/24/09 15:24	NO
05	FE-55	TRG	UM-2009-02-06-02	pCi/g	-1.46E+00	3.24E+00	3.87E+00					02/11/09 00:00	3.05E+01	02/24/09 16:30	NO
06	FE-55	TRG	UM-2009-02-06-03	pCi/g	-3.86E-01	2.07E+00	3.37E+00					02/17/09 00:00	3.81E+01	02/24/09 17:30	NO
07	FE-55	TRG	UM-2009-02-06-04	pCi/g	-4.72E-01	2.55E+00	4.16E+00					02/13/09 00:00	2.86E+01	02/24/09 18:33	NO

Preliminary Data Report & Analytical Calculations
Work Order: 09-02104-Gamma-1

Printed: 2/25/2009 1:31 PM
Page 1 of 1

Lab Fraction	Nuclide	Sample Desc	Client Identification	Activity Units	Results	Error Estimate	MDA	LSC Known	LCS %R	LCS Flag	RPD Flag	Sample Date	Sample Aliquot	Counting Date/Time	Identified
01	CO-60	LCS	LCS	pCi/g	1.30E+02	6.04E+00	5.22E-01	1.23E+02	105.11	OK		02/24/09 00:00	1.00E+00	02/24/09 14:56	YES
01	CS-137	LCS	LCS	pCi/g	6.16E+01	5.30E+00	4.71E-01	7.64E+01	108.69	OK		02/24/09 00:00	1.00E+00	02/24/09 14:56	YES
02	CE-139	MBL	BLANK	pCi/g	-5.06E-03	1.76E-02	3.06E-02					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
02	CO-60	MBL	BLANK	pCi/g	-3.98E-03	3.63E-02	6.68E-02					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
02	CS-134	MBL	BLANK	pCi/g	1.92E-02	3.02E-02	5.60E-02					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
02	EU-152	MBL	BLANK	pCi/g	-4.75E-02	1.70E-01	3.46E-01					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
02	EU-154	MBL	BLANK	pCi/g	-1.11E-02	8.19E-02	1.68E-01					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
02	MN-54	MBL	BLANK	pCi/g	1.42E-02	2.83E-02	5.88E-02					02/24/09 00:00	1.00E+00	02/24/09 14:37	NO
03	CE-139	DUP	UM-2008-12-17-01	pCi/g	-1.48E-02	2.81E-02	4.66E-02					01/09/09 00:00	7.17E+02	02/24/09 15:28	NO
03	CO-60	DUP	UM-2008-12-17-01	pCi/g	2.56E-02	3.11E-02	5.97E-02			INV		01/09/09 00:00	7.17E+02	02/24/09 15:28	NO
03	CS-134	DUP	UM-2008-12-17-01	pCi/g	1.33E-03	2.30E-02	3.83E-02			INV		01/09/09 00:00	7.17E+02	02/24/09 15:28	
03	EU-152	DUP	UM-2008-12-17-01	pCi/g	-8.82E-02	2.08E-01	3.14E-01					01/09/09 00:00	7.17E+02	02/24/09 15:28	NO
03	EU-154	DUP	UM-2008-12-17-01	pCi/g	1.65E-02	7.33E-02	1.38E-01			OK		01/09/09 00:00	7.17E+02	02/24/09 15:28	NO
03	MN-54	DUP	UM-2008-12-17-01	pCi/g	2.06E-02	2.71E-02	5.22E-02					01/09/09 00:00	7.17E+02	02/24/09 15:28	NO
04	CE-139	DO	UM-2008-12-17-01	pCi/g	1.30E-02	2.78E-02	4.83E-02					01/09/09 00:00	7.17E+02	02/24/09 16:33	NO
04	CO-60	DO	UM-2008-12-17-01	pCi/g	1.60E-03	2.77E-02	5.04E-02					01/09/09 00:00	7.17E+02	02/24/09 16:33	NO
04	CS-134	DO	UM-2008-12-17-01	pCi/g	5.21E-03	2.57E-02	4.30E-02					01/09/09 00:00	7.17E+02	02/24/09 16:33	NO
04	EU-152	DO	UM-2008-12-17-01	pCi/g	2.19E-01	2.23E-01	3.17E-01					01/09/09 00:00	7.17E+02	02/24/09 16:33	NO
04	EU-154	DO	UM-2008-12-17-01	pCi/g	2.12E-02	8.37E-02	1.53E-01					01/09/09 00:00	7.17E+02	02/24/09 16:33	NO
04	MN-54	DO	UM-2008-12-17-01	pCi/g	2.14E-02	2.82E-02	4.82E-02					01/09/09 00:00	7.17E+02	02/24/09 16:33	YES
05	CE-139	TRG	UM-2009-02-06-02	pCi/g	-1.60E-02	2.34E-02	3.87E-02					02/11/09 00:00	6.73E+02	02/24/09 15:27	NO
05	CO-60	TRG	UM-2009-02-06-02	pCi/g	7.84E-02	3.19E-02	6.51E-02					02/11/09 00:00	6.73E+02	02/24/09 15:27	YES
05	CS-134	TRG	UM-2009-02-06-02	pCi/g	1.79E-02	3.03E-02	5.38E-02					02/11/09 00:00	6.73E+02	02/24/09 15:27	NO
05	EU-152	TRG	UM-2009-02-06-02	pCi/g	5.10E-01	1.19E-01	3.58E-01					02/11/09 00:00	6.73E+02	02/24/09 15:27	YES
05	EU-154	TRG	UM-2009-02-06-02	pCi/g	-7.89E-02	1.08E-01	1.77E-01					02/11/09 00:00	6.73E+02	02/24/09 15:27	NO
05	MN-54	TRG	UM-2009-02-06-02	pCi/g	-2.30E-04	2.90E-02	5.38E-02					02/11/09 00:00	6.73E+02	02/24/09 15:27	NO
06	CE-139	TRG	UM-2009-02-06-03	pCi/g	1.25E-02	4.03E-02	7.04E-02					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
06	CO-60	TRG	UM-2009-02-06-03	pCi/g	7.07E-02	8.29E-02	1.58E-01					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
06	CS-134	TRG	UM-2009-02-06-03	pCi/g	1.87E-02	6.21E-02	1.00E-01					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
06	EU-152	TRG	UM-2009-02-06-03	pCi/g	9.04E-01	5.11E-01	1.00E+00					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
06	EU-154	TRG	UM-2009-02-06-03	pCi/g	-4.91E-02	1.61E-01	2.89E-01					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
06	MN-54	TRG	UM-2009-02-06-03	pCi/g	2.02E-02	6.08E-02	1.11E-01					02/17/09 00:00	6.82E+02	02/24/09 15:38	NO
07	CE-139	TRG	UM-2009-02-06-04	pCi/g	-1.17E-02	4.08E-02	6.93E-02					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO
07	CO-60	TRG	UM-2009-02-06-04	pCi/g	-4.62E-02	8.18E-02	1.32E-01					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO
07	CS-134	TRG	UM-2009-02-06-04	pCi/g	7.56E-03	5.90E-02	8.39E-02					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO
07	EU-152	TRG	UM-2009-02-06-04	pCi/g	3.87E-01	3.48E-01	7.88E-01					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO
07	EU-154	TRG	UM-2009-02-06-04	pCi/g	-6.13E-03	1.81E-01	3.08E-01					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO
07	MN-54	TRG	UM-2009-02-06-04	pCi/g	5.79E-03	6.36E-02	1.13E-01					02/13/09 00:00	6.61E+02	02/24/09 16:39	NO

APPENDIX K

UNIVERSITY OF MICHIGAN FORD NUCLEAR REACTOR

FINAL DISPOSITION OF THE STORAGE PORTS

**DATED: FEBRUARY 24, 2012
SUBMITTED: SEPTEMBER 18, 2012**

June 1, 2009

Mr. Jeremy Tapp
U.S. Nuclear Regulatory Commission
Region III
2443 Warrenville Road
Lisle, IL 60532-4351

SUBJECT: ORISE CONTRACT NO. DE-AC05-06OR23100
**LETTER REPORT FOR ANALYTICAL RESULTS FOR TWO SOIL
SAMPLES AND ONE CONCRETE SAMPLE FROM THE FORD
REACTOR AT THE UNIVERSITY OF MICHIGAN, ANN ARBOR,
MICHIGAN
[05000002/2009002] (RFTA NO. 09-001)
DCN: 1790-LR-01-0**

Dear Mr. Tapp:

The Oak Ridge Institute for Science and Education (ORISE) received two soil samples and one concrete sample on March 26, 2009. The samples were associated with the Ford Reactor at the University of Michigan in Ann Arbor, Michigan. The samples were analyzed by gamma spectroscopy for cobalt-60 with a requested detection limit of 0.4 pCi/g and for europium-152 with a requested detection limit of 1.0 pCi/g. Iron-55(Fe-55) analysis was also requested with a detection limit of 1,000 pCi/g. The sample identifications are presented in Table 1, the data for gamma spectroscopy are presented in Table 2, and the Fe-55 data are presented in Table 3. The pertinent procedure references are included with the respective data tables.

This letter report was delayed due to analytical problems associated with the Fe-55 analysis. We apologize for the delay, but we believe this was necessary to achieve more defensible analytical results.

ORISE's Quality Control (QC) requirements were met for these analyses. The QC files are available for your review upon request.

My contact information is listed below. You may also contact Wade Ivey at 865.576.9184 with any questions or comments.

Sincerely,

Dale Condra, Manager
Laboratory

RDC:WPI:bf

Enclosures

c: T. Carter, NRC/FSME/DWMEP 7J18
T. Patterson, NRC/FSME/TWFN 8D42
W. Snell, NRC Region III

E. Abelquist, ORISE
T. Vitkus, ORISE
File 1790

Distribution approval and concurrence :	Initials
Technical Review	<i>DCN</i>
Quality Review	<i>TLB</i>

TABLE 1

**SAMPLE IDENTIFICATIONS
AND COLLECTION DATA
FORD REACTOR
UNIVERSITY OF MICHIGAN
ANN ARBOR, MICHIGAN**

ORISE Sample ID	NRC Region III Sample ID	Collection Date	Collection Time
1790S0001	UOM-09-1-01	3/25/2009	11:12 AM
1790S0002	UOM-09-1-02	3/25/2009	11:27 AM
1790M0001	UOM-09-1-03	3/25/2009	12:15 PM

TABLE 2

**CONCENTRATIONS OF SELECTED
GAMMA EMITTING RADIONUCLIDES
IN SOIL AND CONCRETE SAMPLES
BY GAMMA SPECTROSCOPY CP1, REVISION 16**

**FORD REACTOR
UNIVERSITY OF MICHIGAN
ANN ARBOR, MICHIGAN**

ORISE Sample ID	NRC Region III Sample ID	Radionuclide Concentrations, TPUs, and MDCs ^a (pCi/g)	
		Co-60	Eu-152
1790S0001	UOM-09-1-01	0.03 ± 0.03 ^b , 0.03	0.02 ± 0.01, 0.03
1790S0002	UOM-09-1-02	0.01 ± 0.02, 0.03	0.06 ± 0.02, 0.04
1790M0001	UOM-09-1-03	0.04 ± 0.03, 0.05	0.08 ± 0.03, 0.06

^aThe MDCs are after the comma.

^bUncertainties represent the 95% confidence level, based on total propagated uncertainties.

TABLE 3

CONCENTRATIONS OF IRON-55
IN SOIL AND CONCRETE SAMPLES
BY LIQUID SCINTILLATION ANALYSIS
AP16, REVISION 1; CP4, REVISION 3
FORD REACTOR
UNIVERSITY OF MICHIGAN
ANN ARBOR, MICHIGAN

ORISE Sample ID	NRC Region III Sample ID	Fe-55 Concentrations, TPUs, and MDCs^a (pCi/g wet weight)			
1790S0001	UOM-09-1-01	0.3	±	1.4 ^b	, 2.4
1790S0002	UOM-09-1-02	0.7	±	1.4	, 2.4
1790M0001	UOM-09-1-03	0.7	±	1.3	, 2.3

^aThe MDCs are after the comma.

^bUncertainties represent the 95% confidence level, based on total propagated uncertainties.