NRC Public Meeting

Monticello March 31, 2014



Monticello Presenters

- Timothy O'Connor, Senior Vice President and Chief Nuclear Officer
- Karen Fili, Site Vice President
- Peter Gardner, Director, Site Operations
- Harlan Hanson, Plant Manager
- Mark Lingenfelter, Director, Site Engineering



Agenda

- Monticello Values and Priorities
- Monticello Investing in Safe and Reliable Operations for the Future
- NRC-Issued Flooding Mitigation Yellow Finding
- Human Performance
- Dry Fuel Storage
- Closing Remarks



Monticello Values and Priorities









Community





Monticello - Investing in Safe and Reliable Operations for the Future

- Main transformer
- Main generator
- Steam dryer
- 13.8 Kv electrical system
- Reactor feed pumps
- Condensate pumps
- Feedwater heaters




NRC-Issued Flooding Mitigation Yellow Finding

Most significant issue at the site:

- From February 2012 through February 2013, Monticello did not maintain flood mitigation procedures such that timely implementation could be accomplished
- Compliant since February 2013
- How did we improve?
 - Safety Culture
 - Physical barriers





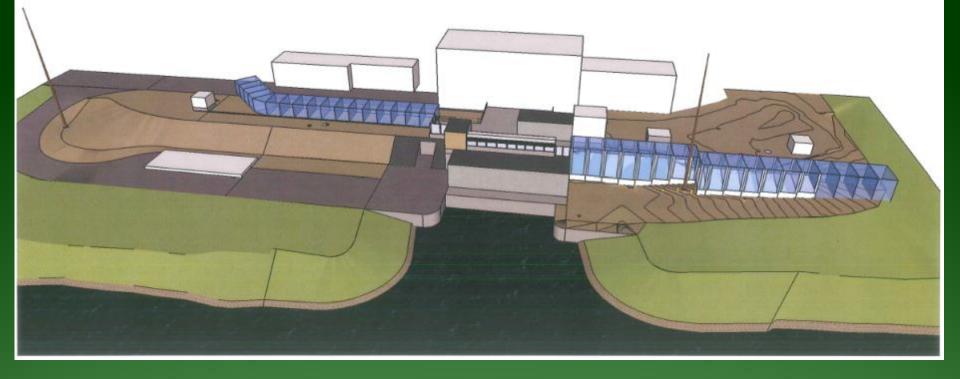






Human Performance and Decision Making

- Leadership training and mentoring
- Increased management presence in the field
- Supplemental worker oversight
- Safety performance improvement
- Working Level Safety Committee



Monticello Dry Fuel Storage

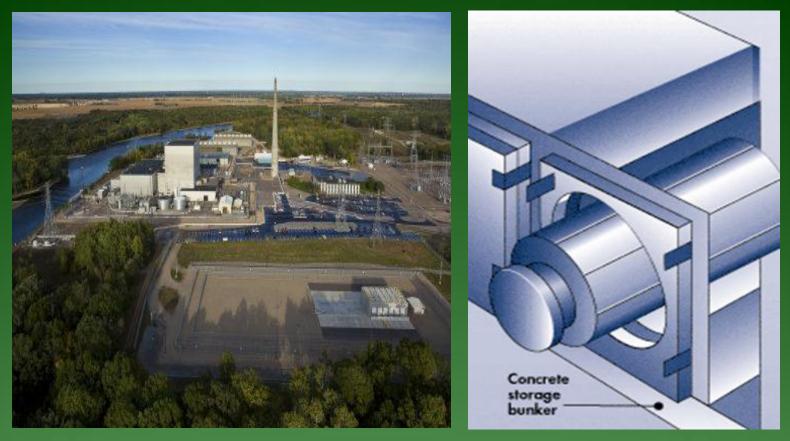



Monticello Dry Fuel Storage

- In 2013, Monticello suspended loading when NRC inspector identified issue with weld inspection
- Affects five canisters in ISFSI and one inside the plant
- Canisters' integrity demonstrated by testing and condition poses no risk to health and safety of employees or public
- Issue resolution team led by senior level manager
- Recent learnings around decision making applied
- Continue to dialogue with NRC on resolution



Summary

Site Vice President's closing remarks





RESPONSIBLE BY NATURE®