


CAUTION
1) Block Obstacles 2) Slip/Trip Hazards
3) Hot Pipe/Surfaces 4) Burn/Chemical Burns
5) Other (List) 6) Hazardous Areas
DO NOT OPERATE THIS EQUIPMENT UNLESS YOU ARE TRAINED AND CERTIFIED TO DO SO.
KAMAD
36

CAUTION
BE DEPLOYED
DURING A
TEST. DO NOT
ENTER THIS AREA
UNLESS YOU ARE TRAINED AND CERTIFIED TO DO SO.

KAMAD
36

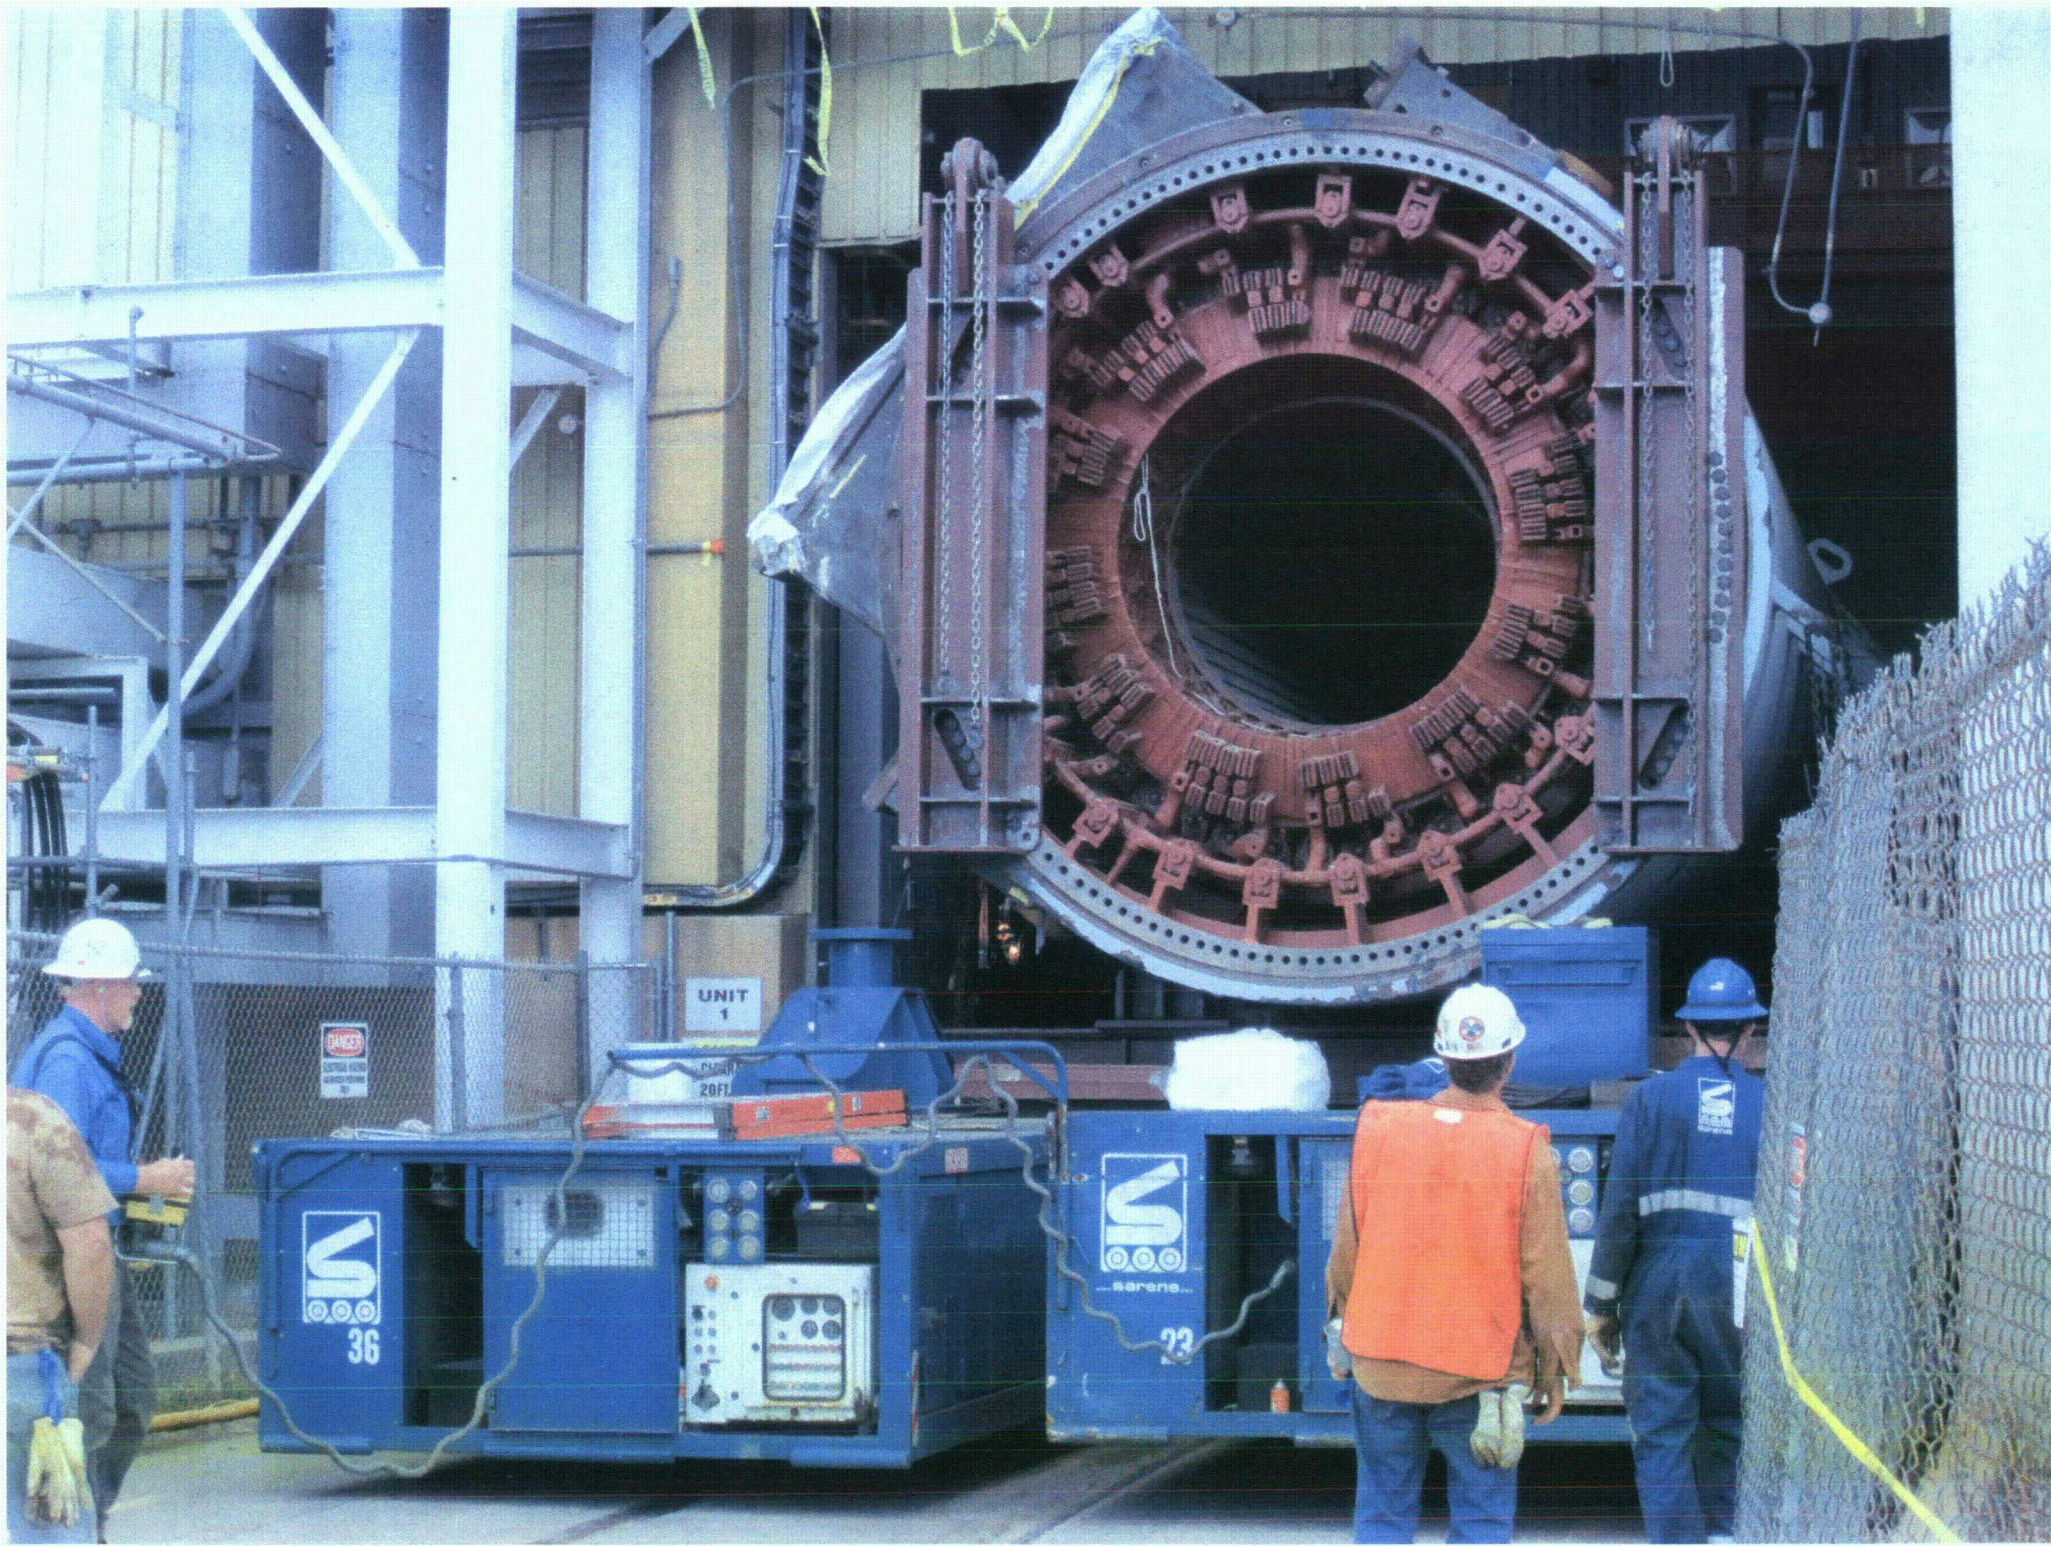

UNIT
1

20FT


SARENS
36

SARENS


22







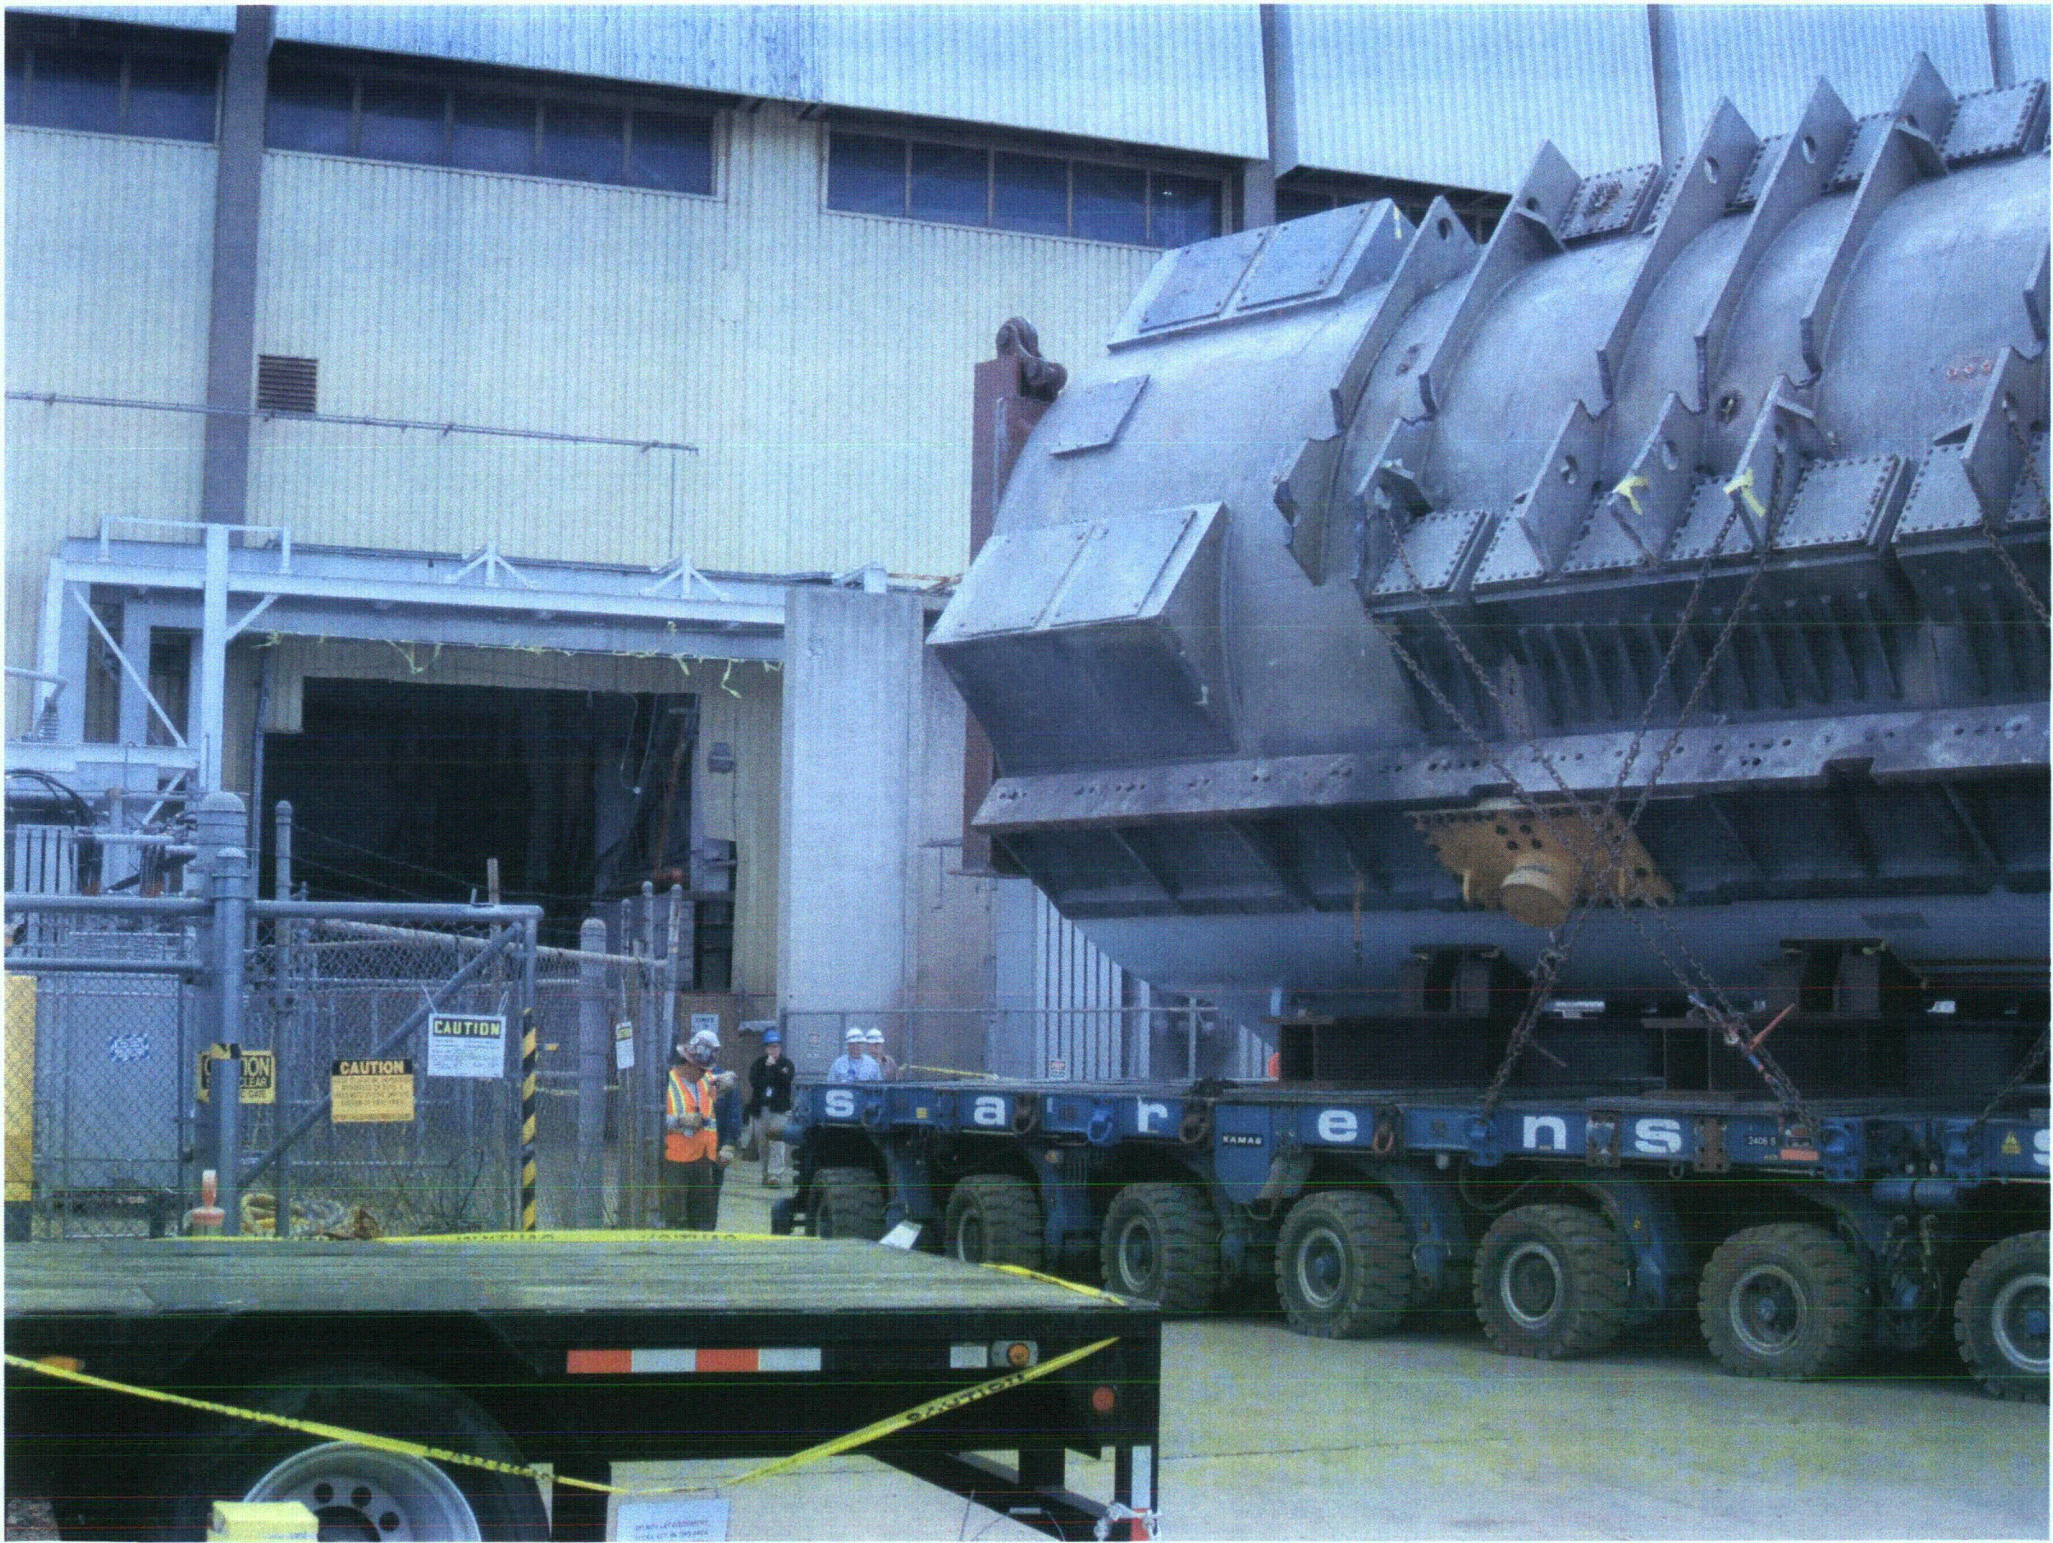



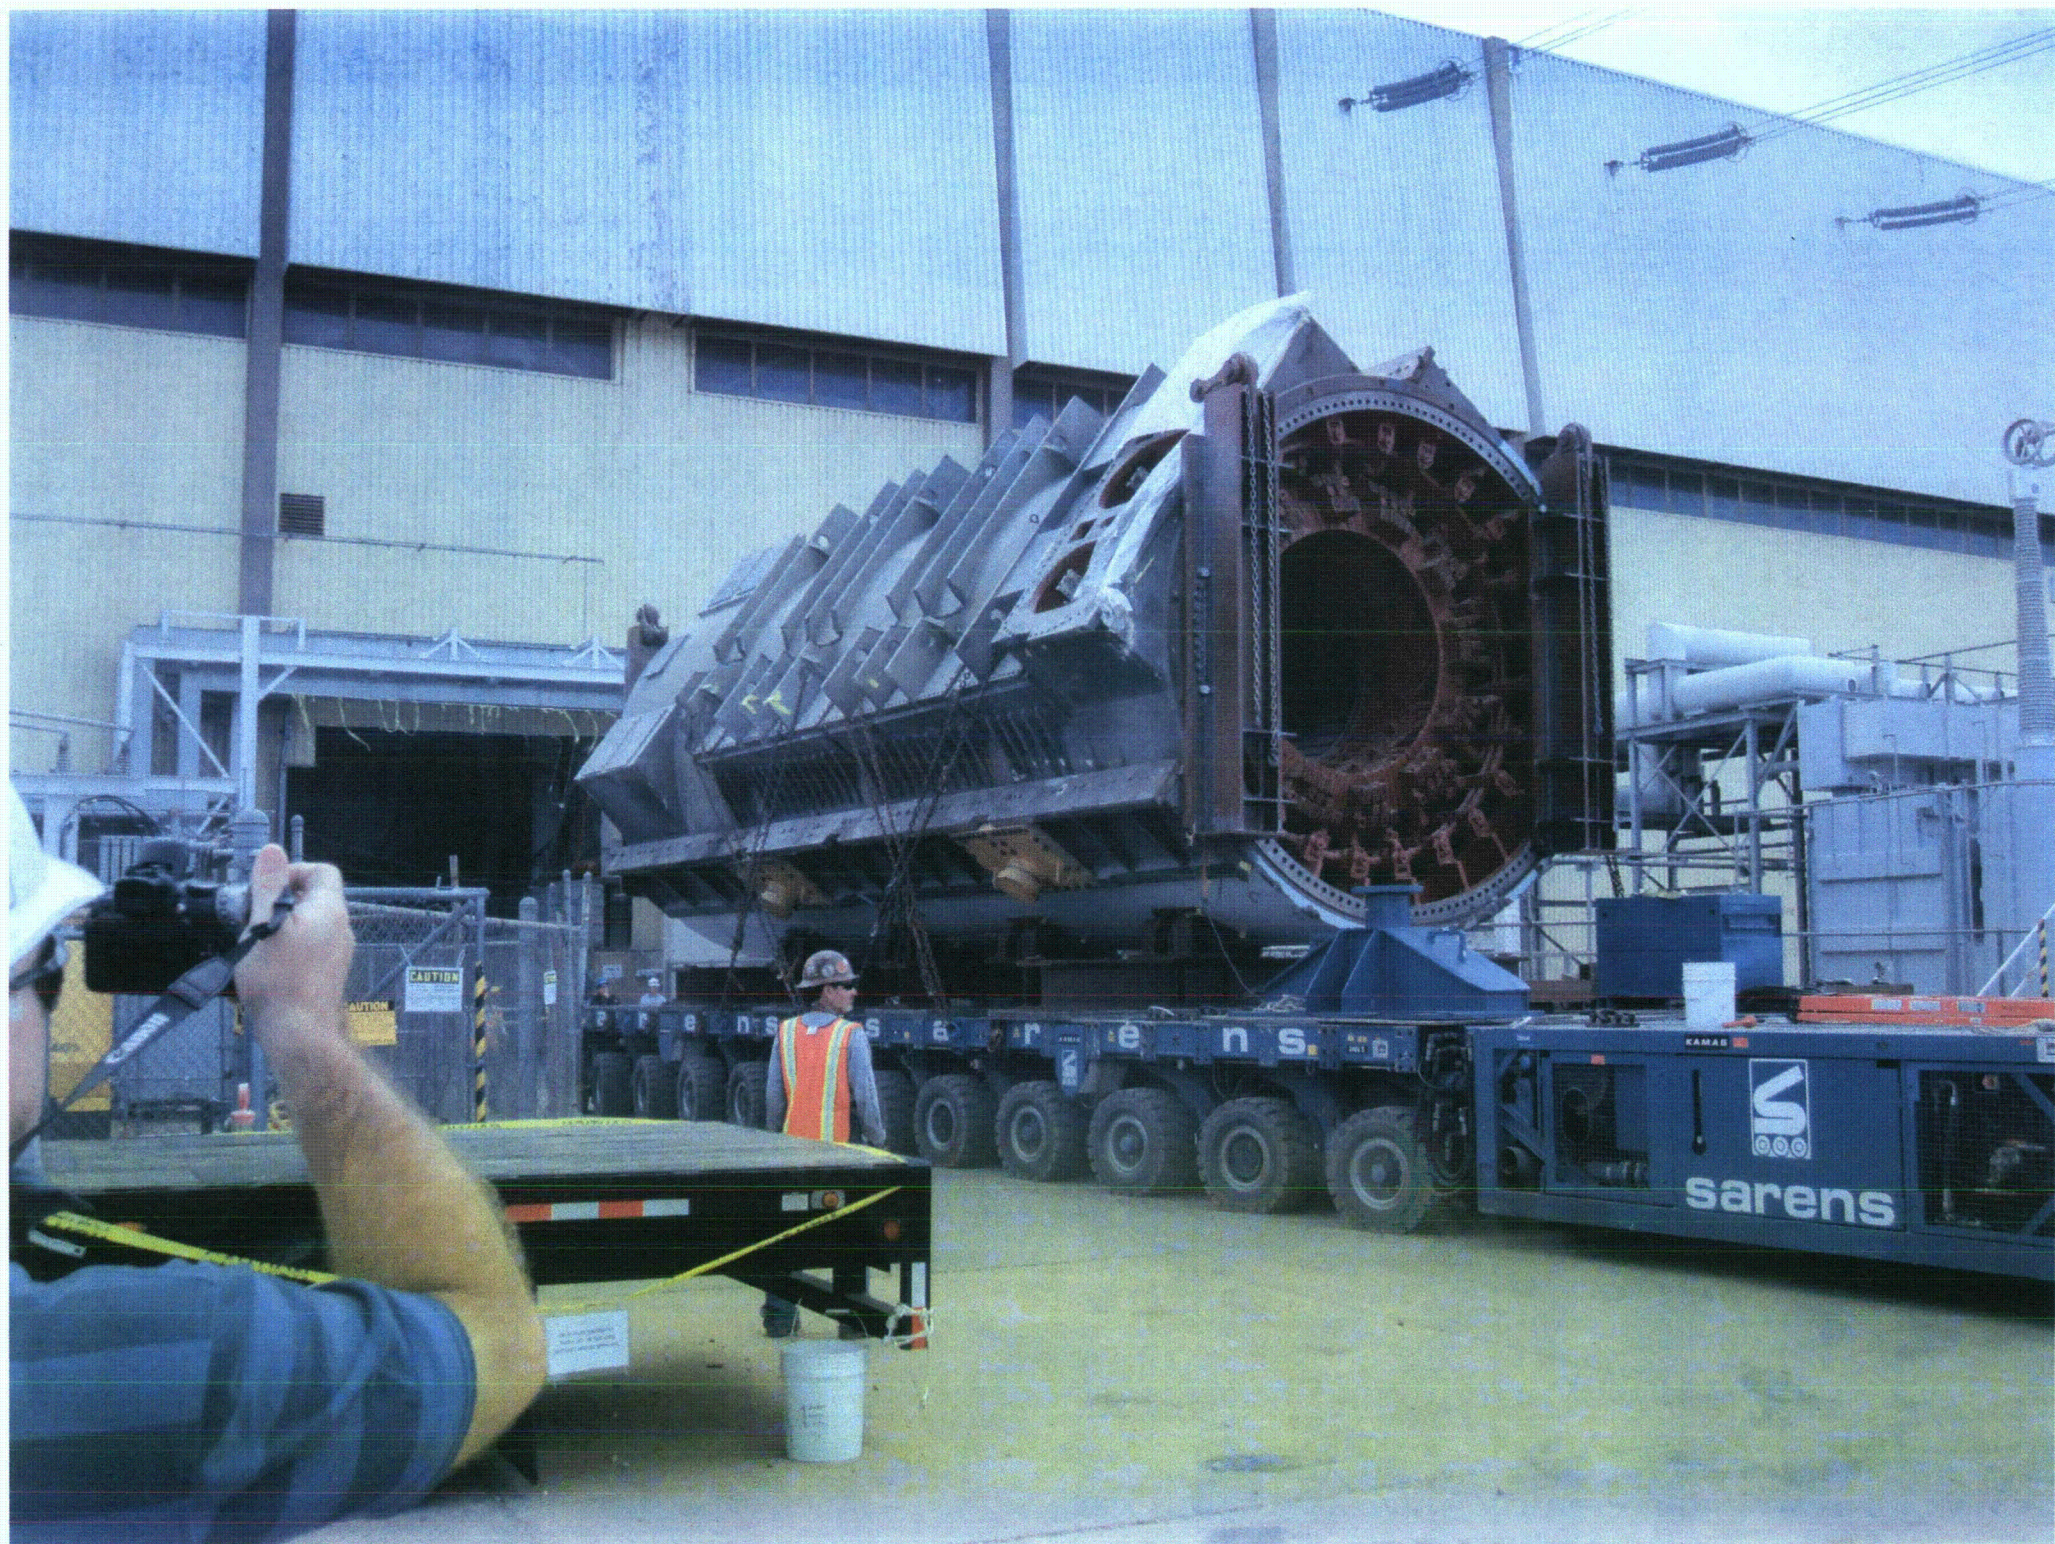

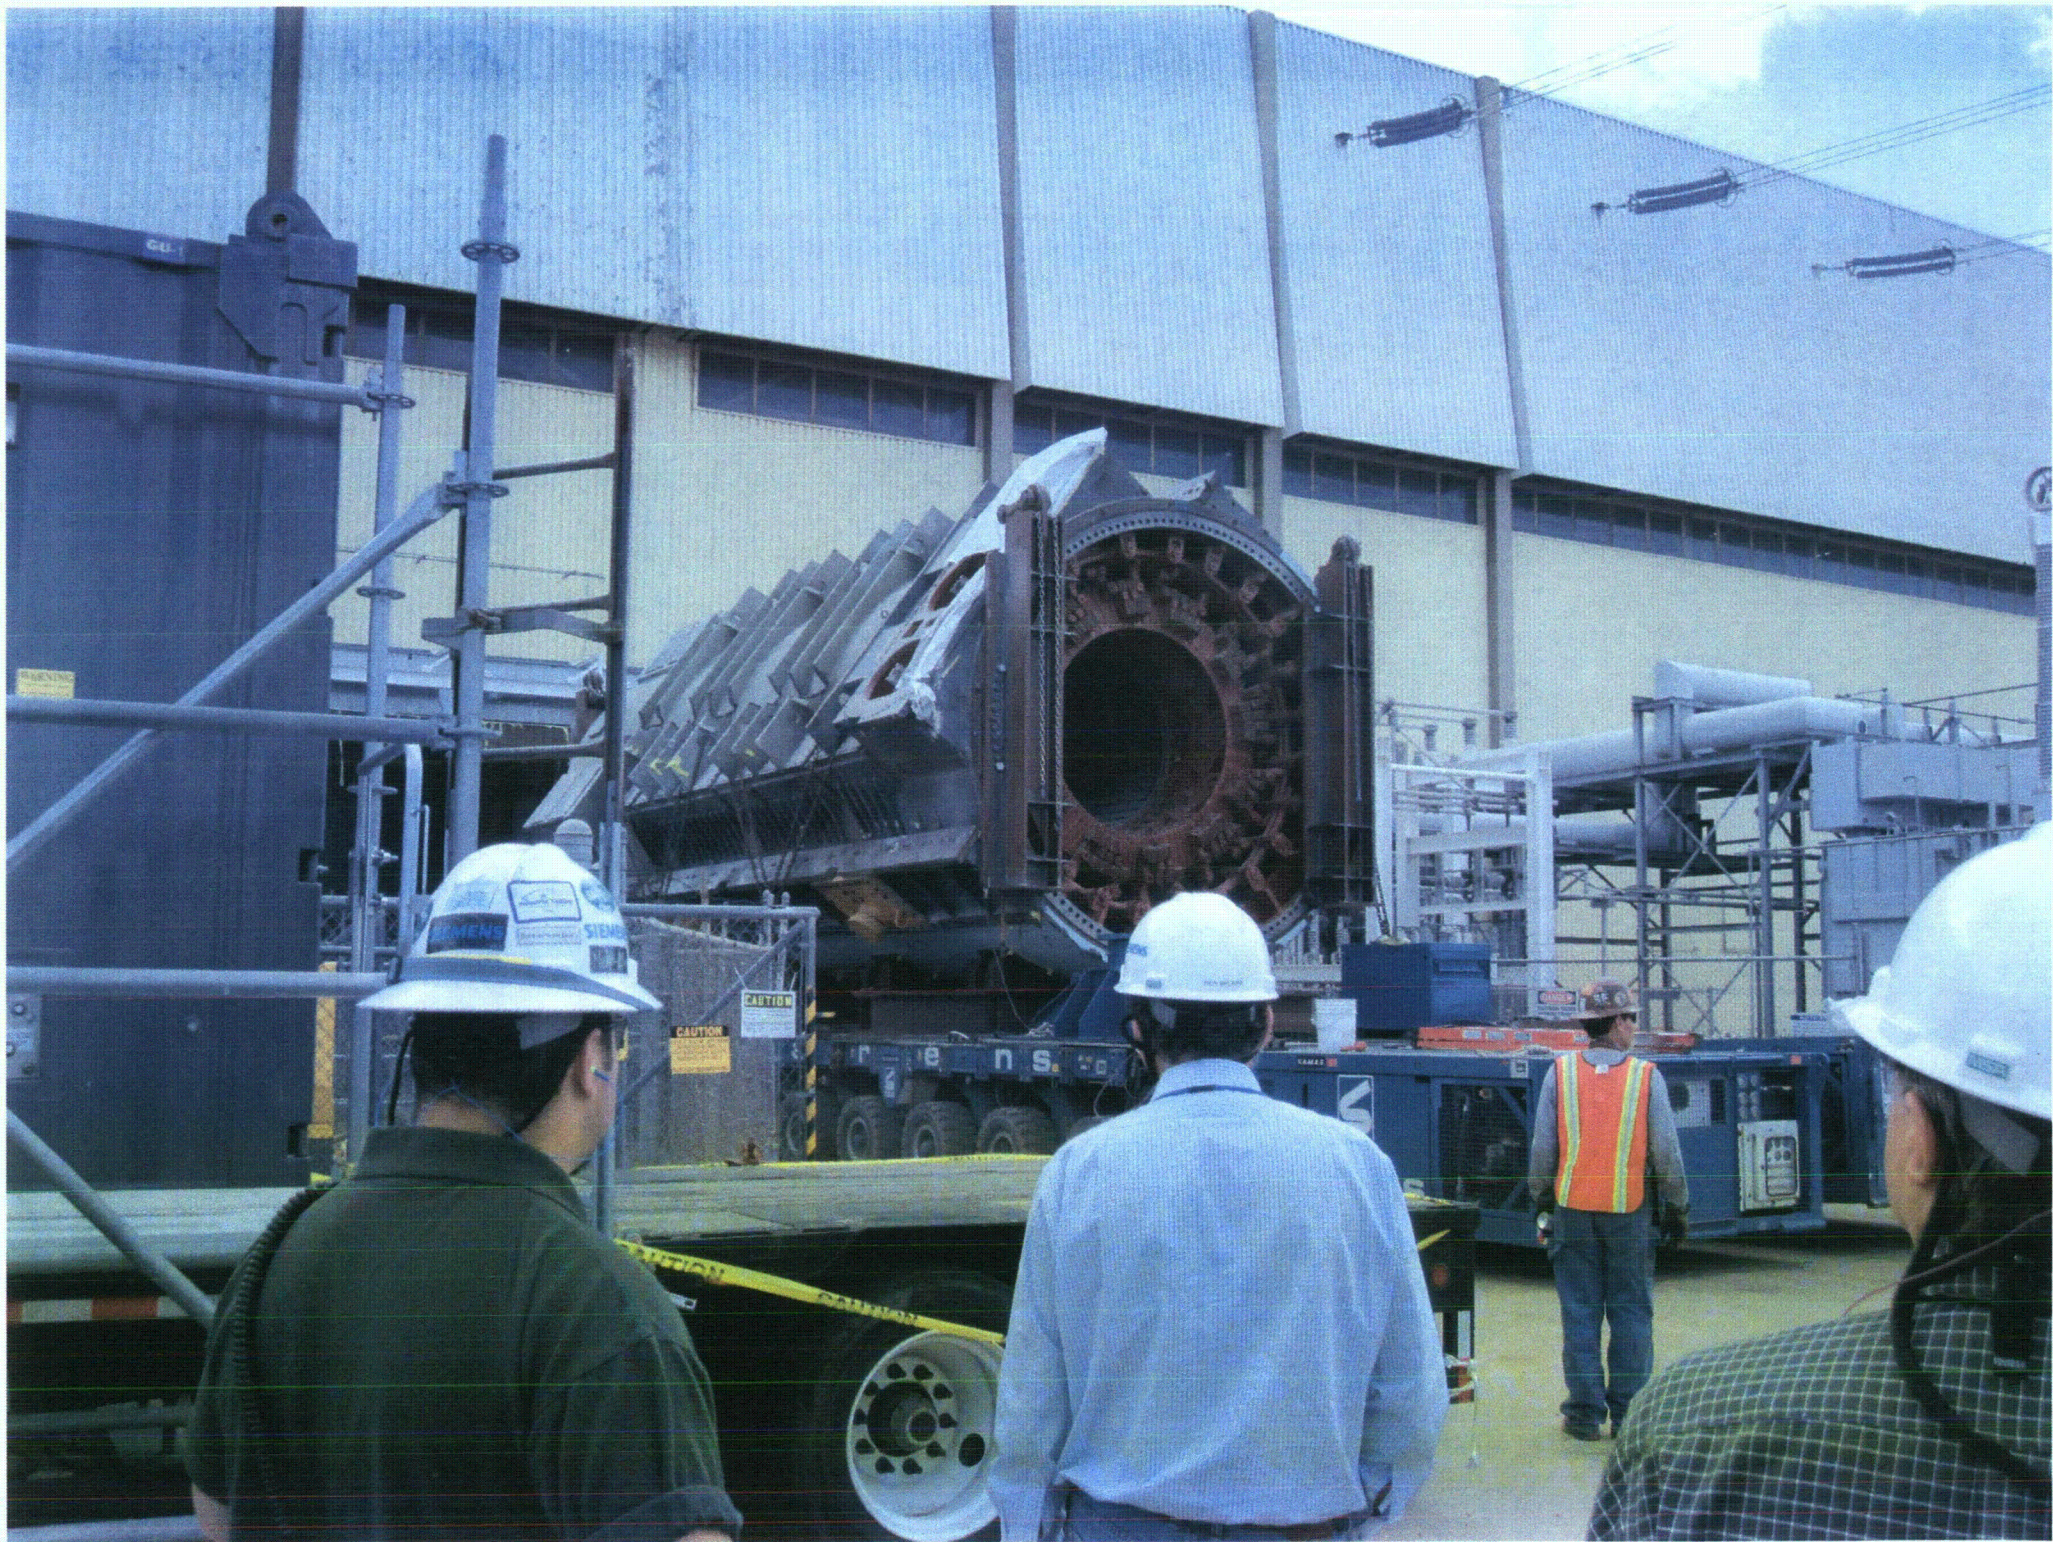

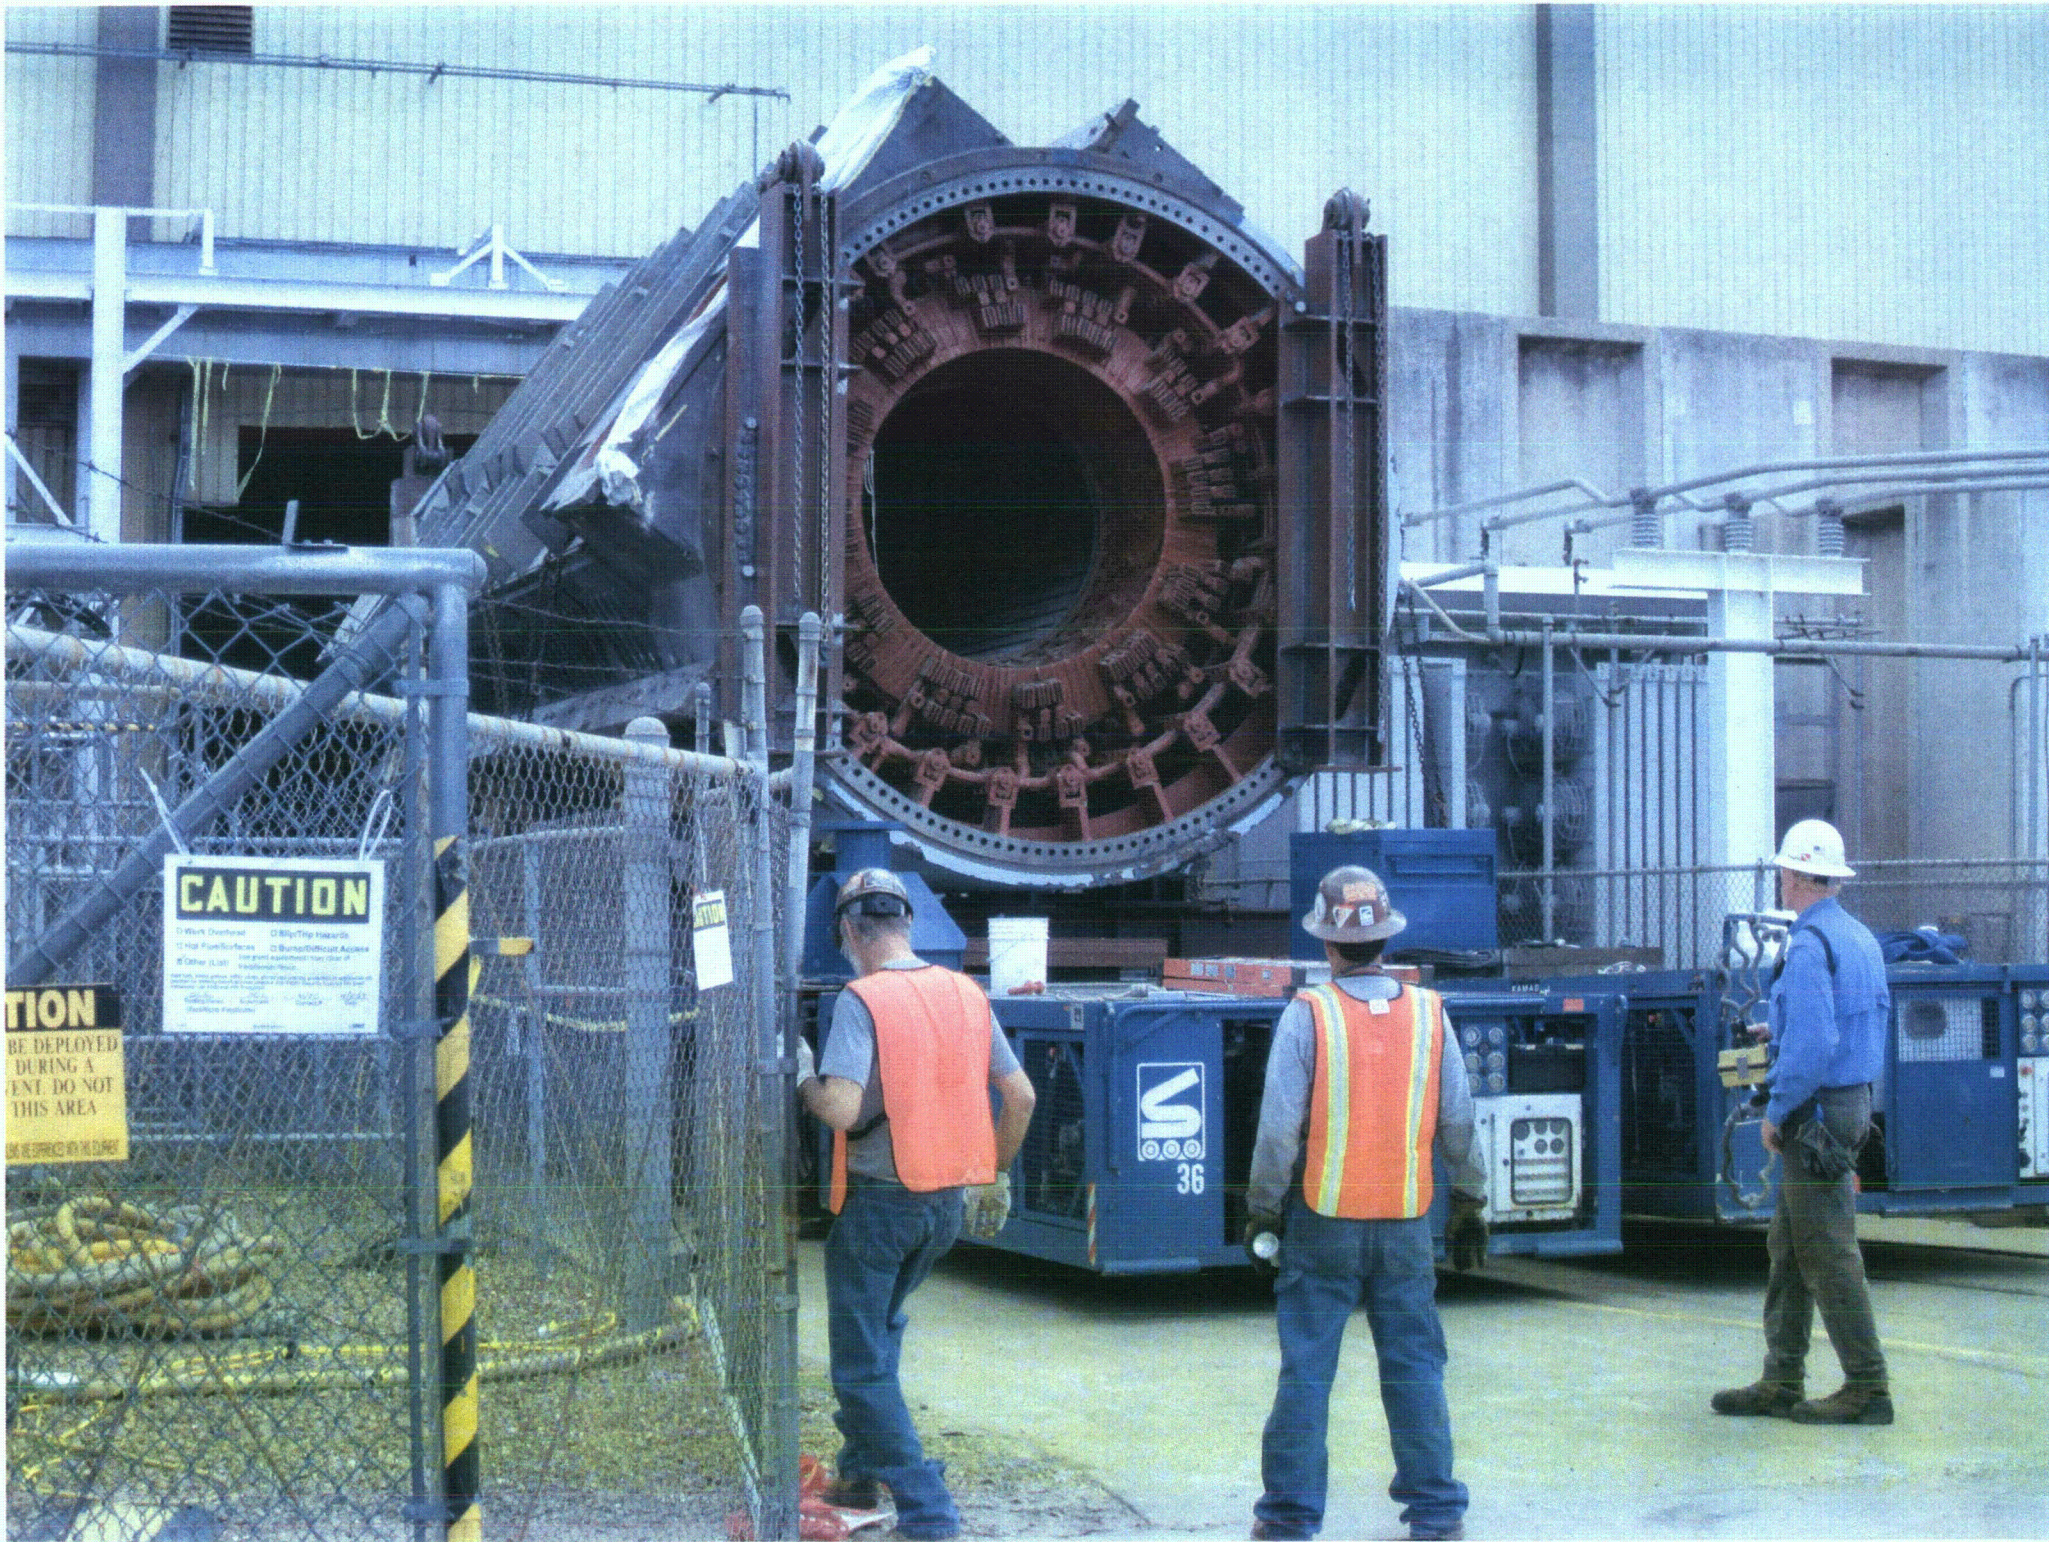

CAUTION
12 Volt Overhead 12 1/2" Trip Hazard
12 High Voltage Areas 12 Burn/Hot Surface Areas
12 Other Hazards Use proper equipment and clear all
 Hazardous Areas
 Hazardous Areas
 Hazardous Areas

CAUTION
BE DEPLOYED
DURING A
... DO NOT
ENTER THIS AREA
USE THE APPROPRIATE PPE AND CLEAR


36



CAUTION
Work Overhead Slip/Trip Hazards
Hot Surfaces Bump/Obstruct Areas
Other (List) High Voltage Area
Unauthorized Access

CAUTION
GATE 53 MAY BE DEPLOYED
REMOTELY DURING A
SECURITY EVENT. DO NOT
LOITER IN THIS AREA

CAUTION
CLEAR
IC GATE


36

