

## Chapter 2 Site Characteristics

### 2.0 Introduction

This section of the referenced DCD is incorporated by reference with the following departures and/or supplements.

---

Replace the last two paragraphs with the following paragraphs.

---

#### EF3 COL 2.0-1-A

DCD site parameter values for the ESBWR standard plant are identified in DCD Table 2.0-1 and DCD Tier 1, Table 5.1-1. DCD site parameter values for the ESBWR standard plant are identified in DCD Table 2.0-1 and DCD Tier 1, Table 5.1-1.

[Table 2.0-201](#) identifies each DCD site parameter value and the corresponding Fermi 3 site characteristic values. In accordance with 10 CFR 52.79(b) and (d); and SRP Section 2.0, Part 1 of [Table 2.0-201](#) evaluates, as applicable, whether the Fermi 3 site characteristic values fall within DCD site parameter values.

#### EF3 SUP 2.0-1

Appendix 2A provides site specific input values used in ARCON96 analysis of on-site X/Q values.

#### EF3 COL 2.0-2-A through 2.0-30-A

Information on Fermi 3 site characteristics is provided in [Section 2.1](#) through [Section 2.5](#). This information addresses NRC guidance in NUREG-0800 as identified in [Table 2.0-2R](#). In the “COL Information” column, the COL Item from the DCD is replaced with information responding to the COL Item and identifying the FSAR section which addresses the SRP section invoked by the COL Item.

---

#### 2.0.1 COL Information

##### 2.0-1-A Site Characteristics Demonstration

#### EF3 COL 2.0-1-A

This COL item is addressed in [Section 2.0](#).

##### 2.0-2-A through 2.0-30-A Standard Review Plan Conformance

#### EF3 COL 2.0-2-A through 2.0-30-A

These COL items are addressed in [Section 2.0](#).

---

**Table 2.0-2R**

**Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR  
Design (Sheet 1 of 5)**

[EF3 COL 2.0-2-A through 2.0-30-A]

	<b>Section</b>	<b>Subject</b>	<b>ESBWR DCD Parameters, Considerations and/or Limits</b>	<b>COL Information</b>
<b>EF3 COL 2.0-2-A</b>	2.1.1	Site Location and Description	None	COL Item 2.0-2-A is addressed in <a href="#">Subsection 2.1.1</a> .
<b>EF3 COL 2.0-3-A</b>	2.1.2	Exclusion Area Authority and Control	None	COL Item 2.0-3-A is addressed in <a href="#">Subsection 2.1.2</a> .
<b>EF3 COL 2.0-4-A</b>	2.1.3	Population Distribution	ESBWR Probabilistic Risk Assessment in DCD Reference 2.0-1 considers a population density of 305 people per square kilometer (790 per square mile), but that is not a limitation for plant siting considerations.	COL Item 2.0-4-A is addressed in <a href="#">Subsection 2.1.3</a> . The population density for offsite analysis provided in <a href="#">Subsection 2.1.3</a> falls within (is less than) the density used in DCD Reference 2.0-1.
<b>EF3 COL 2.0-5-A</b>	2.2.1–2.2.2	Identification of Potential Hazards in Site Vicinity	Per DCD Table 2.0-1	COL Item 2.0-5-A is addressed in <a href="#">Section 2.2</a> .
<b>EF3 COL 2.0-6-A</b>	2.2.3	Evaluation of Potential Accidents	None considered in vicinity of plant	COL Item 2.0-6-A is addressed in <a href="#">Subsection 2.2.3</a> .
<b>EF3 COL 2.0-7-A</b>	2.3.1	Regional Climatology	Per DCD Table 2.0-1	COL Item 2.0-7-A is addressed in <a href="#">Subsection 2.3.1</a> .
<b>EF3 COL 2.0-8-A</b>	2.3.2	Local Meteorology	None	COL Item 2.0-8-A is addressed in <a href="#">Subsection 2.3.2</a> .
<b>EF3 COL 2.0-9-A</b>	2.3.3	Onsite Meteorological Measurements Programs	None	COL Item 2.0-9-A is addressed in <a href="#">Subsection 2.3.3</a> .

**Table 2.0-2R**

**Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 2 of 5)**

[EF3 COL 2.0-2-A through 2.0-30-A]

	<b>Section</b>	<b>Subject</b>	<b>ESBWR DCD Parameters, Considerations and/or Limits</b>	<b>COL Information</b>
<b>EF3 COL 2.0-10-A</b>	2.3.4	Short-Term Dispersion Estimates for Accidental Atmospheric Releases	Per DCD Table 2.0-1. See also <a href="#">Chapter 15</a> .	The portion of COL Item 2.0-10-A to supply information in accordance with SRP 2.3.4 is addressed in <a href="#">Subsection 2.3.4</a> . Information provided in <a href="#">Table 2.0-201</a> shows that the site characteristic short-term meteorological dispersion values fall within the site parameter values. This means that dispersion values given in DCD Chapter 15 remain bounding for this FSAR and less than stipulated in 10 CFR 52.79(a)(1)(vi) and the applicable portions of SRP Sections 11 and 15.
<b>EF3 COL 2.0-11-A</b>	2.3.5	Long-Term Diffusion Estimates	Per DCD Table 2.0-1. See <a href="#">Subsection 2.3.5</a> and <a href="#">Subsection 12.2.2.1</a> for a discussion of the generation of these values.	COL Item 2.0-11-A is addressed in <a href="#">Subsection 2.3.5</a> .
<b>EF3 COL 2.0-12-A</b>	2.4.1	Hydraulic Description Maximum Groundwater Level	Per DCD Table 2.0-1	COL Item 2.0-12-A is addressed in <a href="#">Subsection 2.4.1</a> .
<b>EF3 COL 2.0-13-A</b>	2.4.2	Floods	Per DCD Table 2.0-1	COL Item 2.0-13-A is addressed in <a href="#">Subsection 2.4.2</a> .
<b>EF3 COL 2.0-14-A</b>	2.4.3	Probable Maximum Flood on Streams and Rivers	Probable maximum flooding level on streams and rivers does not exceed the maximum flood level defined in DCD Table 2.0-1.	COL Item 2.0-14-A is addressed in <a href="#">Subsection 2.4.3</a> .
<b>EF3 COL 2.0-15-A</b>	2.4.4	Potential Dam Failures	Potential dam failures do not cause flooding to exceed the maximum flood level defined in DCD Table 2.0-1.	COL Item 2.0-15-A is addressed in <a href="#">Subsection 2.4.4</a> .

**Table 2.0-2R**

**Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR  
Design (Sheet 3 of 5)**

[EF3 COL 2.0-2-A through 2.0-30-A]

	<b>Section</b>	<b>Subject</b>	<b>ESBWR DCD Parameters, Considerations and/or Limits</b>	<b>COL Information</b>
<b>EF3 COL 2.0-16-A</b>	2.4.5	Probable Maximum Surge and Seiche Flooding	Probable maximum surge and seiche flooding level does not exceed the maximum flood level defined in DCD Table 2.0-1.	COL Item 2.0-16-A is addressed in <a href="#">Subsection 2.4.5</a> .
<b>EF3 COL 2.0-17-A</b>	2.4.6	Probable Maximum Tsunami Flooding	Probable maximum tsunami flooding level does not exceed the maximum flood level defined in DCD Table 2.0-1.	COL Item 2.0-17-A is addressed in <a href="#">Subsection 2.4.6</a> .
<b>EF3 COL 2.0-18-A</b>	2.4.7	Ice Effects	None	COL Item 2.0-18-A is addressed in <a href="#">Subsection 2.4.7</a> .
<b>EF3 COL 2.0-19-A</b>	2.4.8	Cooling Water Canals and Reservoirs	None	COL Item 2.0-19-A is addressed in <a href="#">Subsection 2.4.8</a> .
<b>EF3 COL 2.0-20-A</b>	2.4.9	Channel Diversions	None	COL Item 2.0-20-A is addressed in <a href="#">Subsection 2.4.9</a> .
<b>EF3 COL 2.0-21-A</b>	2.4.10	Flooding Protection Requirements	None	COL Item 2.0-21-A is addressed in <a href="#">Subsection 2.4.10</a> .
<b>EF3 COL 2.0-22-A</b>	2.4.11	Cooling Water Supply	None	COL Item 2.0-22-A is addressed in <a href="#">Subsection 2.4.11</a> .
<b>EF3 COL 2.0-23-A</b>	2.4.12	Groundwater	Per DCD Table 2.0-1	COL Item 2.0-23-A is addressed in <a href="#">Subsection 2.4.12</a> .
<b>EF3 COL 2.0-24-A</b>	2.4.13	Accidental Releases of Liquid Effluents in Ground and Surface Waters	The source term provided in DCD Table 12.2-13a, "Liquid Waste Management System Equipment Drain Collection Tank Activity," is used in the effects analysis.	COL Item 2.0-24-A is addressed in <a href="#">Subsection 2.4.13</a> .

**Table 2.0-2R**

**Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 4 of 5)**

[EF3 COL 2.0-2-A through 2.0-30-A]

	<b>Section</b>	<b>Subject</b>	<b>ESBWR DCD Parameters, Considerations and/or Limits</b>	<b>COL Information</b>
<b>EF3 COL 2.0-25-A</b>	2.4.14	Technical Specifications and Emergency Operation Requirements	None	COL Item 2.0-25-A is addressed in <a href="#">Subsection 2.4.14</a> .
<b>EF3 COL 2.0-26-A</b>	2.5.1	Basic Geologic and Seismic Information	None	COL Item 2.0-26-A is addressed in <a href="#">Subsection 2.5.1</a> .
<b>EF3 COL 2.0-27-A</b>	2.5.2	Vibratory Ground Motion	Per DCD Table 2.0-1 (and DCD Figures 2.0-1 and 2.0-2)	The portion of COL Item 2.0-27-A to provide information in accordance with SRP 2.5.2 is addressed in <a href="#">Subsection 2.5.2</a> . Information provided in <a href="#">Table 2.0-201</a> confirms that reactor building/fuel building (RB/FB), control building (CB), and firewater service complex (FWSC) foundation input response spectra (FIRS) (developed in accordance with the guidance in DCD References 2.0-7 and 2.0-8) are enveloped by the ESBWR certified seismic design response spectra (CSDRS) referenced at foundation level.
<b>EF3 COL 2.0-28-A</b>	2.5.3	Surface Faulting	ESBWR design assumes no permanent ground deformation from tectonic or non-tectonic faulting.	COL Item 2.0-28-A is addressed in <a href="#">Subsection 2.5.3</a> . Information to address permanent ground deformation from tectonic or non-tectonic faulting is provided in <a href="#">Subsection 2.5.3</a> .

**Table 2.0-2R**

**Limits Imposed on Acceptance Criteria in Section II of SRP by ESBWR Design (Sheet 5 of 5)**

[EF3 COL 2.0-2-A through 2.0-30-A]

	<b>Section</b>	<b>Subject</b>	<b>ESBWR DCD Parameters, Considerations and/or Limits</b>	<b>COL Information</b>
<b>EF3 COL 2.0-29-A</b>	2.5.4	Stability of Subsurface Materials and Foundations	Per DCD Table 2.0-1	The portion of COL Item 2.0-29-A to provide information in accordance with SRP 2.5.4 is addressed in <a href="#">Subsection 2.5.4</a> . Information to address localized liquefaction potential under other than Seismic Category I structures is provided in <a href="#">Subsection 2.5.4.8</a> . Information to address settlements and differential settlements is provided in <a href="#">Subsection 2.5.4.10.2</a> .
<b>EF3 COL 2.0-30-A</b>	2.5.5	Stability of Slopes	Per DCD Table 2.0-1	COL Item 2.0-30-A is addressed in <a href="#">Subsection 2.5.5</a> .

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 1 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Part 1 – Evaluation of DCD Site Parameters</b>			
<b>Maximum Groundwater Level</b>	0.61 m (2 ft) below plant grade	1.2 m (3.9 ft) below design plant grade	<p>The DCD site parameter of maximum groundwater level of 0.61 m (2 ft) below plant grade is the same as the design groundwater level in DCD Table 3.4-1. The design plant grade elevation identified in DCD Table 3.4-1 is at 4650 mm, which corresponds to 179.6 m (589.3 ft) NAVD 88 for the Fermi 3 site as described in <a href="#">Subsection 2.1.1</a>. Therefore, the DCD site parameter value of 0.61 m (2 ft) below plant grade corresponds to a maximum groundwater level no higher than 179.0 m (587.3 ft) NAVD88 for the Fermi 3 site.</p> <p>The Fermi 3 site characteristic value for maximum groundwater level below design plant grade is 1.2 m (3.9 ft) in the power block area based on the assumed maximum groundwater elevation of 178.4 m (585.4 ft) NAVD 88 from <a href="#">Subsection 2.4.12</a> and by reference <a href="#">2.4.5.2.2.2</a>, and the design plant grade elevation of 179.6 m (589.3 ft) NAVD 88. Therefore, the Fermi 3 site characteristic value for maximum groundwater level below design plant grade falls within (is lower than) the DCD site parameter value.</p>
<b>Extreme Wind</b>			
<b>Seismic Category I, II and Radwaste Building Structures</b>			
100-year Wind Speed (3-sec gust) <sup>(13)</sup>	67.1 m/s (150 mph)	42.9 m/s (96 mph), 3-second gust	The site characteristic value for basic wind speed is defined as the 3-second gust wind speed at 10 m (33 ft) above the ground that has a 1 percent annual probability of being exceeded (100-year mean recurrence interval). The site characteristic value for basic wind speed falls within (is lower than) the DCD site parameter value.
Exposure Category D		Exposure Category C	<p>Exposure category is determined by a number of variables including wind speed, building shape and location, and surface roughness. A DCD site parameter of Exposure Category D results in the most severe design wind pressures.</p> <p>The Fermi 3 site characteristic is Exposure Category C . The Fermi 3 site characteristic falls within (is less than) the DCD site parameter value for extreme wind exposure category, i.e., Exposure Category D.</p>

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 2 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Other Seismic Category NS Standard Plant Structures</b>			
50-year Wind Speed (3-sec gust) <sup>(13)</sup>	58.1 m/s (130 mph)	40.2 m/s (90 mph) 3-second gust,	The Fermi 3 site characteristic value of 40.2 m/s (90 mph) for the 50-year wind speed (3-sec gust) falls within (is less than) the DCD site parameter value for the 50-year wind speed (3-sec gust) of 58.1 m/s (130 mph).
<b>Maximum Flood (or Tsunami) Level</b> <sup>(2)</sup>	0.3 m (1 ft) below plant grade	1.2 m (3.9 ft) below design plant grade based on PMP	<p>The DCD site parameter of maximum flood (or tsunami) water level of 0.3 m (1 ft) below plant grade is the same as the design flood level in DCD Table 3.4-1. The design plant grade elevation identified in DCD Table 3.4-1 is at 4650 mm, which corresponds to 179.6 m (589.3 ft) NAVD 88 for the Fermi 3. Therefore, the DCD site parameter value of 0.3 m (1 ft) below plant grade corresponds to a maximum flood water level below 179.3 m (588.3 ft) for the Fermi 3 site.</p> <p>The Fermi 3 site characteristic value for PMF of 178.4 m (585.4 ft) NAVD 88 is provided in <a href="#">Subsection 2.4.5</a>, and falls within (is less than) the DCD site parameter value. The Fermi 3 site characteristic value for maximum flood water level below design plant grade is due to the 100-year still-water level in addition to the 100-year storm surge. Therefore, the Fermi 3 site characteristic value for maximum flood water level below design plant grade falls within (is lower than) the DCD site parameter value.</p>
<b>Tornado</b>			
Maximum Tornado Wind Speed <sup>(3)</sup>	147.5 m/s (330 mph)	102.8 m/s (230 mph)	The site characteristic value for design basis tornado maximum wind speed is defined as the maximum wind speed resulting from passage of a tornado having a probability of occurrence of 10 <sup>-7</sup> per year. The site characteristic value falls within (is lower than) the DCD site parameter value.
Maximum Rotational Speed	116.2 m/s (260 mph)	82.3 m/s (184 mph)	The site characteristic value for design basis tornado maximum rotational speed is defined as the rotation component of the maximum tornado wind speed. The site characteristic value falls within (is lower than) the DCD site parameter value.
Translational Speed	31.3 m/s (70 mph)	20.6 m/s (46 mph)	The site characteristic value for design basis tornado maximum translational speed is defined as the translational component of the maximum tornado wind speed. The site characteristic value falls within (is lower than) the DCD site parameter value.



**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 3 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Tornado (continued)</b>			
Radius	45.7 m (150 ft)	45.7 m (150 ft)	The site characteristic value for design basis tornado radius of maximum rotational speed is defined as the distance from the center of the tornado at which the maximum rotational wind speed occurs. The site characteristic value falls within (is the same as) the DCD site parameter value.
Pressure Drop	16.6 kPa (2.4 psi)	8.3 kPa (1.2 psi)	The site characteristic value for design basis tornado pressure drop is defined as the decrease in ambient pressure from normal atmospheric pressure resulting from passage of the tornado. The site characteristic value falls within (is lower than) the DCD site parameter value.
Rate of Pressure Drop	11.7 kPa/s (1.7 psi/s)	3.4 kPa/s (0.5 psi/s)	The site characteristic value for design basis tornado maximum rate of pressure drop is defined as the rate of pressure drop resulting from the passage of the tornado. The site characteristic value falls within (is lower than) the DCD site parameter value.
Missile Spectrum <sup>(3)</sup>	Spectrum I of SRP 3.5.1.4, Rev. 2 applied to full building height.	Spectrum I of SRP 3.5.1.4, Rev. 2 applied to full building height	The Fermi 3 site characteristic for tornado missile spectrum is Spectrum I of SRP 3.5.1.4, Rev. 2, applied to full building height. This spectrum fully addresses variations in grade levels at the Fermi 3 site and this Fermi 3 site characteristic value falls within (is the same as) the DCD site parameter value for tornado missile spectrum.
<b>Precipitation (for Roof Design)</b>			
Maximum Rainfall Rate <sup>(4)</sup>	49.3 cm/hr (19.4 in/hr)	43.9 cm/hr (17.3 in/hr)	The Fermi 3 site characteristic value of 43.9 cm/hr for the Maximum Rainfall Rate is less than the Maximum Rainfall Rate precipitation value provided in the DCD site parameter value.
Maximum Short Term Rate	15.7 cm (6.2 in) in 5 min	15 cm (5.8 in) in 5 min	The Fermi 3 site characteristic value for the Maximum Short Term Rate is less than the Maximum Short Term (5 min) precipitation value provided in the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 4 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Precipitation (for Roof Design) (continued)</b>			
Maximum Ground Snow Load for Normal Winter Precipitation Event <sup>(5)</sup>	2394 Pa (50 lbf/ft <sup>2</sup> )	1551 Pa (32.4 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for maximum Ground Snow Load for Normal Winter Precipitation Event is based on site characteristic value for the historical maximum snow pack. The Fermi 3 site characteristic value of 1551 pa (32.4 lbf/ft <sup>2</sup> ) falls within (is lower than) the DCD site parameter value of 2394 pa (50 lbf/ft <sup>2</sup> ).
Maximum Ground Snow Load for Extreme Winter Precipitation Event <sup>(5)</sup>	7757 Pa (162 lbf/ft <sup>2</sup> )	2466 Pa (51.5 lbf/ft <sup>2</sup> )	The site characteristic value for maximum ground snow load for Extreme Frozen Winter Precipitation Event is defined as the combined weight of the historical maximum snowpack and the historical maximum snowfall event. The site characteristic value falls within (is lower than) the DCD site parameter value.
<b>Ambient Design Temperature<sup>(6)</sup></b>			
2% Annual Exceedance Values			
Maximum	35.6°C (96°F) dry bulb 26.1°C (79°F) wet bulb (mean coincident)	29.3°C (84.7°F) dry bulb with 21.6°C (70.8°F) wet bulb (mean coincident) (2% Annual exceedance values)	The Fermi 3 site characteristic values for maximum dry-bulb temperature with mean coincident wet-bulb temperature for 2% annual exceedance are the ambient dry-bulb temperature (and mean coincident wet-bulb temperature) that will be exceeded 2% of the time annually. The site characteristic values fall within (are lower than) the DCD site parameter values.
	27.2°C (81°F) wet bulb (non-coincident)	22.8°C (73.1°F) wet bulb (non-coincident)	The Fermi 3 site characteristic value for the maximum wet bulb temperature (non-coincident) for 2% annual exceedance is defined as the ambient wet-bulb temperature that will be exceeded 2% of the time annually. This value falls within (is less than) the DCD site parameter value for 2% exceedance.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 5 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Ambient Design Temperature (continued)</b>			
Minimum	-23.3°C (-10°F)	-14.8°C (5.3°F) (99% Annual exceedance value)	The Fermi 3 site characteristic value is the site characteristic value for the minimum dry bulb temperature for 1% annual exceedance. This value is defined as the ambient dry-bulb temperature below which dry-bulb temperatures will fall 1% of the time annually. This value falls within (is higher than) the DCD site parameter value for 2% Annual exceedance (i.e., the ambient dry-bulb temperature below which dry-bulb temperatures will fall 2% of the time annually). Because the minimum temperature site characteristic value for 2% is even higher than the 1% value, the site's 2% value also falls within (is higher than) the DCD site parameter value for 1% annual exceedance.
1% Annual Exceedance Values			
Maximum	37.8°C (100°F) dry bulb 26.1°C (79°F) wet bulb (mean coincident)	30.7°C (87.3°F) dry bulb with 22.3°C (72.2°F) wet bulb (mean coincident)	The Fermi 3 site characteristic values for the maximum dry bulb temperature with mean coincident wet bulb temperatures for 1% annual exceedance. These values are the ambient dry-bulb temperature (and mean coincident wet-bulb temperature) that will be exceeded 1 percent of the time annually. These values are 30.7°C (87.3°F) dry bulb with 22.3°C (72.2°F) wet bulb (mean coincident) and fall within (are less than) the DCD site parameter values for 1% exceedance.
Maximum	27.8°C (82°F) wet bulb (non-coincident)	23.8°C (74.8°F) wet-bulb (non-coincident)	The Fermi 3 site characteristic value for the maximum wet bulb temperature (non-coincident) for 0.4% annual exceedance. This value is defined as the ambient wet-bulb temperature that will be exceeded 1% of the time annually. This value is 23.8°C (74.8°F) wet bulb (non-coincident) and falls within (is less than) the DCD site parameter value for 1% Annual exceedance.
Minimum	-23.3°C (-10°F)	-14.8°C (5.3°F) (1% Annual exceedance value)	The Fermi 3 site characteristic value is the site characteristic value for the minimum dry bulb temperature for 1% annual exceedance. This value is defined as the ambient dry-bulb temperature below which dry-bulb temperatures will fall 1% of the time annually. This value falls within (is less than) the DCD site parameter value for 1% Annual exceedance.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 6 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Ambient Design Temperature (continued)</b>			
0% Exceedance Values			
Maximum	47.2°C (117°F) dry bulb 26.7°C (80°F) wet bulb (mean coincident)	40.1°C (104.1°F) dry-bulb with 23.3°C (73.9°F) wet bulb coincident (0% exceedance values)	The Fermi 3 site characteristic values for the 0% maximum dry bulb and wet bulb, coincident temperatures are the 100-year return period values. These values are 40.1°C (104.1°F) dry-bulb with 23.3°C (73.9°F) wet bulb coincident fall within (are less than) the DCD site parameter values for 0% exceedance.
	31.1°C (88°F) wet bulb (non-coincident)	30.0°C (86.0°F) wet-bulb (non-coincident) (0% exceedance value)	The Fermi 3 site characteristic value for the 0% maximum wet bulb temperature (non-coincident) is the 100-year return period value . This value is 30.0°C (86.0°F) wet-bulb (non-coincident) and falls within (is less than) the DCD site parameter value for 0% exceedance.
Minimum	-40°C (-40°F)	-34.9°C (-30.8°F)	The Fermi 3 site characteristic value for minimum temperature is the 100-year return period value. This value is -34.9°C (-30.8°F) and falls within (is higher than) the DCD site parameter value for 0% exceedance.
Maximum Average Dry Bulb Temperature for 0% Exceedance Maximum Temperature Day	39.7°C (103.5°F)	29.48°C (85.1°F)	The Fermi 3 site characteristic value for Maximum Average Dry Bulb Temperature for 0% Exceedance Maximum Temperature Day is 29.48°C (85.1°F). This value falls within (is less than) the DCD site parameter value for Maximum Average Dry Bulb Temperature for 0% Exceedance Maximum Temperature Day.
Minimum Average Dry Bulb Temperature for 0% Exceedance Minimum Temperature Day	-32.5°C (-26.5°F)	-26.35°C (-15.4°F)	The Fermi 3 site characteristic value for Minimum Average Dry Bulb Temperature for 0% Exceedance Minimum Temperature Day is -26.35°C (-15.4°F). This value falls within (is greater than) the DCD site parameter value for Minimum Average Dry Bulb Temperature for 0% Exceedance Minimum Temperature Day.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 7 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Ambient Design Temperature (continued)</b>			
Maximum High Humidity Average Wet Bulb Globe Temperature Index for 0% Exceedance Maximum Wet Bulb Temperature Day	30.3°C (86.6°F)	28.78°C (83.8°F)	The Fermi 3 site characteristic value for Maximum High Humidity Average Wet Bulb Globe Temperature Index for 0% Exceedance Maximum Wet Bulb Temperature Day is 28.78°C (83.8°F). This value falls within (is less than) the DCD site parameter value for Maximum High Humidity Average Wet Bulb Globe Temperature Index for 0% Exceedance Maximum Wet Bulb Temperature Day.
<b>Soil Properties</b>			
Minimum Static Bearing Capacity <sup>(7)</sup> Greater than or equal to the Maximum Static Bearing Demand.			
Maximum Static Bearing Demand:			
Reactor/Fuel Building	699 kPa (14,600 lbf/ft <sup>2</sup> )	4,500 kPa (94,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable bearing capacity from <a href="#">Table 2.5.4-227</a> for the R/FB falls within (is greater than) the DCD site parameter value.
Control Building	292 kPa (6,100 lbf/ft <sup>2</sup> )	14,029 kPa (293,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable bearing capacity from <a href="#">Table 2.5.4-227</a> for the CB falls within (is greater than) the DCD site parameter value.
Fire Water Service Complex	165 kPa (3450 lbf/ft <sup>2</sup> )	1,532 kPa (32,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable bearing capacity from <a href="#">Table 2.5.4-227</a> for the FWSC falls within (is greater than) the DCD site parameter value.
Reactor/Fuel Building			
Soft	1,100 kPa (23,000 lbf/ft <sup>2</sup> )	5,980 kPa (125,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the RB/FB structure is from <a href="#">Table 2.5.4-227</a> and falls within (is greater than) the DCD site parameter value. In accordance with Note Number 16 of the DCD, Tier 2 Table 2.0-1, Fermi 3 site-specific soil structure interaction (SSI) analyses were performed for the RB/FB. The DCD site parameter value for dynamic bearing demand envelopes (is greater than) the SSI dynamic bearing demand for the RB/FB.
Medium	2,700 kPa (56,400 lbf/ft <sup>2</sup> )		
Hard	1,100 kPa (23,000 lbf/ft <sup>2</sup> )		

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 8 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Soil Properties (continued)</b>			
Minimum Dynamic Bearing Capacity <sup>(7)</sup> Greater than or equal to the Maximum Dynamic Bearing Demand.			
Maximum Dynamic Bearing Demand (SSE & Static):			
Control Building			
Soft	500 kPa (10,500 lbf/ft <sup>2</sup> )	18,700 kPa (391,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the CB structure is from <a href="#">Table 2.5.4-227</a> and falls within (is greater than) the DCD site parameter value. In accordance with Note Number 16 of the DCD, Tier 2 Table 2.0-1, Fermi 3 site-specific soil structure interaction (SSI) analyses were performed for the CB. The DCD site parameter value for dynamic bearing demand envelopes (is greater than) the SSI dynamic bearing demand for the CB.
Medium	2,200 kPa (46,000 lbf/ft <sup>2</sup> )		
Hard	420 kPa (8,800 lbf/ft <sup>2</sup> )		
Fire Water Service Complex (FWSC)			
Soft	460 kPa (9,600 lbf/ft <sup>2</sup> )	2100 kPa (43,000 lbf/ft <sup>2</sup> )	The Fermi 3 site characteristic value for allowable dynamic bearing capacity for the FWSC structure is from <a href="#">Table 2.5.4-227</a> and falls within (is greater than) the DCD site parameter value .
Medium	690 kPa (14,400 lbf/ft <sup>2</sup> )		
Hard	1,200 kPa (25,100 lbf/ft <sup>2</sup> )		

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 9 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Soil Properties (continued)</b>			
Minimum Shear Wave Velocity <sup>(8)</sup>	300 m/s (1000 ft/s)	Value for supporting material for each Seismic Category I structure; RB/FB, CB, and FWSC greater than 1,000 ft/sec Value for surrounding material for each Seismic Category I structure: – Below top of bedrock – greater than 1,000 ft.sec – Above top of bedrock – neglected	In accordance with Note Number 16 of the Referenced DCD, Tier 2 Table 2.0-1, Fermi 3 site-specific soil structure interaction (SSI) analyses were performed for the RB/FB and CB. The Fermi 3 site-specific SSI were performed with and without engineered granular backfill above the Bass Islands Group bedrock. Without engineered granular backfill above the Bass Islands Group bedrock, the SSI results are within (less than) the DCD requirements; therefore, the DCD site parameters for engineered granular backfill above the top of the Bass Islands Group bedrock do not apply. Fill concrete is used as backfill below the top of bedrock surrounding the RB/FB and CB, and below the FWSC to the top of bedrock. Fill concrete and supporting bedrock meet the DCD requirement. For supporting foundation material the shear wave velocity for each structure falls within (is greater than) the DCD site parameter value. As shown in <a href="#">Figure 2.5.4-215</a> and <a href="#">Figure 2.5.4-216</a> , the RB/FB, CB, and FWSC foundations are founded on uniform material. Therefore, the ratio of the largest of the smallest shear wave velocity over each mat foundation level does not exceed 1.7.
Liquefaction Potential			
Seismic Category I structures	None under footprint of Seismic Category I structures resulting from site-specific SSE	None at site-specific SSE under Seismic Category I structures	The Fermi 3 Category I structures are founded on bedrock or fill concrete and there is no potential for liquefaction under Fermi 3 Seismic Category I structures at the site-specific SSE ground motion.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 10 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Soil Properties (continued)</b>			
Other than Seismic Category I structures	See Note (14)	See Evaluation column	Note (14) in DCD Table 2.0-1 identifies a requirement to address liquefaction potential under other than Seismic Category I structures. Backfill below Seismic Category II structures from the base of the foundation to the top of bedrock is fill concrete; therefore, liquefaction analysis for soil below Seismic Category II structures is not necessary. <a href="#">Subsection 2.5.4.8</a> provides the results of the analysis for the engineered granular backfill and glacial till at the Fermi 3 site and addresses potential liquefaction under other than Seismic Category I and II structures. Based on the analysis provided, the engineered granular backfill and glacial till are not susceptible to liquefaction.
Angle of Internal Friction (in-situ and backfill)	≥35 degrees	≥35 degrees	The Fermi 3 site characteristic value for angle of internal friction is provided in <a href="#">Subsection 2.5.4.10</a> and falls within (is the same as) the DCD site parameter value.
Backfill on sides of and underneath Seismic Category I structures		See Evaluation Column	The Fermi 3 site characteristic values for the backfill on the sides of seismic Category I structures are specified in <a href="#">Subsection 2.5.4.5.4.2</a> . In accordance with Note Number 16 of the Referenced DCD, Tier 2 Table 2.0-1, Fermi 3 site-specific SSI analyses were performed for the RB/FB and CB. The Fermi 3 site-specific sliding analysis for the RB/FB, CB, and FWSC does not require backfill for sliding stability. Therefore, the Referenced DCD $k_0\gamma$ site parameter for backfill above the top of the bedrock is not required. The engineered granular backfill will meet the values listed in the Fermi 3 Site Characteristic column.



Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Soil Properties (continued)</b>			
i. Product of peak ground acceleration $\alpha$ (in g), Poisson's ratio $\nu$ and density $\gamma$	$\alpha(0.95\nu + 0.65)\gamma$ : 1220 kg/m <sup>3</sup> (76 lbf/ft <sup>3</sup> ) maximum	$\alpha(0.95\nu + 0.65)\gamma$ : 1220 kg/m <sup>3</sup> (76 lbf/ft <sup>3</sup> ) maximum	
ii. Product of at-rest pressure coefficient $k_o$ and density:	$k_o\gamma$ : 750 kg/m <sup>3</sup> (47 lbf/ft <sup>3</sup> ) minimum		
iii. Soil density	$\gamma$ : 2000 kg/m <sup>3</sup> (125 lbf/ft <sup>3</sup> ) minimum	$\gamma$ : 2000 kg/m <sup>3</sup> (125 lbf/ft <sup>3</sup> ) minimum	

**Seismology**

SSE Horizontal Ground Response Spectra <sup>(9)</sup>	See DCD Figure 2.0-1		The DCD site parameter values for SSE response spectra at foundation level are identified as the certified seismic design response spectra (CSDRS). The CSDRS for the control building (CB) and reactor building/fuel building (RB/FB) are shown in DCD Figure 2.0-1 (horizontal) and in DCD Figure 2.0-2 (vertical). The CSDRS for the firewater service complex (FWSC) are 1.35 times the accelerations shown in DCD Figure 2.0-1 (horizontal) and in DCD Figure 2.0-2 (vertical) per Note (9) in DCD Table 2.0-1.
SSE Vertical Ground Response Spectra <sup>(9)</sup>	See DCD Figure 2.0-2		

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 12 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Seismology (continued)</b>			
		See <a href="#">Figure 3.7.1-228</a> , <a href="#">Figure 3.7.1-229</a> , and <a href="#">Figure 3.7.1-238</a>	<p>The Fermi 3 site characteristic values are identified as the foundation input response spectra (FIRS). The CB enhanced Soil Column Outcrop Response (SCOR) FIRS are shown in <a href="#">Figure 3.7.1-229</a>. The RB/FB enhanced SCOR FIRS are shown in <a href="#">Figure 3.7.1-228</a>. The FWSC FIRS are shown in <a href="#">Figure 3.7.1-238</a>.</p> <p>The comparisons of the DCD site parameter (CSDRS for the CB and RB/FB) and Fermi 3 site characteristic values (enhanced SCOR FIRS for the CB and RB/FB) are provided in <a href="#">Figure 2.0-201</a> and <a href="#">Figure 2.0-202</a>. These comparisons demonstrate that the Fermi 3 site characteristic values fall within (are less than) the values established by the DCD site parameters.</p> <p>The comparisons of the DCD site parameter (CSDRS for the FWSC) and Fermi 3 site characteristic values (FIRS for the FWSC) are provided in <a href="#">Figure 2.0-203</a>. These comparisons demonstrate that the Fermi 3 site characteristic values fall within (are less than) the values established by the DCD site parameters.</p>
<b>Hazards in Site Vicinity</b>			
Site Proximity Missiles and Aircraft	< about 10 <sup>-7</sup> per year (for site proximity missile hazards)	No site proximity missile hazards identified	The Fermi 3 site characteristic value for site proximity missiles value is that there are no site proximity missile sources identified. As provided in <a href="#">Subsection 2.2.1</a> , there are no missile sources identified in the site vicinity and this value falls within (is less than) the DCD site parameter value.
	< about 10 <sup>-7</sup> per year (for aircraft hazards)	Annual aircraft crash probability of < about 1 × 10 <sup>-7</sup> (includes civil and military aircraft)	The Fermi 3 site characteristic value for total probability per year of a civil or military aircraft crashing was estimated per NUREG-0800 as shown in <a href="#">Subsection 2.2.3.1.3</a> and the total accident probability falls within (is the same as) the DCD site parameter value except as noted for Mills Field in <a href="#">Subsection 2.2.3.1.3.1</a> .
Volcanic Activity	None	No volcanic activity at the site	The Fermi 3 site characteristic value for volcanic activity is that there is no evidence of non-tectonic deformation at the site, such as volcanic intrusion, as presented in <a href="#">Subsection 2.5.3</a> . The Fermi 3 site characteristic value falls within (is the same as) the DCD site parameter value.
Toxic Gases	None*		

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 13 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Hazards in Site Vicinity (continued)</b>			
* Maximum toxic gas concentrations at the Main Control Room (MCR) HVAC intakes	<toxicity limits	<toxicity limits	The Fermi 3 site characteristic value for toxic gases is that the control room concentration for each chemical analyzed does not exceed the applicable toxicity limit. Based on this result, Seismic Category I Class 1E toxic gas monitoring instrumentation is not required for the MCR HVAC air intakes. The Fermi 3 site characteristic value for toxic gases (control room concentrations < toxicity limits) is presented in <a href="#">Subsection 6.4.5</a> and falls within (is the same as) the DCD site parameter value for toxic gases (control room concentrations < toxicity limits).
<b>Required Stability of Slopes<sup>(10)</sup></b>			
Factor of safety for static (non-seismic) loading	1.5	See Evaluation column	Note (10) in DCD Table 2.0-1 identifies that factors of safety for stability of slopes are not site parameters. These factors are used with slope design features to ensure stability for static and dynamic loading.
Factor of safety for dynamic (seismic) loading due to site-specific SSE	1.1	See Evaluation column	As described in <a href="#">Subsection 2.5.5</a> , there are no natural or man-made slopes that could adversely affect Fermi 3 Seismic Category I structures. <a href="#">Figure 2.4-214</a> and <a href="#">Figure 2.4-215</a> present ground surface contours for the existing and final site grade, and shows the site is relatively level. The foundations for all Category I structures are founded on the bedrock, or fill concrete that extends to the bedrock. Therefore, slope stability in the fill will not impact Category I structures
<b>Maximum Settlement Values for Seismic Category I Buildings<sup>(15)</sup></b>			
<b>Maximum Settlement at any corner of basemat</b>			
Under Reactor/Fuel Building	103 mm (4.0 inches)	13.2 mm (0.52 in) for the maximum settlement of a RB/FB corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the reactor building/fuel building (RB/FB) foundation is provided in <a href="#">Table 2.5.4-232</a> and falls within (is less than) the DCD site parameter value.
Under Control Building	18 mm (0.7 inches)	14.2 mm (0.56 in) for the maximum settlement of a CB corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the control building (CB) foundation is provided in <a href="#">Table 2.5.4-232</a> and falls within (is less than) the DCD site parameter value.
Under FWSC Structure	17 mm (0.7 inches)	4.6 mm (0.18 in) for the maximum settlement of a FWSC corner	The Fermi 3 site characteristic value for the maximum settlement of a corner for the firewater service complex (FWSC) foundation is provided in <a href="#">Table 2.5.4-232</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 14 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Averaged Settlement at four corners of basemat</b>			
Under Reactor/Fuel Building	65 mm (2.6 inches)	12.2 mm (0.48 in) for the maximum settlement of a RB/FB corner	The maximum settlement of a corner for the RB/FB foundation is provided in <a href="#">Table 2.5.4-231</a> and falls within (is less than) the DCD site parameter value.
Under Control Building	12 mm (0.5 inches)	11.9 mm (0.47 in) for the maximum settlement of a CB corner	The maximum settlement of a corner for the CB foundation is provided in <a href="#">Table 2.5.4-231</a> and falls within (is less than) the DCD site parameter value.
Under FWSC Structure	10 mm (0.4 inches)	3.6 mm (0.14 in) for the maximum settlement of a FWSC corner	The maximum settlement of a corner for the FWSC foundation is provided in <a href="#">Table 2.5.4-231</a> and falls within (is less than) the DCD site parameter value.
<b>Maximum Differential Settlement along the longest mat foundation dimension</b>			
Within Reactor/Fuel Building	77 mm (3.0 inches)	8.6 mm (0.34 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in <a href="#">Table 2.5.4-232</a> which, as shown, falls within (is less than) the DCD site parameter value.
Within Control Building	14 mm (0.6 inches)	4.3 mm (0.17 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in <a href="#">Table 2.5.4-232</a> which, as shown, falls within (is less than) the DCD site parameter value.
Under FWSC Structure	12 mm (0.5 inches)	1.8 mm (0.07 in)	The Fermi 3 site characteristic value for the maximum differential settlement along the longest mat foundation dimension is provided in <a href="#">Table 2.5.4-232</a> which, as shown, falls within (is less than) the DCD site parameter value.
	85 mm (3.3 inches)	9.4 mm (0.37 in)	The Fermi 3 site characteristic value for the maximum differential displacement between the RB/FB foundation and the CB foundation is provided in <a href="#">Table 2.5.4-232</a> which, as shown, falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 15 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q)<sup>(11)</sup></b>			
EAB X/Q			
0–2 hours	2.00E-03 s/m <sup>3</sup>	3.95E-04 s/m <sup>3</sup>	The site characteristic value for short-term (accident release) atmospheric dispersion for 0–2 hr X/Q value at the EAB is defined as the 0–2 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the EAB. The site characteristic value falls within (is lower than) the DCD site parameter value.
LPZ X/Q			
0–8 hours	1.90E-04 s/m <sup>3</sup>	3.46E-05 s/m <sup>3</sup>	The site characteristic value for short-term (accident release) atmospheric dispersion for 0–8 hr X/Q value at the LPZ is defined as the 0–8 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.
8–24 hours	1.40E-04 s/m <sup>3</sup>	2.37E-05 s/m <sup>3</sup>	The site characteristic value for short-term (accident release) atmospheric dispersion for 8–24 hr X/Q value at the LPZ is defined as the 8–24 hour atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value
1–4 days	7.50E-05 s/m <sup>3</sup>	1.05E-05 s/m <sup>3</sup>	The site characteristic value for short-term (accident release) atmospheric dispersion for 1–4 day X/Q value at the LPZ is defined as the 1–4 day atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.
4–30 days	3.00E-05 s/m <sup>3</sup>	3.22E-06 s/m <sup>3</sup>	The site characteristic value for short-term (accident release) atmospheric dispersion for 4–30 day X/Q value at the LPZ is defined as the 4–30 day atmospheric dispersion factor to be used to estimate dose consequences of accidental airborne releases at the LPZ. The site characteristic value falls within (is lower than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 16 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q * * First value is for unfiltered inleakage. Second value is for air intakes (emergency and normal).			Control Room X/Q values shown on the same row in DCD Table 2.0-1 are in sets below: first a set for unfiltered inleakage, followed by a set for air intakes (emergency and normal).
Reactor Building			
Unfiltered inleakage			
0–2 hours	1.90E-03 s/m <sup>3</sup>	1.7E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value
2–8 hours	1.30E-03 s/m <sup>3</sup>	1.1E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	5.90E-04 s/m <sup>3</sup>	4.3E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	5.00E-04 s/m <sup>3</sup>	3.3E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	4.40E-04 s/m <sup>3</sup>	2.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Air intakes (maximum of emergency and normal)			
0–2 hours	1.50E-03 s/m <sup>3</sup>	1.1E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	1.10E-03 s/m <sup>3</sup>	7.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 17 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued)			
Reactor Building – (continued)			
Air intakes (maximum of emergency and normal) (continued)			
8–24 hours	5.00E-04 s/m <sup>3</sup>	3.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	4.20E-04 s/m <sup>3</sup>	2.4E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	3.80E-04 s/m <sup>3</sup>	1.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
<b>Passive Containment Cooling System/Reactor Building Roof</b>			
Unfiltered inleakage			
0–2 hours	3.40E-03 s/m <sup>3</sup>	1.7E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	2.70E-03 s/m <sup>3</sup>	1.2E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.40E-03 s/m <sup>3</sup>	4.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m <sup>3</sup>	2.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	7.90E-04 s/m <sup>3</sup>	2.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
<b>Air intakes (maximum of emergency and normal)</b>			
0–2 hours	3.00E-03 s/m <sup>3</sup>	1.4E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 18 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued)			
Passive Containment Cooling System/Reactor Building Roof (continued)			
Air intakes (maximum of emergency and normal) (continued)			
2–8 hours	2.50E-03 s/m <sup>3</sup>	1.0E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.20E-03 s/m <sup>3</sup>	3.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	9.00E-04 s/m <sup>3</sup>	2.7E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	7.00E-04 s/m <sup>3</sup>	2.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
<b>Blowout Panels/Reactor Building Roof</b>			
Unfiltered inleakage			
0–2 hours	7.00E-03 s/m <sup>3</sup>	4.6E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	5.00E-03 s/m <sup>3</sup>	3.9E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 days	2.10E-03 s/m <sup>3</sup>	1.6E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	1.70E-03 s/m <sup>3</sup>	1.3E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	1.50E-03 s/m <sup>3</sup>	1.1E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.



**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 19 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued)			
Blowout Panels/Reactor Building Roof (continued)			
Air intakes (maximum of emergency and normal)			
0–2 hours	5.90E-03 s/m <sup>3</sup>	3.7E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	4.70E-03 s/m <sup>3</sup>	3.0E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 days	1.50E-03 s/m <sup>3</sup>	1.2E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m <sup>3</sup>	9.1E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m <sup>3</sup>	7.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Turbine Building			
Unfiltered inleakage			
0–2 hours	1.20E-03 s/m <sup>3</sup>	6.4E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	9.80E-04 s/m <sup>3</sup>	3.8E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	3.90E-04 s/m <sup>3</sup>	1.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	3.80E-04 s/m <sup>3</sup>	1.1E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	3.20E-04 s/m <sup>3</sup>	8.5E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 20 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued)			
Turbine Building (continued)			
Air intakes (maximum of emergency and normal)			
0–2 hours	1.20E-03 s/m <sup>3</sup>	6.8E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	9.80E-04 s/m <sup>3</sup>	4.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	3.90E-04 s/m <sup>3</sup>	1.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	3.80E-04 s/m <sup>3</sup>	1.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	3.20E-04 s/m <sup>3</sup>	9.1E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Fuel Building			
Unfiltered inleakage			
0–2 hours	2.80E-03 s/m <sup>3</sup>	2.2E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	2.50E-03 s/m <sup>3</sup>	1.6E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.25E-03 s/m <sup>3</sup>	6.4E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 21 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued)			
Fuel Building (continued)			
Unfiltered inleakage (continued)			
1–4 days	1.10E-03 s/m <sup>3</sup>	5.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m <sup>3</sup>	4.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Air intakes (maximum of normal and emergency)			
0–2 hours	2.80E-03 s/m <sup>3</sup>	2.0E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	2.50E-03 s/m <sup>3</sup>	1.6E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.25E-03 s/m <sup>3</sup>	6.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m <sup>3</sup>	4.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-03 s/m <sup>3</sup>	4.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Radwaste Building			
Unfiltered inleakage			
The PCCS vent X/Q values are assumed to bound the X/Q values for any release from the RW Building based on distance and direction to the CR receptors, and the PCCS vent X/Q values are used to evaluate releases from the RW Building in the DCD (Section 15.3.16). The PCCS X/Q values are compared to the RW Building X/Q results.			
0–2 hours	3.40E-03 s/m <sup>3</sup>	1.7E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 22 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Control Room X/Q (continued) Radwaste Building (continued) Unfiltered inleakage (continued)			
2–8 hours	2.70E-03 s/m <sup>3</sup>	1.2E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.40E-03 s/m <sup>3</sup>	4.5E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	1.10E-03 s/m <sup>3</sup>	2.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	7.90E-04 s/m <sup>3</sup>	2.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Air Intakes (maximum of normal and emergency)			
0–2 hours	3.00E-03 s/m <sup>3</sup>	1.4E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	2.50E-03 s/m <sup>3</sup>	1.0E-03 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	1.20E-04 s/m <sup>3</sup>	3.9E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	9.00E-04 s/m <sup>3</sup>	2.7E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	7.00E-04 s/m <sup>3</sup>	2.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 23 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Reactor Building			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	1.00E-03 s/m <sup>3</sup>	2.4E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	6.00E-04 s/m <sup>3</sup>	2.0E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	3.00E-04 s/m <sup>3</sup>	8.2E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	2.00E-04 s/m <sup>3</sup>	6.8E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	1.00E-04 s/m <sup>3</sup>	5.8E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
Turbine Building			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	2.00E-03 s/m <sup>3</sup>	6.6E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	1.50E-03 s/m <sup>3</sup>	4.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	8.00E-04 s/m <sup>3</sup>	1.7E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	6.00E-04 s/m <sup>3</sup>	1.4E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	5.00E-04 s/m <sup>3</sup>	1.2E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 24 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Meteorological Dispersion (X/Q) (continued)</b>			
Passive Containment Cooling System/Reactor Building Roof			
TSC Unfiltered Inleakage and TSC Air Intakes (emergency and normal)			
0–2 hours	2.00E-03 s/m <sup>3</sup>	3.6E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
2–8 hours	1.10E-03 s/m <sup>3</sup>	2.8E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
8–24 hours	5.00E-04 s/m <sup>3</sup>	1.1E-04 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
1–4 days	4.00E-04 s/m <sup>3</sup>	9.3E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
4–30 days	3.00E-04 s/m <sup>3</sup>	7.3E-05 s/m <sup>3</sup>	The Fermi 3 site characteristic value is provided in <a href="#">Table 2.3-301</a> and <a href="#">Table 2.3-378</a> and falls within (is less than) the DCD site parameter value.
<b>Long Term Dispersion Estimates<sup>(12)</sup></b>			
X/Q	1.5E-07 s/m <sup>3</sup>	The site characteristic values for long term (routine release) atmospheric dispersion estimates are based on the maximally exposed individual (MEI) for each pathway.	The site characteristic values for long term (routine release) atmospheric dispersion estimates are defined based on type of sensitive receptor (MEI) and decay time. Each of these values is compared with the appropriate DCD site parameter value, X/Q or D/Q, below. Each site characteristic value that is equal to or less than the DCD site parameter value results in a lower estimated dose for the same source term, and conversely, a higher X/Q or D/Q results in a higher estimated dose.
RB/FB Vent Stack	1.2E-07 s/m <sup>3</sup>		
TB Vent Stack	5.0E-06 s/m		
RWB Vent Stack			

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
D/Q			As shown below, every site characteristic value does not fall within (some are greater than) the DCD site parameter value. Per Note (12) of DCD Table 2.0-1, if a site-specific X/Q value exceeds the site parameter value, the release concentrations in DCD Table 12.2-17 must be adjusted proportionate to the change in X/Q values using the stack release information in DCD Table 12.2-16 to show the 10 CFR 20 limits are met; and the annual average doses in DCD Table 12.2-18b must be changed to show the 10 CFR 50 Appendix I doses are met. Per DCD COL Item 12.2-2-A, calculation bases in DCD Tables 12.2-15 and 12.2-18a are replaced with site-specific values for calculation of airborne concentrations and doses. <a href="#">Table 12.2-15R</a> and <a href="#">Table 12.2-18aR</a> identify the replacement DCD information. This table identifies that there are Fermi 3 site characteristic values that do not fall within (are greater than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	The characteristic values assume conservatively, that each sensitive receptor (meat animal, vegetable garden, residence) is at the location of the closest receptor.	
TB Vent Stack	3.5E-09 m <sup>-2</sup>		
RWB Vent Stack	1.9E-08 m <sup>-2</sup>		
<b>Site Boundary Annual Average</b>			
X/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary undepleted/no decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in <a href="#">Table 2.3-305</a> , <a href="#">Table 2.3-306</a> and <a href="#">Table 2.3-307</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-345</a> , <a href="#">Table 2.3-346</a> , and <a href="#">Table 2.3-347</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	8.7 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	9.6 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m <sup>3</sup>	1.1 × 10 <sup>-5</sup> s/m <sup>3</sup> undepleted/no decay	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 26 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Site Boundary Annual Average (continued)			
X/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary undepleted/2.26-day decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in <a href="#">Table 2.3-305</a> , <a href="#">Table 2.3-306</a> and <a href="#">Table 2.3-307</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-345</a> , <a href="#">Table 2.3-346</a> , and <a href="#">Table 2.3-347</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	8.7 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	9.6 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	1.1 × 10 <sup>-5</sup> s/m <sup>3</sup> undepleted/2.26-day	
X/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary depleted/8.00-day decay X/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in <a href="#">Table 2.3-305</a> , <a href="#">Table 2.3-306</a> and <a href="#">Table 2.3-307</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-345</a> , <a href="#">Table 2.3-346</a> , and <a href="#">Table 2.3-347</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	8.1 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	8.9 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	1.0 × 10 <sup>-5</sup> s/m <sup>3</sup> depleted/8.00-day decay	
D/Q			The site characteristic value for this long term dispersion estimate is defined as the maximum annual average site boundary D/Q value for use in determining gaseous pathway doses to the maximally exposed individual. The site characteristic value is provided in <a href="#">Table 2.3-305</a> , <a href="#">Table 2.3-306</a> and <a href="#">Table 2.3-307</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-345</a> , <a href="#">Table 2.3-346</a> , and <a href="#">Table 2.3-347</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	1.7 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	1.5 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-2</sup>	4.9 × 10 <sup>-8</sup> 1/m <sup>2</sup>	



**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 27 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Annual Average Nearest Residence			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-308</a> , <a href="#">Table 2.3-309</a> and <a href="#">Table 2.3-310</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-348</a> , <a href="#">Table 2.3-349</a> , and <a href="#">Table 2.3-350</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.8 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.2 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	7.0 × 10 <sup>-6</sup> s/m <sup>3</sup> undepleted/no decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-308</a> , <a href="#">Table 2.3-309</a> and <a href="#">Table 2.3-310</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-348</a> , <a href="#">Table 2.3-349</a> , and <a href="#">Table 2.3-350</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.8 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.2 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	7.0 × 10 <sup>-6</sup> s/m <sup>3</sup> undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-308</a> , <a href="#">Table 2.3-309</a> and <a href="#">Table 2.3-310</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-348</a> , <a href="#">Table 2.3-349</a> , and <a href="#">Table 2.3-350</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.3 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.6 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	6.3 × 10 <sup>-6</sup> s/m <sup>3</sup> depleted/8.00-day decay,	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-308</a> , <a href="#">Table 2.3-309</a> and <a href="#">Table 2.3-310</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-348</a> , <a href="#">Table 2.3-349</a> , and <a href="#">Table 2.3-350</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	1.2 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	1.2 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-</sup>	3.4 × 10 <sup>-8</sup> 1/m <sup>2</sup>	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 28 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Annual Average Nearest Meat Animal			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-320</a> , <a href="#">Table 2.3-321</a> and <a href="#">Table 2.3-322</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	4.8 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	4.3 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	1.9 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/no decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-320</a> , <a href="#">Table 2.3-321</a> and <a href="#">Table 2.3-322</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	4.8 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	4.3 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	1.8 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-320</a> , <a href="#">Table 2.3-321</a> and <a href="#">Table 2.3-322</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	4.3 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	3.8 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	1.4 × 10 <sup>-7</sup> s/m <sup>3</sup> depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-320</a> , <a href="#">Table 2.3-321</a> and <a href="#">Table 2.3-322</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is less than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	3.4 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	3.3 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-</sup>	6.4 × 10 <sup>-10</sup> 1/m <sup>2</sup>	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 29 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Annual Average Nearest Garden			
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-311</a> , <a href="#">Table 2.3-312</a> and <a href="#">Table 2.3-313</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-351</a> , <a href="#">Table 2.3-352</a> , and <a href="#">Table 2.3-353</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.8 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.1 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	7.0 × 10 <sup>-6</sup> s/m <sup>3</sup> undepleted/no decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-311</a> , <a href="#">Table 2.3-312</a> and <a href="#">Table 2.3-313</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.8 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.1 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	7.0 × 10 <sup>-6</sup> s/m <sup>3</sup> undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic value for this long term dispersion estimate is provided in <a href="#">Table 2.3-311</a> , <a href="#">Table 2.3-312</a> and <a href="#">Table 2.3-313</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	6.3 × 10 <sup>-7</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.5 × 10 <sup>-7</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	6.3 × 10 <sup>-6</sup> s/m <sup>3</sup> depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic value for this long term dispersion estimate taken is provided in <a href="#">Table 2.3-311</a> , <a href="#">Table 2.3-312</a> and <a href="#">Table 2.3-313</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-360</a> , <a href="#">Table 2.3-361</a> , and <a href="#">Table 2.3-362</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values do not fall within (is greater than) all of the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	1.2 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	1.1 × 10 <sup>-8</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-</sup>	3.4 × 10 <sup>-8</sup> 1/m <sup>2</sup>	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 30 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Annual Average Nearest Milk Cow			
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-323</a> , <a href="#">Table 2.3-324</a> and <a href="#">Table 2.3-325</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-363</a> , <a href="#">Table 2.3-364</a> , and <a href="#">Table 2.3-365</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	8.4 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.6 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	3.4 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/no decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-323</a> , <a href="#">Table 2.3-324</a> and <a href="#">Table 2.3-325</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-363</a> , <a href="#">Table 2.3-364</a> , and <a href="#">Table 2.3-365</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	8.4 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	7.5 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	3.3 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-323</a> , <a href="#">Table 2.3-324</a> and <a href="#">Table 2.3-325</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-363</a> , <a href="#">Table 2.3-364</a> , and <a href="#">Table 2.3-365</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	7.7 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.8 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	2.8 × 10 <sup>-7</sup> s/m <sup>3</sup> depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-323</a> , <a href="#">Table 2.3-324</a> and <a href="#">Table 2.3-325</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-363</a> , <a href="#">Table 2.3-364</a> , and <a href="#">Table 2.3-365</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	9.5 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	8.9 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-</sup>	1.7 × 10 <sup>-9</sup> 1/m <sup>2</sup>	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Sheet 31 of 31)**

[EF3 COL 2.0-1-A]

Subject <sup>(16)</sup>	DCD Site Parameter Value <sup>(1)(16)</sup>	Fermi 3 Site Characteristic	Evaluation
<b>Long Term Dispersion Estimates (continued)</b>			
Annual Average Nearest Milk Goat			
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-317</a> , <a href="#">Table 2.3-318</a> and <a href="#">Table 2.3-319</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-357</a> , <a href="#">Table 2.3-358</a> , and <a href="#">Table 2.3-359</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	7.7 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.9 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	3.0 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/no decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-317</a> , <a href="#">Table 2.3-318</a> and <a href="#">Table 2.3-319</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-357</a> , <a href="#">Table 2.3-358</a> , and <a href="#">Table 2.3-359</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	7.7 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.9 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	3.0 × 10 <sup>-7</sup> s/m <sup>3</sup> undepleted/2.26-day decay	
X/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-317</a> , <a href="#">Table 2.3-318</a> and <a href="#">Table 2.3-319</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-357</a> , <a href="#">Table 2.3-358</a> , and <a href="#">Table 2.3-359</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	1.5E-07 s/m <sup>3</sup>	7.0 × 10 <sup>-8</sup> s/m <sup>3</sup>	
TB Vent Stack	1.2E-07 s/m <sup>3</sup>	6.1 × 10 <sup>-8</sup> s/m <sup>3</sup>	
RWB Vent Stack	5.0E-06 s/m	2.4 × 10 <sup>-7</sup> s/m <sup>3</sup> depleted/8.00-day decay	
D/Q			The Fermi 3 site characteristic values for this long term dispersion estimate is provided in <a href="#">Table 2.3-317</a> , <a href="#">Table 2.3-318</a> and <a href="#">Table 2.3-319</a> (based on the 2002-2007 met data) and <a href="#">Table 2.3-357</a> , <a href="#">Table 2.3-358</a> , and <a href="#">Table 2.3-359</a> (based on the 1985-1989 met data). The Fermi 3 site characteristic values fall within (is smaller than) the DCD site parameter values. See <a href="#">Section 12.2</a> for the site-specific concentration and dose analysis inputs and results.
RB/FB Vent Stack	4.8E-09 m <sup>-2</sup>	8.4 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
TB Vent Stack	3.5E-09 m <sup>-2</sup>	7.9 × 10 <sup>-10</sup> 1/m <sup>2</sup>	
RWB Vent Stack	1.9E-08 m <sup>-</sup>	1.5 × 10 <sup>-9</sup> 1/m <sup>2</sup>	

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Notes) (Sheet 1 of 2)**

[EF3 COL 2.0-1-A]

1. The site parameters defined in this table are applicable to Seismic Category I, II, and Radwaste Building structures, unless noted otherwise.
2. Probable maximum flood level (PMF), as defined in Table 1.2-6 of Volume III of DCD Reference 2.0-4.
3. Maximum speed selected is based on Attachment I of Reference 2.0-5, which summarizes the NRC Interim Position on RG 1.76. Concrete structures designed to resist Spectrum I missiles of SRP 3.5.1.4, Rev. 2, will also resist missiles postulated in RG 1.76, Revision 1. Tornado missiles do not apply to Seismic Category NS and Seismic Category II buildings. For the Radwaste building, the tornado missiles defined in Regulatory Guide 1.143, Table 2, Class RW-IIa apply. The hurricane missile spectrum for the Seismic Category NS and Seismic Category II structures that house RTNSS equipment is consistent with the tornado missile spectrum identified in this table. See DCD Tables 19A-3 and 19A-4 for additional details
4. Based on probable maximum precipitation (PMP) for one hour over 2.6 km<sup>2</sup> (one square mile) with a ratio of 5 minutes to one hour PMP of 0.32 as found in DCD Reference 2.0-3. See also DCD Table 3G.1-2.
5. See DCD Reference 2.0-9 for the definition of normal winter precipitation and extreme winter precipitation events. The maximum ground snow load for extreme winter precipitation event includes the contribution from the normal winter precipitation event. See also DCD Table 3G.1-2.
6. Zero percent exceedance values are based on conservative estimates of historical high and low values for potential sites. They represent historical limits excluding peaks of less than one hour: which are conservative relative to DCD Reference 2.0-4. One and two percent exceedance values were selected in order to bound the values presented in DCD Reference 2.0-4 and available Early Site Permit applications.
7. At the foundation level of Seismic Category I structures, the dynamic bearing pressure is the toe pressure. The maximum static bearing demand is compared with the site-specific allowable static bearing pressure, which is obtained by dividing the ultimate soil bearing capacity by a factor of safety appropriate for the design load combination. The maximum dynamic bearing demand is compared with the site-specific allowable dynamic bearing pressure, which is obtained by dividing the ultimate soil bearing capacity by a factor of safety appropriate for the design load combination. When a site specific shear wave velocity is between soft soil and medium soil the larger of the soft or medium maximum dynamic bearing demand will be used. When a site-specific shear wave velocity is between medium soil and hard soil the larger of the medium or hard maximum dynamic bearing demand will be used. Alternatively, for soils with a site-specific shear wave velocity a linearly interpolated dynamic bearing demand between soft and medium soil or between medium and hard soil can be used. The shear wave velocities of soft, medium and hard soils are 300 m/sec (1000 ft/sec), 800 m/sec (2600 ft/sec) and greater than or equal to 1700 m/sec (5600 ft/sec), respectively.
8. This is the minimum shear wave velocity of the supporting foundation material and material surrounding the embedded walls associated with seismic strains for lower bound soil properties at minus one sigma from the mean. The ratio of the largest to the smallest shear wave velocity over the mat foundation width of the supporting foundation material does not exceed 1.7.
9. Safe Shutdown Earthquake (SSE) design ground response spectra of 5% damping, also termed Certified Seismic Design Response Spectra (CSDRS), are defined as free-field outcrop spectra at the foundation level (bottom of the base slab) of the Reactor/Fuel and Control Building structures. For the Firewater Service Complex, which is essentially a surface founded structure, the CSDRS is 1.35 times the values shown in DCD Figures 2.0-1 and 2.0-2 and is defined as free-field outcrop spectra at the foundation level (bottom of the base slab) of the Firewater Service Complex structure.
10. Values reported here are actually design criteria rather than site parameters. They are included here because they don't appear elsewhere in the DCD.

**Table 2.0-201 Evaluation of Site/Design Parameters and Characteristics (Notes) (Sheet 2 of 2)**

[EF3 COL 2.0-1-A]

11. If a selected site has a X/Q value that exceeds the ESBWR reference site value, the COL applicant will address how the radiological consequences associated with the controlling design basis accident continue to meet the dose reference values provided in 10 CFR 52.79(a)(1)(vi) and control room operator dose limits provided in General Design Criterion 19 using site-specific X/Q values.
12. If a selected site has a X/Q value that exceeds the ESBWR reference site value, the release concentrations in DCD Table 12.2-17 would be adjusted proportionate to the change in X/Q values using the stack release information in DCD Table 12.2-16. In addition, for a site selected that exceeds the bounding X/Q or D/Q values, the COL applicant will address how the resulting annual average doses (DCD Table 12.2-18b) continue to meet the dose reference values provided in 10 CFR 50 Appendix I using site-specific X/Q and D/Q values.
13. Values were selected to comply with expected requirements of southeastern coastal locations, which include the consideration of hurricanes as described in ASCE 7-02. Wind speeds are considered to be at 10 m (33 ft) above ground per ASCE 7-02. Seismic Category NS buildings that house RTNSS equipment are designed to withstand hurricane Category 5 wind velocity at 87.2 m/s (195 mph), 3-second gust, and missiles generated by that wind velocity. See DCD Tables 19A-3 and 19A-4 for additional details.
14. Localized liquefaction potential under other than Seismic Category I structures is addressed per SRP 2.5.4 in DCD Table 2.0-2.
15. Settlement values are long-term (post-construction) values except for differential settlement within the foundation mat. The design of the foundation mat accommodates immediate and long-term (post-construction) differential settlements after the installation of the basemat.
16. Information in this column and notes (1) through (15) are from DCD Table 2.0-1. In these notes, "DCD" was added before cited tables, figures, and references from the DCD.

Figure 2.0-201

**Horizontal and Vertical RB/FB Enhanced SCOR FIRS and CSDRS**  
**[5 Percent Damping] (FIRS are developed in Subsection 3.7.1)**  
[EF3 COL 2.0-1-A]

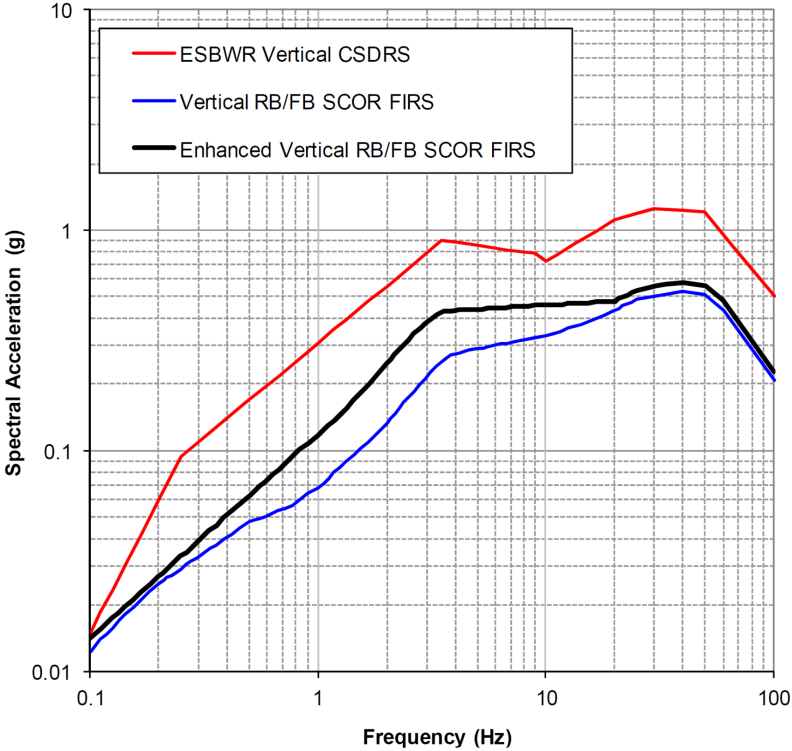
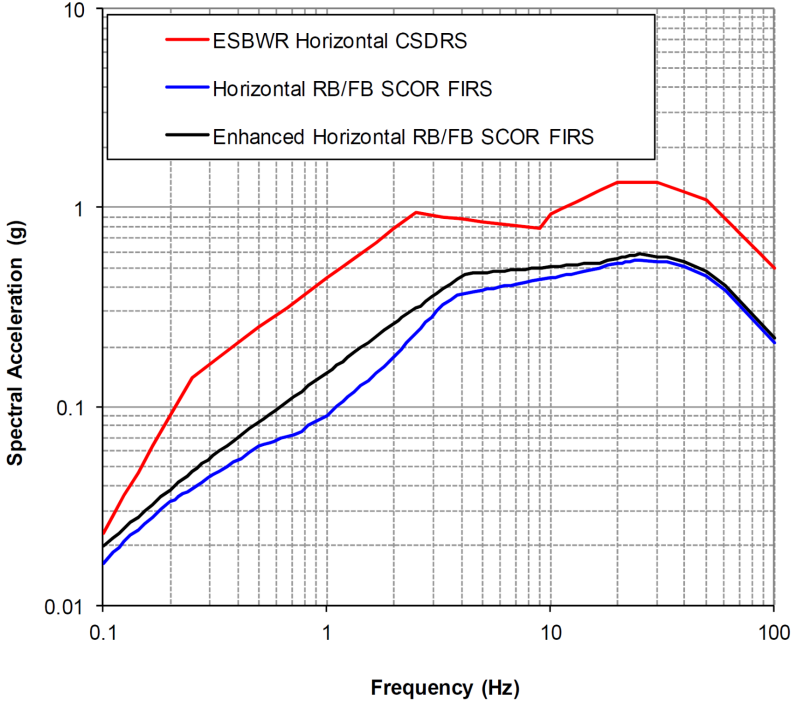




Figure 2.0-202

**Horizontal and Vertical CB Enhanced SCOR FIRS and CSDRS  
[5 Percent Damping] (FIRS are developed in Subsection 3.7.1)  
[EF3 COL 2.0-1-A]**


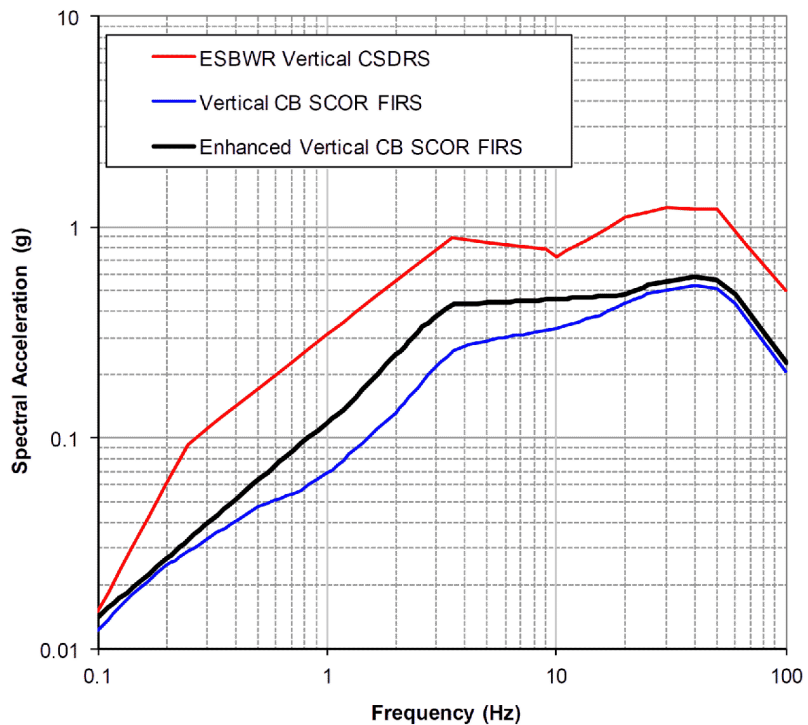


Figure 2.0-203

**Horizontal and Vertical FWSC FIRS and 1.35 Times the CSDRS  
[5 Percent Damping] (FIRS are developed in Subsection 3.7.1)**

[EF3 COL 2.0-1-A]

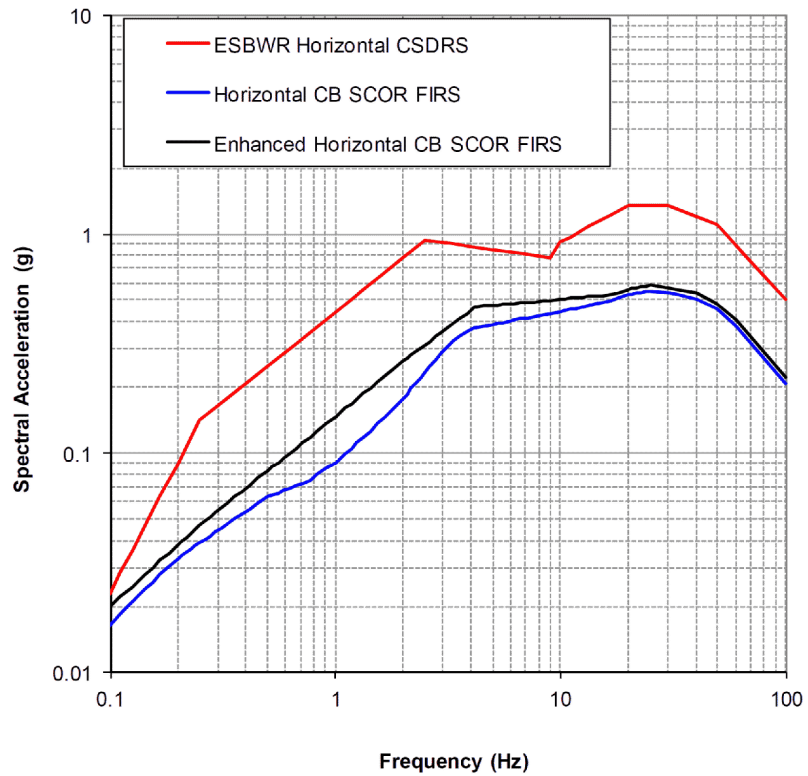