

TVA

**WALL THICKNESS
PROFILE SHEET**

REPORT NO:


R-P0149

PROJECT: WBN
UNIT: 2


WELD NO: ECF-C3-2
SYSTEM: RCS

Record Thickness Measurements As Indicated, including Weld Width, Edge-To-Edge At 0°

Position	0°	90°	180°	270°
1	<i>NA</i>	<i>NA</i>	<i>NA</i>	<i>NA</i>
2	<i>3.97</i>	<i>NA</i>	<i>3.72</i>	<i>3.62</i>
3	<i>3.58</i>	<i>2.29</i>	<i>3.48</i>	<i>3.31</i>
4	<i>3.21</i>	<i>3.17</i>	<i>3.24</i>	<i>3.20</i>
5	<i>2.93</i>	<i>2.99</i>	<i>2.93</i>	<i>2.94</i>

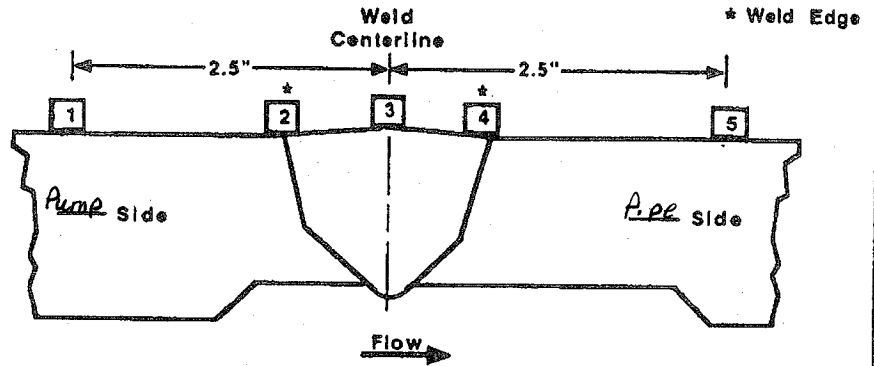

CROWN HEIGHT: Flush DIAMETER: 310
CROWN WIDTH: 2.75 WELD LENGTH: 105.5

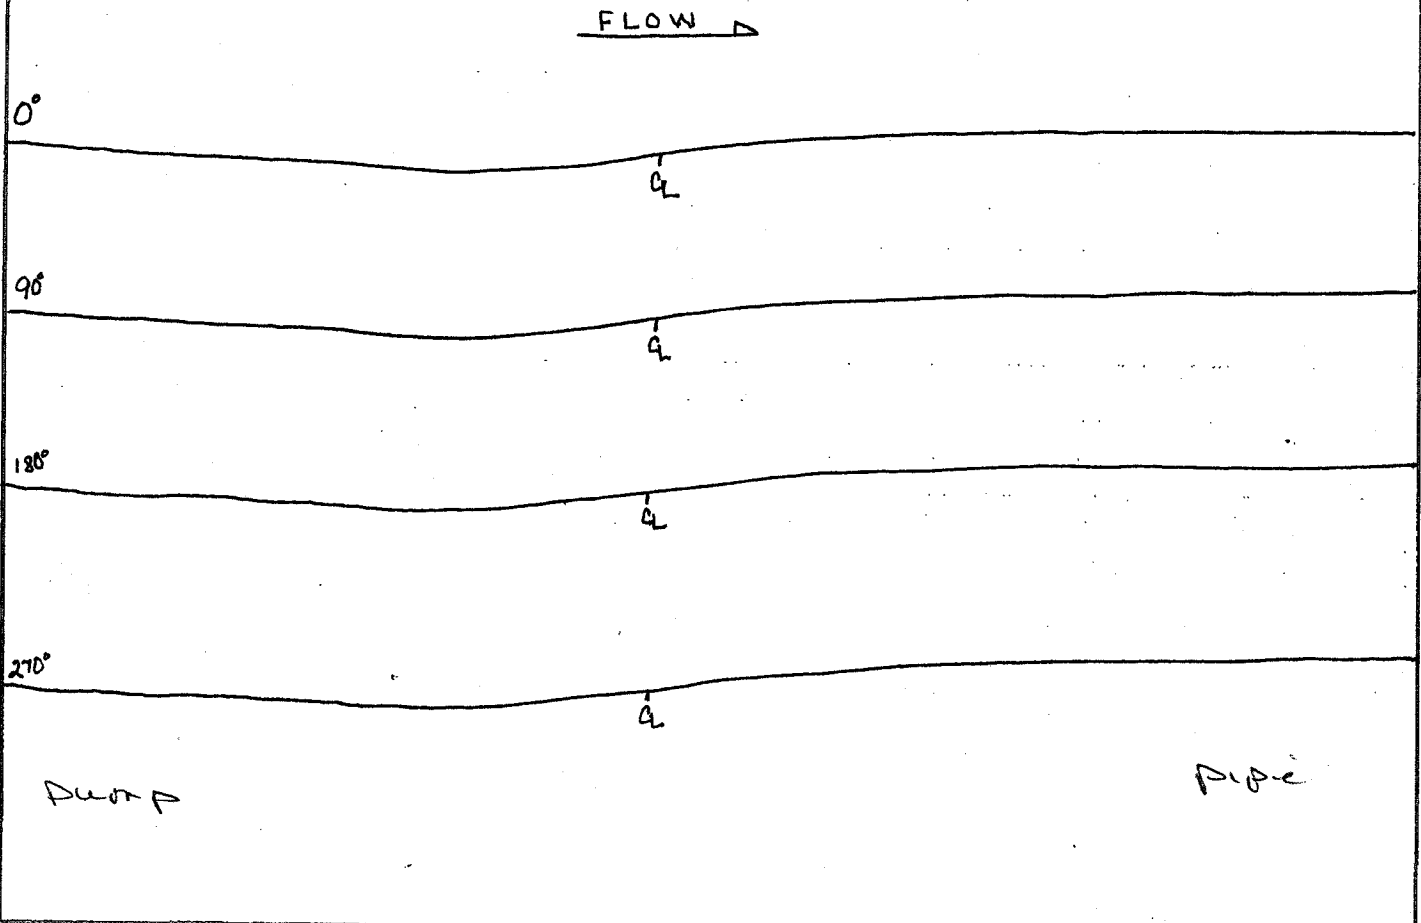

EXAMINER: Marcie Kalkbrenner
LEVEL: II
DATE: 2/4/2009

REVIEWED BY: *[Signature]*
LEVEL: III DATE: 2-17-09

ANII: *[Signature]*
DATE: 3/9/09
PAGE 4 OF 5

TVA

Office of Nuclear Power

PROJECT: WBN


SYSTEM: RCS

REPORT NO.:

UNIT: 2

WELD NO: RCE-C3-2

R-20149

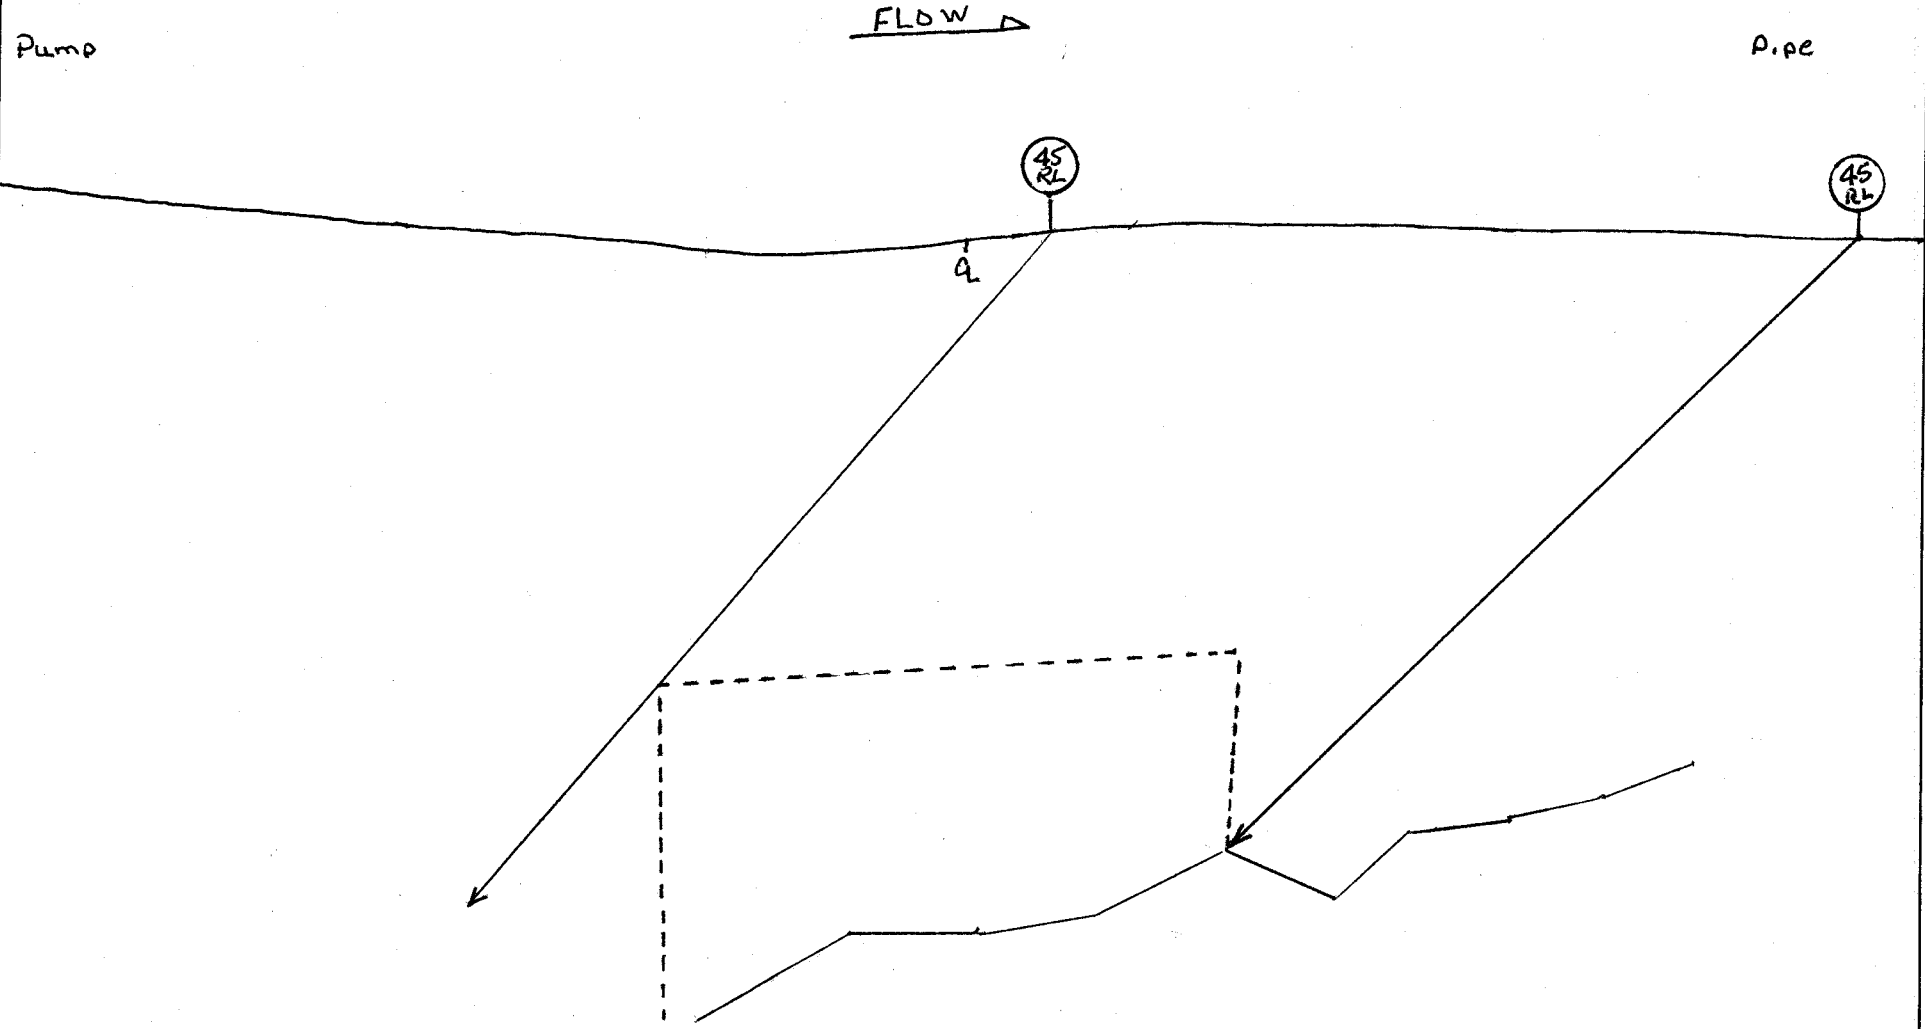

BY: Marcie Kalkbrenner / Marcie Kalkbrenner

LEVEL: II

DATE: 2/4/2009

PAGE 5 OF 5