

TVA

Office of Nuclear Power

PROJECT: WBN SYSTEM: SIS (063)

UNIT: 2 WELD NO: SIF-B-T142-25


REPORT NO.:

R. P2477

FLANGE

← FLOW

PIPE

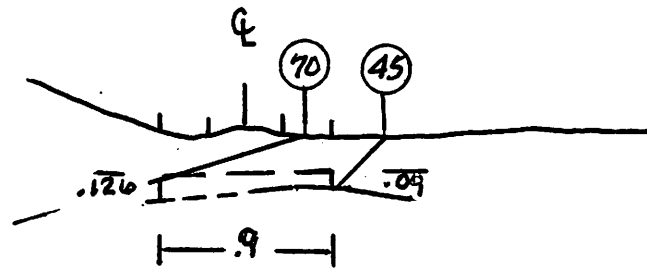

50% one sided examination
code credit coverage achieved.

BY: (Paul Augusto) LEVEL: () DATE: 03-18-15 PAGE 4 OF (7)

TVA

WALL THICKNESS
PROFILE SHEET

REPORT NO:

R.P2477

PROJECT: WBN


WELD NO: SIF-B-T142-25

UNIT: 2


SYSTEM: SIS (063)

Record Thickness Measurements As Indicated, Including Weld Width, Edge-To-Edge At 0°

| Position | 0° | 90° | 180° | 270° |
|----------|------|-----|------|------|
| 1 | .322 | | | |
| 2 | .282 | | N | |
| 3 | .326 | | | |
| 4 | .436 | | | A |
| 5 | * | | | |

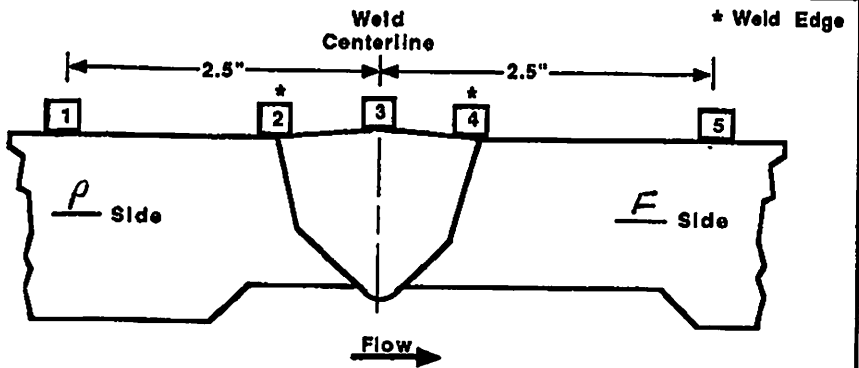

CROWN HEIGHT: .10 DIAMETER: 1.50
 CROWN WIDTH: .40 WELD LENGTH: 6.5

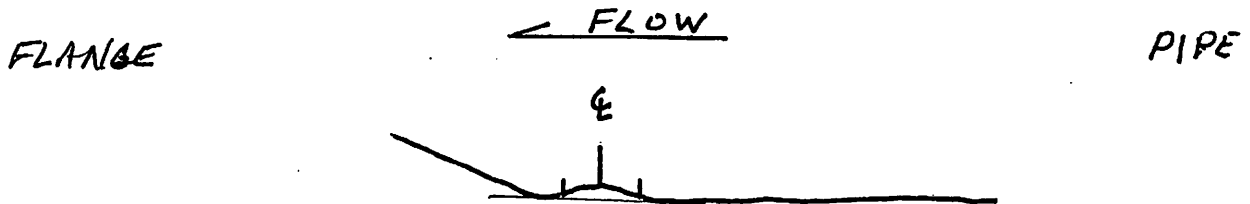

EXAMINER: Mike Cleland
 LEVEL: II
 DATE: 03-18-15

REVIEWED BY: Darlene DeLong
 LEVEL: III DATE: 5/6/15

ANII: Andrew Sletto
 DATE: 7-28-15
 PAGE 5 OF 7