


1 2 3 4 5 6 7



EXTENT OF FIRE RATED SLAB

#9 @ 12" E.W. T.&B.
TYP. 2'-9" THK. SLAB
REINFORCING STEEL

WALL ABOVE

FIRE RATED
WALL BELOW

P

EXTENT OF FIRE
RATED SLAB

W16x36

W18x64 (-1'-9")

ELEVATOR
SHAFT

W36x245

W24x130
EL. 776'-10"

W24x130
EL. 776'-10"

EL. 773'-4" 2MK8

EL. 773'-4" 2MK828
DN TO EL. 756'-6"

W24x76

29'-0"

EL. 772'-11" 2PHB33
DN TO EL. 737'-4"

EL. 772'-11" 2PKB
EL. 771'-5" 2KK8

EL. 771'-5" 2KHB32
DN TO EL. 743'-7"

EL. 771'-7" 2PKB
EL. 771'-1" 2KK8

(SHT. 3) ↑ B

W30x112 **

W18x50
WALL ABOVE

WALL BELOW

EL. 772'-2" 2PKB
EL. 770'-8" 2KK8

WALL BELOW

WALL ABOVE

(SHT. 3) ↑ A

(SHT. 3) ↑ B

W24x130 EL. 776'-10"

EL. 773'-4" 2KK828
DN TO EL. 756'-6"

EL. 773'-4" 2KK828
DN TO EL. 756'-6"

EL. 773'-4" 2KK8

2'-9" SLAB 1'-9" SLAB

Q

** BG-310-4
(-1'-9")

** BG-310-3
(-1'-9")

EL. 771'-2" 2KLP41
UP TO EL. 786'-7"

#8 @ 12" E.W. T.&B.
TYP. 1'-9" THK. SLAB
REINFORCING STEEL

WALL ABOVE GIRDER

EL. 756'-0" 2KKH

1'-9" THK. SLAB 2'-9" THK. SLAB

MATCH LINE
(SEE SHT. 2)

37.4

36


34.5

** MINIMUM REQUIRED MEMBERS
FOR THIS FIRE RATED FL. SLAB.
FIRE ZONE ABOVE FIRE RATED FLOOR
SLAB: 2-6A.
FIRE ZONE BELOW FIRE RATED FLOOR
SLAB: 2-5C & 2-5D.

CABLE TRAY - ALL TRAYS ARE
24" WIDE OR LESS, UNLESS
NOTED OTHERWISE.

CROSS HATCHING REPRESENTS
FIRE RATED FLOOR SLAB.

PART PLAN BELOW EL. 779'-1
T.O.S. EL. 777'-4 O.N.O.
SCALE: 1/4" = 1'-0"

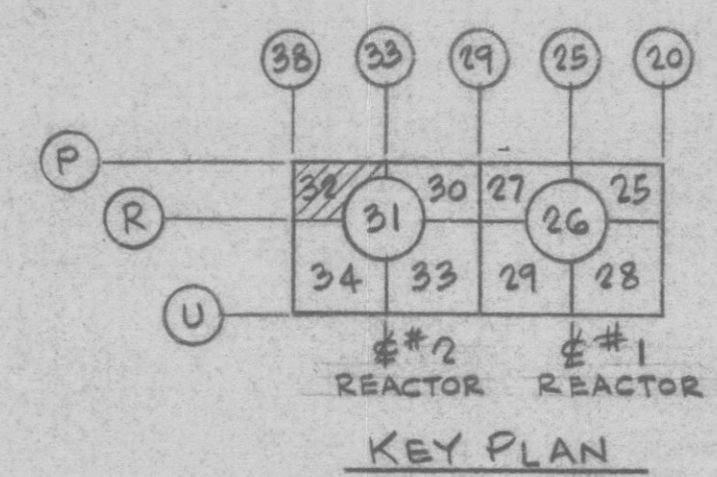

C-227	E-105257
C-310	E-105317
E-32-5	E-107639 SH.5
AE DRAWING NO.	PP&L DRAWING NO.
REFERENCE DRAWINGS	
TI APERTURE CARD	
0 INITIAL ISSUE	W D T N O F X H TAG %/4/4
REV	DESCRIPTION DR CH APPROVED DATE
NON-QUALITY RELATED DWG CLASS 3	
SUSQUEHANNA S.E.S. UNIT #2	
REACTOR BUILDING APPENDIX R-DEVIATION REQ. #6 FIRE RATED FL. SLAB EL. 779'-1	
AREA 32	ELEV. 779'-1 SCALE: NOTED
PENNSYLVANIA POWER & LIGHT COMPANY ALLENTOWN PA.	
PP&L DRAWING NO.	SHEET NO. REV. NO.
C-206015	1 0
AE DRAWING NO.	C-1775

PP&L FORM 3505C (1/84)

60712

3611 060 298 C