

FIRE AREA KEY PLAN
HATCHED AREA

* ALL CABLES REGARDLESS OF DIVISION OR SAFETY-RELATED DESIGNATION MUST BE PROTECTED.


SECTION B-B
(SEE DUG. E-200987)

SECTION A-A
(SEE DUG. E-200987)

SECTION D-D
(SEE DUG. E-200987)

NOTES
1.) PROTECTED SAFE SHUTDOWN PATH (I.E. DIVISION) IS DEFINED AS THOSE SAFE SHUTDOWN CABLES AND COMPONENTS WHICH MUST BE PROTECTED FROM FIRE DAMAGE WITHIN THE DESIGNATED FIRE ZONE. WHERE BOTH DIVISIONS ARE SHOWN, BOTH DIVISIONS MUST BE PROTECTED.

DEVIATION REQUEST NO. 14 FIRE ZONES WITHOUT FIRE DETECTION

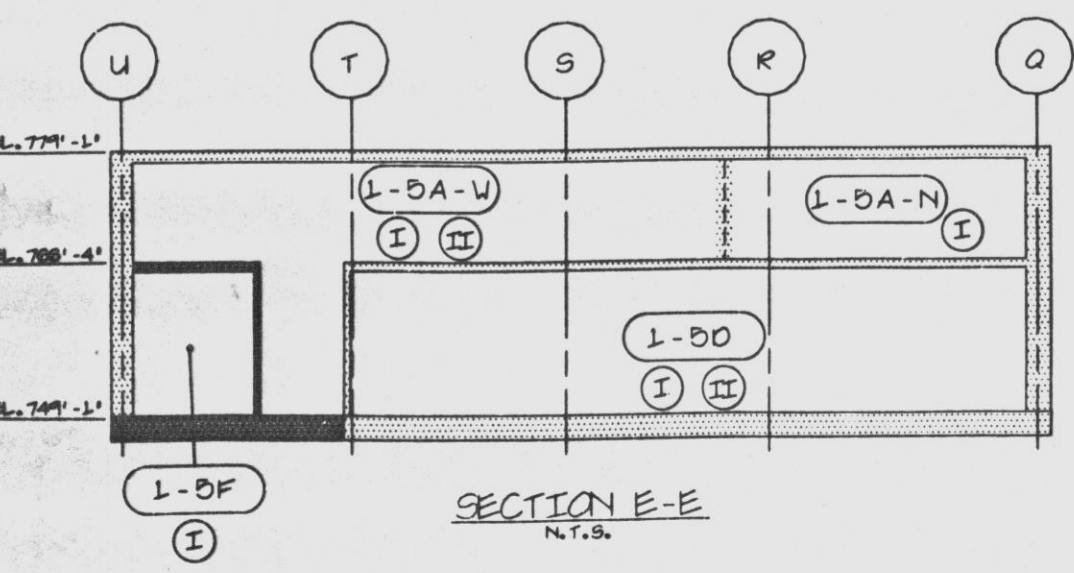

SECTION E-E
N.T.S.

LEGEND

- FIRE ZONES
- ① DIVISION I PROTECTED SAFE SHUTDOWN PATH
- ② DIVISION II PROTECTED SAFE SHUTDOWN PATH
- ▨ 3 HR. FIRE-RATED WALLS
- ▨ FIRE RATED FLOORS
- ◇ FIRE DOOR NUMBER
- ▬ FIRE ZONE BOUNDARY

DO NOT TEMPORARILY OR PERMANENTLY STORE, PLACE OR INSTALL ANY COMBUSTIBLE MATERIALS IN THIS AREA. TRANSIENT CONDUCTIBLES SHALL BE RESTRICTED IN THIS AREA.

INFERRED CONTAINMENT BOUNDARY

FIRE DAMPER

FIRE DAMPER PPO-RATING-12-2-1
FIRE RATING
1/2 = 1 1/2 HR. RATING
3 = 3 HR. RATING
3P = 3 HR. RATING PRELIMINARY OPER. TYPE.

REV.	DESCRIPTION	OR	CHK	APPROVED DATE
4	ADDED SECTION C-G	BDR	DW	11/87
3	INCORP. DCN 10 (87-4670)	BDR	DN	11/87
2	PER ENGINEERING INFO.	BDR	DN	11/87
1	PER ENGINEERING INFO.	BDR	DN	11/87
0	INITIAL ISSUE	BDR	DN	11/87
	NON-QUALITY RELATED			

A-15	E-184302, SHT. S
C-1886	E-213485
C-1739	E-205988
C-1738	E-205987
C-1737	E-205988
C-1736	E-205985

PPAL DRAWING NO.	SHEET NO.	REV. NO.
E-205953	1	4
NE DRAWING NO.	SHEET NO.	REV. NO.
C-1724	1	4

30X I CERTIFY THAT THE IMAGE CONTAINED ON THIS FRAME WAS MADE TO THE NORMAL AND REGULAR COURSE OF BUSINESS ON THE DATE STATED BELOW, AND THAT IT IS AN ACCURATE REPRODUCTION OF THE DOCUMENT SUBMITTED TO THIS CORRESPONDENCE AND DRAWING FILES.
DATE: 12/15/87
[Signature]

SI APERTURE CARD

8812200257 *D*