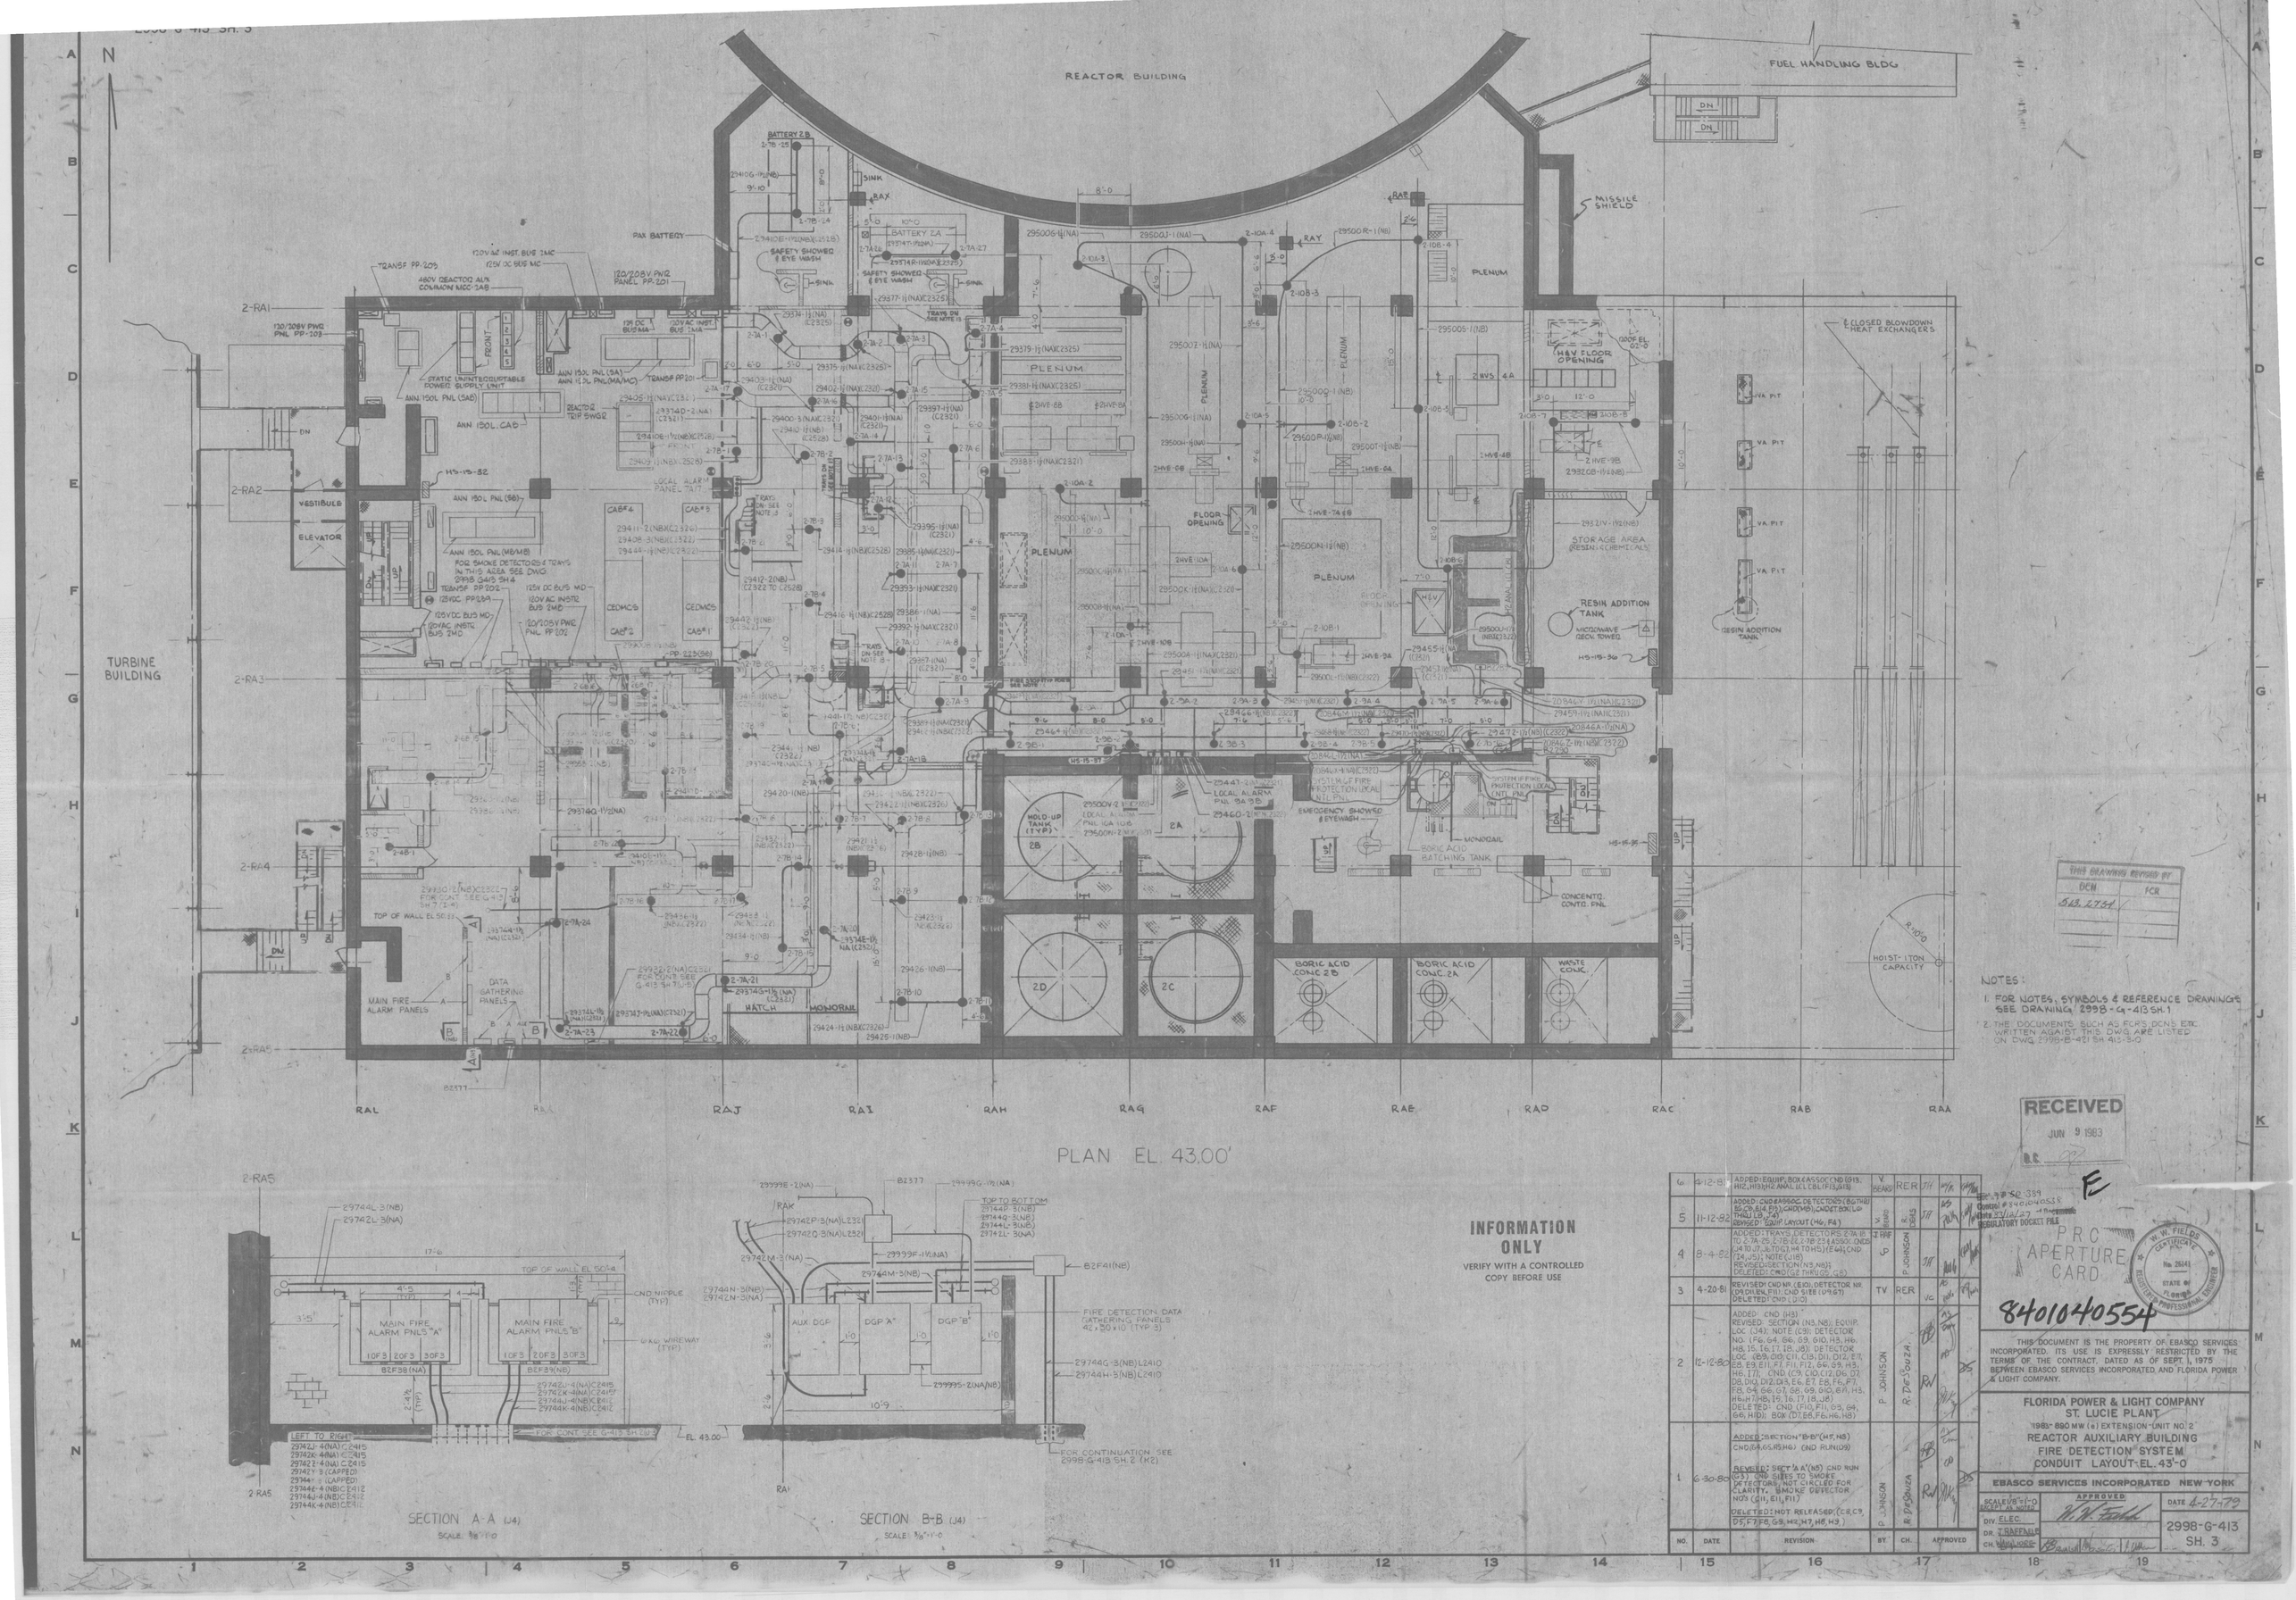

PLAN EL 43.00'

INFORMATION ONLY

VERIFY WITH A CONTROLLED COPY BEFORE USE

NO.	DATE	REVISION	BY	CH.	APPROVED
6	4-12-83	ADDED: EQUIP. BOX & ASSOC CND (G13, H12, H13) & H/C ANAL. LCL CBL (F13, G13)	V. BEARD	RER	JTH
5	11-12-82	ADDED: CND & ASSOC. DETECTORS (B6 THRU B8, C6, E14, F9); CND (M5) & CNDET 25K (LIP THRU L8, L4). REVISED: EQUIP LAYOUT (H6, F4)	V. BEARD	RER	JTH
4	8-4-82	ADDED: TRAYS, DETECTORS 2-7A-18 TO 2-7A-25, 2-7B-6 & 2-7B-23 & 2593C CNDS (J4, J10, J11, J12, M4 TO M5) (E6), CND (J4, J5); NOTE (J18). REVISED: SECTION (N3, N8); DELETED: CND (G2 THRU 8, G6)	P. JOHNSON	RER	JTH
3	4-20-81	REVISED: CND NR. (E10), DETECTOR NR. (D9, D11, E4, F11), CND SIZE (D9, G7) DELETED: CND (J10)	TV	RER	VC
2	12-12-80	ADDED: CND (H3) REVISED: SECTION (N3, N8); EQUIP. LOC (J4); NOTE (C9); DETECTOR NO. (F6, G4, G6, G9, G10, H3, H6, H8, I5, I6, I7, I8, J8); DETECTOR LOC. (B9, C10) C11, C13, D11, D12, E7, E8, E9, E11, F7, F11, F12, G6, G9, H3, H6, I7); CND. (C9, C10, C12, D6, D7, D8, D10, D12, D13, E6, E7, E8, F6, F7, F8, G4, G6, G7, G8, G9, G10, G11, H3, H6, H7, H8, I5, I6, I7, I8, J8). DELETED: CND (F10, F11, G5, G4, G6, H10); BOX (D7, E8, F6, H6, H8)	P. JOHNSON	R. D'SOUZA	RW
1	6-30-80	ADDED: SECTION "B-B" (H5, N8) CND (G4, G5, H3, H6) (IND RUN 09). REVISED: SECT "A-A" (N5) CND RUN (G3). CND SIZES TO SMOKE DETECTORS, NOT CIRCLED FOR CLARITY. SMOKE DETECTOR NOS. (J11, E11, F11). DELETED: NOT RELEASED (C8, C9, D5, F7, F8, G5, H5, J7, H8, H9)	P. JOHNSON	R. D'SOUZA	RW

THIS DRAWING REVISED BY

DCN	FCR
543, 2751	

NOTES:

1. FOR NOTES, SYMBOLS & REFERENCE DRAWINGS SEE DRAWING 2998-G-413 SH. 1
2. THE DOCUMENTS SUCH AS FCR'S, DCN'S ETC. WRITTEN AGAINST THIS DWG ARE LISTED ON DWG 2998-B-421 SH 413-3.0

RECEIVED
JUN 9 1983

Rec'd by SC 389
Control # 8401040538
Date 5/16/27
REGULATORY DOCKET FILE

P.R.C. APERTURE CARD

8401040554

W. W. FIELDS CERTIFICATE No. 2641 STATE OF FLORIDA REGISTERED PROFESSIONAL ENGINEER

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF SEPT. 1, 1975 BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1983 - 890 MW (e) EXTENSION - UNIT NO. 2
REACTOR AUXILIARY BUILDING
FIRE DETECTION SYSTEM
CONDUIT LAYOUT - EL. 43'-0

EBASCO SERVICES INCORPORATED NEW YORK

SCALE 1/8"=1'-0 (EXCEPT AS NOTED)
DIV. ELEC.
DR. T. RAFFAELE
CH. W. HOPE

APPROVED: W. W. Fields
DATE 4-27-79

2998-G-413 SH. 3