8770-G-078
SHEET 164

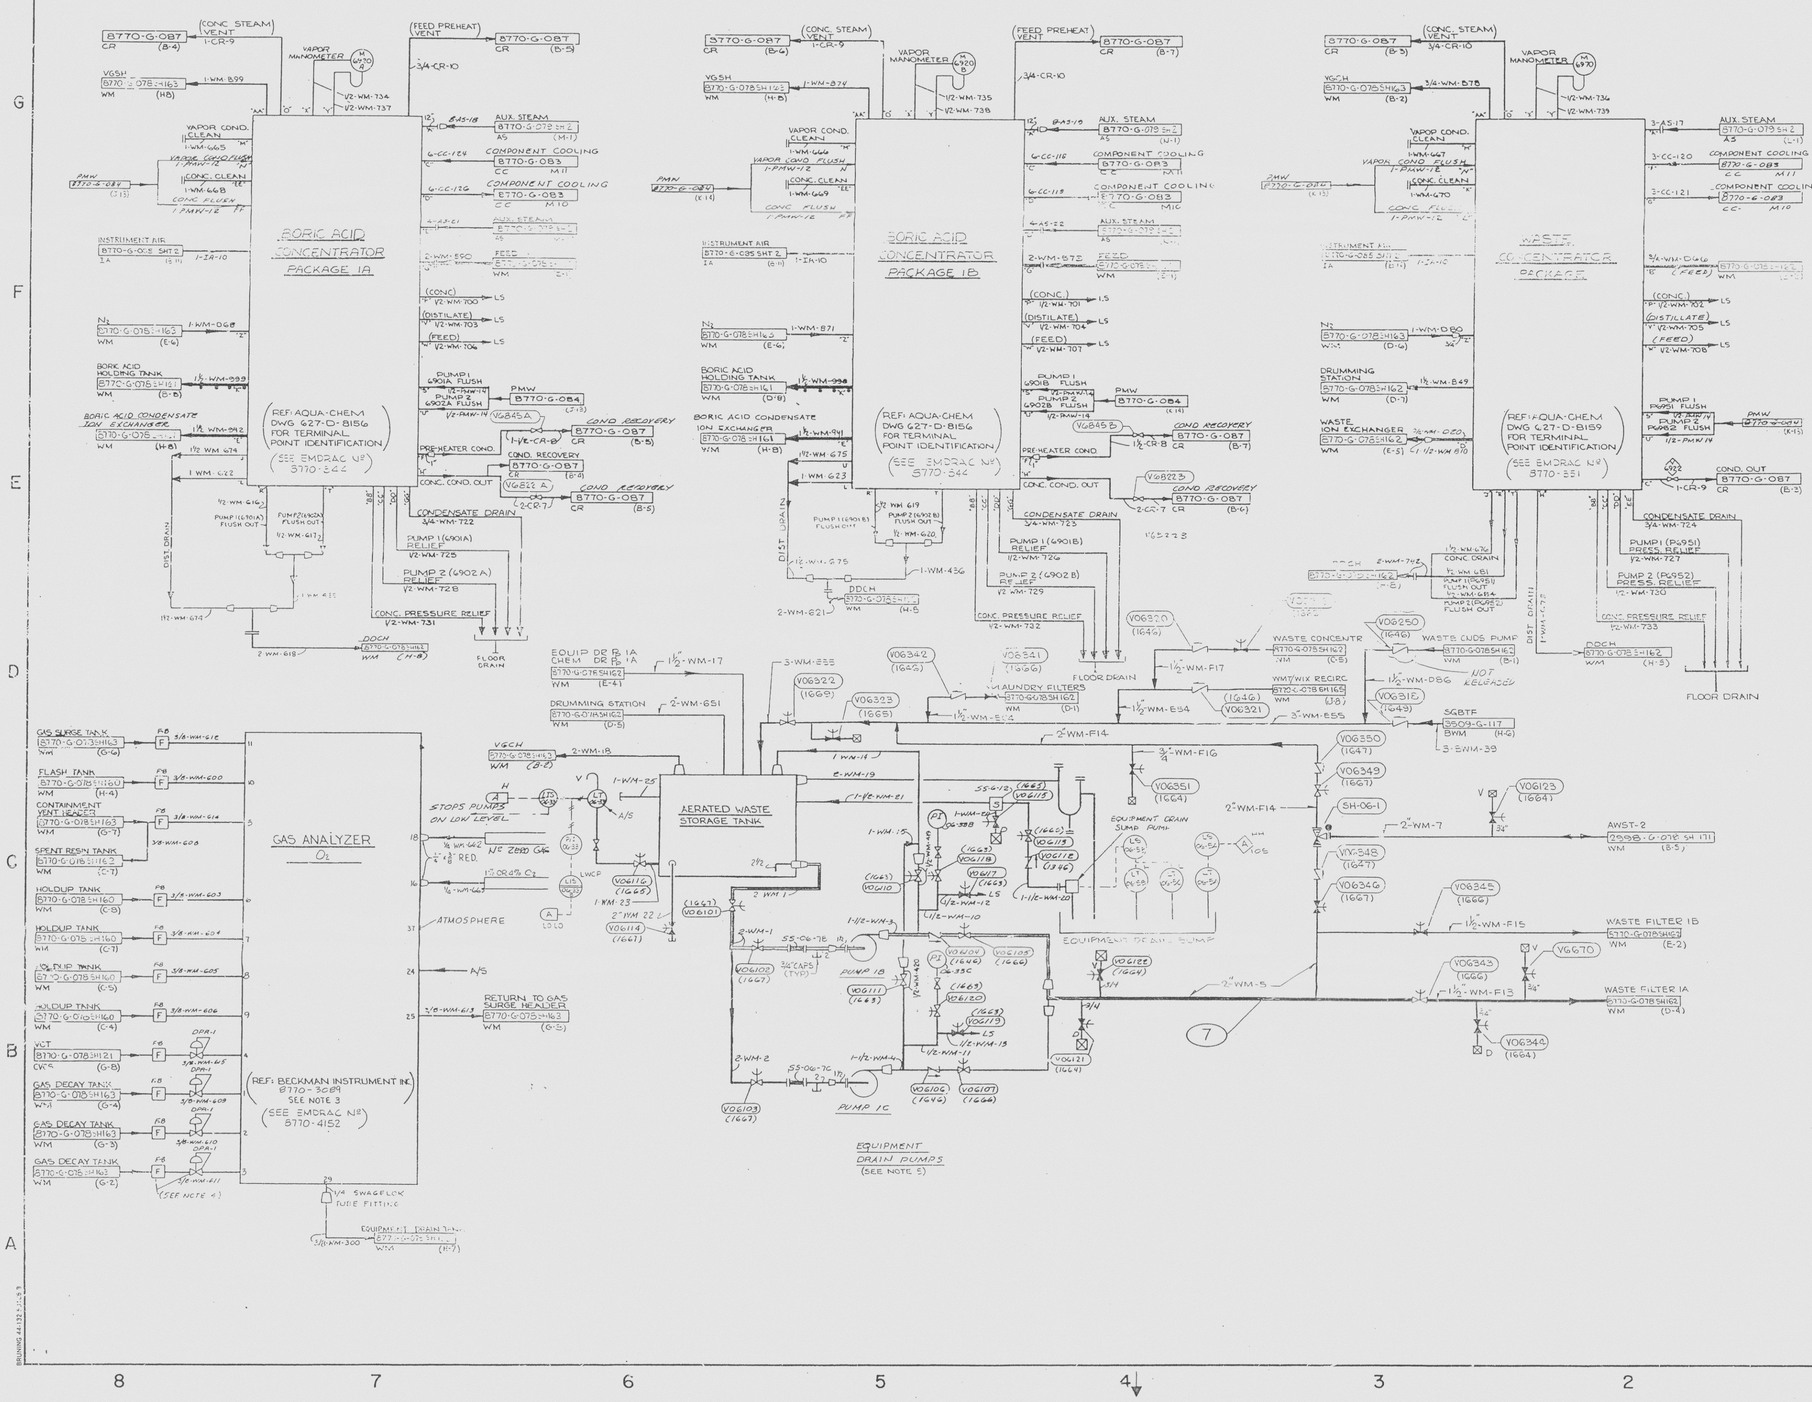

REVISIONS					
NO	DATE	DESCRIPTION	BY	CH	APPROVED
0	7-27-81	THE FOLLOWING CHANGES MADE PER [illegible] TO DRAWING ISSUE: GEN. OR DWG NOS TO EBASCO DWG NOS WHERE APPLICABLE (NOT CIRCLED) PCM-215-77 ADDED (D-6) PIPING PCM-77 REVISED (D-5) PIPING	MF	E	[illegible]
3	11/14/84	PCM 138-186 REV (B7) DWG NO. GEN REV (C2) DWG NO. (C7) NAME, (E4, E7) VA. NO'S	PK	NA	[illegible]
4	4/27/84	APP'D BY V.F. RUBANO FL PE #43127 PCM 220-188 REV (C3, C4) INSTRUMENTATION, ADD (C4) NOTE GEN REV (A9) NOTE NO.	WW	NA	[illegible]
5	1/10/84	PCM 250-191 A REV (B5) TAG NUMBER	RB	TJ	[illegible]
6	10/4/84	PCM 253-192 DEL (D6, E3) HEAT TRACING LINE DESIGNATION	GM	[illegible]	[illegible]
7	8-2-85	DCR-SLM-54-057 REV (C2) SHEET NUMBER CONTINUATIONS & COORDINATES	[illegible]	[illegible]	[illegible]

NOTES:

1 FOR SYMBOLS AND ABBREVIATION SEE REFERENCE DWG 8770-G-078 SH. 100
2 FOR ADDITIONAL WASTE MANAGEMENT SHEETS SEE DWGS 8770-G-078 SH. 160, 161, 162, 163 & 165
3 FILTERS AND PRESSURE REGULATORS ARE FURNISHED BY ANALYZER VENDOR BUT ARE TO INSTALLED EXTERNAL TO ANALYZER
4 FILTERS F-8 AND PRESSURE REGULATORS DPR-1 ARE IDENTIFIED ON BECKMAN INSTRUMENTS INC. CUSTOMER CHECK LIST FOR DWG SEE C/AE 12389-5 SPEC 632015 (8770-4152)
5 FOR PUMP VENTS & DRAINS, SEE 8770-G-078 SH. 105
6 ALL PIPING QUALITY GROUP "D"

REVISION OF THIS DRAWING MAY REQUIRE UPDATE OF THE FOLLOWING DOCUMENT:
FSAR-FIG. 11.2-48

⚠ THE DESIGN INFORMATION FOR THE CHANGES SHOWN IN THIS REVISION HAS BEEN ENGINEERED BY FLORIDA POWER & LIGHT COMPANY.

THE INFORMATION SHOWN ON REVISION [illegible] OF THIS DRAWING HAS BEEN PHOTOGRAPHICALLY REPRODUCED FROM [illegible] DRAWING NO. [illegible], REVISION 8 (EMDRAC NO 8770-6512 [illegible], REVISION 9) AND EBASCO SERVICES INCORPORATED BEARS NO RESPONSIBILITY FOR THE DESIGN INFORMATION SHOWN.

THIS DOCUMENT IS THE PROPERTY OF EBASCO SERVICES INCORPORATED. ITS USE IS EXPRESSLY RESTRICTED BY THE TERMS OF THE CONTRACT, DATED AS OF AUGUST 10, 1968, BETWEEN EBASCO SERVICES INCORPORATED AND FLORIDA POWER & LIGHT COMPANY.

FLORIDA POWER & LIGHT COMPANY
ST. LUCIE PLANT
1976-850,000 KW INSTALLATION UNIT No. 1

FLOW DIAGRAM
WASTE MANAGEMENT SYSTEM
(SHEET-5)

EBASCO SERVICES INCORPORATED

SCALE: N/A	APPROVED	DATE 7-27-81	
DIV MECH	[signature]	8770-G-078	
DR M. FEDYAK		SHEET 164	7
CH F. PAGAN	[signature]		

9701270078-09

E