

Don/06/78

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)
DISTRIBUTION FOR INCOMING MATERIAL 50-335

REC: OREILLY J P
NRC

ORG: SCHMIDT A D
FL PWR & LIGHT

DOC DATE: 08/28/78
DATE RCVD: 09/05/78

DOCTYPE: LETTER NOTARIZED: NO
SUBJECT:

COPIES RECEIVED
LTR 1 ENCL 1

FORWARDING LICENSEE EVENT REPT (RO 50-335/78-026) ON 07/30/78 CONCERNING
DURING PWR OPERATION, THE DIGITAL DATA PROCESSING SYSTEM MANLFUNCTIONED,
RESULTING IN LOSS OF CEA BACKUP POSITION INDICATION AND THE INCORE FLUX
DETECTOR SYSTEM USED TO MONITOR FLUX D

Detector

PLANT NAME: ST LUCIE #1

REVIEWER INITIAL: XJM
DISTRIBUTOR INITIAL:

***** DISTRIBUTION OF THIS MATERIAL IS AS FOLLOWS *****

INCIDENT REPORTS
(DISTRIBUTION CODE A002)

FOR ACTION: BR CHIEF ORR#4 BC**W/4 ENCL

INTERNAL:

REG FILE**W/ENCL
I & E**W/2 ENCL
I & C SYSTEMS BR**W/ENCL
NOVAK/CHECK**W/ENCL
AD FOR ENG**W/ENCL
HANAUER**W/ENCL
AD FOR SYS & PROJ**W/ENCL
ENGINEERING BR**W/ENCL
KREGER/J. COLLINS**W/ENCL
K SEYFRIT/IE**W/ENCL

NRC PDR**W/ENCL
MIPC**W/3 ENCL
EMERGENCY PLAN BR**W/ENCL
EEB**W/ENCL
PLANT SYSTEMS BR**W/ENCL
AD FOR PLANT SYSTEMS**W/ENCL
REACTOR SAFETY BR**W/ENCL
VOLLMER/BUNCH**W/ENCL
POWER SYS BR**W/ENCL

EXTERNAL:


LPDR'S
FT PIERCE, FL**W/ENCL
NSIC**W/ENCL
ACRS CAT B**W/16 ENCL

DISTRIBUTION: LTR 44 ENCL 44
SIZE: 1P+1P


CONTROL NBR: 782480132

Ad 4
60

***** THE END *****

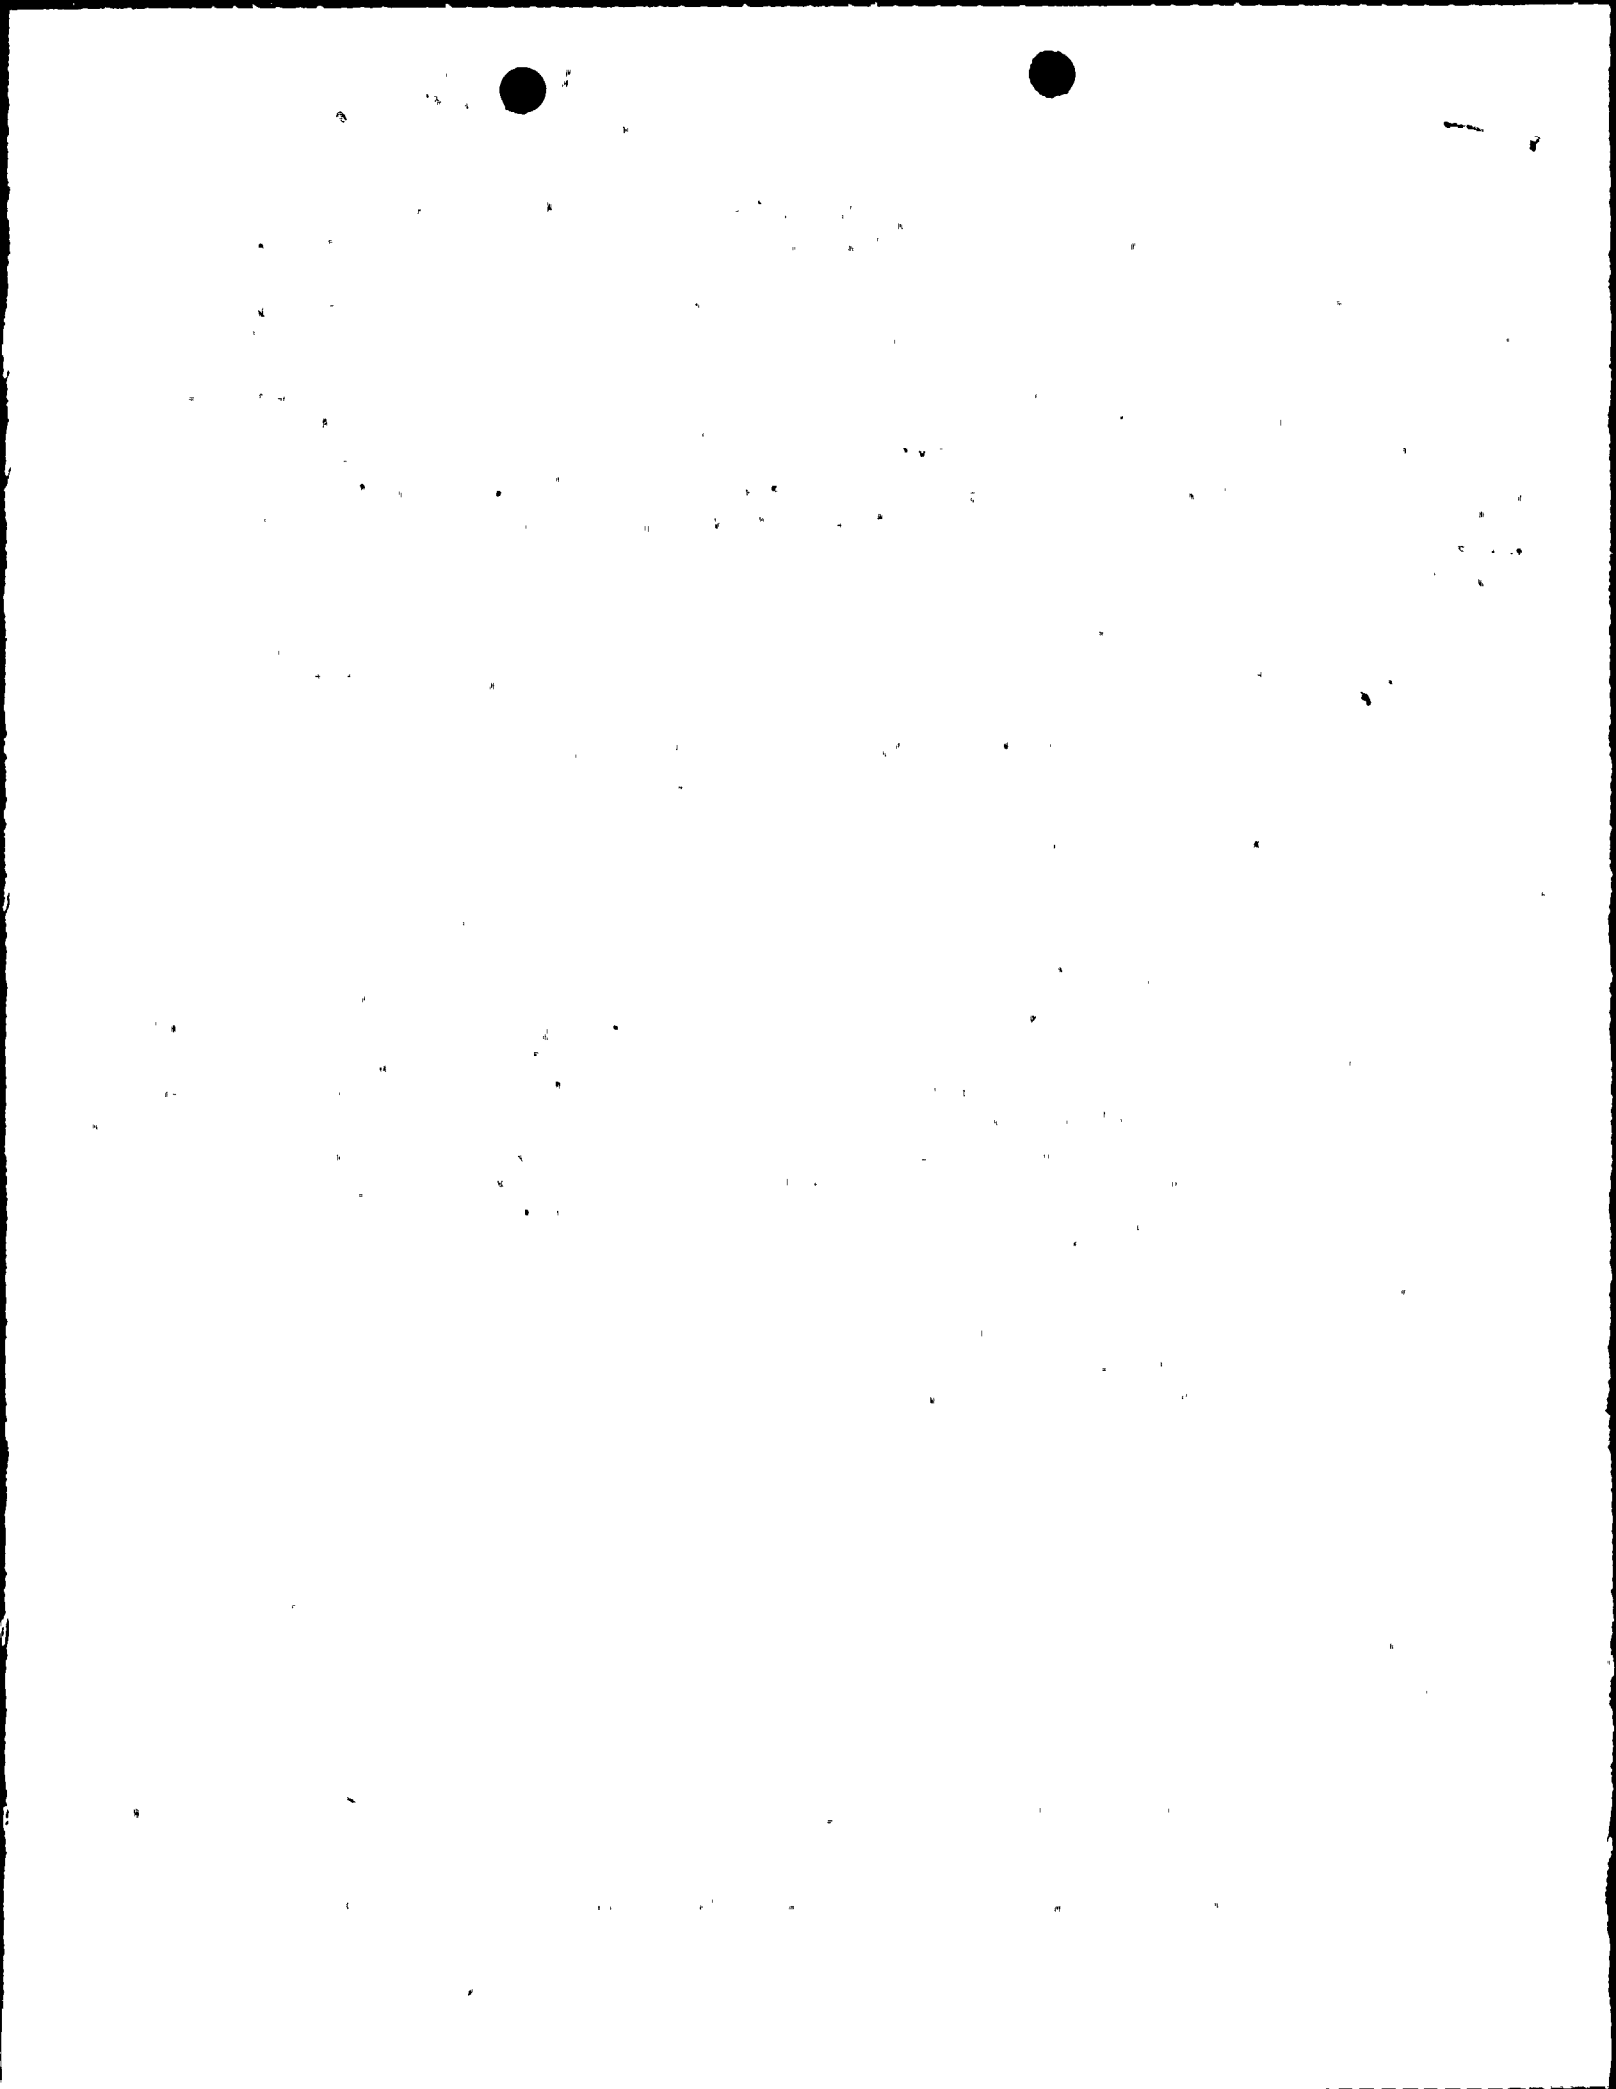

REGISTRATION NUMBER 12000-1217

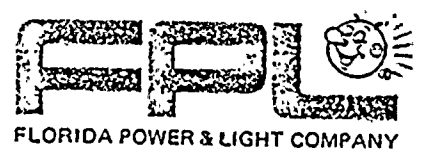

August 28, 1978

PRN-LI-78-236

REC'D
REGISTRATION
DIVISION

Mr. James P. O'Reilly, Directory, Region II
Office of Inspection and Enforcement
U.S. Nuclear Regulatory Commission
230 Peachtree Street, N.W., Suite 1217
Atlanta, Georgia 30303

Dear Mr. O'Reilly:

REPORTABLE OCCURRENCE 335-78-26
ST. LUCIE UNIT 1
DATE OF OCCURRENCE: JULY 30, 1978

TECHNICAL SPECIFICATION 3.1.3.3
DIGITAL DATA PROCESSING SYSTEM

The attached Licensee Event Report is being submitted in accordance with Technical Specification 6.9 to provide 30-day notification of the subject occurrence.

Very truly yours,

for *JR Beusen*
A.D. Schmidt
Vice President
Power Resources

MAS/sn

Attachment

cc: Harold F. Reis, Esquire
Director, Office of Inspection and Enforcement (30)
Director, Office of Management Information and Program Control (3)

782480132

A002
5/11

Handwritten marks and scribbles in the top right corner.