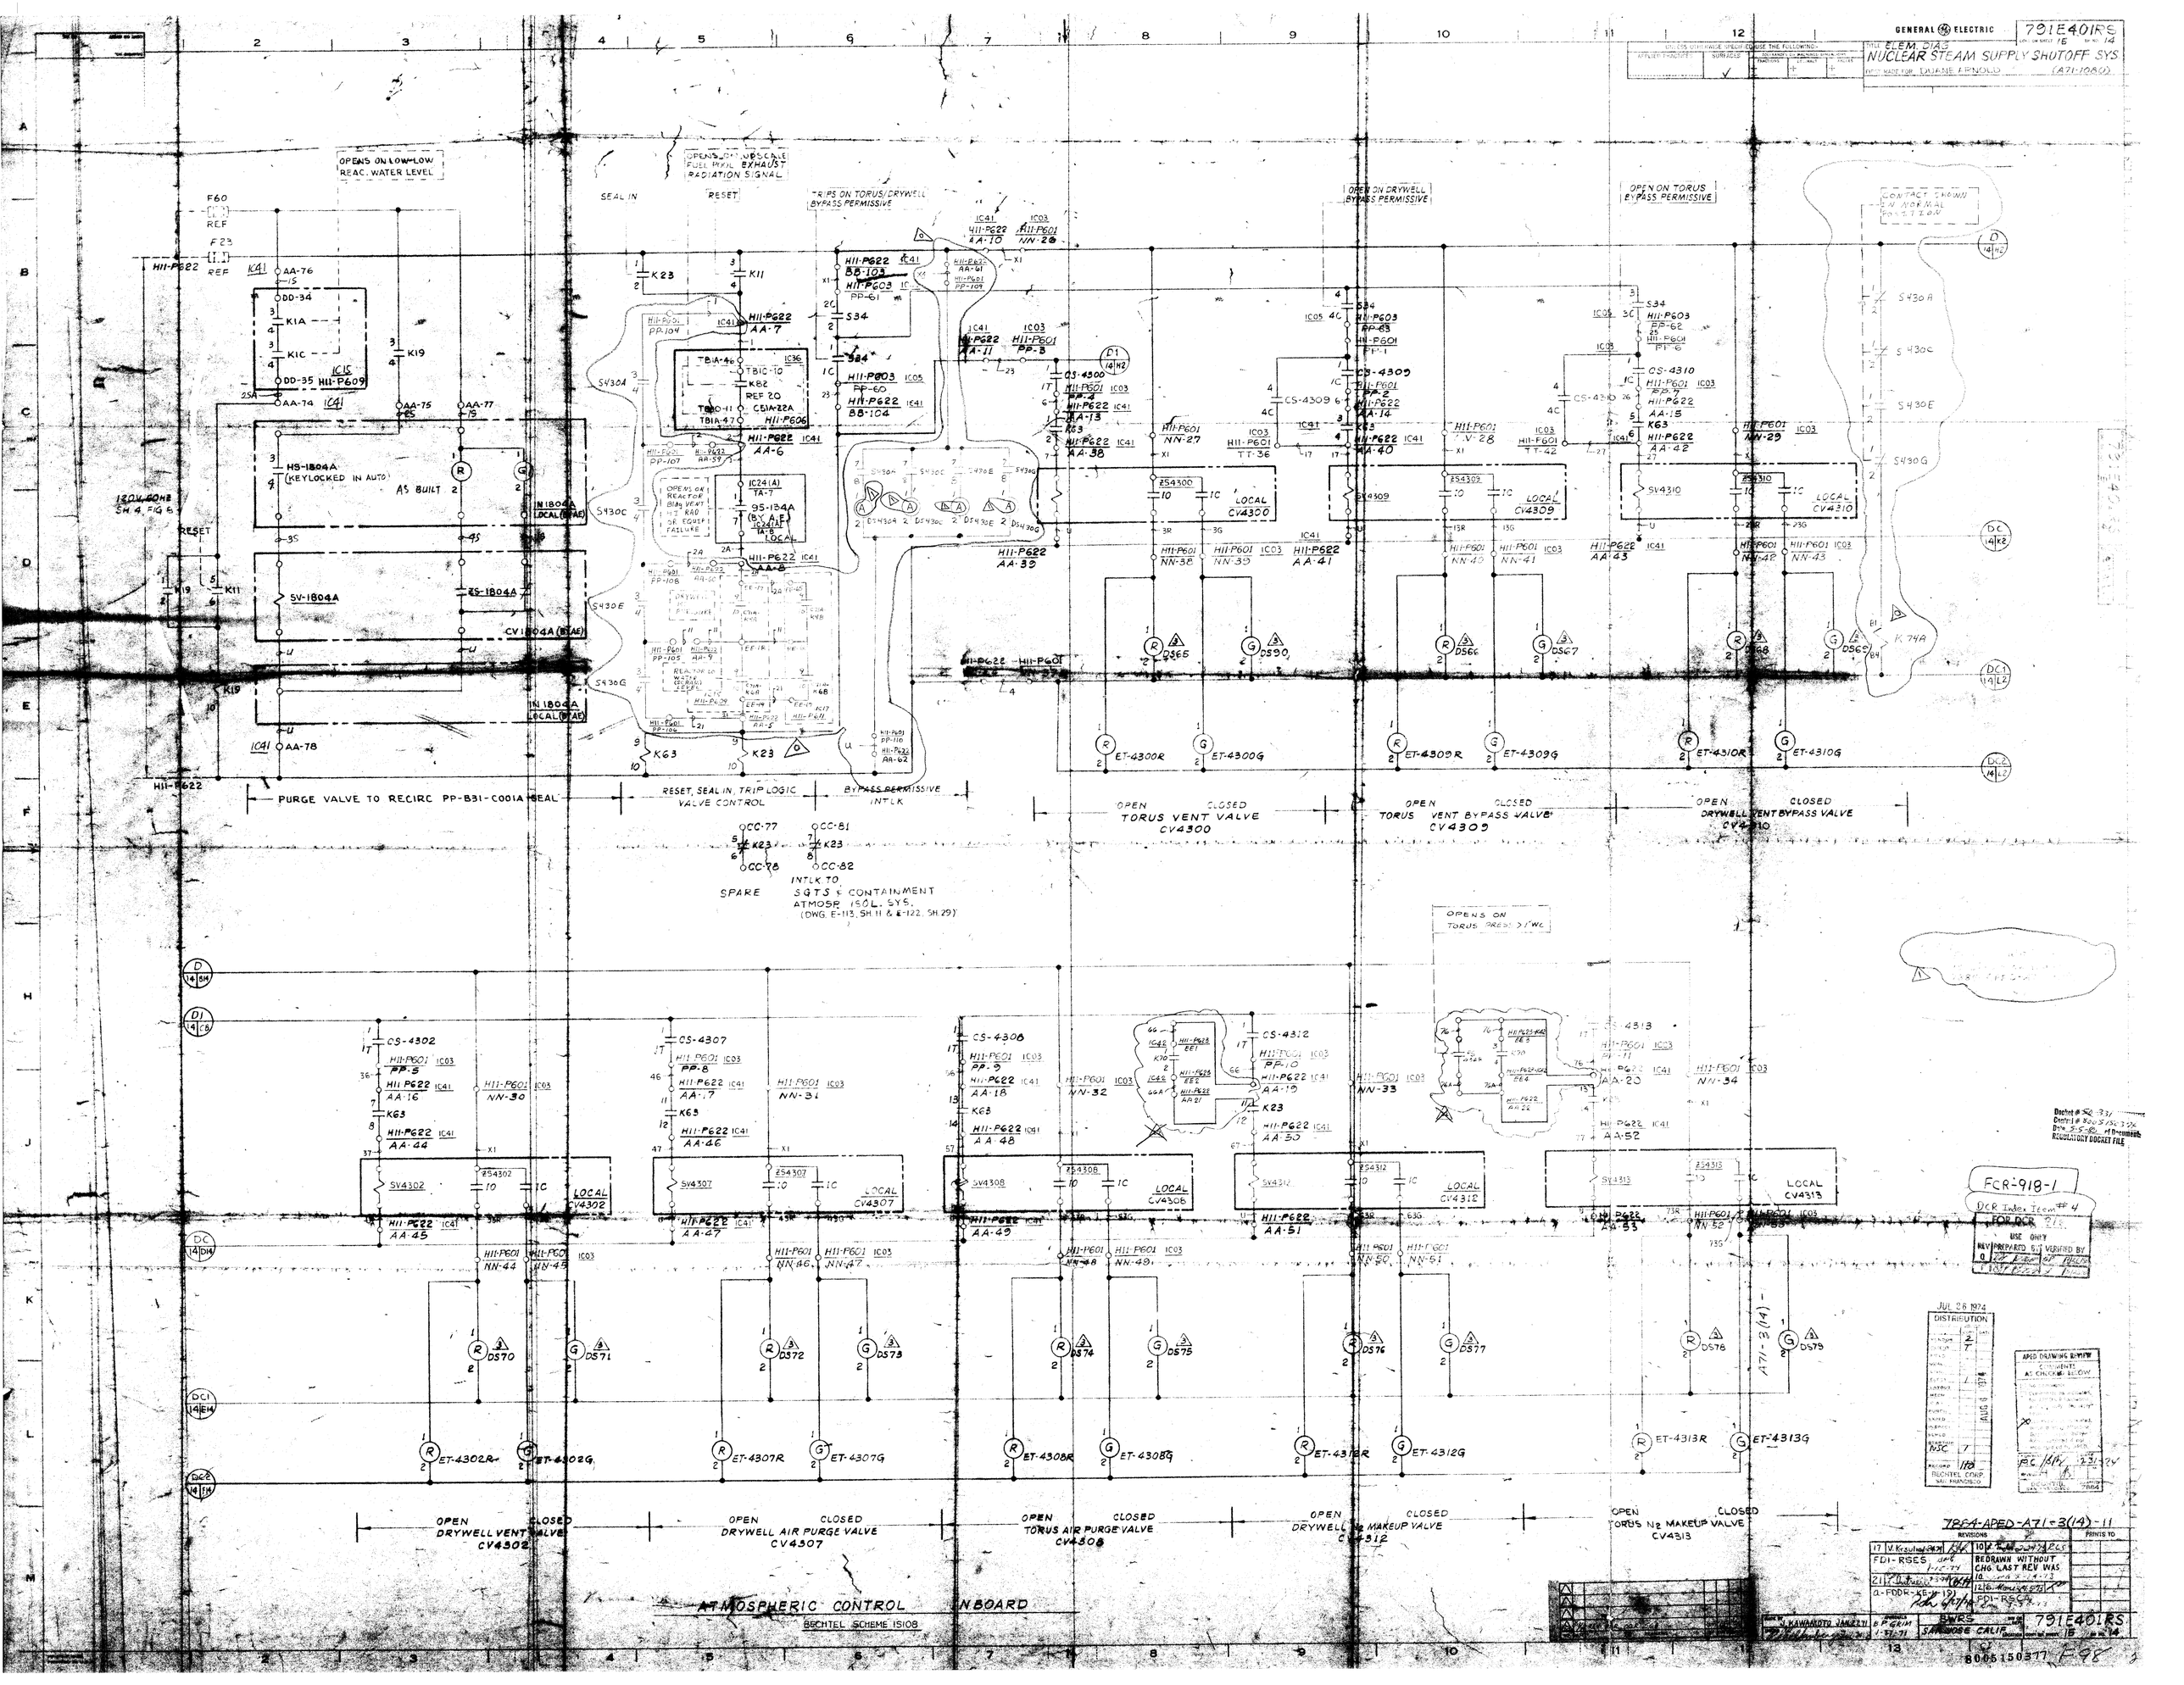
GENERAL ELECTRIC
791E401RS
ELEM. DIAG
NUCLEAR STEAM SUPPLY SHUTOFF SYS
OPENS ON LOW-LOW REAC. WATER LEVEL
OPENS ON LOW SCALE FUEL POOL EXHAUST RADIATION SIGNAL
TRIPS ON TORUS/DRYWELL BYPASS PERMISSIVE
OPEN ON DRYWELL BYPASS PERMISSIVE
OPEN ON TORUS BYPASS PERMISSIVE
CONTACT SHOWN IN NORMAL POSITION
PURGE VALVE TO RECIRC PP-B31-C001A SEAL
RESET, SEAL IN, TRIP LOGIC VALVE CONTROL
BYPASS PERMISSIVE INTLK
OPEN CLOSED TORUS VENT VALVE CV4300
OPEN CLOSED TORUS VENT BYPASS VALVE CV4309
OPEN CLOSED DRYWELL VENT BYPASS VALVE CV4310
SPARE
INTLK TO SGTS & CONTAINMENT ATMOSP. ISOL. SYS. (DWG. E-113, SH. 11 & E-122, SH. 29)
OPENS ON TORUS PRESS >1" WC
OPEN CLOSED DRYWELL VENT VALVE CV4302
OPEN CLOSED DRYWELL AIR PURGE VALVE CV4307
OPEN CLOSED TORUS AIR PURGE VALVE CV4308
OPEN CLOSED DRYWELL N2 MAKEUP VALVE CV4312
OPEN CLOSED TORUS N2 MAKEUP VALVE CV4313
ATMOSPHERIC CONTROL INBOARD
BECHTEL SCHEME 15108
FCR-918-1
DCR Index Item #4
FOR DCR
USE ONLY
JUL 26 1974
DISTRIBUTION
APED DRAWING REVIEW
COMMENTS AS CHECKED BELOW
7864-APED-A71-3(14)-11
REVISIONS
FDI-RSES
REDRAWN WITHOUT CHG. LAST REV WAS
FDI-RSCA
BWRS
SAN JOSE CALIF
791E401RS
8005150377